

STATE OF MAINE

Department of Environmental Protection

Paul R. LePage GOVERNOR

Patricia W. Aho COMMISSIONER

July 10, 2015

Mr. Thomas D. Gentner, P.E. Vice President
Maine Electronics, Inc.
19 Saint Anne Street
Lisbon, ME. 04250

e-mail: thomas.gentner@rockwellcollins.com

RE:

Maine Pollutant Discharge Elimination System (MEPDES) Permit #ME0020427

Maine Waste Discharge License (WDL) #W007759-5S-G-R

Final Permit

Dear Mr. Gentner:

Enclosed please find a copy of your final MEPDES permit and Maine WDL renewal which was approved by the Department of Environmental Protection. Please read this permit/license renewal and its attached conditions carefully. You must follow the conditions in the order to satisfy the requirements of law. Any discharge not receiving adequate treatment is in violation of State Law and is subject to enforcement action.

Any interested person aggrieved by a Department determination made pursuant to applicable regulations, may appeal the decision following the procedures described in the attached DEP FACT SHEET entitled "Appealing a Commissioner's Licensing Decision."

If you have any questions regarding the matter, please feel free to call me at 287-7693.

Sincerely,

Gregg Wood

Division of Water Quality Management

Bureau of Water Quality

Enc.

cc:

Denise Behr, DEP/CMRO

Sandy Mojica, USEPA

Olga Vergara, USEPA MarelynVega, USEPA

AUGUSTA 17 STATE HOUSE STATION AUGUSTA, MAINE 04333-0017 (207) 287-3901 FAX: (207) 287-3435 RAY BLDG., HOSPITAL ST.

BANGOR 106 HOGAN ROAD BANGOR, MAINE 04401 (207) 941-4570 FAX: (207) 941-4584 PORTLAND 312 CANCO ROAD PORTLAND, MAINE 04103 (207) 822-6300 FAX: (207) 822-6303 PRESQUE ISLE 1235 CENTRAL IDRIVE, SKYWAY PARK PRESQUE ISLE, MAINE 04769-2094 (207) 764-6477 FAX: (207) 764-1507

web site: www.maine.gov/dep



STATE OF MAINE DEPARTMENT OF ENVIRONMENTAL PROTECTION 17 STATE HOUSE STATION AUGUSTA, ME 04333

DEPARTMENT ORDER

IN THE MATTER OF

MAINE ELECTRONIC	CS INC.)	MAINE POLLUTANT DISCHARGE
LISBON, ANDROSCO	OGGIN COUNTY, MAINE)	ELIMINATION SYSTEM PERMIT
GROUND WATER RI	EMEDIATION)	AND
ME0020427)	WASTE DISCHARGE LICENSE
W007759-5S-G-R	APPROVAL)	RENEWAL

Pursuant to the provisions of the Federal Water Pollution Control Act, Title 33 USC, Section 1251, et seq. and Maine Law, 38 M.R.S.A., Section 414-A et seq., and applicable regulations, the Department of Environmental Protection (Department hereinafter) has considered the application of MAINE ELECTRONICS INC., (MEI or permittee hereinafter) with its supportive data, agency review comments, and other related materials on file and FINDS THE FOLLOWING FACTS:

APPLICATION SUMMARY

MEI has submitted a timely and complete application to the Department for the renewal of combination Maine Pollutant Discharge Elimination System (MEPDES) permit ME0020427/Maine Waste Discharge License (WDL) #W007759-5S-E-R, (permit hereinafter) which was issued by the Department on May 13, 2010, for a five-year term. The permit authorized a discharge of up to a daily maximum of 79,000 gallons per day (gpd) or 0.079 million gallons per day (MGD) of treated ground water from a former electronic circuit board manufacturing complex to the Sabattus River, Class C, in Lisbon, Maine.

PERMIT SUMMARY

With the exception of inorganic arsenic, this permit is carrying forward all the terms and conditions of the previous permitting action. The May 13, 2010 permit was modified on September 11, 2013, by removing the water quality based limitations and monitoring requirements for inorganic arsenic given the human AWQC was revised on July 29, 2012, and the discharge no longer had a reasonable potential to exceed said revised criteria.

CONCLUSIONS

BASED on the findings in the attached Fact Sheet dated June 9, 2015, and subject to the Conditions listed below, the Department makes the following CONCLUSIONS:

- 1. The discharge, either by itself or in combination with other discharges, will not lower the quality of any classified body of water below such classification.
- 2. The discharge, either by itself or in combination with other discharges, will not lower the quality of any unclassified body of water which the Department expects to adopt in accordance with the state law.
- 3. The provisions of the State's antidegradation policy, 38 M.R.S.A., Section 464(4)(F), will be met in that:
 - a. Existing in-stream water uses and the level of water quality necessary to protect and maintain those existing uses will be maintained and protected;
 - b. Where high quality water of the State constitute an outstanding national resource, that water quality will be maintained and protected;
 - c. Where the standards of classification of the receiving water body are not met, the discharge will not cause or contribute to the failure of the water body to meet the standards of classification;
 - d. Where the actual quality of any classified receiving water body exceeds the minimum standards of the next highest classification, that higher water quality will be maintained and protected; and
 - e. Where a discharge will result in lowering the existing quality of any water body, the Department has made the finding, following opportunity for public participation, that this action is necessary to achieve important economic or social benefits to the State.
- 4. The discharge will be subject to effluent limitations that require application of best practicable treatment.

ME0020427 2015

5.

ACTION

THEREFORE, the Department APPROVES the above noted application of MAINE ELECTRONICS INC., to discharge up to a daily maximum of 79,000 gallons per day (gpd) or 0.079 million gallons per day (MGD) of treated ground water to the Sabattus River, Class C, in Lisbon, Maine, and is SUBJECT TO THE ATTACHED CONDITIONS, and all applicable standards and regulations including:

- 1. "Maine Pollutant Discharge Elimination System Permit Standard Conditions Applicable To All Permits," revised July 1, 2002, copy attached.
- 2. The attached Special Conditions, including any effluent limitations and monitoring requirements.
- 3. This permit becomes effective upon the date of signature below and expires at midnight five (5) years after that date. If a renewal application is timely submitted and accepted as complete for processing prior to the expiration of this permit, the terms and conditions of this permit and all subsequent modifications and minor revisions thereto remain in effect until a final Department decision on the renewal application becomes effective. [Maine Administrative Procedure Act, 5 M.R.S.A. § 10002 and Rules Concerning the Processing of Applications and Other Administrative Matters, 06-096 CMR 2(21)(A) (effective April 1, 2003)].

₹ •				
DONE AND DATED AT AUGUSTA, MAINE,	THIS 13th	AY OF July		, 201
COMMISSIONER OF ENVIRONMENTAL PR BY: Michael Kulus For Patricia W. Aho, Commissioner	OTECTION	O		
PLEASE NOTE ATTACHED SHEET FOR GUI	IDANCE ON	APPEAL PRO	CEDURES	
Date of initial receipt of application	April 15, 2	015		
Date of application acceptance	April 23, 2	015		
		File	d	7
		JUL 13	2015	
	E	State of M Soard of Environmen	aine ntal Protectio	ŋ
Date filed with Board of Environmental Protection	on			
This order prepared by Gregg Wood, BUREAU (OF WATER	QUALITY		•

7/9/15

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

1. The permittee is authorized to discharge treated ground water from Outfall 001 to the Sabattus River. Such discharges shall be limited and monitored by the permittee as specified below. (1)

TIER I(2)

Effluent Characteristic		Discharge I	imitations		Minimum N Require	
	Monthly Average	Daily <u>Maximum</u>	Monthly Average	Daily <u>Maximum</u>	Measurement Frequency	Sample <u>Type</u>
Flow [30050]	66,000 gpd ₇₀₇₇	72,000 gpd _[07]			Continuous _[99/99]	Recorder _[RC]
Temperature _[0001] June 1 – September 30				70 °F _[15]	1/Month _[0]/30]	Grab _[GR]]
Perchloroethylene [34475]	0.032 lbs/day _[26]		118 ug/L _{/28/}	and Political	1/Month _[0]/30]	Grab _[GR]
1,1-Dichloroethane _[3,1496]	3.8 lbs/day _[26]	****	14,000 ug/L _[28]		1/Month _[0]/30]	Grab _{/GRI}
1,1,1 Trichloroethane _[34506]	11 lbs/day _{/261}		40,000 ug/L _[28]		1/Month _{/01/30]}	Grab _{/GR/}
Trichloroethylene _[78391]	0.13 lbs/day _{/261}		474 ug/L _[28]		1/Month _[0]/30]	Grab _{/GRI}
Methylene Chloride (3.4423)	0.25 lbs/day _{/261}		920 ug/L _{/28/}		1/Month _[01/30]	Grab _{/GR/}
Cadmium (Total) [01027]	0.0015 lbs/day _[26]	0.0072 lbs/day	5.4 ug/L _[28]	24 ug/L _[28]	1/Month _[0]/30]	Grab _[GR]
Chromium III f070347	0.43 lbs/day _[26]	7.8 lbs/day _[26]	1,572 ug/L _{/281}	28,500 ug/L _{/28/}	1/Month _{/01/307}	Grab _{fGR]}
Copper (Total) [0]042]	0.028 lbs/day _[26]	0.021 lbs/day	102 ug/L _[28]	70 ug/L _[28]	1/Month _[01/30]	Grab _[GR]

SPECIAL CONDITIONS (cont'd)

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd)

TIER I⁽²⁾

Effluent Characteristic		Discharge Limitations						
	Monthly <u>Average</u>	Daily <u>Maximum</u>	Monthly Average	Daily <u>Maximum</u>	Measurement Frequency	Sample <u>Type</u>		
Iron (Total) [01045]	5.6 lbs/day _[26]	***	20,400 ug/L _[28]		1/Month _[0]/30]	Grab _(GR)		
Lead (Total) [0][05]]	0.0033 lbs/day _[26]	0.19 lbs/day _{/261}	12 ug/L _{/28/}	620 ug/L _{/28/}	1/Month _[0]/30]	Grab _[GR]		
Manganese (Total) [0]055]	2.7 lbs/day _[26]		10,000 ug/L _{/28/}	\$40 MA 1144	1/Month _{/01/301}	Grab _(GR)		
pH [00400]			WAS IN	6.0 – 8.5 S.U _{//2/}	1/Month _[0]/30]	Grab _[GR]		
Analytical Chemistry (4)				Report ug/L	1/Quarter [01/90]	Composite/ Grab _{[24/GR)}		

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

2. The permittee is authorized to discharge treated ground water from Outfall 001 to the Sabattus River. Such discharges shall be limited and monitored by the permittee as specified below. (1)

TIER II (2)

Effluent Characteristic		Minimum Monitoring Requirements				
	Monthly Average	Daily <u>Maximum</u>	Monthly Average	Daily <u>Maximum</u>	Measurement Frequency	Sample <u>Type</u>
Flow [50050]	72,000 gpd _[07]	79,000 gpd _{/077}		The public	Continuous [99/99]	Recorder _{/RC}
Temperature _[00011] June 1 — September 30	ww.			70 °F _[15]	1/Month _[0]/30]	Grab _[GR]]
Perchloroethylene [34475]	0.032 lbs/day _[26]		108 ug/L _{/28/}		1/Month _[0]/30]	Grab _{/GRI}
1,1-Dichloroethane [34496]	3.8 lbs/day _[26]		12,846 ug/L _{/28/}		1/Month _{/01/30]}	Grab _[GR]
1,1,1 Trichloroethane [3.4506]	11 lbs/day _{/261}		36,700 ug/L _[28]		1/Month _[0]/30]	Grab _[GR]
Trichloroethylene _[7839]]	0.13 lbs/day _{/261}		435 ug/L _{/28/}		1/Month _[01/30]	Grab _[GR]
Methylene Chloride _[34423]	0.25 lbs/day _{/261}		844 ug/L _{/28/}	40 44 44	1/Month _[0]/30]	Grab _{/GR/}
Cadmium (Total) [01027]	0.0015 lbs/day _[26]	0.0072 lbs/day	5 ug/L _[28]	22 ug/L _[28]	1/Month _[01/30]	Grab _[GR]
Chromium III _[01034]	0.43 lbs/day _[26]	7.7 lbs/day _[26]	1,432 ug/L _{/28/}	25,600 ug/L _[28]	1/Month _[0]/30]	Grab _[GR]
Copper (Total) [0]042]	0.028 lbs/day _[26]	0.021 lbs/day	94 ug/L _[28]	64 ug/L _[28]	1/Month _[0]/30]	Grab _[GR]

SPECIAL CONDITIONS (cont'd)

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd)

TIER II⁽²⁾

Effluent Characteristic		Minimum Monitoring Requirements					
	Monthly Average	Daily <u>Maximum</u>	Monthly Average	Daily <u>Maximum</u>	Measurement Frequency	Sample <u>Type</u>	
Iron (Total) [0] [0] [0] [0] [0] [0] [0] [0] [0] [0]	5.6 lbs/day _[26]		18,600 ug/L _[28]		1/Month _[0]/30]	Grab _{/GRI}	
Lead (Total) [0] [0] [0]	0.0033 lbs/day _[26]	0.18 lbs/day _[26]	11 ug/L _{/28/}	558 ug/L _{/28/}	1/Month _{/0//30/}	Grab _[GR]	
Manganese (Total) [0][055]	2.8 lbs/day _{/261}	******	9,200 ug/L _[28]	\$1 00 NO	1/Month _[0]/30]	Grab _(GR)	
pH _[60400]				6.0 – 8.5 S.U _[12]	1/Month _[0]/30]	Grab _(GR)	
Analytical Chemistry (4)				Report ug/L	1/Quarter [01/90]	Composite/ Grab _{[24/GR)}	

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd) – OUTFALL #001

SCREENING LEVEL TESTING – Beginning upon commencement of a continuous discharge (30 consecutive days or 45 days within any 12-month period) and lasting through a minimum of twelve (12) consecutive months;

Effluent Characteristic		Discharge 1	Monitoring F	Requirements		
	Monthly <u>Average</u>	Daily Maximum	Monthly Average	Daily Maximum	Measurement Frequency	Sample Type
Whole Effluent Toxicity (WET) (3) A-NOEL Ceriodaphnia dubia [TDA3B] Salvelinus fontinalis [TDA6F]				Report % [23] Report % [23]	2/Year [02/YR] 2/Year [02/YR]	Composite [24] Composite [24]
<u>C-NOEL</u> Ceriodaphnia dubia _[ТВРЗВ] Salvelinus fontinalis _[ТВО6F]				Report % [23] Report % [23]	2/Year [02/YR] 2/Year [02/YR]	Composite [24] Composite [24]
Analytical Chemistry (4,6) [51477]		***************************************	_	Report ug/L	1/Quarter [01/90]	Composite/ Grab
Priority Pollutants ^(5,6)				Report ug/L	1/Year [01/YR]	Composite/ Grab [24/GR]

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd)

Footnotes:

1. Sampling Location—Composite and grab sampling of the treatment plant effluent for compliance with this permit shall be conducted after the final neutralization tank but prior to the parshall flume. Any change in sampling location must be approved by the Department in writing.

The permittee must conduct sampling and analysis in accordance with; a) methods approved by 40 Code of Federal Regulations (CFR) Part 136, b) alternative methods approved by the Department in accordance with the procedures in 40 CFR Part 136, or c) as otherwise specified by the Department. Samples that are sent out for analysis must be analyzed by a laboratory certified by the State of Maine's Department of Health and Human Services for wastewater. Samples that are sent to a POTW licensed pursuant to Waste discharge licenses, 38 M.R.S.A. § 413 are subject to the provisions and restrictions of Maine Comprehensive and Limited Environmental Laboratory Certification Rules, 10-144 CMR 263 (effective April 1, 2010). If the permittee monitors any pollutant more frequently than required by the permit using test procedures approved under 40 CFR Part 136 or as specified in this permit, the results of this monitoring must be included in the calculation and reporting of the data submitted in the Discharge Monitoring Report.

- 2. Tier I Limitations are in effect upon issuance of this permit. The permittee must formally request in writing, and receive written approval from the Department for authorization to discharge under limitations established in Tier II. Tier II limitations are not in effect until the monthly average discharge flow associated with the ground water remediation activities is >0.072 MGD for six (6) consecutive calendar months.
- 3. Whole effluent toxicity (WET) testing Definitive WET testing is a multi-concentration testing event which provides a point estimate of toxicity in terms of No Observed Effect Level, commonly referred to as NOEL or NOEC. Tests shall be conducted such that a minimum of five dilutions bracketing the critical acute and chronic dilutions of 39:1 and 45:1 respectively for Tier I, (2.6% and 2.2% respectively mathematical inverse of the dilution factor) and 35:1 and 41:1 respectively for Tier II (2.8% and 2.4%) are performed. A-NOEL is defined as the acute no observed effect level with survival as the end point. C-NOEL is defined as the chronic no observed effect level with survival, reproduction and growth as the end points.

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd)

Footnotes:

Screening level testing - Beginning upon commencement of a continuous discharge (30 consecutive days or 45 days within any 12-month period) and lasting through a minimum of twelve (12) consecutive months, the permittee shall initiate screening level WET testing at a frequency of two per year. Testing shall be conducted on the water flea (<u>Ceriodaphnia dubia</u>) and the brook trout (<u>Salvelinus fontinalis</u>). Results shall be submitted to the Department within thirty (30) days of the permittee receiving the data report from the laboratory conducting the testing. See Attachment A of this permit for a copy of the Department's WET reporting form.

Once the screening level of testing is completed, the Department will perform a statistical evaluation on the WET test results to determine if the discharge exceeds or has a reasonable potential to exceed the applicable acute and chronic critical ambient water quality thresholds cited in paragraph #1 of this footnote. WET testing thereafter (if necessary) will be determined by the Department and Special Condition G, *Reopening Of Permit For Modifications*, of this permit will be utilized to formally modify the permit accordingly.

WET test results must be submitted to the Department not later than the next Discharge Monitoring Report (DMR) required by the permit, provided, however, that the permittee may review the toxicity reports for up to 10 business days of their availability before submitting them. The permittee shall evaluate test results being submitted and identify to the Department possible exceedences of the critical acute and chronic water quality thresholds specified above.

Toxicity tests must be conducted by an experienced laboratory approved by the Department. The laboratory must follow procedures as described in the following USEPA methods manuals as modified by Department protocol for the brook trout. See **Attachment C** of this permit for the Department protocol.

- a. <u>Short Term Methods for Estimating the Chronic Toxicity of Effluent and Receiving Water to Freshwater Organisms</u>, Fourth Edition, October 2002, EPA-821-R-02-013.
- b. <u>Methods for Measuring the Acute Toxicity of Effluent and Receiving Waters to Freshwater and Marine Organisms</u>, Fifth Edition, October 2002, EPA-821-R-02-012.

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd)

Footnotes:

Each time a WET test is performed, the permittee shall sample and analyze for the parameters in the WET Chemistry and the Analytical Chemistry sections of the Department form entitled, *Maine Department of Environmental Protection, WET and Chemical Specific Data Report Form.* See Attachment B of this permit.

4. Analytical chemistry – Refers to a suite of chemicals listed in Attachment B of this permit.

Screening level testing – Beginning upon commencement of a continuous discharge (30 consecutive days or 45 days within any 12-month period) and lasting through a minimum of twelve (12) consecutive months, the permittee shall conduct analytical chemistry testing at a minimum frequency of once per calendar quarter for four consecutive calendar quarters.

5. Priority pollutant testing – Refers to a suite of chemical listed in Attachment B of this permit.

Screening level testing – Beginning upon commencement of a continuous discharge (30 consecutive days or 45 days within any 12-month period) and lasting through a minimum of twelve (12) consecutive months, the permittee shall conduct screening level priority pollutant testing at a minimum frequency of once per year, except for those analytical chemistry parameter(s) otherwise regulated in this permit.

Surveillance level testing is not required pursuant to Department rule 06-096 CMR Chapter 530.

6. Priority pollutant and analytical chemistry - Testing shall be conducted on samples collected at the same time as those collected for whole effluent toxicity tests when applicable. Priority pollutant and analytical chemistry testing shall be conducted using methods that permit detection of a pollutant at existing levels in the effluent or that achieve minimum reporting levels of detection as specified by the Department.

Test results must be submitted to the Department not later than the next Discharge Monitoring Report (DMR) required by the permit, provided, however, that the permittee may review the toxicity reports for up to 10 business days of their availability before submitting them. The permittee shall evaluate test results being submitted and identify to

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (cont'd)

Footnotes:

the Department, possible exceedences of the acute, chronic or human health AWQC as established in *Surface Water Quality Criteria for Toxic Pollutants*, 06-096 CMR 584 (effective October 9, 2005). For the purposes of DMR reporting, enter a "1" for <u>yes</u>, testing done this monitoring period or "NODI-9" monitoring <u>not required</u> this period.

Once the screening level of chemical specific and priority pollutant testing is completed, the Department will perform a statistical evaluation on the chemical specific test results to determine if the discharge exceeds or has a reasonable potential to exceed the acute, chronic and or human health ambient water quality criteria (AWQC). Chemical specific testing thereafter (if necessary) will be determined by the Department and Special Condition G, *Reopening Of Permit For Modifications*, of this permit will be utilized to formally modify the permit accordingly.

B. NARRATIVE EFFLUENT LIMITATIONS

- 1. The effluent shall not contain a visible oil sheen, foam or floating solids at any time which would impair the uses designated by the classification of the receiving waters.
- 2. The effluent shall not contain materials in concentrations or combinations which are hazardous or toxic to aquatic life, or which would impair the uses designated by the classification of the receiving waters.
- 3. The discharges shall not cause visible discoloration or turbidity in the receiving waters which would impair the uses designated by the classification of the receiving waters.
- 4. Notwithstanding specific conditions of this permit the effluent must not lower the quality of any classified body of water below such classification, or lower the existing quality of any body of water if the existing quality is higher than the classification.

C. AUTHORIZED DISCHARGES

The permittee is authorized to discharge only in accordance with: 1) the permittee's General Application for Waste Discharge Permit, accepted for processing on April 23, 2015, 2) the terms and conditions of this permit; and 3) only from Outfall #001. Discharges of waste water from any other point source are not authorized under this permit, and shall be reported in accordance with Standard Condition B(5)(Bypass) of this permit.

D. OPERATION & MAINTENANCE (O&M) PLAN

On or before 45 days of commencing a discharge, the permittee shall submit a written comprehensive Operation & Maintenance (O&M) Plan to the Department for review. The plan shall provide a systematic approach by which the permittee shall at all times, properly operate and maintain all facilities and systems of transport, treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of this permit.

By December 31 of each year, or within 90 days of any process changes or minor equipment upgrades, the permittee shall evaluate and modify the O&M Plan including site plan(s) and schematic(s) for the waste water treatment facility to ensure that it is up-to-date. The O&M Plan shall be kept on-site at all times and made available to Department and EPA personnel upon request.

Within 90 days of completion of new and or substantial upgrades of the waste water treatment facility, the permittee shall submit the updated O&M Plan to their Department inspector for review and comment.

E. NOTIFICATION REQUIREMENT

In accordance with Standard Condition D, the permittee shall notify the Department of any substantial change in the volume or character of pollutants being discharged.

F. MONITORING AND REPORTING

Monitoring results obtained during the previous month shall be summarized for each month and reported on separate Discharge Monitoring Report (DMR) forms provided by the Department and postmarked on or before the thirteenth (13th) day of the month or hand-delivered to a Department Regional Office such that the DMR's are received by the Department on or before the fifteenth (15th) day of the month following the completed reporting period. A signed copy of the DMR and all other reports required herein shall be submitted to the following address:

Department of Environmental Protection Central Maine Regional Office Bureau of Land and Water Quality Division of Water Quality Management 17 Station House Station Augusta, ME. 04333 ME0020427 W007759-5S-G-R

SPECIAL CONDITIONS

F. MONITORING AND REPORTING

Alternatively, if you are submitting an electronic DMR (eDMR), the completed eDMR must be electronically submitted to the Department by a facility authorized DMR Signatory not later than close of business on the 15th day of the month following the completed reporting period. Hard Copy documentation submitted in support of the eDMR must be postmarked on or before the thirteenth (13th) day of the month or hand-delivered to the Department's Regional Office such that it is received by the Department on or before the fifteenth (15th) day of the month following the completed reporting period. Electronic documentation in support of the eDMR must be submitted not later than close of business on the 15th day of the month following the completed reporting period.

G. REOPENING OF PERMIT FOR MODIFICATIONS

Upon evaluation of the tests results or monitoring requirements specified in Special Conditions of this permitting action, new site specific information, or any other pertinent test results or information obtained during the term of this permit, the Department may, at any time and with notice to the permittee, modify this permit to; 1) include effluent limits necessary to control specific pollutants or whole effluent toxicity where there is a reasonable potential that the effluent may cause water quality criteria to be exceeded, (2) require additional effluent and or ambient water quality monitoring if results on file are inconclusive; or (3) change monitoring requirements or limitations based on new information.

H. SEVERABILITY

In the event that any provision(s), or part thereof, of this permit is declared to be unlawful by a reviewing court, the remainder of the permit shall remain in full force and effect, and shall be construed and enforced in all aspects as if such unlawful provision, or part thereof, had been omitted, unless otherwise ordered by the court.

ATTACHMENT A

MAINE DEPARTMENT OF ENVIRONMENTAL PROTECTION WHOLE EFFLUENT TOXICITY REPORT FRESH WATERS

Facility Name				MEPDES Permi	#	
Facility Representative	at to the best of my	knowledge that the	Signature	d is true, accurate,	and complete.	
Facility Telephone #			Date Collected		Date Tested	60) 60) 60)
Chlorinated?		Dechlorinated?		mm/đd/yy		mın/dd/yy
Results A-NOEL	% eff water flea	uent	CETTON:		A-NOEL C-NOEL	Effluent Limitations
C-NOEL_	 % sı	water flea arvival] no. young	% s	trout urvival	final weight (mg)
QC standard lab control receiving water control conc. 1 (%) conc. 2 (%) conc. 3 (%) conc. 5 (%) conc. 6 (%) stat test used place * nex Reference toxicant. toxicant / date limits (mg/L) results (mg/L)	A>90 t to values statis Next A-NOEL	-		A>90 for trout show find C-NOEL	nal wt and % inc	> 2% increase
Comments Laboratory conducting tes Company Name Mailing Address City, State, ZIP	t		Company Rep. Na Company Rep. Sig Company Telepho	nature		
City, State, ZIP			Company Telepho	ne#jjingjingjing		

Report WET chemistry on DEP Form "ToxSheet (Fresh Water Version), March 2007."

ATTACHMENT B

Maine Department of Environmental Protection WET and Chem

This form is for reporting laboratory data and facility information. Official compliance reviews will be done by DEP.

	Facility Name _		····	MEPDES# Pipe#		Facility Re	epresentative Signature _ To the best of my kno	wiedge this info	rmation is true	, accurate an	id complete.
	Licensed Flow (MGD) Acute dilution factor			Flow for	Day (MGD) ⁽¹⁾		Flow Avg. for Mo	onth (MGD) ⁽²⁾			
	Chronic dilution factor			Date Samp	le Collected		Date Samp	le Analyzed			
1	Human health dilution factor			•	•		•	, ,	<u> </u>		
	Criteria type: M(arine) or F(resh)	f			Laboratory				Telephone		
					Address			····	. ,		
	Lastrevision Ludyin 2015				Lab Contact				Lab ID#		
	ERROR WARNING ! Essential facility	FRESH W	ATER VER	SION	Lab Contact				Lab ID#		
	information is missing. Please check	- 10001111		<u> </u>	-	Receiving	Effluent				
		Please see the for	otnotes on t	he last page.		Water or Ambient	Concentration (ug/L or as noted)				
1	WHOLE EFFLUENT TOXICITY										
11		The second secon	Effluent	Limits, %	S THE RESERVE THE PROPERTY OF THE PARTY OF T		WET Result, %	Reporting	channe bereits translaters to the territories of the	Exceed	
I	·	Ì	Acute	Chronic	1		Do not enter % sign	Limit Check		Chronic	
Ť	Trout - Acute										
II	Trout - Chronic		***						1		
ij	Water Flea - Acute										
	Water Flea - Chronic										
Į,	WET CHEMISTRY								机图 化阿尔图		
Į	pH (S.U.) (9)										
	Total Organic Carbon (mg/L)	1				(8)	•				
	Total Solids (mg/L)								Ė		
1	Total Suspended Solids (mg/L)			1							
11	Alkalinity (mg/L)				<u> </u>	(8)					
Щ	Specific Conductance (umhos)								1		
11	Total Hardness (mg/L)			<u> </u>		(8)			<u> </u>	\	<u> </u>
	Total Magnesium (mg/L)			ļ		(8)		 			
	Total Calcium (mg/L)	arenemanaren eta	etimenuovees	 	nicristerrererentskien)	(8)		esterioris de la contraction d		i Markani poentarino	A SUMBARIA CARROLLA
	Also do these tests on the effluent with		Eff	fluent Limits	. ua/L				Possibl	e Exceed	lence ⁽⁷⁾
	WET. Testing on the receiving water is	Chambathan I Inch		Chronic ^(S)	Health ⁽⁶⁾	1	1	Reporting Limit Check		Chronic	Health
Н	optional TOTAL RESIDUAL CHLORINE (mg/L) (9)	Reporting Limit 0.05	Acute	CHOILC	Legitti	NA NA		Limit Check	Acute	Critoric	nealui
Н	AMMONIA (Ing/L) (9)	NA.				(8)		<u> </u>			
D.		NA NA		 		(8)			 	 	
i,		5		 		(8)	,	 			
Ž,	CADMIUM	1		 		(8)					
J.		10		 	- 	(8)					1
M	I COPPER	3				(8)					
Ī	I CYANIDE, TOTAL	5	}			(8)					
Į	CYANIDE, AVAILABLE (3a)	5				(8)					
ľ	LEAD	3				(8)		Į		1	+
1	NICKEL SILVER	5 1		 		(8)		 	 	 	+
V	W ZINO	5	 	 	- 	(8)		 	- 	_	+
H	ZINC ZINC	<u> </u>	<u> </u>	1		1 (9)	1	<u> </u>	_1	-4	

Maine Department of Environmental Protection WET and Chem

This form is for reporting laboratory data and facility information. Official compliance reviews will be done by DEP.

PRIORITY POLLUTANTS (4)	Tarates patricular designation						2014/24/25/19/55			
			Effluent Lim	V			Reporting	Possible	Exceed	ence ''
	Reporting Limit	Acute ⁽⁶⁾	Chronic ⁽⁶⁾	Health ⁽⁶⁾			Limit Check	Acute	Chronic	Healtr
ANTIMONY	5									
BERYLLIUM	2	2	Transport of the Control of the Cont		Parket of the rest to be a selected by the services of the selected by the services of the ser	CONTROL PRODUCTOR CONTROL CONTROL STREET, SECURITIES AND SECURITIE	en viene en	·	Control I I Control Control Control	
EL MERCURY (5) EN HARRICH HAR EN HARRICH HAR					NAME OF THE OWNER, WHEN					洲線洲
SELENIUM	5	ļ								
THALLIUM	4		<u> </u>							ļ
2.4,6-TRICHLOROPHENOL	5									
2.4-DICHLOROPHENOL	5									
2.4-DIMETHYLPHENOL	5									<u></u>
2,4-DINITROPHENOL	45			<u> </u>		<u> </u>		<u> </u>	ļ	
2-CHLOROPHENOL	5					<u> </u>				
2-NITROPHENOL	1 5									
4,6 DINITRO-O-CRESOL (2-Methyl-4,6-	l		•			1			1	
dinitrophenol)	25					<u> </u>				
4-NITROPHENOL	20									
P-CHLORO-M-CRESOL (3-methyl-4-					_	· · · · · · · · · · · · · · · · · · ·				
chlorophenol)+B80	5	1		1			<u> </u>]	<u> </u>
PENTACHLOROPHENOL	20									
PHENOL	5							•		
1,2,4-TRICHLOROBENZENE	5							l		
1,2-(0)DICHLOROBENZENE	5							}		
1,2-DIPHENYLHYDRAZINE	20			T			·		·	
1,3-(M)DICHLOROBENZENE	5									***************************************
1,4-(P)DICHLOROBENZENE	5	1								
1 2,4-DINITROTOLUENE	6									
J 2.6-DINITROTOLUENE	5									1
1 2-CHLORONAPHTHALENE	5						1			1.
3.3'-DICHLOROBENZIDINE	16.5									
3.4-BENZO(B)FLUORANTHENE	5	1							-	1
4-BROMOPHENYLPHENYL ETHER	5		1	<u> </u>			<u> </u>	******	-	1
4-CHLOROPHENYL PHENYL ETHER	5		1	<u> </u>	}					+
ACENAPHTHENE	5				<u> </u>			1	· ····	-
ACENAPHTHYLENE	5				1	· · · · · · · · · · · · · · · · · · ·				
ANTHRACENE	5								†	+
BENZIDINE	45	***************************************			· · · · · · · · · · · · · · · · · · ·	· [
N BENZO(A)ANTHRACENE	8					· · · · · · · · · · · · · · · · · · ·		· · · · · · · · · · · · · · · · · · ·		
N BENZO(A)PYRENE	5		 						1	+
BENZO(G,H,I)PERYLENE	5			·			·	1	-}	+
N BENZO(K)FLUORANTHENE	5					 			 	
BIS(2-CHLOROETHOXY)METHANE	5	· · · · · · · · · · · · · · · · · · ·	 				1			
N BIS(2-CHLOROETHYL)ETHER	6				 	<u> </u>	 	+		
N BIS(2-CHLOROISOPROPYL)ETHER	6				 	 	1	 -		+
BIS(2-ETHYLHEXYL)PHTHALATE	10	+		 	 		1	 		-
N BUTYLBENZYL PHTHALATE	5	 	·· 		 	· · · · · · · · · · · · · · · · · · ·	1	 	+	+
N CHRYSENE	5				 			 	+	+
N DI-N-BUTYL PHTHALATE	5	+					 	·	+	+
N DI-N-OCTYL PHTHALATE	5				 			 		+
N DIBENZO(A,H)ANTHRACENE	5				 	 	 		+	+
N DIETHYL PHTHALATE			 		 			 	+	+
N DIMETHYL PHTHALATE	5	-	_		 			 		1
N IPLUORANTHENE	5				<u>i </u>	<u> </u>		1	1	

Maine Department of Environmental Protection WET and Chem

This form is for reporting laboratory data and facility information. Official compliance reviews will be done by DEP.

						<u> </u>				
	FLUORENE	5								,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
BN	HEXACHLOROBENZENE	5								
BN	HEXACHLOROBUTADIENE	5)							
	HEXACHLOROCYCLOPENTADIENE	10								
	HEXACHLOROETHANE	5								
BIN	MEXACILOROET HANE	3 -								
	INDENO(1,2,3-CD)PYRENE	5								
	ISOPHORONE	5		· ·						
BN	N-NITROSODI-N-PROPYLAMINE	10							1	
BN	N-NITROSODIMETHYLAMINE	5						· · · · · · · · · · · · · · · · · · ·		
BN	N-NITROSODIPHENYLAMINE	5								
	NAPHTHALENE	5 ·								
	NITROBENZENE	5							·	
	PHENANTHRENE	5								
							<u> </u>			
	PYRENE	5								
P	4,4'-DDD	0.05					1			<u> </u>
R	4,4'-DDE	0.05								L
P	(4,4'-DDT	0.05					l		1	·
P	IA-BHC	0.2					T		((
R	A-ENDOSULFAN	0.05					·			
R	ALDRIN	0.15					 		 	
R	B-SHC	0.05		· · · · · · · · · · · · · · · · · · ·		<u> </u>			 	
R -	B-ENDOSULFAN								 	
		0.05	<u> </u>						ļ	
P P	CHLORDANE	0.1	}				<u> </u>		1	
P	D-BHC_	0.05			1	<u> </u>	<u> </u>		1	
3	DIELDRIN	0.05						-	1	· ·
n 12	ENDOSULFAN SULFATE	0.1			1		1			
P	ENDRIN :	0.05			 					
P	ENDRIN ALDEHYDE	0.05			 		 		 	
P	G-BHC	0.15			 		·	 		
				<u></u>	 	 	 		 	
117	HEPTACHLOR	0.15					-			
IIP	HEPTACHLOR EPOXIDE	0.1							<u> </u>	
II P	PC8-1016	0.3					<u> </u>	<u> </u>		1
<u>Φ</u> - <u>Φ</u> - <u>Φ</u> - <u>Φ</u> -	PCB-1221	0.3		,			1	•		
D:	PCB-1232	0.3							T	1
III P	PCB-1242	0.3			1		1		-	
P.	PCB-1248	0.3	 -				1		 	-
6	PCB-1254		 		 	 	· · · · · · · · · · · · · · · · · · ·	-		
 		0.3			 					
P	PCB-1260	0.2			ļ	.l	<u> </u>		 	
P	TOXAPHENE	1	<u> </u>		<u> </u>	<u> </u>	<u> </u>			ļ
V	1.1,1-TRICHLOROETHANE	5	1			<u> 1 </u>	.1	1		
N	1,1,2,2-TETRACHLOROETHANE	7			T					
V	1,1,2-TRICHLOROETHANE	5			1		T T		T	1
V	1,1-DICHLOROETHANE	5					1			
	1,1-DICHLOROETHYLENE (1,1-		 				1	 	+	+
,				l		l	1	l .	1	}
	dichloroethene	3					 	 	+	
	1,2-DICHLOROETHANE	3			<u> </u>			ļ		+
W	1,2-DICHLOROPROPANE	6						<u> </u>		
	1,2-TRANS-DICHLOROETHYLENE (1,2-									
IIIW	trans-dichloroethene)	5			}		Ì			
	1,3-DICHLOROPROPYLENE (1,3-		 		1				7	
\mathbb{N}		5			1		l .	1	1	
	dichloropropene)		 							
N.	2-CHLOROETHYLVINYL ETHER	20	<u> </u>						_	-
V	ACROLEIN	NA		-		<u> </u>		1		
V	ACRYLONITRILE	NA						<u> </u>		
IIIV	BENZENE	5	-					1		1
11 11					*					

Revised July 1, 2015

Page 3

DEPLW 0740-H2015

Printed 7/10/2015

Maine Department of Environmental Protection WET and Chem

This form is for reporting laboratory data and facility information. Official compliance reviews will be done by DEP.

	ROMOFORM	5								
	CARBON TETRACHLORIDE	5								
	HLOROBENZENE	6	l l							
	CHLORODIBROMOMETHANE	3								
W C	CHLOROETHANE	5								
	CHLOROFORM	5								
	DICHLOROBROMOMETHANE	3								
	THYLBENZENE	10							-	
	METHYL BROMIDE (Bromomethane)	5					1			
	METHYL CHLORIDE (Chloromethane)	5]			
V A	METHYLENE CHLORIDE	5				B Total				
	ETRACHLOROETHYLENE			l	l	1	l .	\		1
	Perchloroethylene or Tetrachloroethene)	5					<u> </u>			
	TOLUENE	5								1
	RICHLOROETHYLENE								1	
	Trichloroethene)	3								
W 1/	/INYL CHLORIDE	5		•	1					1

Notes

- (1) Flow average for day pertains to WET/PP composite sample day.
- (2) Flow average for month is for month in which WET/PP sample was taken.
- (3) Analytical chemistry parameters must be done as part of the WET test chemistry.
- 🕍 (3a) Cyanide, Available (Cyanide Amenable to Chlorination) is not an analytical chemistry parameter, but may be required by certain discharge permits .
 - (4) Priority Pollutants should be reported in micrograms per liter (ug/L).

(5) Welchydsloffennegodedin manograms berliter ing/s) by the contract izboratory sorbers ure to convention incograms pen hen on this spreadsheet.

- (6) Effluent Limits are calculated based on dilution factor, background allocation (10%) and water quality reserves (15% to allow for new or changed discharges or non-point sources).
- (7) Possible Exceedence determinations are done for a single sample only on a mass basis using the actual pounds discharged. This analysis does not consider watershed wide allocations for fresh water discharges.
- (8) These tests are optional for the receiving water. However, where possible samples of the receiving water should be preserved and saved for the duration of the WET test. In the event of questions about the receiving water's possible effect on the WET results, chemistry tests should then be conducted.
- (9) pH and Total Residual Chlorine must be conducted at the time of sample collection. Tests for Total Residual Chlorine need be conducted only when an effluent has been chlorinated or residual chlorine is believed to be present for any other reason.

Comments:

ATTACHMENT C

Salmonid Survival and Growth Test

The Salmonid survival and growth test must follow the procedures for the fathead minnow larval survival and growth tests detailed in USEPA's freshwater acute and chronic methods manuals with the following Department modifications:

Species - Brook Trout, Salvelinus fontinalis, or other salmonid approved by the Department.

Age - Less than six months old for the first test each year and less than twelve months for subsequent tests.

Size - The largest fish must not be greater than 150% of the smallest.

Loading Rate - < 0.5 g/l/day

Feeding rate - 5% of body weight 3 times daily (15%/day)

Temperature - $12^{\circ} \pm 1^{\circ}C$

Dissolved Oxygen - 6.5 mg/l ,aeration if needed with large bubbles (> 1 mm diameter) at a rate of <100/min

Dilution Water - Receiving water upstream of discharge (or other ambient water approved by the Department)

Dilution Series - A minimum of 5 effluent concentrations (including the instream waste concentrations bracketing acute and chronic dilutions calculated pursuant to Section D); a receiving water control; and control of known suitable water quality

Duration - Acute = 48 hours

- Chronic = 10 days minimum

Test acceptability - Acute = minimum of 90% survival in 2 days

- Chronic = minimum of 80% survival in 10 days; minimum growth of 20 mg/gm/d dry weight in controls, (individual fish weighed, dried at 100°C to constant weight and weighed to 3 significant figures)

MAINE POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

CONTENTS

SECTION		TOPIC	PAGE
A		GENERAL PROVISIONS	
	1	General compliance	2
	2	Other materials	2
		Duty to Comply	2
	4	Duty to provide information	2
	5	Permit actions	2
	6	Reopener clause	2
	7	Oil and hazardous substances	2
	8	Property rights	3
	9	Confidentiality	3
	10	Duty to reapply	3
	11	Other laws	3
	12	Inspection and entry	3
В		OPERATION AND MAINTENANCE OF FACILITIES	
	1	General facility requirements	3
	2	Proper operation and maintenance	4
	3	Need to halt reduce not a defense	4
	4	Duty to mitigate	4
	5	Bypasses	4
	6	Upsets	5.
С		MONITORING AND RECORDS	•
	1	General requirements	6
	2	Representative sampling	6
	3	Monitoring and records	6
D		REPORTING REQUIREMENTS	
	1	Reporting requirements	7
	2	Signatory requirement	8
	3	Availability of reports	8
	4	Existing manufacturing, commercial, mining, and silvicultural dischargers	8
	5	Publicly owned treatment works	9
E		OTHER PROVISIONS	
	1	Emergency action - power failure	9
	2	Spill prevention	10
	3	Removed substances	10
	4	Connection to municipal sewer	10
F		DEFINTIONS	10

Revised July 1, 2002

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

A. GENERAL PROVISIONS

- 1. General compliance. All discharges shall be consistent with the terms and conditions of this permit; any changes in production capacity or process modifications which result in changes in the quantity or the characteristics of the discharge must be authorized by an additional license or by modifications of this permit; it shall be a violation of the terms and conditions of this permit to discharge any pollutant not identified and authorized herein or to discharge in excess of the rates or quantities authorized herein or to violate any other conditions of this permit.
- 2. Other materials. Other materials ordinarily produced or used in the operation of this facility, which have been specifically identified in the application, may be discharged at the maximum frequency and maximum level identified in the application, provided:
 - (a) They are not
 - (i) Designated as toxic or hazardous under the provisions of Sections 307 and 311, respectively, of the Federal Water Pollution Control Act; Title 38, Section 420, Maine Revised Statutes; or other applicable State Law; or
 - (ii) Known to be hazardous or toxic by the licensee.
 - (b) The discharge of such materials will not violate applicable water quality standards.
- 3. Duty to comply. The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of State law and the Clean Water Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application.
 - (a) The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Clean Water Act, and 38 MRSA, §420 or Chapter 530.5 for toxic pollutants within the time provided in the regulations that establish these standards or prohibitions, even if the permit has not yet been modified to incorporate the requirement.
 - (b) Any person who violates any provision of the laws administered by the Department, including without limitation, a violation of the terms of any order, rule license, permit, approval or decision of the Board or Commissioner is subject to the penalties set forth in 38 MRSA, §349.
- 4. Duty to provide information. The permittee shall furnish to the Department, within a reasonable time, any information which the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit or to determine compliance with this permit. The permittee shall also furnish to the Department upon request, copies of records required to be kept by this permit.
- 5. Permit actions. This permit may be modified, revoked and reissued, or terminated for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition.
- 6. Reopener clause. The Department reserves the right to make appropriate revisions to this permit in order to establish any appropriate effluent limitations, schedule of compliance or other provisions which may be authorized under 38 MRSA, §414-A(5).

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

- 7. Oil and hazardous substances. Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities or penalties to which the permittee is or may be subject under section 311 of the Federal Clean Water Act; section 106 of the Federal Comprehensive Environmental Response, Compensation and Liability Act of 1980; or 38 MRSA §§ 1301, et. seq.
- 8. Property rights. This permit does not convey any property rights of any sort, or any exclusive privilege.
- 9. Confidentiality of records. 38 MRSA §414(6) reads as follows. "Any records, reports or information obtained under this subchapter is available to the public, except that upon a showing satisfactory to the department by any person that any records, reports or information, or particular part or any record, report or information, other than the names and addresses of applicants, license applications, licenses, and effluent data, to which the department has access under this subchapter would, if made public, divulge methods or processes that are entitled to protection as trade secrets, these records, reports or information must be confidential and not available for public inspection or examination. Any records, reports or information may be disclosed to employees or authorized representatives of the State or the United States concerned with carrying out this subchapter or any applicable federal law, and to any party to a hearing held under this section on terms the commissioner may prescribe in order to protect these confidential records, reports and information, as long as this disclosure is material and relevant to any issue under consideration by the department."
- 10. Duty to reapply. If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for and obtain a new permit.
- 11. Other laws. The issuance of this permit does not authorize any injury to persons or property or invasion of other property rights, nor does it relieve the permittee if its obligation to comply with other applicable Federal, State or local laws and regulations.
- 12. Inspection and entry. The permittee shall allow the Department, or an authorized representative (including an authorized contractor acting as a representative of the EPA Administrator), upon presentation of credentials and other documents as may be required by law, to:
 - (a) Enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this permit;
 - (b) Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit;
 - (c) Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit; and
 - (d) Sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Clean Water Act, any substances or parameters at any location.

B. OPERATION AND MAINTENACE OF FACILITIES

- 1. General facility requirements.
 - (a) The permittee shall collect all waste flows designated by the Department as requiring treatment and discharge them into an approved waste treatment facility in such a manner as to

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

- maximize removal of pollutants unless authorization to the contrary is obtained from the Department.
- (b) The permittee shall at all times maintain in good working order and operate at maximum efficiency all waste water collection, treatment and/or control facilities.
- (c) All necessary waste treatment facilities will be installed and operational prior to the discharge of any wastewaters.
- (d) Final plans and specifications must be submitted to the Department for review prior to the construction or modification of any treatment facilities.
- (e) The permittee shall install flow measuring facilities of a design approved by the Department.
- (f) The permittee must provide an outfall of a design approved by the Department which is placed in the receiving waters in such a manner that the maximum mixing and dispersion of the wastewaters will be achieved as rapidly as possible.
- 2. Proper operation and maintenance. The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.
- 3. Need to halt or reduce activity not a defense. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.
- 4. Duty to mitigate. The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.

5. Bypasses.

- (a) Definitions.
 - (i) Bypass means the intentional diversion of waste streams from any portion of a treatment facility.
 - (ii) Severe property damage means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
- (b) Bypass not exceeding limitations. The permittee may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of paragraphs (c) and (d) of this section.
- (c) Notice.
 - (i) Anticipated bypass. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible at least ten days before the date of the bypass.

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

(ii) Unanticipated bypass. The permittee shall submit notice of an unanticipated bypass as required in paragraph D(1)(f), below. (24-hour notice).

(d) Prohibition of bypass.

- (i) Bypass is prohibited, and the Department may take enforcement action against a permittee for bypass, unless:
 - (A) Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
 - (B) There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and
 - (C) The permittee submitted notices as required under paragraph (c) of this section.
- (ii) The Department may approve an anticipated bypass, after considering its adverse effects, if the Department determines that it will meet the three conditions listed above in paragraph (d)(i) of this section.

6. Upsets.

- (a) Definition. Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
- (b) Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of paragraph (c) of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review.
- (c) Conditions necessary for a demonstration of upset. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
 - (i) An upset occurred and that the permittee can identify the cause(s) of the upset;
 - (ii) The permitted facility was at the time being properly operated; and
 - (iii) The permittee submitted notice of the upset as required in paragraph D(1)(f), below. (24 hour notice).
 - (iv) The permittee complied with any remedial measures required under paragraph B(4).
- (d) Burden of proof. In any enforcement proceeding the permittee seeking to establish the occurrence of an upset has the burden of proof.

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

C. MONITORING AND RECORDS

- 1. General Requirements. This permit shall be subject to such monitoring requirements as may be reasonably required by the Department including the installation, use and maintenance of monitoring equipment or methods (including, where appropriate, biological monitoring methods). The permittee shall provide the Department with periodic reports on the proper Department reporting form of monitoring results obtained pursuant to the monitoring requirements contained herein.
- 2. Representative sampling. Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. If effluent limitations are based wholly or partially on quantities of a product processed, the permittee shall ensure samples are representative of times when production is taking place. Where discharge monitoring is required when production is less than 50%, the resulting data shall be reported as a daily measurement but not included in computation of averages, unless specifically authorized by the Department.

3. Monitoring and records.

- (a) Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
- (b) Except for records of monitoring information required by this permit related to the permittee's sewage sludge use and disposal activities, which shall be retained for a period of at least five years, the permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least 3 years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.
- (c) Records of monitoring information shall include:
 - (i) The date, exact place, and time of sampling or measurements;
 - (ii) The individual(s) who performed the sampling or measurements;
 - (iii) The date(s) analyses were performed;
 - (iv) The individual(s) who performed the analyses;
 - (v) The analytical techniques or methods used; and
 - (vi) The results of such analyses.
- (d) Monitoring results must be conducted according to test procedures approved under 40 CFR part 136, unless other test procedures have been specified in the permit.
- (e) State law provides that any person who tampers with or renders inaccurate any monitoring devices or method required by any provision of law, or any order, rule license, permit approval or decision is subject to the penalties set forth in 38 MRSA, §349.

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

D. REPORTING REQUIREMENTS

1. Reporting requirements.

- (a) Planned changes. The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required only when:
 - (i) The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
 - (ii) The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, nor to notification requirements under Section D(4).
 - (iii) The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan;
- (b) Anticipated noncompliance. The permittee shall give advance notice to the Department of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements.
- (c) Transfers. This permit is not transferable to any person except upon application to and approval of the Department pursuant to 38 MRSA, § 344 and Chapters 2 and 522.
- (d) Monitoring reports. Monitoring results shall be reported at the intervals specified elsewhere in this permit.
 - (i) Monitoring results must be reported on a Discharge Monitoring Report (DMR) or forms provided or specified by the Department for reporting results of monitoring of sludge use or disposal practices.
 - (ii) If the permittee monitors any pollutant more frequently than required by the permit using test procedures approved under 40 CFR part 136 or as specified in the permit, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Department.
 - (iii) Calculations for all limitations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified by the Department in the permit.
- (e) Compliance schedules. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit shall be submitted no later than 14 days following each schedule date.
- (f) Twenty-four hour reporting.
 - (i) The permittee shall report any noncompliance which may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the permittee becomes aware of the circumstances. A written submission shall also be provided within 5 days of the time the permittee becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.

- (ii) The following shall be included as information which must be reported within 24 hours under this paragraph.
 - (A) Any unanticipated bypass which exceeds any effluent limitation in the permit.
 - (B) Any upset which exceeds any effluent limitation in the permit.
 - (C) Violation of a maximum daily discharge limitation for any of the pollutants listed by the Department in the permit to be reported within 24 hours.
- (iii) The Department may waive the written report on a case-by-case basis for reports under paragraph (f)(ii) of this section if the oral report has been received within 24 hours.
- (g) Other noncompliance. The permittee shall report all instances of noncompliance not reported under paragraphs (d), (e), and (f) of this section, at the time monitoring reports are submitted. The reports shall contain the information listed in paragraph (f) of this section.
- (h) Other information. Where the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or information.
- 2. Signatory requirement. All applications, reports, or information submitted to the Department shall be signed and certified as required by Chapter 521, Section 5 of the Department's rules. State law provides that any person who knowingly makes any false statement, representation or certification in any application, record, report, plan or other document filed or required to be maintained by any order, rule, permit, approval or decision of the Board or Commissioner is subject to the penalties set forth in 38 MRSA, §349.
- 3. Availability of reports. Except for data determined to be confidential under A(9), above, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Department. As required by State law, effluent data shall not be considered confidential. Knowingly making any false statement on any such report may result in the imposition of criminal sanctions as provided by law.
- 4. Existing manufacturing, commercial, mining, and silvicultural dischargers. In addition to the reporting requirements under this Section, all existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Department as soon as they know or have reason to believe:
 - (a) That any activity has occurred or will occur which would result in the discharge, on a routine or frequent basis, of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":
 - (i) One hundred micrograms per liter (100 ug/l);
 - (ii) Two hundred micrograms per liter (200 ug/l) for acrolein and acrylonitrile; five hundred micrograms per liter (500 ug/l) for 2,4-dinitrophenol and for 2-methyl-4,6-dinitrophenol; and one milligram per liter (1 mg/l) for antimony;
 - (iii) Five (5) times the maximum concentration value reported for that pollutant in the permit application in accordance with Chapter 521 Section 4(g)(7); or
 - (iv) The level established by the Department in accordance with Chapter 523 Section 5(f).

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

- (b) That any activity has occurred or will occur which would result in any discharge, on a non-routine or infrequent basis, of a toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following ``notification levels":
 - (i) Five hundred micrograms per liter (500 ug/l);
 - (ii) One milligram per liter (1 mg/l) for antimony;
 - (iii) Ten (10) times the maximum concentration value reported for that pollutant in the permit application in accordance with Chapter 521 Section 4(g)(7); or
 - (iv) The level established by the Department in accordance with Chapter 523 Section 5(f).

5. Publicly owned treatment works.

- (a) All POTWs must provide adequate notice to the Department of the following:
 - (i) Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA or Chapter 528 if it were directly discharging those pollutants.
 - (ii) Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit.
 - (iii) For purposes of this paragraph, adequate notice shall include information on (A) the quality and quantity of effluent introduced into the POTW, and (B) any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.
- (b) When the effluent discharged by a POTW for a period of three consecutive months exceeds 80 percent of the permitted flow, the permittee shall submit to the Department a projection of loadings up to the time when the design capacity of the treatment facility will be reached, and a program for maintaining satisfactory treatment levels consistent with approved water quality management plans.

E. OTHER REQUIREMENTS

- 1. Emergency action power failure. Within thirty days after the effective date of this permit, the permittee shall notify the Department of facilities and plans to be used in the event the primary source of power to its wastewater pumping and treatment facilities fails as follows.
 - (a) For municipal sources. During power failure, all wastewaters which are normally treated shall receive a minimum of primary treatment and disinfection. Unless otherwise approved, alternate power supplies shall be provided for pumping stations and treatment facilities. Alternate power supplies shall be on-site generating units or an outside power source which is separate and independent from sources used for normal operation of the wastewater facilities.
 - (b) For industrial and commercial sources. The permittee shall either maintain an alternative power source sufficient to operate the wastewater pumping and treatment facilities or halt, reduce or otherwise control production and or all discharges upon reduction or loss of power to the wastewater pumping or treatment facilities.

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

- 2. Spill prevention. (applicable only to industrial sources) Within six months of the effective date of this permit, the permittee shall submit to the Department for review and approval, with or without conditions, a spill prevention plan. The plan shall delineate methods and measures to be taken to prevent and or contain any spills of pulp, chemicals, oils or other contaminates and shall specify means of disposal and or treatment to be used.
- 3. Removed substances. Solids, sludges trash rack cleanings, filter backwash, or other pollutants removed from or resulting from the treatment or control of waste waters shall be disposed of in a manner approved by the Department.
- 4. Connection to municipal sewer. (applicable only to industrial and commercial sources) All wastewaters designated by the Department as treatable in a municipal treatment system will be cosigned to that system when it is available. This permit will expire 90 days after the municipal treatment facility becomes available, unless this time is extended by the Department in writing.
- **F. DEFINITIONS.** For the purposes of this permit, the following definitions shall apply. Other definitions applicable to this permit may be found in Chapters 520 through 529 of the Department's rules

Average means the arithmetic mean of values taken at the frequency required for each parameter over the specified period. For bacteria, the average shall be the geometric mean.

Average monthly discharge limitation means the highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month. Except, however, bacteriological tests may be calculated as a geometric mean.

Average weekly discharge limitation means the highest allowable average of daily discharges over a calendar week, calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Best management practices ("BMPs") means schedules of activities, prohibitions of practices, maintenance procedures, and other management practices to prevent or reduce the pollution of waters of the State. BMPs also include treatment requirements, operating procedures, and practices to control plant site runoff, spillage or leaks, sludge or waste disposal, or drainage from raw material storage.

Composite sample means a sample consisting of a minimum of eight grab samples collected at equal intervals during a 24 hour period (or a lesser period as specified in the section on monitoring and reporting) and combined proportional to the flow over that same time period.

Continuous discharge means a discharge which occurs without interruption throughout the operating hours of the facility, except for infrequent shutdowns for maintenance, process changes, or other similar activities.

Daily discharge means the discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the average measurement of the pollutant over the day.

STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

Discharge Monitoring Report ("DMR") means the EPA uniform national form, including any subsequent additions, revisions, or modifications for the reporting of self-monitoring results by permittees. DMRs must be used by approved States as well as by EPA. EPA will supply DMRs to any approved State upon request. The EPA national forms may be modified to substitute the State Agency name, address, logo, and other similar information, as appropriate, in place of EPA's.

Flow weighted composite sample means a composite sample consisting of a mixture of aliquots collected at a constant time interval, where the volume of each aliquot is proportional to the flow rate of the discharge.

Grab sample means an individual sample collected in a period of less than 15 minutes.

Interference means a Discharge which, alone or in conjunction with a discharge or discharges from other sources, both:

- (1) Inhibits or disrupts the POTW, its treatment processes or operations, or its sludge processes, use or disposal; and
- (2) Therefore is a cause of a violation of any requirement of the POTW's NPDES permit (including an increase in the magnitude or duration of a violation) or of the prevention of sewage sludge use or disposal in compliance with the following statutory provisions and regulations or permits issued thereunder (or more stringent State or local regulations): Section 405 of the Clean Water Act, the Solid Waste Disposal Act (SWDA) (including title II, more commonly referred to as the Resource Conservation and Recovery Act (RCRA), and including State regulations contained in any State sludge management plan prepared pursuant to subtitle D of the SWDA), the Clean Air Act, the Toxic Substances Control Act, and the Marine Protection, Research and Sanctuaries Act.

Maximum daily discharge limitation means the highest allowable daily discharge.

New source means any building, structure, facility, or installation from which there is or may be a discharge of pollutants, the construction of which commenced:

- (a) After promulgation of standards of performance under section 306 of CWA which are applicable to such source, or
- (b) After proposal of standards of performance in accordance with section 306 of CWA which are applicable to such source, but only if the standards are promulgated in accordance with section 306 within 120 days of their proposal.

Pass through means a discharge which exits the POTW into waters of the State in quantities or concentrations which, alone or in conjunction with a discharge or discharges from other sources, is a cause of a violation of any requirement of the POTW's NPDES permit (including an increase in the magnitude or duration of a violation).

Permit means an authorization, license, or equivalent control document issued by EPA or an approved State to implement the requirements of 40 CFR parts 122, 123 and 124. Permit includes an NPDES general permit (Chapter 529). Permit does not include any permit which has not yet been the subject of final agency action, such as a draft permit or a proposed permit.

Person means an individual, firm, corporation, municipality, quasi-municipal corporation, state agency, federal agency or other legal entity.

MAINE POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT STANDARD CONDITIONS APPLICABLE TO ALL PERMITS

Point source means any discernible, confined and discrete conveyance, including, but not limited to, any pipe, ditch, channel, tunnel, conduit, well, discrete fissure, container, rolling stock, concentrated animal feeding operation or vessel or other floating craft, from which pollutants are or may be discharged.

Pollutant means dredged spoil, solid waste, junk, incinerator residue, sewage, refuse, effluent, garbage, sewage sludge, munitions, chemicals, biological or radiological materials, oil, petroleum products or byproducts, heat, wrecked or discarded equipment, rock, sand, dirt and industrial, municipal, domestic, commercial or agricultural wastes of any kind.

Process wastewater means any water which, during manufacturing or processing, comes into direct contact with or results from the production or use of any raw material, intermediate product, finished product, byproduct, or waste product.

Publicly owned treatment works ("POTW") means any facility for the treatment of pollutants owned by the State or any political subdivision thereof, any municipality, district, quasi-municipal corporation or other public entity.

Septage means, for the purposes of this permit, any waste, refuse, effluent sludge or other material removed from a septic tank, cesspool, vault privy or similar source which concentrates wastes or to which chemicals have been added. Septage does not include wastes from a holding tank.

Time weighted composite means a composite sample consisting of a mixture of equal volume aliquots collected over a constant time interval.

Toxic pollutant includes any pollutant listed as toxic under section 307(a)(1) or, in the case of sludge use or disposal practices, any pollutant identified in regulations implementing section 405(d) of the CWA. Toxic pollutant also includes those substances or combination of substances, including disease causing agents, which after discharge or upon exposure, ingestion, inhalation or assimilation into any organism, including humans either directly through the environment or indirectly through ingestion through food chains, will, on the basis of information available to the board either alone or in combination with other substances already in the receiving waters or the discharge, cause death, disease, abnormalities, cancer, genetic mutations, physiological malfunctions, including malfunctions in reproduction, or physical deformations in such organism or their offspring.

Wetlands means those areas that are inundated or saturated by surface or ground water at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions. Wetlands generally include swamps, marshes, bogs, and similar areas.

Whole effluent toxicity means the aggregate toxic effect of an effluent measured directly by a toxicity test.

MAINE POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT AND MAINE WASTE DISCHARGE LICENSE

FACT SHEET

Date: June 9, 2015

PERMIT NUMBER:

ME0020427

LICENSE NUMBER:

W007759-5S-G-R

NAME AND ADDRESS OF APPLICANT:

MAINE ELECTRONICS, INC. 19 Saint Anne Street Lisbon, ME. 04250

COUNTY:

Androscoggin County

NAME AND ADRESS WHERE DISCHARGE OCCURS:

19 Saint Anne Street Lisbon, ME. 04250

RECEIVING WATER/CLASSIFICATION:

Sabattus River/Class C

COGNIZANT OFFICIAL AND TELEPHONE NUMBER: Mr. Thomas D. Gentner, V.P.

Mr. William Sanborn, Operator

(207) 353-8612

e-mail: thomas.gentner@rockwellcollins.com

1. APPLICATION SUMMARY

a. Application – Maine Electronic Inc. (MEI hereinafter) has filed a timely and complete application to the Department for the renewal of combination Maine Pollutant Discharge Elimination System (MEPDES) permit ME0020247/Maine Waste Discharge License (WDL) #W007759-5S-E-R, (permit hereinafter) which was issued on by the Department on May 13, 2010, for a five-year term. The permit approved a discharge of up to a daily maximum of 79,000 gallons per day (gpd) or 0.079 million gallons per day (MGD) of treated ground water from a former electronic circuit board manufacturing complex to the Sabattus River, Class C, in Lisbon, Maine. The May 13, 2010 permit was modified on September 11, 2013, by removing the water quality based limitations and monitoring requirements for inorganic arsenic given the human AWQC was revised on July 29, 2012, and the discharge no longer had a reasonable potential exceed said revised criteria. See Attachment A of this Fact Sheet for a location map for the facility.

1. APPLICATION SUMMARY (cont'd)

b. Source Description: Maine Electronics manufactured circuit boards at the Lisbon facility from 1971 to 1989. In the late 1980's, ground water contamination was discovered on the Maine Electronics property and further investigation indicated that the contamination had migrated off-site and was detected in the public drinking water source on the Moody Road. On July 29, 1991, the Department issued a Compliance Order to Maine Electronics that contained requirements to address ground water contamination, including investigation and remediation. The ground water investigation and remediation provisions of that Compliance Order have been largely superseded by the requirements contained in the Hazardous Waste Facility Post Closure Licenses issued by the Department, the most recent of which is O-000153-HG-C-R issued in September of calendar year 2003.

In June of 1991, Woodard and Curran, on behalf of Maine Electronics, submitted an application to the Department for a waste discharge license for the pump and treat remediation project.

On April 3, 1993, the EPA issued a NPDES permit exclusion, pursuant to 40 CFR, 122.3(d), authorizing the discharge for a pilot test of the recovery and treatment system. The permit exclusion specified a flow limitation of fifty-five (55) gallons per minute and established concentration limitations for specific elements and compounds expected to be present in the discharge from the treatment system. The permit exclusion was in effect until the EPA issued the NPDES permit on August 9, 1994.

On June 3, 1993, Maine Electronics received approval from the Department for the start-up and operation of the remedial pump and treat system over a short-term pilot test period. Maine Electronics had requested the pilot test operation in order to collect operational and treatability data to evaluate the long-term treatment requirements for the remediation of the ground water. During operation, influent and effluent water quality samples were collected for laboratory analysis and subsequently reported to EPA and Department. In addition, Maine Electronics engaged a firm to conduct one set of whole effluent toxicity (WET) tests (acute and chronic testing on vertebrate and invertebrate species) utilizing the treated effluent. Priority pollutant testing was conducted on an additional sample of effluent collected at the same time as the sample for WET testing. At the completion of the pilot test period in October 1993, Maine Electronics considered whether to continue operating the system or shut it down until the appropriate State WDL and federal NPDES permit were issued. Maine Electronics chose to suspend operation of the system in order to avoid an exceedence of the concentration limitations established in the EPA permit exclusion.

1. APPLICATION SUMMARY (cont'd)

Based on the results of the pilot test operation, it became apparent in discussions between Maine Electronics and the Department that the issuance of a WDL would require the development of a site specific criterion for arsenic or the development of a new treatment technology for arsenic. In the absence of a State toxicologist in 1993, the Department obtained the services of a toxicologist in the State's Department of Agriculture. After a review of up-to-date scientific literature on the components that are factored into the equation for establishing water quality criteria that is protective of human health, the toxicologist rendered a decision on an interim effluent limitation for arsenic. The interim limitation for arsenic permitted Maine Electronics to continue operating the pump and treat system, remediate ground water on-site and remove a potential threat to the adjacent aquifer that supplies water to the municipal well located at Moody Road while a site specific criterion or new treatment technology for arsenic were developed. Additional water quality data collected during the term of the license would provide further insight into the occurrence and variation of arsenic levels over time and aid in the toxicological assessment for the long term discharge.

c. Waste Water Treatment: The ground water treatment system consists of air stripping to remove volatile organic compounds (VOCs). Periodically, the air stripper is cleaned to maintain air-water flow conditions at optimum performance levels. The cleaning with a weak acid removes inorganics that precipitate out on the interior surfaces of the air stripper. Residue collected as a result of cleaning the air stripper media is properly disposed of in accordance with federal and State regulations. The treated ground water will be discharged to the Sabattus River via a concrete pipe measuring 18 inches in diameter that extends three to four feet out into the river.

It is noted the permittee has not discharged to the Sabattus River as of the date of this permitting action as the waste water generated to date has been conveyed to the Town of Lisbon's publicly owned treatment works. The permittee has requested to retain a permit to discharge to the Sabattus River due to clauses in a document entitled, Agreement For Sewer Use, Town of Lisbon Industrial Waste Water Discharge Permit #70799, dated July 7, 1994 and subsequently renewed several times with an expiration date of December 31, 2015. Under the agreement, the Town of Lisbon may unilaterally modify, suspend or revoke the aforementioned local permit if conditions warrant such action. Should the Town of Lisbon revoke the local permit and a discharge to the Sabattus River is realized, the terms and conditions of this MEPDES permit become effectively immediately.

2. PERMIT SUMMARY

With the exception of inorganic arsenic, this permit is carrying forward all the terms and conditions of the previous permitting action. The May 13, 2010 permit was modified on September 11, 2013, by removing the water quality based limitations and monitoring requirements for inorganic arsenic given the human AWQC was revised on July 29, 2012, and the discharge no longer had a reasonable potential to exceed said revised criteria.

3. CONDITIONS OF PERMITS

Maine law, 38 M.R.S.A. Section 414-A, requires that the effluent limitations prescribed for discharges, including, but not limited to, effluent toxicity, require application of best practicable treatment (BPT), be consistent with the U.S. Clean Water Act, and ensure that the receiving waters attain the State water quality standards as described in Maine's Surface Water Classification System. In addition, 38 M.R.S.A., Section 420 and Department rule 06-096 CMR Chapter 530, Surface Water Toxics Control Program, require the regulation of toxic substances not to exceed levels set forth in Department rule 06-096 CMR Chapter 584, Surface Water Quality Criteria for Toxic Pollutants, and that ensure safe levels for the discharge of toxic pollutants.

4. RECEIVING WATER QUALITY STANDARDS

Maine law, 38 M.R.S.A., Section 467(1)(D)(3) classifies the Sabattus River as a Class C waterway. Maine law, 38 M.R.S.A., §465(4) contains the classification standards for Class C waters as follows:

- A. Class C waters must be of such quality that they are suitable for the designated uses of drinking water supply after treatment; fishing; agriculture; recreation in and on the water; industrial process and cooling water supply; hydroelectric power generation, except as prohibited under Title 12, section 403; navigation; and as a habitat for fish and other aquatic life.
- B. The dissolved oxygen content of Class C water may be not less than 5 parts per million or 60% of saturation, whichever is higher, except that in identified salmonid spawning areas where water quality is sufficient to ensure spawning, egg incubation and survival of early life stages, that water quality sufficient for these purposes must be maintained. In order to provide additional protection for the growth of indigenous fish, the following standards apply.

4. WATER QUALITY STANDARDS (cont'd)

- (1) The 30-day average dissolved oxygen criterion of a Class C water is 6.5 parts per million using a temperature of 22 degrees centigrade or the ambient temperature of the water body, whichever is less, if:
 - (a) A license or water quality certificate other than a general permit was issued prior to March 16, 2004 for the Class C water and was not based on a 6.5 parts per million 30-day average dissolved oxygen criterion; or
 - (b) A discharge or a hydropower project was in existence on March 16, 2005 and required but did not have a license or water quality certificate other than a general permit for the Class C water. This criterion for the water body applies to licenses and water quality certificates issued on or after March 16, 2004.
- (2) In Class C waters not governed by subparagraph (1), dissolved oxygen may not be less than 6.5 parts per million as a 30-day average based upon a temperature of 24 degrees centigrade or the ambient temperature of the water body, whichever is less. This criterion for the water body applies to licenses and water quality certificates issued on or after March 16, 2004. The department may negotiate and enter into agreements with licensees and water quality certificate holders in order to provide further protection for the growth of indigenous fish. Agreements entered into under this paragraph are enforceable as department orders according to the provisions of sections 347-A to 349.

Between May 15th and September 30th, the number of Escherichia coli bacteria of human and domestic animal origin in Class C waters may not exceed a geometric mean of 126 per 100 milliliters or an instantaneous level of 236 per 100 milliliters. In determining human and domestic animal origin, the department shall assess licensed and unlicensed sources

using available diagnostic procedures. The board shall adopt rules governing the procedure for designation of spawning areas. Those rules must include provision for periodic review of designated spawning areas and consultation with affected persons prior to designation of a stretch of water as a spawning area.

C. Discharges to Class C waters may cause some changes to aquatic life, except that the receiving waters must be of sufficient quality to support all species of fish indigenous to the receiving waters and maintain the structure and function of the resident biological community. This paragraph does not apply to aquatic pesticide or chemical discharges approved by the department and conducted by the department, the Department of Inland Fisheries and Wildlife or an agent of either agency for the purpose of restoring biological communities affected by an invasive species.

5. RECEIVING WATER CONDITIONS

A 9.1-mile Class C segment of Sabattus River (ABD Assessment Unit ID ME0104000210_418R01, is listed in a table entitled, Category 5-A: Rivers And Streams Impaired By Pollutants Other Than Those Listed In 5-B Through 5-D (TMDL Required) in a document entitled The 2012 Integrated Water Quality Monitoring and Assessment Report, published by the Department. The table states that aquatic life standards are impaired due to insufficient dissolved oxygen and excessive nutrient loading due to Sabattus Lake's eutrophic state and point and non-point source loadings from the municipal waste water treatment facility and agricultural runoff. The Department collected additional ambient water quality data during the summer of calendar year 2002 to supplement a data set collected in August of calendar year 2000. To address the aforementioned water quality issues, the Department is required to prepare a Total Maximum Daily Load (TMDL) report for review and approval by the EPA. The Department has not completed the TMDL as of the date of this permitting action.

Given the nature of the discharge from the Maine Electronics facility (ground water), the Department has made a determination that the discharge will not cause or contribute to the failure of the Sabattus River to meet the standards of its assigned classification.

6. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

- a. <u>Flow</u>: The previous permitting action established monthly average and daily maximum flow limitations of 0.066 MGD and 0.072 MGD respectively for Tier I and monthly average and daily maximum flow limitations of 0.072 MGD and 0.079 MGD respectively, for Tier II. All four flow limitations are being carried forward in this permitting action.
- b. Temperature Department regulation Chapter 582 Regulations Relating to Temperature, states that no discharge shall cause the ambient temperature of any freshwater body such as a stream or river, as measured outside a mixing zone, to be raised more than 5°F. The regulation also limits a discharger to an in-stream temperature increase (ΔT) of 0.5° F above the ambient receiving water temperature when the weekly average temperature of the receiving water is greater than or equal to 66° F or when the daily maximum temperature is greater than or equal to 73° F. The temperature thresholds are based on EPA water quality criterion for the protection of brook trout and Atlantic salmon (both species indigenous to the Sabattus River). The weekly average temperature of 66° F was derived to protect for the growth of the brook trout and the daily maximum threshold temperature of 73° F protects for the survival of juveniles and adult Atlantic salmon during the summer months. As a point of clarification, the Department interprets the term "weekly average temperature" to mean a seven (7) day rolling average.

To promote consistency, the Department also interprets the ΔT of 0.5° F as a weekly rolling average criteria when the receiving water temperature is \geq 66° F and <73° F. When the receiving water is \geq 73°F the ΔT of 0.5° F is a daily criteria. The Department has determined that the 7Q10 low flow for the Sabattus River is 4.5 cfs or 1.62 MGD based on the required minimum low flow release from Sabattus Lake and low flow data collected by the Department in calendar year 2002.

This permitting action is carrying forward the seasonal (summer - June 1 through September 30) daily maximum temperature limitation of 70°F established in the previous licensing actions as it has been determined to be representative of the daily maximum temperature of the discharge during the summer months.

The Department has determined that these limitations are well within the criteria established in Chapter 582 as the maximum temperature increase in the receiving water during the critical time of the year (June 1 – September 30) is 0.11° F. This determination is based on the assumption that the discharge is at the Tier II daily maximum discharge flow limit of 0.079 MGD, the daily maximum discharge temperature limit of 70° F, the receiving water flow at the 1Q10 critical low flow of 4.2 cfs (2.71 MGD) and the receiving water is at the critical threshold of 66° F. The calculation is as follows:

$$(70^{\circ} \text{ F})(0.079 \text{ MGD}) + (66^{\circ} \text{ F})(2.71 \text{ MGD}) = 66.11^{\circ} \text{ F}$$

 $(0.079 \text{ MGD}) + (2.71 \text{ MGD})$

c. <u>Dilution Factors</u> - The Department establishes applicable dilution factors for discharges in accordance with freshwater protocols established in Department Rule Chapter 530, <u>Surface Water Toxics Control Program</u>, October 2005. With a monthly average and daily maximum permit flow limits of 0.066 MGD and 0.072 MGD for Tier I and 0.072 MGD and 0.079 MGD for Tier II respectively, and critical receiving water low flow values of 4.2 cfs⁽¹⁾ (1Q10), 4.5 cfs⁽¹⁾ (7Q10) and 13.5 cfs⁽²⁾ (harmonic mean) the dilution factors are as follows:

Tier I

Acute:
$$1Q10 = 4.2 \text{ cfs}$$
 $\Rightarrow (4.2 \text{ cfs})(0.6464) + (0.072 \text{ MGD}) = 39:1$ (0.072 MGD)

Chronic:
$$7Q10 = 4.5 \text{ cfs}$$
 $\Rightarrow (4.5 \text{ cfs})(0.6464) + (0.066 \text{ MGD}) = 45:1$ (0.066 MGD)

Harmonic Mean: = 13.5 cfs
$$\Rightarrow$$
 (13.5 cfs)(0.6464) + (0.066 MGD) = 133:1 (0.066 MGD)

Tier II

Acute: 1Q10 = 4.2 cfs

 \Rightarrow (4.2 cfs)(0.6464) + (0.079 MGD) = 35:1

(0.079 MGD)

Chronic: 7Q10 = 4.5 cfs

 \Rightarrow (4.5 cfs)(0.6464) + (0.072 MGD) = 41:1

(0.072 MGD)

Harmonic Mean: = 13.5 cfs \Rightarrow (13.5 cfs)(0.6464) + (0.072 MGD) = 122:1

(0.072 MGD)

Footnotes:

- 1) The 7010 and 1010 critical low flow values for the Sabattus River take into consideration the minimum low flow requirements in the April 16, 2001 Water Level Order approved for Sabattus Lake by the Sabattus Lake Dam Commission and low flow data for the Sabattus River collected by the Department in calendar year 2002.
- 2) The harmonic mean dilution factor is approximated by multiplying the chronic dilution factor by three (3). This multiplying factor is based on guidelines for estimation of human health dilution presented in the USEPA publication Technical Support Document for Water Quality-Based Toxics Control (Office of Water; EPA/505/2-90-001, page 88), and represents an estimation of harmonic mean flow.
- d. Whole effluent toxicity (WET) testing WET monitoring is required to assess and protect against impacts upon water quality and designated uses caused by the aggregate effect of the discharge on specific aquatic organisms. Acute and chronic WET tests are performed on invertebrate and vertebrate species. Priority pollutant and analytical chemistry testing is required to assess the levels of individual toxic pollutants in the discharge, comparing each pollutant to acute, chronic, and human health AWQC as established in Chapter 584.

Chapter 530 establishes four categories of testing requirements based predominately on the chronic dilution factor. The categories are as follows:

- 1) Level I chronic dilution factor of <20:1.
- 2) Level II chronic dilution factor of $\geq 20:1$ but $\leq 100:1$.
- 3) Level III chronic dilution factor \geq 100:1 but <500:1 or >500:1 and Q \geq 1.0 MGD
- 4) Level IV chronic dilution >500:1 and Q \leq 1.0 MGD

Department rule Chapter 530 (1)(D) specifies the criteria to be used in determining the minimum monitoring frequency requirements for WET, priority pollutant and analytical chemistry testing. Based on the Chapter 530 criteria, the permittee's facility falls into the Level II frequency category as the facility has a chronic dilution factor of >20:1 but <100:1. Chapter 530(1)(D)(1) specifies that <u>routine</u> screening and surveillance level testing requirements are as follows:

Screening level testing – Beginning 24 months prior to permit expiration and lasting through 12 months prior to permit expiration (Year 4 of the term of the permit) and every five years thereafter if a timely request for renewal has been made and the permit continues in force, or is replaced by a permit renewal containing this requirement, the permittee shall conduct screening level testing as follows:

Level	WET Testing	Priority pollutant	Analytical chemistry
		testing	
II	2 per year	1 per year	4 per year

Surveillance level testing – Beginning upon permit issuance and lasting through 24 months prior to permit expiration (Years 1, 2 & 3 of the term of the permit) and commencing again 12 months prior to permit expiration (Year 5 of the term of the permit), the permittee shall conduct surveillance level testing as follows

Level	WET Testing	Priority pollutant testing	Analytical chemistry
II	1 per year	None required	2 per year

Special Condition A, Effluent Limitations and Monitoring Requirements, of this permit requires the permittee to commence WET testing beginning upon commencement of a continuous discharge (30 consecutive days or 45 days within any 12-month period) and lasting through a minimum of twelve (12) consecutive months. Once the screening level of testing is completed, the Department will perform a statistical evaluation on the WET test results to determine if the discharge exceeds or has a reasonable potential to exceed the applicable acute and chronic critical ambient water quality thresholds of 2.6% and 2.2% respectively for Tier I and 2.8% and 2.4% respectively for Tier II. If necessary, this permit may be reopened pursuant to Special Condition G, Reopening of Permit For Modifications, to establish applicable limitations and or additional monitoring requirements.

e. <u>Chemical specific testing</u> - Parameters that have been limited by this permit and the previous permit have been previously identified or expected to be present in the treated ground water. The compounds were identified in the October 1994 waste discharge license application and subsequent correspondence submitted to the Department by the permittee, as well as the State Compliance Order issued in 1991.

Maine Law, 38 M.R.S.A, Sections 414-A and 420, Maine Rules Chapter 523(5)(d)(i), prohibit the discharge of effluents containing substances in amounts which would cause the surface waters of the State to contain toxic substance above levels set forth in federal ambient water quality criteria (AWQC) as established by the U.S. EPA. Accordingly, the discharge is subject to effluent monitoring requirements pursuant to Department rule 06-096 CMR Chapter 530, Surface Water Toxics Control Program, and ambient water quality criteria (AWQC) established in Department rule 06-096 CMR Chapter 584, Surface Water Quality Criteria for Toxic Pollutants, that ensure safe levels for the discharge of toxic pollutants.

Permit limitations based on human health criteria have been calculated utilizing an AWQC associated with the consumption of water and organisms from the receiving water, as one of the designated uses of the Sabattus River include "... a drinking water supply after treatment, fishing...."

The EPA, <u>Technical Support Document for Water Quality Based Toxics Control</u>, <u>March 1991</u>, recommends the harmonic mean river flow be used in calculating limitations for carcinogens. If there is insufficient data to calculate the harmonic flow of the river, permit writers are authorized to utilize a flow that is three (3) times the 7Q10 flow. The 7Q10 is defined as the lowest observed seven (7) consecutive days of flow recorded over a ten (10) year reoccurrence interval.

Limitations for non-carcinogenic constituents were established to protect the aquatic community from acute and chronic effects of the discharge. Maximum daily limits are based on the maximum daily flow limitation (0.072 MGD for Tier I and 0.079 MGD for Tier II) from the facility, the 1Q10 river flow (lowest observed one (1) day flow recorded over a ten (10) year reoccurrence interval) and the criteria maximum concentration (CMC - acute). The monthly average limitations are based on the monthly average flow limitation (0.066 MGD for Tier I and 0.072 MGD for Tier II) from the facility, the 7Q10 river flow and the criteria continuous concentration (CCC - chronic). For parameters without an established CMC and or CCC, the next most stringent criteria, maximum

contamination levels (MCL) were utilized to derive the effluent limitation. In the absence of a CMC, CCC or MCL the State's human health maximum exposure guidelines (MEG) July 28, 2008, that utilizes a risk level of (10-5) and a harmonic mean river flow were used to derive monthly average limitations.

The Fact Sheet of the 8/17/04 permit contained the following text "The mass and concentration limits calculated for the VOCs in this Fact Sheet are less stringent than the previous State WDL issued on February 2, 1999 and the federal NPDES issued by the EPA on August 5, 1994. The Fact Sheet attached to the 8/5/94 NPDES permit states that the calculated end-of-pipe mass and concentration limits "... have been reduced by 80% so that the permitted discharge utilizes no more 20% of the total maximum daily load allowable in the Sabattus River." This methodology for establishing permit limits originated with a mid-1980's Department practice of limiting new or increased discharges to not consuming more than 20% of the remaining assimilative capacity of a receiving water. The intent was to always reserve a portion of the remaining assimilative capacity for future discharges. It remains Department practice to consider any discharge that consumes 20% or more of the remaining assimilative capacity of a receiving water to be a significant lowering of water quality under the State's antidegradation policy described more fully below."

Chapter 530 (promulgated on October 12, 2005) §4(C), states "The background concentration of specific chemicals must be included in all calculations using the following procedures. The Department may publish and periodically update a list of default background concentrations for specific pollutants on a regional, watershed or statewide basis. In doing so, the Department shall use data collected from reference sites that are measured at points not significantly affected by point and non-point discharges and best calculated to accurately represent ambient water quality conditions. The Department shall use the same general methods as those in section 4(D) to determine background concentrations. For pollutants not listed by the Department, based on previously collected data from 60 rivers and streams statewide, in the absence of ambient data, an assumed concentration of 10% of the applicable water quality criteria must be used in calculations." The Department has limited information on the background levels of metals in the water column in the Sabattus River in the vicinity of the permittee's outfall. Therefore, a default background concentration of 10% of the applicable water quality criteria is being used in the calculations of this permitting action.

Chapter 530 4(E), states "In allocating assimilative capacity for toxic pollutants, the Department shall hold a portion of the total capacity in an unallocated reserve to allow for new or changed discharges and non-point source contributions. The unallocated reserve must be reviewed and restored as necessary at intervals of not more than five years. The water quality reserve must be not less than 15% of the total assimilative quantity." Therefore, the Department is reserving 15% of the applicable water quality criteria in the calculations of this permitting action.

Due to the Chapter 530 criteria regarding withholding 10% of the assimilative capacity of the receiving water for background and 15% of the assimilative capacity for reserve, this permitting action is not carrying forward the additional withholding of 20% of the assimilative capacity as this would be considered "double counting" the withholdings.

Chapter 530 §(3)(E) states "... that a discharge contains pollutants or WET at levels that have a reasonable potential to cause or contribute to an exceedence of water quality criteria, appropriate water quality-based limits must be established in any licensing action."

Chapter 530 §4(F) states in part "Where there is more than one discharge into the same fresh or estuarine receiving water or watershed, the Department shall consider the cumulative effects of those discharges when determining the need for and establishment of the level of effluent limits. The Department shall calculate the total allowable discharge quantity for specific pollutants, less the water quality reserve and background concentration, necessary to achieve or maintain water quality criteria at all points of discharge, and in the entire watershed. The total allowable discharge quantity for pollutants must be allocated consistent with the following principles.

Evaluations must be done for individual pollutants of concern in each watershed or segment to assure that water quality criteria are met at all points in the watershed and, if appropriate, within tributaries of a larger river.

The total assimilative capacity, less the water quality reserve and background concentration, may be allocated among the discharges according to the past discharge quantities for each as a percentage of the total quantity of discharges, or another comparable method appropriate for a specific situation and pollutant. Past discharges of pollutants must be determined using the average concentration discharged during the past five years and the facility's licensed flow.

The amount of allowable discharge quantity may be no more than the past discharge quantity calculated using the statistical approach referred to in section 3(E) [Section 3.3.2 and Table 3-2 of USEPA's "Technical Support Document for Water Quality-Based Toxics Control"] of the rule, but in no event may allocations cause the water quality reserve amount to fall below the minimum referred to in 4(E) [15% of the total assimilative capacity]. Any difference between the total allowable discharge quantity and that allocated to existing dischargers must be added to the reserve.

The previous permitting action established monthly average and or daily maximum mass limits for the volatile organic compounds based on allocating 100% of the assimilative capacity of the Sabattus River and established monthly average and or daily maximum mass limits for metals based on allocating 20% of the assimilative capacity of the Sabattus River. Pursuant to Chapter 530, this permitting action is establishing the

monthly average and daily maximum water quality based mass limitations for all parameters based on 75% of the assimilative capacity of the Sabattus River or something less taking into consideration the discharge of toxic pollutants of concern being discharged from the Sabattus Sanitary District's waste water treatment facility located approximately 5 miles upstream of the MEI facility.

The Sabattus River is a tributary to the Androscoggin River. One municipal waste water treatment facility that is subject to the Department's Chapter 530 testing requirements discharges to the Sabattus River. The waste water treatment facility is the Sabattus Sanitary District located approximately 5 miles upstream from the MEI facility. As previously cited, Chapter 530 requires that AWQC must be met at the confluence of the Sabattus River and the Androscoggin River as well as at the individual discharge points on the Sabattus River after taking into consideration historic discharge levels for the two facilities as well as an allocation dedicated to background (10% of AWQC) and a reserve (15% of AWQC).

See Attachment B of this Fact Sheet Based on Department guidance that establishes protocols for establishing waste load allocations. The guidance states that the most protective of water quality becomes the facility's allocation.

Volatile Organic Compounds (VOCs)

Based on the fact the volatile organic compounds regulated by this permit and the last permitting action are unique to this discharge, the Department is utilizing the individual allocation method for determining limitations in this permit. The monthly average limitations for VOCs in this permitting action were derived utilizing the following equation.

EOP concentration = [Dilution factor x $0.75 \times AWQC$ in ug/L] + $[0.25 \times AWQC$ in ug/L]

Mass limit = $(EOP \text{ concentration in ug/L})(8.34 \text{ lbs/gal})(Permit flow limit in MGD})$ 1000 ug/mg

f. <u>Perchloroethylene (Tetrachloroethylene)</u> – The 5/13/10 permitting action established water quality based <u>monthly average</u> mass and concentration limits as follows:

Tier I

Mass: 0.032 lbs/day

Concentration: 118 ug/L

Tier II

Mass: 0.032 lbs/day

Concentration: 108 ug/L

The limits were based on the human health AWQC of 0.59 ug/L (associated with the consumption of water and organisms), the harmonic mean dilution factor of 133:1 (Tier I) and 122:1 (Tier II) and the monthly average permit flow limit of 0.066 MGD (Tier I) and 0.072 MGD (Tier II). The mass limitations for perchloroethylene (tetrachloroethylene) in the 5/13/10 permit were derived as follows:

Tier I

EOP concentration: (133)(0.75)(0.59 ug/L) + (0.25)(0.59 ug/L) = 59 ug/L

Mass: (59 ug/L)(8.34)(0.066 MGD) = 0.032 lbs/day1000 ug/mg

Tier II

 $\overline{Concentration}(122)(0.75)(0.59 \text{ ug/L}) + (0.25)(0.59 \text{ ug/L}) = 54 \text{ ug/L}$

Mass: (54 ug/L)(8.34)(0.072 MGD) = 0.032 lbs/day1,000 ug/mg

As for concentration, Chapter 530 §(3)(D)(1) states "For specific chemicals, effluent limits must be expressed in total quantity that may be discharged and in effluent concentration. In establishing concentration, the Department may increase allowable values to reflect actual flows that are lower than permitted flows and/or provide opportunities for flow reductions and pollution prevention provided water quality criteria are not exceeded. With regard to concentration limits, the Department may review past and projected flows and set limits to reflect proper operation of the treatment facilities that will keep the discharge of pollutants to the minimum level practicable."

Since the adoption of Chapter 530, the Department has a developed a policy by which to establish equitable concentration limits in permits that are greater than calculated end-of-pipe concentrations. In general, most dischargers subject to the Chapter 530 testing requirements are discharging at or about 50% of the flow limitations established in their permits. This provides the Department with the flexibility to establish higher concentration limits in the permit while still maintaining compliance with the water quality based mass limitations. With an actual discharge flow at ½ (0.5) of permitted flow rate, a concentration limit of two times (mathematical inverse of 0.5) the calculated end-of-pipe concentration, will maintain compliance with water quality based mass limits. Therefore, this permitting action is establishing concentration limitations that are two (2) times higher than the calculated end-of-pipe concentrations. The permittee must keep in mind, if flows greater than 50% of the permitted flow are realized, the concentration in the effluent must be reduced proportional to maintain compliance with the mass limitations.

Volatile Organic Compounds (VOCs)

Concentration limitations for perchloroethylene in this permitting action were derived as follows;

Tier I

Permit concentration limit: (59 ug/L)(2.0) = 118 ug/L

Tier II

Permit concentration limit: (54 ug/L)(2.0) = 108 ug/L

g. <u>1.1 Dichloroethane</u> – The 5/10/13 permitting action established water quality based monthly average mass and concentration limits as follows:

Tier I

Mass: 3.8 lbs/day

Concentration: 14.0 mg/L

Tier II

Mass: 3.8 lbs/day

Concentration: 12.8 mg/L

The limits were based on the State of Maine's July 28 2008 interim MEG of 70 ug/L, the harmonic mean dilution factor of 133:1 (Tier I) and 122:1 (Tier II) and the monthly average permit flow limit of 0.066 MGD (Tier I) and 0.072 MGD (Tier II). The mass limitations for 1,1 dichloroethane in the 5/13/10 permit were derived as follows:

Tier I

EOP concentration: (133)(0.75)(70 ug/L) + (0.25)(70 ug/L) = 7,000 ug/L

Mass: (7,000 ug/L)(8.34)(0.066 MGD) = 3.8 lbs/day1,000 ug/mg

<u>Tier II</u>

Concentration(122)(0.75)(70 ug/L) + (0.25)(70 ug/L) = 6,423 ug/L

Mass: (6.423 ug/L)(8.34)(0.072 MGD) = 3.8 lbs/day1000 ug/mg

Concentration limitations for 1,1 dichloroethane in the 5/13/10 permit were derived as follows;

Tier I

Permit concentration limit: (7,000 ug/L)(2.0) = 14,000 ug/L

Tier II

Permit concentration limit: (6,423 ug/L)(2.0) = 12,846 ug/L

Volatile Organic Compounds (VOCs)

h. <u>1,1,1 Trichloroethane</u> – The 5/13/10 permitting action established water quality based monthly average mass and concentration limits as follows:

Tier I

Mass: 11 lbs/day

Concentration: 40 mg/L

Tier II

Mass: 11 lbs/day

Concentration: 36.7 mg/L

The limits were based on the State of Maine's July 28, 2008 interim MEG of 200 ug/L, the harmonic mean dilution factor of 133:1 (Tier I) and 122:1 (Tier II) and the monthly average permit flow limit of 0.066 MGD (Tier I) and 0.072 MGD (Tier II). The mass limitations for 1,1,1 trichloroethane in the 5/13/10 permit were derived as follows:

Tier I

EOP concentration: (133)(0.75)(200 ug/L) + (0.25)(200 ug/L) = 20,000 ug/L

Mass: (20,000 ug/L)(8.34)(0.066 MGD) = 11 lbs/day1,000 ug/mg

Tier II

EOP concentration: (122)(0.75)(200 ug/L) + (0.25)(200 ug/L) = 18,350 ug/L

Mass: (18,350 ug/L)(8.34)(0.072 MGD) = 11 lbs/day1,000 ug/mg

Concentration limitations for 1,1,1 trichloroethane in this permitting action were derived as follows;

Tier I

 \overline{Permit} concentration limit: (20,000 ug/L)(2.0) = 40,000 ug/L

Tier II

 \overline{Permit} concentration limit: (18,350 ug/L)(2.0) = 36,700 ug/L

Volatile Organic Compounds (VOCs)

i. <u>Trichloroethylene</u> – The 5/13/10 permitting action established water quality based monthly average mass and concentration limits as follows:

Tier I

Mass: 0.13 lbs/day

Concentration: 474 ug/L

Tier II

Mass: 0.13 lbs/day

Concentration: 435 ug/L

The limits were established based on the human health AWQC of 2.37 ug/L (associated with the consumption of water and organisms), the harmonic mean dilution factor of 133:1 (Tier I) and 122:1 (Tier II) and the monthly average permit flow limit of 0.066 MGD (Tier I) and 0.072 MGD (Tier II). The mass limitations for trichloroethylene in the 5/13/10 permit were derived as follows:

Tier I

EOP concentration: (133)(0.75)(2.37 ug/L) + (0.25)(2.37 ug/L) = 237 ug/L

Mass: (237 ug/L)(8.34)(0.066 MGD) = 0.13 lbs/day1,000 ug/mg

Tier II

EOP concentration: (122)(0.75)(2.37 ug/L) + (0.25)(2.37 ug/L) = 217 ug/L

Mass: (217 ug/L)(8.34)(0.072 MGD) = 0.13 lbs/day1,000 ug/mg

Concentration limitations for trichloroethylene in this permitting action were derived as follows;

Tier I

Permit concentration limit: (237 ug/L)(2.0) = 474 ug/L

Tier II

Permit concentration limit: (217 ug/L)(2.0) = 435 ug/L

Volatile Organic Compounds (VOCs)

j. <u>Methylene Chloride</u> – The 5/10/13 permitting action established water quality based monthly average mass and concentration limits as follows:

Tier I

Mass: 0.25 lbs/day

Concentration: 920 ug/L

Tier II

Mass: 0.25 lbs/day

Concentration: 844 ug/L

The limits were established based on the human health AWQC of 4.6 ug/L (associated with the consumption of water and organisms), the harmonic mean dilution factor of 133:1 (Tier I) and 122:1 (Tier II) and the monthly average permit flow limit of 0.066 MGD (Tier I) and 0.072 MGD (Tier II). The mass limitations for methylene chloride in the 5/10/13 permit were derived as follows:

Tier I

EOP concentration: (133)(0.75)(4.6 ug/L) + (0.25)(4.6 ug/L) = 460 ug/L

Mass: (460 ug/L)(8.34)(0.066 MGD) = 0.25 lbs/day1,000 ug/mg

Tier II

 \overline{EOP} concentration: (122)(0.75)(4.6 ug/L) + (0.25)(4.6 ug/L) = 422 ug/L

Mass: (422 ug/L)(8.34)(0.072 MGD) = 0.25 lbs/day1,000 ug/mg

Concentration limitations for methylene chloride in this permitting action were derived as follows;

Tier I

Permit concentration limit: (460 ug/L)(2.0) = 920 ug/L

Tier II

Permit concentration limit: (422 ug/L)(2.0) = 844 ug/L

Volatile Organic Compounds (VOCs)

Metals

Based on the fact metals are being regulated in this permit and the permit for the Sabattus Sanitary District, the Department is utilizing the segment allocation method for determining limitations in this permit. However, given the fact the MEI facility has never discharged to the Sabattus River, it has no historical discharge levels to be used in calculations pursuant to the Department's protocol. See Attachment C of this Fact Sheet for a copy of the Department protocol. Therefore, the monthly average and/or daily maximum water quality based mass limitations for metals in this permitting action were derived by calculating the end-of-pipe limitations for pollutants of concern for the Sabattus Sanitary District and then assigning the remainder of the allocation to the MEI facility or calculating an individual allocation if the pollutant of concern is specific to the MEI facility only.

It is noted the Sabattus River flows of 1Q10 of 4.2 cfs, the 7Q10 of 4.5 cfs and the harmonic mean of 13.5 cfs are applicable to both facilities as this is a regulated flow limit from Sabattus Pond. See the discussion in Section 6(c) of this Fact Sheet.

k. <u>Cadmium</u> – The 5/10/13 permitting action established water quality based monthly average and daily maximum mass and concentration limits that are being carried forward in this permit as follows:

Tier I

	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	0.0015 lbs/day	5.4 ug/L
Daily Max.	0.0072 lbs/day	24 ug/L

Tier II

	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	0.0015 lbs/day	5 ug/L
Daily Max.	0.0072 lbs/day	22 ug/L

Department rule Chapter 584, Surface Water Quality Criteria for Toxic Pollutants, promulgated on October 12, 2005, adopted acute and chronic AWQC for cadmium. The CCC (chronic) is 0.08 ug/L and CMC (acute) is 0.42 ug/L. It is noted the 12/4/09 statistical evaluation for the Sabattus River indicates the discharge of cadmium was not of a concern for the Sabattus Sanitary District. Therefore, the MEI facility was allocated 75% of the assimilative capacity of the receiving water at this time.

Metals

The monthly average mass and concentration limits established in the 5/13/10 permit were derived utilizing the chronic dilution factor of 45:1 (Tier I) and 41:1 (Tier II) and the monthly average flow limitations of 0.066 MGD (Tier I) and 0.072 MGD (Tier II).

The daily maximum mass and concentration limits were established utilizing the acute dilution factor of 39:1 (Tier I) and 35:1 (Tier II) and the daily maximum flow limitations of 0.072 MGD (Tier I) and 0.079 MGD (Tier II).

The monthly average and daily maximum limitations for total cadmium established in the 5/13/10 permit were derived as follows:

Monthly Average

Tier I

EOP concentration: (45)(0.75)(0.08 ug/L) + (0.25)(0.08 ug/L) = 2.7 ug/L

Mass: (2.7 ug/L)(8.34)(0.066 MGD) = 0.0015 lbs/day1,000 ug/mg

Tier II

EOP concentration: (41)(0.75)(0.08 ug/L) + (0.25)(0.08 ug/L) = 2.5 ug/L

Mass: (2.5 ug/L)(8.34)(0.072 MGD) = 0.0015 lbs/day1,000 ug/mg

Daily Maximum

Tier I

EOP concentration: (39)(0.75)(0.42 ug/L) + (0.25)(0.42 ug/L) = 12 ug/L

Mass: (12 ug/L)(8.34)(0.072 MGD) = 0.0072 lbs/day1,000 ug/mg

Tier II

EOP concentration: (35)(0.75)(0.42 ug/L) + (0.25)(0.42 ug/L) = 11 ug/L

Mass: (11 ug/L)(8.34)(0.079 MGD) = 0.0072 lbs/day1,000 ug/mg

Metals

Concentration limitations for total cadmium in the 5/13/10 permit were derived as follows;

Monthly Average

Tier I

Permit concentration limit: (2.7 ug/L)(2.0) = 5.4 ug/L

Tier II

Permit concentration limit: (2.5 ug/L)(2.0) = 5.0 ug/L

Daily Maximum

Tier I

Permit concentration limit: (12 ug/L)(2.0) = 24 ug/L

Tier II

Permit concentration limit: (11 ug/L)(2.0) = 22 ug/L

I. <u>Chromium III</u> - The 5/13/10 permit established water quality based monthly average and daily maximum mass and concentration limits that are being carried forward in this permit as follows:

Tier I

	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	0.43 lbs/day	1.57 mg/L
Daily Max.	7.8 lbs/day	28.5 mg/L

Tier II

	<u>Mass</u>	Concentration
Monthly Avg.	0.43 lbs/day	1.43 mg/L
Daily Max.	7.7 lbs/day	25.6 mg/L

Department rule Chapter 584, Surface Water Quality Criteria for Toxic Pollutants, promulgated on October 12, 2005, adopted AWQC for chromium III. The CCC (chronic) is 23.1 ug/L and CMC (acute) is 483 ug/L. It is noted the 12/4/09 statistical evaluation for the Sabattus River indicated the discharge of chromium III is not of a concern for the Sabattus Sanitary District. Therefore, the MEI facility was allocated 75% of the assimilative capacity of the receiving water at this time.

Metals

The monthly average mass and concentration limits established in the 5/13/10 permit were derived utilizing the chronic dilution factor of 45:1 (Tier I) and 41:1 (Tier II) and the daily maximum flow limitation of 0.066 MGD (Tier I) and 0.072 MGD (Tier II).

The daily maximum mass and concentration limits established in the 5/13/10 permit were derived utilizing the acute dilution factor of 39:1 (Tier I) and 35:1 (Tier II) and the daily maximum flow limitation of 0.072 MGD (Tier I) and 0.079 MGD (Tier II).

Monthly Average

Tier I

EOP concentration: (45)(0.75)(23.1 ug/L) + (0.25)(23.1 ug/L) = 785 ug/L

Mass: (785 ug/L)(8.34)(0.066 MGD) = 0.43 lbs/day1,000 ug/mg

Tier II

EOP concentration: (41)(0.75)(23.1 ug/L) + (0.25)(23.1 ug/L) = 716 ug/L

Mass: (716 ug/L)(8.34)(0.072 MGD) = 0.43 lbs/day1,000 ug/mg

Daily Maximum

Tier I

EOP concentration: (39)(0.75)(483 ug/L) + (0.25)(483 ug/L) = 14,248 ug/L

Mass: (14.248 mg/L)(8.34)(0.066 MGD) = 7.8 lbs/day

Tier II

EOP concentration: (35)(0.75)(483 ug/L) + (0.25)(483 ug/L) = 12,800 ug/L

Mass: (13 mg/L)(8.34)(0.072 MGD) = 7.7 lbs/day

Metals

Concentration limitations for chromium III in the 5/13/10 permit were derived as follows;

Monthly Average

Tier I

Permit concentration limit: (786 ug/L)(2.0) = 1,572 ug/L

Tier II

Permit concentration limit: (716 ug/L)(2.0) = 1,432 ug/L

Daily Maximum

Tier I

Permit concentration limit: (14,248 ug/L)(2.0) = 28,500 ug/L

Tier II

Permit concentration limit: (12,800 ug/L)(2.0) = 25,600 ug/L

m. <u>Copper</u> – The 5/13/10 permit established water quality based monthly average and daily maximum mass and concentration limits that are being carried forward in this permit as follows:

Tier I

	<u>Mass</u>	Concentration
Monthly Avg.	0.028 lbs/day	102 ug/L
Daily Max.	0.021 lbs/day	70 ug/L

Tier II

	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	0.028 lbs/day	94 ug/L
Daily Max.	0.021 lbs/day	64 ug/L

Department rule Chapter 584, Surface Water Quality Criteria for Toxic Pollutants, promulgated on October 12, 2005, adopted chronic and acute AWQC for copper. The CCC (chronic) is 2.36 ug/L and CMC (acute) is 3.07 ug/L. The 12/4/09 statistical evaluation for the Sabattus River indicated the discharge of copper was also a concern for the Sabattus Sanitary District. Therefore, mass limits for total copper were derived utilizing the segment allocation methodology outlined in the Department's guidance in Attachment B of this Fact Sheet.

Metals

A statistical evaluation was conducted on December 4, 2009 (Report ID 194) on the data for the Sabattus Sanitary District to establish limitations of concern and the remaining balance of the allocation for each pollutant was apportioned to the MEI facility. The total copper limits established in the 5/13/10 permit for the MEI facility were calculated as follows:

Monthly Average

Chronic - 7Q10 = 4.5 cfs (0.6464) = 2.91 MGD Chronic AWQC = 2.36 ug/L or 0.00236 mg/L

Taking into consideration 15% of the AWQC reserve and 10% for background for a total of 25%, the assimilative capacity of the Sabattus River at the confluence of the Androscoggin River can be calculated as follows:

(0.00236 mg/L)(0.75)(8.34 lbs/gal)(2.91 MGD) = 0.0520 lbs/day

Based on the 12/4/09 statistical evaluation utilizing the segment allocation methodology, the Sabattus Sanitary District was given a daily maximum allocation of 0.023821 lbs for total copper. Thus, the balance of the assimilative capacity was allocated to the MEI facility. The calculation is as follows:

0.0520 lbs/day - 0.023821 lbs/day = 0.0282 lbs/day

Daily Maximum

Acute - 1Q10 = 4.2 cfs (0.6464) = 2.71 MGDAcute AWQC = 3.07 ug/L or 0.00307 mg/L

Taking into consideration 15% of the AWQC reserve and 10% for background for a total of 25%, the assimilative capacity of the Sabattus River at the confluence of the Androscoggin River can be calculated as follows:

(0.00307 mg/L)(0.75)(8.34 lbs/gal)(2.71 MGD) = 0.0520 lbs/day

Based on the 12/4/09 statistical evaluation utilizing the segment allocation methodology, the Sabattus Sanitary District was given a daily maximum allocation of 0.031041 lbs for total copper. Thus, the balance of the assimilative capacity was allocated to the MEI facility. The calculation is as follows:

0.0520 lbs/day - 0.031041 lbs/day = 0.0210 lbs/day

Metals

n. <u>Iron</u> – The 5/13/10 permit established water quality based monthly average limits that are being carried forward in this permit as follows:

Tier I

Mass Concentration
5.6 lbs/day 20.4 mg/L

Tier II

Monthly Avg.

Monthly Avg.

Mass Concentration
5.6 lbs/day 18.6 mg/L

Department rule Chapter 584, Surface Water Quality Criteria for Toxic Pollutants, promulgated on October 12, 2005, did not adopt AWQC for iron so the EPA MCL of 300 ug/L was the criteria by which the limitations for iron were established. It is noted the 5/13/10 statistical evaluation for the Sabattus River indicated the discharge of iron was not of a concern for the Sabattus Sanitary District. Therefore, the MEI facility was allocated 75% assimilative capacity of the receiving water at this time. The monthly average limits for total iron limits in the 5/13/10 permit were calculated as follows:

Monthly Average

Tier I

EOP concentration: (45)(0.75)(300 ug/L) + (0.25)(300 ug/L) = 10,200 ug/L

Mass: (10.2 mg/L)(8.34)(0.066 MGD) = 5.6 lbs/day

Tier II

EOP concentration: (41)(0.75)(300 ug/L) + (0.25)(300 ug/L) = 9,300 ug/L

Mass: (9.3 mg/L)(8.34)(0.072 MGD) = 5.6 lbs/day

Concentration limitations for total iron in this permitting action were derived as follows;

Tier I

Permit concentration limit: (10,200 ug/L)(2.0) = 20,400 ug/L

Tier II

Permit concentration limit: (9,300 ug/L)(2.0) = 18,600 ug/L

Metals

o. <u>Lead</u> – The 5/13/10 permit established water quality based monthly average and daily maximum mass and concentration limits that are being carried forward in this permit as follows

Tier I

	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	0.0033 lbs/day	12 ug/L
Daily Max.	0.19 lbs/day	620 ug/L

Tier II

	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	0.0033 lbs/day	11 ug/L
Daily Max.	0.18 lbs/day	588 ug/L

The 12/4/09 statistical evaluation for the Sabattus River indicated the discharge of lead (chronic) was also a concern for the Sabattus Sanitary District. Therefore, new monthly average mass limits for total lead were derived utilizing the segment allocation methodology outlined in the Department's guidance in **Attachment C** of this Fact Sheet and daily maximum mass limits for the MEI facility were allocated based on 75% of the assimilative capacity of the receiving water at this time. A statistical evaluation was conducted on December 4, 2009 (Report ID 194) on the data for the Sabattus Sanitary District to establish limitations of concern and the remaining balance of the allocation for each pollutant was apportioned to the MEI facility. The total lead limits established in this permitting action for the MEI facility were calculated as follows:

Monthly Average

Chronic - 7Q10 = 4.5 cfs (0.6464) = 2.91 MGD Chronic AWQC = 0.41 ug/L or 0.00041 mg/L

Taking into consideration 15% of the AWQC reserve and 10% for background for a total of 25%, the assimilative capacity of the Sabattus River at the confluence of the Androscoggin River can be calculated as follows:

(0.00041 mg/L)(0.75)(8.34 lbs/gal)(2.91 MGD) = 0.007463 lbs/day

Based on the 12/4/09 statistical evaluation utilizing the segment allocation methodology, the Sabattus Sanitary District was given a monthly average allocation of 0.004142 lbs for total lead. Thus, the balance of the assimilative capacity was allocated to the MEI facility. The calculation is as follows:

0.007463 lbs/day - 0.004142 lbs/day = 0.003321 lbs/day

Metals

For concentration, the monthly average end-of pipe concentration was established by back-calculating from the mass limit and the monthly average permit flow limits of 0.066 MGD (Tier I) and 0.072 MGD (Tier II). The calculations are as follows:

Monthly Average

Tier I

0.003321 lbs/day = 0.0060 mg/L or 6.0 ug/L (0.066 MGD)(8.34 gal/lb)

Tier II

0.003321 lbs/day = 0.0055 mg/L or 5.5 ug/L (0.072 MGD)(8.34 gal/lb)

Tier I

Permit concentration limit: (6 ug/L)(2.0) = 12 ug/L

Tier II

Permit concentration limit: (5.5 ug/L)(2.0) = 11 ug/L

Daily Maximum

The daily maximum mass limits for the MEI facility were allocated based on 75% of the assimilative capacity of the receiving water at this time.

Tier I

EOP concentration: (39)(0.75)(10.52 ug/L) + (0.25)(10.52 ug/L) = 310 ug/L

Mass: (310 ug/L)(8.34)(0.072 MGD) = 0.19 lbs/day1000 ug/mg

Tier II

EOP Concentration: (35)(0.75)(10.52 ug/L) + (0.25)(10.52 ug/L) = 279 ug/L

Mass: (279 ug/L)(8.34)(0.079 MGD) = 0.18 lbs/day1000 ug/mg

Metals

Daily maximum concentration limitations for total lead in the 5/13/10 permit were derived as follows;

Daily Maximum

Tier I

Permit concentration limit: (310 ug/L)(2.0) = 620 ug/L

Tier II

Permit concentration limit: (279 ug/L)(2.0) = 558 ug/L

q. <u>Manganese</u> – The 5/13/10 permit established water quality based monthly average mass and concentration limits that are being carried forward in this permit, as follows:

Tier I

	3.6	C
	<u>Mass</u>	<u>Concentration</u>
Monthly Avg.	2.7 lbs/day	10 mg/L

Tier II

	<u>Mass</u>	Concentration
Monthly Avg.	2.8 lbs/day	9.2 mg/L

Tier I

EOP concentration: (133)(0.75)(50 ug/L) + (0.25)(50 ug/L) = 5,000 ug/L or 5.0 mg/L

Mass: (5.0 mg/L)(8.34)(0.066 MGD) = 2.7 lbs/day

Tier II

EOP concentration:
$$(122)(0.75)(50 \text{ ug/L}) + (0.25)(50 \text{ ug/L}) = 4,600 \text{ ug/L} \text{ or } 4.6 \text{ mg/L}$$

Mass: (4.6 mg/L)(8.34)(0.072 MGD) = 2.8 lbs/day

Monthly average concentration limitations for manganese in this permitting action were derived as follows;

Tier I

Permit concentration limit: (5,000 ug/L)(2.0) = 10,000 ug/L

Tier II

Permit concentration limit: (4,600 ug/L)(2.0) = 9,200 ug/L

7. IMPACT ON RECEIVING WATER QUALITY

The Department has made a determination that as permitted, the discharge will not cause of contribute to the failure of the water body to meet the standards of Class C classification and the discharge will be subject to effluent limitations that require application of best practicable treatment.

8. PUBLIC COMMENTS

Public notice of this application was made in the Lewiston 'Sun Journal newspaper on April 14, 2015. The Department receives public comments on an application until the date a final agency action is taken on that application. Those persons receiving copies of draft permits shall have at least 30 days in which to submit comments on the draft or to request a public hearing, pursuant to Chapter 522 of the Department's rules.


9. DEPARTMENT CONTACTS


Additional information concerning this permitting action may be obtained from and written comments should be sent to:

Gregg Wood
Bureau of Water Quality
Department of Environmental Protection
17 State House Station
Augusta, Maine 04333-0017 Telephone (207) 287-7693
E-mail: gregg.wood@maine.gov

10. RESPONSE TO COMMENTS

During the period of June 9, 2015, through the issuance date of the permit/license, the Department solicited comments on the proposed draft permit/license to be issued for the discharge(s) from the Maine Electronics facility. The Department did not receive comments from the permittee, state or federal agencies or interested parties that resulted in any substantive change(s) in the terms and conditions of the permit. Therefore, the Department has not prepared a Response to Comments.

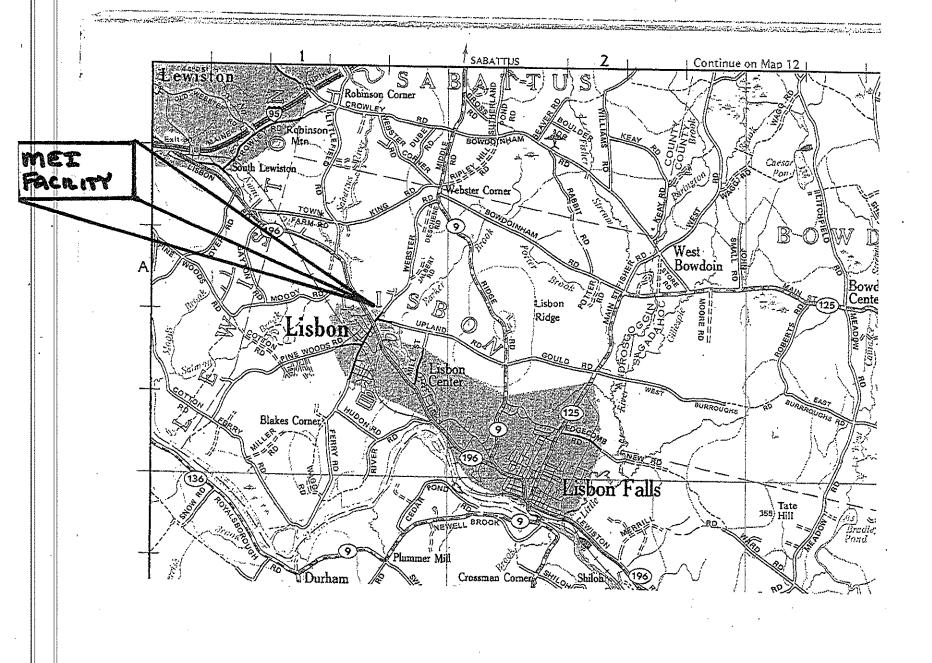

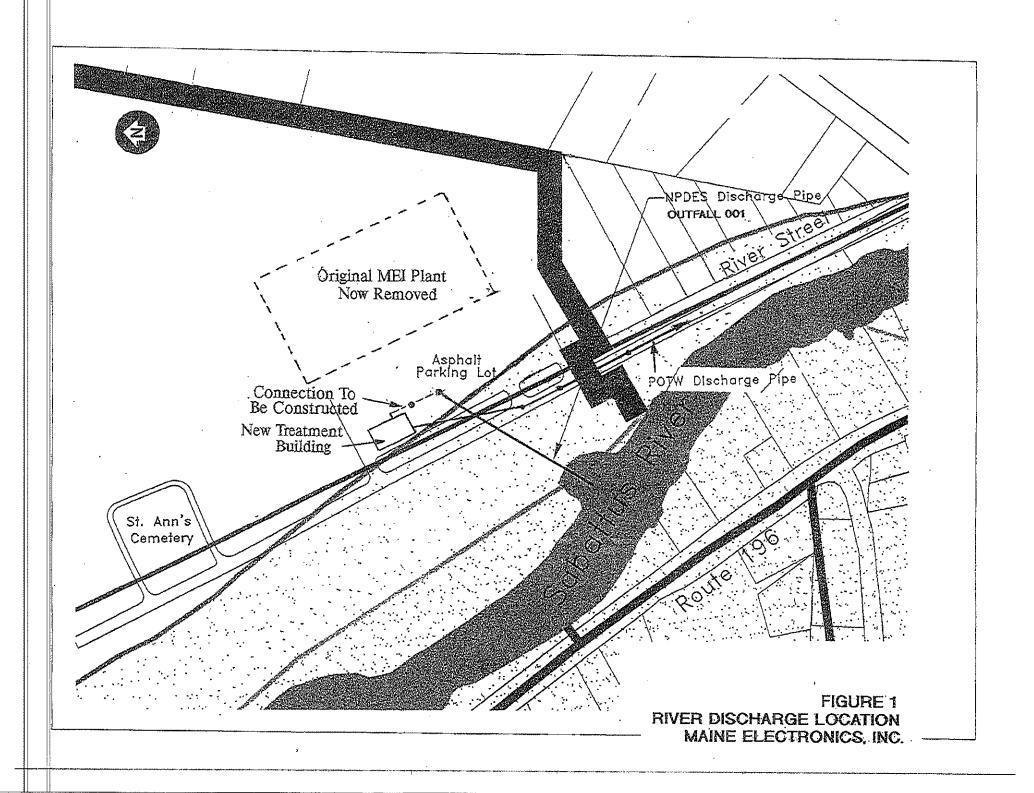

ATTACHMENT B

MAINE DEPARTMENT OF ENVIRONMENTAL PROTECTION

MEMORANDUM

DATE: October 2008

TO: Interested Parties

FROM: Dennis Merrill, DEP

SUBJECT: DEP's system for evaluating toxicity from multiple discharges

Following the requirements of DEP's rules, Chapter 530, section 4(F), the Department is evaluating discharges of toxic pollutants into a freshwater river system in order to prevent cumulative impacts from multiple discharges. This is being through the use of a computer program known internally as "DeTox". The enclosed package of information is intended to introduce you to this system.

Briefly, the DeTox program evaluates each wastewater facility within a watershed in three different ways in order to characterize its effluent: 1) the facility's past history of discharges, 2) its potential toxicity at the point of discharge on an individual basis, and 3) the facility's contribution to cumulative toxicity within a river segment in conjunction with other facilities. The value that is most protective of water quality becomes the value that is held in the DeTox system as an allocation for the specific facility and pollutant.

The system is not static and uses a five-year "rolling" data window. This means that, over time, old test results drop off and newer ones are added. The intent of this process is to maintain current, uniform facility data to estimate contributions to a river's total allowable pollutant loading prior to each permit renewal.

Many facilities are required to do only a relatively small amount of pollutant testing on their effluent. This means, statistically, the fewer tests done, the greater the possibility of effluent limits being necessary based on the facility's small amount of data. To avoid this situation, most facilities, especially those with low dilution factors, should consider conducting more than the minimum number of tests required by the rules.

Attached you will find three documents with additional information on the DeTox system:

- Methods for evaluating the effects of multiple discharges of toxic pollutants
- Working definitions of terms used in the DeTox system
- Reviewing DeTox Reports
- Prototype facility and pollutant reports

If you have questions as you review these, please do not hesitate to contact me at Dennis L. Merrill@maine.gov or 287-7788.

Maine Department of Environmental Protection

Methods for evaluating the effects of multiple discharges of toxic pollutants.

Reference: DEP Rules, Chapter 530, section 4(F)

To evaluate discharges of toxic pollutants into a freshwater river system and prevent cumulative impacts from multiple discharges, DEP uses a computer program called "DeTox that functions as a mathematical evaluation tool.

It uses physical information about discharge sources and river conditions on file with the Department, established water quality criteria and reported effluent test information to perform these evaluations. Each toxic pollutant and associated water quality criterion for acute, chronic and/or human health effects is evaluated separately.

Each facility in a river drainage area has an assigned position code. This "address" is used to locate the facility on the river segment and in relation to other facilities and tributary streams. All calculations are performed in pounds per day to allow analysis on a mass balance. Pollutants are considered to be conservative in that once in the receiving water they will not easily degrade and have the potential to accumulate.

The process begins with establishing an assimilative capacity for each pollutant and water quality criterion at the most downstream point in the river segment. This calculation includes set-aside amounts for background and reserve quantities and assumed values for receiving water pH, temperature and hardness. The resulting amount of assimilative capacity is available for allocation among facilities on the river.

Each facility is evaluated to characterize its past discharge quantities. The historical discharge, in pounds per day, is figured using the average reported concentration and the facility's permitted flow. As has been past practice, a reasonable potential (RP) factor is used as a tool to estimate the largest discharge that may occur with a certain degree of statistical certainty. The RP factor is multiplied by the historical average to determine an allocation based on past discharges. The RP factor is also multiplied by the single highest test to obtain a maximum day estimate. Finally, the direct average without RP adjustment is used to determine the facility's percent contribution to the river segment in comparison to the sum of all discharges of the pollutant. This percent multiplied by the total assimilative capacity becomes the facility's discharge allocation used in evaluations of the segment loadings.

Additionally, individual facility discharges are evaluated as single sources, as they have been in the past to determine if local conditions are more limiting than a segment evaluation.

With all of this information, facilities are evaluated in three ways. The methods are:

- The facility's past history. This is the average quantity discharged during the past five years multiplied by the applicable RP factor. This method is often the basis for an allocation when the discharge quantity is relatively small in comparison to the water quality based allocation.
- 2. An individual evaluation. This assumes no other discharge sources are present and the allowable quantity is the total available assimilative capacity. This method may be used when a local condition such as river flow at the point of discharge is the limiting factor.
- 3. A segment wide evaluation. This involves allocating the available assimilative capacity within a river segment based on a facility's percent of total past discharges. This method would be used when multiple discharges of the same pollutant to the same segment and the available assimilative capacity is relatively limited.

The value that is most protective of water quality becomes the facility's allocation that is held in the system for the specific facility and pollutant. It is important to note that the method used for allocation is facility and pollutant specific and different facilities on the same segment for the same pollutant can have different methods used depending on their individual situations.

Discharge amounts are always allocated to all facilities having a history of discharging a particular pollutant. This does not mean that effluent limits will be established in a permit. Limits are only needed when past discharge amounts suggest a reasonable potential to exceed a water quality based allocation, either on an individual or segment basis. Similar to past practices for single discharge evaluations, the single highest test value is multiplied by a RP factor and if product is greater than the water quality allowance, an effluent limit is established. It is important to remember an allocation is "banking" some assimilative capacity for a facility even if effluent limits are not needed.

Evaluations are also done for each tributary segment with the sum of discharge quantities in tributaries becoming a "point source" to the next most significant segment. In cases where a facility does not use all of its assimilative capacity, usually due to a more limiting individual water quality criterion, the unused quantity is rolled downstream and made available to other facilities.

The system is not static and uses a five-year rolling data window. Over time, old tests drop off and newer ones are added on. These changes cause the allocations and the need for effluent limits to shift over time to remain current with present conditions. The intent is to update a facility's data and relative contribution to a river's total assimilative capacity prior to each permit renewal. Many facilities are required to do only minimal testing to characterize their effluents. This creates a greater degree of statistical uncertainty about the true long-term quantities. Accordingly, with fewer tests the RP factor will be larger and result in a greater possibility of effluent limits being necessary. To avoid this situation, most facilities, especially those with relatively low dilution factors, are encouraged to conduct more that a minimum number of tests. It is generally to a facility's long-term benefit to have more tests on file since their RP factor will be reduced.

Maine Department of Environmental Protection

Working Definitions of Terms Used in the DeTox System.

Allocation. The amount of pollutant loading set aside for a facility. Separate amounts are set for each water quality criterion. Each pollutant having a history of being discharged will receive an allocation, but not all allocations become effluent limits. Allocation may be made in three ways: historical allocation, individual allocation or segment allocation.

Assimilative capacity. The amount of a pollutant that river segment can safely accept from point source discharges. It is determined for the most downstream point in a river segment using the water quality criterion and river flow. Separate capacities are set for acute, chronic and human health criteria as applicable for each pollutant. Calculation of this capacity includes factors for reserve and background amounts.

Background. A concentration of a pollutant that is assumed to be present in a receiving water but not attributable to discharges. By rule, this is set as a rebuttable presumption at 10% of the applicable water quality criterion.

Effluent limit. A numeric limit in a discharge permit specifically restricting the amount of a pollutant that may be discharged. An effluent limit is set only when the highest discharge, including an adjustment for reasonable potential, is greater than a facility's water quality based allocation for a pollutant.

Historical allocation (or RP history). One of three ways of developing an allocation. The facility's average history of discharges, in pounds at design flow, is multiplied by the appropriate reasonable potential factor. An allocation using this method does not become an effluent limit.

Historical discharge percentage. For each pollutant, the average discharge concentration for each facility in a segment is multiplied by the permitted flow (without including a reasonable potential factor). The amounts for all facilities are added together and a percent of the total is figured for each facility. When a facility has no detectable concentrations, that pollutant is assumed to be not present and it receives no percentage.

Individual allocation. One of three ways of developing an allocation. The facility's single highest discharge on record multiplied by the appropriate reasonable potential factor is compared to a water quality based quantity with an assumption that the facility is the only point source to that receiving water. If the RP-adjusted amount is larger, the water quality amount may become an effluent limit.

Less than. A qualification on a laboratory report indicating the concentration of a pollutant was below a certain concentration. Such a result is evaluated as being one half of the Department's reporting limit in most calculations.

Reasonable potential (RP). A statistical method to determine the highest amount of a pollutant likely to be present at any time based on the available test results. The method produces a value or RP factor that is multiplied by test results. The method relies on an EPA guidance document, and considers the coefficient of variation and the number of tests. Generally, the fewer number of tests, the higher the RP factor.


Reserve. An assumed concentration of a pollutant that set aside to account for non-point source of a pollutant and to allow new discharges of a pollutant. By rule this is set at 15% of the applicable water quality criterion.

Segment allocation. One of three ways of developing an allocation. The amount is set by multiplying a facility's historical discharge percentage for a specific pollutant by the assimilative capacity for that pollutant and criterion. A facility will have different allocation percentages for each pollutant. This amount may become an effluent limit.

Tributary. A stream flowing into a larger one. A total pollutant load is set by adding the all facilities *allocations* on the tributary and treating this totaled amount as a "point source" to the next larger segment.

Water quality criteria. Standards for acceptable in-stream or ambient levels of pollutants. These are established in the Department's Chapter 584 and are expressed as concentrations in ug/L. There may be separate standards for acute and chronic protection aquatic life and/or human health. Each criterion becomes a separate standard. Different stream flows are used in the calculation of each.

I. Preparation
Select Watershed
Select watersned
Select values for pH, Temp, hardness,
Background %, Reserve %
Algorithms for some pollutants
Water quality tables
C. 1. 1.1t. and the suite of Acute Chronic Health
Calculate water quality criteria: Acute, Chronic, Health

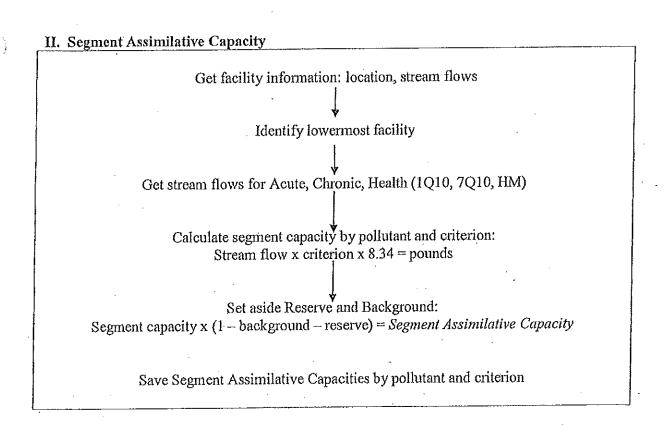

Select each facility effluent data for each facility

Data input and edits

Identify "less than" results and assign at ½ of reporting limit

Bypass pollutants if all results are "less than"

Average concentrations and calculate pounds:
Ave concentration x license flow x 8.34 = Historical Average

Determine reasonable potential (RP) using algorithm

Calculate RP adjusted pounds:
Historical Average x RP factor = RP Historical Allocation

Save for comparative evaluation

Calculate adjusted maximum pounds:
Highest concentration x RP factor x license flow x 8.34 = RP Maximum Value

By pollutant, identify facilities with Historical Average

Sum all Historical Averages within segment

By facility, calculate percent of total:
Facility pounds / Total pounds = Facility History %

V. Segment Allocation By pollutant and criterion, select Segment Assimilative Capacity

Select individual Facility History %

Determine facility allocation:
Assimilative Capacity x Facility History % = Segment Allocation

Save for comparative evaluation

VI. Individual Allocation

Select individual facility and dilution factor (DF)

Select pollutant and water quality criterion

By pollutant and criterion, calculate individual allocations: $[DF \times 0.75 \times criterion] + [0.25 \times criterion] = Individual Concentration$

Determine individual allocation:
Individual Concentration x license flow x 8.34 = Individual Allocation

Save for comparative evaluation

VII. Make Initial Allocation

By facility, pollutant and criterion, get: Individual Allocation, Segment Allocation, RP Historical Allocation

Compare allocation and select the smallest

Save as Facility Allocation

VIII. Evaluate Need for Effluent Limits

By facility, pollutant and criterion select Segment Allocation, Individual Allocation and RP Maximum value

If RP Maximum value is greater than either Segment Allocation or Individual Allocation, use lesser value as Effluent Limit

Save Effluent Limit for comparison

IX. Reallocation of Assimilative Capacity

Starting at top of segment, get Segment Allocation, Facility Allocation and Effluent Limit

If Segment Allocation equals Effluent Limit, move to next facility downstream

If not, subtract Facility Allocation from Segment Allocation

Save difference

Select next facility downstream

Figure remaining Segment Assimilative Capacity at and below facility, less tributaries

Add saved difference to get an adjusted Segment Assimilative Capacity

Reallocate Segment Assimilative Capacity among downstream facilities per step V

Repeat process for each facility downstream in turn



DEP INFORMATION SHEET

Appealing a Department Licensing Decision

Dated: March 2012

Contact: (207) 287-2811

SUMMARY

There are two methods available to an aggrieved person seeking to appeal a licensing decision made by the Department of Environmental Protection's ("DEP") Commissioner: (1) in an administrative process before the Board of Environmental Protection ("Board"); or (2) in a judicial process before Maine's Superior Court. An aggrieved person seeking review of a licensing decision over which the Board had original jurisdiction may seek judicial review in Maine's Superior Court.

A judicial appeal of final action by the Commissioner or the Board regarding an application for an expedited wind energy development (35-A M.R.S.A. § 3451(4)) or a general permit for an offshore wind energy demonstration project (38 M.R.S.A. § 480-HH(1) or a general permit for a tidal energy demonstration project (38 M.R.S.A. § 636-A) must be taken to the Supreme Judicial Court sitting as the Law Court.

This INFORMATION SHEET, in conjunction with a review of the statutory and regulatory provisions referred to herein, can help a person to understand his or her rights and obligations in filing an administrative or judicial appeal.

I. ADMINISTRATIVE APPEALS TO THE BOARD

LEGAL REFERENCES

The laws concerning the DEP's Organization and Powers, 38 M.R.S.A. §§ 341-D(4) & 346, the Maine Administrative Procedure Act, 5 M.R.S.A. § 11001, and the DEP's Rules Concerning the Processing of Applications and Other Administrative Matters ("Chapter 2"), 06-096 CMR 2 (April 1, 2003).

HOW LONG YOU HAVE TO SUBMIT AN APPEAL TO THE BOARD

The Board must receive a written appeal within 30 days of the date on which the Commissioner's decision was filed with the Board. Appeals filed after 30 calendar days of the date on which the Commissioner's decision was filed with the Board will be rejected.

HOW TO SUBMIT AN APPEAL TO THE BOARD

Signed original appeal documents must be sent to: Chair, Board of Environmental Protection, c/o Department of Environmental Protection, 17 State House Station, Augusta, ME 04333-0017; faxes are acceptable for purposes of meeting the deadline when followed by the Board's receipt of mailed original documents within five (5) working days. Receipt on a particular day must be by 5:00 PM at DEP's offices in Augusta; materials received after 5:00 PM are not considered received until the following day. The person appealing a licensing decision must also send the DEP's Commissioner a copy of the appeal documents and if the person appealing is not the applicant in the license proceeding at issue the applicant must also be sent a copy of the appeal documents. All of the information listed in the next section must be submitted at the time the appeal is filed. Only the extraordinary circumstances described at the end of that section will justify evidence not in the DEP's record at the time of decision being added to the record for consideration by the Board as part of an appeal.

WHAT YOUR APPEAL PAPERWORK MUST CONTAIN

Appeal materials must contain the following information at the time submitted:

OCF/90-1/r95/r98/r99/r00/r04/r12

- 1. Aggrieved Status. The appeal must explain how the person filing the appeal has standing to maintain an appeal. This requires an explanation of how the person filing the appeal may suffer a particularized injury as a result of the Commissioner's decision.
- 2. The findings, conclusions or conditions objected to or believed to be in error. Specific references and facts regarding the appellant's issues with the decision must be provided in the notice of appeal.
- 3. The basis of the objections or challenge. If possible, specific regulations, statutes or other facts should be referenced. This may include citing omissions of relevant requirements, and errors believed to have been made in interpretations, conclusions, and relevant requirements.
- 4. *The remedy sought.* This can range from reversal of the Commissioner's decision on the license or permit to changes in specific permit conditions.
- 5. All the matters to be contested. The Board will limit its consideration to those arguments specifically raised in the written notice of appeal.
- 6. Request for hearing. The Board will hear presentations on appeals at its regularly scheduled meetings, unless a public hearing on the appeal is requested and granted. A request for public hearing on an appeal must be filed as part of the notice of appeal.
- 7. New or additional evidence to be offered. The Board may allow new or additional evidence, referred to as supplemental evidence, to be considered by the Board in an appeal only when the evidence is relevant and material and that the person seeking to add information to the record can show due diligence in bringing the evidence to the DEP's attention at the earliest possible time in the licensing process or that the evidence itself is newly discovered and could not have been presented earlier in the process. Specific requirements for additional evidence are found in Chapter 2.

OTHER CONSIDERATIONS IN APPEALING A DECISION TO THE BOARD

- Be familiar with all relevant material in the DEP record. A license application file is public
 information, subject to any applicable statutory exceptions, made easily accessible by DEP. Upon
 request, the DEP will make the material available during normal working hours, provide space to
 review the file, and provide opportunity for photocopying materials. There is a charge for copies or
 copying services.
- 2. Be familiar with the regulations and laws under which the application was processed, and the procedural rules governing your appeal. DEP staff will provide this information on request and answer questions regarding applicable requirements.
- 3. The filing of an appeal does not operate as a stay to any decision. If a license has been granted and it has been appealed the license normally remains in effect pending the processing of the appeal. A license holder may proceed with a project pending the outcome of an appeal but the license holder runs the risk of the decision being reversed or modified as a result of the appeal.

WHAT TO EXPECT ONCE YOU FILE A TIMELY APPEAL WITH THE BOARD

The Board will formally acknowledge receipt of an appeal, including the name of the DEP project manager assigned to the specific appeal. The notice of appeal, any materials accepted by the Board Chair as supplementary evidence, and any materials submitted in response to the appeal will be sent to Board members with a recommendation from DEP staff. Persons filing appeals and interested persons are notified in advance of the date set for Board consideration of an appeal or request for public hearing. With or without holding a public hearing, the Board may affirm, amend, or reverse a Commissioner decision or remand the matter to the Commissioner for further proceedings. The Board will notify the appellant, a license holder, and interested persons of its decision.

II. JUDICIAL APPEALS

Maine law generally allows aggrieved persons to appeal final Commissioner or Board licensing decisions to Maine's Superior Court, see 38 M.R.S.A. § 346(1); 06-096 CMR 2; 5 M.R.S.A. § 11001; & M.R. Civ. P 80C. A party's appeal must be filed with the Superior Court within 30 days of receipt of notice of the Board's or the Commissioner's decision. For any other person, an appeal must be filed within 40 days of the date the decision was rendered. Failure to file a timely appeal will result in the Board's or the Commissioner's decision becoming final.

An appeal to court of a license decision regarding an expedited wind energy development, a general permit for an offshore wind energy demonstration project, or a general permit for a tidal energy demonstration project may only be taken directly to the Maine Supreme Judicial Court. See 38 M.R.S.A. § 346(4).

Maine's Administrative Procedure Act, DEP statutes governing a particular matter, and the Maine Rules of Civil Procedure must be consulted for the substantive and procedural details applicable to judicial appeals.

ADDITIONAL INFORMATION

If you have questions or need additional information on the appeal process, for administrative appeals contact the Board's Executive Analyst at (207) 287-2452 or for judicial appeals contact the court clerk's office in which your appeal will be filed.

Note: The DEP provides this INFORMATION SHEET for general guidance only; it is not intended for use as a legal reference. Maine law governs an appellant's rights.