


NOTE: Dimensions are approximate and should not be used to "rough-in" equipment.

* Add circulator amps.

**For incoming gas pressures lower than 5" WC natural or 11" WC propane, consult factory.

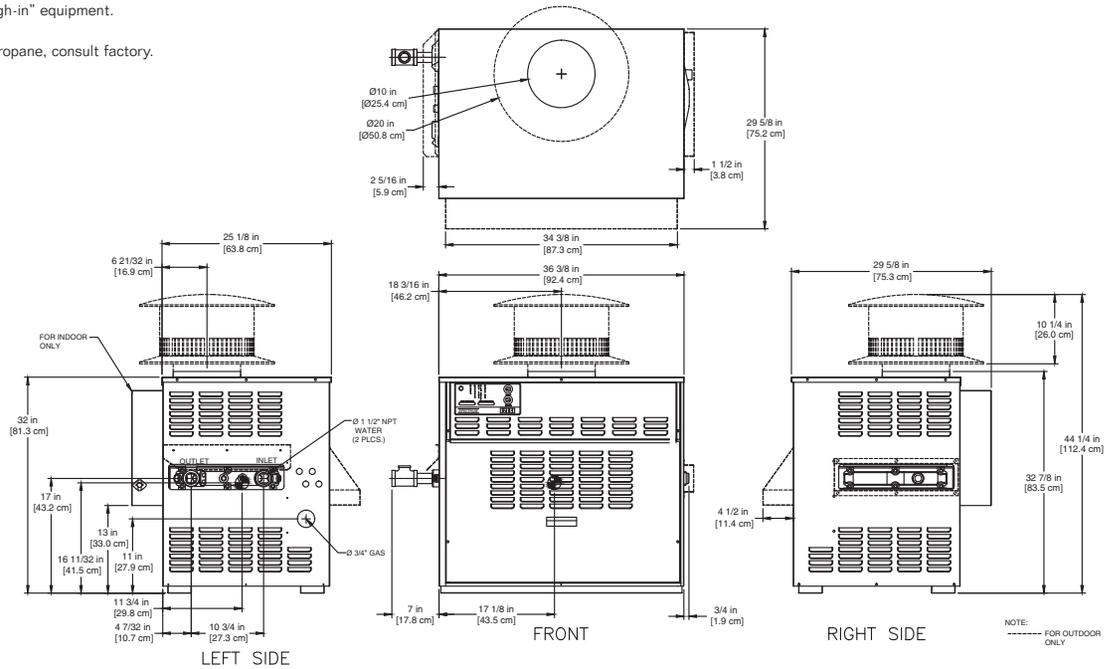

RSUB-7-C

AGA CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	1*
Input BTU/hr.	399,000 / 117 kW	Min. Gas Pressure Required	5" WC**
Output BTU/hr.	323,988 / 95 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC / 1 ph / 60 hz	Operating Weight	272 lbs. / 123 kg.

TEMPERATURE RISE / PRESSURE DROP

10°F / 5.5°C		20°F / 11.1°C				30°F / 16.7°C					
Flow Rate		Pressure Drop		Flow Rate		Pressure Drop		Flow Rate		Pressure Drop	
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
66.4	4.2	1.77	5.2	33.2	2.1	0.49	1.4	22.1	1.4	0.20	0.7
-	-	-	-	33.2	2.1	3.54	10.4	22.1	1.4	1.70	4.9

2 Pass
4 Pass

BOILER TRIM & CONTROLS

Gas Valve - INT	Honeywell VR8304M 3/4"	Ignition Control (SB On/Off)	Honeywell S9361A2085
Gas Valve	Honeywell VR8304Q 3/4"- 2 Stg	Ignition Control (SB 2 Stg.)	Honeywell S86IOM
Gas Valve	Honeywell VR8304Q 3/4"- 2 Stg.	Ignition Control (SW)	Honeywell S86IOM
Operating Control (SB)	Jumo - 2 Stage	Relief Valve - SW	3/4" x 3/4" set @ 125 psi
High Limit (SB/SW)	Jumo	Relief Valve - SB	3/4" x 3/4" set @ 30 psi
		Flow Switch	TACO IFS-1

RECOVERY CAPACITY

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
972	3681	648	2454	486	1840	389	1472	324	1227	278	1052

ASME

ASME Sect IV Htg Surface	54.3 Sq. Ft. / 5.04 Sq. M.	Design Data	Max. 160 psig & 250°F
Water Volume	1.49 gal / 5.64 l (liters)		

REP FIRM _____
SUBMITTED BY _____
JOB NAME _____
ARCHITECT _____
ENGINEER _____
CONTRACTOR _____
DATE _____

SPECTRUM 400

Category I Appliance

Must be vented into a negative pressure vent system.



® A Division of Mestek, Inc.
 Westfield, MA 01085
 (413) 568-9571