

### **CODE OPTIONS**


CSD-1	UTC 1003-616A Ignition Control UTC Lockout/Reset Control Manual Reset LWCO
IRI	IRI requirements as listed in IM.4.1.1 (two motorized safety valves with N.O.V.V. no longer applies to listed atmospheric gas boilers). The addition of CSD-1 option satisfies IRI requirement for the 8900 Series.
Kentucky	200°F Maximum Operating Control and High Limit

**NOTE:** Dimensions are approximate and should not be used to "rough-in" equipment.

- \* Add circulator amps.
- \*\*For incoming gas pressures lower than 6" WC natural or 11" WC propane, consult factory.



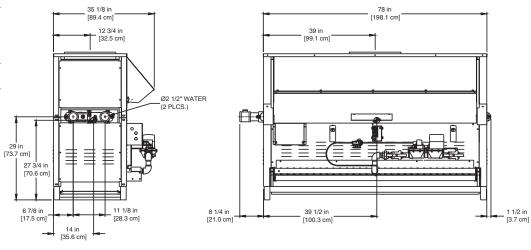



LEFT SIDE FRONT RIGHT SIDE

## **AGA CERTIFIED RATINGS & CAPACITIES**

Fuel Type	Natural/Propane Gas	Boiler FLA	1*
Input BTU/hr.	1,580,000 / 463 kW	Min. Gas Pressure Required	6" WC**
Output BTU/hr.	1,279,800 / 375 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC / 1 ph / 60 hz	Operating Weight	836 lbs. / 379 kg.

## **TEMPERATURE RISE / PRESSURE DROP**

30°F / 16.7°C				35°F / 19.4°C			
Flow	Flow Rate Pressure Drop		Flow Rate		Pressure Drop		
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
85.3	5.4	6.5	19.0	73.1	4.6	4.8	14.3

# **BOILER TRIM & CONTROLS**

Main Gas Valve	Honeywell V8944B 1-1/4"	High Limit (HB/HW)	Honeywell L4008E
Firing Valve	Honeywell B200T1041 1-1/4"	Ignition Control	Honeywell S8610M
Safety Valve	Honeywell V88A 1-1/4"	Solenoid Valve w/Reg.	CV100
Operating Control (HB)	Honeywell L4008A - On/Off	Relief Valve - HW	3/4" x 3/4" set @ 125 psi
Operating Control (HW)	Honeywell L6008A - On/Off	Relief Valve - HB	3/4" x 1" set @ 50 psi
Operating Control (HB/HW)	Honeywell L6008G - 2 Stage	Flow Switch	TACO IFS-1
Operating Control (HB/HW)	Tekmar BTC-4PA-4 Stg.		

#### **ASME**

ASME Sect IV Htg Surface	124.32 Sq. Ft. / 11.55 Sq. M.	Design Data	Max. 160 psig & 250°F
Water Valores	0.4 mal / 0.1 l (litarra)		

## **RECOVERY CAPACITY**

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
3841	14540	2561	9693	1920	7270	1536	5816	1280	4847	1097	4154

REP FIRM		
SUBMITTED BY		
JOB NAME		
ARCHITECT		
ENGINEER		
CONTRACTOR		
DATE	_	

# 8900 1580

#### Category I Appliance

Must be vented into a negative pressure vent system.



A Division of Mestek, Inc. Westfield, MA 01085 (413) 568-9571