



791 STRIKE DETAIL

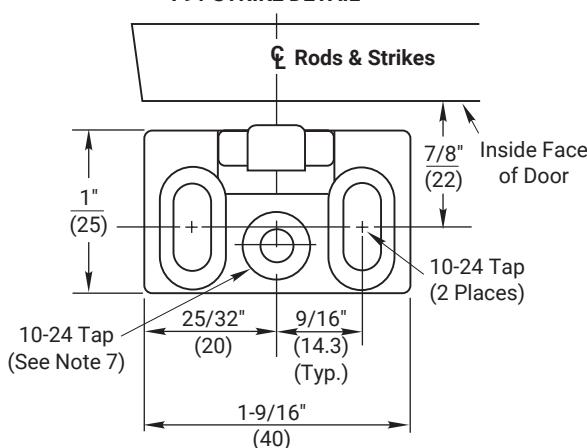

NOTES:

1. Do not scale drawing.
2. Dimensions are in inches (mm).
3. LHR door shown. Preparation is typical for both door hands.
4. Minimum door stile width 4-1/2" (114).
5. Prepare mounting holes when installing device.
6. Unreinforced frames require blind rivet nuts (by others) to mount the strike.
7. This hole MUST be field located using physical part as template, after installation is complete and device is fully operational.
8. Provide adequate structural support to maintain door integrity after device installation with power tools, door use, or abuse.
9. Device mount to hinge stile (not shown) requires hole location and preparation during device installation. Door structural requirements to support the device cases are similar for both door stiles.
10. For outside trim preparation see appropriate trim template.
11. Cutout, 1/2" (13) deep, only required when outside trim is used.
12. Wood screws #14 x 1-1/2" (by others) permitted in solid core wood doors, if pilot holes are used for installation, when door label allows its use.

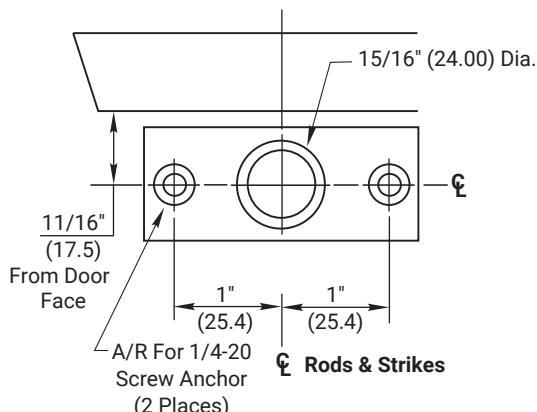

794 STRIKE DETAIL

RESPONSIBILITY
DOOR AND FRAME MANUFACTURERS ARE
RESPONSIBLE FOR PROVIDING ADEQUATE
CONSTRUCTION OR REINFORCEMENTS FOR
PROPER INSTALLATION OF HARDWARE SHOWN.
ALL ARCHITECTURAL BUILDERS HARDWARE MUST
BE INSTALLED ON PROPERLY REINFORCED
DOORS AND FRAMES, REGARDLESS OF TYPE,
MATERIAL, OR METHOD OF CONSTRUCTION.

Experience a safer
and more open world

Copyright © 1999, 2023, 2024, ASSA ABLOY Access and Egress Hardware Group, Inc.
All rights reserved. Reproduction in whole or in part without the express written
permission of ASSA ABLOY Access and Egress Hardware Group, Inc. is prohibited.

1510 & 1510F Surface Vertical Rod Exit Devices with Optional 794 Floor Strike and SNB

Application for Wood Door and H.M. Frame

1-855-557-5078 Ext. 2

www.accentra-assaabloy.com

ACCENTRA

ASSA ABLOY

SUPERSEDES 7415-1012 (12/23) DO NOT SCALE DRAWING

TEMPLATE NUMBER	7415-1012	SHEET	1 of 1	DATE
				05/24