

**FOR NOTES & FRAME PREP  
SEE SHEET 2**

## DOOR SPECIFICATION

Door Thickness: 1-3/4"  
(45mm) Min.


Door Construction: Wood or composite door with fire or panic rating as required. Door may require metal channel edge which may alter backset dimensions. Consult door manufacturers listings.

## Exit Device Ratings:

6160-LBR, 6165-LBR,  
7160-LBR, 7165-LBR,  
Panic Exit Door up to 4' x 8'


6160F90-LBR, 7160F90-LBR,  
90 Minutes rated Fire Exit  
Door up to 4' x 8'

6160-LBR-10, 6165-LBR-10.,  
7 -LBR-10, 160 7165-LBR-10,  
Panic Exit Door up to 4' x 10'

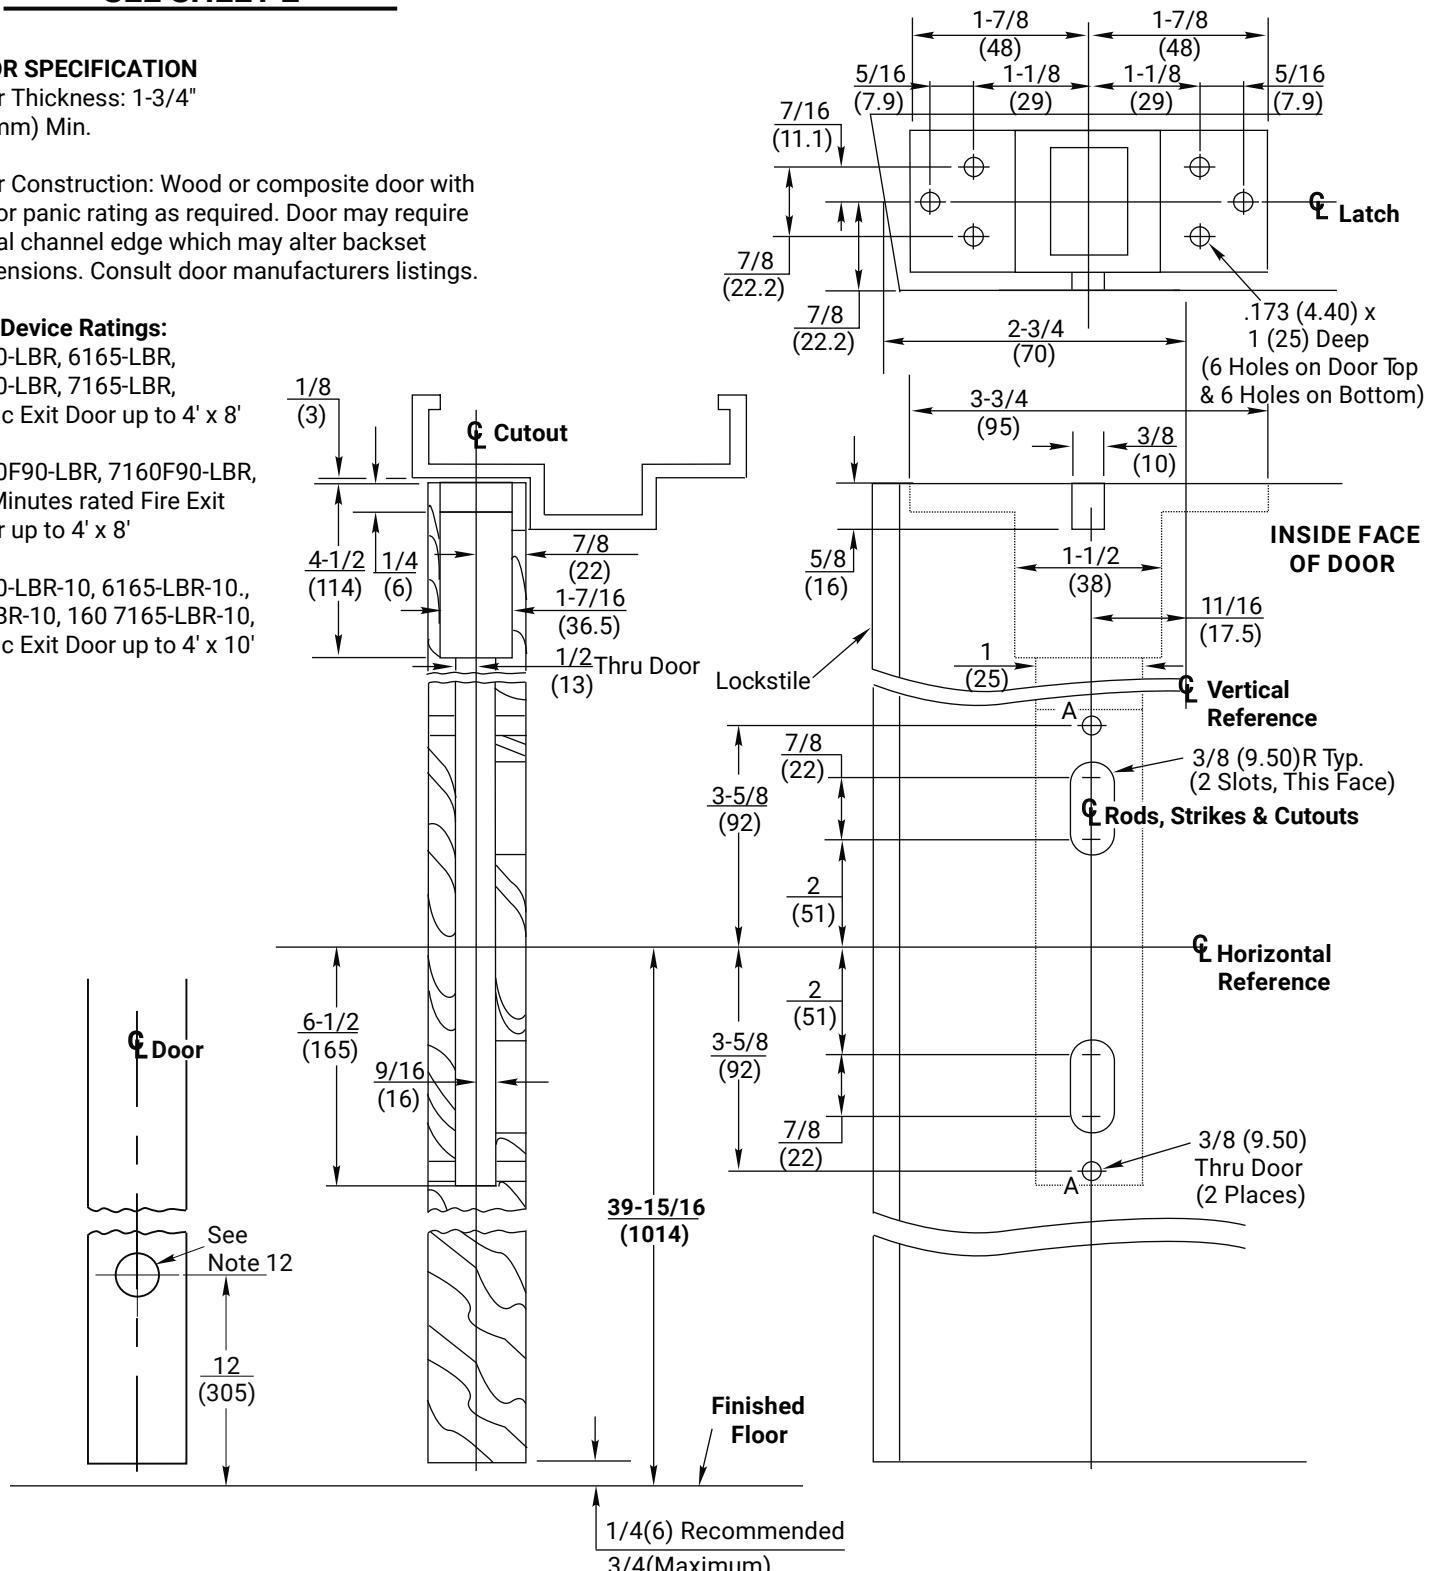

<p><b>RESPONSIBILITY</b> DOOR AND FRAME MANUFACTURERS ARE RESPONSIBLE FOR PROVIDING ADEQUATE CONSTRUCTION OR REINFORCEMENTS FOR PROPER INSTALLATION OF HARDWARE SHOWN. ALL ARCHITECTURAL BUILDERS HARDWARE MUST BE INSTALLED ON PROPERLY REINFORCED DOORS AND FRAMES, REGARDLESS OF TYPE, MATERIAL, OR METHOD OF CONSTRUCTION.</p>	<p><b>6160(F90)LBR, 7160(F90)LBR, 6165LBR(-10) &amp; 7165LBR(-10)</b></p> <p><b>Concealed Vertical Rod Exit Devices</b></p> <p>Application for Wood Door &amp; Metal Frame Less Bottom Rod; 761 Top Strike</p> <p>1-855-557-5078 Ext. 2</p> <p><a href="http://www.accentra-assaabloy.com">www.accentra-assaabloy.com</a></p>	 
<p><b>Experience a safer and more open world</b></p>	<p>Copyright © 2016, 2024, 2025, ASSA ABLOY ACCENTRA™ Access and Egress Hardware Group, Inc. All rights reserved. Reproduction in whole or in part without the express written permission of ASSA ABLOY Access and Egress Hardware Group, Inc. is prohibited.</p>	<p>SUPERSEDES      04/24      DO NOT SCALE DRAWING</p> <p>TEMPLATE NUMBER      7470-1065      SHEET      1 of 2      DATE      09/25</p>

## 761 Top Strike Preparation (See Note 6)

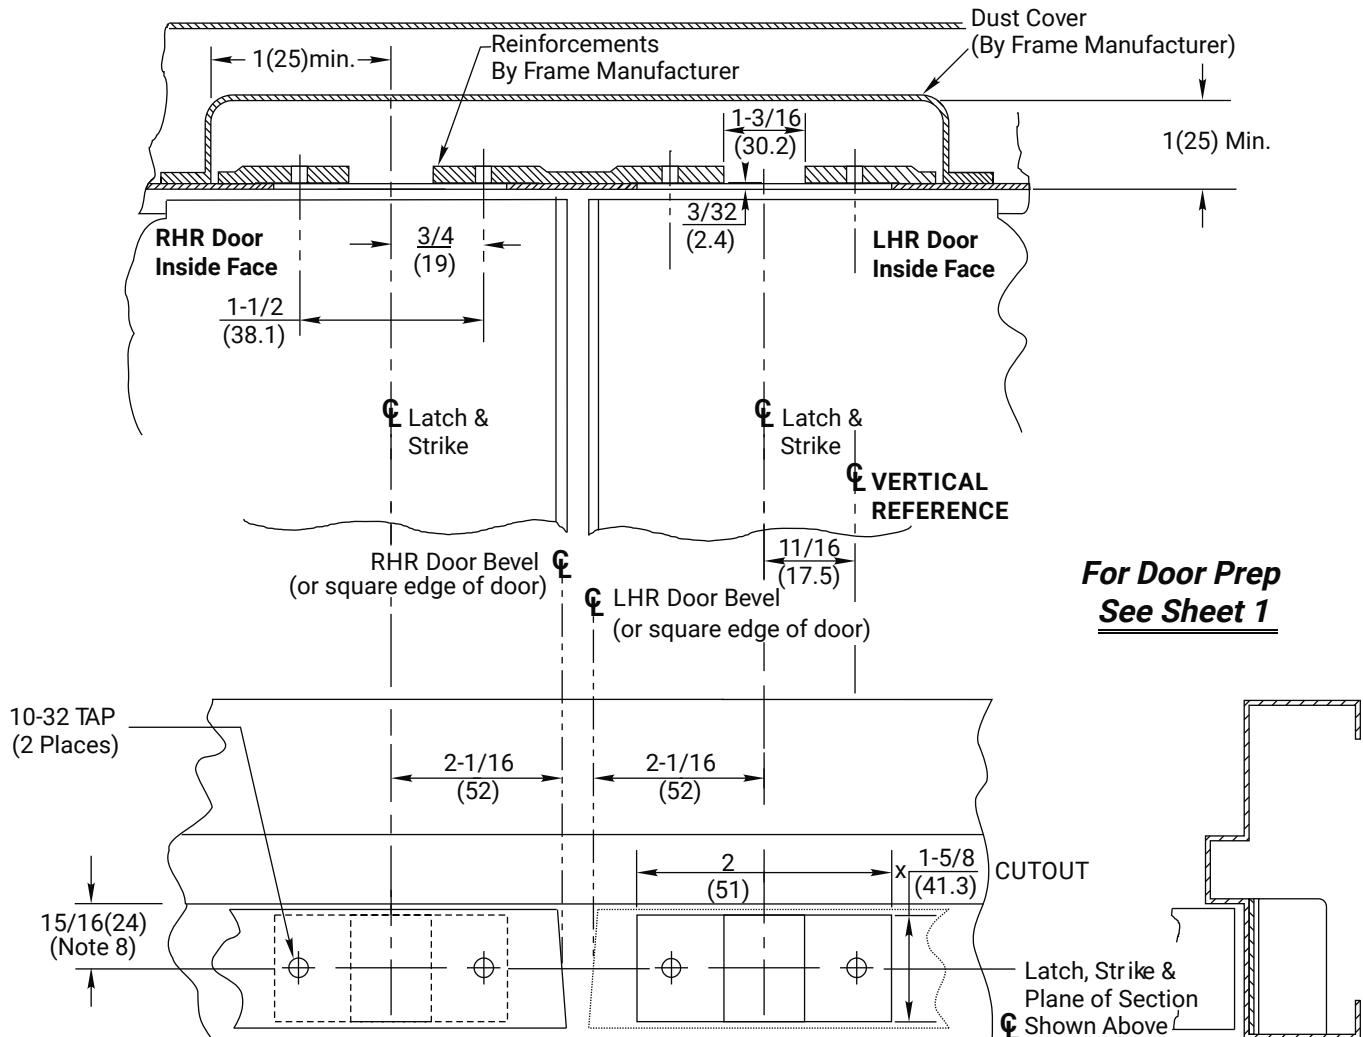

### NOTES:

1. Do not scale drawing.
2. Dimensions are in inches (mm).
3. Preparation is typical for both hands.
4. Minimum door stile width: 4-1/2 (114).
5. Prepare mounting holes when installing the device.
6. Drawing shows elevation (frame bisected on strikecenter), bottom view looking up and side view.
7. Provide adequate structural support to maintain door integrity after device installation with power tools, door use, or abuse.
8. Door located in frame for door silencers. If not used, compensate this dimension to seat the door against the stop without rattle.
9. Device mount to hinge stile (not shown) requires hole location and preparation during device installation. Door structural requirements are similar for both stiles.
10. For outside trim preparation see appropriate trim template.
11. For electrical devices (suffixes "-B", "-G", "-O", "-P", "-S", MELR) also see template 7477-0001.
12. For labeled door pairs only. Reinforce door as needed for heat activated interlocking bolt. See template 7470-1700.
13. Door structure as required for heat activated interlocking bolt. 1-1/2 square 16 ga. plate recommended.

**RESPONSIBILITY**  
DOOR AND FRAME MANUFACTURERS ARE  
RESPONSIBLE FOR PROVIDING ADEQUATE  
CONSTRUCTION OR REINFORCEMENTS FOR  
PROPER INSTALLATION OF HARDWARE SHOWN.  
ALL ARCHITECTURAL BUILDERS HARDWARE MUST  
BE INSTALLED ON PROPERLY REINFORCED  
DOORS AND FRAMES, REGARDLESS OF TYPE,  
MATERIAL, OR METHOD OF CONSTRUCTION.

**6160(F90)LBR, 7160(F90)LBR, 6165LBR(-10)**  
**& 7165LBR(-10)**  
**Concealed Vertical Rod Exit Devices**  
Application for Wood Door & Metal Frame Less Bottom  
Rod; 761 Top Strike  
1-855-557-5078 Ext. 2  
[www.accentra-assaabloy.com](http://www.accentra-assaabloy.com)

**ACCENTRA®**  
**ASSA ABLOY**

Experience a safer  
and more open world

Copyright © 2016, 2024, 2025, ASSA ABLOY ACCENTRA™ Access and Egress Hardware Group, Inc. All rights reserved. Reproduction in whole or in part without the express written permission of ASSA ABLOY Access and Egress Hardware Group, Inc. is prohibited.

SUPERSEDES	04/24	DO NOT SCALE DRAWING
TEMPLATE NUMBER	7470-1065	SHEET
	2 of 2	DATE
		09/25