


NOTES:

1. Do not scale drawing.
2. Dimensions are in inches(mm).
3. LHR active pair shown. Preparation is typical for both hands.
4. Minimum door stile width: 4-1/2(114).
5. Prepare mounting holes when installing the device.
6. For square door edges, or other center clearance, compensate locating dimensions as required to maintain strike to device distance shown.
7. For trim preparation see appropriate trim template.

8. Provide adequate structural support to maintain door integrity after device installation with power tools, door use, or abuse.
9. Device mount to hinge stile (not shown) requires holes location and preparation during device installation. Door structural requirements are similar for both door stiles.
10. For electrical devices (suffixes "-B", "-G", "-O", "-P", "-S", MELR) also see template 7477-0001.
11. Wood screws (by others) permitted in solid core wood doors if pilot holes are used for installation. Device:#14x1-1/4"; Strike:#10x1-1/4".

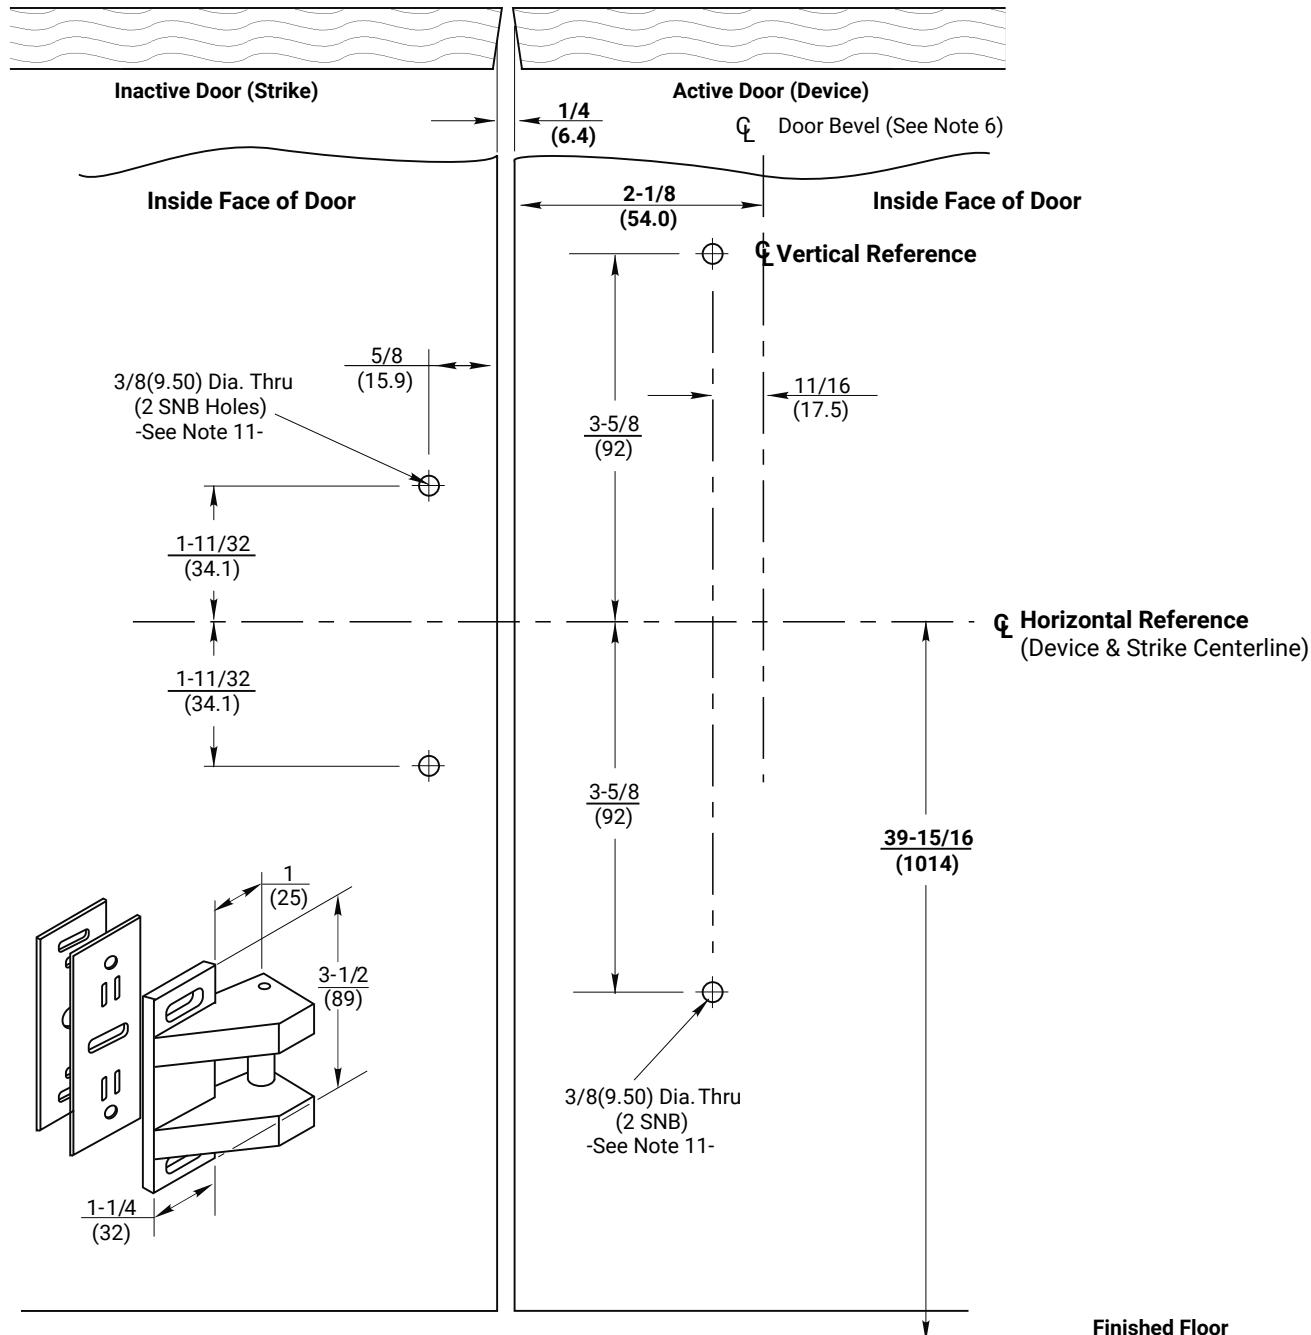

RESPONSIBILITY
DOOR AND FRAME MANUFACTURERS ARE
RESPONSIBLE FOR PROVIDING ADEQUATE
CONSTRUCTION OR REINFORCEMENTS FOR
PROPER INSTALLATION OF HARDWARE SHOWN.
ALL ARCHITECTURAL BUILDERS HARDWARE MUST
BE INSTALLED ON PROPERLY REINFORCED
DOORS AND FRAMES, REGARDLESS OF TYPE,
MATERIAL, OR METHOD OF CONSTRUCTION.

**6100, 6105, 7100 & 7105 Rim Exit Devices
Optional 793 Strike and SNB**
Application to Pair of Wood or Composite Doors
without Mullion (Not for Fire Labeled Devices)
1-855-557-5078 Ext. 2
www.accentra-assaabloy.com

ACCENTRA®
ASSA ABLOY

Experience a safer
and more open world

Copyright © 2015, 2023, 2024, 2025, ASSA ABLOY ACCENTRA™ Access and Egress Hardware Group, Inc. All rights reserved. Reproduction in whole or in part without the express written permission of ASSA ABLOY Access and Egress Hardware Group, Inc. is prohibited.

SUPERSEDES	04/24	DO NOT SCALE DRAWING
TEMPLATE NUMBER	7470-1793	SHEET 1 of 1
		DATE 09/25