

Rods & Strikes

$\frac{1}{8}$ (25)

$\frac{7}{8}$ Inside Face of Door (22)

10-24 Tap (See Note 7)


$\frac{25}{32}$ (20)

$\frac{9}{16}$ (14.3) (Typ.)

10-24 Tap (2 Places)

$1-\frac{9}{16}$ (40)

1. Do not scale drawing.
2. Dimensions are in inches (mm).
3. LHR door shown. Preparation is typical for both door hands.
4. Minimum door stile width: 4-1/2 (114).
5. Prepare mounting holes when installing the device.
6. Unreinforced frames require blind rivet nuts (by others) to mount the strike.
7. This hole **MUST** be field located using physical part as template, after installation is complete and device is fully operational.
8. For outside trim preparation see appropriate trim template.
9. Provide adequate structural support to maintain door integrity after device installation with power tools, door use, or abuse.
10. Device mount to hinge stile (not shown) requires hole location and preparation during device installation. Door structural requirements are similar for both door stiles.
11. For electrical devices (suffixes "-B", "-G", "-O", "-P", "-S", MELR) see also template 7477-0001.
12. Wood screws #14 x 1-1/4" (by others) permitted for solid core wood doors if pilot holes are used for installation, when door label allows its use.

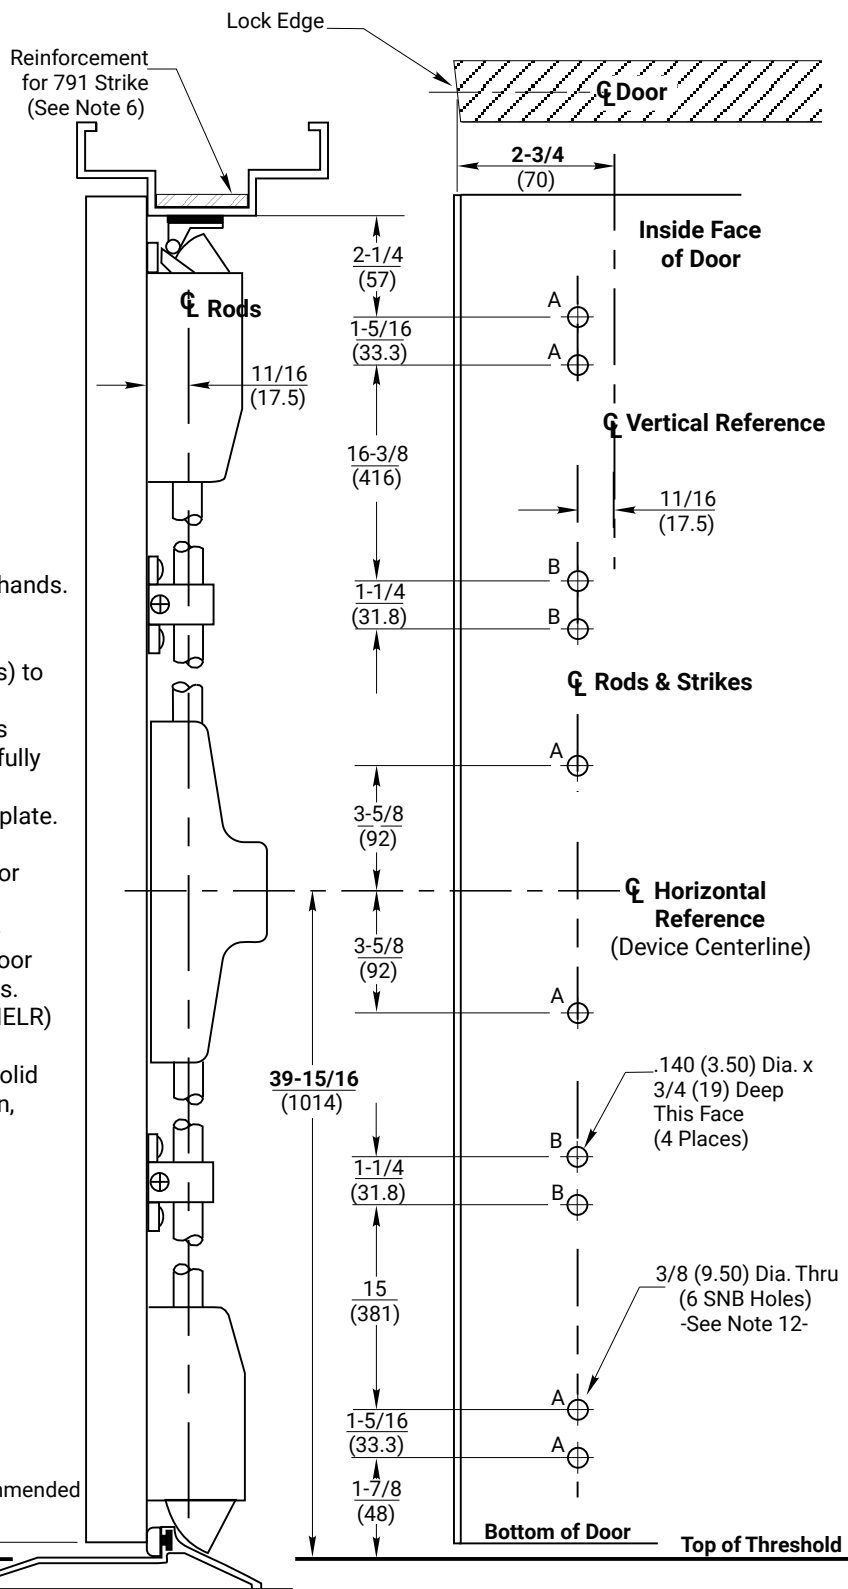

SUPERSEDES 04/24		DO NOT SCALE DRAWING	
TEMPLATE NUMBER 7470-1016		SHEET 1 of 1	DATE 09/25