
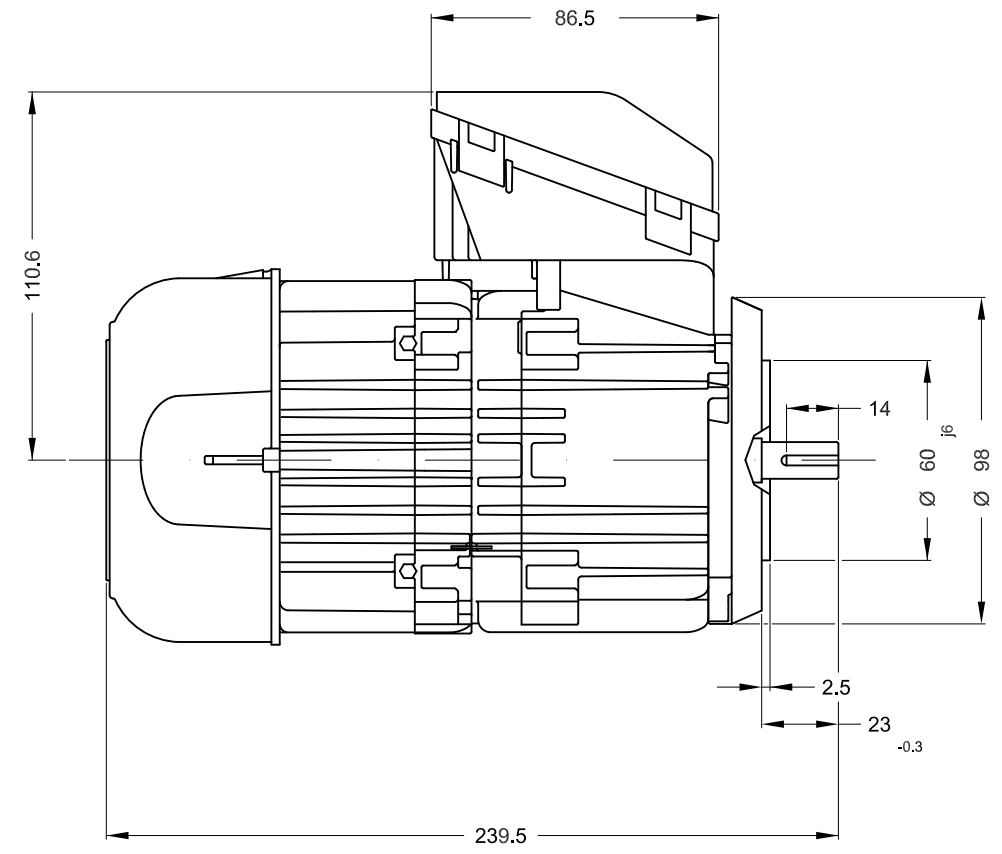


1 2 3 4 5 6

A

B


C

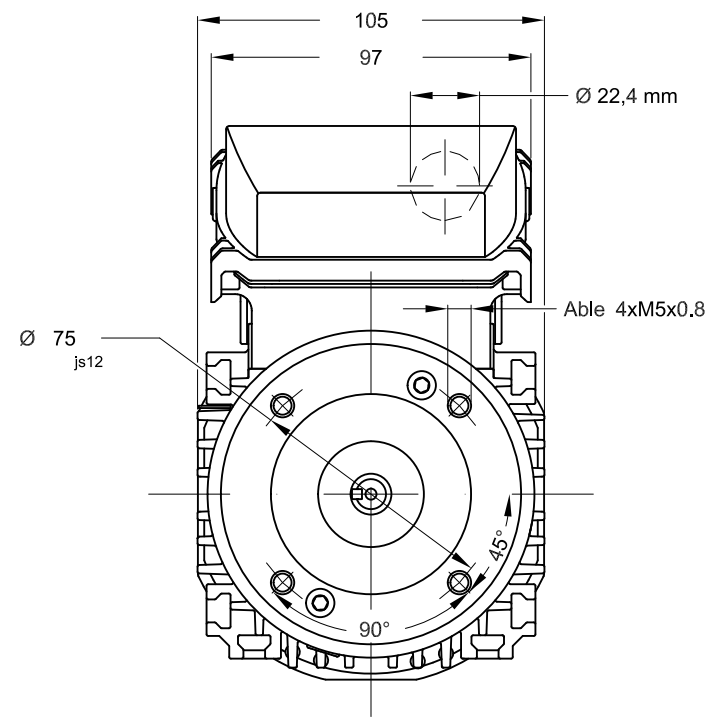

D

E

Cables outlet directed to NDE  
 Without finish coating  
 Without coating  
 Mounting B14T

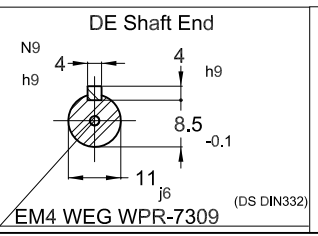

0.18 kW 04 Poles 50 Hz A

						HYBRISUSER				00	
ECM	LOC	SUMMARY OF MODIFICATIONS				EXECUTED	CHECKED	RELEASED	DATE	VER	
EXECUTED	HYBRISUSER	THREE PH. MOTOR GENERAL PURPOSE IE2		FRAME W63 IP55 TEFC		PREVIEW				WEG	
CHECKED						WDD 00					
RELEASED						SHEET		1 / 1			
REL. DATE		WMO	Jaragua do Sul	Product Engineering							