
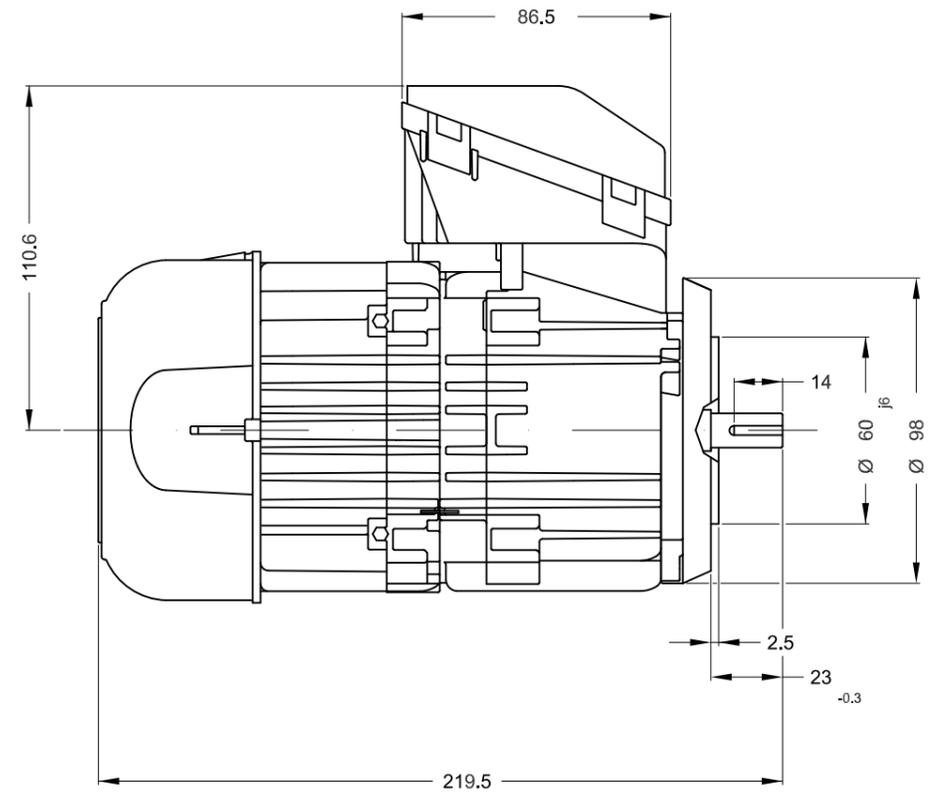


1 2 3 4 5 6

A

B


C

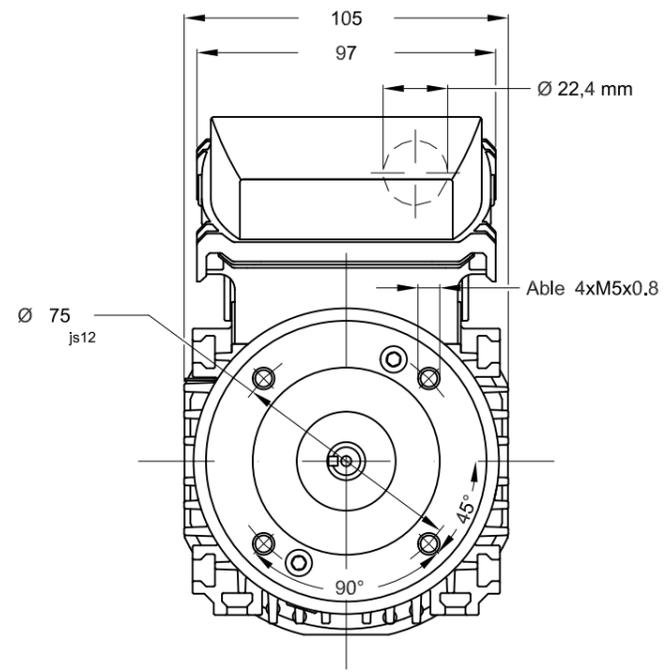

D

E

Cables outlet directed to NDE
 Without finish coating
 Without coating
 Mounting B14T



0.12 kW 04 Poles 50 Hz A

| | | | | | | | | | | | |
|-----------|------------|-------------------------------------|----------------|---------------------|--|------------|---------|----------|------|-----|--|
| | | | | | | HYBRISUSER | | | | 00 | |
| ECM | LOC | SUMMARY OF MODIFICATIONS | | | | EXECUTED | CHECKED | RELEASED | DATE | VER | |
| EXECUTED | HYBRISUSER | THREE PH. MOTOR GENERAL PURPOSE IE2 | | FRAME W63 IP55 TEFC | | PREVIEW | | | | WEG | |
| CHECKED | | | | | | WDD 00 | | | | | |
| RELEASED | | | | | | SHEET | | 1 / 1 | | | |
| REL. DATE | | WMO | Jaragua do Sul | Product Engineering | | | | | | | |