

DX³ 4-pole RCBO 6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07, 4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51, 4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81




CONTENTS	PAGE
1. Description, use	1
2. Range	1
3. Overall dimensions.....	1
4. Preparation - Connection.....	1
5. General characteristics.....	3
6. Compliance and approvals.....	15
7. Curves	16
8. Auxiliaries and accessories	25
9. Safety.....	25

1. DESCRIPTION - USE

Residual Current Operated Circuit Breaker (RCBO) with positive contact indication for control, protection against short circuits and overload and isolation of electrical circuits, protecting people from direct and indirect contact and protecting installations from insulation faults.

Symbol:



Technology:

- . Limiting device
- . Simultaneous control of all poles for closing and opening (trip-free mechanism)

2. RANGE

Polarity:

- 4 protected poles

Width:

- . 4 modules (4 x 17.8 mm = 71,2 mm)

Rated currents In:

- 10 / 13 / 16 / 20/ 25/ 32 A

Magnetic tripping curve:

- . C (between 5 and 10 In)
- . B (between 3 and 5 In)

Type:

- . AC (sinusoidal differential alternating current)
- . A (residual current with a DC component)
- . F (immunised against false tripping). F products are also A type.

Sensitivity – Operating time:

- . 30 mA - instantaneous
- . 300 mA - instantaneous
- . 1 000 mA - instantaneous

2. RANGE (continued)

Rated voltage and frequency:

- . 230/400 V~, 50 Hz with standard tolerances
- . 240/415 V~, 50 Hz with standard tolerances


Maximum operating voltage:

- . 440 V~, 50 Hz with standard tolerances

Breaking capacity:

- . I_{cn} = 6000 A in accordance with standard EN/IEC 61009-1
- . I_{cu} = 10 kA in accordance with standard EN/IEC 60947-2

3. OVERALL DIMENSIONS:

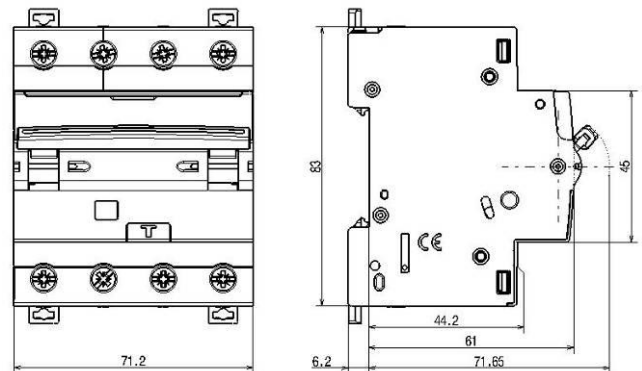


4. PREPARATION - CONNECTION

Mounting:

- . On symmetrical EN 60.715 rail or DIN 35 rail

Operating positions:

- . Vertical horizontal upside down On the side

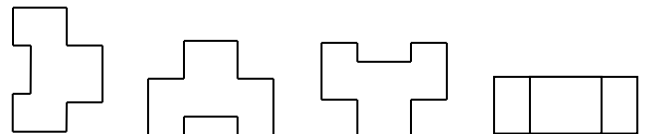

Power supply:



- . Either from the top or the bottom

DX³ 4-pole RCBO 6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81


4. PREPARATION - CONNECTION *(continued)*

400V three-phase network wiring without neutral:
connect the 3 phases as indicated by the arrows in below diagram

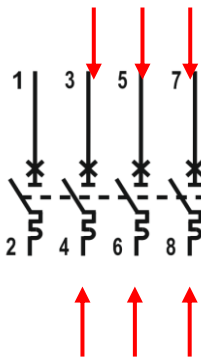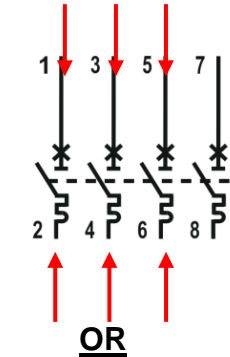


Module maintenance :

. A RCBO may be replaced in the middle of a row supplied with busbars without disconnecting the other products

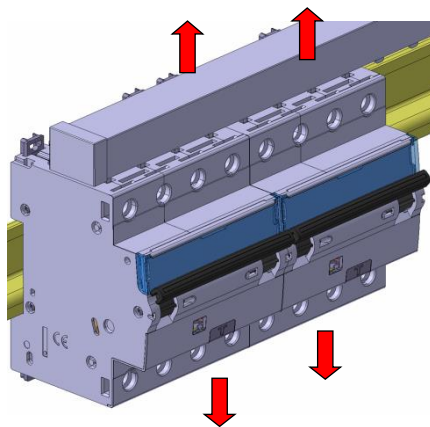


Put the clamp in the unlocking position

Unscrew the four upper terminals completely

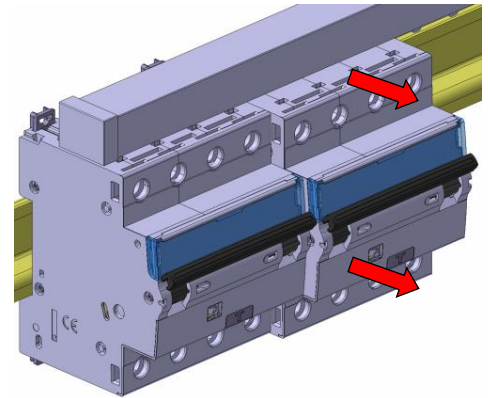

Pull the device forward in order to release it from the rail

Pull the device downward in order to release it completely from the prongs of the busbar

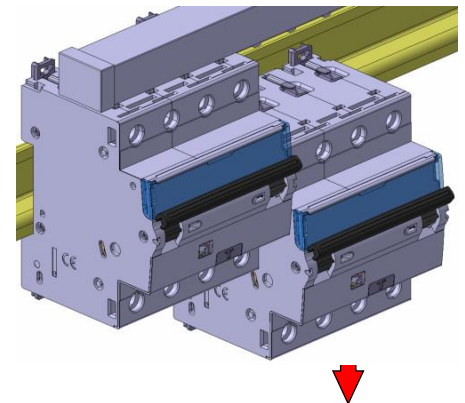

Connection:

- . Terminals protected against direct contact IP20, when device wired
- . Cage terminals, with release and captive screws
- . Terminals fitted with shutters preventing a cable being placed under the terminal, with the terminal partly open or closed
- . Alignment and spacing of the terminals permitting connection with the other products via prong and fork-type (biconnect) supply busbars
- . Terminal depth: 13 mm upstream and 13 mm downstream
- . Screw head: mixed, slotted and Pozidriv no. 2
- . Tightening torque:
 - Recommended: 2.5 Nm
 - Min.: 1.2 Nm
 - Max.: 3.5 Nm

DX³ 4-pole RCBO 6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

4. PREPARATION - CONNECTION (continued)

Conductor type:

- Copper cable
- Cable cross-section:

	Without ferrule	With ferrule
Rigid cable	1 x 0.75 mm ² to 35 mm ² 2 x 0.75 mm ² to 16 mm ²	-
Flexible cable	1 x 0.75 mm ² to 25 mm ² 2 x 0.75 mm ² to 16 mm ²	1 x 0.75 mm ² to 25 mm ²

- Prong supply busbar at the top or the bottom of the product, alone or with a 16 mm² flexible wire (without ferrule) or a connection terminal in the same terminal.
- Fork supply busbar at the bottom of the product

Recommended tools:

- For the screw terminals, screwdriver with 5.5 mm to 6.5 mm blade or Pozidriv no. 2 screwdriver
- For attaching or removing the DIN rail, screwdriver with 5.5 mm to 6.5 mm blade or Pozidriv no. 2 screwdriver

Manual actuation of the RCBO

- Ergonomic 2-position handle:
- "O-OFF": Device open
- "I-ON": Device closed

Contact status display:

- By marking of the handle:
- "O-OFF" in white on a green background = contacts open
- "I-ON" in white on a red background = contacts closed

Trip indication on residual current fault:

- Yellow indicator on the front

Locking:

- Padlocks possible in the open or closed positions with padlock support (Cat. No. 4 063 03) and Ø 5 mm padlock (Cat. No. 4 063 13) or Ø6 mm padlock (Cat. No. 227 97)

Sealing:

- Possible in the open or closed positions

Labelling:

- Circuit identification by way of a label inserted in the label holder situated on the front of the product



5. GENERAL CHARACTERISTICS

Neutral earthing system:

- IT, TT, TN


Marking on the front side:

- By permanent ink pad printing



Marking on the upper panel:

- By permanent ink pad printing

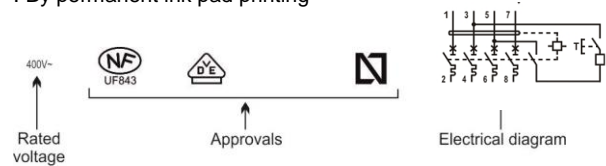

Test operating voltages:

I _{Δn}	30 mA	300 mA	1000 mA
min. U	320 V~	220 V~	230 V~
max. U	440 V~	440 V~	440 V~

Breaking capacity:

- With a three-phase network + neutral (with alternating current 50 Hz)

Standard	Voltage between poles	Breaking capacity	
EN 61009-1	230 V	I _{cn}	6 kA
	400 V		6 kA
EN 60947-2	230 V	I _{cu}	10 kA
	400 V		10 kA
	230 V	I _{cs}	50 % I _{cu}
	400 V		50 % I _{cu}

Residual breaking capacity:

- I_{Δm} = 4.5 kA in accordance with EN 61009-1 section 9.12.11.4d (I_{Δm}: short-circuit to earth)

Breaking capacity on one single pole (phase pole):

- In accordance with I_{IT} EN60947-2 – Appendix H (double fault in IT system): 3 kA at 400 V ~ and 6 kA at 230 V ~
- In accordance with I_{cn1} EN60898-1: 10 kA at 230 V ~

5. GENERAL CHARACTERISTICS (continued)

Isolation distance:

. The distance between the contacts is greater than 5.5 mm with the handle in the open position. The RCBO is suitable for isolation in accordance with standard EN/IEC 61009-1

Insulation voltage:

. $U_i = 500$ V in accordance with standard EN/IEC 61009-1

Degree of pollution:

. 2 in accordance with standard EN/IEC 61009-1

Dielectric strength:

. 3,500 V

Rated impulse withstand voltage:

. $U_{imp} = 4$ kV (wave 1.2/50 μ s)

Protection from false tripping:

. 8/20 μ s wave resistance: 250 A
. 0.5 μ s/100 kHz damped recurring wave resistance: 200 A

Degree or class of protection:

. Terminals protected against direct contact, Class of protection against solid objects and liquids (wired device): IP20 in accordance with standards IEC 529 – EN 60529 and NF 20-010
. Front panel protected against direct contact: IP 40
. Class II in relation to metallic conductive parts
. Class of protection against mechanical impacts IK 02 in accordance with standard EN 62262.

Plastic materials:

. Polyamide and P.B.T.

Enclosure heat and fire resistance:

. Resistance to glow wire tests at 960°C, in accordance with standard IEC/EN 61009-1
. Classification V0, in accordance with standard UL94

Higher heating potential:

. The heat potential of a 30 mA AC type C16 device is estimated at: 4.73 MJ

Closing and opening force via the handle:

. 6 N on opening
. 20 N on closing

Mechanical endurance:

Compliant with standard EN/IEC 61009-1
. Tested with 20,000 operations with no load

Electrical endurance:

Compliant with standard EN/IEC 61009-1
. Tested with 10,000 operations with load (at $I_n \times \cos(\phi 0.9)$)
. Tested with 2,000 residual current trip operations using the Test button or the fault current

Sinusoidal vibration resistance (in accordance with IEC 60068.2.6):

. Axes: x - y - z
. Frequency: 10 to 55 Hz
. Acceleration: 3g ($1g = 9.81$ m.s⁻²)

Resistance to tremors:

. In accordance with standard EN/IEC 61009-1

Ambient temperatures:

. Operation: from – 25°C to + 60°C
. Storage: from – 40°C to + 70°C

DC operation:

. Cannot be used with DC

Frequency:

. Operation at 400 Hz: No
. Operation at 60 Hz: Yes., except sensitivities 30mA, A and AC types, which can be replaced, only for ratings 16A,20A,25A,32A, by F types of equivalent ratings and sensitivity.

Packaged volume:

	Volume (dm ³)	Packaging
For all ratings	0.7	Per 1

Average weight per device:

. 30mA RCBOs= 0,48 kg
. 300mA RCBOs= 0,45 kg
. 1 A RCBOs= 0,45 kg

Derating of RCBOs function of the number of devices placed side by side:

When several RCBOs are installed side by side and operate simultaneously, the heat dissipation of one pole is limited. This results in an increased operating temperature for the RCBOs causing false tripping. Applying the following additional coefficients to the operating currents is recommended.

Number of RCBOs side by side	Coefficient
2 - 3	0.9
4 - 5	0.8
6 - 9	0.7
≥ 10	0.6

These values are provided by recommendation IEC 60439-1 and the standards NF C 63421 and EN 60439-1.
In order to avoid having to use these coefficients there must be good ventilation and the devices must be kept apart using the spacing elements Cat. No. 4 063 07 (0.5 module).

Specific use: Appropriate to operate in humid atmosphere and polluted by a chlorinated environment (pool-type)

5. GENERAL CHARACTERISTICS *(continued)*

Derating of RCBOs in the event of use with fluorescent tubes:

Electronic or ferromagnetic ballasts provide a high inrush current for a very short time. These currents are liable to cause tripping of the RCBOs.

The maximum number of ballasts per RCBOs stated by the lamp and ballast manufacturers in their catalogues should be taken into account during installation.

Impact of height:

	≤2,000 m	3,000 m	4,000 m	5,000 m
Dielectric strength	3,500 V	2,500 V	2,000 V	1,500 V
Maximum operating voltage	400 V	400 V	400 V	400 V
Derating at 30°C	none	none	none	none

Dissipated power (per device):

. B and C curve RCBOs, all types and all sensitivities

Rated current	10 A	13 A	16 A	20 A	25 A	32 A
Power (W)	4.7	5.7	8.9	9.3	10.4	12.3

Derating of RCBOs depending on the ambient temperature:

. The nominal characteristics of a RCBO are modified depending on the ambient temperature which prevails in the cabinet or enclosure where the RCBO is located.

. Reference temperature: 30°C in accordance with standard IEC/EN 60947-2.

In (A)	Ambient Temperature/In								
	- 25°C	- 10°C	0°C	10°C	20°C	30°C	40°C	50°C	60°C
10	13	12	12	11	11	10	10	10	10
13	17	16	15	14	14	13	13	13	13
16	20	19	18	18	18	16	16	16	16
20	26	24	23	22	21	20	20	20	20
25	32	30	29	28	26	25	25	25	25
32	41	38	37	35	34	32	32	32	32

Association and coordination with upstream fuses:

. Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2

. TT neutral earthing or TNS system

Downstream RCBO		Upstream fuse									
		gG and aM types									
		≤20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX ³ 6000 A B and C curves	≤13 A	100 kA	100 kA	100 kA	100 KA	100 KA	100 kA	100 kA	100 kA	100 kA	40 kA
	16 A	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	20 A	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	25 A	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	32 A	-	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA

5. GENERAL CHARACTERISTICS (continued)

Association and coordination with upstream MCBs:

- Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2
- TT neutral earthing or TNS system

		Upstream MCB			
		DX ³ 10 kA B and C curves DX ³ 6000/10 kA B, C and D curves			
Downstream RCBO		≤32 A	40 A	50 A	63 A
DX ³ 6000 A B and C curves	≤25 A	10 kA	10 kA	10 kA	10 kA
	32 A	-	10 kA	10 kA	10 kA

		Upstream MCB											
		DX ³ 10000 16 kA B/C/D curves			DX ³ 25 kA B/C/D curves			DX ³ 36 kA C curve			DX ³ 50 kA B/C/D curves		
Downstream RCBO		≤15 A	32 A	40 to 125 A	≤25 A	32 A	40 to 125 A	≤25 A	32 A	40 to 80 A	≤25 A	32 A	40 to 63
DX ³ 6000 A B and C curves	≤20 A	16 kA	16 kA	16 kA	25 kA	25 kA	25 kA	36 kA	36 kA	36 kA	50 kA	50 kA	50 kA
	25 A	-	16 kA	16 kA	-	25 kA	25 kA	-	36 kA	36 kA	-	50 kA	50 kA
	32 A	-	-	16 kA	-	-	25 kA	-	-	36 kA	-	-	50 kA

Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs):

- Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2
- TT neutral earthing or TNS system

		Upstream MCCBs											
		DPX ³ 160 16 kA			DPX ³ 160 25 kA			DPX ³ 160 36 kA			DPX ³ 160 50 kA		
Downstream RCBO		16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A
DX ³ 6000 A B and C curves	≤13 A	16 kA	16 kA	16 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA
	16 A	-	16 kA	16 kA	-	25 kA	25 kA	-	25 kA	25 kA	-	25 kA	25 kA
	20 A	-	16 kA	16 kA	-	25 kA	25 kA	-	25 kA	25 kA	-	25 kA	25 kA
	25 A	-	-	16 kA	-	-	25 kA	-	-	25 kA	-	-	25 kA
	32 A	-	-	16 kA	-	-	25 kA	-	-	25 kA	-	-	25 kA

5. GENERAL CHARACTERISTICS (continued)

Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs):

- . Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2
- . TT neutral earthing or TNS system

		Upstream MCCB			
		DPX ³ 250 25 kA	DPX ³ 250 36 kA	DPX ³ 250 50 kA	DPX ³ 250 70 kA
Downstream RCBO		25 to 250 A	25 to 250 A	25 to 250 A	25 to 250 A
DX ³ 6000 A B and C curves	≤32 A	25 kA	25 kA	25 kA	25 kA

		Upstream MCCB				
		DPX 250 36 kA DPX-H 250 70KA	DPX / DPX-H 630	DPX / DPX-H 1250	DPX / DPX-H 1600	
Downstream RCBO		25 A	40 to 250 A	250 to 630 A	500 to 1,250 A	630 to 1600 A
DX ³ 6000 A B and C curves	≤20 A	25 kA	25 kA	25 kA	25 kA	25 kA
	25 A	-	25 kA	25 kA	20 kA	20 kA
	32 A	-	25 kA	25 kA	15 kA	15 kA

		Upstream MCCB	
		DPX 250 ER AB	DPX 400 AB
Downstream RCBO			
DX ³ 6000 A B and C curves	≤32 A	25 kA	25 kA

Association and coordination with upstream fuses only for sensitivities 300mA and 1000mA :

- . Three-phase network (+N) 230/240, in accordance with standard IEC 60947-2
- . TT neutral earthing or TNS system

		Upstream fuse									
		gG and aM types									
Downstream RCBO		≤20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX ³ 6000 A B and C curves	≤13 A	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	16 A	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	20 A	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	25 A	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	32 A	-	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA

5. GENERAL CHARACTERISTICS *(continued)*

Association and coordination with upstream MCBs, only for sensitivities 300mA and 1000mA :

- . Three-phase network (+N) 230/240 V, in accordance with standard IEC 60947-2
- . TT neutral earthing or TNS system

		Upstream MCB			
		DX ³ 6000/10 kA B, C and D curves			
Downstream RCBO		≤32A	40A	50A	63A
DX ³ 6000 A B and C curves	≤ 25 A	25 kA	25 kA	25 kA	25 kA
	32 A	-	25 kA	25 kA	25 kA

		Upstream MCB											
		DX ³ 10000 16 kA B/C/D curves			DX ³ 25 kA B/C/D curves			DX ³ 36 kA C curve			DX ³ 50 kA B/C/D curves		
Downstream RCBO		≤25 A	32 A	40 to 120 A	≤25 A	32 A	40 to 125 A	≤25 A	32A	40 to 80 A	≤25 A	32 A	40 to 63 A
DX ³ 6000 A B and C curves	≤20 A	32 kA	32 kA	25 kA	50 kA	50 kA	25 kA	50 kA	50 kA	50 kA	50 kA	50 kA	50 kA
	25 A	-	32 kA	25 kA	-	50 kA	25 kA	-	50 kA	50 kA	-	50 kA	50 kA
	32 A	-	-	25 kA	-	-	25 kA	-	-	50 kA	-	-	50 kA

Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs), only for sensitivities 300mA and 1000mA :

- . Three-phase network (+N) 230/240 V, in accordance with standard IEC 60947-2
- . TT neutral earthing or TNS system

		Upstream MCCB											
		DPX ³ 160 16 kA			DPX ³ 160 25 kA			DPX ³ 160 36 kA			DPX ³ 160 50 kA		
Downstream RCBO		16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A
DX ³ 6000 A B and C curves	≤13 A	25 kA	25 kA	25 kA	40 kA	40 kA	40 kA	50 kA	50 kA	50 kA	50 kA	50 kA	50 kA
	16 A	-	25 kA	25 kA	-	40 kA	40 kA	-	50 kA	50 kA	-	50 kA	50 kA
	20 A	-	25 kA	25 kA	-	40 kA	40 kA	-	50 kA	50 kA	-	50 kA	50 kA
	25 A	-	-	25 kA	-	-	40 kA	-	-	50 kA	-	-	50 kA
	32 A	-	-	25 kA	-	-	40 kA	-	-	50 kA	-	-	50 kA

5. GENERAL CHARACTERISTICS (continued)

Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs), only for sensitivities 300mA and 1000mA:

- Three-phase network (+N) 230/240 V, in accordance with standard IEC 60947-2
- TT neutral earthing or TNS system

		Upstream MCCB			
		DPX ³ 250 25 kA	DPX ³ 250 36 kA	DPX ³ 250 50 kA	DPX ³ 250 70 kA
Downstream RCBO		≤ 250A	≤ 250A	≤ 250A	≤ 250A
DX ³ 6000A B and C curves	≤32A	40 kA	50 kA	50 kA	50 kA

		Upstream MCCB				
		DPX / DPX-H 250	DPX / DPX-H 630	DPX / DPX-H 1250	DPX / DPX-H 1600	
Downstream RCBO		25 A	40 to 250A	≤ 630A	≤ 1250A	≤ 1,600A
DX ³ 6000A B and C curves	≤20 A	50 kA	50 kA	50 kA	50 kA	50 kA
	25A	-	50 kA	50 kA	50 kA	50 kA
	32A	-	50 kA	50 kA	50 kA	50 kA

		Upstream MCCB	
		DPX 250 ER AB	DPX 400 AB
DX ³ 6000A B and C curves	≤32 A	50 kA	50 kA

Selectivity between two levels of protection

- The downstream MCB must always have a magnetic threshold and a rated current lower than those of the upstream protection.
- Selectivity or Discrimination is said to be total (T) if there is discrimination up to the value of breaking capacity (in accordance with standard EN/IEC 60947-2) of the downstream MCB.

Discrimination with upstream fuses, only for sensitivities 300mA and 1000mA:

- Discrimination limit with a voltage of 230 V ~ (Values in A)

		Upstream fuse gG type							
		32A	40A	50A	63A	80A	100A	125A	160A
DX ³ 6000A B and C curves	10 A	-	1600	2200	3200	3000	T	T	T
	13A	-	1400	1800	2600	3000	5600	T	T
	16A	-	1400	1800	2600	3000	5600	T	T
	20A	-	1200	1500	2200	2500	4600	T	T
	25A	-	-	1300	2000	2200	4100	5500	T
	32A	-	-	1200	1700	1900	3500	4500	T

T = Total discrimination

- The downstream RCBO must always have a magnetic threshold and rated current lower than those of the upstream circuit breaker.

5. GENERAL CHARACTERISTICS *(continued)*

Discrimination with upstream fuses, only for sensitivities 300mA and 1000mA :

. Discrimination limit with a voltage of 230 V ~ (Values in A)

Downstream RCBO		Upstream fuse aM type								
		25A	32A	40A	50A	63A	80A	100A	125A	160A
DX ³ 6000A B and C curves	10A	-	1100	1700	2500	5000	T	T	T	T
	13A	-	1000	1400	2100	4000	T	T	T	T
	16A	-	1000	1400	2100	4000	T	T	T	T
	20A	-	-	1300	1800	3400	5100	T	T	T
	25A	-	-	1100	1600	3000	4500	T	T	T
	32A	-	-	-	1300	2400	3800	5000	T	T

Discrimination with upstream MCBs, only for sensitivities 300mA and 1000mA :

. Discrimination limit with a voltage of 230 V ~ (Values in A)

Downstream RCBO		Upstream MCB											
		DX ³ 4500/6 kA - DX ³ 6000/10 kA - DX ³ 10000/16 kA B curve											
Downstream RCBO		10A	13A	16A	20A	25A	32A	40A	50A	63A	80A	100A	125A
DX ³ 6000A B and C curves	10A	-	-	-	80	100	128	160	200	252	3000	5000*	T*
	13A	-	-	-	-	100	128	160	200	252	2500	4000	6000*
	16A	-	-	-	-	-	128	160	200	252	2000	3600	5500*
	20A	-	-	-	-	-	-	160	200	252	1600	3000	4000
	25A	-	-	-	-	-	-	-	200	252	1300	2400	3300
	32A	-	-	-	-	-	-	-	-	252	1000	1800	2700

Downstream RCBO		Upstream MCB											
		DX ³ 3000 - DX ³ 4500/6 kA - DX ³ 6000/10 kA - DX ³ 10000/16 kA C curve											
Downstream RCBO		10A	13A	16A	20 A	25A	32A	40A	50A	63A	80A	100A	125A
DX ³ 6000A B and C curves	10A	-	98	120	150	187	240	300	375	472	3000	5000*	T*
	13A	-	-	120	150	187	240	300	375	472	2500	4000*	6000*
	16A	-	-	-	150	187	240	300	375	472	2000	3600*	5500*
	20A	-	-	-	-	187	240	300	375	472	1600	3000	4000*
	25A	-	-	-	-	-	240	300	375	472	1300	2400	3300*
	32A	-	-	-	-	-	-	300	375	472	1000	1800	2700

. T = Total discrimination

. *: If the discrimination value stated in the table is greater than the breaking capacity of the upstream circuit breaker then the breaking capacity of the upstream device must be taken as the discrimination value (the discrimination value may not exceed the breaking capacity of the upstream device).

5. GENERAL CHARACTERISTICS (continued)

Discrimination with upstream modular MCBs , only for sensitivities 300mA and 1000mA :

. Discrimination limit with a voltage of 230 V ~ (Values in A)

		Upstream MCB											
		DX ³ 4500/6 kA - DX ³ 6000/10 kA - DX ³ 10000/16 kA D curve											
Downstream RCBO		10A	13A	16A	20A	25A	32A	40A	50A	63A	80A	100A	125A
DX ³ 6000A B/C curves	10A	-	-	192	240	300	384	480	600	756	3000	5000	T
	13A	-	-	-	240	300	384	480	600	756	2500	4000	6000
	16A	-	-	-	240	300	384	480	600	756	2000	3600	5500
	20A	-	-	-	-	300	384	480	600	756	1600	3000	4000
	25A	-	-	-	-	-	384	480	600	756	1300	2400	3300
	32A	-	-	-	-	-	-	480	600	756	1100	1450	2700

		Upstream MCB											
		DX ³ 25 kA B curve											
Downstream RCBO		10A	16A	20A	25A	32A	40A	50A	63A	80 A	100A	12 A	
DX ³ 6000A B and C curves	10A	-	-	80	100	500	700	1000	1800	3000	5000	T	
	13A	-	-	-	100	400	600	1200	1500	2500	4000	T	
	16A	-	-	-	-	300	500	700	1300	2000	3600	5500	
	20A	-	-	-	-	-	400	500	1000	1600	3000	4000	
	25A	-	-	-	-	-	-	500	800	1300	2400	3300	
	32A	-	-	-	-	-	-	500	600	1000	1800	2700	

		Upstream MCB											
		DX ³ 25 kA C curve											
Downstream RCBO		10A	16A	20A	25A	32A	40A	50A	63A	80A	100 A	125 A	
DX ³ 6000A B and C curves	10A	-	120	150	187	500	700	1000	1800	3000	5000	T	
	13A	-	120	150	187	400	600	1200	1500	2500	4000	T	
	16A	-	-	150	187	300	500	700	1300	2000	3600	5500	
	20A	-	-	-	187	300	400	500	1000	1600	3000	4000	
	25 A	-	-	-	-	240	400	500	800	1300	2400	3300	
	32A	-	-	-	-	-	300	500	600	1000	1800	2700	

T = Total discrimination

5. GENERAL CHARACTERISTICS (continued)

Discrimination with upstream MCBs, only for sensitivities 300mA and 1000mA :

. Discrimination limit with a voltage of 230 V ~ (Values in A)

		Upstream MCB										
		DX ³ 25 kA D curve										
Downstream RCBO		10A	16A	20A	25A	32A	40A	50A	63A	80A	10 A	125 A
DX ³ 6000A B and C curves	10A	-	192	240	300	500	700	1000	1800	3000	5000	T
	13A	-	-	240	300	400	600	1200	1500	2500	4000	T
	16A	-	-	240	300	384	500	700	1300	2000	3600	5500
	20A	-	-	-	300	384	480	600	1000	1600	3000	4000
	25A	-	-	-	-	384	480	600	800	1300	2400	3300
	32A	-	-	-	-	-	480	600	756	1100	1450	2700

		Upstream MCB									
		DX ³ 36 kA/DX ³ 50 kA C curve									
Downstream RCBO		10A	16A	20A	25A	32A	40A	50A	63A	80A	
DX ³ 6000A B and C curves	10A	-	120	150	210	500	700	1000	1800	3000	
	13A	-	120	150	200	400	600	1200	1500	2500	
	16A	-	-	150	187	300	500	700	1300	2000	
	20A	-	-	-	187	300	400	500	1000	1600	
	25A	-	-	-	-	240	400	500	800	1300	
	32A	-	-	-	-	-	300	500	600	1000	

		Upstream MCB														
		DX ³ 50 kA B curve							DX ³ 50 kA D curve							
Downstream RCBO		≤16A	2 A	25A	32A	40A	50A	63A	10A	16A	20A	25A	32A	40A	50A	63A
DX ³ 6000A B and C curves	10A	-	150	210	500	700	1000	1800	-	192	240	300	500	700	1000	1800
	13A	-	-	200	400	600	1200	1500	-	-	240	300	400	600	1200	1500
	16A	-	-	-	300	500	70	1000	-	-	240	300	384	500	700	1300
	20A	-	-	-	-	400	500	1000	-	-	-	300	384	480	600	1000
	25A	-	-	-	-	-	500	800	-	-	-	-	384	480	600	800
	32A	-	-	-	-	-	500	600	-	-	-	-	-	480	600	756

T = Total discrimination

Discrimination is said to be total if there is discrimination up to the value of the breaking capacity (in accordance with EN 60947-2) of the downstream RCBO.

The downstream RCBO must always have a magnetic threshold and rated current lower than those of the upstream circuit breaker.

5. GENERAL CHARACTERISTICS (continued)

Discrimination with upstream Moulded Case Circuit Breakers (MCCBs) , only for sensitivities 300mA and 1000mA :
 . Discrimination limit with a voltage of 230 V ~ (Values in A)

		Upstream MCCB							
		DPX ³ 160 16 kA to 50 kA							
Downstream RCBO		16A	25A	40A	63A	80A	100A	125A	160A
DX ³ 6000A B and C curves	10A	5	T	T	T	T	T	T	T
	13A	-	T	T	T	T	T	T	T
	16A	-	T	T	T	T	T	T	T
	20A	-	5	5	5	5	6	T	T
	25A	-	-	4.5	4.5	4.5	4.5	T	T
	32A	-	-	-	3	4	4	T	T

		Upstream MCCB		
		DPX ³ 250		
Downstream RCBO		40A	100A	160 to 250A
DX ³ 6000A B and C curves	10A	T	T	T
	13A	T	T	T
	16A	T	T	T
	20A	5	T	T
	25A	4	T	T
	32A	-	5	T

		Upstream MCCB				
		DPX 250 / DPX-H 250 Thermal-magnetic				
Downstream RCBO		25A	40A	63A	100A	160 to 250A
DX ³ 6000A B and C curves	10A	5	5	5	T	T
	13A	4	4	4	T	T
	16A	4	4	4	T	T
	20A	-	4	4	T	T
	25A	-	3	3	T	T
	32A	-	-	2	5	T

T = Total discrimination

5. GENERAL CHARACTERISTICS (continued)

Discrimination with upstream Moulded Case Circuit Breakers (MCCBs) , only for sensitivities 300mA and 1000mA :
 . Discrimination limit with a voltage of 230 V ~ (Values in A)

		Upstream MCCB				
		DPX 250 / DPX-H 250 Electronic				DPX / DPX-H 630 / 1250 / 1600 DMX ³ 2500 / 4000
Downstream RCBO		40A	100A	160A	250A	160 to 4000A
DX ³ 6000A B and C curves	10A	T	T	T	T	T
	13A	T	T	T	T	T
	16A	T	T	T	T	T
	20A	5	T	T	T	T
	25A	4	T	T	T	T
	32A	-	5	T	T	T

		Upstream MCCB		
		DPX 250 ER AB		DPX 400 AB
Downstream RCBO		90A	130 to 240A	320 and 400A
DX ³ 6000A B and C curves	10A	T	T	T
	13A	T	T	T
	16A	T	T	T
	20A	T	T	T
	25A	T	T	T
	32A	5	T	T

T = Total discrimination

6. COMPLIANCE AND APPROVALS

In accordance with standards:

- . EN/IEC 61009-1 (NF C 61440)
- . EN/IEC 62423 (F type)

Usage in special conditions:

- . Category C compliant (testing temperature range from -25°C to +70°C, resistant to salt spray) in accordance with the classification defined in Appendix Q of standard IEC/EN 60947-1

Respect for the environment – Compliance with European Union Directives:

- . Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1st July 2006
- . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/04

Plastic materials:

- . Halogen free plastic materials
- . Labelling of parts compliant with ISO 11469 and ISO 1043.

Packaging:


- . Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

Approvals obtained:

- . France: NF

7. CURVES


Thermal-magnetic tripping curve range typical of B and C curve RCBOs:

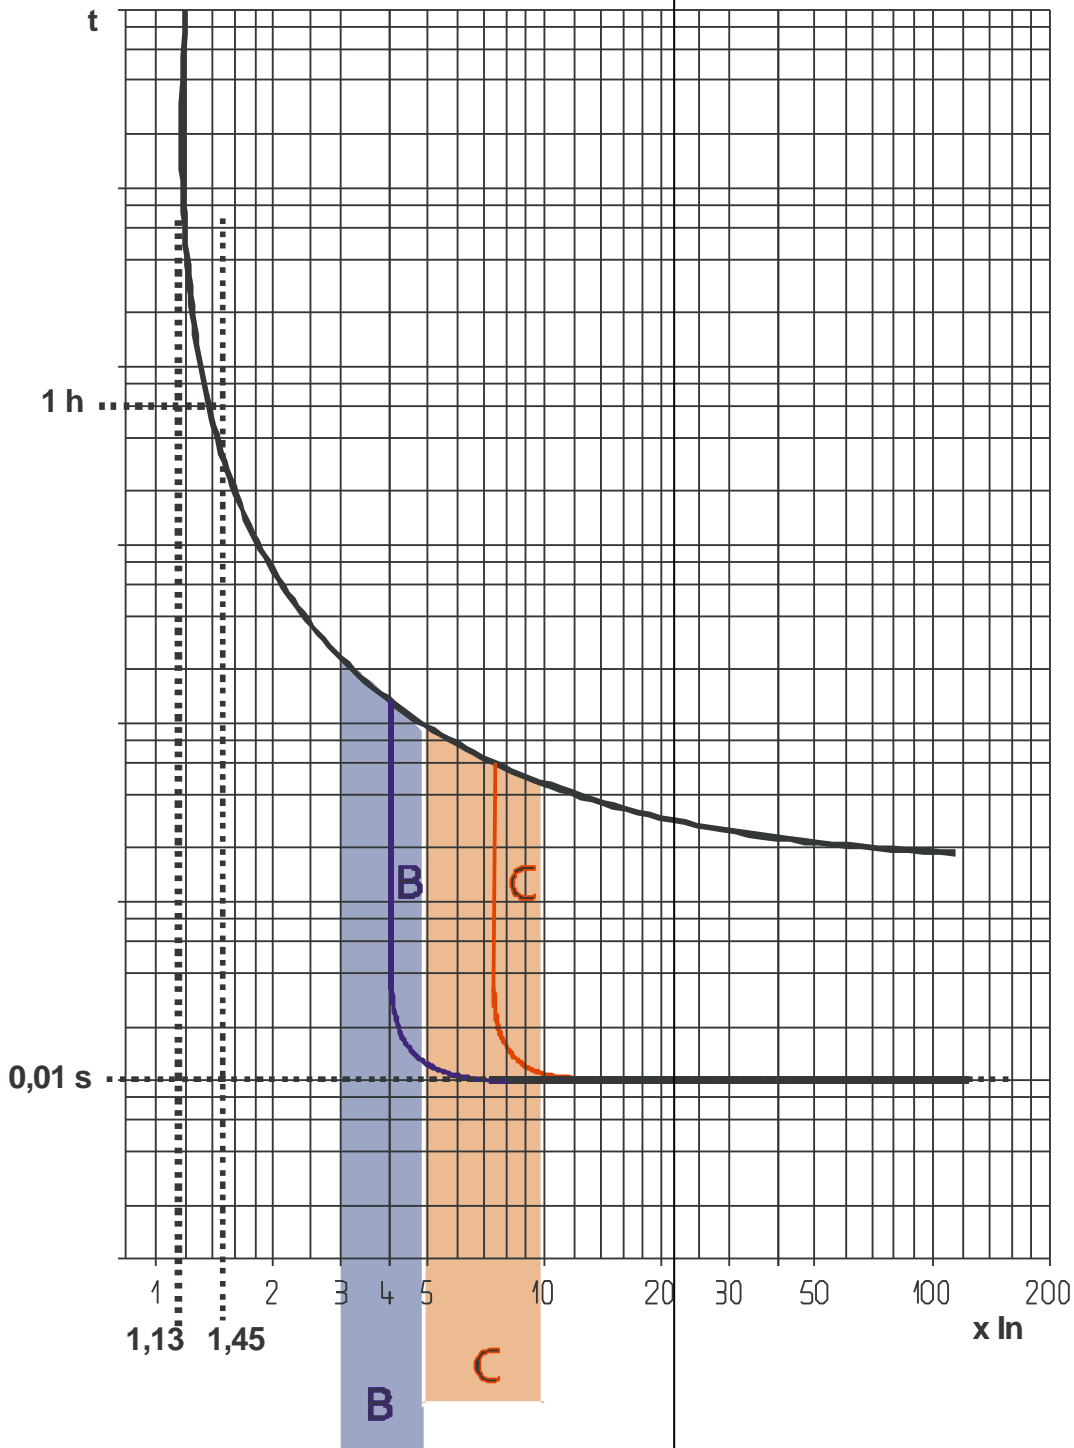

Thermal tripping at ambient temperature = 30°C
 I_n = RCBO rated current

7. CURVES (continued)

Average thermal-magnetic tripping curves range typical of B curve RCBOs:

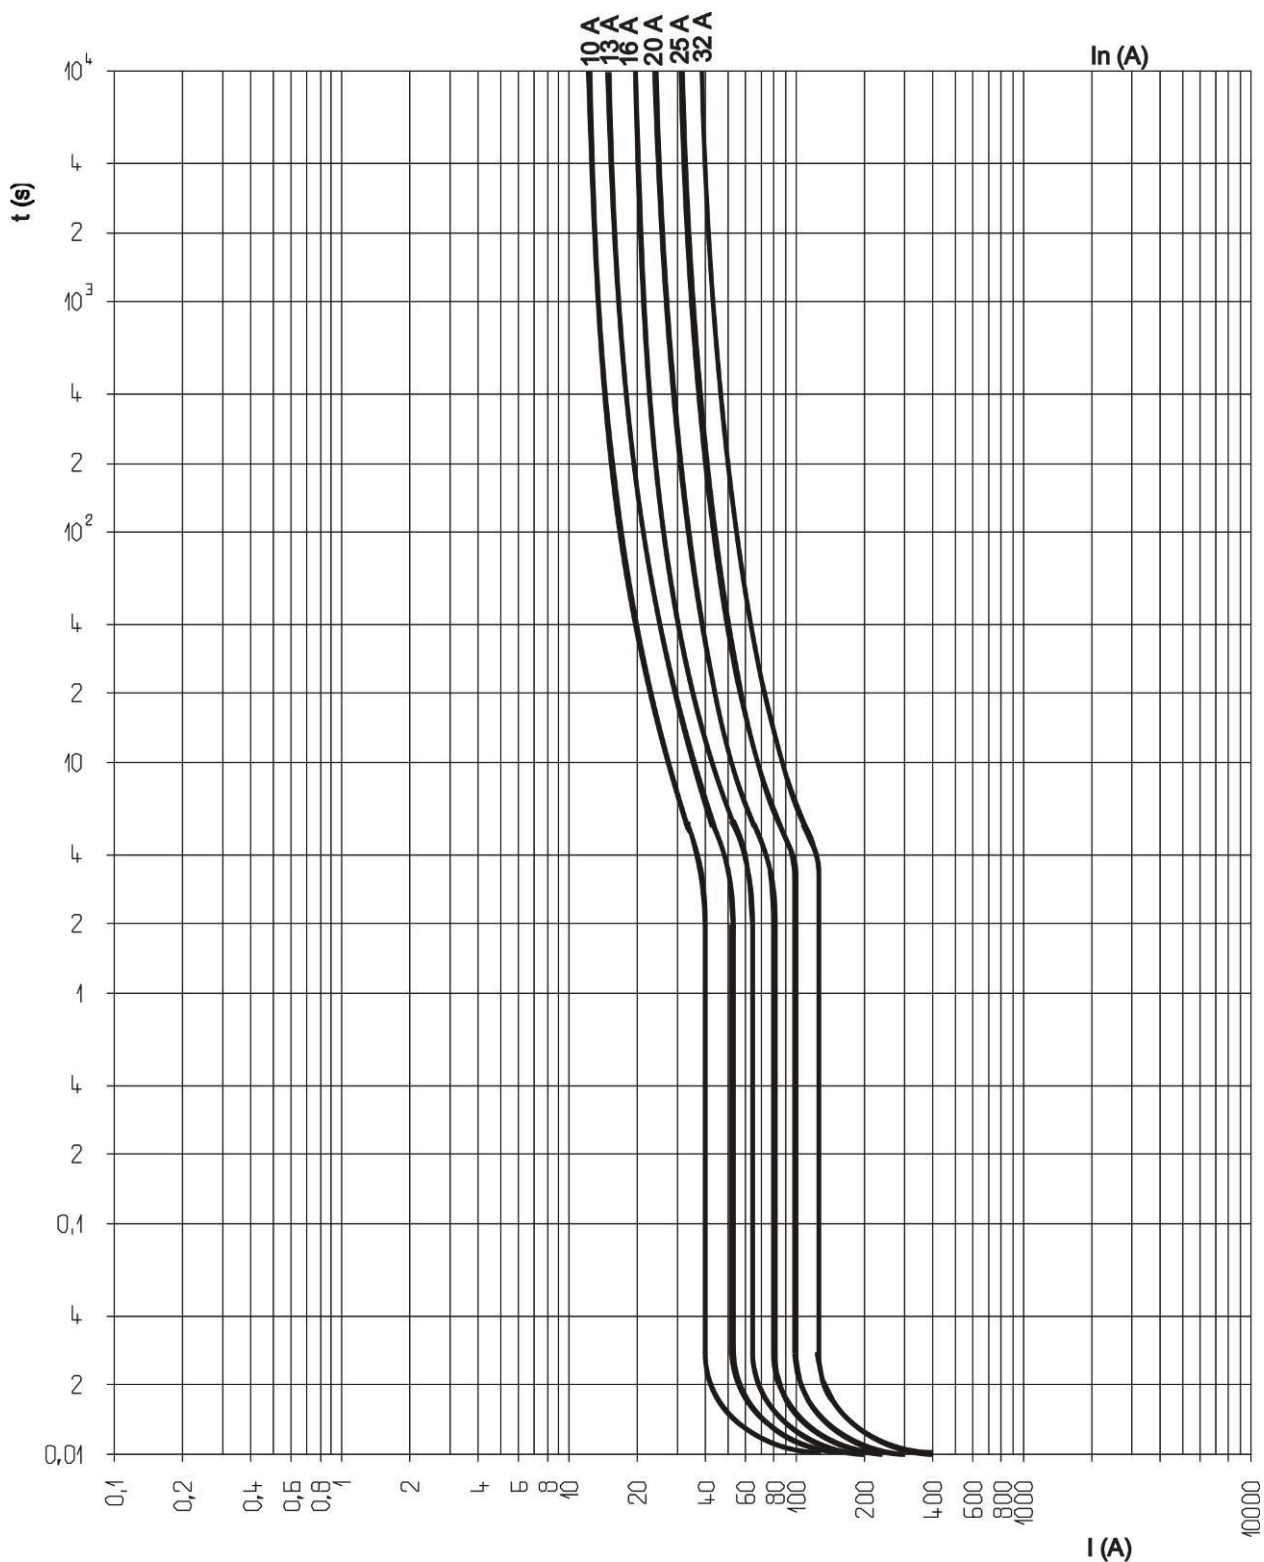

Technical data sheet: F01315EN/05

Updated on: 12/11/19

Created on: 27/05/11




DX³ 4-pole RCBO
6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

7. CURVES (continued)

Average thermal-magnetic tripping curves range typical of C curve circuit RCBOs:

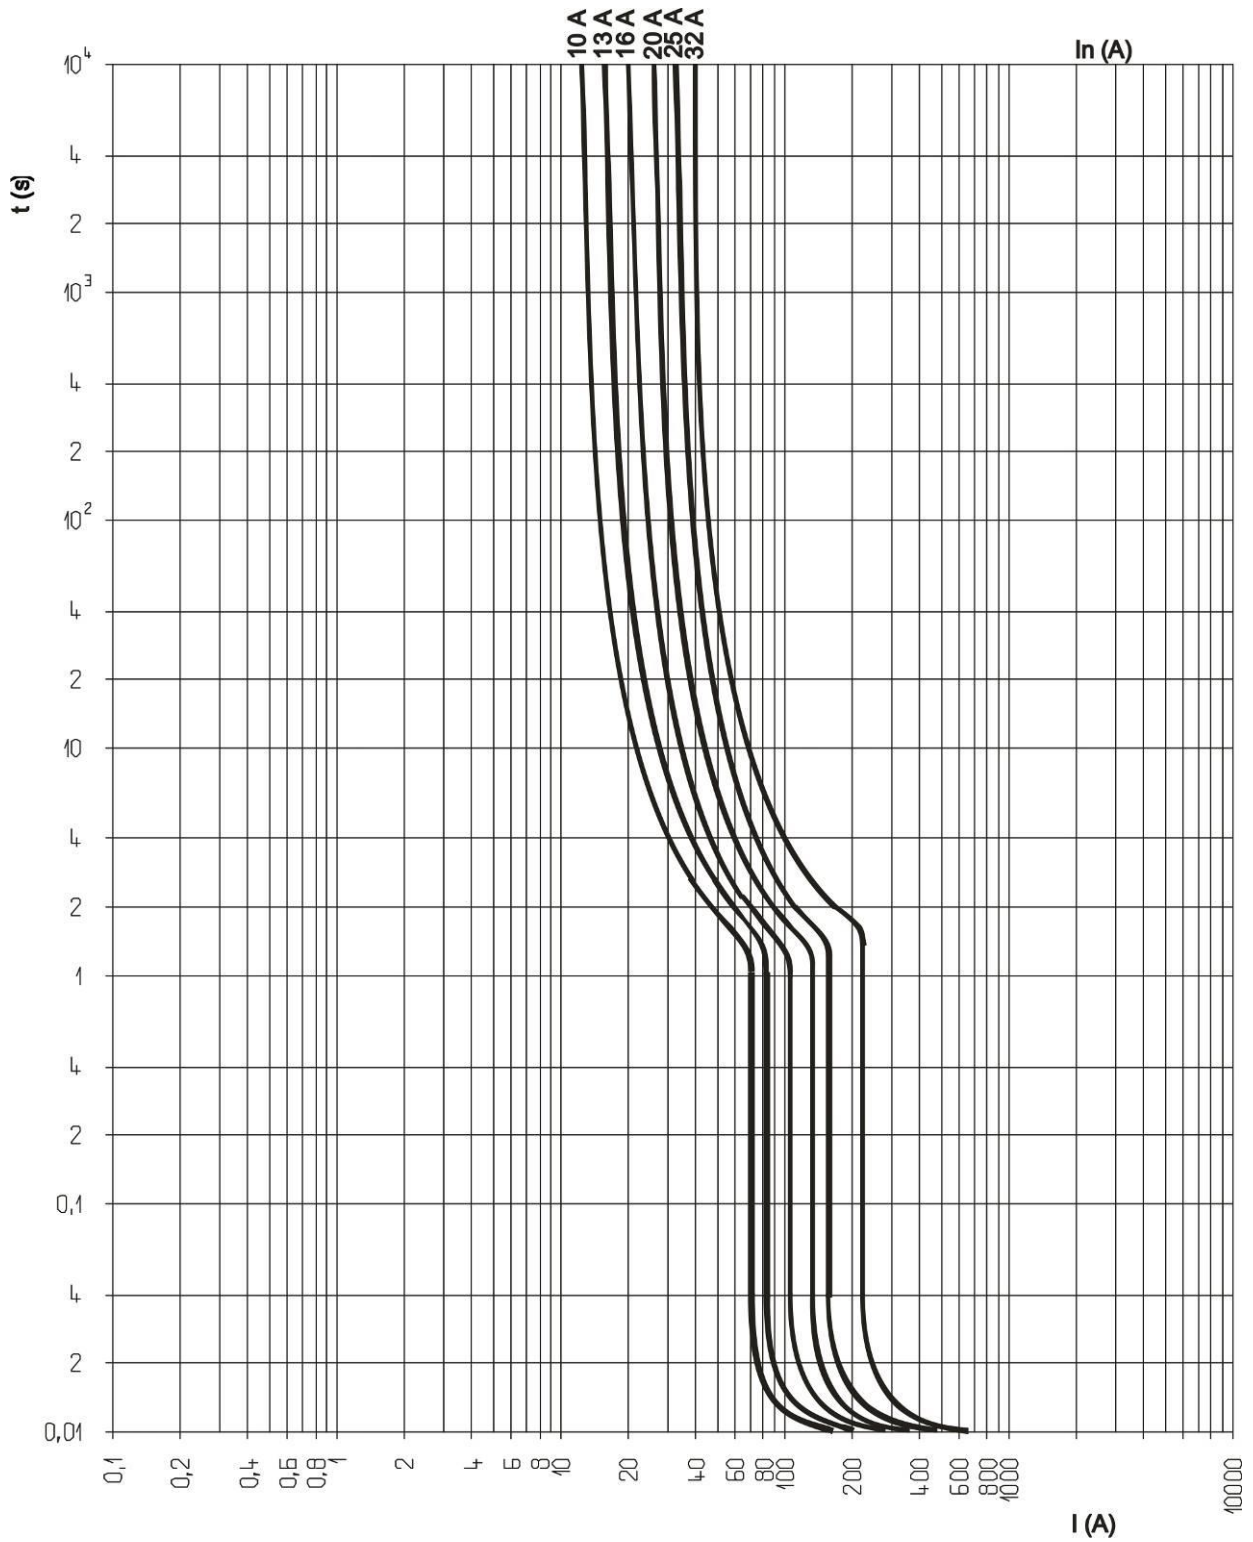

Technical data sheet: F01315EN/05

Updated on: 12/11/19

Created on: 27/05/11




DX³ 4-pole RCBO
6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

7. CURVES (continued)

Current limiting curves:

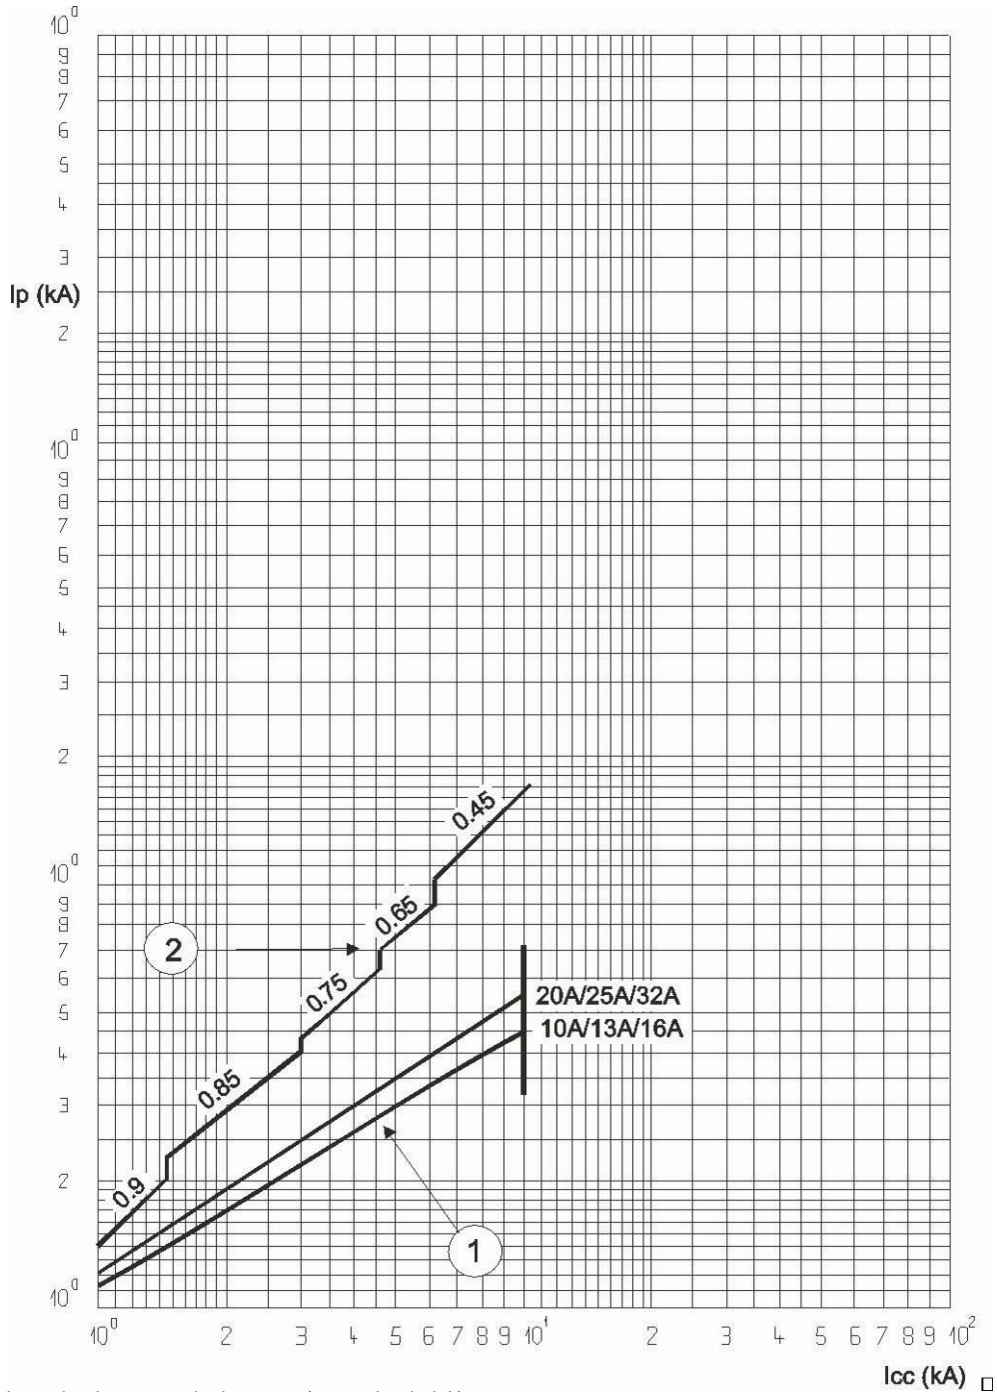


- I_{cc} = Prospective short-circuit symmetrical current (rms value in kA)
- I_p = Maximum peak value (kA)
- ① = Short-circuit rms currents (max. peak)
- ② = Unlimited peak currents (max), corresponding to power factors shown above (0.15 to 0.9)

7. CURVES (continued)

Thermal stress limiting curves:

. B curve 4-pole RCBO

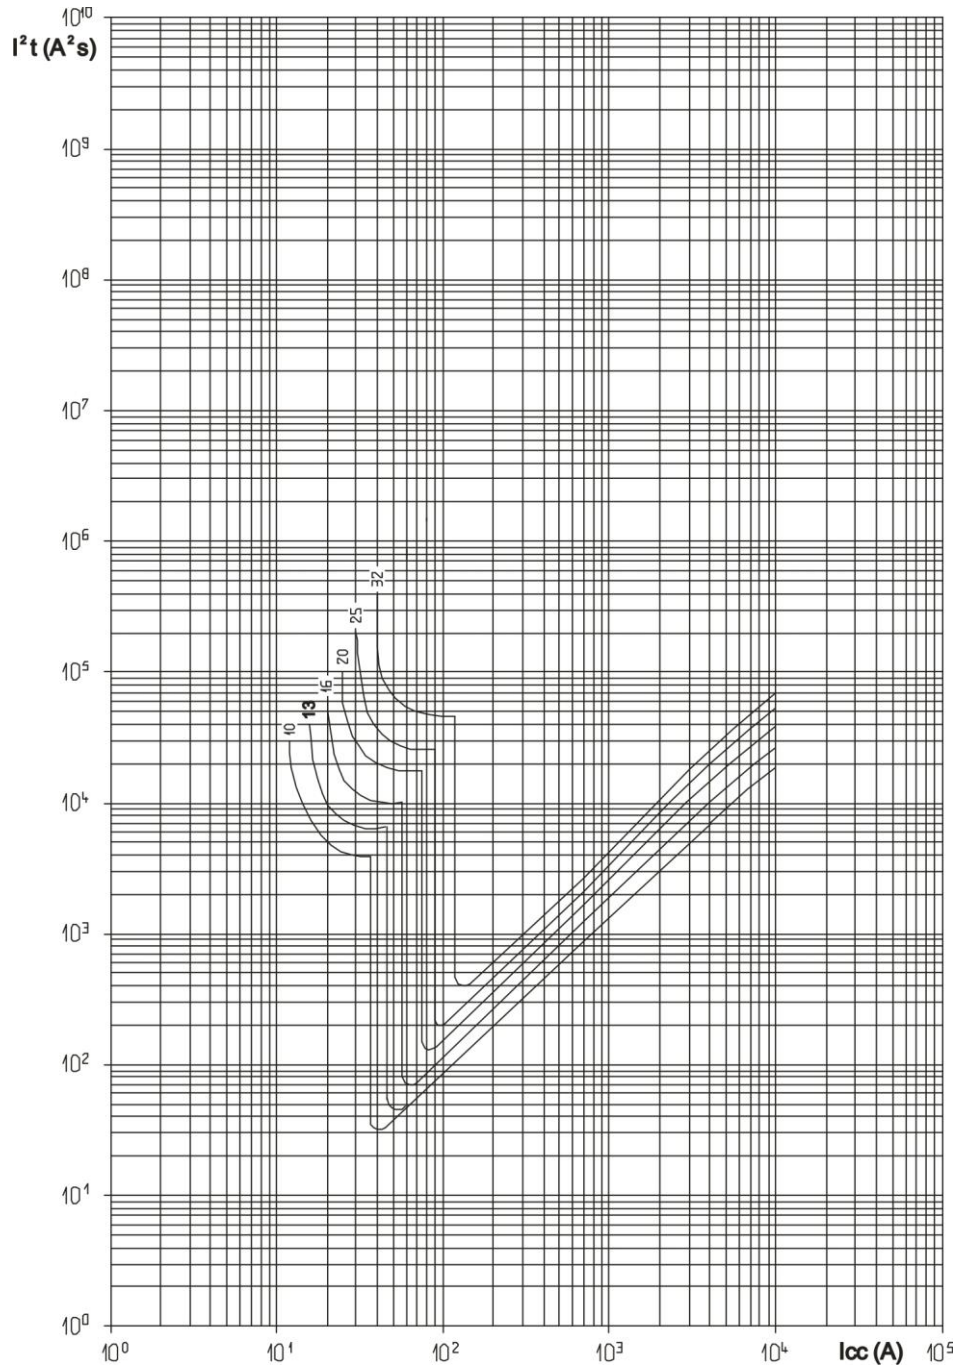

I_{cc} = Prospective short-circuit symmetrical current (rms value in kA)
 I^2t = Limited thermal stress (in A^2s)


DX³ 4-pole RCBO
6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
 4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
 4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
 4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

7. CURVES (continued)

Thermal stress limiting curves:

. C curve 4-pole RCBO

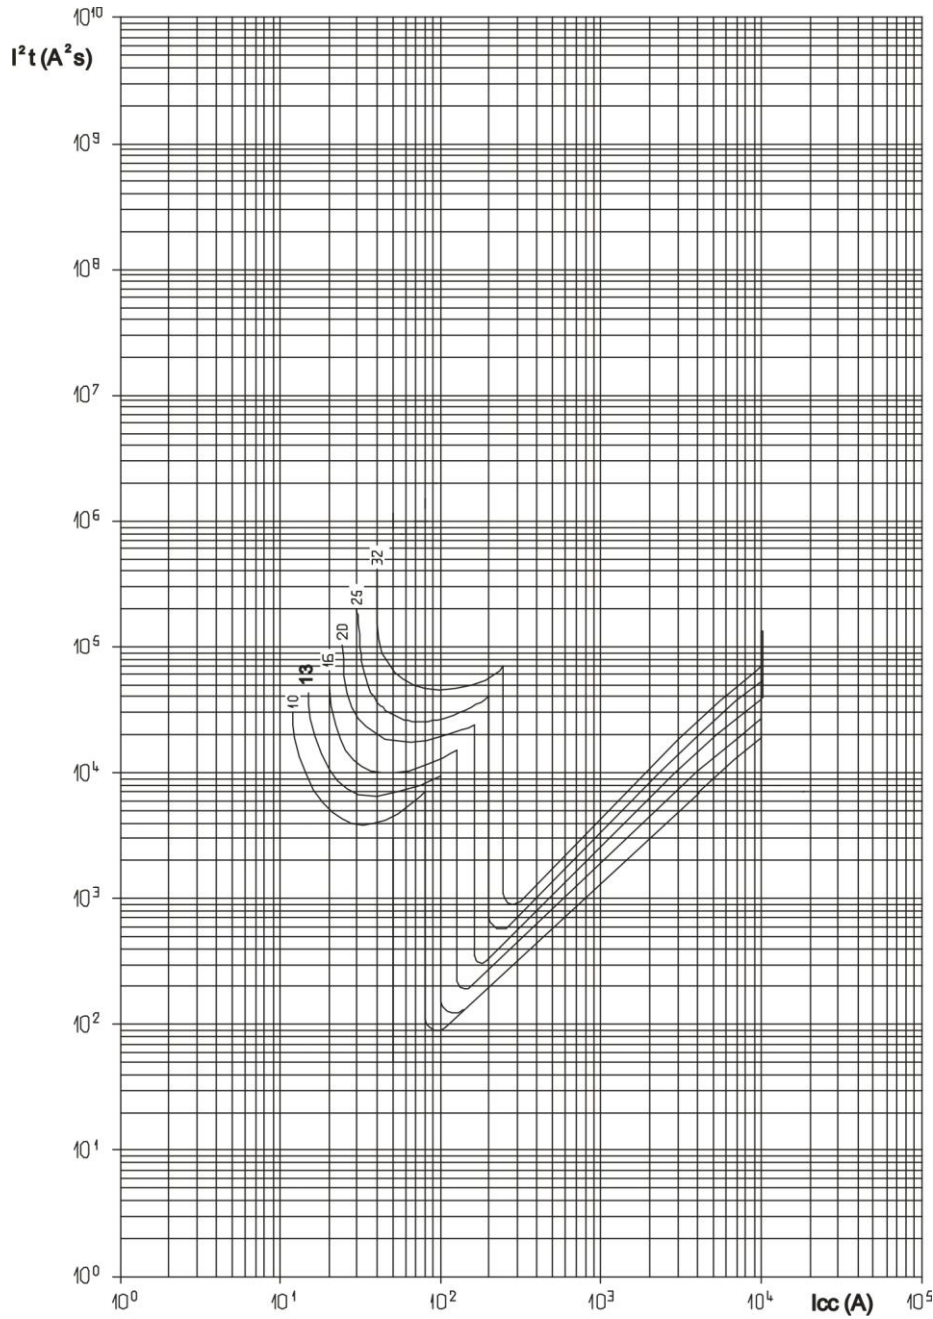

I_{cc} = Prospective short-circuit symmetrical current (rms value in kA)
 I²t = Limited thermal stress (in A²s)

DX³ 4-pole RCBO
6000 A/10 kA


Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
 4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
 4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
 4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

7. CURVES (continued)

Tripping current curves:

. Tripping time curve depending on the value of the fault current:

AC TYPE

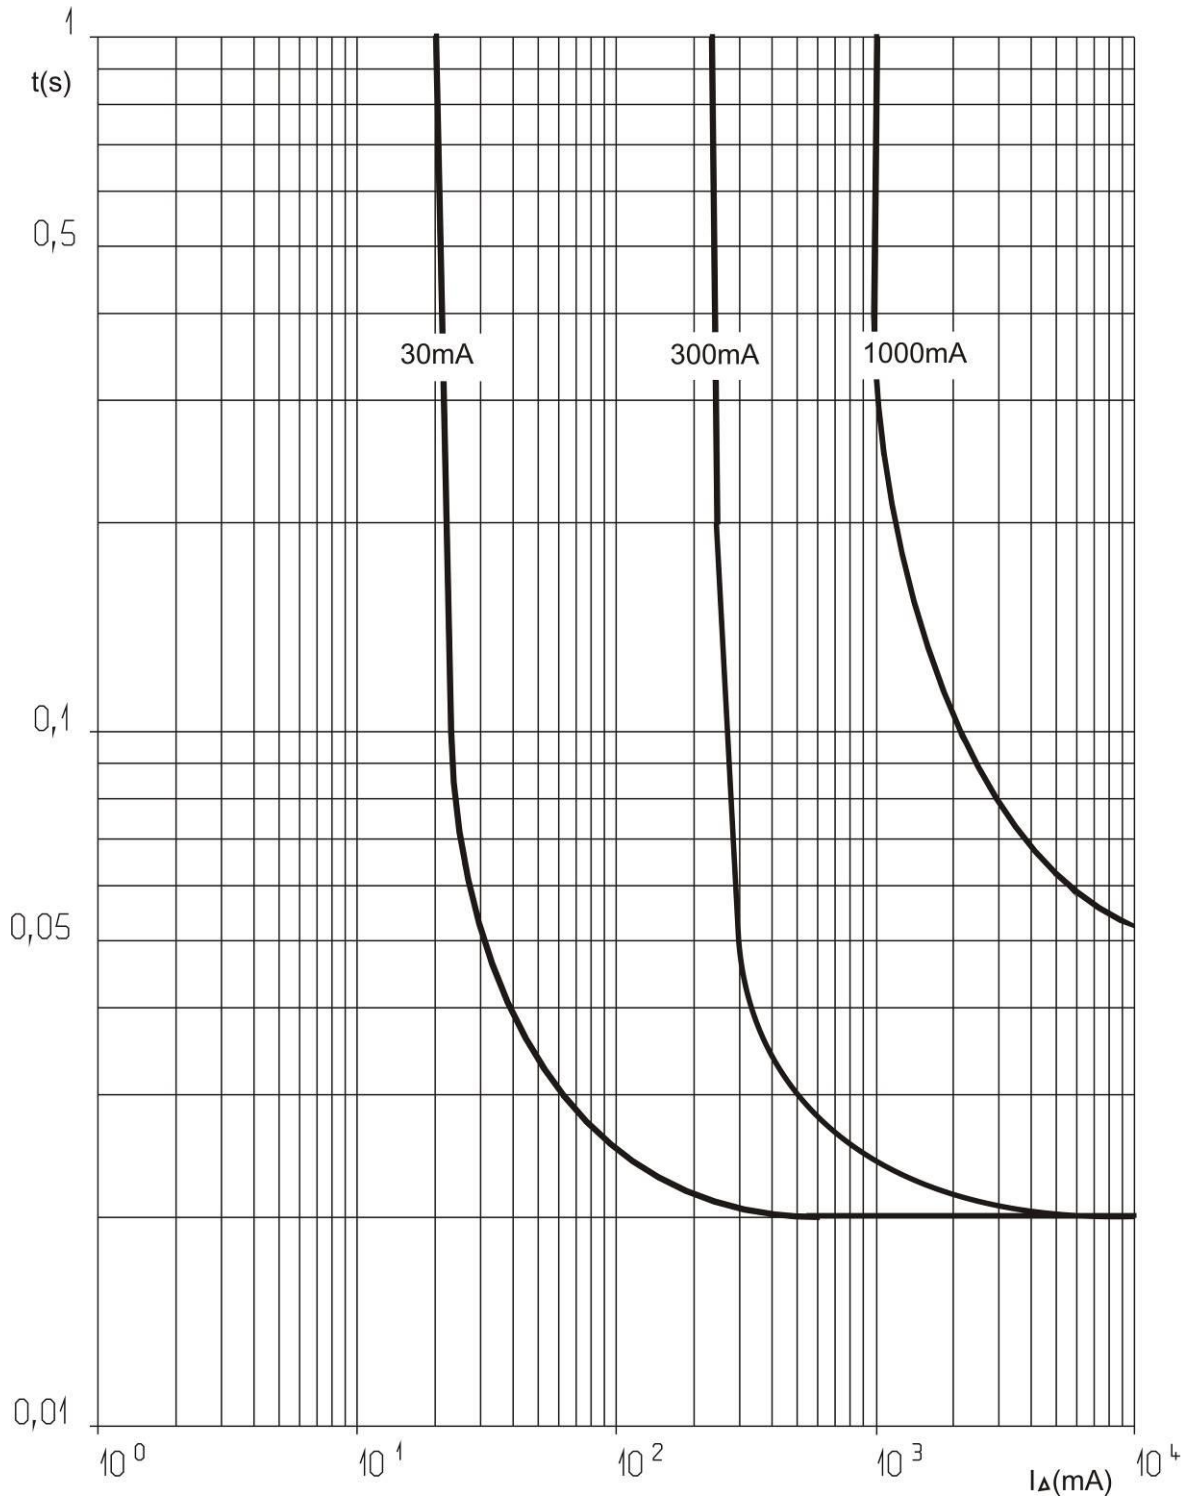

Technical data sheet: F01315EN/05

Updated on: 12/11/19

Created on: 27/05/11

legrand

DX³ 4-pole RCBO
6000 A/10 kA


Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

7. CURVES (continued)

Tripping current curves:

. Tripping time curve depending on the value of the fault current:

A TYPE

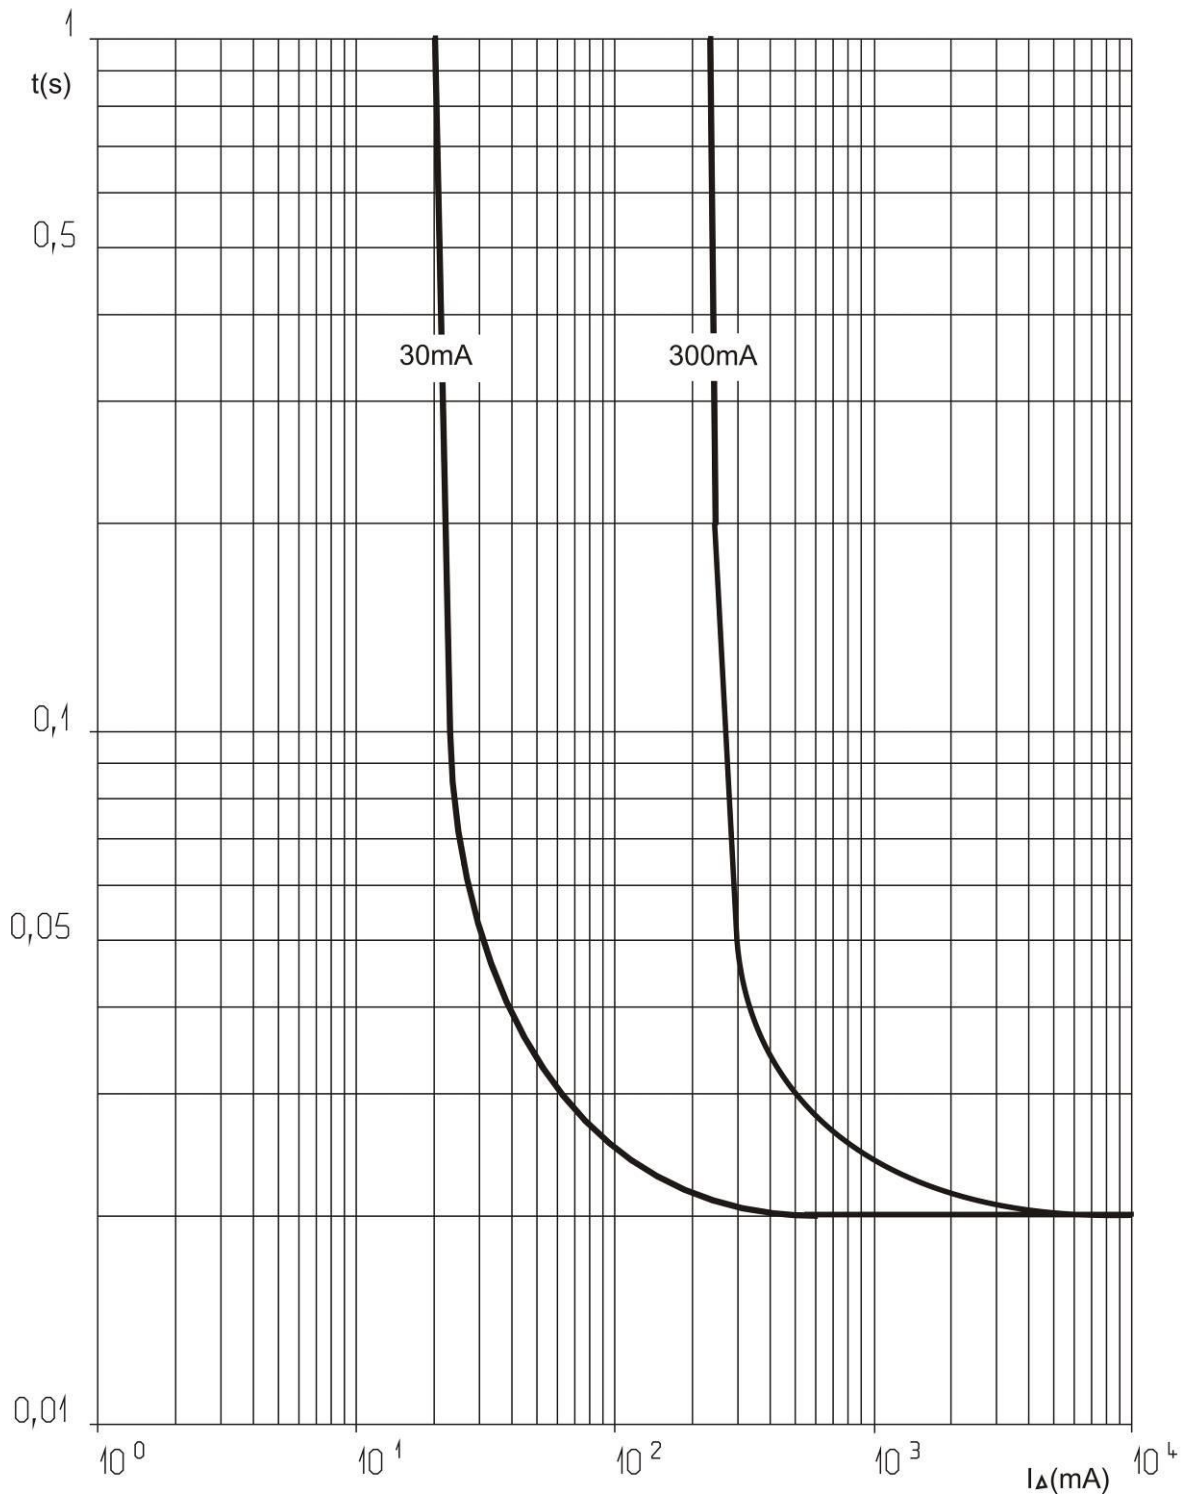

Technical data sheet: F01315EN/05

Updated on: 12/11/19

Created on: 27/05/11

 **legrand**


DX³ 4-pole RCBO
6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

7. CURVES (continued)

Tripping current curves:

. Tripping time curve depending on the value of the fault current:

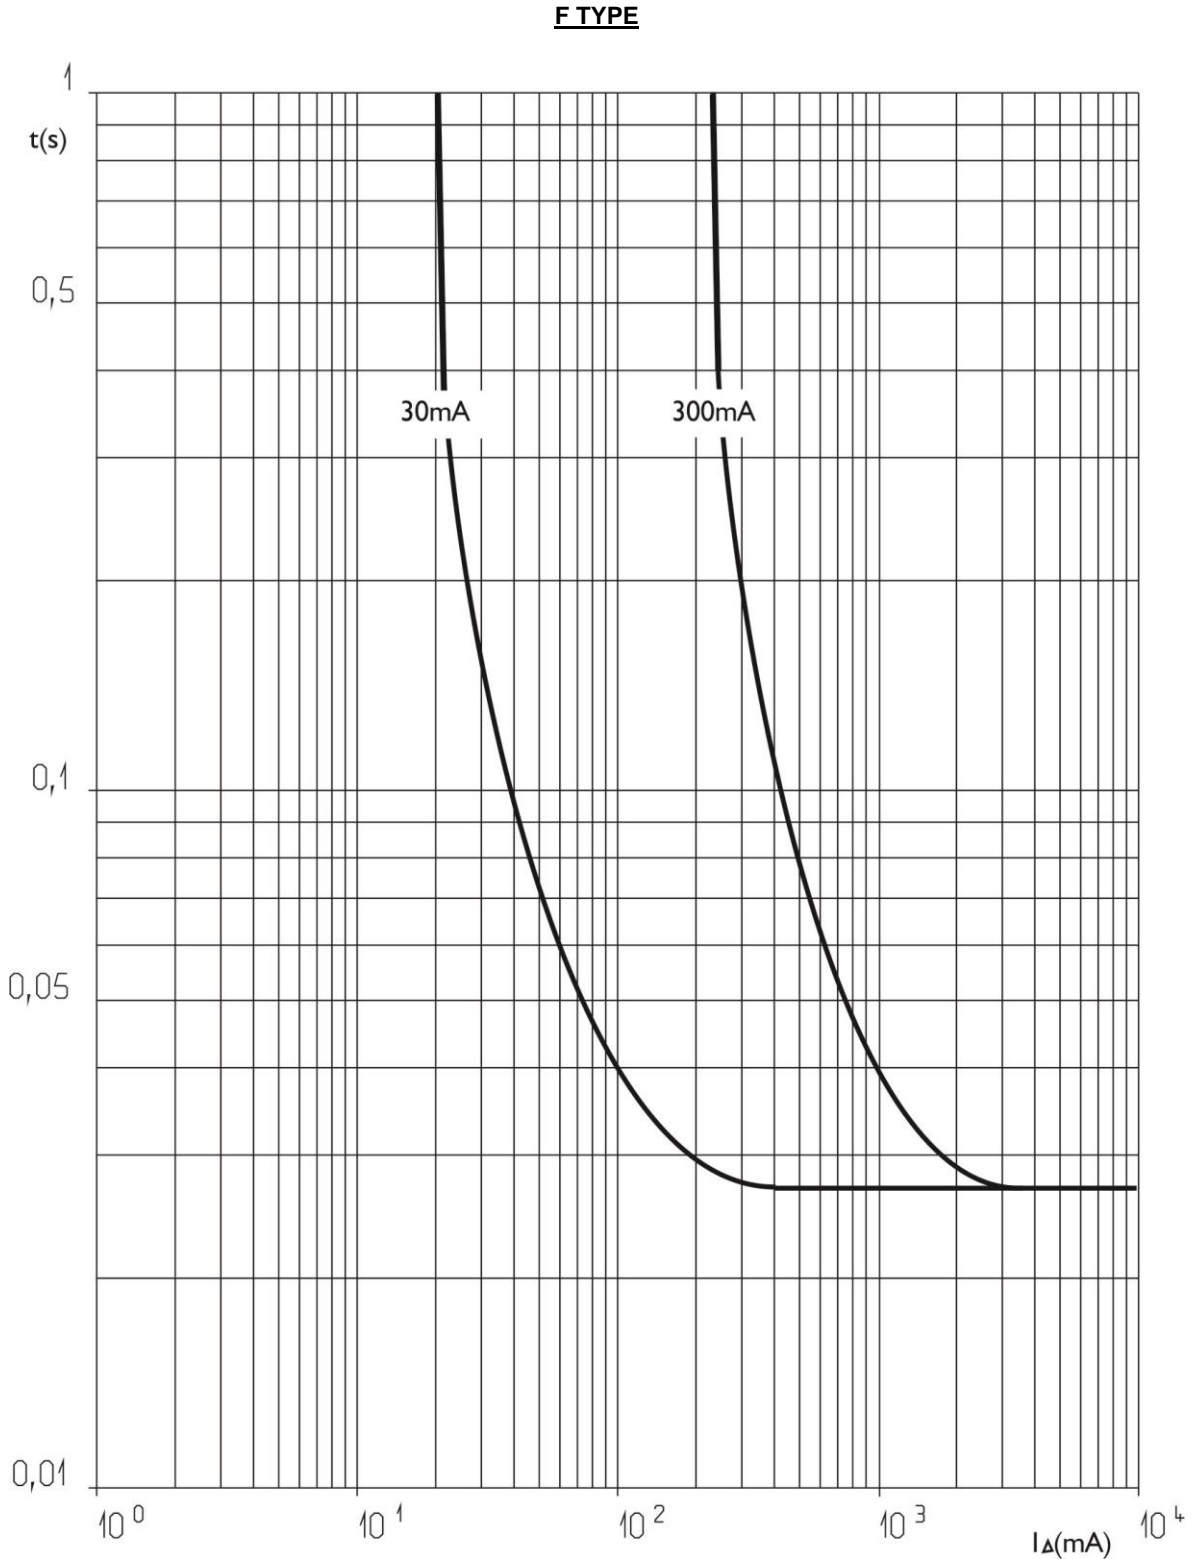

Technical data sheet: F01315EN/05

Updated on: 12/11/19

Created on: 27/05/11

legrand

DX³ 4-pole RCBO
6000 A/10 kA

Cat. N°(s) : 4 111 85, 86, 87, 88, 89 / 4 112 04, 05, 06, 07,
4 112 08, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35,
4 112 36, 37, 38, 39, 40, 41, 42, 44, 45, 46, 47, 49, 50, 51,
4 112 52 / 4 113 50, 56, 57, 59, 60, 61, 62, 80, 81

8. AUXILIARIES AND ACCESSORIES

Wiring accessories:

- . Supply busbar:
- HX³ 4-pole universal supply busbar (Cat. No. 4 049 44, 9 45)
- . Connection Terminals for aluminium cable with max. 50 mm² cross-section (Cat. No. 4 063 10)
- . Sealable screw cover (Cat. No. 4 063 04)

Signalling auxiliaries:

- . Auxiliary contact (0.5 module, Cat. No. 4 062 58)
- . Fault signalling contact (0.5 module, Cat. No. 4 062 60)
- . Auxiliary contact that can be changed into fault signalling contact (0.5 module, Cat. No. 4 062 62)
- . Auxiliary contact + fault signalling contact that can be changed into 2 auxiliary contacts (1 module, Cat. No. 4 062 66)

Control auxiliaries:

- . Shunt trip (1 module, Cat. No. 4 062 76, 2 78)
- . Undervoltage release (1 module, Cat. No. 4 062 80, 82)
- . Stand-alone release for N/C push-button (1.5 module, Cat. No. 4 062 87)

Motor driven control modules:

- . Motor-driven control module (1 module, Cat. No. 4 062 91)
- . Motor-driven control module with integrated automatic reset (2 modules, Cat. Nos. 4 062 93, 95)

Possible combinations of auxiliaries and RCBOs:

- . The auxiliaries are installed to the left of the RCBOs
- . Maximum number of auxiliaries = 3
- . Maximum number of 1 module signalling auxiliaries = 2
- . Maximum number of control auxiliaries (Cat. Nos. 4 062 76 to 4 062 87) = 1
- . The control auxiliary trip (Cat. Nos. 4 062 76 to 4 062 87) must mandatorily be placed to the left of the signalling auxiliaries (Cat. Nos. 4 062 58 to 4 062 66) where the auxiliaries from these 2 families are connected to the same RCBO

Sealing:

- . Possible in the open or closed positions

Locking options:

- . Via padlock 5 mm in diameter (Cat. No. 4 063 13) or padlock 6 mm in diameter (Cat. No. 227 97) and padlock support (Cat. No. 4 063 03)

Installation software:

- . XL PRO³

9. SAFETY

. For your safety your electrical installation is equipped with residual current protection and this must be tested periodically. In the absence of any national regulations on the time period required for this, Legrand recommends that this test be carried out every month: press the "T" test button, the device should trip. Please call an electrician immediately if this does not happen as the safety level of your installation has been reduced

. The presence of residual current protection does not remove the need to observe all the precautions associated with using electrical energy.