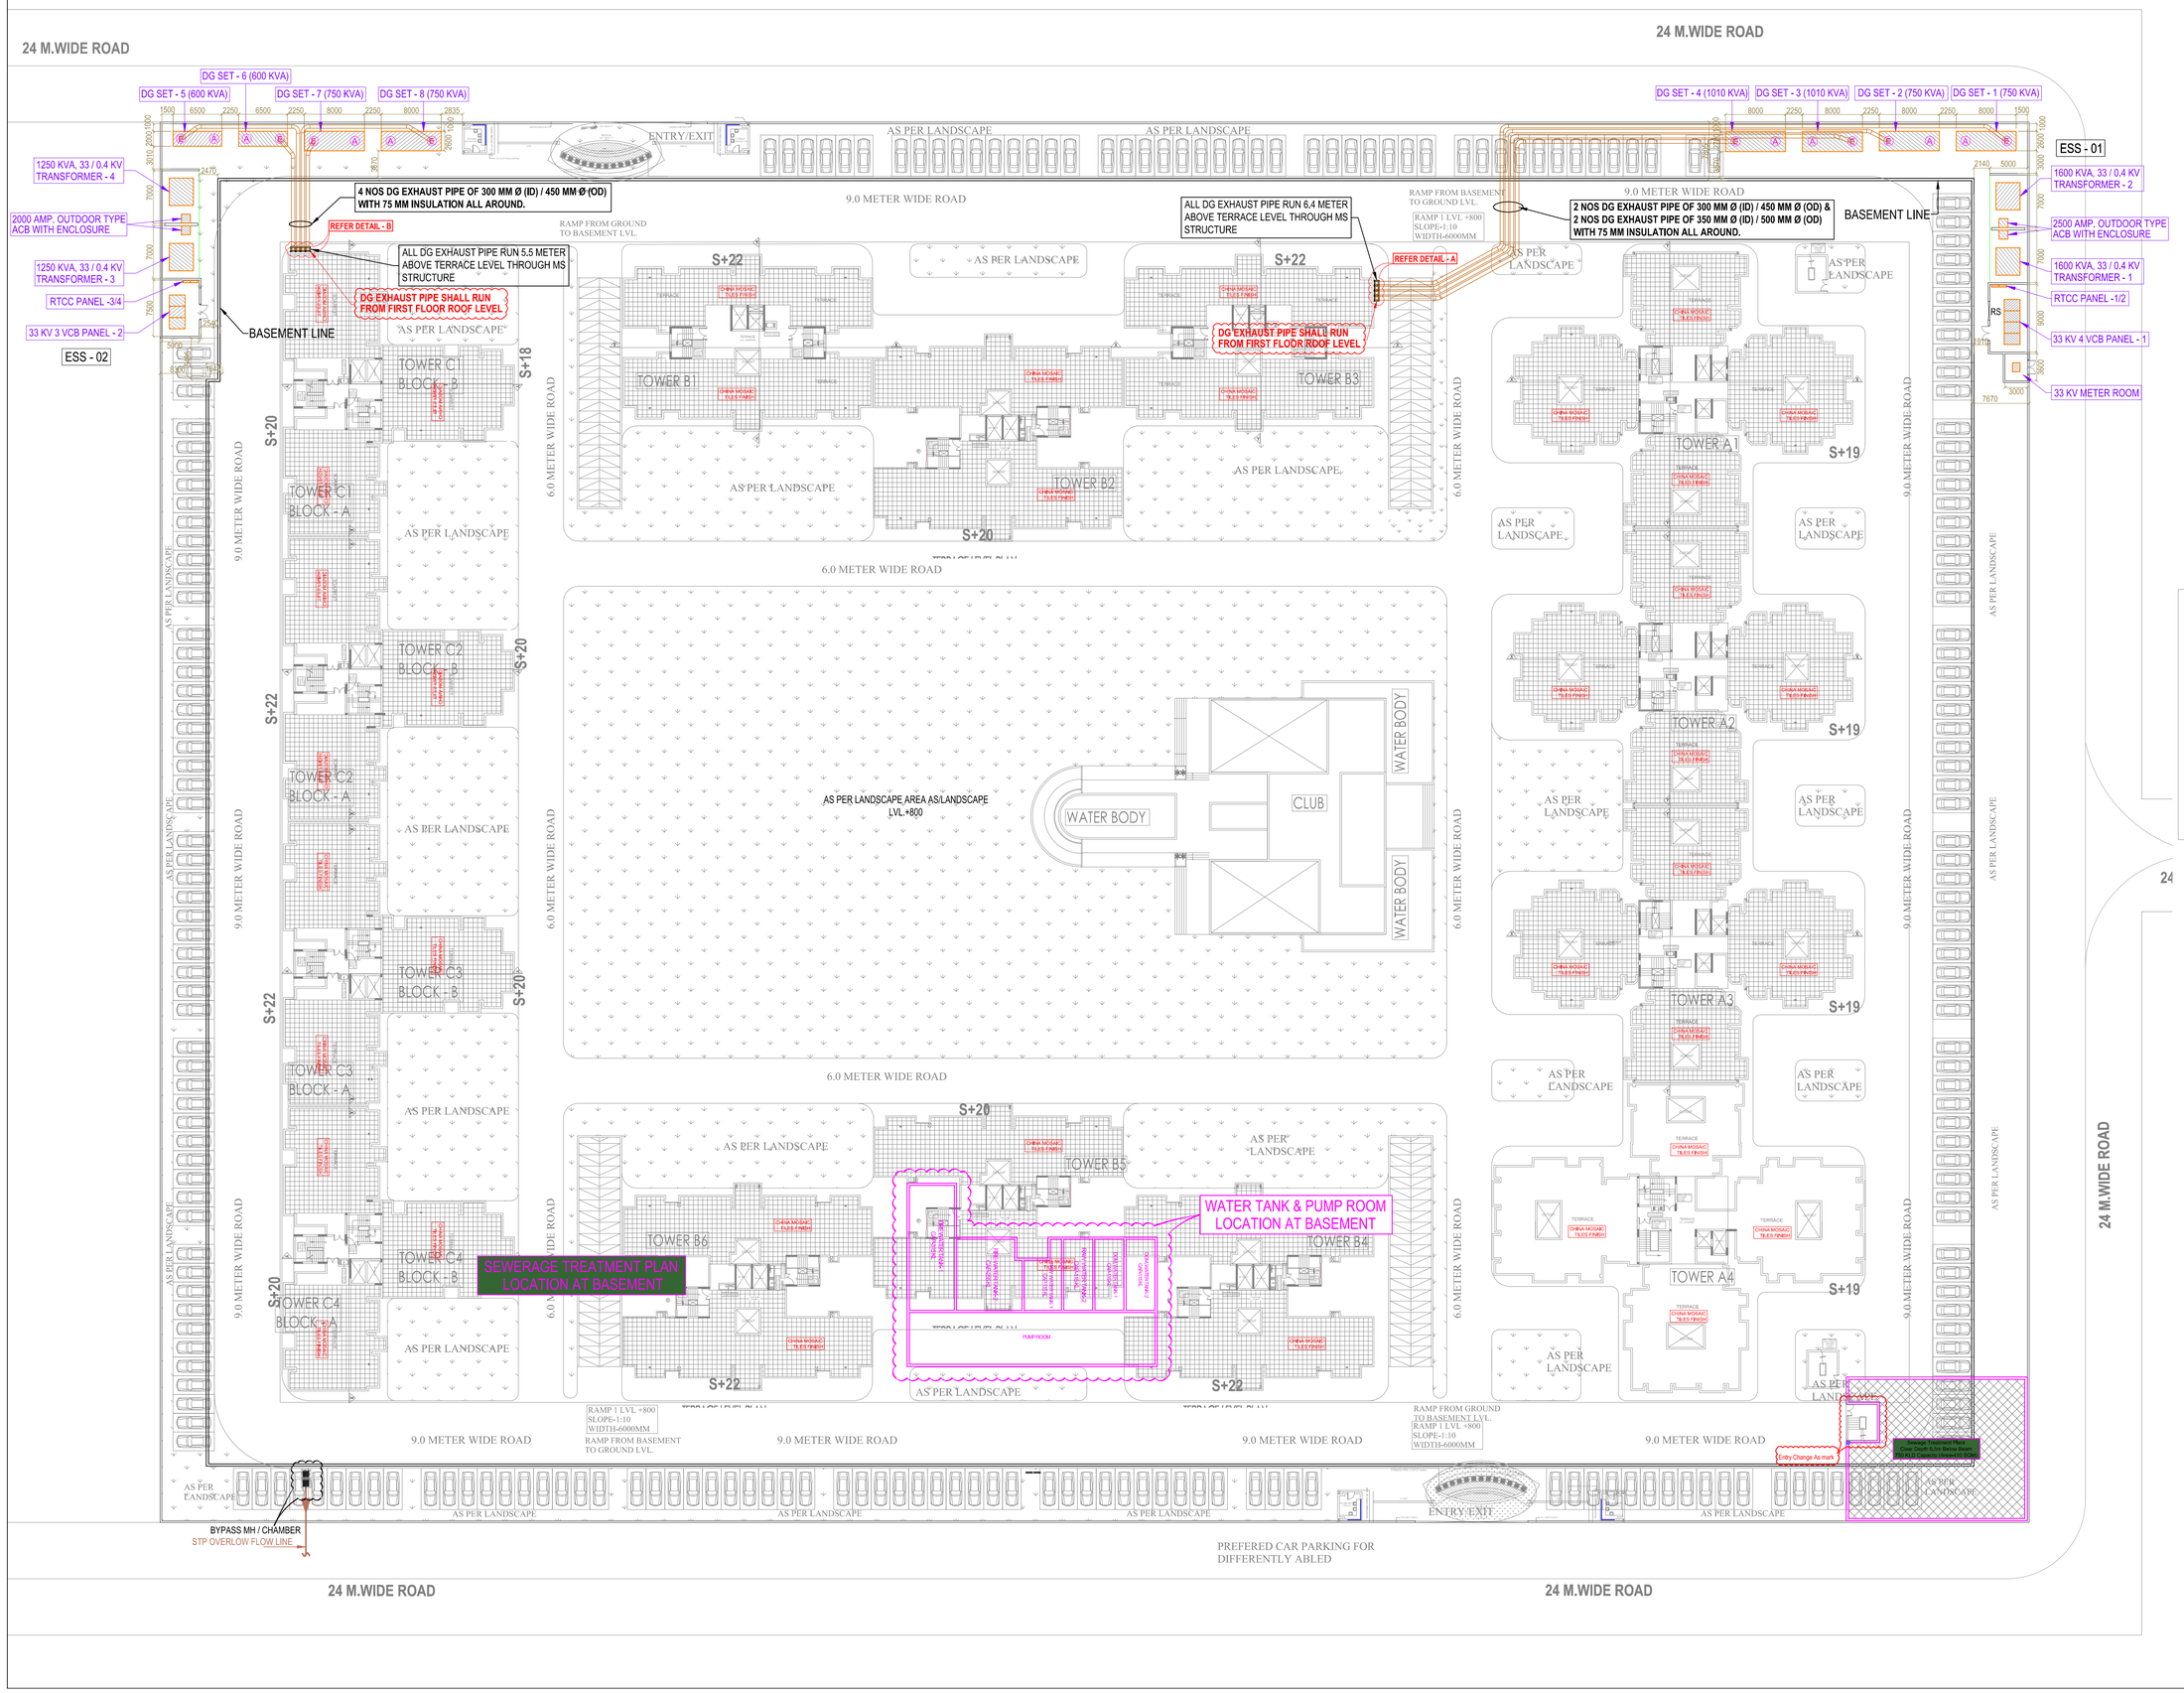

NOTES :

1) Clear height of 33 KV VCB room shall be minimum 3.6 mtr.
2) Plinth Level of VCB room shall be 450 mm above final finished ground level.

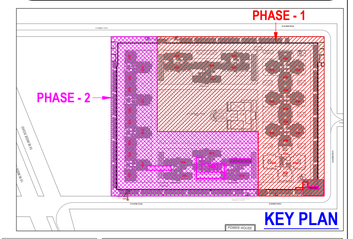

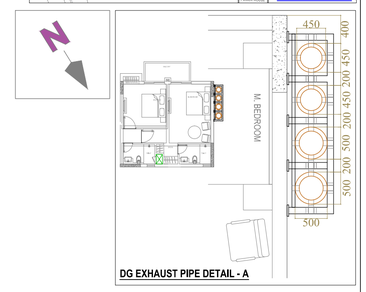

DG EXHAUST PIPE DETAIL - A

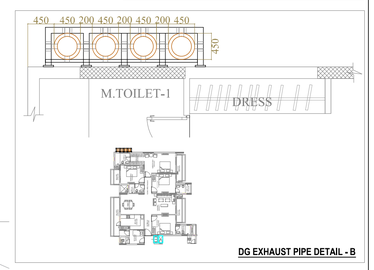

DG EXHAUST PIPE DETAIL - B

rev. no.	date	revision
R3	22.10.2016	Arch. Plan Revised
R2	31.07.2015	Revised as per requirement
R1	22.07.2015	Revised as per requirement

project
MANHATTAN GROUP HOUSING
AT LUCKNOW

title
SITE PLAN

subtitle
ELECTRICAL LAYOUT

drawing released for
- [x] APPROVAL
- [ ] SUBMISSION
- [ ] ADVANCE COPY
- [ ] CONSTRUCTION

drg. no. RM / EE - 02	drawn by Mandeep
scale 1 : 450	designed by M. Sadiq
date July 2015	checked by Anand Havelia

architects
DESIGN FORUM INTERNATIONAL
K-47 , KAILASH COLONY NEW DELHI-48
PHONE: 011 - 46556600 FAX : 46556601

services consultant
Consummate Engineering Services (P) Ltd.
Noida Office : B - 67, Sector - 67, Noida - 201 301
Tel : (0120) 2593500 (30 Lines)
Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow
Tel : (0522) 6515455
e mail : mail@cespl.in, website : www.cespl.in