



Wellfit



EN 60903:2003
IEC 60903:2014



(*) Add the size:
6 to 12 according to class

FIELD OF USE

- Personal protection against electrical shocks for live working from 500 V AC to 36 000 V AC depending on the selected class (00 to 4)
- These gloves must be used with leather over gloves, to ensure a mechanical protection.
- The use of thin cotton under gloves is recommended for a better comfort and a good hygiene.

CHARACTERISTICS


- **Wellfit**: improved comfort of use thanks to a softer and suppler finish enhancing the dexterity.
- **Cut edges**
- **Marking**: Inkjet
- **Insulating gloves**: class 00 to 4
- **Material**: natural latex
- **Color**: beige
- This shape will ensure good ergonomics and a good sensitivity.
- **AZC Category**: resistant to acid, ozone and very low temperature
- Supplied in an individual anti UV bag including an Instruction for use.
(Gloves class and size are identified with a sticker on the back)



RANGE

| Reference | Class | AC voltage | DC voltage | Category | Length (mm) | Size |
|-----------|-------|------------|------------|----------|-------------|---------|
| GP-00-xx | 00 | 500 | 750 | AZC | 360 | 6 to 12 |
| GP-0-xx | 0 | 1 000 | 1 500 | RC | 360 | 6 to 12 |
| GP-1-xx | 1 | 7 500 | 11 250 | RC | 360 | 7 to 12 |
| GP-2-xx | 2 | 17 000 | 25 500 | RC | 360 | 7 to 12 |
| GP-3-xx | 3 | 26 500 | 39 750 | RC | 360 | 8 to 12 |
| GP-4-xx | 4 | 36 000 | 54 000 | RC | 410 | 8 to 12 |

MARKING

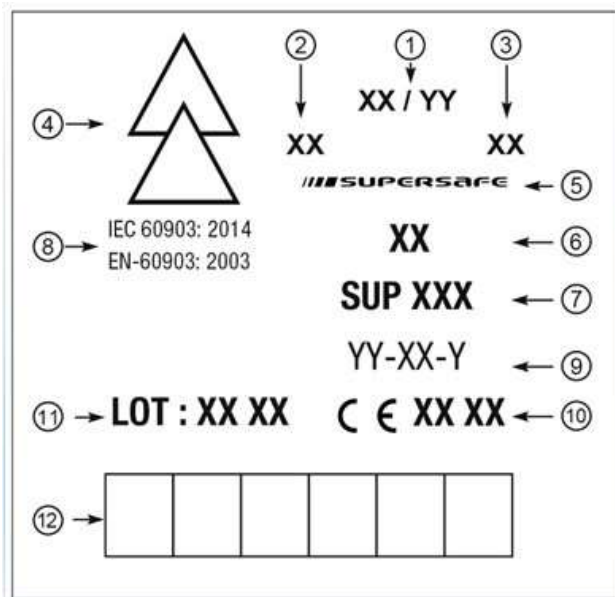

- 1.- CLASS/CATEGORY
- 2.- MONTH OF MANUFACTURE
- 3.- YEAR OF MANUFACTURE
- 4.- DOUBLE TRIANGLE FOR LIVE WORKING
- 5.- BRAND
- 6.- SIZE
- 7.- CE REFERENCE
- 8.- STANDARDS
- 9.- PRODUCT REFERENCE
- 10.- CE MARK
- 11.- TRACEABILITY
- 12.- AREA TO MARK THE DATE OF THE 1ST USE OR RETEST

DIMMENSIONS

| Reference | Thickness max (mm) according to IEC 60903:2014* |
|-----------|-------------------------------------------------|
| GP-00 | 0,5 |
| GP-0 | 1,0 |
| GP-1 | 1,5 |
| GP-2 | 2,3 |
| GP-3 | 2,9 |
| GP-4 | 3,6 |

*Thickness is aligned with IEC 60903:2014. Gloves category A, H, Z and R may require an additional thickness which must not exceed 0,6 mm

RECOMMANDATIONS (annex E IEC 60903)

- **Examination before use:** Each time before use, both gloves of a pair should be visually inspected and subjected to a manually applied air test, where practicable. If either glove is thought to be unsafe, the pair should not be used and should be returned for testing.
- **Storage:** Gloves should be stored in their container or package. Care should be taken to ensure that gloves are not compressed, folded or stored in proximity to steam pipes, radiators or other sources of artificial heat or exposed to direct sunlight, artificial light or other source of ozone. It is desirable that the ambient temperature be between 10°C and 21°C.
- **Periodic inspection:** no gloves, not even those held in storage, should be used unless they have been tested within a maximum period of six months. The tests consist of air inflation to check for air leaks, a visual inspection while pressurized, and then a routine dielectric test, in accordance with IEC 60903.
- The test of the 1st use, and the controls dates, must be marked on the gloves.

ACCESSORIES

- **CG-981: Leather Overgloves for class 00 & 0**
- **CG-991: Overgloves for class 1 to 4**
- **CG-37: Fire-resistant gloves**
- **CG-117: Pneumatic gloves tester**
- **CG-36-1: Carrying bag for class 00 to 1**
- **CG-36-2: Carrying bag for class 2 to 4**
- **CG-35-2: Plastic box**



Leather
Overgloves
CG-981



Leather
Overgloves
CG-991



Fire-resistant gloves
CG-80H/F



Gloves tester
CG-117



Carrying bag
CG-36/1, CG36/2



Plastic box
CG-35/2