



Datasheet

Stock No. 102-6136

Phase Failure, Phase Sequence, Under Voltage plus Time Delay




ENGLISH



- ***NEW*** 17.5mm DIN rail housing
- Microprocessor based
- True R.M.S. monitoring
- Monitors own supply and detects an Under voltage condition on one or more phases
- Measures phase to phase voltages
- Detects incorrect phase sequence and phase loss
- Adjustment for Under voltage trip level
- Adjustment for Time delay (from an Under voltage condition)
- 1 x SPDT relay output 8A
- Green LED indication for supply status
- Red LED indication for relay status

FUNCTION DIAGRAM

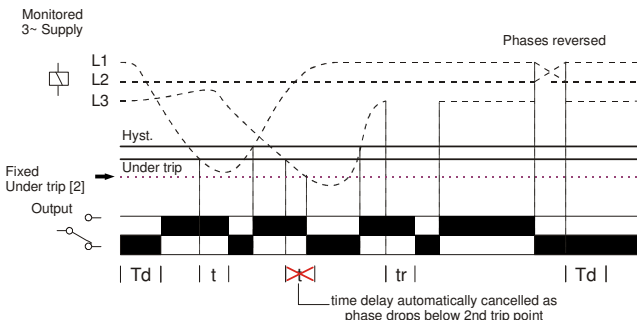

INSTALLATION AND SETTING



Installation work must be carried out by qualified personnel.

- BEFORE INSTALLATION, ISOLATE THE SUPPLY.
- Connect the unit as required. The Connection Diagram below shows a typical installation, whereby the supply to a load is being monitored by the Phase monitoring relay. If a fault should occur (i.e. fuse blowing), the relay will de-energise and assuming control of the external Contactor, de-energise the Contactor as well.

Applying power.

- Set the "<U (volts)" ④ and "Delay (t)" ③ adjustment to minimum.
- Apply power and the green "Power supply" ① and red "Relay" ② LED's will illuminate, relay energise and contacts 15 and 18 will close. Refer to the troubleshooting table if the unit fails to operate correctly.

Setting the unit (with power applied).


- Accurate setting can be achieved by adjusting the trip level "<U (volts)" until the unit trips (relay de-energises) then by decreasing the trip level "<U (volts)" until the relay re-energises. Close setting the trip level ensures the unit will detect a phase loss even with a large percentage of re-generative voltage.
- In order to set the unit as previously described but without causing disruption to the equipment being controlled/monitored, set the "Delay (t)" to maximum. It will now be possible to establish the trip point when the red "Relay" LED starts to flash. Decrease the trip level setting to stop the LED flashing. (Note: If the time delay is allowed to expire, the output relay will de-energise)
- If large supply variations are anticipated, the trip level should be set further from the nominal voltage.
- Set the "Delay (t)" as required. (Note that the delay is only effective should the supply drop below the set trip level. However, if during an under voltage condition the supply drops below the 2nd under voltage trip level, any set time delay is automatically cancelled and the relay de-energises). Note: If the supply voltage increases above the maximum "<U" trip setting by approx. 10% or more, the relay will de-energise immediately.

Troubleshooting.

The table below shows the status of the unit during a fault condition.

Supply fault	Green LED	Red LED	Relay
Phase missing	On	Off	De-energised
Phases reversed (no delay)	Flashing	Off	De-energised
Under Voltage condition (during timing)	On	Flashing	Energised for set delay (t)
Under Voltage condition (after timing)	On	Off	De-energised
Phase below 70% of Un (fixed under trip level [2])	On	Off	De-energised


CONNECTION DIAGRAM

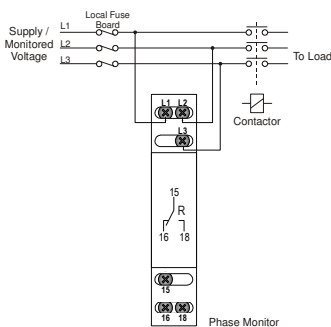


SETTING DETAILS

1. Power supply status (Green) LED
2. Relay output / Timing status (Red) LED
3. "Delay" adjustment
4. "<U (volts)" Under voltage trip level adjustment

^Example on the right shows the 280 – 520V version.

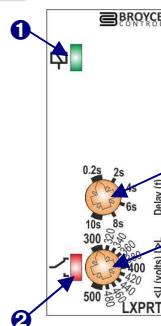

DIMENSIONS

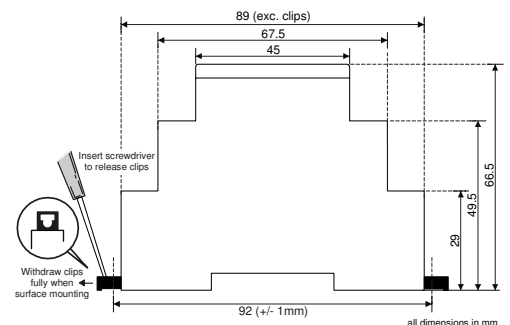

TECHNICAL SPECIFICATION

Supply/monitoring voltage	
U (L1, L2, L3):	280 – 520V AC
Frequency range:	48 – 63Hz
Supply variation:	± 30%
Overvoltage category:	III (IEC 60664)
Rated impulse withstand voltage:	4kV (1.2/50µs) IEC 60664
Power consumption (max.):	8VA
Monitoring mode: Under voltage	
Trip levels:	Under [2] Under
Supply voltage 280 – 520V:	280V 300 – 500V
Hysteresis:	≈ 2% of trip level (factory set)
Setting accuracy:	± 3%
Repeat accuracy:	± 0.5% at constant conditions
Immunity from micro power cuts:	<50mS
Response time:	≈ 50mS
Time delay (t):	0.2 – 10 sec. (± 5%)
Note: actual delay (t) = adjustable delay + response time	
Delay from Phase loss (tr):	≈ 150mS (worst case = tr x 2)
Power on delay (Td):	≈ 1 sec. (worst case = Td x 2)
Power on indication:	Green LED
Relay status indication:	Red LED
Ambient temp:	-20 to +60°C
Relative humidity:	+95% max.
Output (15, 16, 18):	SPDT relay
Output rating:	AC1 250V 8A (2000VA)
	AC15 250V 5A (no), 3A (nc)
	DC1 25V 8A (200W)
Electrical life:	≥ 150,000 ops at rated load
Dielectric voltage:	2kV AC (rms) IEC 60947-1
Rated impulse withstand voltage:	4kV (1.2/50µs) IEC 60664
Housing:	Orange flame retardant UL94
Weight:	75g
Mounting option:	On to 35mm symmetric DIN rail to BS EN 60715 or direct surface mounting via 2 x M3.5 or 4BA screws using the black clips provided on the rear of the unit.
Terminal conductor size	≤ 2 x 2.5mm ² solid or stranded

Approvals:



IND. CONT. EQ.
E111187

CE, and RoHS Compliant.

EMC: Immunity: EN 61000-6-2 [EN 61000-4-3 15V/m 80MHz - 2.7GHz]

Emissions: EN 61000-6-4