



# Datasheet Sealed Lead-Acid Battery General Purpose Specification


#### 174-8856(6V12Ah)

Cells Per Unit	3
Voltage Per Unit	6
Capacity	12.0Ah@20hr-rate to 1.80V per cell @25°C
Weight	Approx 1.8 kg
Max. Discharge Current	180 A (5 sec)
Internal Resistance	Approx 15 m $\Omega$
Operating Temp.Range	Discharge : -15 $\sim$ 50 $^{\circ}$ C (5 $\sim$ 122 $^{\circ}$ F) Charge : 0 $\sim$ 40 $^{\circ}$ C (32 $\sim$ 104 $^{\circ}$ F) Storage : -15 $\sim$ 40 $^{\circ}$ C (5 $\sim$ 104 $^{\circ}$ F)
Nominal Operating Temp. Range	25±3°C (77±5°F )
Float charging Voltage	6.75to 6.9 VDC/unit Average at 25°C
Recommended Maximum Charging Current Limit	3.6 A
Equalization and Cycle Service	7.2 to 7.5 VDC/unit Average at 25°C
Self Discharge	The batteries can be stored for more than 6 months at 25°C. Self-discharge ratio less than 3% per month at 25°C. Please charge batteries before using.
Terminal	T1
Container Material	A.B.S. (UL94-HB)

#### **Applications**

- ♦ All purpose
- ♦ Uninterruptable Power Supply (UPS)
- ♦ Electric Power System (EPS)
- ♦ Emergency backup power supply
- ♦ Emergency light
- ♦ Railway signal
- ♦ Aircraft signal
- ♦ Alarm and security system
- ♦ Electronic apparatus and equipment
- ♦ Communication power supply
- ♦ DC power supply
- ♦ Auto control system

#### Dimensions

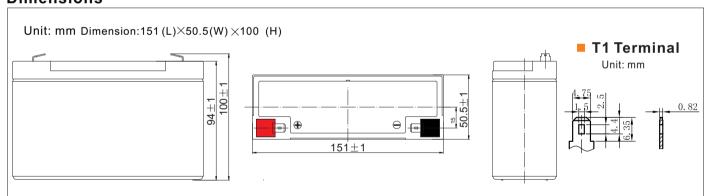



#### Constant Current Discharge Characteristics: A (25 °C) F.V/Time 10min 5h 6h 5min 15min 20min 30min 45min 1h 2h 3h 4h 8h 10h 20h 1.85V/cell 22.9 17.5 14.5 12.6 9.72 7.16 6.03 3.57 2.79 2.27 1.85 1.61 1.30 1.08 0.594 6.76 1.37 1.80V/cell 30.7 22.4 17.6 14.9 11.5 8.33 3.90 3.00 2.42 1.99 1.72 1.12 0.600 1.75V/cell 34.6 24.6 19.2 16.0 11.9 8.64 7.07 4.04 3.06 2.48 2.04 1.77 1.40 1.15 0.606 1.70V/cell 26.9 20.5 16.8 12.4 8.99 7.29 4.14 3.15 2.09 1.81 1.42 1.17 0.617 1.65V/cell 21.8 7.46 1.85 1.44 0.625 1.60V/cell

Constant Power Discharge Characteristics : W (25 °C)															
F.V/Time	5min	10min	15min	20min	30min	45min	1h	2h	3h	4h	5h	6h	8h	10h	20h
1.85V/cell	41.8	32.4	27.1	23.7	18.5	13.8	11.6	6.93	5.44	4.44	3.63	3.16	2.56	2.14	1.18
1.80V/cell	55.5	40.9	32.3	27.6	21.5	15.9	13.0	7.51	5.82	4.71	3.88	3.37	2.71	2.21	1.19
1.75V/cell	61.2	44.3	34.9	29.4	22.2	16.3	13.5	7.76	5.91	4.80	3.97	3.46	2.75	2.26	1.20
1.70V/cell	65.6	47.1	36.7	30.7	22.9	16.9	13.9	7.94	6.06	4.92	4.06	3.52	2.78	2.31	1.22
1.65V/cell	71.3	50.4	38.7	32.3	24.0	17.2	14.1	8.01	6.29	5.07	4.16	3.59	2.82	2.35	1.23
1.60V/cell	76.8	53.5	40.8	34.1	25.2	17.8	14.2	8.31	6.45	5.21	4.28	3.65	2.84	2.37	1.24







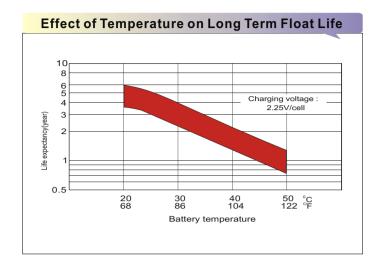

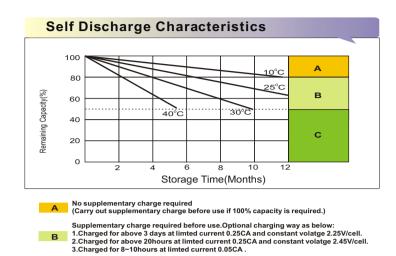

Avoid this storage period unless regular Top charge.
Supplementary charge may often fail to recover the full capacity

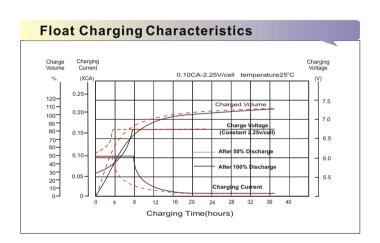

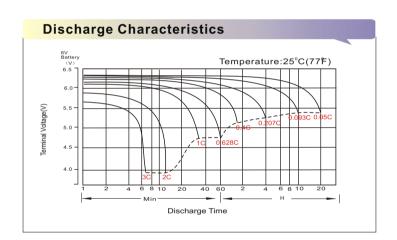

#### Available Capacity Subject to Temperature

Battery	Туре	-20℃	-10℃	0℃	5℃	10℃	20℃	25℃	30℃	40℃	<b>45</b> ℃
AGM Battery	6V&12V	46%	66%	86%	89%	93%	98%	100%	102%	103%	105%

#### Discharge Current VS. Discharge Voltage

Final Discharge Voltage V/cell	1.80V	1.75V	1.60V	
Discharge Current (A)	(A) ≤0.2C	0.2C< (A) <1.0C	(A) ≥1.0C	

### Charge the batteries at least once every six months, if they are stored at $25^{\circ}$ C.

#### **Charging Method:**

Constant Voltage	-0.2Cx2h+2.4~2.45V/Cellx24h,Max. Current 0.3CA
Constant Current	0.1C until the voltage reaching 7.2V, then 0.1Cx4h

#### Maintenance & Cautions

## Float Service: ◆It is recommended to check battery/Float voltage each month.

#### Equalisation charge:

- ◆Equalisation charging is recommended once every 3 to 6 months using.
- ◆Discharge 100% rated capacity.
- ♦ Charge 2.35v/cell constant voltage, maximum 0.3CA 24hrs.