



HDh. Nellaidhoo Health Centre Portico And Extension

Architectural Detailed Drawings


Kulhudhufushi Regional Hospital

Date: Thursday, August 24, 2023

Project Number: EP/PRJ/2023/22



NELLAIIDHOO EXISTING BUILDING

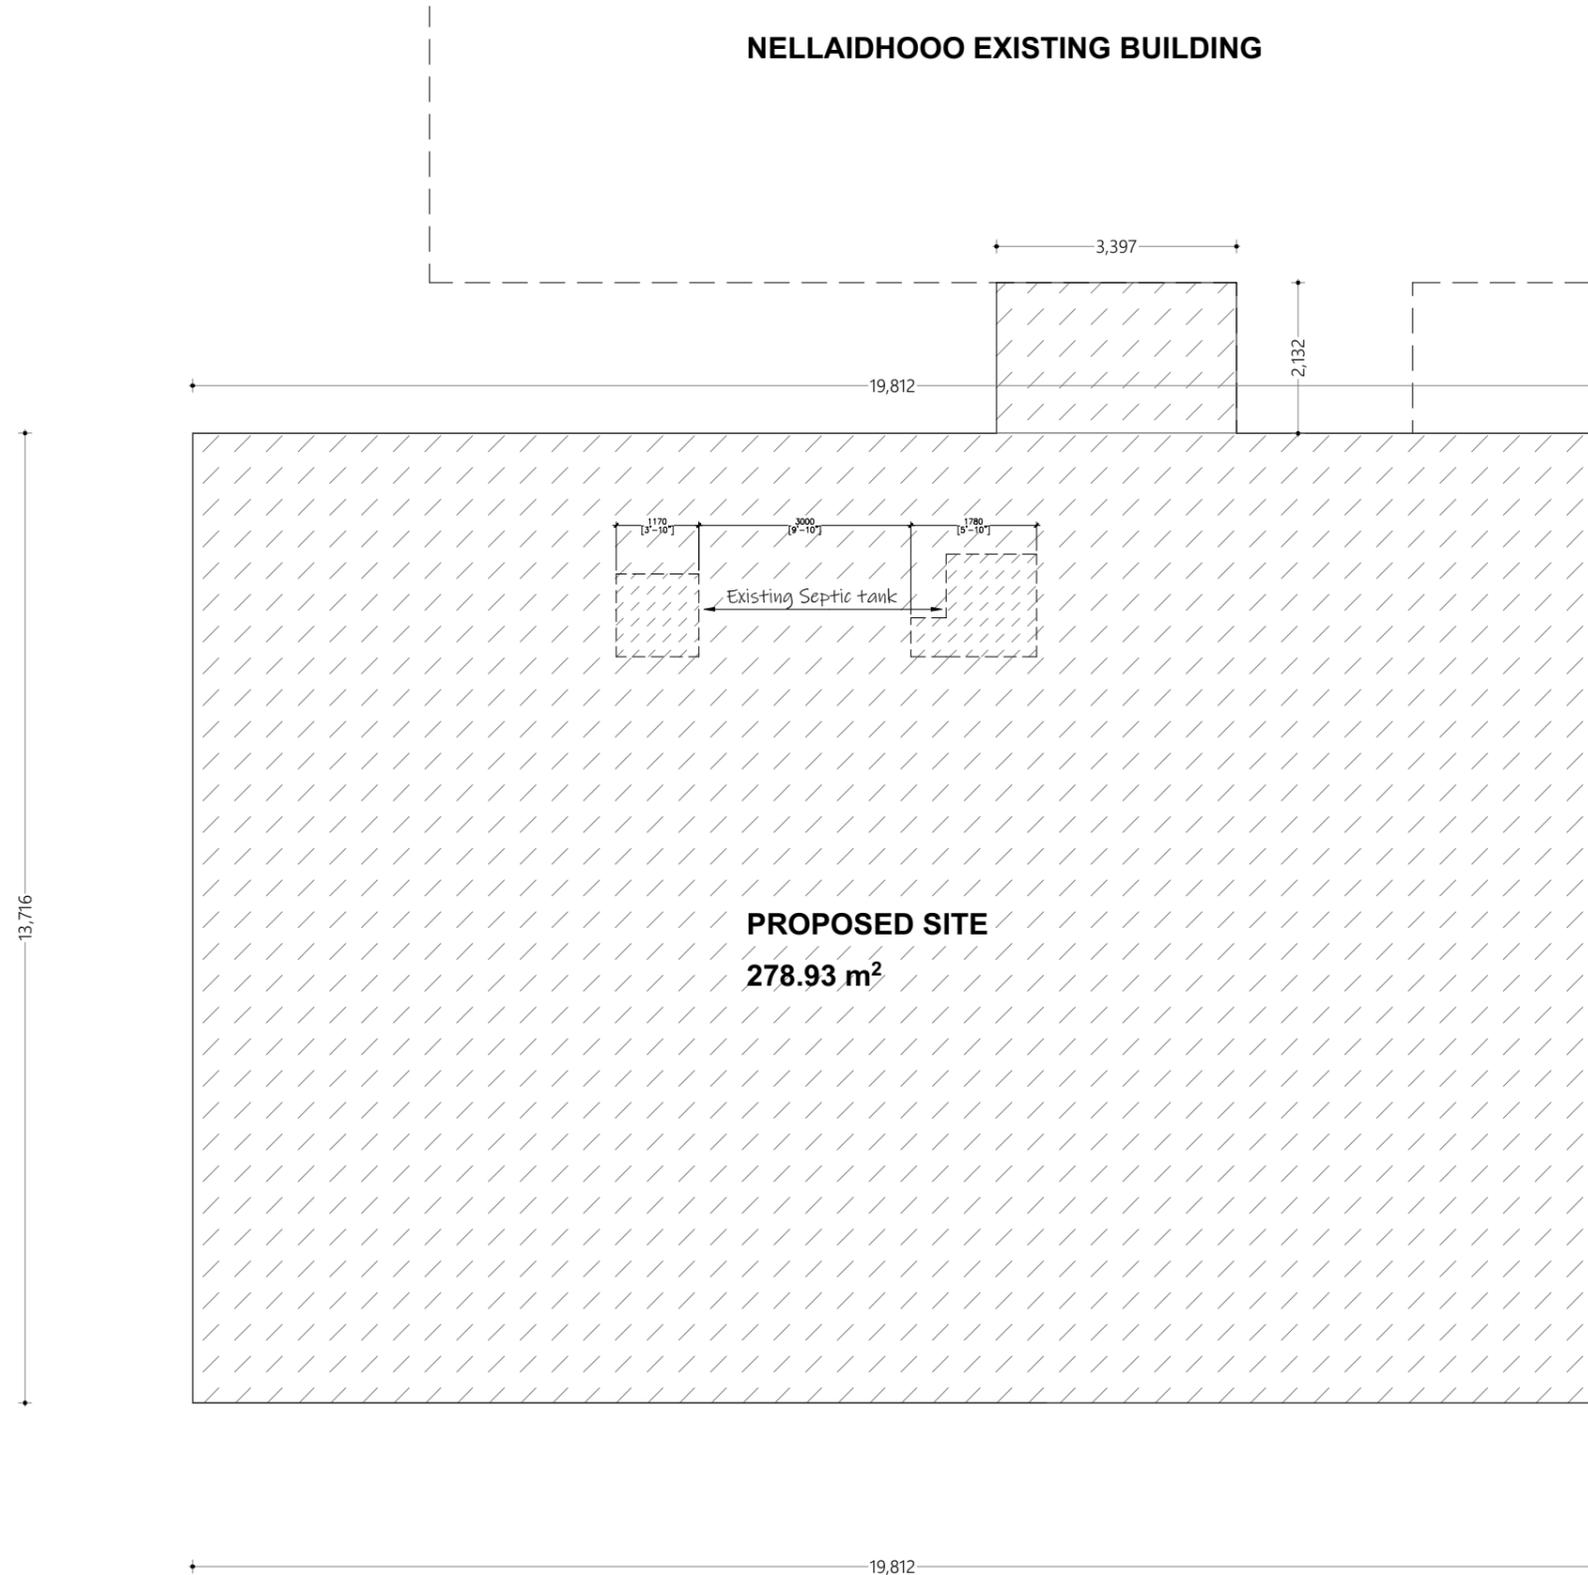

PROPOSED SITE
278.93 m²

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-060-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by

T: +960 333 3528, E: info@epochassociates.
 W: www.epochassociates, A.G.Rosary West, 3rd Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassaan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
 Site Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : A.1.01

Site Plan
 1:100

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22- 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001



Wall Legend	
2D Plan View	Description
	100mm thick interior duct wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick exterior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick interior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color

Wall Legend
1:1

Ground Floor Plan
1:100

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A:G.Rosany West, 3rd
 Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Ground Floor Plan

Scale : 1:100, 1:1

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : A.2.01



Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22- 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

Wall Legend	
2D Plan View	Description
	100mm thick interior duct wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick exterior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color
	150mm thick interior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color

Wall Legend
1:1

First Floor Plan
1:100

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A:G.Rosary West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
First Floor Plan

Scale : 1:100, 1:1


Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** A.2.02

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

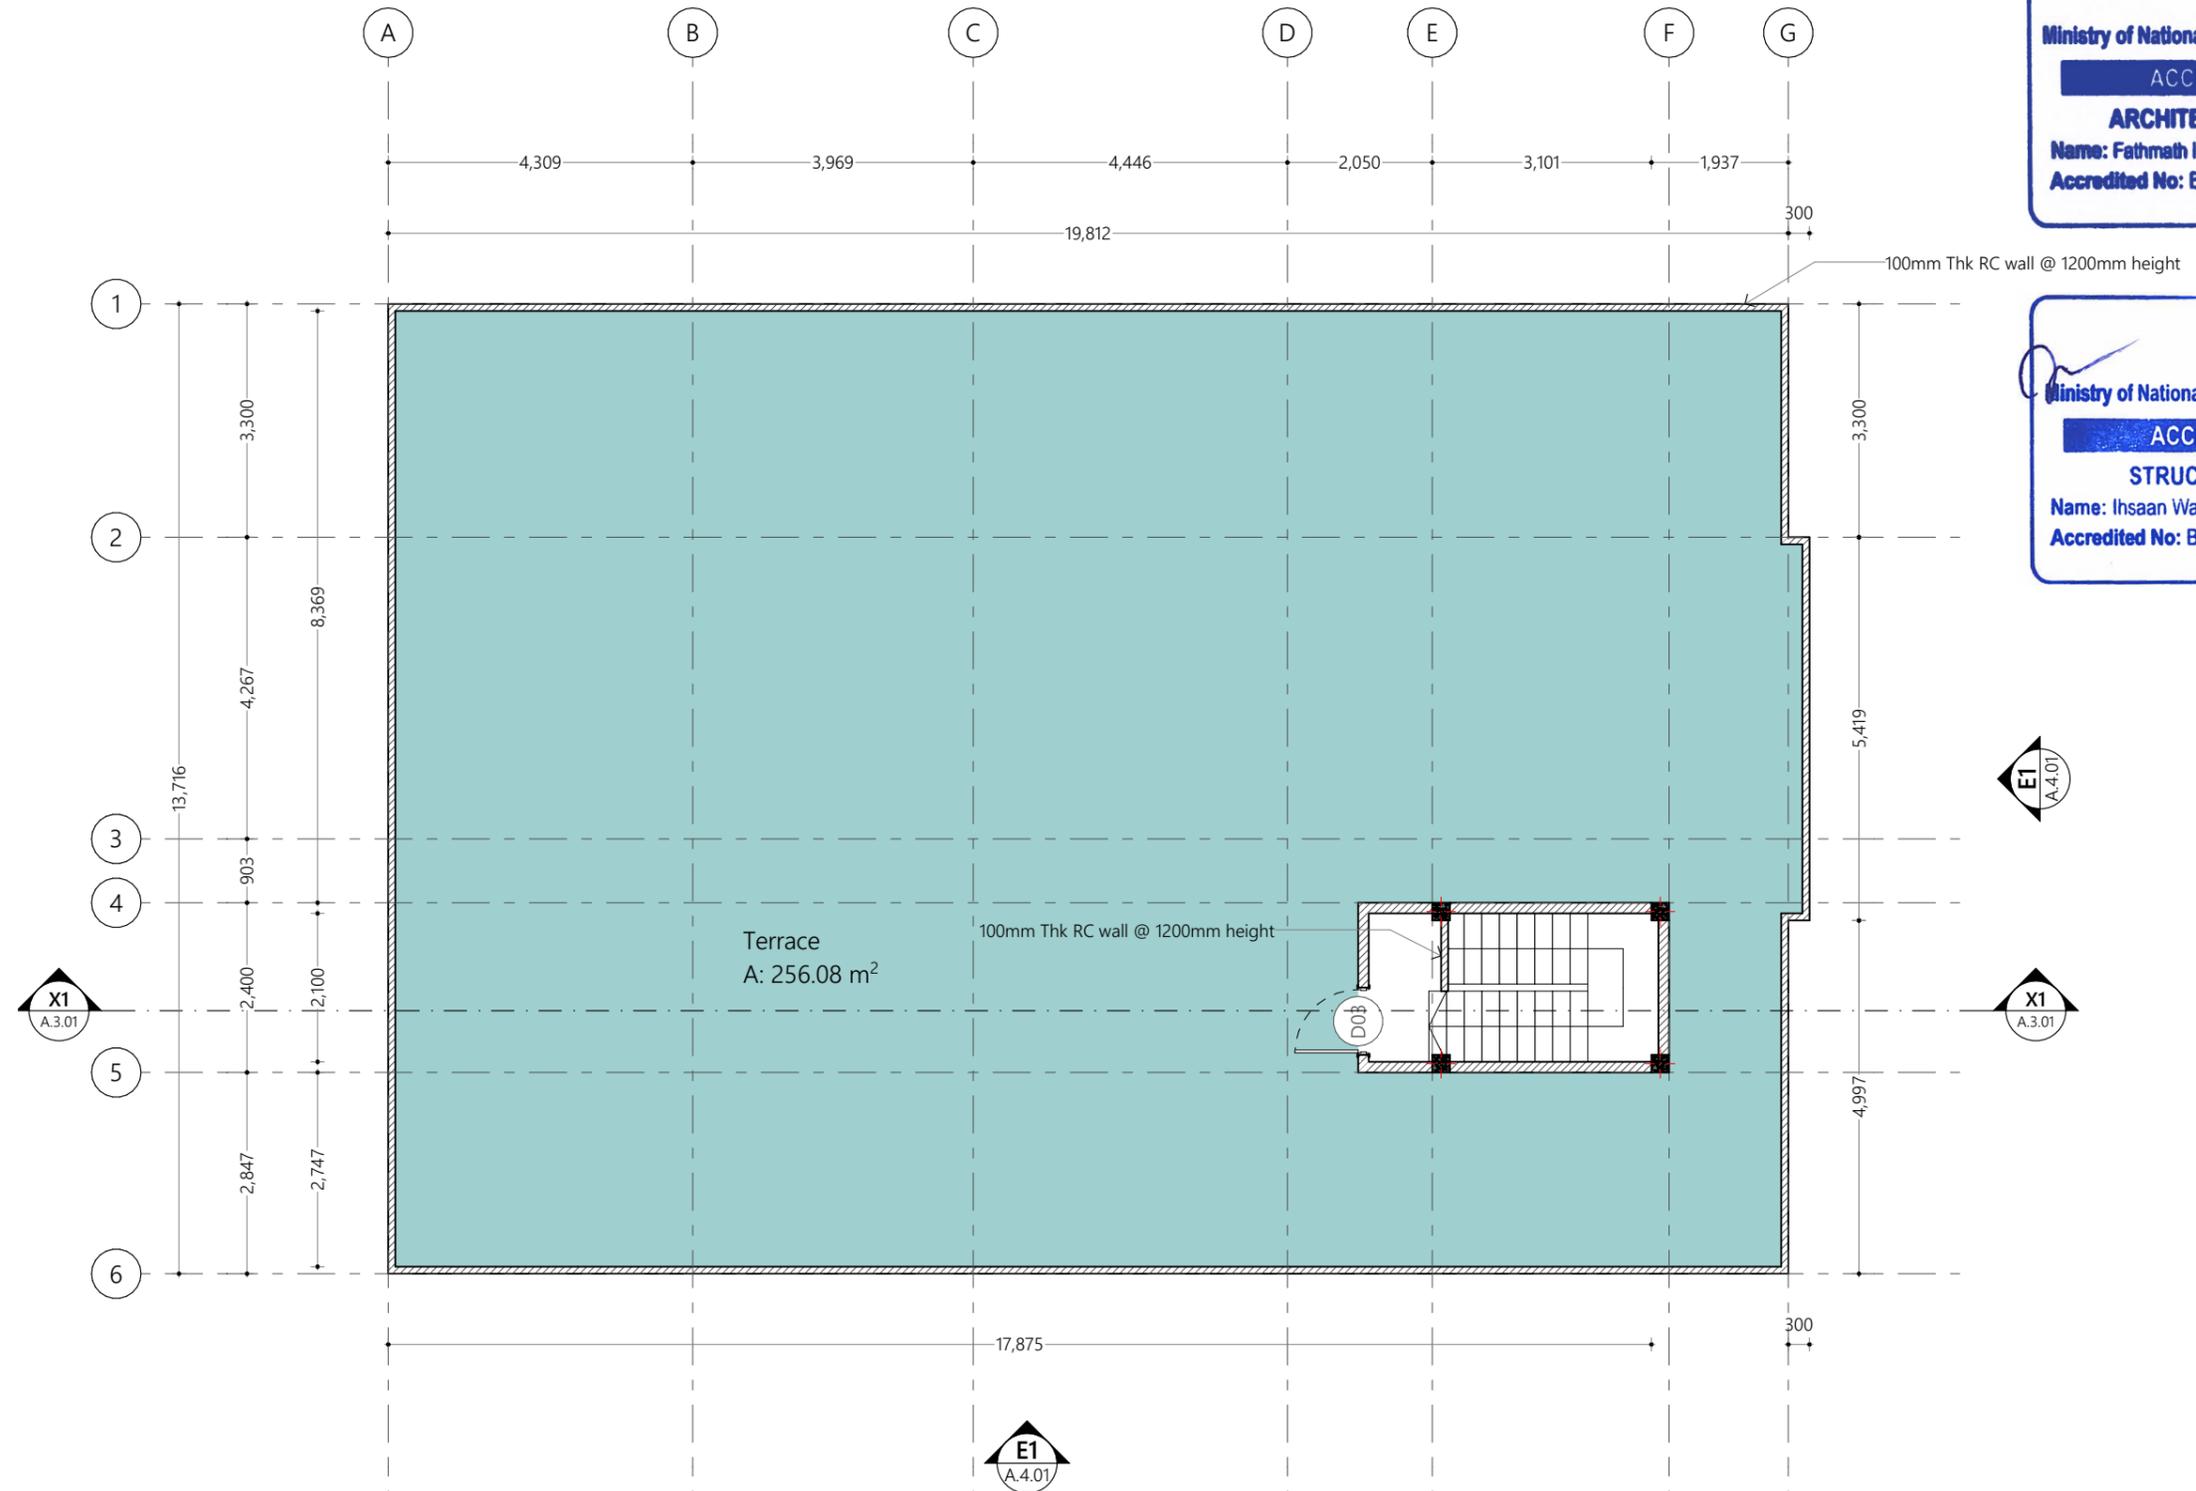

Terrace Plan
1:100

Wall Legend	
2D Plan View	Description
	150mm thick exterior masonry wall with 25mm plaster on exterior and 16mm plaster on interior finished with ground smooth and washable paint of selected color

Wall Legend
1:1

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A.G.Rosary West, 3rd
 Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
Terrace Floor Plan

Scale : 1:100, 1:1

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : A.2.03

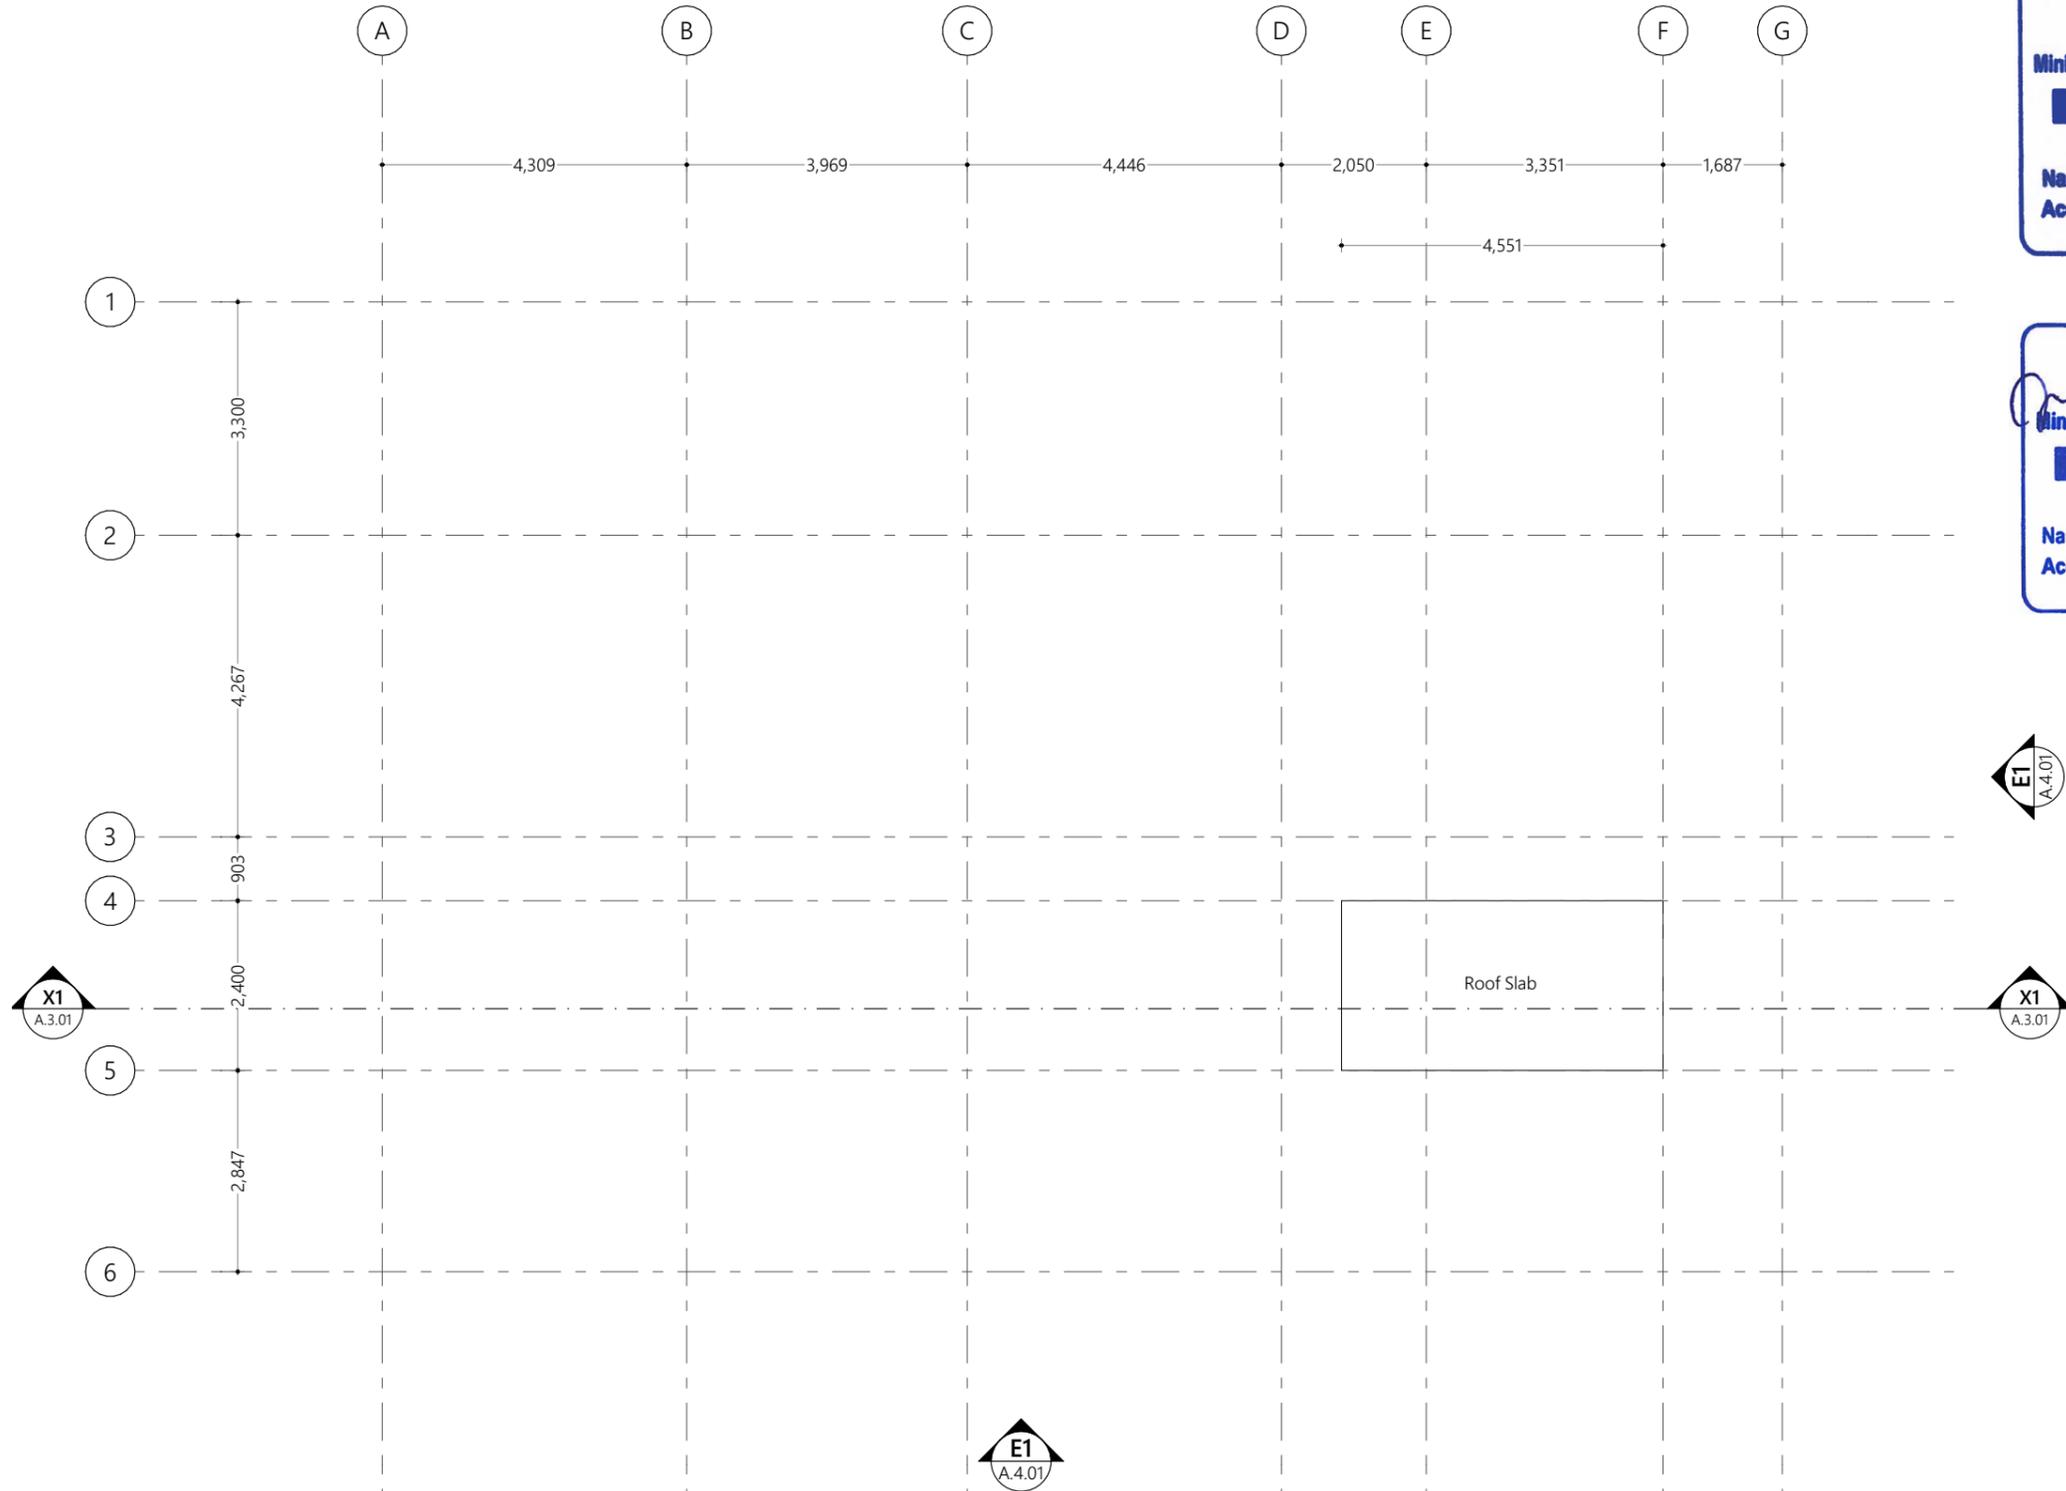

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22- 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by



Roof Plan
 1:100

T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A.G.Rosary West, 3rd
 Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
 Roof Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** A.2.04

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23

Accredited No: BPR2022050B1 B1-2022-060-001



Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23

Accredited No: BPR2022021A1 A1-2022-021-001

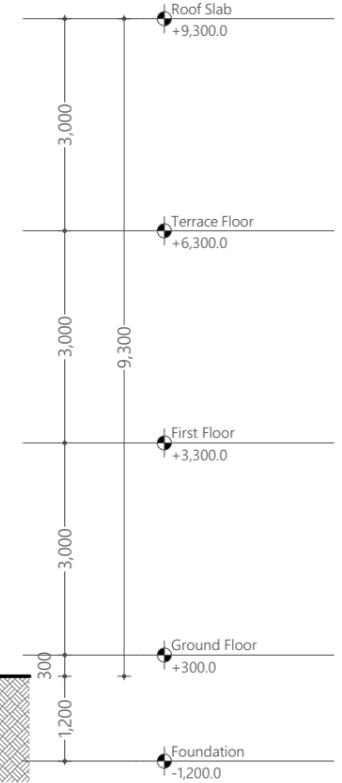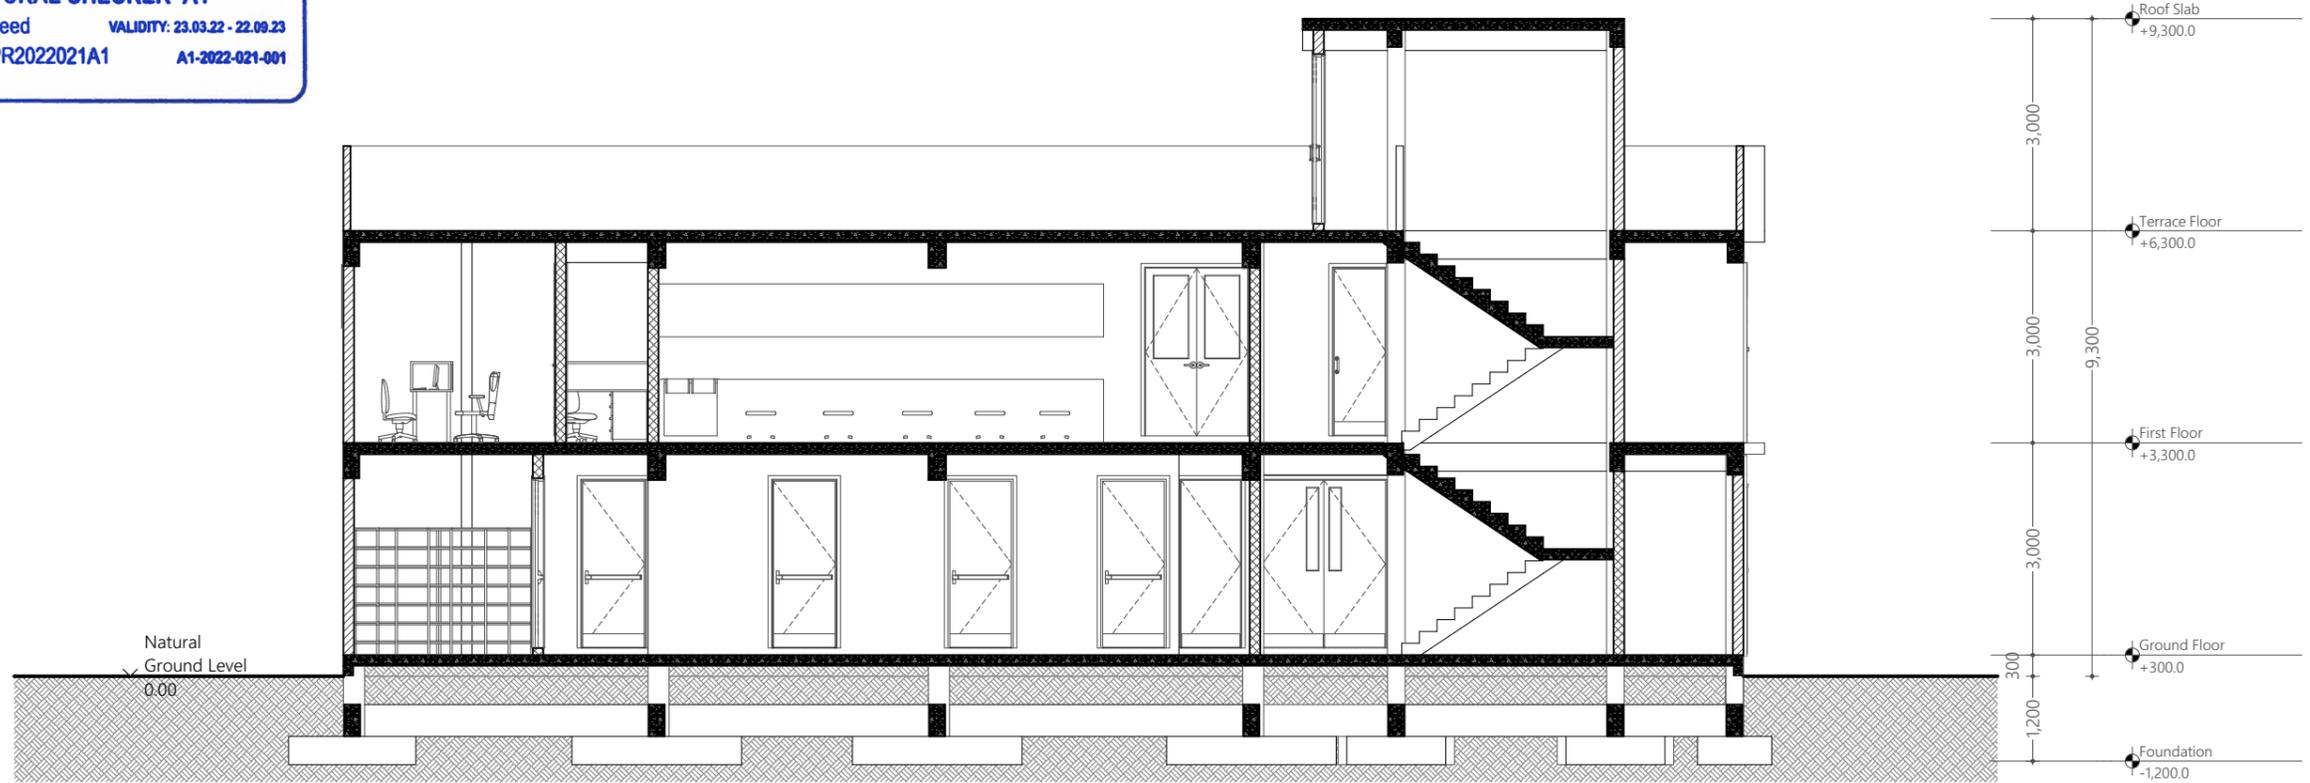

#	REVISION	BY	APP	DATE

X1 Building Section
1:100

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Section 1

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** A.3.01

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23

Accredited No: BPR2022050B1 B1-2022-060-001


Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER


STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23

Accredited No: BPR2022021A1 A1-2022-021-001

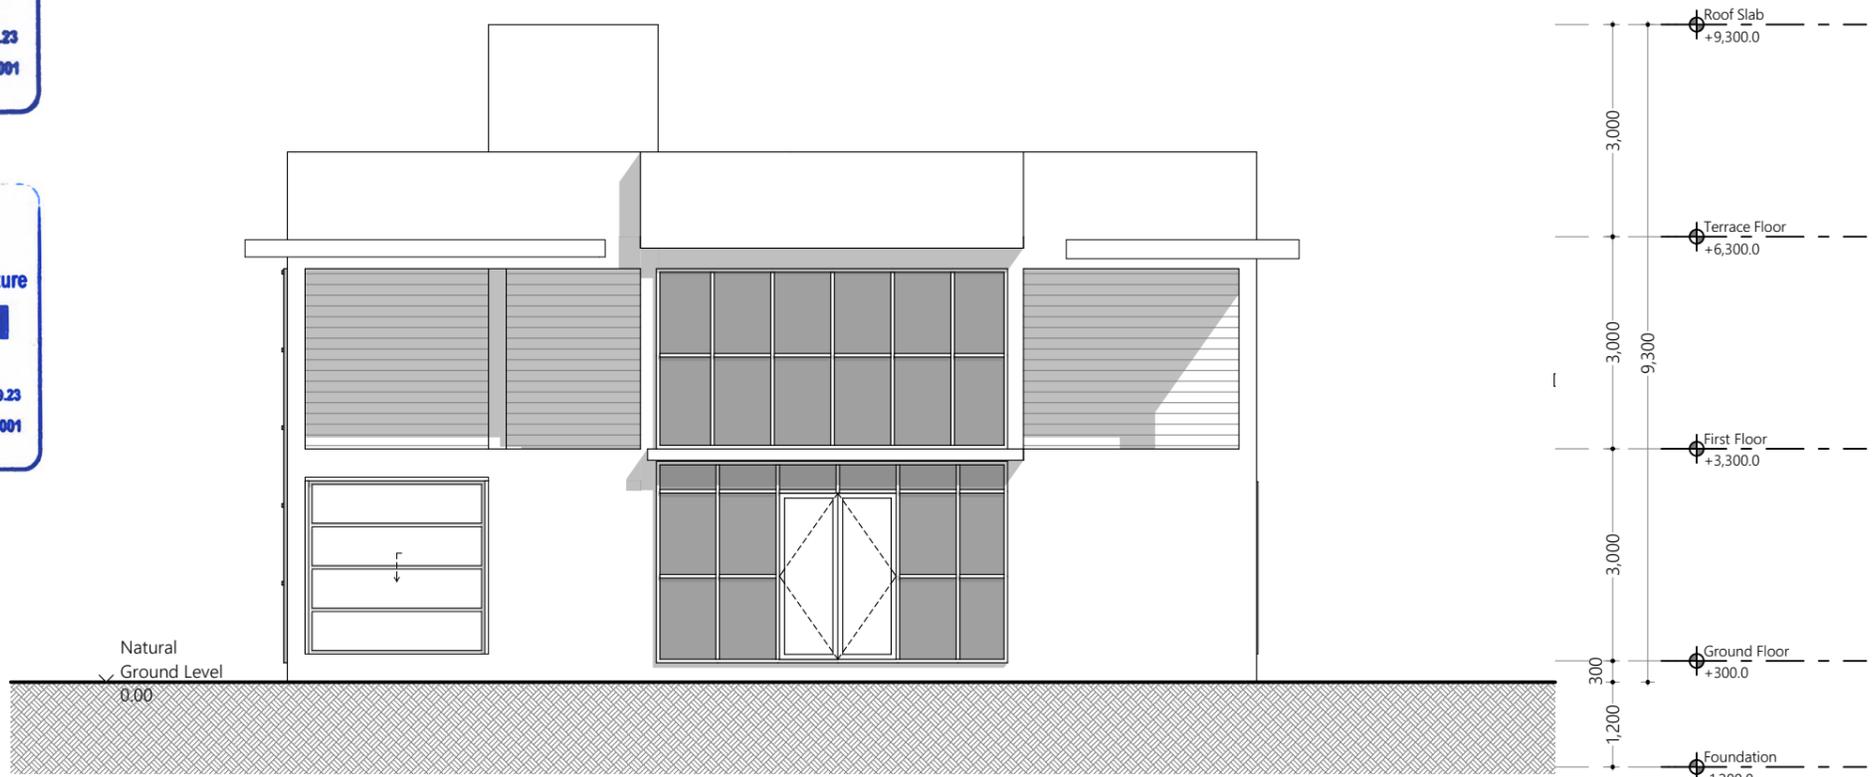

Elevation E1
1:100

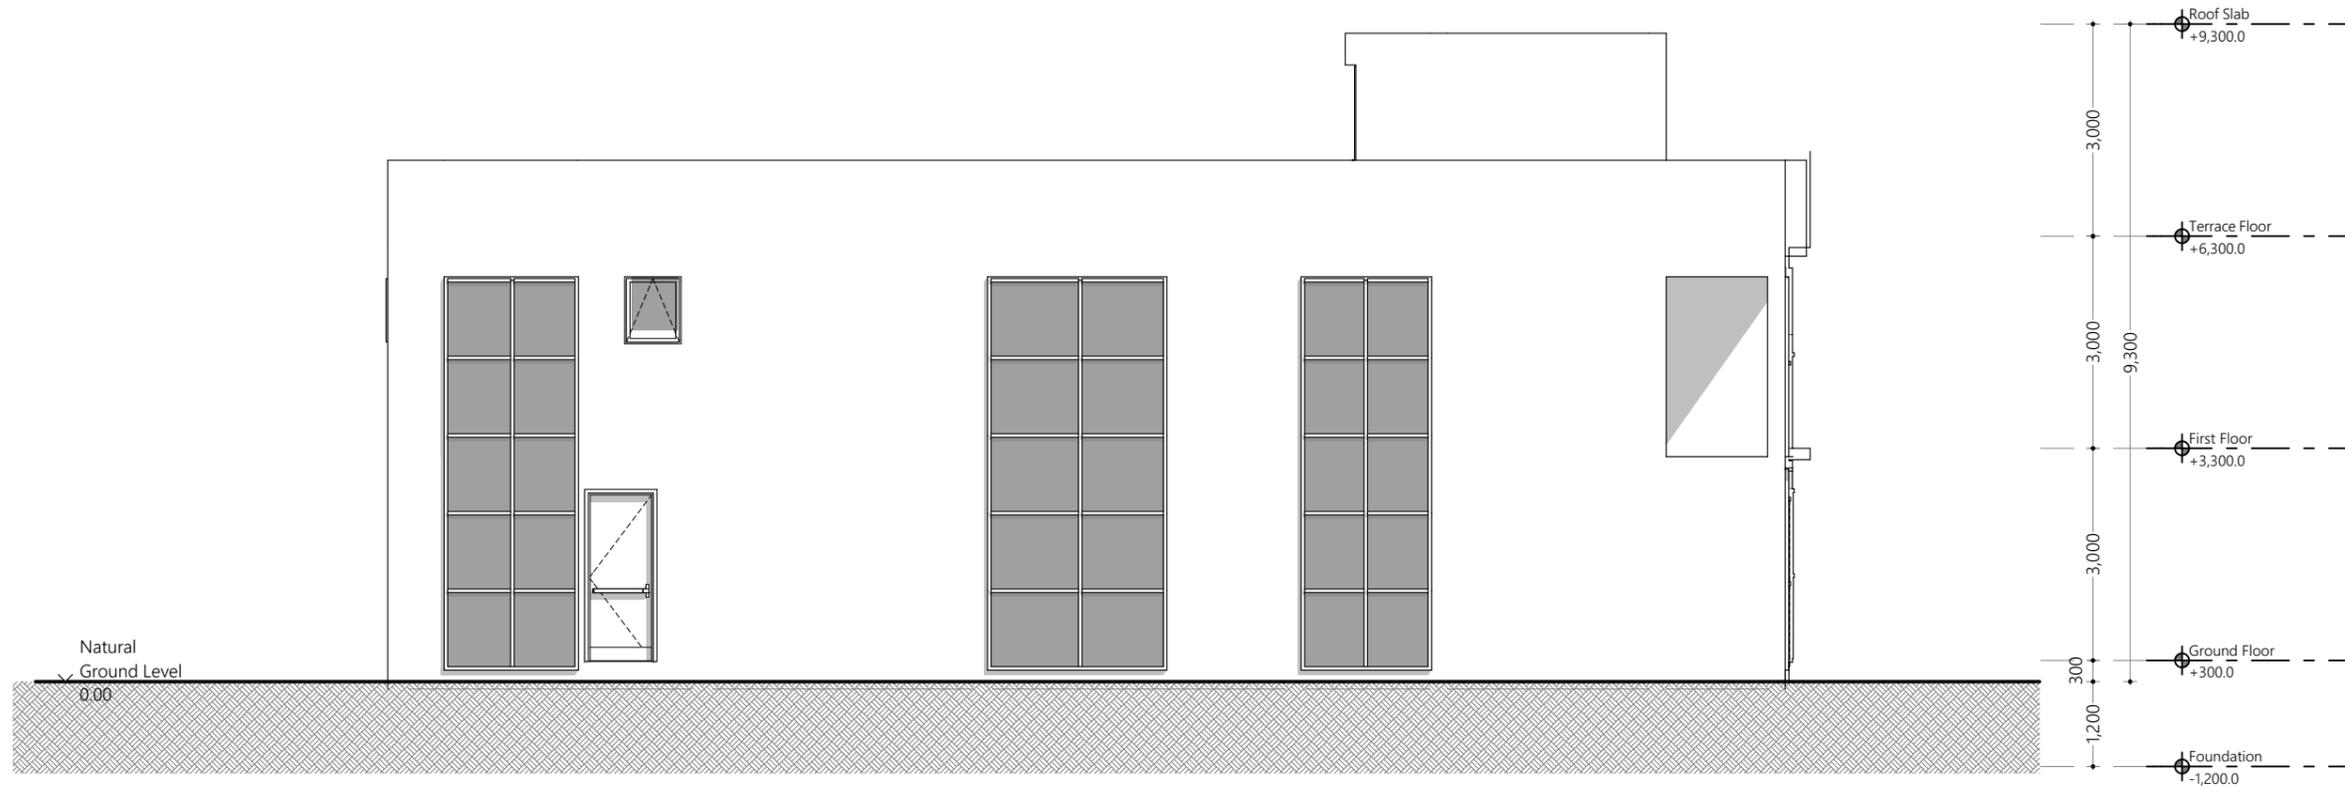

Elevation E2
1:100

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by

T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosany West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Elevation 1

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : A.4.01

All Openings Schedule				
Element ID	Auto Sliding Door	D01	D02	D02
Quantity	1	14	3	5
W x H Size	3,400x2,100	800x2,400	900x2,400	900x2,400
Sill height	100	100	100	100
Head height	2,200	2,500	2,500	2,500
2D Symbol				
View from Side Opposite to Opening Side				
Frame	02 Solid Core Hardwood	GRP (Glass reinforced polyester) door frame	03 50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	GRP (Glass reinforced polyester) door frame
Door Leaf	02 Solid Core Hardwood	GRP hermetically hygenic sealed door panel	03 40mm Thick solid core aluminium panel of selected colour and finish	GRP hermetically hygenic sealed door panel
Window Sash	---	---	---	---
Glazing	01 (No Glazing)	01 (No Glazing)	01 (No Glazing)	01 (No Glazing)

Door and Window Notes

Dimensions shown on DWG indicate effective openings of frame

All frame depths are 100mm
 All door leaf thicknesses are 35mm
 All window sash thickness are 25mm
 All frame edges shall be trimmed 3mm
 All wooden components should be wood stained finish
 All aluminum components to be powder coated (min. 60 microns)

All aluminum panels should be of 6mm thick unless specified
 All glazing should be of 6mm unless specified

External units must comply the following weather conditions:
 Wind pressure: 200 kg/sqm
 Water tightness: 25 kg/sqm

All external frames / wall joints must be sealed with silicon sealant and the wedges trimmed with 12X12mm hardwood beading fixed to frames by brass nails

Sealant shall be provided at all joints while fabrication

All hardware should be provided for the performance of all functions of the units
 Hinges shall confirm to

1) Door size more than 700X1900mm
 WD: 125mm X2 sets
 SD: 150mm X3 sets

2) Door size less than 700X1900mm
 WD: 100mm X2 sets
 SD: 125mm X2 sets

Locks shall be cylindrical with master key sets
 Door knobs shall be 1000mm above FFL

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A.G.Rosany West, 3rd
 Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassaan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
 All Opening Schedule

Scale : 1:1, 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** A.5.01

All Openings Schedule					
Element ID	D03	D04	D05	D06	D07
Quantity	12	5	1	4	1
W x H Size	950x2,400	1,000x2,400	1,200x2,400	1,500x2,400	1,800x2,400
Sill height	100	100	100	100	100
Head height	2,500	2,500	2,500	2,500	2,500
2D Symbol					
View from Side Opposite to Opening Side					
Frame	GRP (Glass reinforced polyester) door frame	GRP (Glass reinforced polyester) door frame	GRP (Glass reinforced polyester) door frame	03 50x100x2mm Thick powder coated (60 microns) Aluminum frame of selected colour	GRP (Glass reinforced polyester) door frame
Door Leaf	GRP hermetically hygenic sealed door panel	GRP hermetically hygenic sealed door panel	GRP hermetically hygenic sealed door panel	03 40mm Thick solid core aluminium panel of selected colour and finish	GRP hermetically hygenic sealed door panel
Window Sash	---	---	---	---	---
Glazing	01 (No Glazing)	01 (No Glazing)	01 (No Glazing)	01 (No Glazing)	01 (No Glazing)

Door and Window Notes

Dimensions shown on DWG indicate effective openings of frame

Sealant shall be provided at all joints while fabrication

All frame depths are 100mm

All hardware should be provided for the performance of all functions of the units

All door leaf thicknesses are 35mm

Hinges shall confirm to

All window sash thickness are 25mm

All frame edges shall be trimmed 3mm

1) Door size more than 700X1900mm

All wooden components should be wood stained finish

WD: 125mm X2 sets

All aluminum components to be powder coated (min. 60 microns)

SD: 150mm X3 sets

All aluminum panels should be of 6mm thick unless specified

2) Door size less than 700X1900mm

All glazing should be of 6mm unless specified

WD: 100mm X2 sets

External units must comply the following weather conditions:

SD: 125mm X2 sets

Wind pressure: 200 kg/sqm

Water tightness: 25 kg/sqm

Locks shall be cylindrical with master key sets

All external frames / wall joints must be sealed with silicon sealant and the wedges trimmed with 12X12mm hardwood beading fixed to frames by brass nails

Door knobs shall be 1000mm above FFL

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A:G.Rosany West, 3rd
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassaan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
All Opening Schedule

Scale : 1:1, 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : **Pg :** A.5.02

Ventilation Schedule					
Room Name	Room Area	Opening	Required Opening	Designed Opening	Opening %
Ground Floor					
Nurses station	4.96	Mechanical Ventilation			
Public Health Unit	16.15				
Treatment Room / Sample collection	9.24				
Ward (10 beds)	82.23				
Garage	16.14				
Health education	3.59				
Maintenance Store	3.23				
Toilet (F)	4.84				
Prayer Room	5.19				
Reproductive health	3.59				
Toilet (F)	4.17				
Vaccine Store	4.32				
Medical Store room/medicine preparation room	7.4				
Toilet (F)	4.04				
Toilet (F)	5.72				
General Store	8.43				
Laundry	7.4				
Clean Utility	2.77				
Main Store	5.52				
Dirty Utility	2.74				
First Floor					
Conference Hall	45.99	Mechanical Ventilation			
Disposal area	3.31				
General Store	8.23				
Lab	33.83				
Senior management	8.33				
Staff Lounge	24.95				
Toilet	2.12				
Toilet (F)	1.31				
Toilet (M)	2.86				
Cleaners closet	3.6				
Manager Room	8.33				
Toilet (F)	4.04				
Meeting Room	11.3				
Office	33.69				

f
Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

f
Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by

T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Ventilation Schedule

Scale :

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : **Pg :** A.5.03



HDh. Nellaidhoo Health Centre Portico And Extension

Structural Detailed Drawings

Kulhudhufushi Regional Hospital

Date: Thursday, August 24, 2023

Project Number: EP/PRJ/2023/22

1. General notes

1.1. Do not scale the drawings. All dimensions shall be read from the drawing or computed. Elevations are in millimeters, distances and reinforcement bar sizes are in millimeters.

1.2. In the interpretation of these drawings, indicated dimensions shall govern and distances or sizes shall not be scaled for construction purposes.

1.3. The contractor shall coordinate with the arse, ee and other utility and equipment plans for the exact size number and locations of all sleeves or openings through floor slabs, beams and walls. Any discrepancies or conflict in the setting out lines, levels, details, locations, sizes, reinforcement etc. Of the structural member shall be brought to the attention of the engineer prior to commencement of work.

1.4. All reinforced concrete work shall be done in accordance with the British structural code BS 8110 or EC-EN2 building code.

1.5. All structural steel work shall be done in accordance with the British structural code BS 5950 parts 1 to 9 and EC-EN3 in so far as they do not conflict with the local building code requirements.

1.6. All slabs, beams and other structural elements which are not indicated, detailed, designated or inadvertently omitted but are necessary to be coordinated with architectural and other allied engineering plans as well as to complete the structural works in accordance with the intent of the plans and specifications shall be brought up during pre-bids/meetings/negotiations. It is understood that the contractor has provided and included all these items in his bid.

1.7. The contractor shall produce shop drawings and schedules as required for completion of the works and record drawings of the as-built and builder works for the consultant's approval.

1.8. Contractor shall do full coordination between structural, architectural and MEP drawings in wet areas to allow for drainage pipes.

1.9. All discrepancies shall be brought to the attention of the consultant engineer proceeding with the work on site.

1.10. All materials to be used in conjunctions shall comply with the requirements of the specified codes, standards and ordinance of relevant building authorities unless noted otherwise in the project specification and/or drawings.

1.11. All dimensions and levels shown on the drawings shall be verified by the contractor. Any discrepancies shall be brought to consultants attention prior to construction.

1.12. The contractor shall ensure that during construction no part of the structure is overstressed by excessive construction loads until their completion. Temporary bracing and propping to be provided where required.

1.13. Once the excavation is done to a specified depth the bearing capacity of the soil shall be confirmed by relevant test, if the value is less than the design bearing capacity the engineer is to be informed immediately.

1.14. The contractor shall submit a method statement for all elements of work and shall not proceed until consultant's written approval is given. The method statement shall provide the contractor's preferable options where such options are available.

1.15. The contractor shall comply with all requirements of the local regulations and requirements of all concerned authorities.

1.16. Quality of concrete finish for all non-plastered columns and beams is to be in accordance with fair faced concrete as reflected on the architectural drawings and specifications.

1.17. Any structural requirements specified by relevant authorities, which are not covered in notes and specifications are assumed to be duly considered by the contractor.

1.18. All typical details and notes shown on drawings shall apply unless noted otherwise. Typical detail may not necessary be indicated on the plans but shall still apply as shown or described in the details where particular details are noted on the drawings the specified details shall be used.

1.19. The design life of the structure of this project shall maintain a minimum of 50 years life period. The primary structural components are to be designed and detailed to satisfy this requirement. Concrete mix supplier shall submit a life cycle analysis which reflects a 50 years design life without maintenance inspection and repair requirement during this period.

2. Concrete

2.1. All concrete works shall conform to the BS 8110 or EC-EN, a grade of C25/30 indicates that concrete shall have a f_{cu} compressive strength of 30 N/mm² established from test cubes at 28 days equivalent to a compressive strength of 25 N/mm² established from cylinder tests at 28 days.

concrete mix design shall comply with BS 5500-1:2006 as follows:

Mix Number	1	2	3	4
Grade	C30/37	C25/30	C25/30	C16/20
Min cement content (kg/m ³)	380	340	340	300
Cement Type	SRC	SRC / OPC	OPC	SRC
Max free W/C ratio	0.4	0.45	0.45	0.55
Slump	75 ± 25	75 ± 25	75 ± 25	100 ± 25
Aggregate	20	20	20	20

mix 1 - used in reinforced concrete works for structures at sea/exposed to sea, water retaining structures and tank structures.

mix 2 - used in reinforced concrete works for ground level and below (sub-structure) or any reinforced concrete works in contact with soil or water.

mix 3 - used in reinforced concrete works above ground level (superstructure) for horizontal members (beams/slabs) and vertical members (columns/walls).

mix 4 - used for plain concrete blinding and mass fill.

2.2. Contractor shall implement a trial mix in accordance with the project specifications & authority requirements. Trial mix results shall be submitted for engineer's review & approval prior to commencing concreting.

2.3. Contractor shall submit the details of additives, plasticizers, micro silica, curing compounds, waterproofing agents, etc. Application should follow strictly the manufacturer recommendation. It is contractor's responsibility to ensure that all constituents of concrete are compatible to each other.

2.4. Maximum percentage (by weight) of salt contents permissible in aggregates used for concrete, hollow blocks & hourdi blocks, etc, shall be as follows:

- a) acid soluble chlorides in aggregate - (fine 0.03%, coarse 0.02%)
- b) acid soluble sulphate in aggregate - (fine 0.3%, coarse 0.2%)

2.5. Concrete shall be cured by an approved means in accordance with the specifications.


2.6. Aggregates shall be from approved source and in accordance with the specifications.

2.7. Openings, sleeves:

- a) no holes, sleeves or penetrations be placed vertically or horizontally through beams unless approved by the engineer.
- b) no holes to be made in slabs unless approved by the engineer.

2.8. Construction joints:

- a) the contractor shall submit to the engineer for approval a plan marked up showing the location of all construction joints
- b) horizontal construction joints shall not be made in beams, unless approved by the consultant or engineers.
- c) vertical construction joints may be located at midspan of slabs or beams after reviewed and approved by the engineers.
- d) contractor shall submit shear friction and the additional required reinforcement calculation of construction joint (at any location) for engineers review and approval.

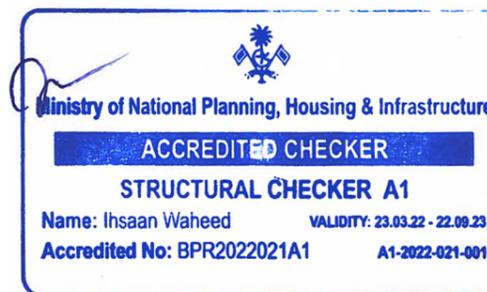

3. Reinforcement

3.1. The reinforcement used in the reinforced concrete shall be round, deformed type 2 bars marked as (t) to indicate high yield strength of 460 N/mm² to BS 4449 or type 500b to EC-EN. The carbon equivalent of rebars should not exceed 0.51 for grade 460.

3.2. Reinforcement details shown are indicative. The contractor shall prepare detailed shop drawings & full bar schedules in accordance with the design drawings and shall be cut and bent in accordance with BS 8666 and ACI 315-09 for the engineer's approval at least four weeks prior to commencement of reinforced concrete work and after coordinating with all concerned parties.

3.3. Lap lengths and anchorage lengths of reinforcement shall be as per BS 8110 and EC-EN. Additional lapping if required to be provided with engineer's approval. The minimum lap length of reinforcement shall be the maximum of (45 bar dia in general and 50 dia for tension) or the values of the table a.

Table a : schedule of lap splices

Bar dia	Lap splices length (mm)
10	500
12	600
16	800
20	1000
25	1250

3.4. Spacer bars in beams shall be a minimum t25 or the size of bar if greater than 1000mm c/c; chairs in slabs shall be a minimum t12@1000mm c/c; and minimum ties in walls shall be t8@1000mm c/c.

3.5. Clear cover to reinforcement including links, stirrups, and ties shall be as follows:

A) structure in contact with ground

- Footings = 55mm
- Wall and column = 50mm
- Ground beam = 50mm
- Slab at ground level = 50mm

B) super structure

- Columns = 40mm
- Beams = 35mm
- Slabs = 30mm
- Walls = 40mm
- All concrete elements in contact with water/splash zone = 75mm

3.6. Reinforcement bars to be cut, bent or adjusted to clear all openings and interfering structures to suit at site to the approval of the consultant or engineer.

3.7. For holes in slabs up to 300x300 sq., reinforcement is to be cut and replacement bars fixed adjacent to the hole extending 50x bar diameter beyond the hole.

4. Fire resistance

4.1. All structural concrete members between units on boundaries are designed to maintain fire resistance of 2 hours.

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A: G.Rosary West, 3rd
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Structural Notes 1

Scale : 1:20

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : B.1.02

5. Cracking

5.1. The cracking of the structural concrete in general is restricted to 0.30mm.

6. Earthwork & foundations

6.1. Foundation detail design is based on the assumed safe allowable bearing capacity has been taken as 150kpa. The actual requirement for the foundation design is to be verified based on final geotechnical report for the project.

6.2. Excavations for foundations down to formation level shall be carried out by mechanical means, except for the last 100mm of excavation which is to be carried out by manual methods and recommended by geotechnical consultant.

6.3. The formation level of foundation is to be inspected and approved by the geotechnical engineer before commencement of the work.

6.4. Engineering fill (unless specified otherwise as a higher quality material) shall be selected well graded granular material approved by the engineer with a minimum soaked cbr of 15% compacted not exceeding 250mm in layers to 95% maximum dry density as per geotechnical investigation report recommendations in accordance with the specification. However, a minimum cover of 250mm back fill material shall be provided at the top of foundations below the blinding to cast against.

6.5. Efficient site drainage during and after construction of the project should be provided by the contractor.

6.6. Site inspection by a qualified engineer should be carried out after completion of the excavation works and after preparation of the proposed foundation level to ensure that the contact surface is free from any loose/soft layer and properly prepared for the foundation.

7. Concrete workmanship

7.1. All concrete without plaster shall be fair finish unless noted otherwise.

7.2. All concrete surface to have plaster are to be hacked to have an adequate surface key.

7.3. All concrete is to be cured by an approved method-water pounding or curing compound.

7.4. All types of construction joints in concrete shall be at a specified locations and approved by the engineers.

7.5. All substructure concrete works shall be protected with water proofing as per standard details & specifications.

7.6. All concrete shall be compacted using a mechanical vibration process.

7.7. 25x25mm chamfers to external corners and edges shall be provided in accordance with specifications and directed by the engineer.

8. Structural steel

8.1. All structural steel works shall be in accordance with bs 5950 parts 1 to 9 or ec-en3.

8.2. Maximum dimension of holes shall be in accordance with bs 5950 : part 1 : 2000 table 35, unless indicated otherwise.

8.3. The contractor shall provide whatever temporary ties or bracing necessary for a safe and proper erection of the steel structures.

8.4. Welding shall comply with bs en 1011-1: 2009, bs en 1011-2 : 2001 and bs bs en 1011-8 : 2004.

8.5. Contractor shall do a detailed design for aluminum shades and to submit full design calculations and detailed shop drawings for all steel sections and connections to the engineer for approval prior to commencement of fabrication.

8.6. All rolled products and plates shall conform to bs en 10025-2. Cold form welded structural hollow sections shall conform to bs en 10219-1. Hot finish hollow sections shall conform to bs 10210-1 unless noted otherwise on drawings.

8.7. All connections shall be made with minimum 2nos. Galvanized grade 8.8 to bs 3692 with a minimum diameter of 20mm and minimum yield strength of 627mpa and minimum ultimate strength of 765mpa and electrodes to bsd 639, unless noted otherwise.

8.8. Unless noted otherwise on the drawings, all connections shall be in accordance with the following minimum requirements:

- A) all welds shall be at least 6mm continuous fillet welds all around.
- B) all structural bolted connections should be galvanized minimum 85 micron and with a minimum of 2 bolts per connection. Purlin bolts shall be in accordance with the suppliers recommendations.
- C) all gusset plates shall be at least 4mm thick.
- D) all cap plates shall be at least 4mm thick.
- E) all base plates shall be at least 4mm thick.

8.9. As minimum all structural steel members shall be shot blasted to sa 2.5, galvanized, primed & painted as below unless noted otherwise:

- A) hot galvanization (dft 200micron)
- B) primer coat to contain 2 coats of zinc rich epoxy primer (dft 75 micron)
- C) top coat to contain 2 coats of polyurethane enamel paint (dft 125 micron)

8.10. All structural steel work shall be corrosion protected in accordance with the structural specifications.

8.11. All steel should conform to the following:

- A) shs, rhs and chs sections bsen 10210 s275 fy=275mpa
- B) all angles and channels u.n.o bsen 10025 s275 fy=275mpa

8.12. All steel columns to be central on grids or equally spaced between grids unless noted otherwise.

8.13. All steel beams to be central on grids or equally spaced between grids unless noted otherwise.

8.14. All steel dimensions are to center line of section unless noted otherwise.

8.15. All bracing is to be set out on the centroids of bracing members and on the center line of beams and columns unless noted otherwise.

8.16. Where bracing is shown offset from center of members the contractor shall design and provide all necessary stiffeners.

8.17. Contractor to provide all leader railing as required to support free edges not trimmed with cold formed or mild steel work. To be provided in accordance with architect's drawings.

8.18. Location of any connections, splices not shown in the drawings shall be submitted with design for engineer's approval. No splices shall be made unless shown in the drawings and as approved by the engineers.

8.19. Contractor shall do a full coordination between architecture and structural drawings for the steel support for shade elements, locations and sizing connections with structural concrete elements and sections. Care shall be taken to prevent dissimilar metal corrosion.

9. Masonry blocks

9.1. Design and construction of all blocks shall comply with bs 5628 : parts 1.2 & 3 : 1992 or en-ec6. The contractor shall submit a construction method statement prior to commencing the works.

9.2. Wall ties in accordance with bs 1248 - cp 121 part 1.73.

9.3. All block wall joints to manufacturers specifications.

9.4. All block work walls are to be considered as non-load bearing partitions unless noted otherwise in drawings.

9.5. Block walls shall be reinforced horizontally and vertically as per manufacturers requi

9.6. Masonry wall mechanical properties

- young's modulus = 3.5e+006 kn/m²
- poisson's ratio = 0.25
- density = 20kn/m³
- min.compressive strength = 3.5 mpa

10. Design & loading

10.1. Consultant design

design and construction of reinforced concrete structural members, shall be in accordance with bs8110 & ec-en2 and the structural steel members to bs 5950 & ec-en3.

10.2. Contractor design

the contractor is responsible for the design of all temporary works. (shoring for excavation, signage... Etc) and the following items of permanent secondary works. (subjected to engineers review and approval)

- a) precast concrete elements
- b) architectural facade and support steelwork
- c) non load bearing feature columns
- d) all secondary steel works
- e) structural steelwork connections
- f) structural support for mep services
- g) shade structures
- h) balustrade and crash barrier
- i) structural glass
- j) interior signage

the design of the primary structure is considering the interfaces with these structures) loading reactions, opening...etc.) And were detailed to accommodate these elements into the design.

the contractor shall submit a full detail design for the wall and boundary wall foundation, also the contractor to do

full coordination between the structural foundation for villas (including the water tanks, and the boundary wall for clashes, the contractor shall produce shop drawings for the boundary walls for engineer's approval.

10.3. Loading

- a) superimposed (dead loads & live loads) as per bs 6399 or en-ec1.
- b) self-weight & densities as per bs 648 or en-ec1.
- c) wind loads as per bs 6399 or en-ec1 (mean wind speed = 25m/s).

11. Timber

11.1. All timbers shall be in accordance with bs 5268 or ec-en5

11.2. All timber members sizes are indicative. Contractor shall coordinate with supplier and submit detail designs for all prefab timber structure for approval.



#	REVISION	BY	APP	DATE

Project: Haldhoo Health Centre Portico And Extension

Client : Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates, W: www.epochassociates, A:G.Rosary West, 3rd Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassaan	APPROVED: Ihsaan Waheed

Page Title
Structural Notes 2

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : Pg : B.1.03

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-060-001


Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

Notes:


1. First stirrups location shall be $\frac{L}{2}$ from the face of the column/ support.
2. Place one b bar in each bottom corner and one t bar in each top corner of the stirrup cage.
3. Condition shown is at columns Where beams and girder intersect use typical interior girder section.
4. All bottom bars and top bars shall be placed in one layer unless two layers are noted in the beam schedule Where two layers are noted provide 25 mm clear between layers If two layers are noted place bar t_2 above bar b and bar t_1 above t_3 .
5. Length of exterior top bars are given only when straight bar occurs otherwise hooked bars are required
6. Where a member is supported by a column but has another member running perpendicular to it at the same column the first stirrup spacing shall start from the face of the column and not from the face of the transverse beam
7. Top & bottom reinforcement lapping of both main rebars can be ignored if the main rebars at left and right side of lapping location are identical
8. For 'column width less or equal 2m $l^* = \text{column width} / 2$. For 'column width' greater than 2m, $l^* = 1m$

Supplementary abbreviations


- B1- continuous bottom bars.
- B2 - additional bottom bars
- CE- cantilevered end
- D - depth of member, mm
- EE- each end
- EF- each face
- FL- full length
- EW- each way
- H - aci standard hook
- ITB- interior top bar
- LE- left end
- LG- length
- P - paired stirrups
- RE- right end
- REM- remainder
- S- side bars
- T1 - top bars at internal supports
- T2 - top bars at mid-span
- T3 - top bars at end support
- W - width of member, mm

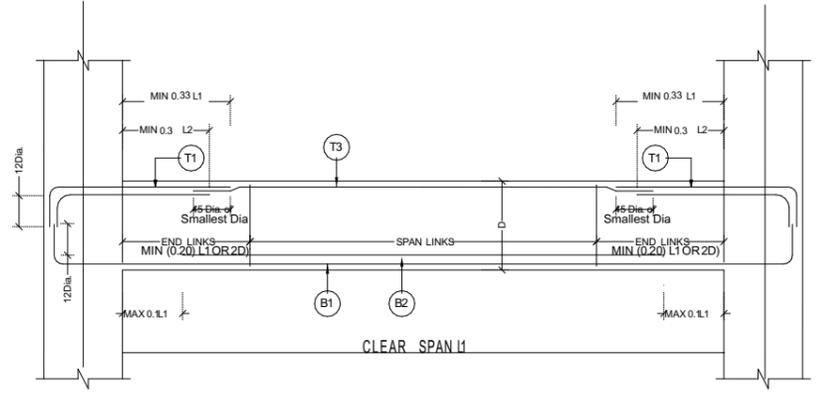


SIMPLE BEAM DETAILS
NTS

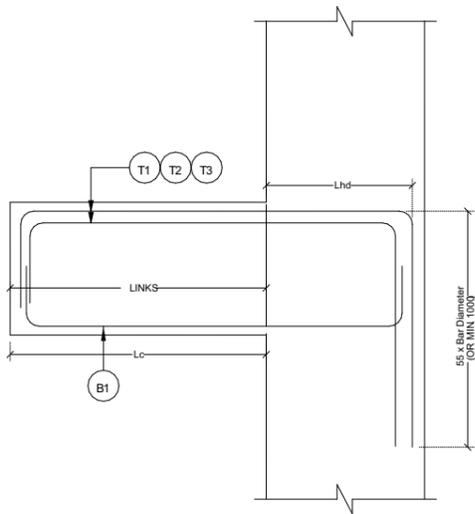

TYPICAL CANTELEVER BEAM FROM COLUMN
NTS

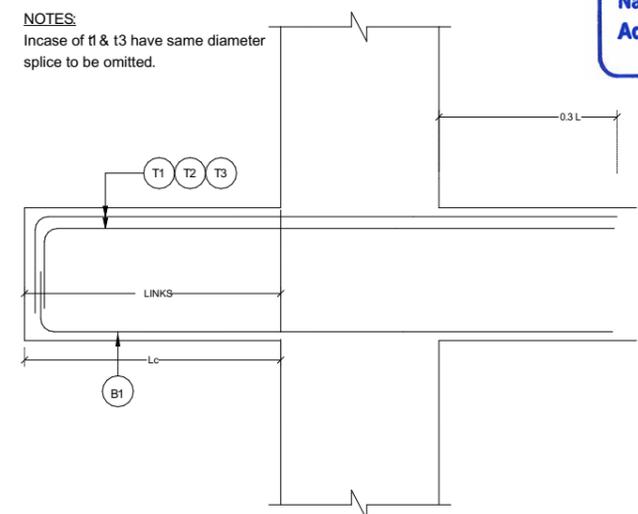

TYPICAL CANTELEVER BEAM CONTINUOUS
NTS

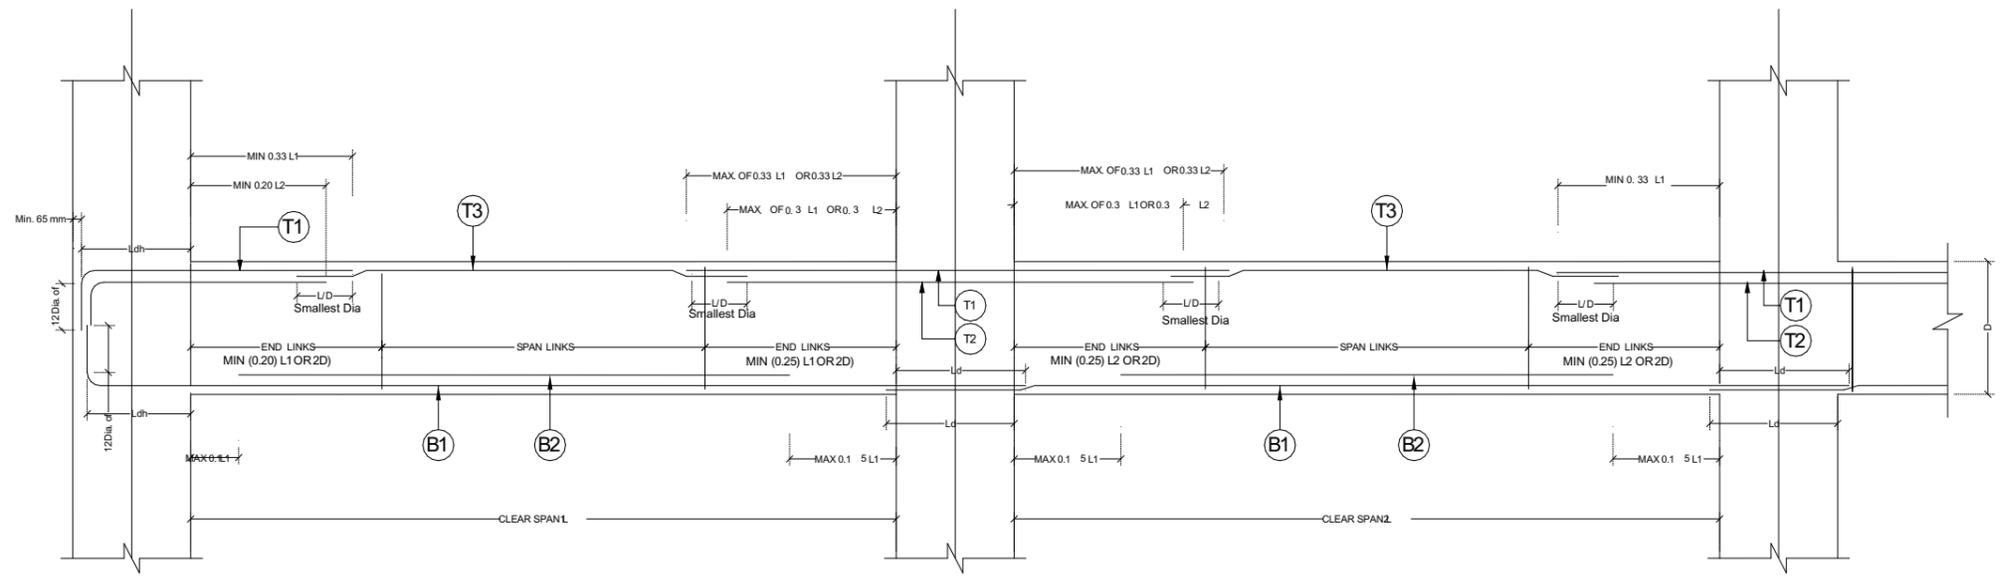

CONTINUOUS BEAM DETAILS
NTS

#	REVISION	BY	APP	DATE

Project: Kalladhoo Health Centre Portico And Extension

Client: Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates.
 W: www.epochassociates, A: G.Rosany West, 3rd Floor, Husnuheena Magu, Malé, Maldives

DESIGNER:	CHECKED:
Muaviyath A. Sathar	F. Ihudha Amir
DRAWN:	APPROVED:
Mohamed Hassaan	Ihsaan Waheed


Page Title
Structural Notes 3

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : Pg : B.1.04

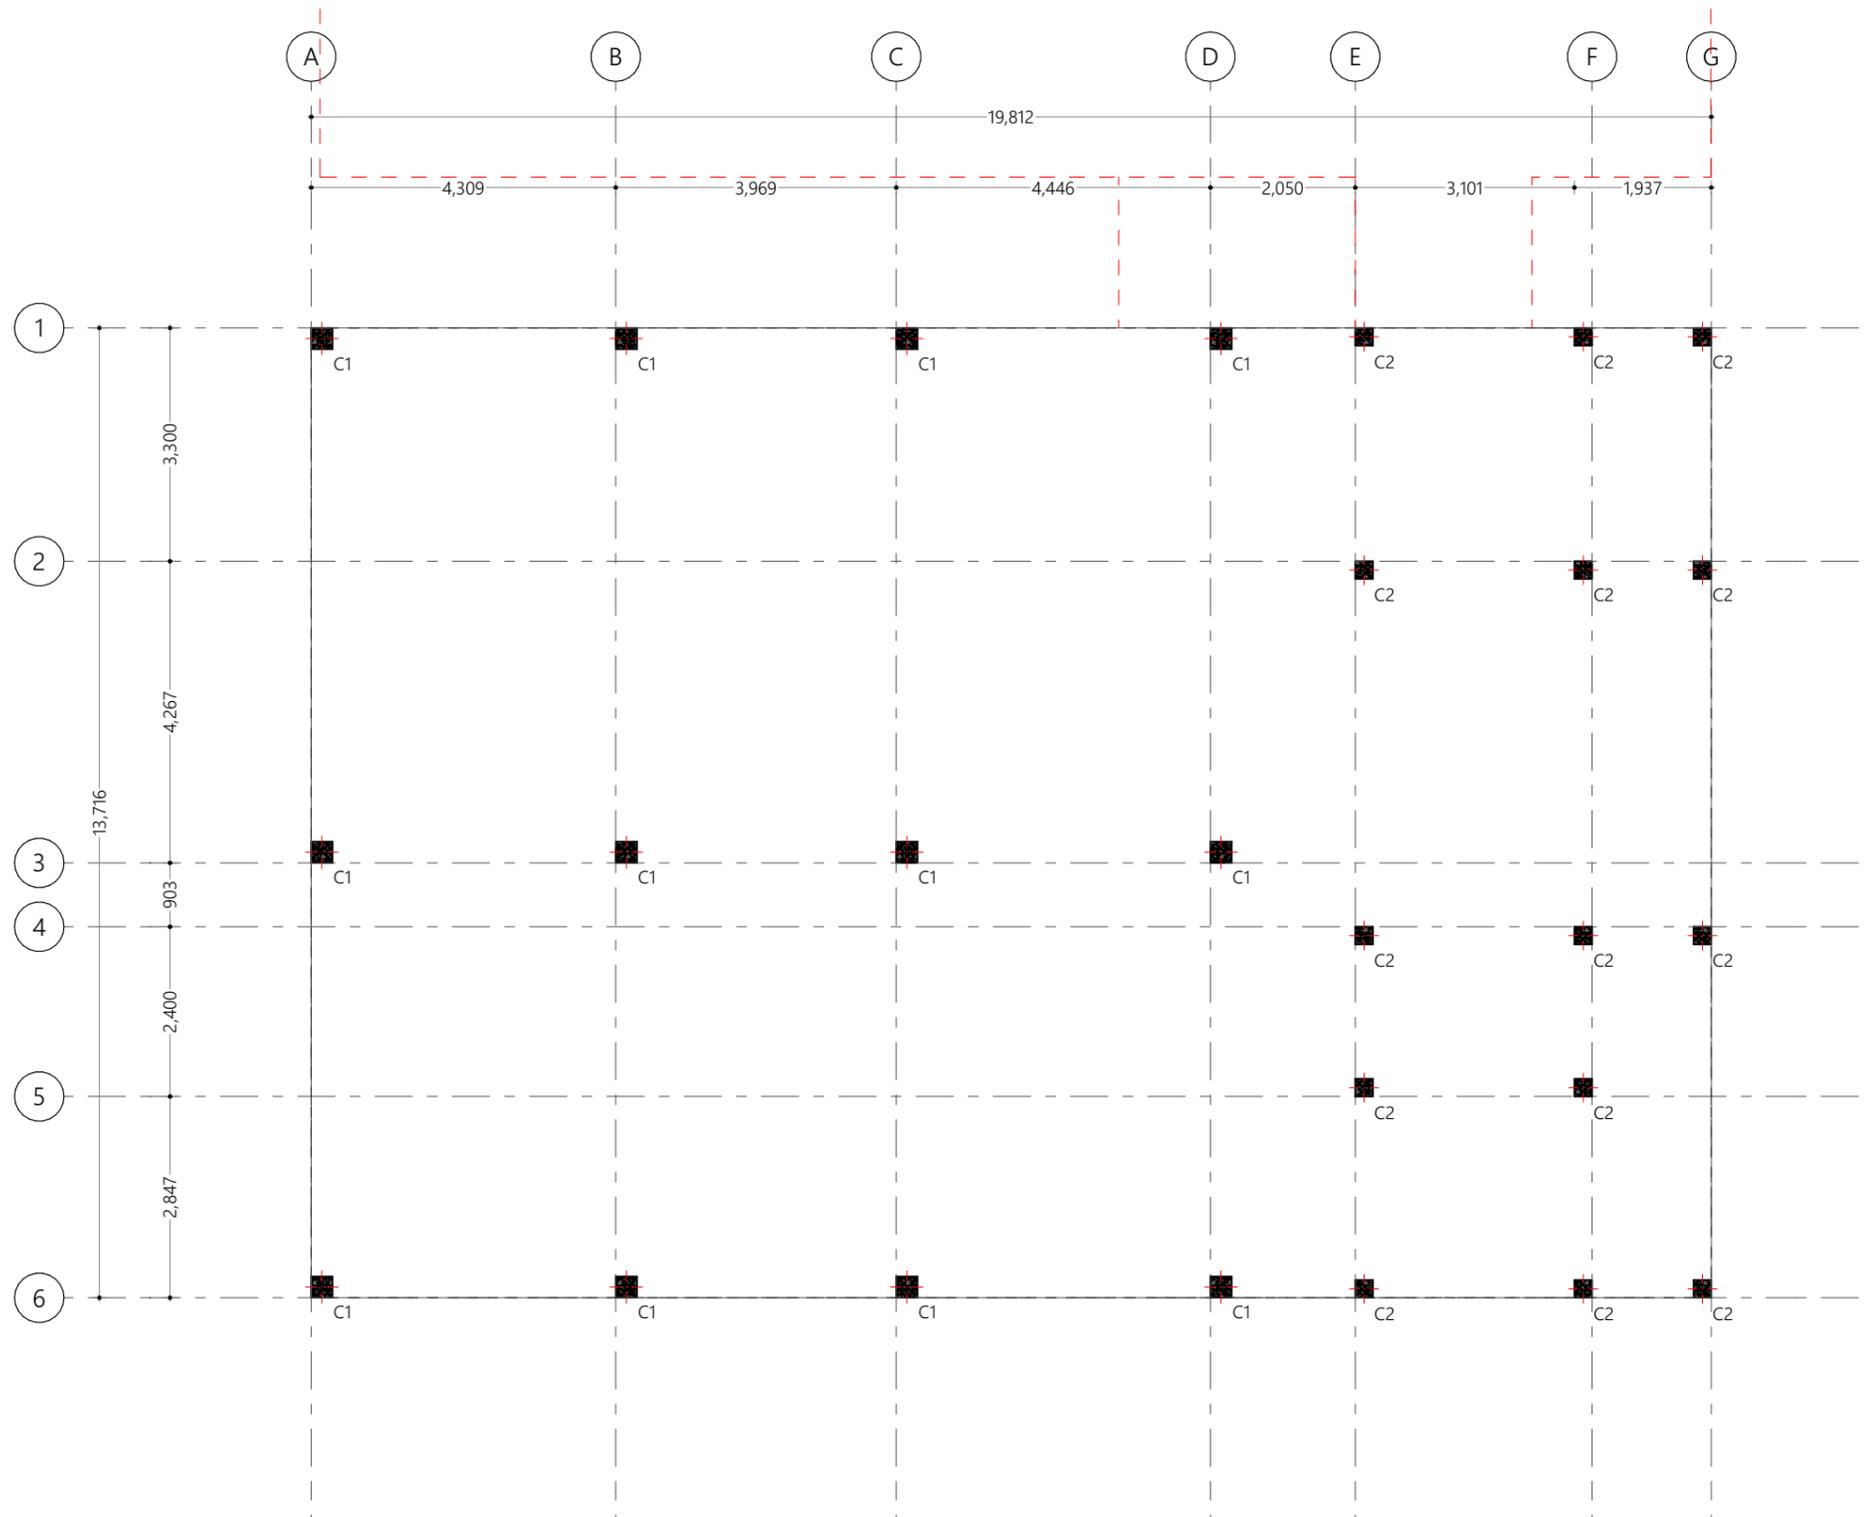

Column Layout
1:100

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by

T: +960 333 3528, E: info@epochassociates.
 W: www.epochassociates, A.G.Rosary West, 3rd Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
 Column Layout

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : B.1.05

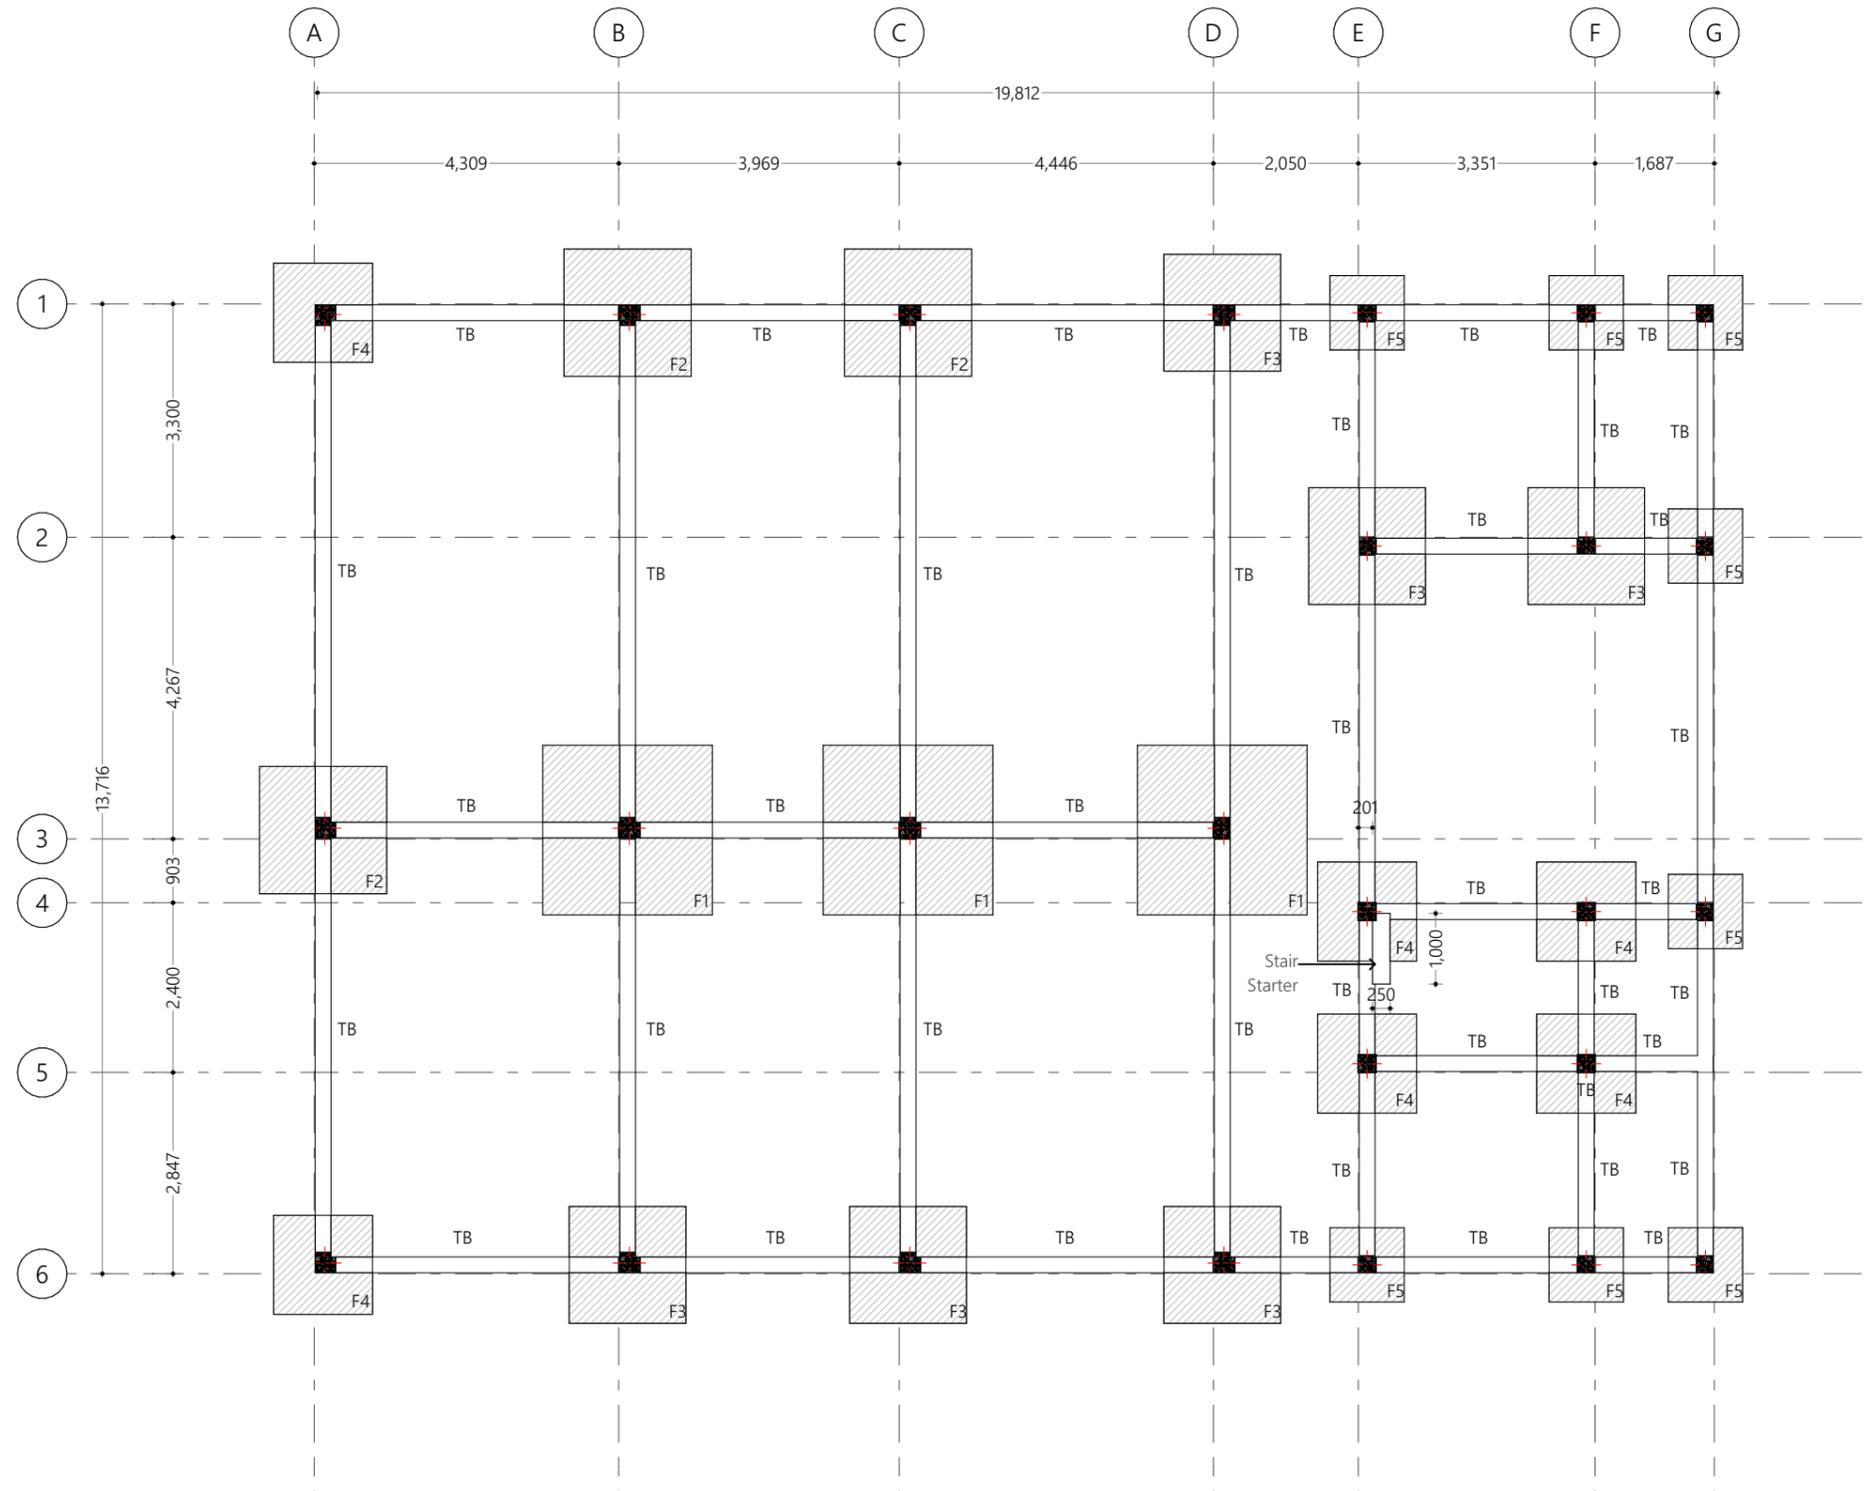

f

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-060-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates.
 W: www.epochassociates, A.G.Rosary West, 3rd Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
 Foundation Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** B.1.06


Foundation Details:

	Dimensions	Reinforcement
F1	2400x2400x400	T12@100C/C B/W (B)
F2	1800x1800x400	T12@150C/C B/W (B)
F3	1650x1650x400	T12@150C/C B/W (B)
F4	1400x1400x400	T10@150C/C B/W (B)
F5	1050x1050x400	T10@150C/C B/W (B)

Foundation Depth = 1200mm
 Ground Slab = 100mm thick RC slab on fill reinforced with T10@200C/C (B/W)

All Footings are to be laid on top of 50mm thick lean concrete
 Apply waterproofing to all substructure (below ground elements)
 All below ground & terrace concrete works shall be done using waterproofing admixtures

Foundation Plan
 1:100

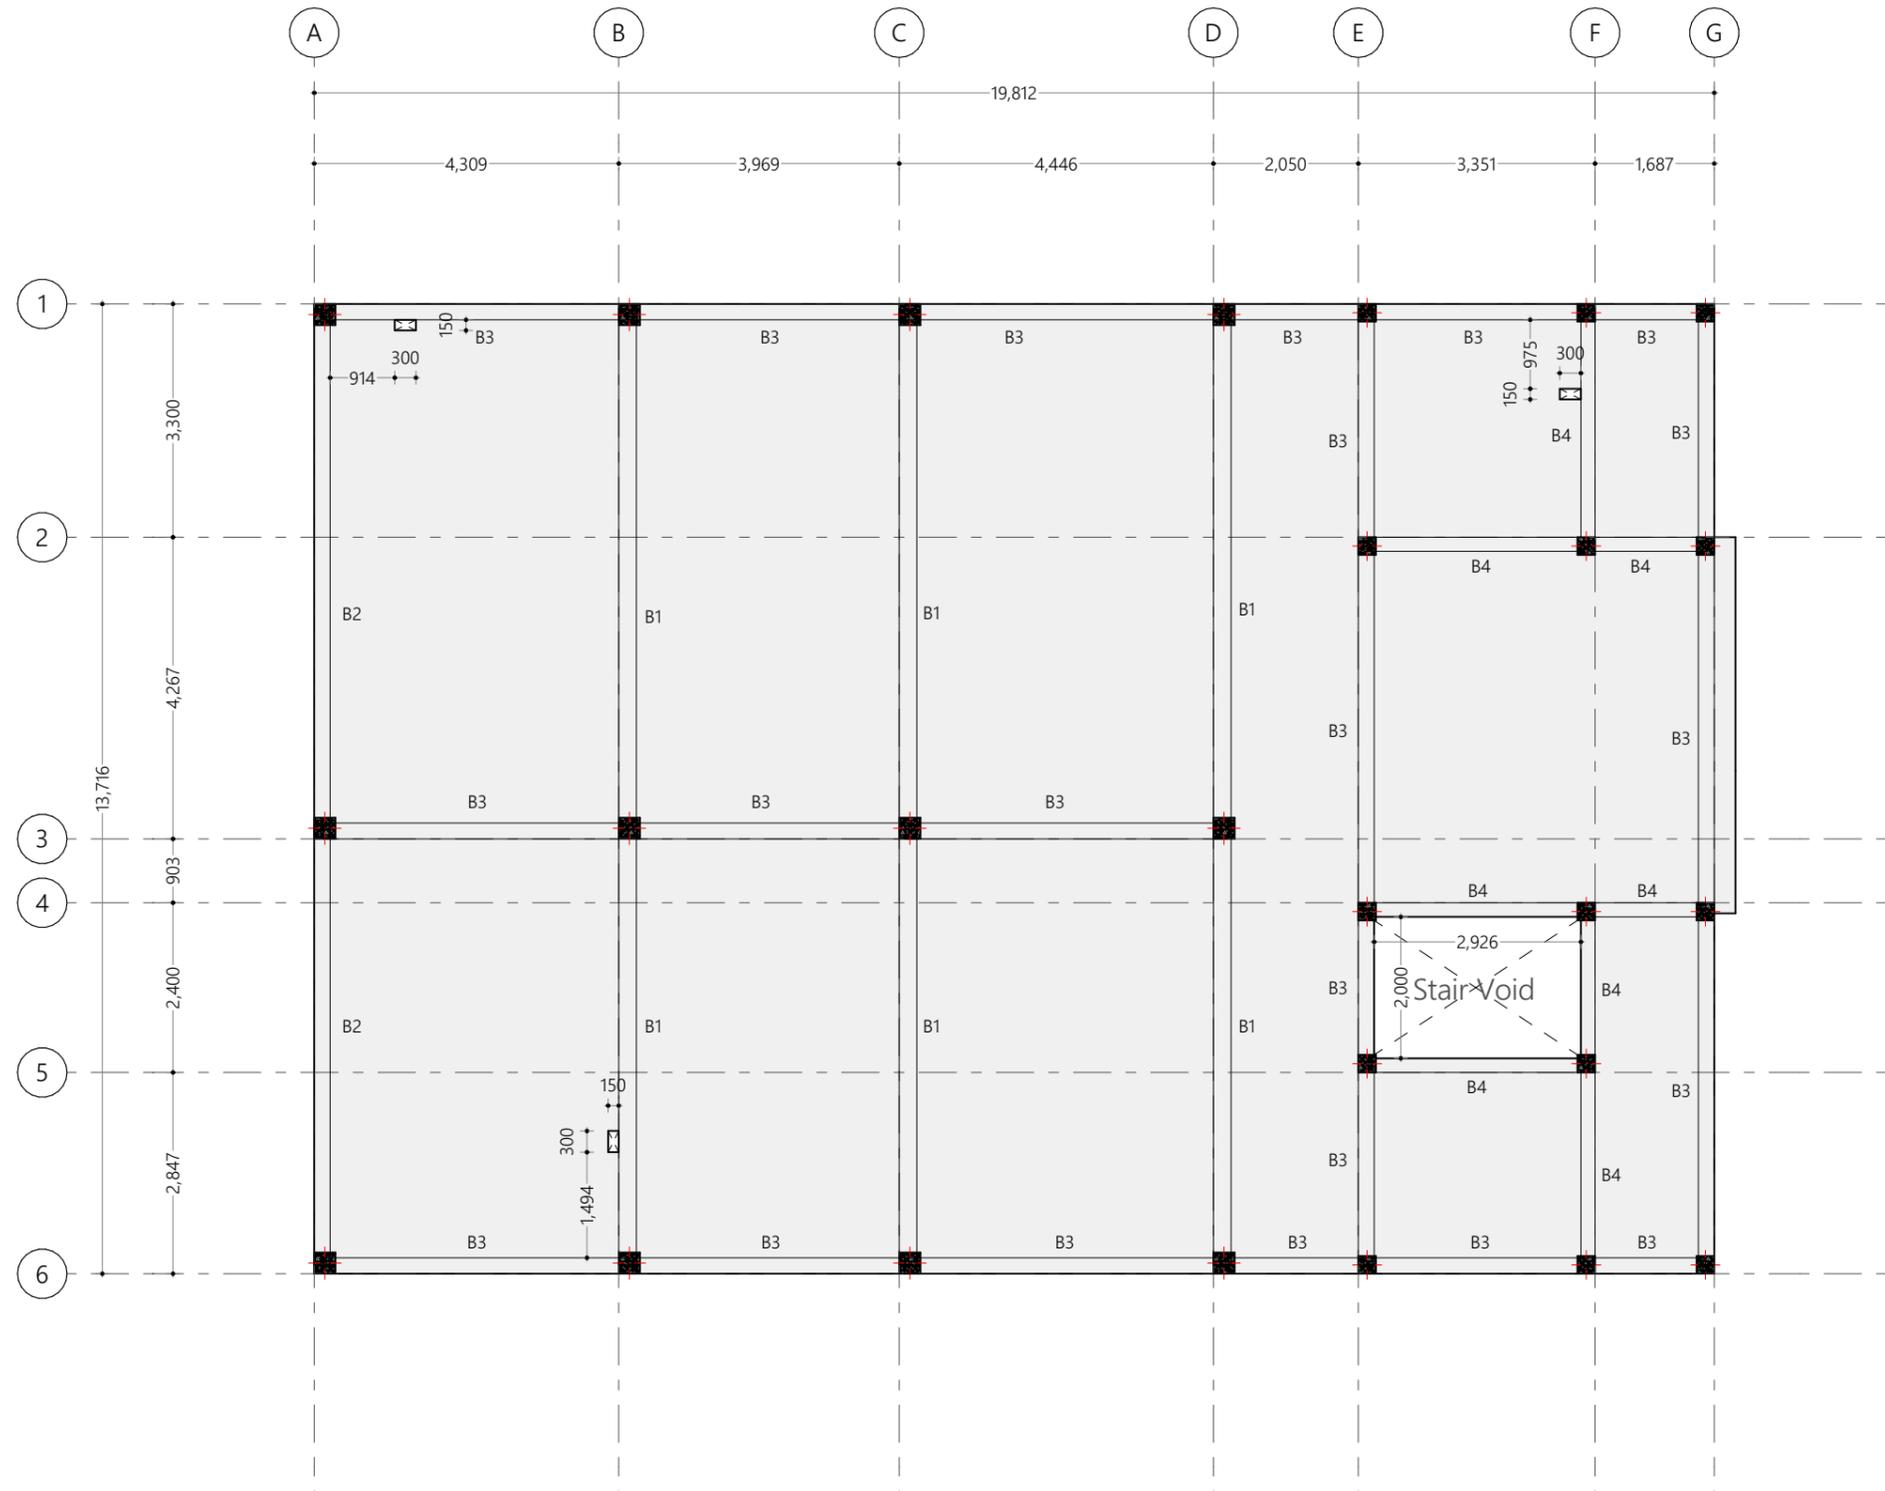

First Floor Beam Plan
1:100

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A.G.Rosary West, 3rd
 Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
 First Floor Beam Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** B.2.01

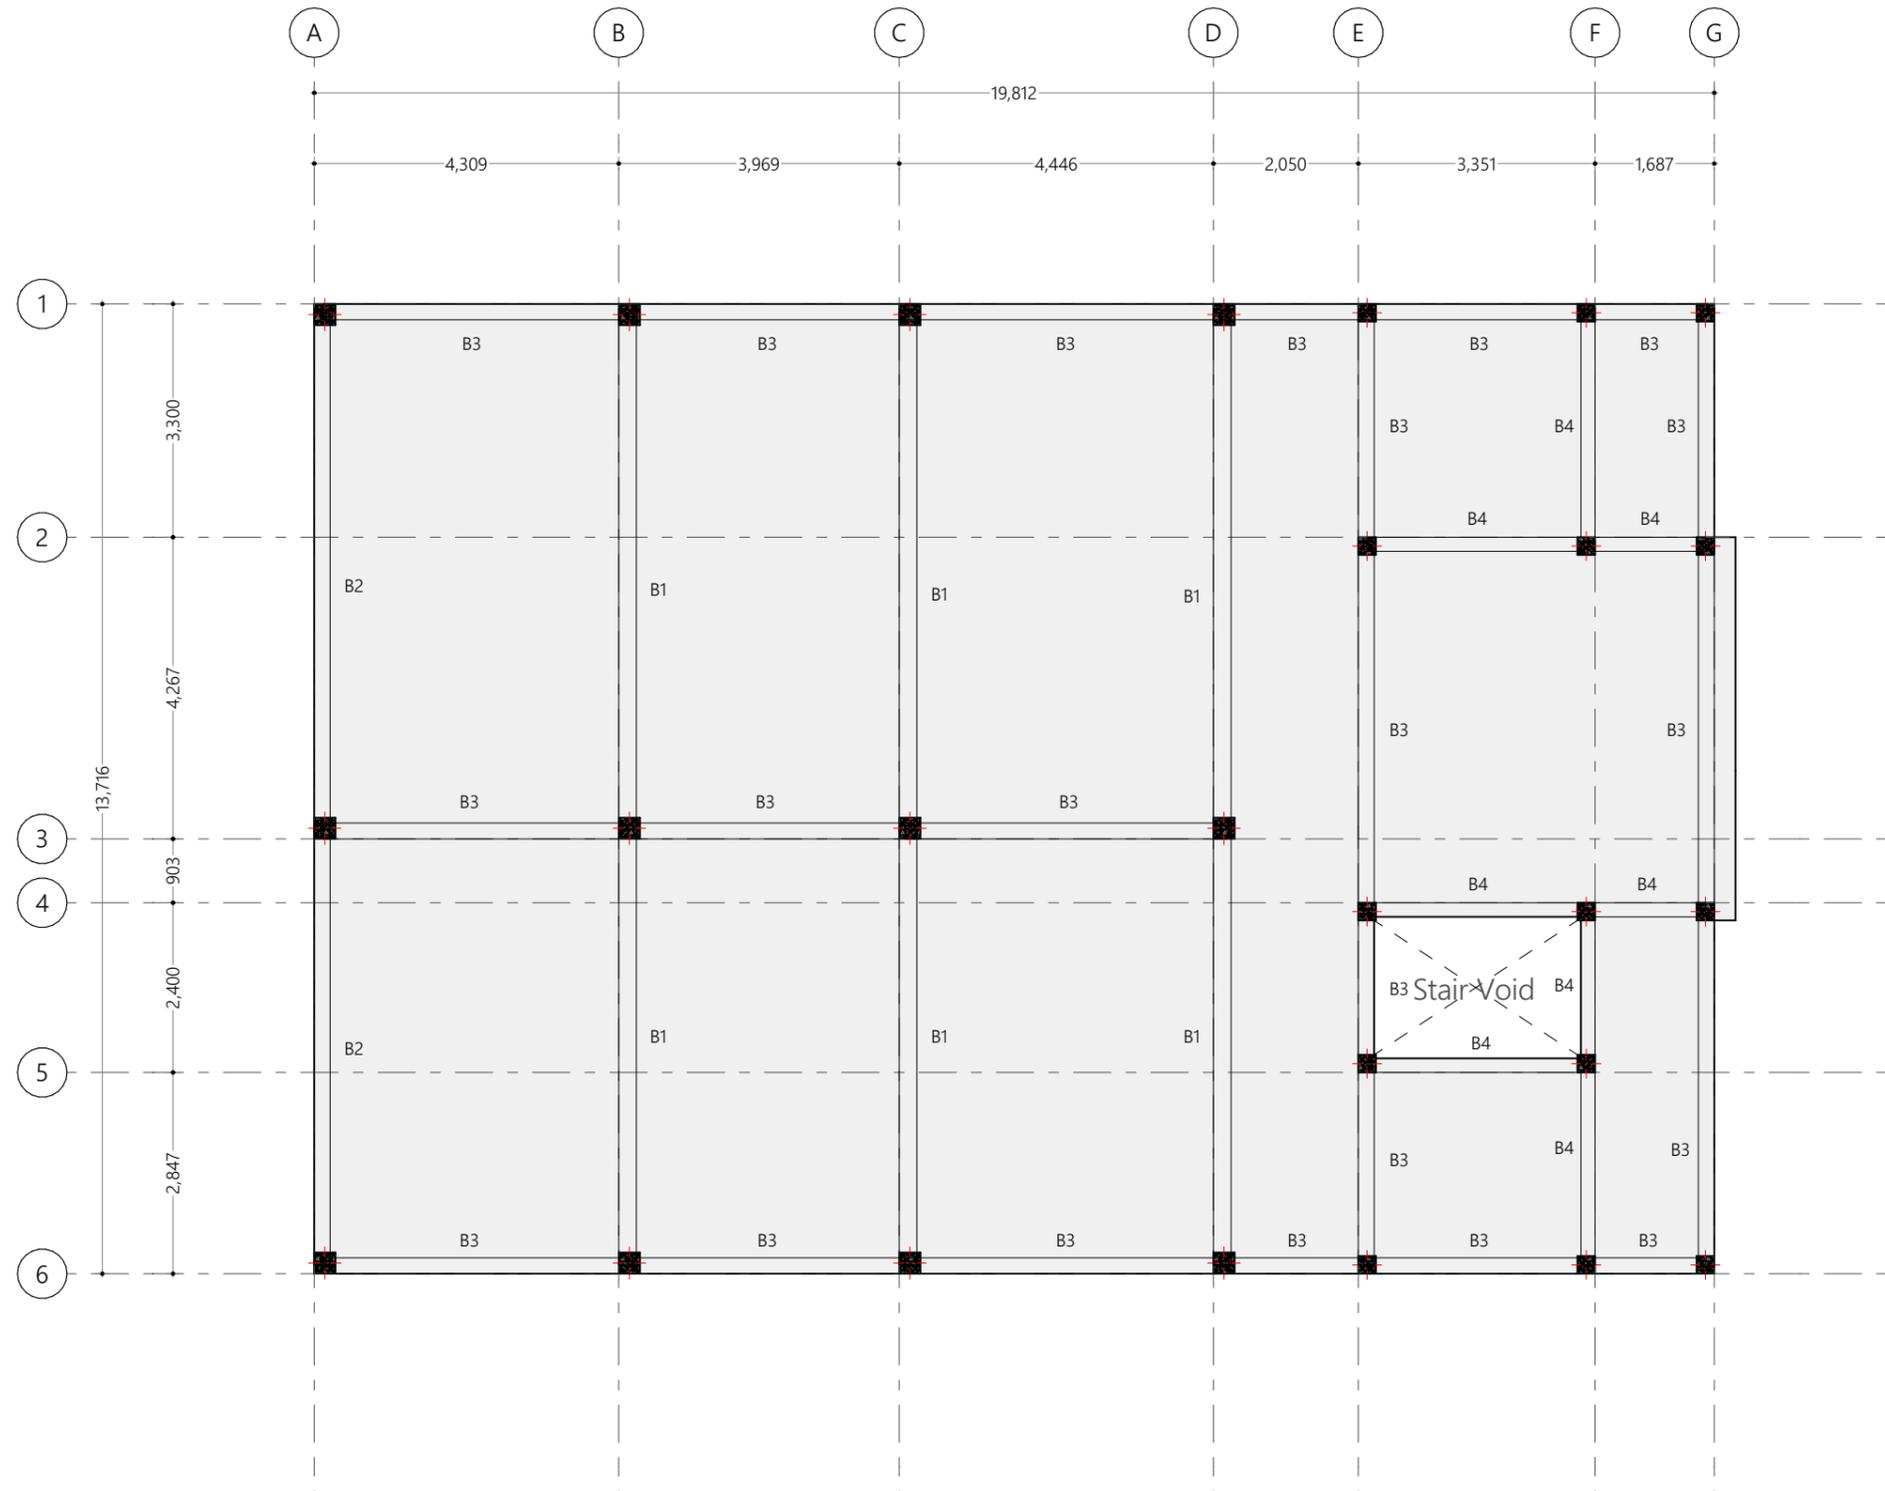

Terrace Beam Plan
1:100

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
Terrace Floor Beam Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : **Pg :** B.2.02

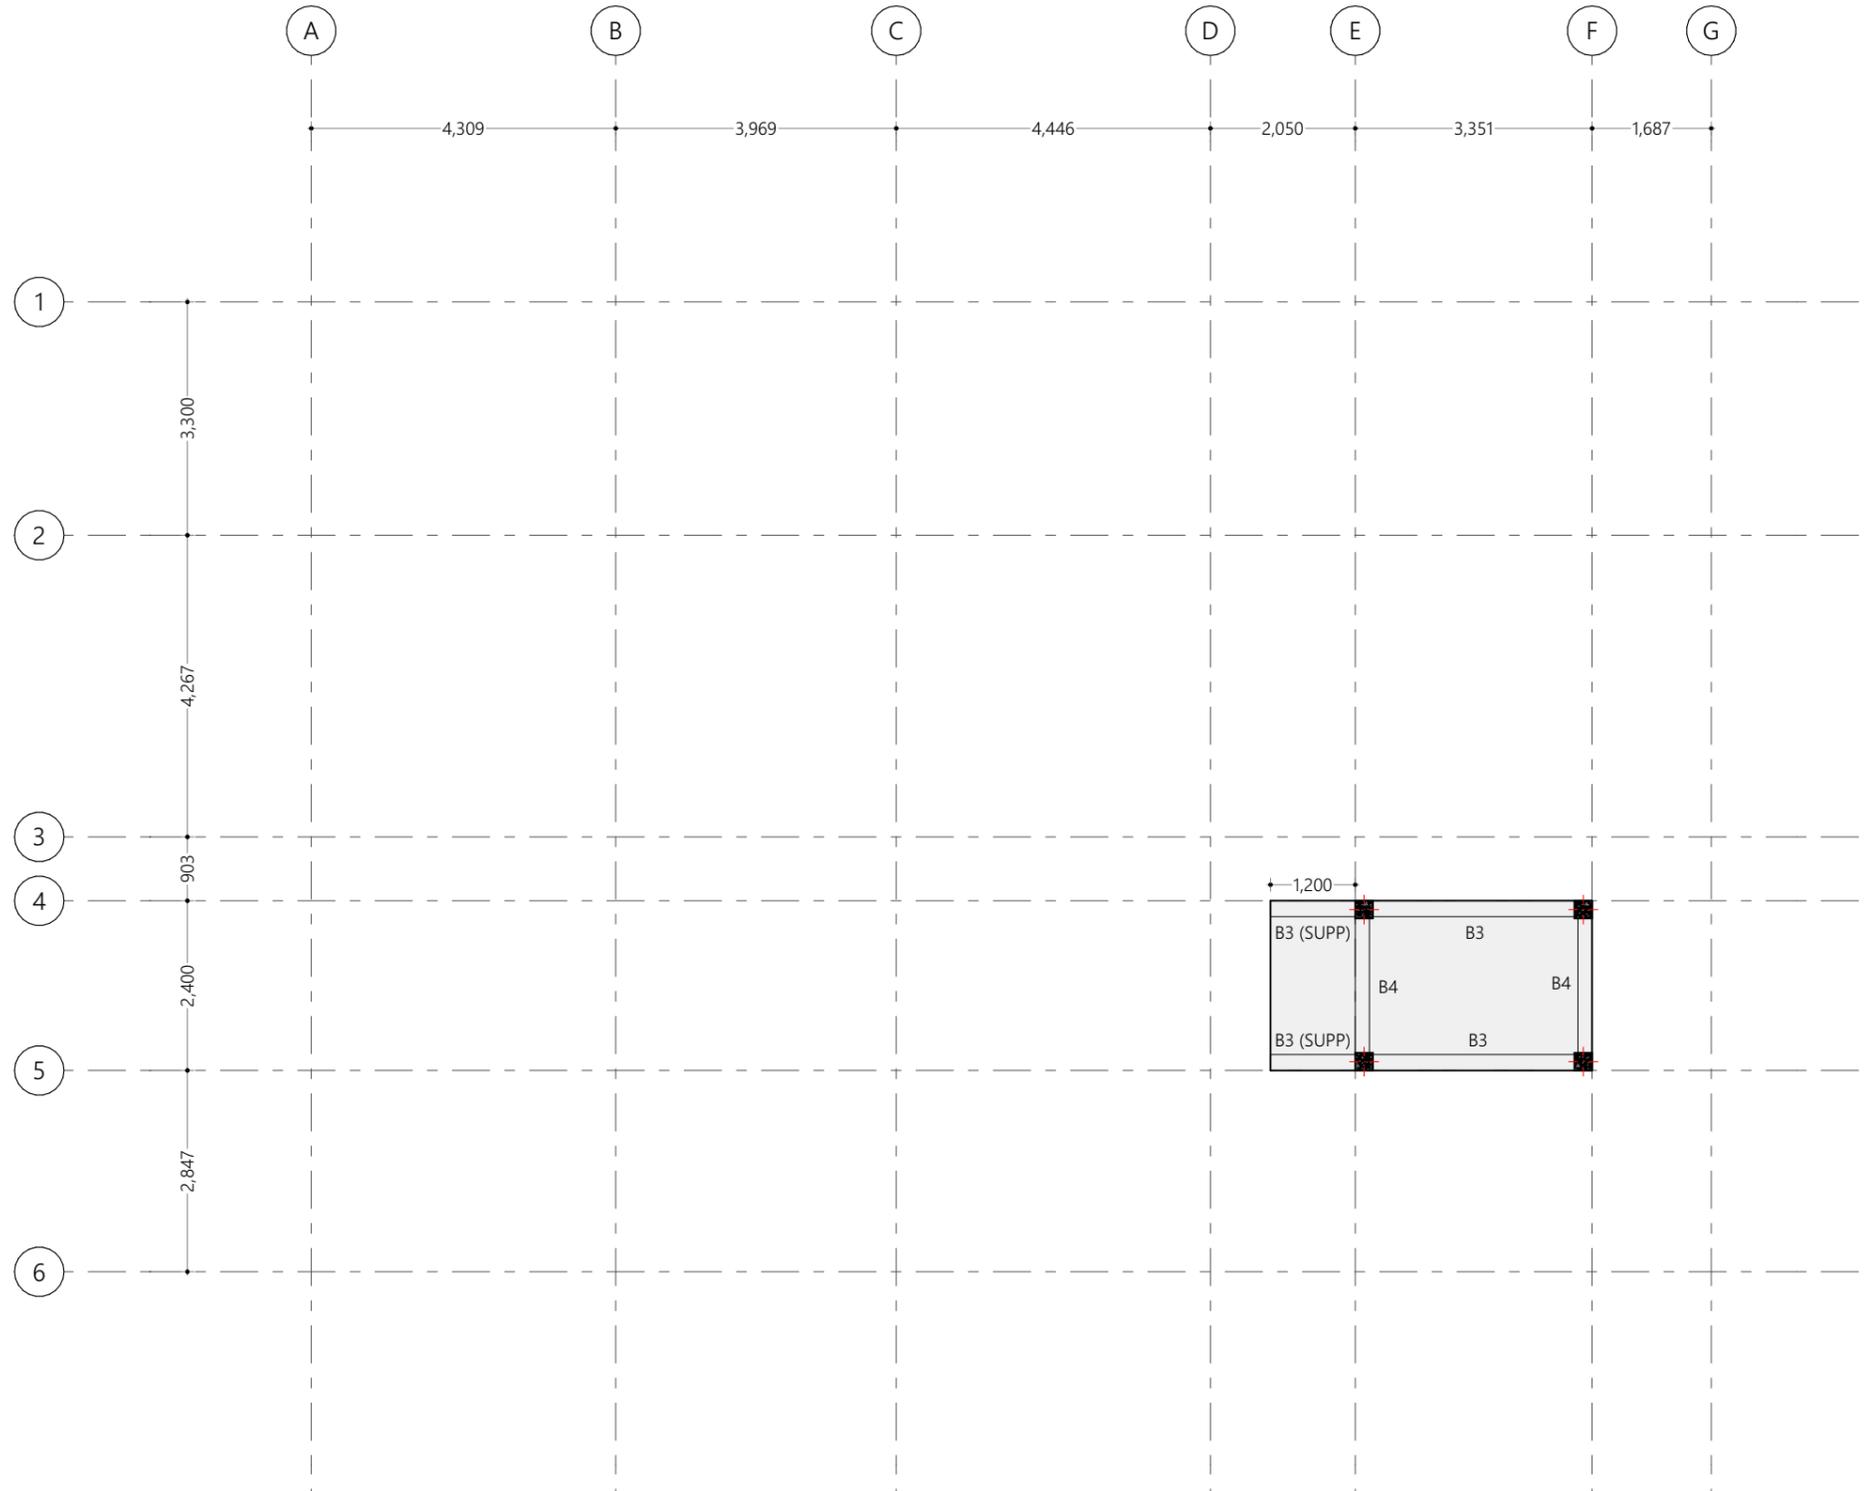

f
Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

f
Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Roof Beam Plan


Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** B.2.03

Roof Beam Plan
1:100

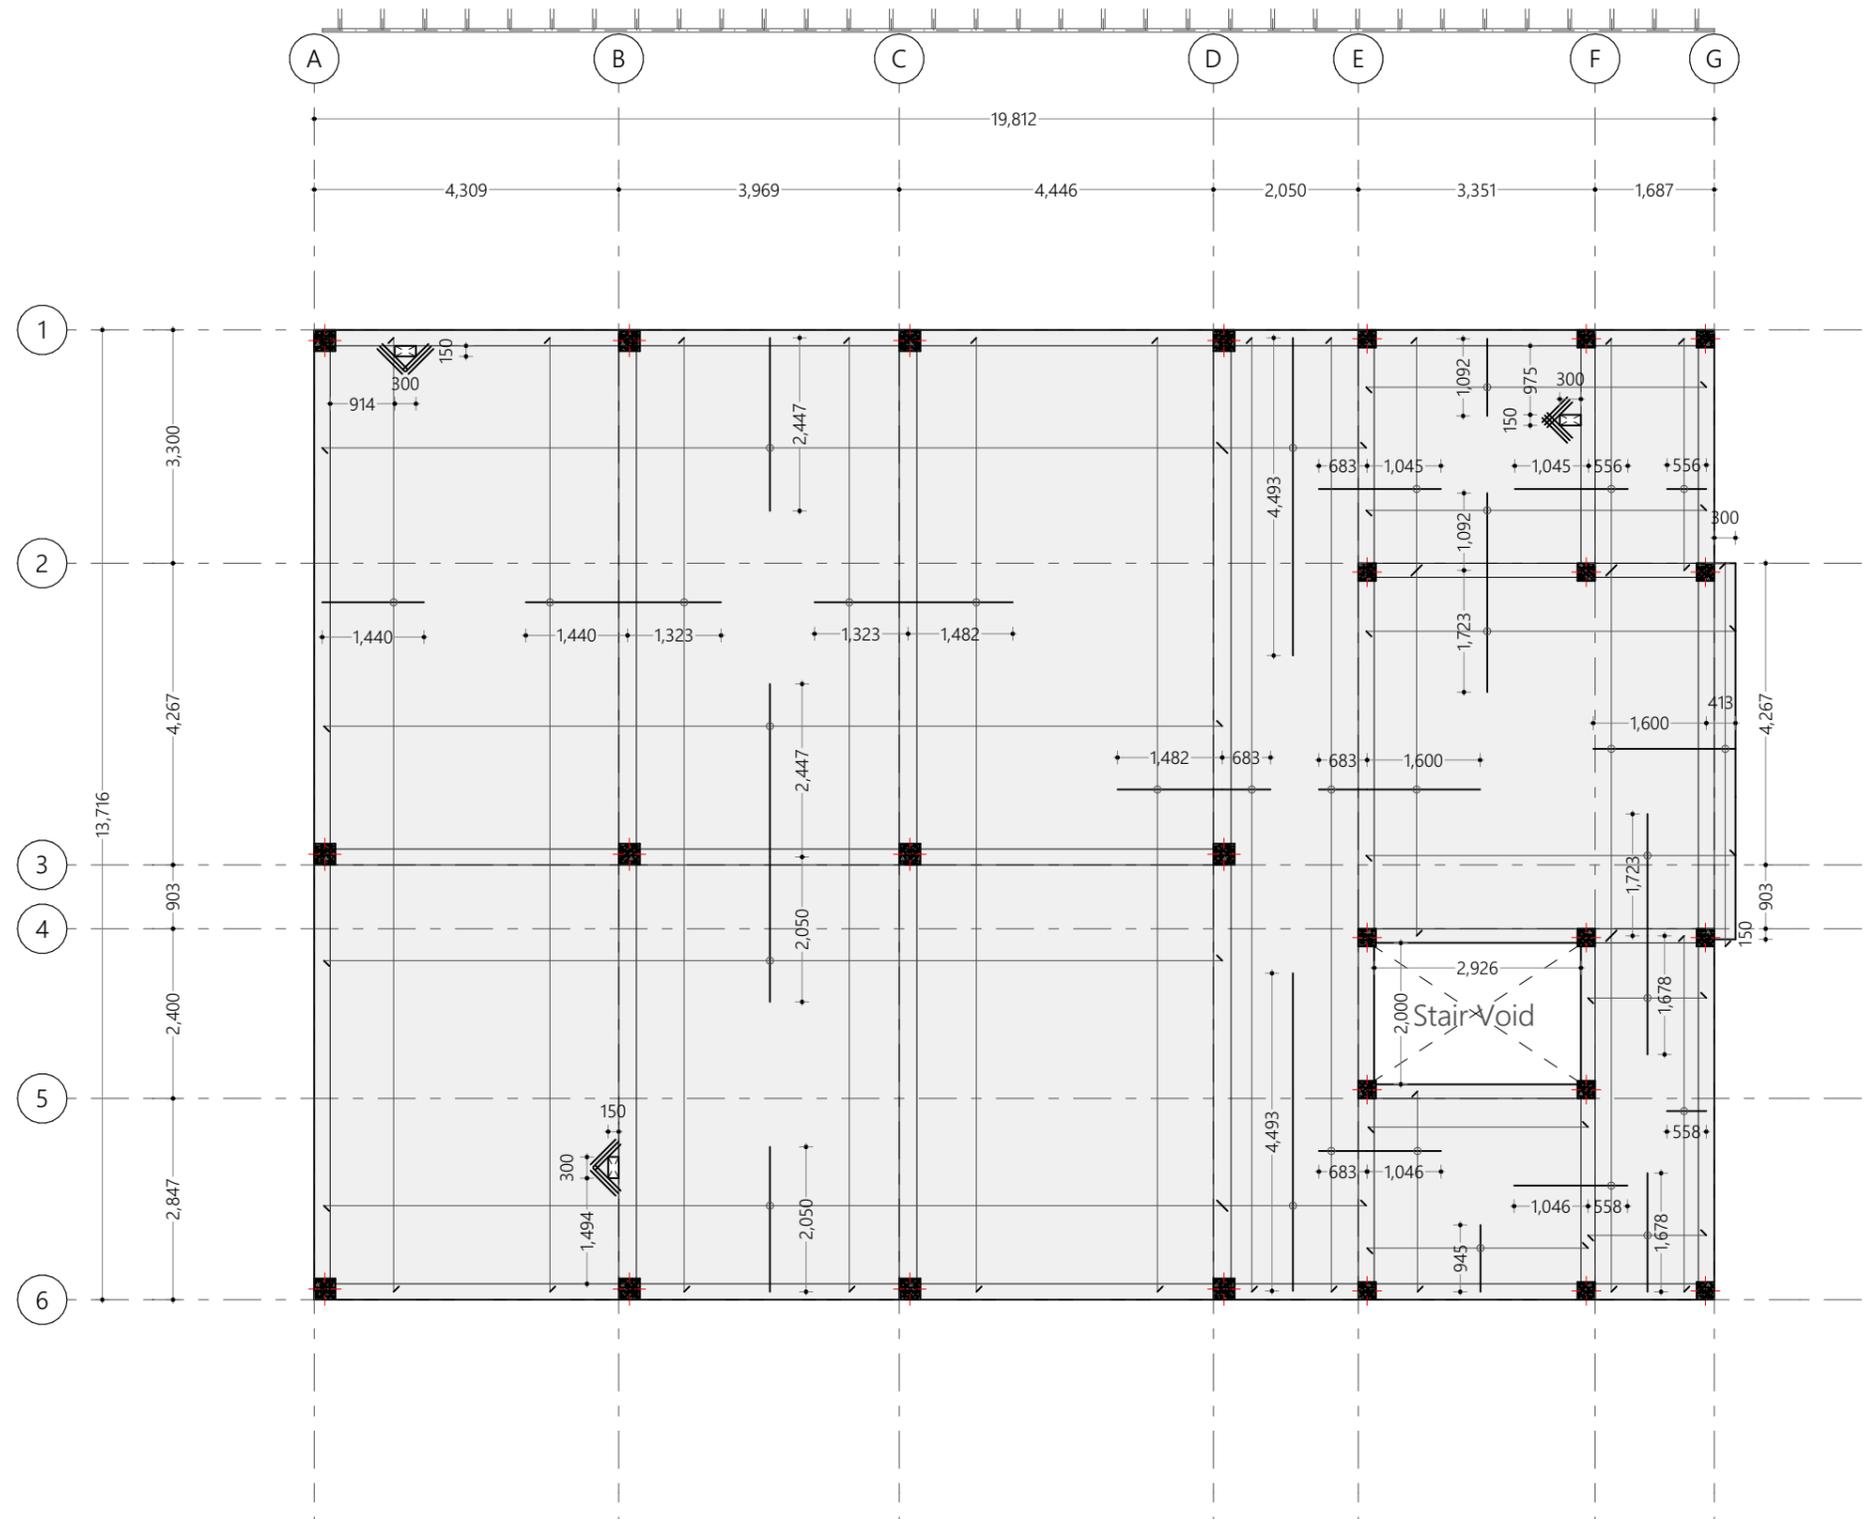

Notes:

■ Slab thickness: 160mm

- Bottom Reinforcement - T10@150 C/C B/W (not shown)
- Top Reinf. - T10@150C/C (as shown, unless stated)
- Top Dist. Steel - T10@150 C/C (not shown)
- Corner Bars - 3T10@45C/C T&B as shown
- Reinforcement discontinuous at voids
- Provide 30mm cover

First Floor Slab Reinforcement Plan
1:100

f
Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

f
Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
First Floor Slab Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** B.3.1

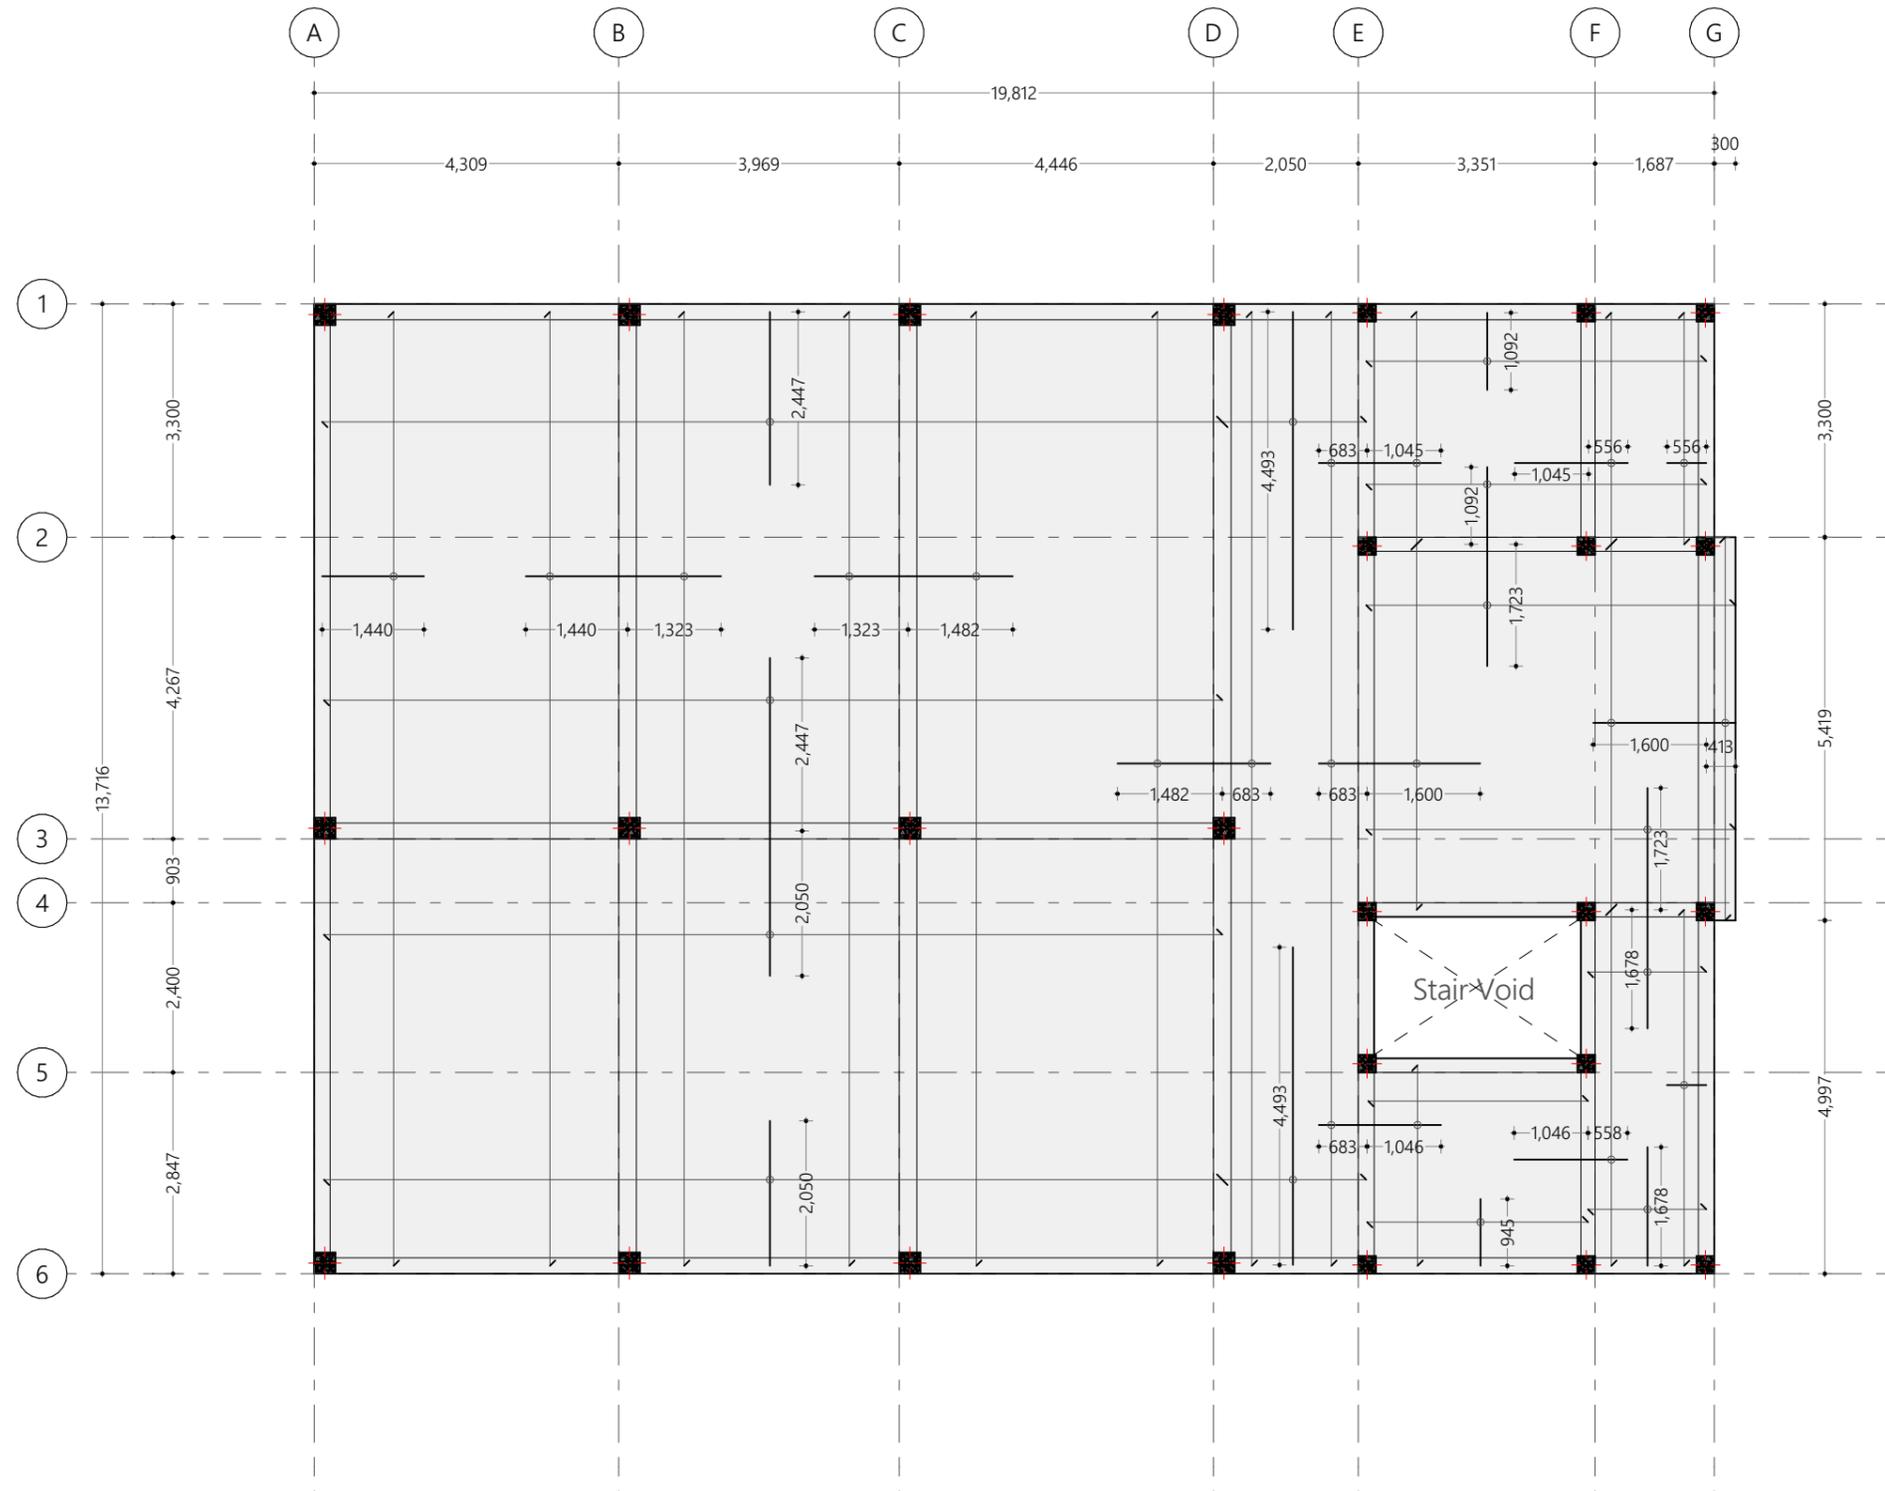

Terrace Floor Slab Reinforcement Plan
1:100

Notes:

- Slab thickness: 160mm
- Bottom Reinforcement - T10@150 C/C B/W (not shown)
- Top Reinf. - T10@150C/C (as shown, unless stated)
- Top Dist. Steel - T10@150 C/C (not shown)
- Corner Bars - 3T10@45C/C T&B as shown
- Reinforcement discontinuous at voids
- Provide 30mm cover

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-060-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A:G.Rosany West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
Terrace Floor Slab Plan

Scale : 1:100

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : | **Pg :** B.3.2

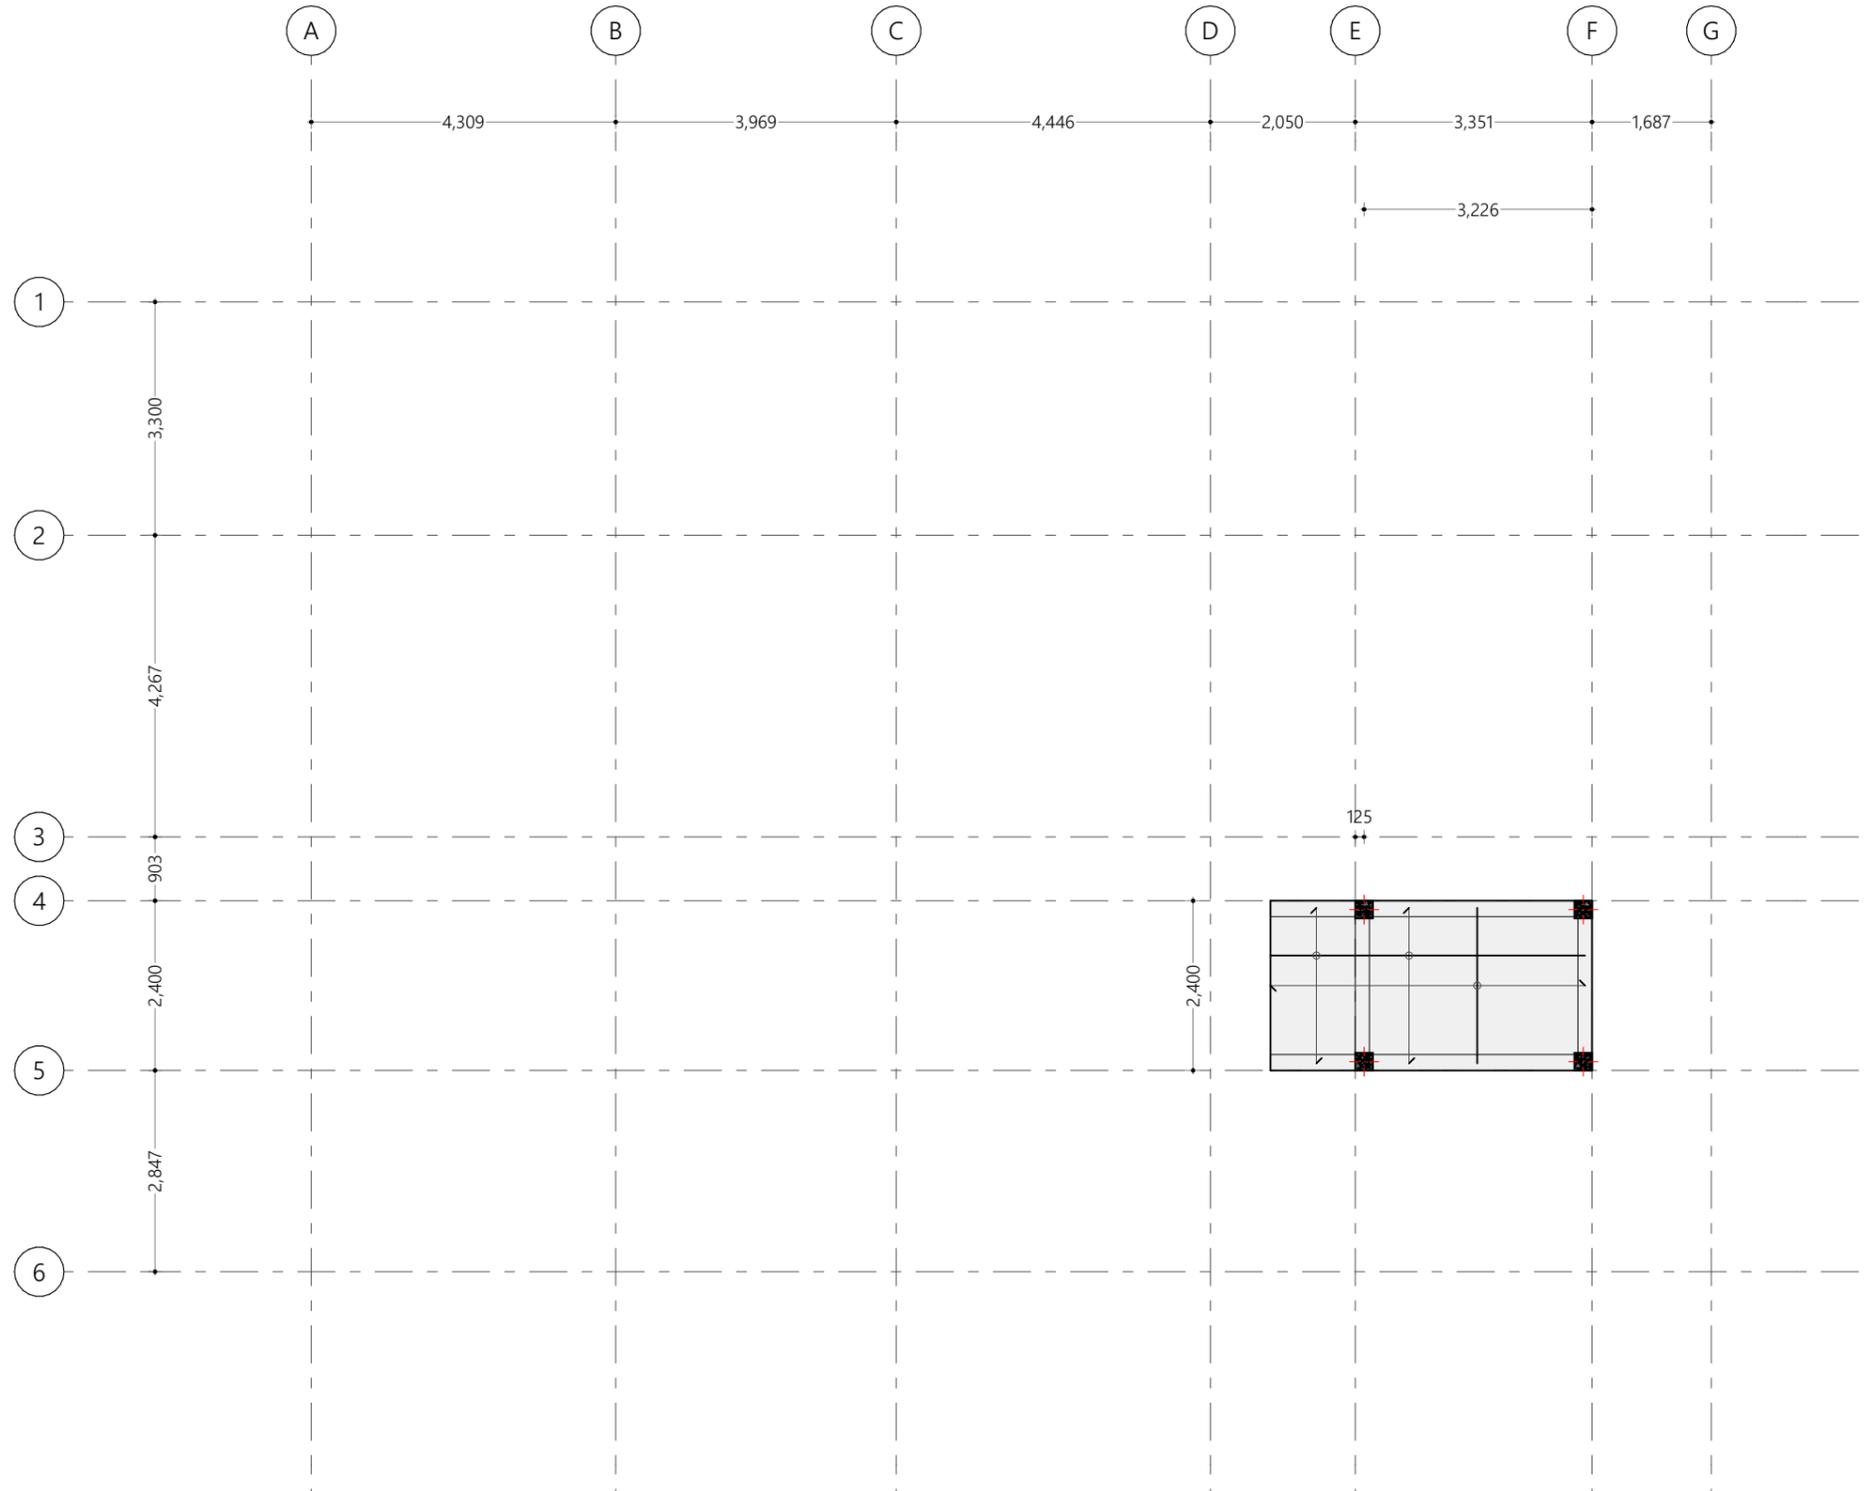

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project :
 HDh. Nellaidhoo Health Centre Portico And Extension

Client :
 Kulhudhufushi Regional Hospital

Prepared by

EPOCH

T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A.G.Rosary West, 3rd
 Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
 Roof Slab Plan

Scale : 1:100


Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023


Rev No : | **Pg :** B.3.3

- Notes:**
- Slab thickness: 160mm
 - Bottom Reinforcement - T10@150 C/C B/W (not shown)
 - Top Reinf. - T10@150C/C (as shown, unless stated)
 - Top Dist. Steel - T10@150 C/C (not shown)
 - Corner Bars - 3T10@45C/C T&B as shown
 - Reinforcement discontinuous at voids
 - Provide 30mm cover


Roof Slab Reinforcement Plan
 1:100

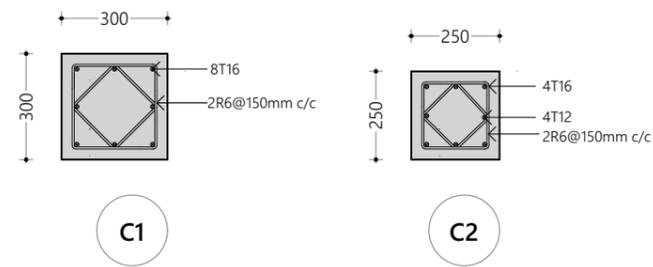


Column Detail
1:20

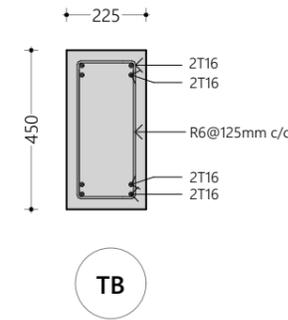

Tie Beam Details
1:20

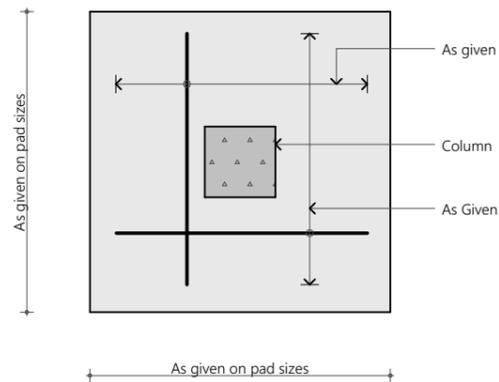

Plan View

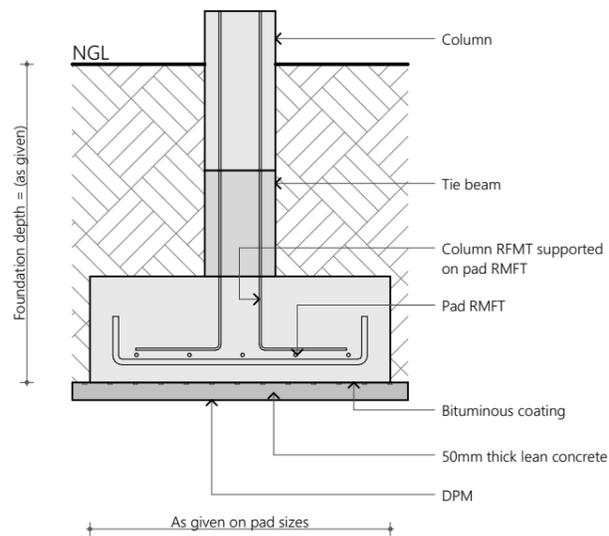

Sectional View

Typical Footing Detail
1:20

Foundation Details:


	Dimensions	Reinforcement
F1	2400x2400x400	T12@100C/C B/W (B)
F2	1800x1800x400	T12@150C/C B/W (B)
F3	1650x1650x400	T12@150C/C B/W (B)
F4	1400x1400x400	T10@150C/C B/W (B)
F5	1050x1050x400	T10@150C/C B/W (B)

Foundation Depth = 1200mm
Ground Slab = 100mm thick RC slab on fill reinforced with T10@200C/C (B/W)

All Footings are to be laid on top of 50mm thick lean concrete
Apply waterproofing to all substructure (below ground elements)
All below ground & terrace concrete works shall be done using waterproofing admixtures

Notes:

- Cover to foundations = 55mm
- Cover to floor slabs = 30mm
- Cover to floor beams = 35mm
- Cover to columns = 40mm
- Laps = 45Dia (Dia=Bar Diameter)
- Mid bars = 0.85 x Span
- Sup bars = 1/3 x Span
- Concrete mix = 1:2:3 (C:S:A)
- Lean concrete mix = 1:2:5

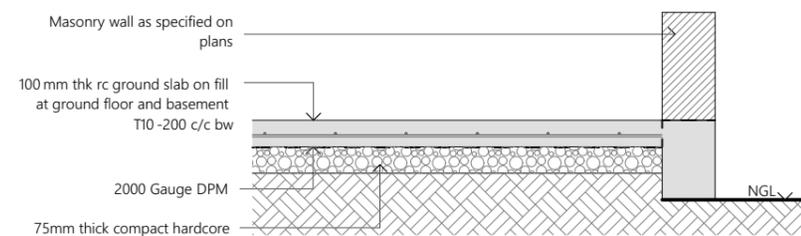

Note :

All cover blocks shall be casted using grade C 25 / 30 concrete with 5-10 mm aggregates

For slab, rebar spacer chairs spacing shall be minimum 1m spacing or 1 no. per 1 sqm

Typical Ground Slab Construction Detail
1:20

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
Accredited No: BPR2022050B1 B1-2022-060-001

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project: Wajidullaheedoo Health Centre Portico And Extension

Client : Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates.
W: www.epochassociates, A.G.Rosary West, 3rd Floor, Husnuheena Magu, Male', Maldives

DESIGNER:	CHECKED:
Muaviyath A. Sathar	F. Ihudha Amir
DRAWN:	APPROVED:
Mohamed Hassaan	Ihsaan Waheed


Page Title
Structural Details 01

Scale : 1:20, 1:100


Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023


Rev No : | **Pg :** C.1.1

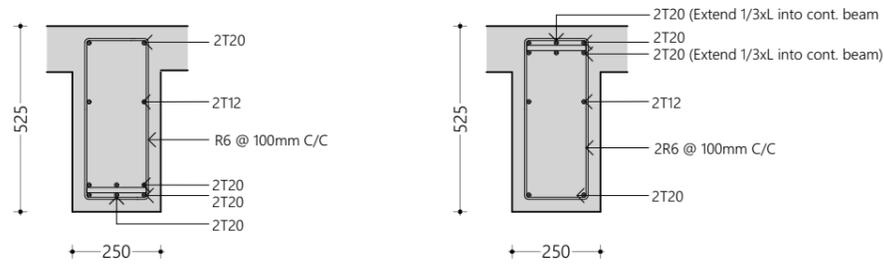


Mid Span **B1** Support

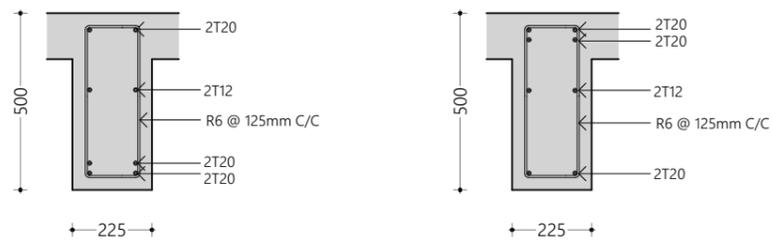

Mid Span **B2** Support

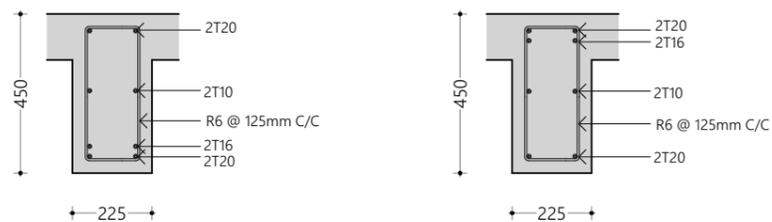

Mid Span **B3** Support

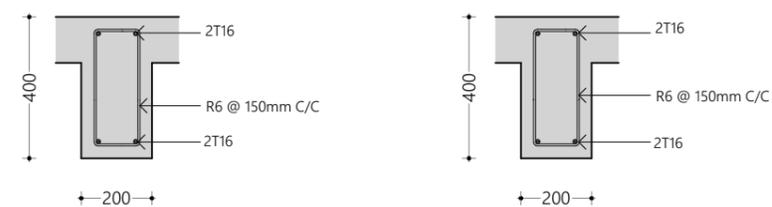

Mid Span **B4** Support

Beam Details
1:20

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-060-001

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

#	REVISION	BY	APP	DATE

Project: **Wajidellaidhoo Health Centre Portico And Extension**

Client :
Kulhudhufushi Regional Hospital

Prepared by
EPOCH

T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A:G.Rosany West, 3rd
 Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassaan	APPROVED: Ihsaan Waheed

Page Title
Structural Details 02

Scale : 1:20

Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : Pg : C.1.2

f

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
Accredited No: BPR2022050B1 B1-2022-050-001


f

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
Accredited No: BPR2022021A1 A1-2022-021-001

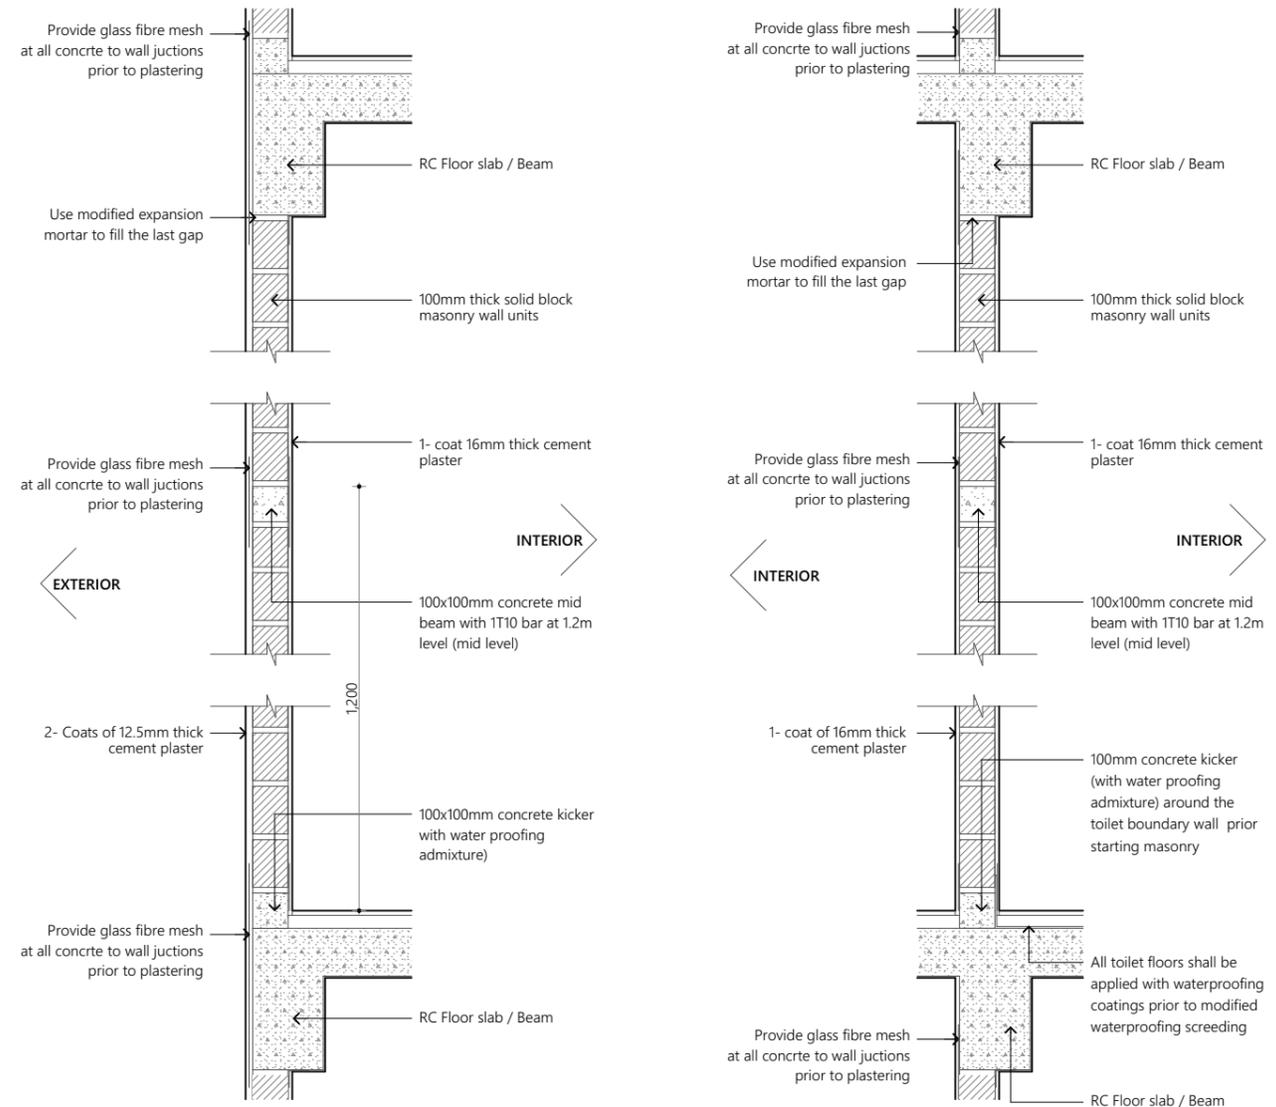

Note:

- * Concrete surfaces shall be thoroughly cleaned with water & applied with mastercast 141 or equivalent bonding mortar prior to plastering.
- * Plastering mortar mix shall be 1:4 (cement: sand) ratio.
- * Plaster mix shall be modified using fibre wool & mastercast 141 or equivalent plasticisers as per manufacturer's specification.
- * Height of placing blocks shall be maximum 1.2m per day.
- * After initial coat of plastering, water curing shall be provided for minimum 3 days & after final coat water curing shall be provided for 7 days.

Typical Wall Construction Detail
1:20

#	REVISION	BY	APP	DATE

Project: Haidhoo Health Centre Portico And Extension

Client: Kulhudhufushi Regional Hospital

Prepared by:



T: +960 333 3528, E: info@epochassociates.
W: www.epochassociates, A.G.Rosary West, 3rd Floor, Husnuheena Magu, Male', Maldives

DESIGNER:	CHECKED:
Muaviyath A. Sathar	F. Ihudha Amir
DRAWN:	APPROVED:
Mohamed Hassaan	Ihsaan Waheed

Page Title: Typical Wall Construction Detail

Scale: 1:20

Doc No: EP/BLD-AR/2022/08/ST-104



Date: Thursday, August 24, 2023

Rev No: | **Pg:** C.2.1



Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001


Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

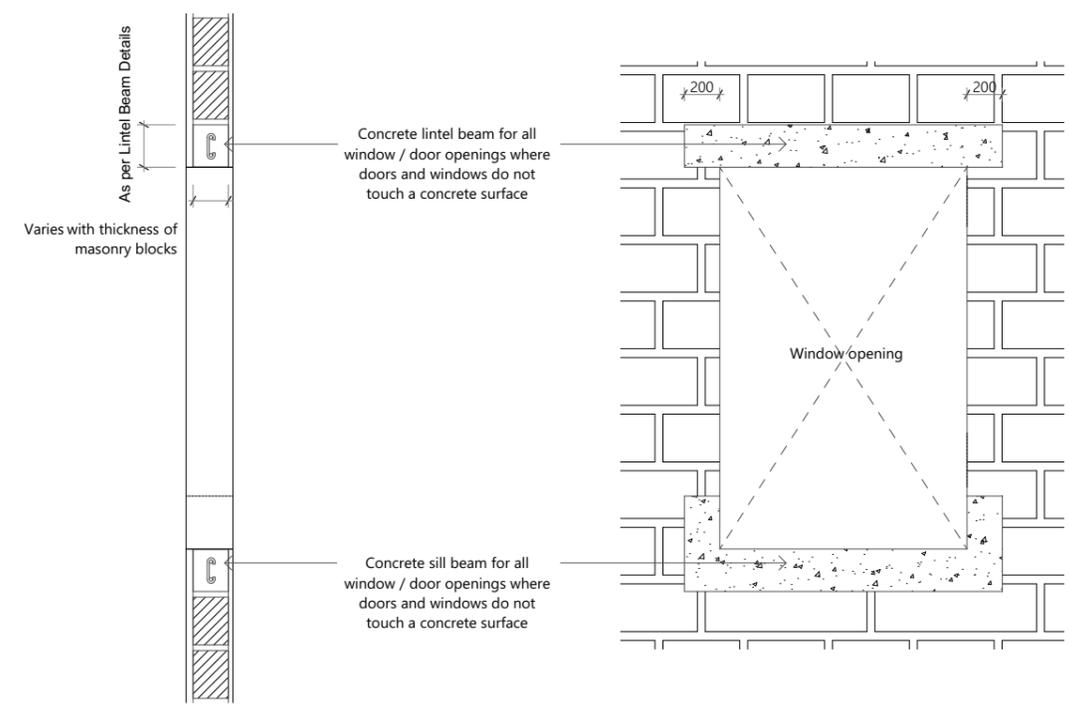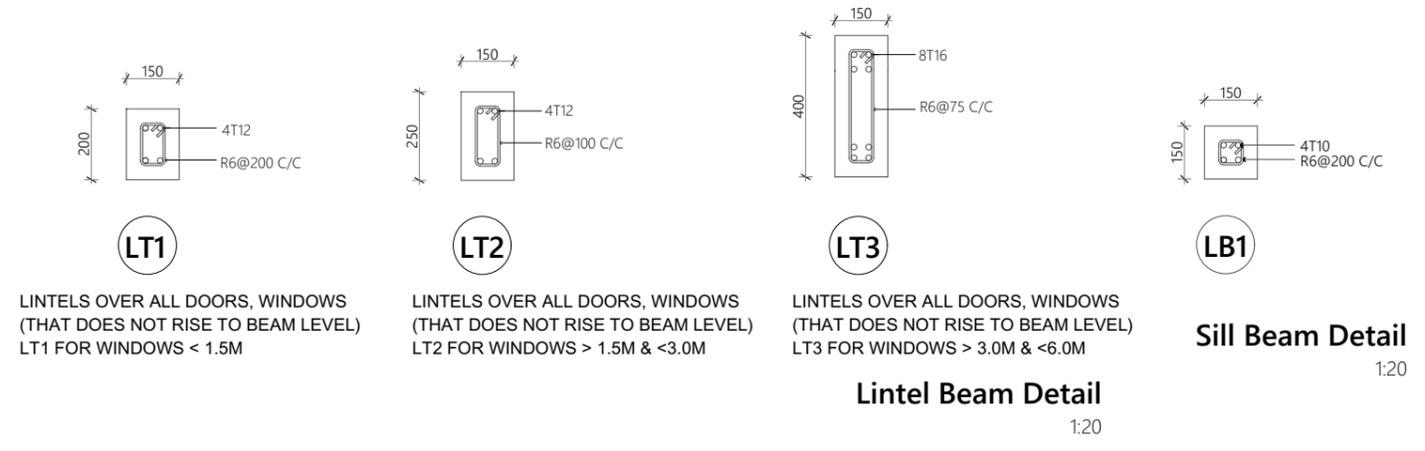

#	REVISION	BY	APP	DATE

Project: Wajidellaidhoo Health Centre Portico And Extension

Client: Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
 W: www.epochassociates, A.G.Rosary West, 3rd
 Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: F. Ihudha Amir
DRAWN: Mohamed Hassaan	APPROVED: Ihsaan Waheed

Page Title
Typical Window Construction Detail

Scale : 1:20

Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : | **Pg** : C.2.2

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22- 22.09.23

Accredited No: BPR2022050B1 B1-2022-060-001


Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER


STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23


Accredited No: BPR2022021A1 A1-2022-021-001

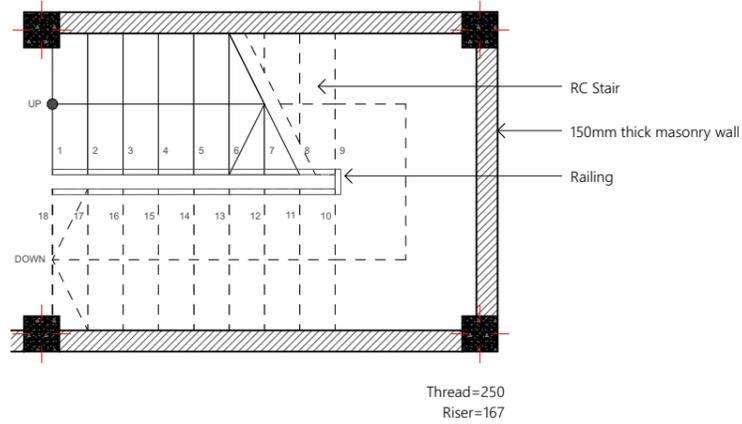

Stair Railing Detail - Plan
1:50

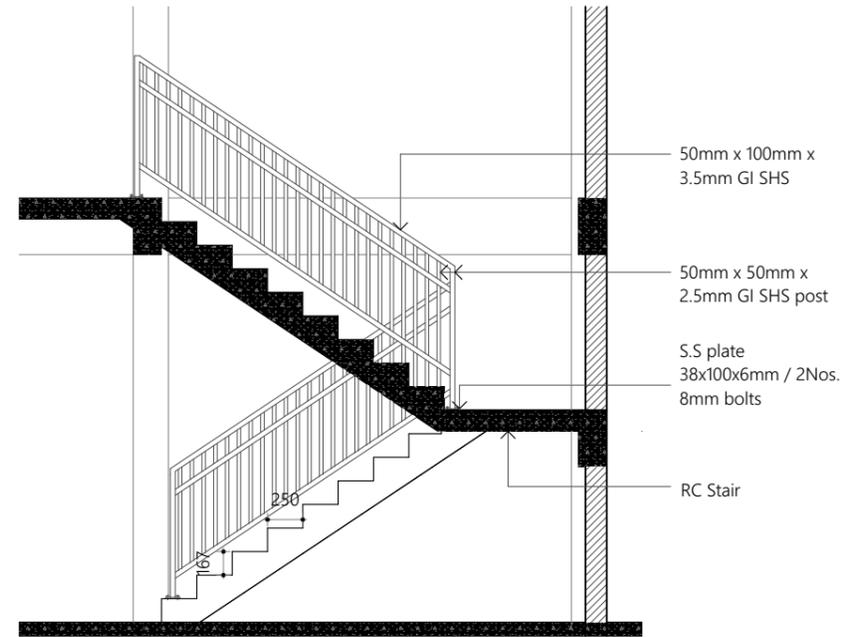

Stair Railing Detail - Section
1:50

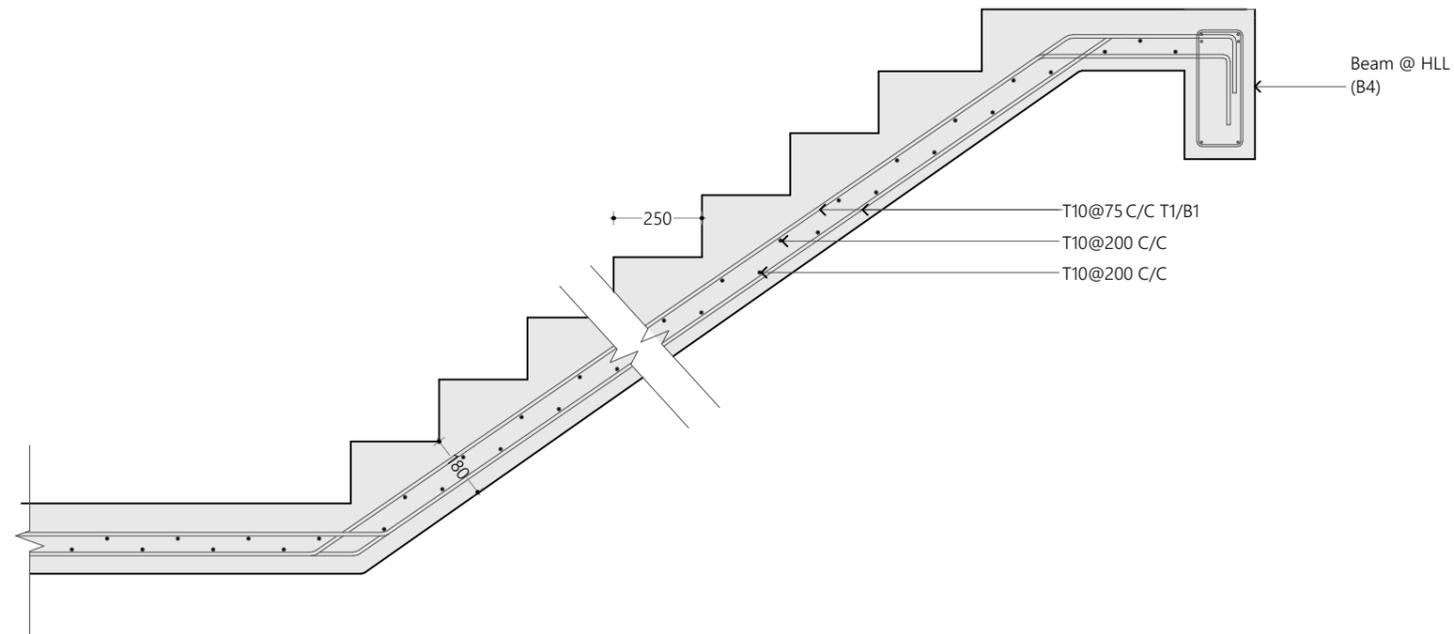

Staircase Reinforcement Detail
1:20

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Male', Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassaan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Stair Detail

Scale : 1:20, 1:50

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : Pg : C.2.3



Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23

 Accredited No: BPR2022050B1 B1-2022-050-001




Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER


STRUCTURAL CHECKER A1

 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23


 Accredited No: BPR2022021A1 A1-2022-021-001

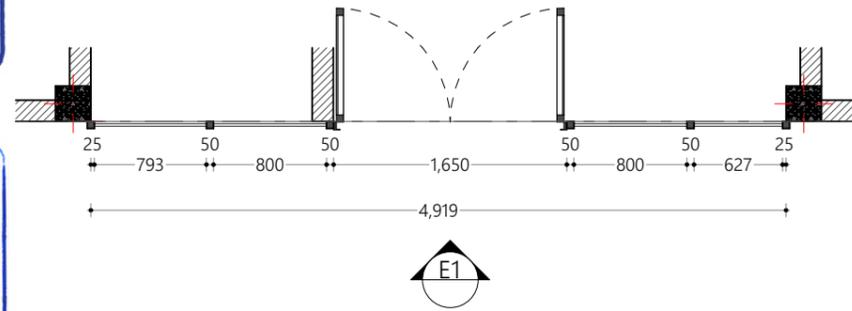


Curtain Wall CW1 Detail - Plan
1:50

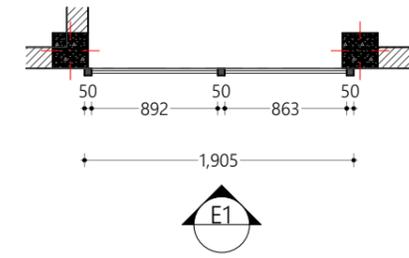

Curtain Wall CW2 Detail - Plan
1:50

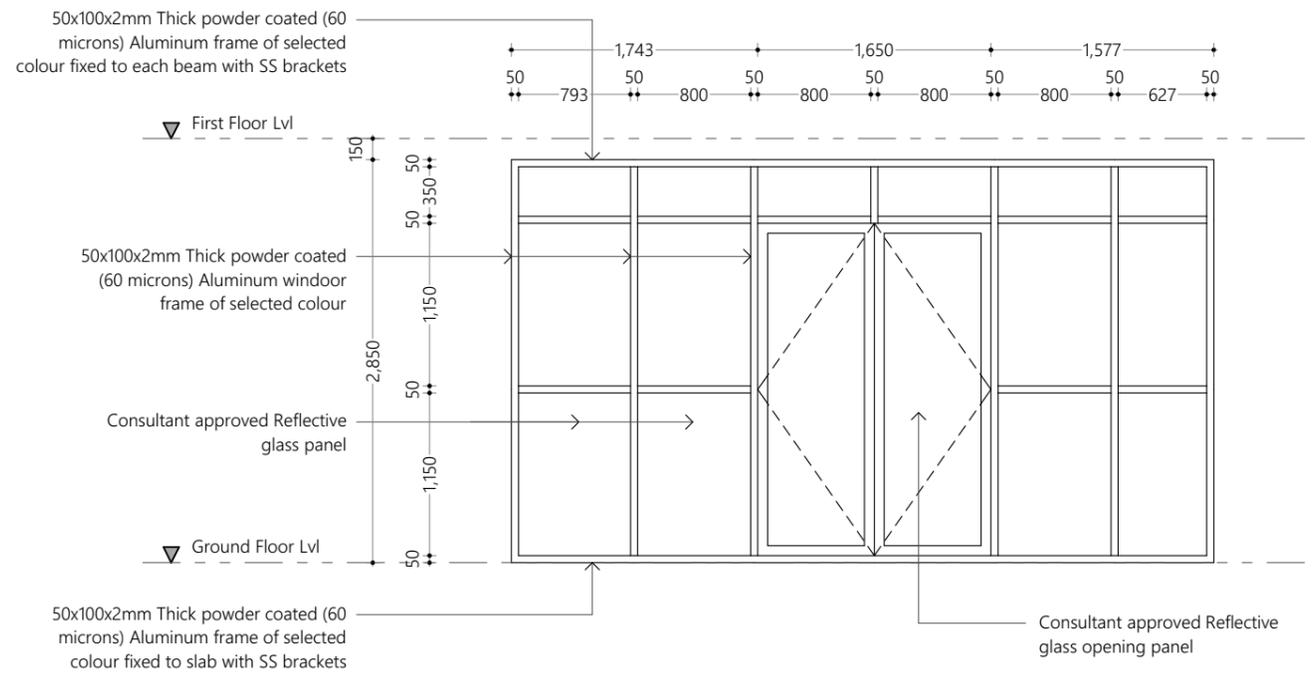

Curtain Wall CW1 Detail - Elevation E1
1:50

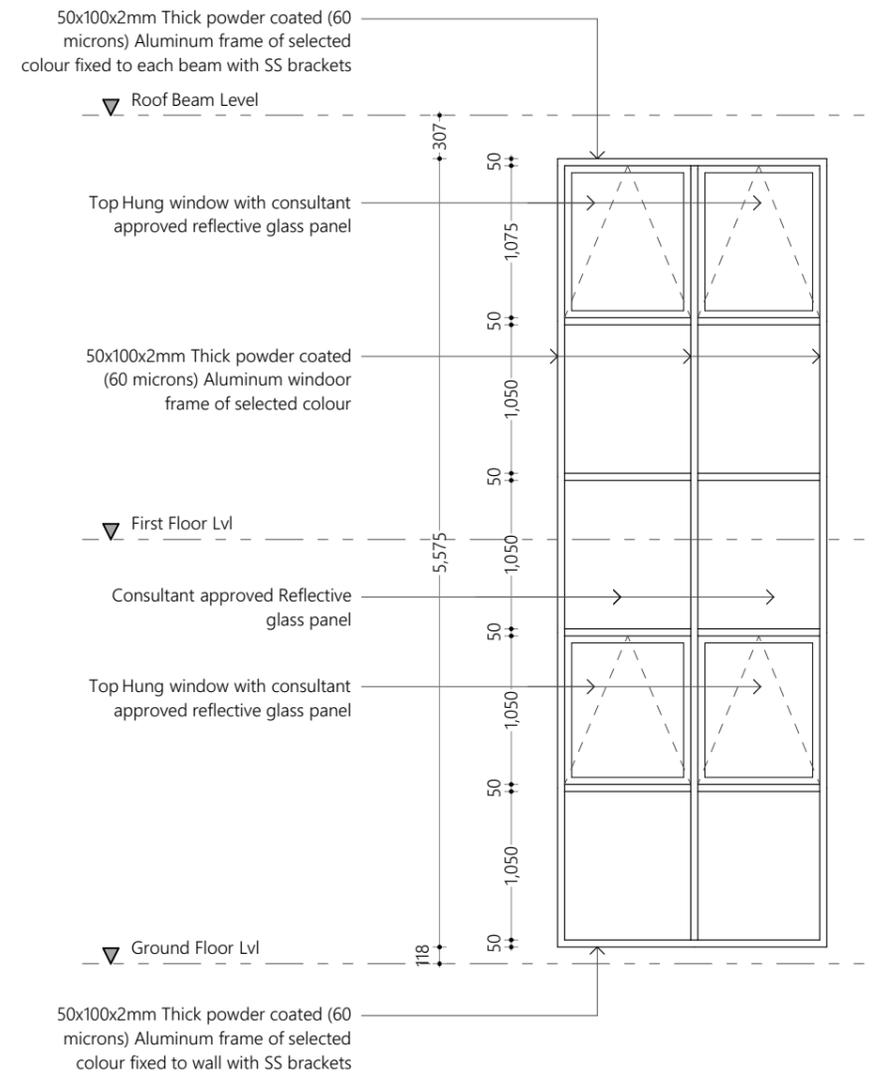

Curtain Wall CW2 Detail - Elevation E1
1:50

#	REVISION	BY	APP	DATE

Project: Haidhoo Health Centre Portico And Extension

Client: Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates.
W: www.epochassociates, A.G.Rosary West, 3rd Floor, Husnuheena Magu, Malé, Maldives

DESIGNER:	CHECKED:
Muaviyath A. Sathar	F. Ihudha Amir
DRAWN:	APPROVED:
Mohamed Hassaan	Ihsaan Waheed

Page Title
Curtain Wall Detail 1

Scale : 1:50

Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : Pg : C.2.4


Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23

Accredited No: BPR2022050B1 B1-2022-050-001

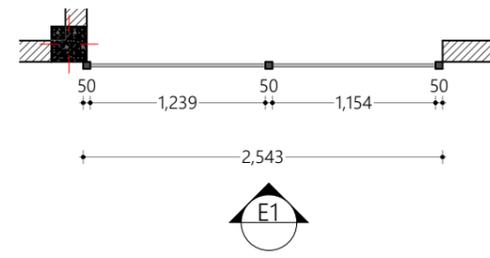

Curtain Wall CW3 Detail - Plan 1:50


Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER


STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23


Accredited No: BPR2022021A1 A1-2022-021-001

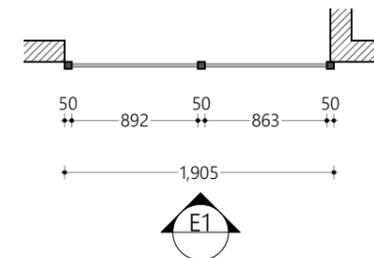

Curtain Wall CW4 Detail - Plan 1:50

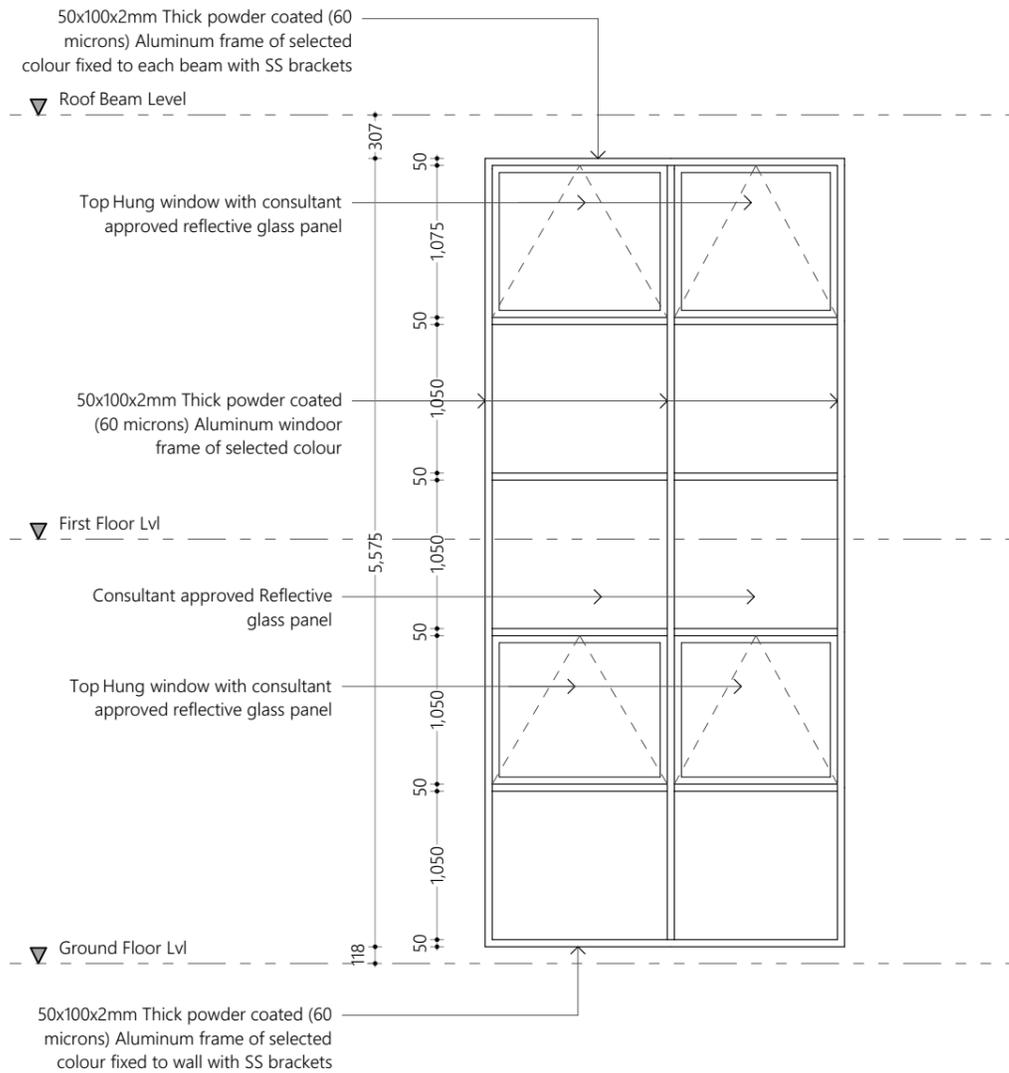

Curtain Wall CW3 Detail - Elevation E1 1:50

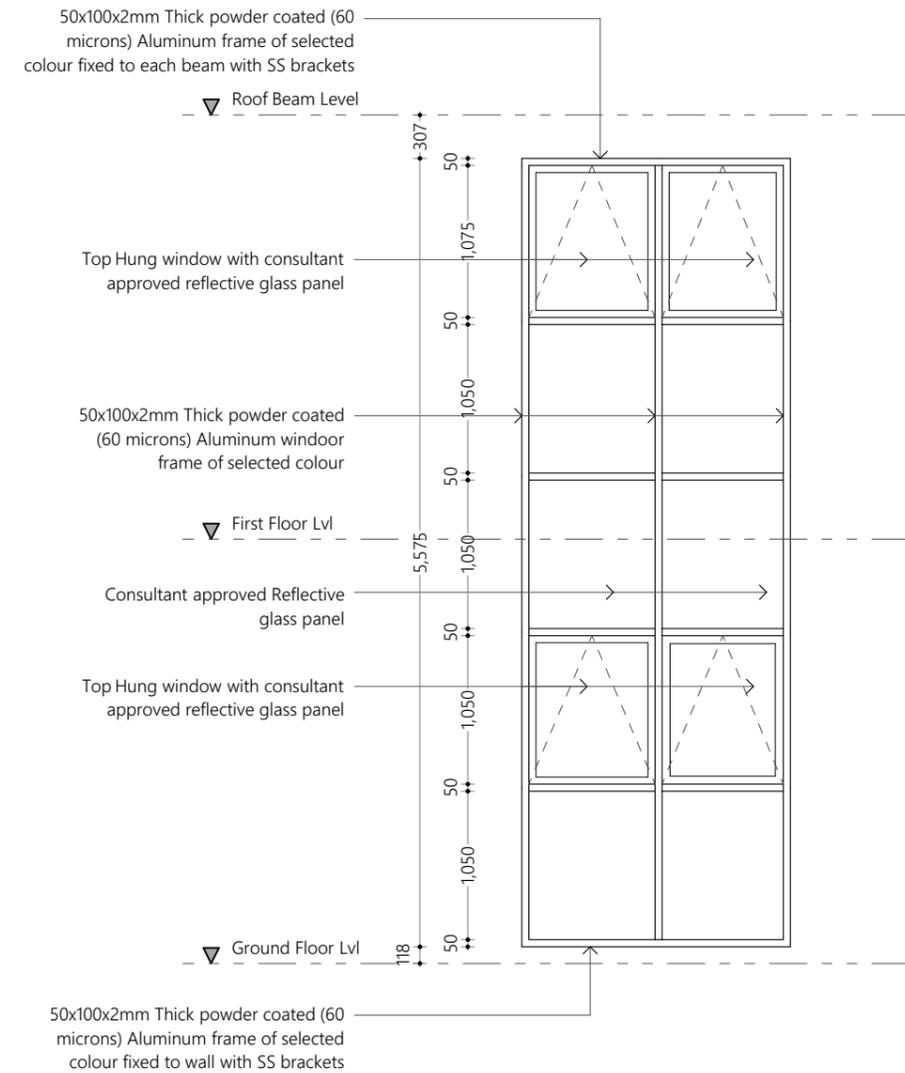

Curtain Wall CW4 Detail - Elevation E1 1:50

#	REVISION	BY	APP	DATE

Project: **Kulhudhufushi Health Centre Portico And Extension**

Client: **Kulhudhufushi Regional Hospital**

Prepared by



T: +960 333 3528, E: info@epochassociates.
W: www.epochassociates, A:G.Rosany West, 3rd Floor, Husnuheena Magu, Malé, Maldives

DESIGNER	CHECKED
Muaviyath A. Sathar	F. Ihudha Amir
DRAWN	APPROVED
Mohamed Hassaan	Ihsaan Waheed

Page Title
Curtain Wall Detail 2

Scale : 1:50

Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : Pg : C.2.5

Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER

ARCHITECTURAL CHECKER B1

Name: Fathmath Ihudha Amir VALIDITY: 17.03.22- 22.09.23

Accredited No: BPR2022050B1 B1-2022-050-001


Ministry of National Planning, Housing & Infrastructure

ACCREDITED CHECKER


STRUCTURAL CHECKER A1

Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23

Accredited No: BPR2022021A1 A1-2022-021-001

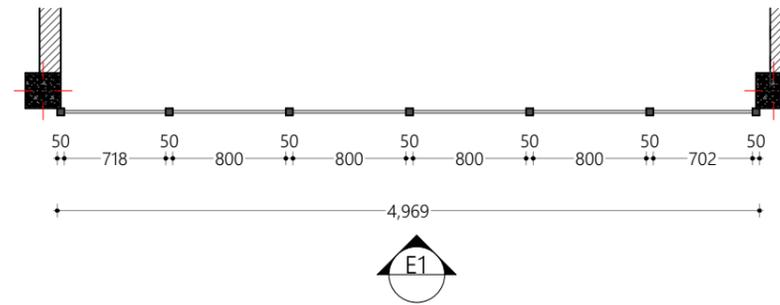

Curtain Wall CW5 Detail - Plan
1:50

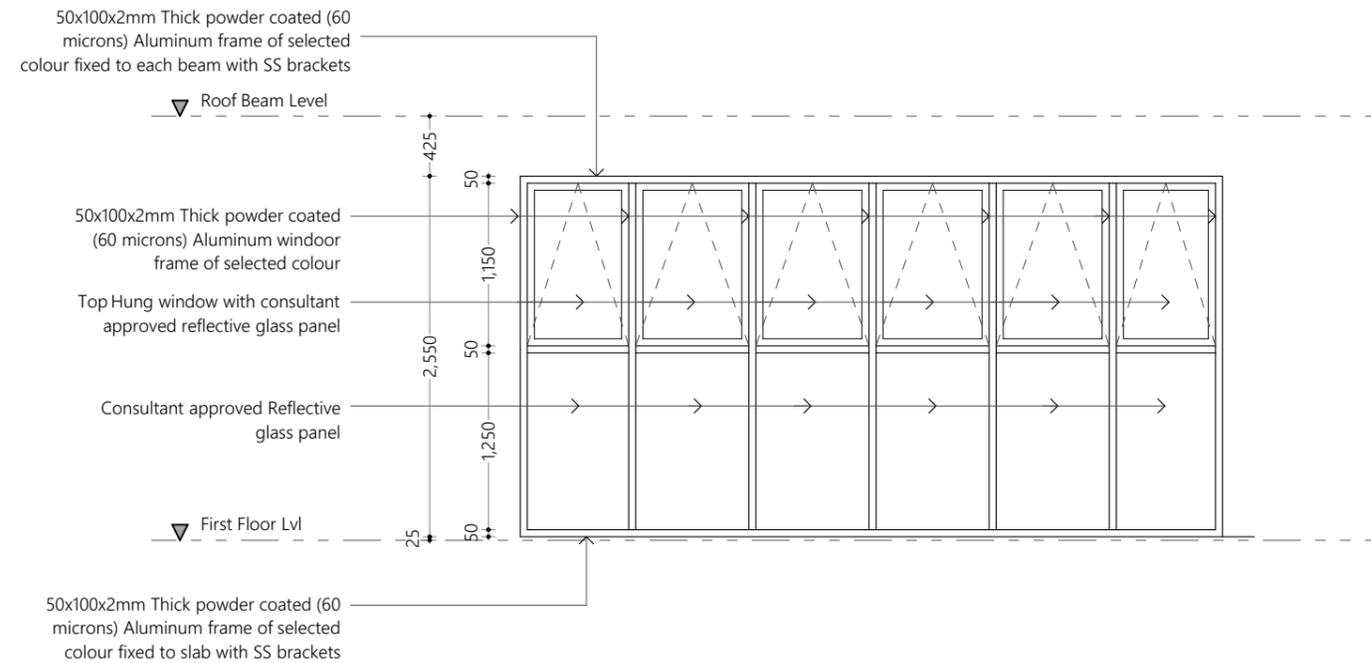

Curtain Wall CW5 Detail - Elevation E1
1:50

#	REVISION	BY	APP	DATE

Project: Male' Health Centre Portico And Extension

Client: Kuluhoodhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A: G.Rosary West, 3rd
Floor, Husnuheena Magu, Male', Maldives

DESIGNER:	CHECKED:
Muaviyath A. Sathar	F. Ihudha Amir
DRAWN:	APPROVED:
Mohamed Hassaan	Ihsaan Waheed


Page Title
Curtain Wall Detail 3

Scale : 1:50


Doc No : EP/BLD-AR/2022/08/ST-104

Date : Thursday, August 24, 2023

Rev No : Pg : C.2.6

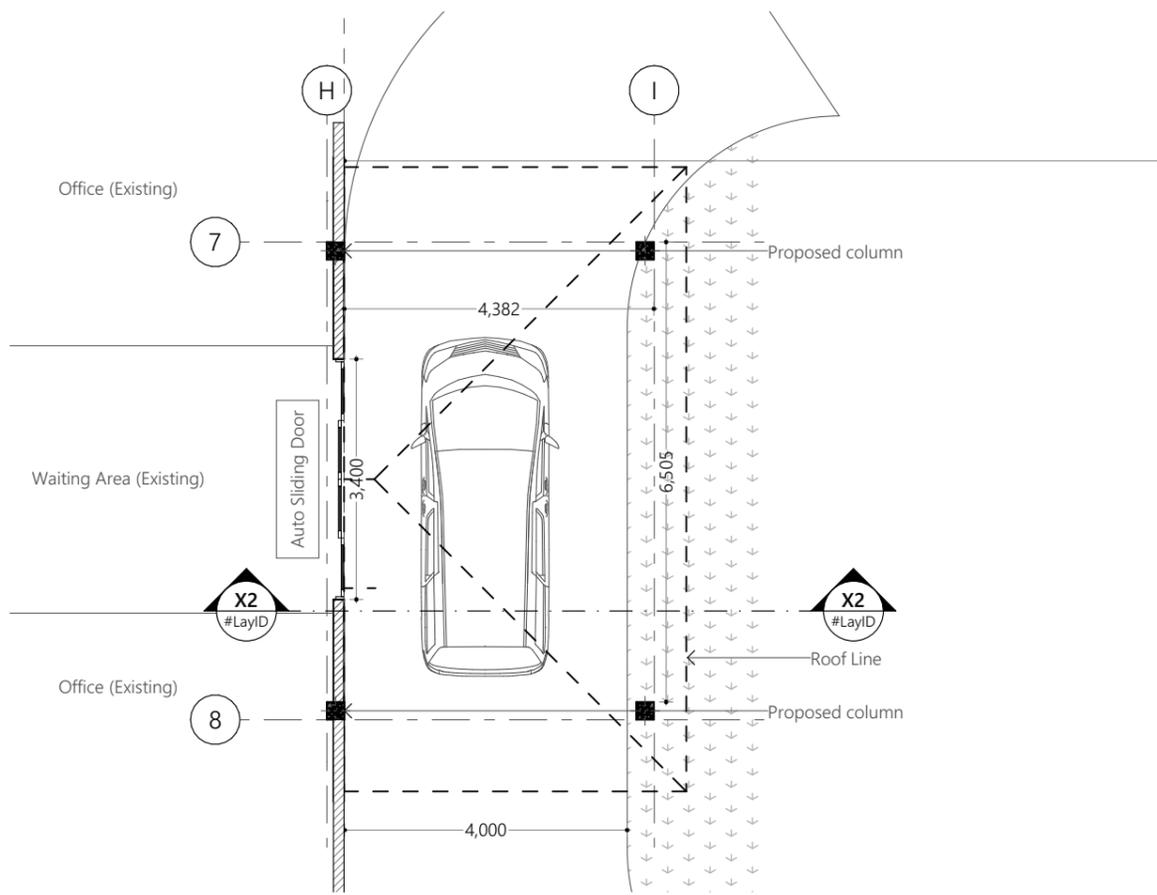


Ground Floor Plan
1:100

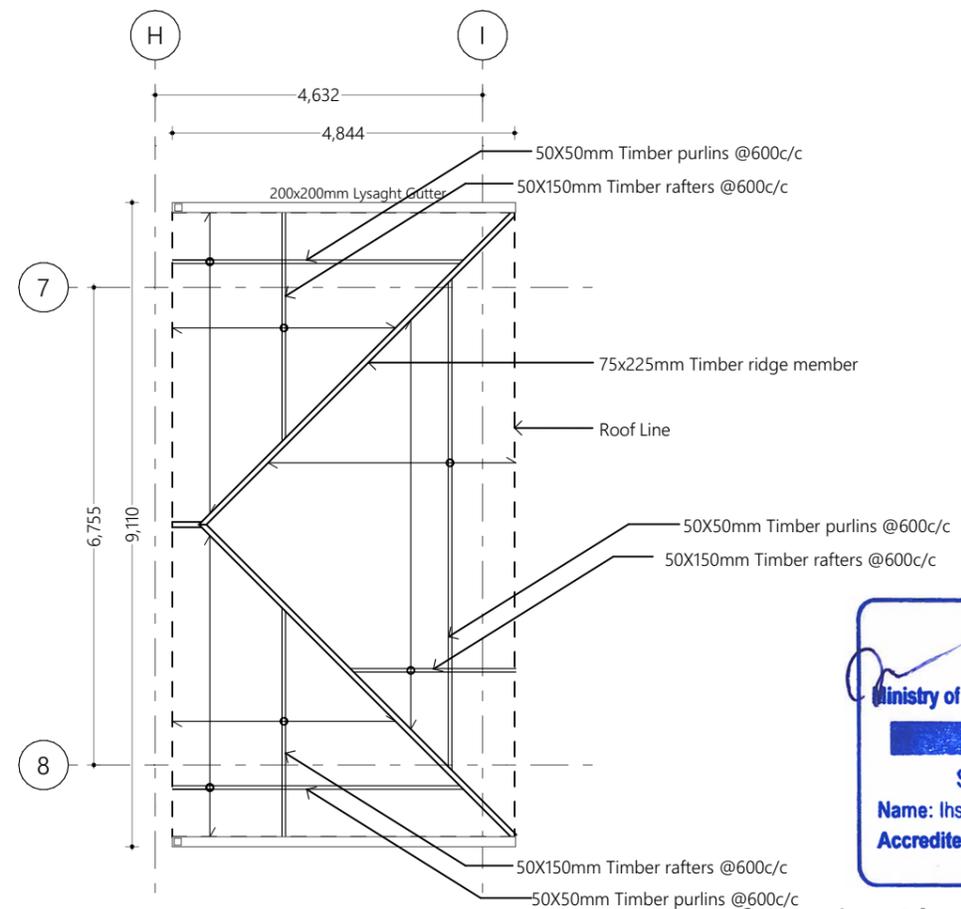


Roof Framing Plan
1:100

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
STRUCTURAL CHECKER A1
 Name: Ihsaan Waheed VALIDITY: 23.03.22 - 22.09.23
 Accredited No: BPR2022021A1 A1-2022-021-001

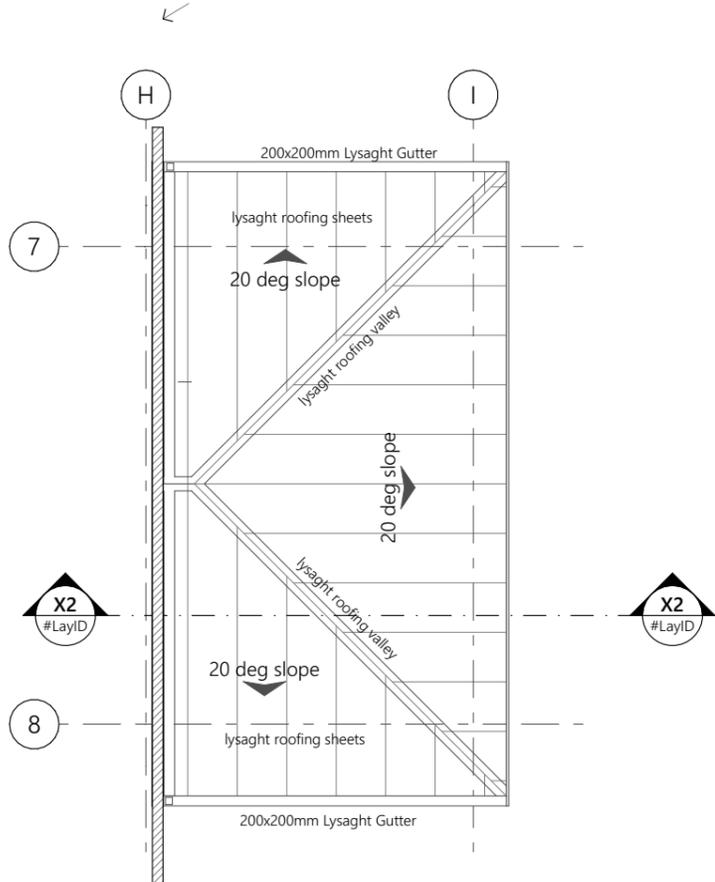

Roof Plan
1:100

Ministry of National Planning, Housing & Infrastructure
ACCREDITED CHECKER
ARCHITECTURAL CHECKER B1
 Name: Fathmath Ihudha Amir VALIDITY: 17.03.22 - 22.09.23
 Accredited No: BPR2022050B1 B1-2022-050-001

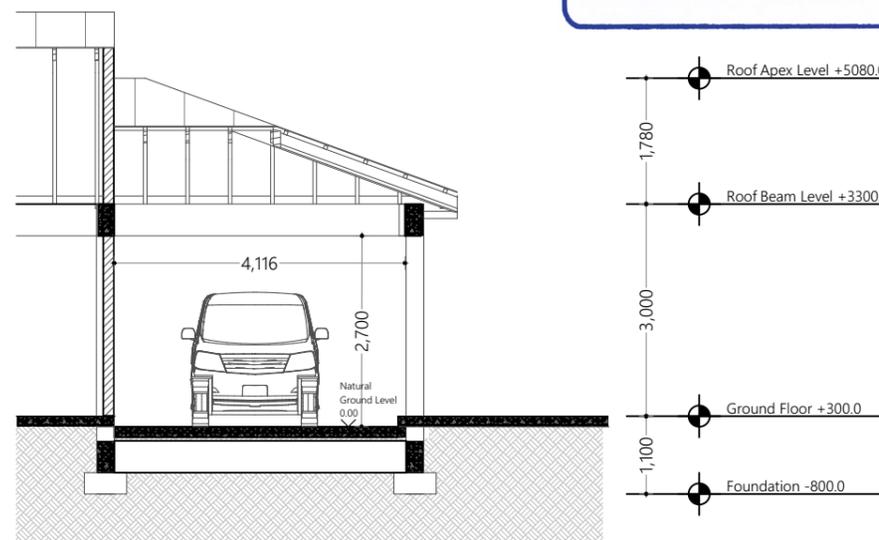

Section X2
1:100

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates.
 W: www.epochassociates, A.G.Rosany West, 3rd
 Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassaan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed


Page Title
Portico Extension Detail 01

Scale : 1:100


Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023


Rev No : Pg : C.2.7

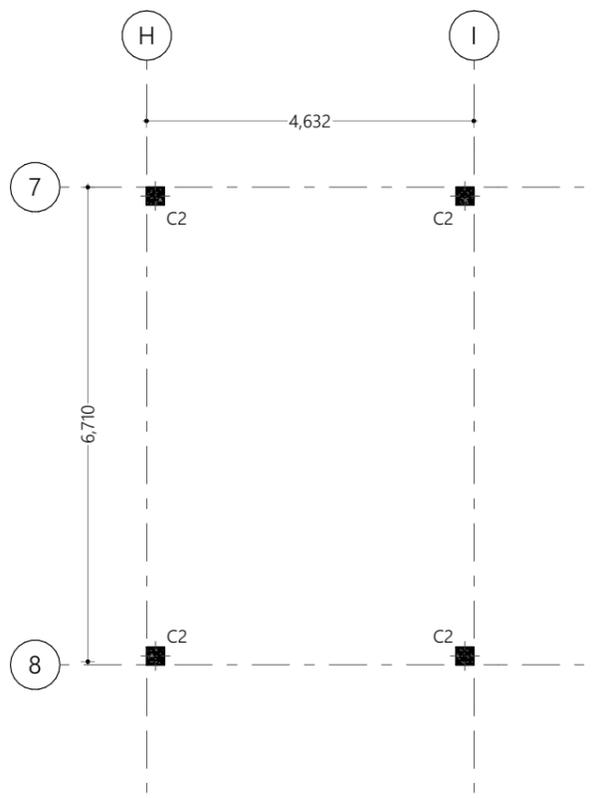


Column Layout
1:100

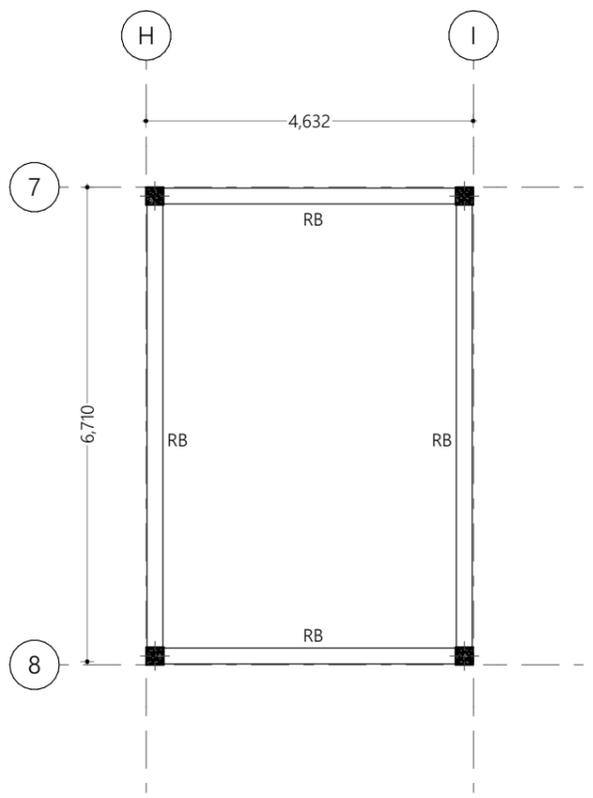


Roof Beam Plan
1:100

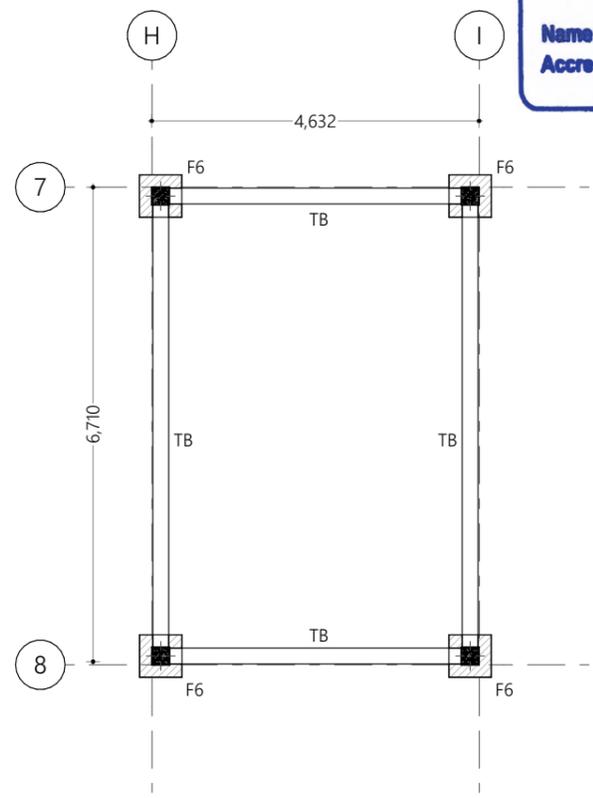


Foundation Plan
1:100

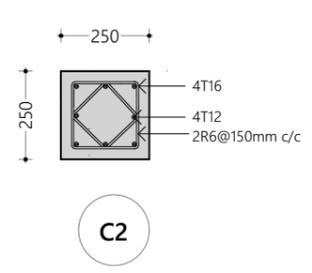

Column Detail
1:20

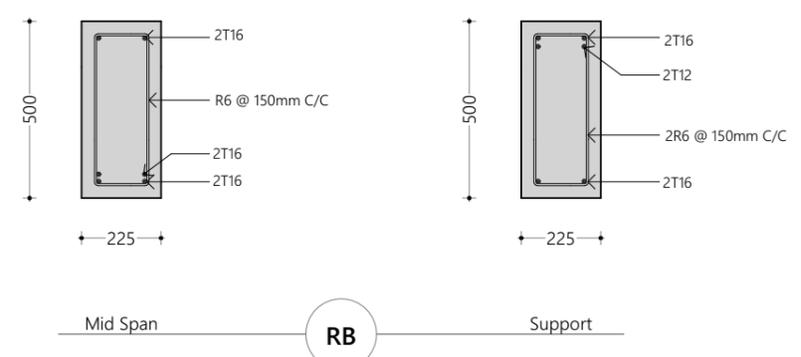

Beam Details
1:20

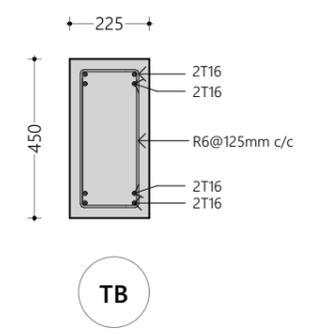

Tie Beam Details
1:20

#	REVISION	BY	APP	DATE

Project :
HDh. Nellaidhoo Health Centre Portico And Extension

Client :
Kulhudhufushi Regional Hospital

Prepared by



T: +960 333 3528, E: info@epochassociates,
W: www.epochassociates, A.G.Rosary West, 3rd
Floor, Husnuheena Magu, Malé, Maldives

DESIGNER: Muaviyath A. Sathar	CHECKED: Mohamed Hassan
DRAWN: F.Ihudha Amir	APPROVED: Ihsaan Waheed

Page Title
Portico Extension Detail 02

Scale : 1:100, 1:20

Doc No : EP/BLD-AR/2022/08/AR-104

Date : Thursday, August 24, 2023

Rev No : **Pg :** C.2.8

Foundation Details:

	Dimensions	Reinforcement
F6	600X600X300	T10@150C/C B/W (B)

Foundation Depth = 800mm

All Footings are to be laid on top of 50mm thick lean concrete
Apply waterproofing to all substructure (below ground elements)
All below ground & terrace concrete works shall be done using waterproofing admixtures