drawing index

CB300-STR-1000 drawing index

CB300-STR-1002 notes

CB300-STR-1003 construction information

CB300-STR-1004 construction information

CB300-STR-1006 general arrangement 3D views

CB300-STR-1010 general arrangement site plan

CB300-STR-1100 valve chamber floor and roof plans

CB300-STR-1110 valve chamber typical sections

CB300-STR-1115 valve chamber concrete details

CB300-STR-1120 valve chamber precast panel set-out plan

CB300-STR-1121 valve chamber precast panel details

CB300-STR-1140 valve chamber stair 1 details

CB300-STR-1145 valve chamber stair 2 details

CB300-STR-1150 valve chamber stair/working platform

CB300-STR-1200 reservoir floor plan

CB300-STR-1201 reservoir roof plan

CB300-STR-1205 reservoir floor reinforcing plan

CB300-STR-1206 reservoir roof reinforcing plan

CB300-STR-1210 reservoir typical sections

CB300-STR-1215 reservoir concrete details

CB300-STR-1216 reservoir concrete details

CB300-STR-1220 reservoir precast panel setout plan

CB300-STR-1221 reservoir precast panel details

CB300-STR-1222 reservoir precast panel details

CB300-STR-1230 reservoir pipe supports

CB300-STR-1240 reservoir internal stair details

CB300-STR-1245 reservoir external stair details

CB300-STR-1250 reservoir access hatch cover details

| | | | SURVEYED | | | |
|-----|-------------------------|------------|---------------|-------|------------|-------|
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | 1 |
| | | | CAD REVIEW | DLP | 23/06/2025 | 1 |
| С | 100% Prelinimary Design | 22/07/2025 | DESIGN CHECK | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | | 1 |
| A | 30% Preliminary Design | 08/05/2025 | APPROVED | | | 1 |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRA | TION: | ' | Holme |





| CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY DESIGN |
|---|------------------------|
| IAF PROJECTS | Date Stamp 23/06/2025 |
| drawing index | Scales n/a |
| arawing mask | Drawing No. Rev. |
| | CB300-STR-1000 C |

general notes:

- 1. All drawings to be read in conjunction with the Holmes Structural Specification.
- 2. The below information applies to all structural elements unless specifically noted otherwise on individual drawings.
- 3. Notes shall be read in conjunction with structural drawings and specifications.
- 4. Temporary propping indicated in this drawing set is not exhaustive. Unless specifically noted on the drawings, the design, location and layout of temporary propping is the responsibility of the
- This drawing set contains colour. All reproduction to be in colour.

concrete notes:

- 1. Reservoir precast wall panels normal class –
- 2. Reservoir floor slab normal class 40MPa
- 3. Reservoir wall stitches and foundation nibs SPECIAL class – 40MPa with xypex addative
- 4. Reservoir roof insitu slab normal class 40MPa
- 5. Valve chamber normal class 40MPa
- 6. Concrete exposure = A2
- 7. All concrete cover: 35mm for 50MPa concrete.
- 35mm for 40MPa concrete. 50mm to DPM (underside of slab)
- 8. All concrete to be cured in accordance NZS 3109:1997, with a minimum 7 days curing duration.
- 9. Tolerance as per NZS 3109:1997.
- 10. All construction joints and areas to have new concrete/grout cast against hardened concrete to be 'Type B' in accordance with NZS 3109:1997.

reinforcing notes:

- 1. Grade 500 MA, ductility class E to AS/NZS 4671.
- 2. Reinforcing quantities shown on the drawings are exclusive of allowance for laps, splices etc. Laps and splices to be staggered unless noted otherwise.
- 3. Laps, splices, hooks, bends as per NZS 3109:1997.
- 4. Placement tolerance as per NZS 3109:1997.
- 5. Reinforcing bar couplers to be in accordance with NZS3101:2006 Amendment 3, NZTA Bridge Manual and NZTA TAN #17-14 requirements.

prestressing/post-tensioning Strand notes:

- 1. Strand to be 7 wire ordinary 15.2mm (or 12.7 where noted) super-strand, Relax 2, complying with AS/NZS 4672.
- 2. Proprietary anchor head systems to be used for post-tensioning tendons.
- 3. All ducts to be grouted with min 40MPa shrink compensated grout mix.

steel notes:

- 1. Steel grade:
- A. Hot rolled steel sections Grade 300 B. Flat plate Grade 300 C. RHS / SHS / CHS sections Grade 350 L0, ends of sections to be capped with an end
- 2. Bolts high strength class 8.8/S
- 3. Corrosion protection for all exterior steelwork HDG600 hot dip galvanised.
- 4. All metalwork inside the tank to be stainless steel (316L).
- 5. All pipework inside the tank to be stainless steel
- 6. Exposed steelwork classification = C2

abbreviations:

alt Alternate. Approximate. approx arch(s) Architect(s). btm Bottom. Bb Bottom bottom (reinf). Bt Bottom top (reinf). BOS Bottom of steel. bldg Building. c.f Concrete filled. CHS Circular hollow section. CL Centre line. Column. col Centres. crs Check on site. c.o.s Complete Penetration Butt Weld **CPBW** conc Concrete. Contraction joint. c.j Continuous. cont cnr Corner. Cover. cvr Deformed reinforcing (300E). DPC Damp proof course. DPM Damp proof membrane.

Ø Diameter. Deep. dp Diagonal. diag Drawing. dwg Embedment. embed extg Existing. EA Equal angle e.f Each face. Each side. Each way.

e.s e.w EQ Equal(s). f.f Far face. Flange. FFL Finished floor level. FGL Finish ground level. Fb Flybrace.

galv Galvanised. Ground level. Heavy welded beam (Steltech). HDHolding down (bolt). horiz Horizontal. ID Inside diameter. kg/m3 Kilogram per cubic metre.

Kilonewton. kPa Kilopascal. Long. Live load. Maximum. max MPa Megapascal. Metre.

abbreviations:

Metric bolt ISO. Mild steel. m.s mm Millimetre. Minimum. n.f Near face. n.t.s Not to scale. OD Outside diameter. o/a Overall. p/c PFC Precast concrete. Parallel flange channel. PLPlain round reinforcing (300E). rad Radius. RB Reidbar reinforcing. RL Reduced level. Reinforcing. reinf req'd Required. RHS Rectangular hollow section. Snug fit bolt. SB Standard welded beam (Steltech). SDL Superimposed dead load. SFL Structural floor level. sim Similar. sp Splice. Specification. spec sq SHS Square. Square hollow section. stgd Staggered. Stainless steel. SS stiff Stiffener. Starter(s). str(s) stp(s) Stirrup(s). Tb Top bottom (reinf). TB Tension bearing bolt. t.b.a To be advised. t.b.c To be confirmed. TF Tension friction bolt. Τt Top top (reinf). thk Thick. TOS Top of steel. typ Typical. ÚA Unequal angle. Unless noted otherwise. u.n.o Underside. u/s UB Universal beam. UC Universal column. UDL Uniformly distributed load.

Vert

WB

WP

XD

XR

Vertical.

Weld plate.

Welded beam (Steltech).

Deformed reinforcing (500E).


Plain round reinforcing (500E).

| | | | SURVEYED | | |
|-----|-------------------------|------------|---------------|-------|------------|
| | | | DESIGNED | CPL | 23/06/2025 |
| | | | DRAWN | AJW | 23/06/2025 |
| | | | CAD REVIEW | DLP | 23/06/2025 |
| _ | | | DESIGN CHECK | | |
| С | 100% Prelinimary Design | 22/07/2025 | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | |
| Α | 30% Preliminary Design | 08/05/2025 | APPROVED | | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRA | TION: | F |






| CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY DESIGN | | | |
|---|------------------------|--|--|--|
| IAF PROJECTS | Date Stamp 23/06/2025 | | | |
| notes | Scales n/a | | | |
| 110.00 | Drawing No. Rev. | | | |
| | CB300-STR-1002 C | | | |

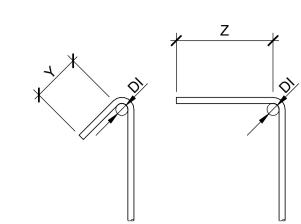

| reinf bar | bend | hook length | | | | |
|-----------|------------|-------------|---------------------|-----|--|--|
| | inside dia | 180° hook | 180° hook 135° hook | | | |
| | DI | Х | Υ | Z | | |
| R6 | 12 | 65 | 65 | 96 | | |
| (X)R10 | 20 | 65 | 80 | 160 | | |
| (X)R12 | 24 | 65 | 96 | 192 | | |
| (X)R16 | 32 | 65 | 128 | 256 | | |
| (X)R20 | 40 | 80 | 160 | 320 | | |


- 1. Tabulated dimensions shown above are minimums.
- 2. Bend inside diameter (DI) to be the greater of either tabulated bend inside diameter or diameter of the largest enclosed bar
- 3. Refer to the Holmes Structural Specification for bend diameters and other requirements for galvanised bars.
- 4. Hook information above applies to plain bar stirrups and ties only.



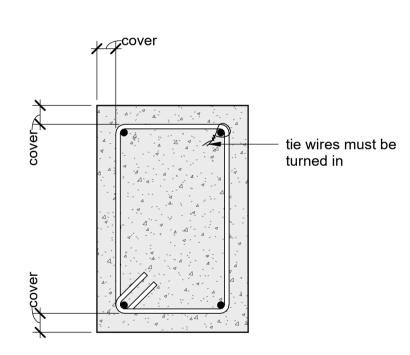

notes


- For specific cover dimensions, refer to the Holmes Structural Specification.
- 2. Cover is measured to the outer most piece of reinforcing.
- Cover shall be maintained to all edges including penetrations, formwork and metal tray flooring.

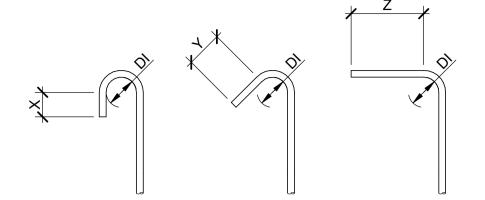


| reinf bar | I | | hook length | | | | |
|-----------|------------|-----------|-------------|----------|--|--|--|
| | inside dia | 180° hook | 135° hook | 90° hook | | | |
| | DI | Х | Y | Z | | | |
| (X)D10 | 50 | 65 | 65 | 120 | | | |
| (X)D12 | 60 | 65 | 72 | 144 | | | |
| (X)D16 | 80 | 65 | 96 | 192 | | | |
| (X)D20 | 100 | 80 | 120 | 240 | | | |
| (X)D25 | 150 | 100 | 150 | 300 | | | |
| (X)D32 | 192 | 128 | 192 | 384 | | | |
| XD40 | 240 | 160 | 240 | 480 | | | |

notes:


- 1. Tabulated dimensions shown above are minimums.
- 2. Refer to the Holmes Structural Specification for bend diameters and other requirements for galvanised bars.



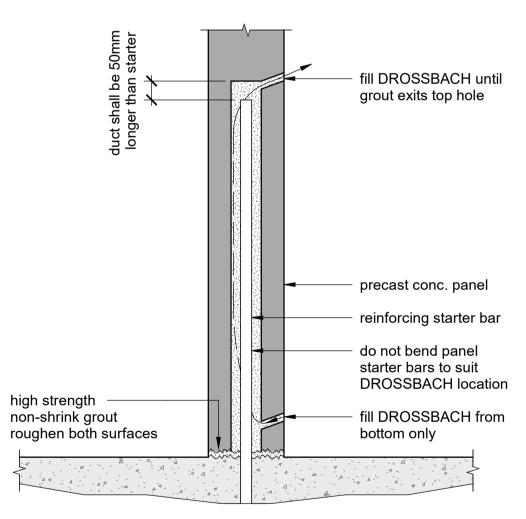


note


- 1. Refer to the Holmes Structural Specification for grout requirements.
- 2. Grout to be mixed and placed in accordance with the manufacturers specifications.

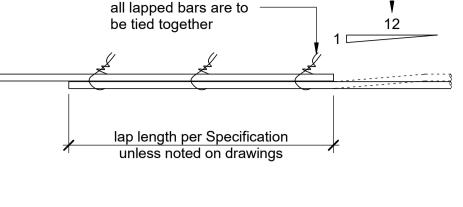

crank (if required) to

be max 1:12 slope

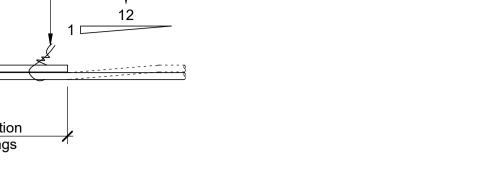



notes:

Specification.

1. The information on this sheet must be read in

not a substitute for the Holmes Structural

2. Where there are differences between the

drawing information will take priority.


conjunction with the Holmes Structural Specification & drawings. The notes and details on this sheet are

information on this sheet and the Holmes Structural

Specification & drawings, the Specification &

3. The information on this sheet is generic construction related information to assist the contractor as a reference. The information contained is not to be


used for contractor initiated remedial solutions.




- 1. For specific cover dimensions, refer to the Holmes Structural Specification.
- 2. Plain bars shall not be lapped using straight laps.

notes:

- 3. Reinforcing shall not be tack welded in any instance.
- 4. Welded bar splices must have engineers approval.




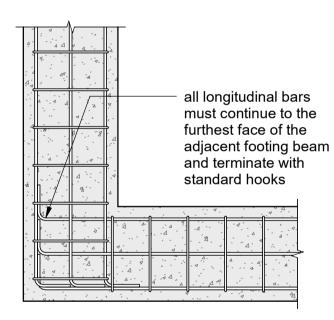


1. Refer to detail 2 for reinforcing bar standard hook requirements.

notes:

- All non-lapped reinforcing bar ends shall be terminated with standard hooks unless noted otherwise.
- 2. Refer to detail 1 and detail 2 for standard hook requirements.



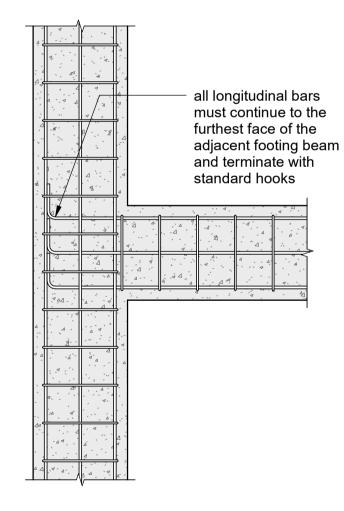

notes:

1. Refer to detail 2 for reinforcing bar standard hook requirements.

reinforcing at footing junctions







| | | | SURVEYED | | | |
|-----|-------------------------|------------|----------------|-------|------------|---|
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | |
| | | | CAD REVIEW | DLP | 23/06/2025 | |
| | | | DESIGN CHECK | | | |
| С | 100% Prelinimary Design | 22/07/2025 | | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | | |
| Α | 30% Preliminary Design | 08/05/2025 | APPROVED | | | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRAT | ΓΙΟΝ: | | Н |






| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS |
|--|
| construction information |

Drawing No.


CB300-STR-1003


Rev.

C

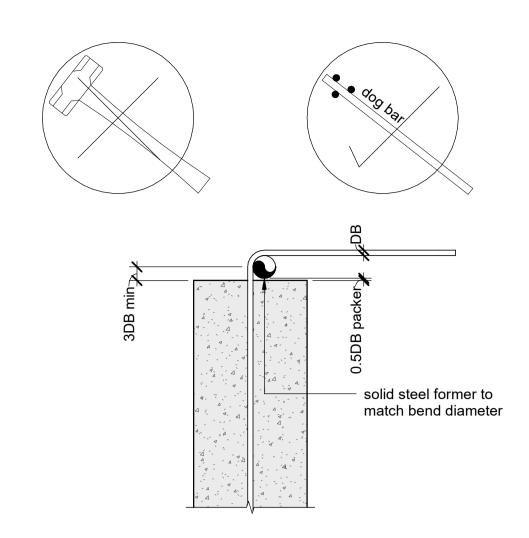

- 1. All reinforcing bars shall be bent using a steel former and appropriately dimensioned 'dog bar' or similar.
- 2. Reinforcing bars shall not be bent using a hammer or similar.




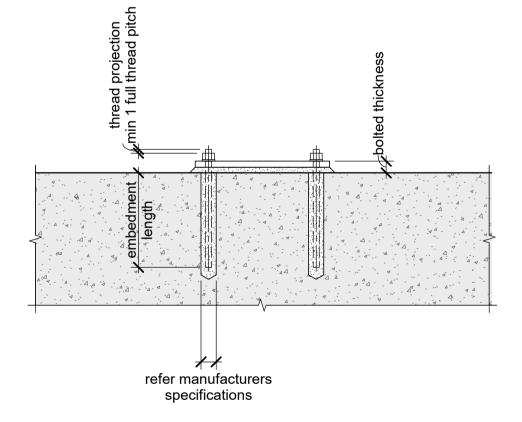

notes


- 1. Post-fixed anchors to be installed as per the manufacturers specifications.
- 2. Substitution of brand is not permitted without the approval of Holmes.
- Contractor to locate all reinforcement within reinforced concrete elements prior to drilling holes for epoxy anchors, dowels and fixings. Holes to be drilled with a hammer drill only. Reinforcement is to not be struck or damaged.
- 4. Minimum thread considerations as per cast-in anchors note 3.




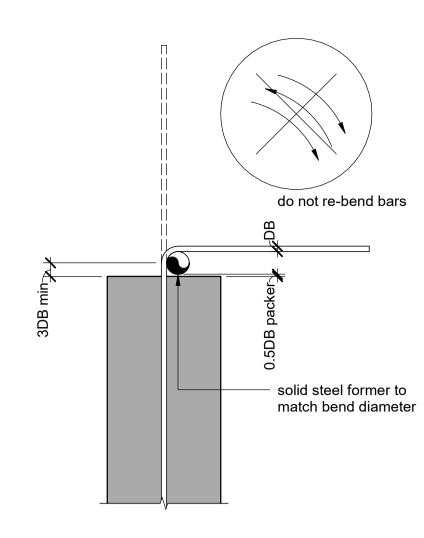

notes:


- 1. Reinforcing bars shall not be bent more than once.
- Re-bending of any reinforcing bars is only permitted with structural engineers approval and in accordance with the Holmes Structural Specification.




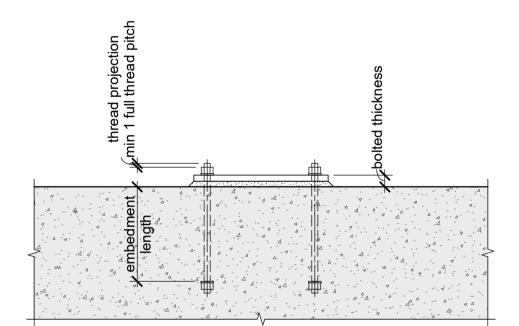

notes:


- 1. Cast-in anchors shall include a nut and washer at the cast-in end u.n.o on the drawings.
- 2. Set out cast-in bolts using a template, do not tack weld to reinforcing or bolts.
- 3. Contractor to consider additional thread projection for construction tolerances to ensure minimum thread projection is achieved.




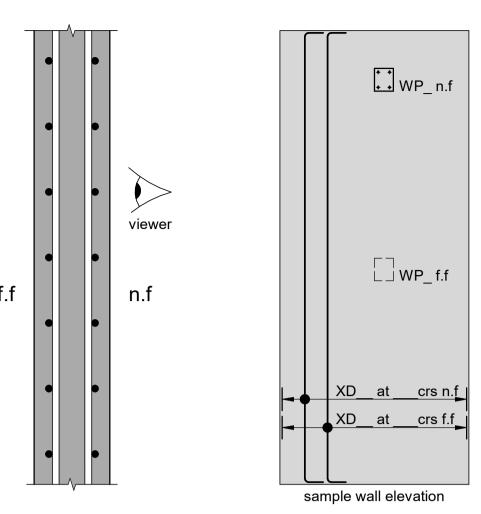

notes:

- Near face and far face notes relate to the position of the viewer of a wall elevation in Holmes drawings. These do not have any relation to the casting face, mould face or form face of precast panels.
- n.f = near face, face closest to viewer of elevation in Holmes drawings.
- 3. f.f = far face, face furthest from viewer of elevation in Holmes drawings.



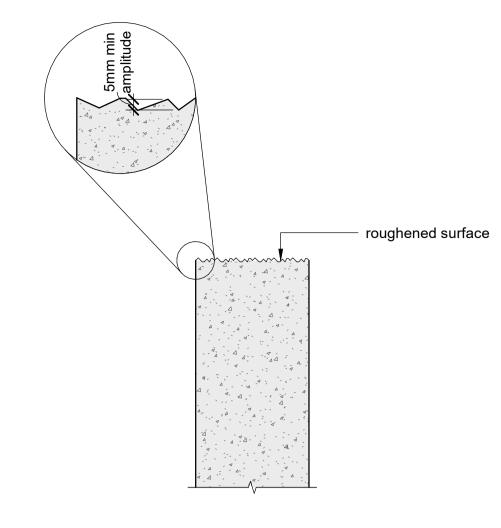

notes:

Specification.

1. The information on this sheet must be read in

not a substitute for the Holmes Structural

2. Where there are differences between the

drawing information will take priority.

conjunction with the Holmes Structural Specification & drawings. The notes and details on this sheet are

information on this sheet and the Holmes Structural Specification & drawings, the Specification &


3. The information on this sheet is generic construction

related information to assist the contractor as a reference. The information contained is not to be used for contractor initiated remedial solutions.

notes:

- Refer to the Holmes Structural Specification and drawings for further details on roughened surface locations and requirements.
- Roughened surfaces shall be cleaned and all laitance removed prior to pouring of adjoining concrete.



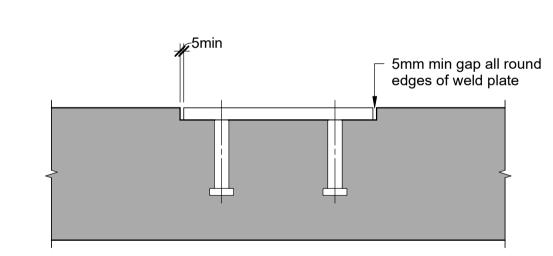

1. Specified length in drawings is the finished length after installation.



notes:

1. Gap may be sealed/filled after steelwork installation. Sealant/filler subject to Architect approval.

casting of weld plates n.t.s.

| | | | SURVEYED | | | |
|------|-------------------------|------------|----------------|-------|------------|----|
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | |
| | | | CAD REVIEW | DLP | 23/06/2025 | 1 |
| С | 100% Prelinimary Design | 22/07/2025 | DESIGN CHECK | | | 1 |
| | , , | | DESIGN REVIEW | | | 1 |
| | | 08/05/2025 | APPROVED | | | |
| RE\/ | REVISION DESCRIPTION | DATE | PROF REGISTRAT | TION: | | Ho |





| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | |
|--|--|
| construction information | |


| Status Stamp | |
|--------------|--------------------|
| 90% | PRELIMINARY DESIGN |
| Date Stamp | |
| · | 23/06/2025 |

| 23 |
|--------------|
| Scales n.t.s |
| Drawing No. |
| CB300-STE |

- 1. Refer to CB300-STR-1002 for all general notes.
- 2. All pipework by others, shown indicatively only.





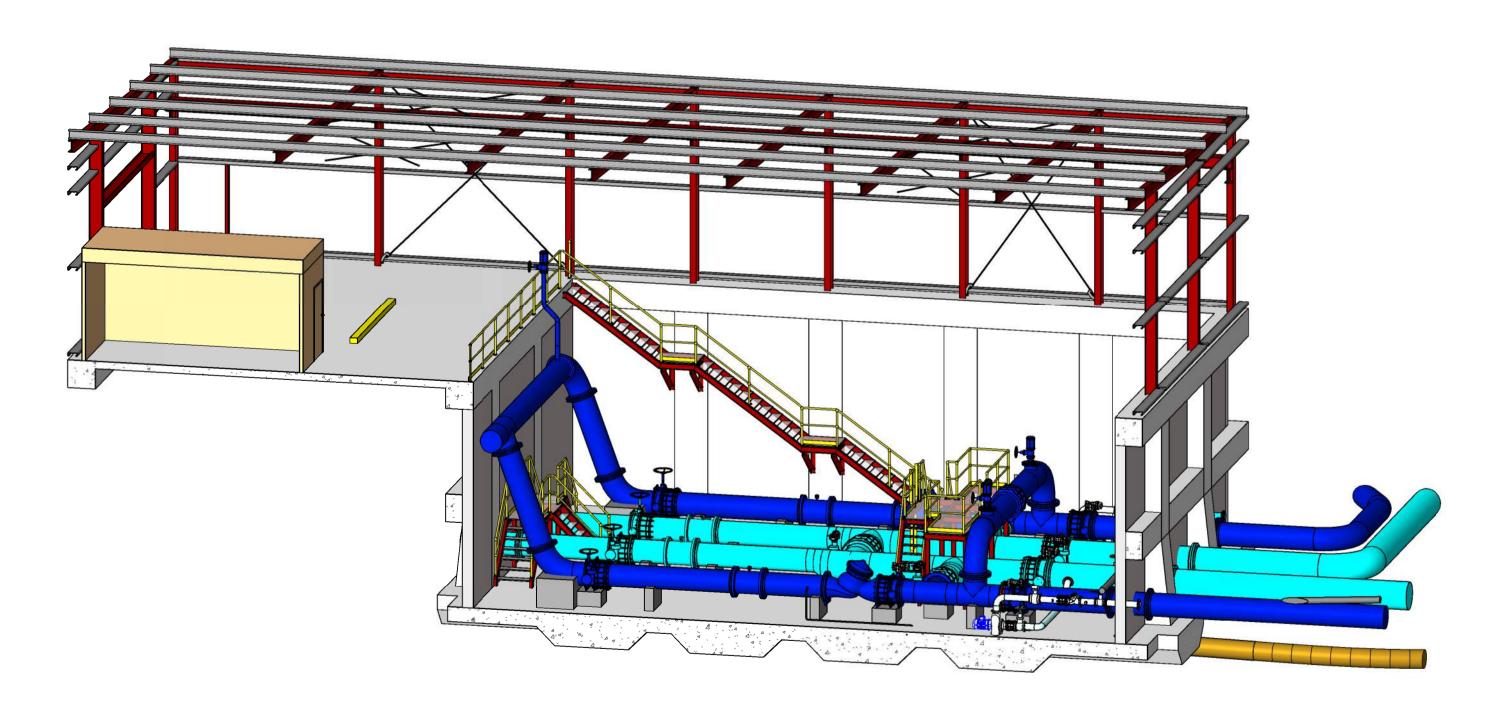


valve chamber 3D view n.t.s.


| | | | SURVEYED | | | |
|-----|---|------------|---------------|---------------|------------|--|
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | |
| | | | CAD REVIEW | DLP | 23/06/2025 | |
| | 4000/ Pushiriman Pasing | 22/07/2025 | DESIGN CHECK | | | |
| В | 100% Prelinimary Design 90% Preliminary Design | | DESIGN REVIEW | | | |
| A | 30% Preliminary Design | 08/05/2025 | APPROVED | | | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRA | REGISTRATION: | | |







| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY DESIGN Date Stamp 23/06/2025 |
|--|---|
| general arrangement 3D views | Drawing No. CB300-STR-1006 Rev. C |

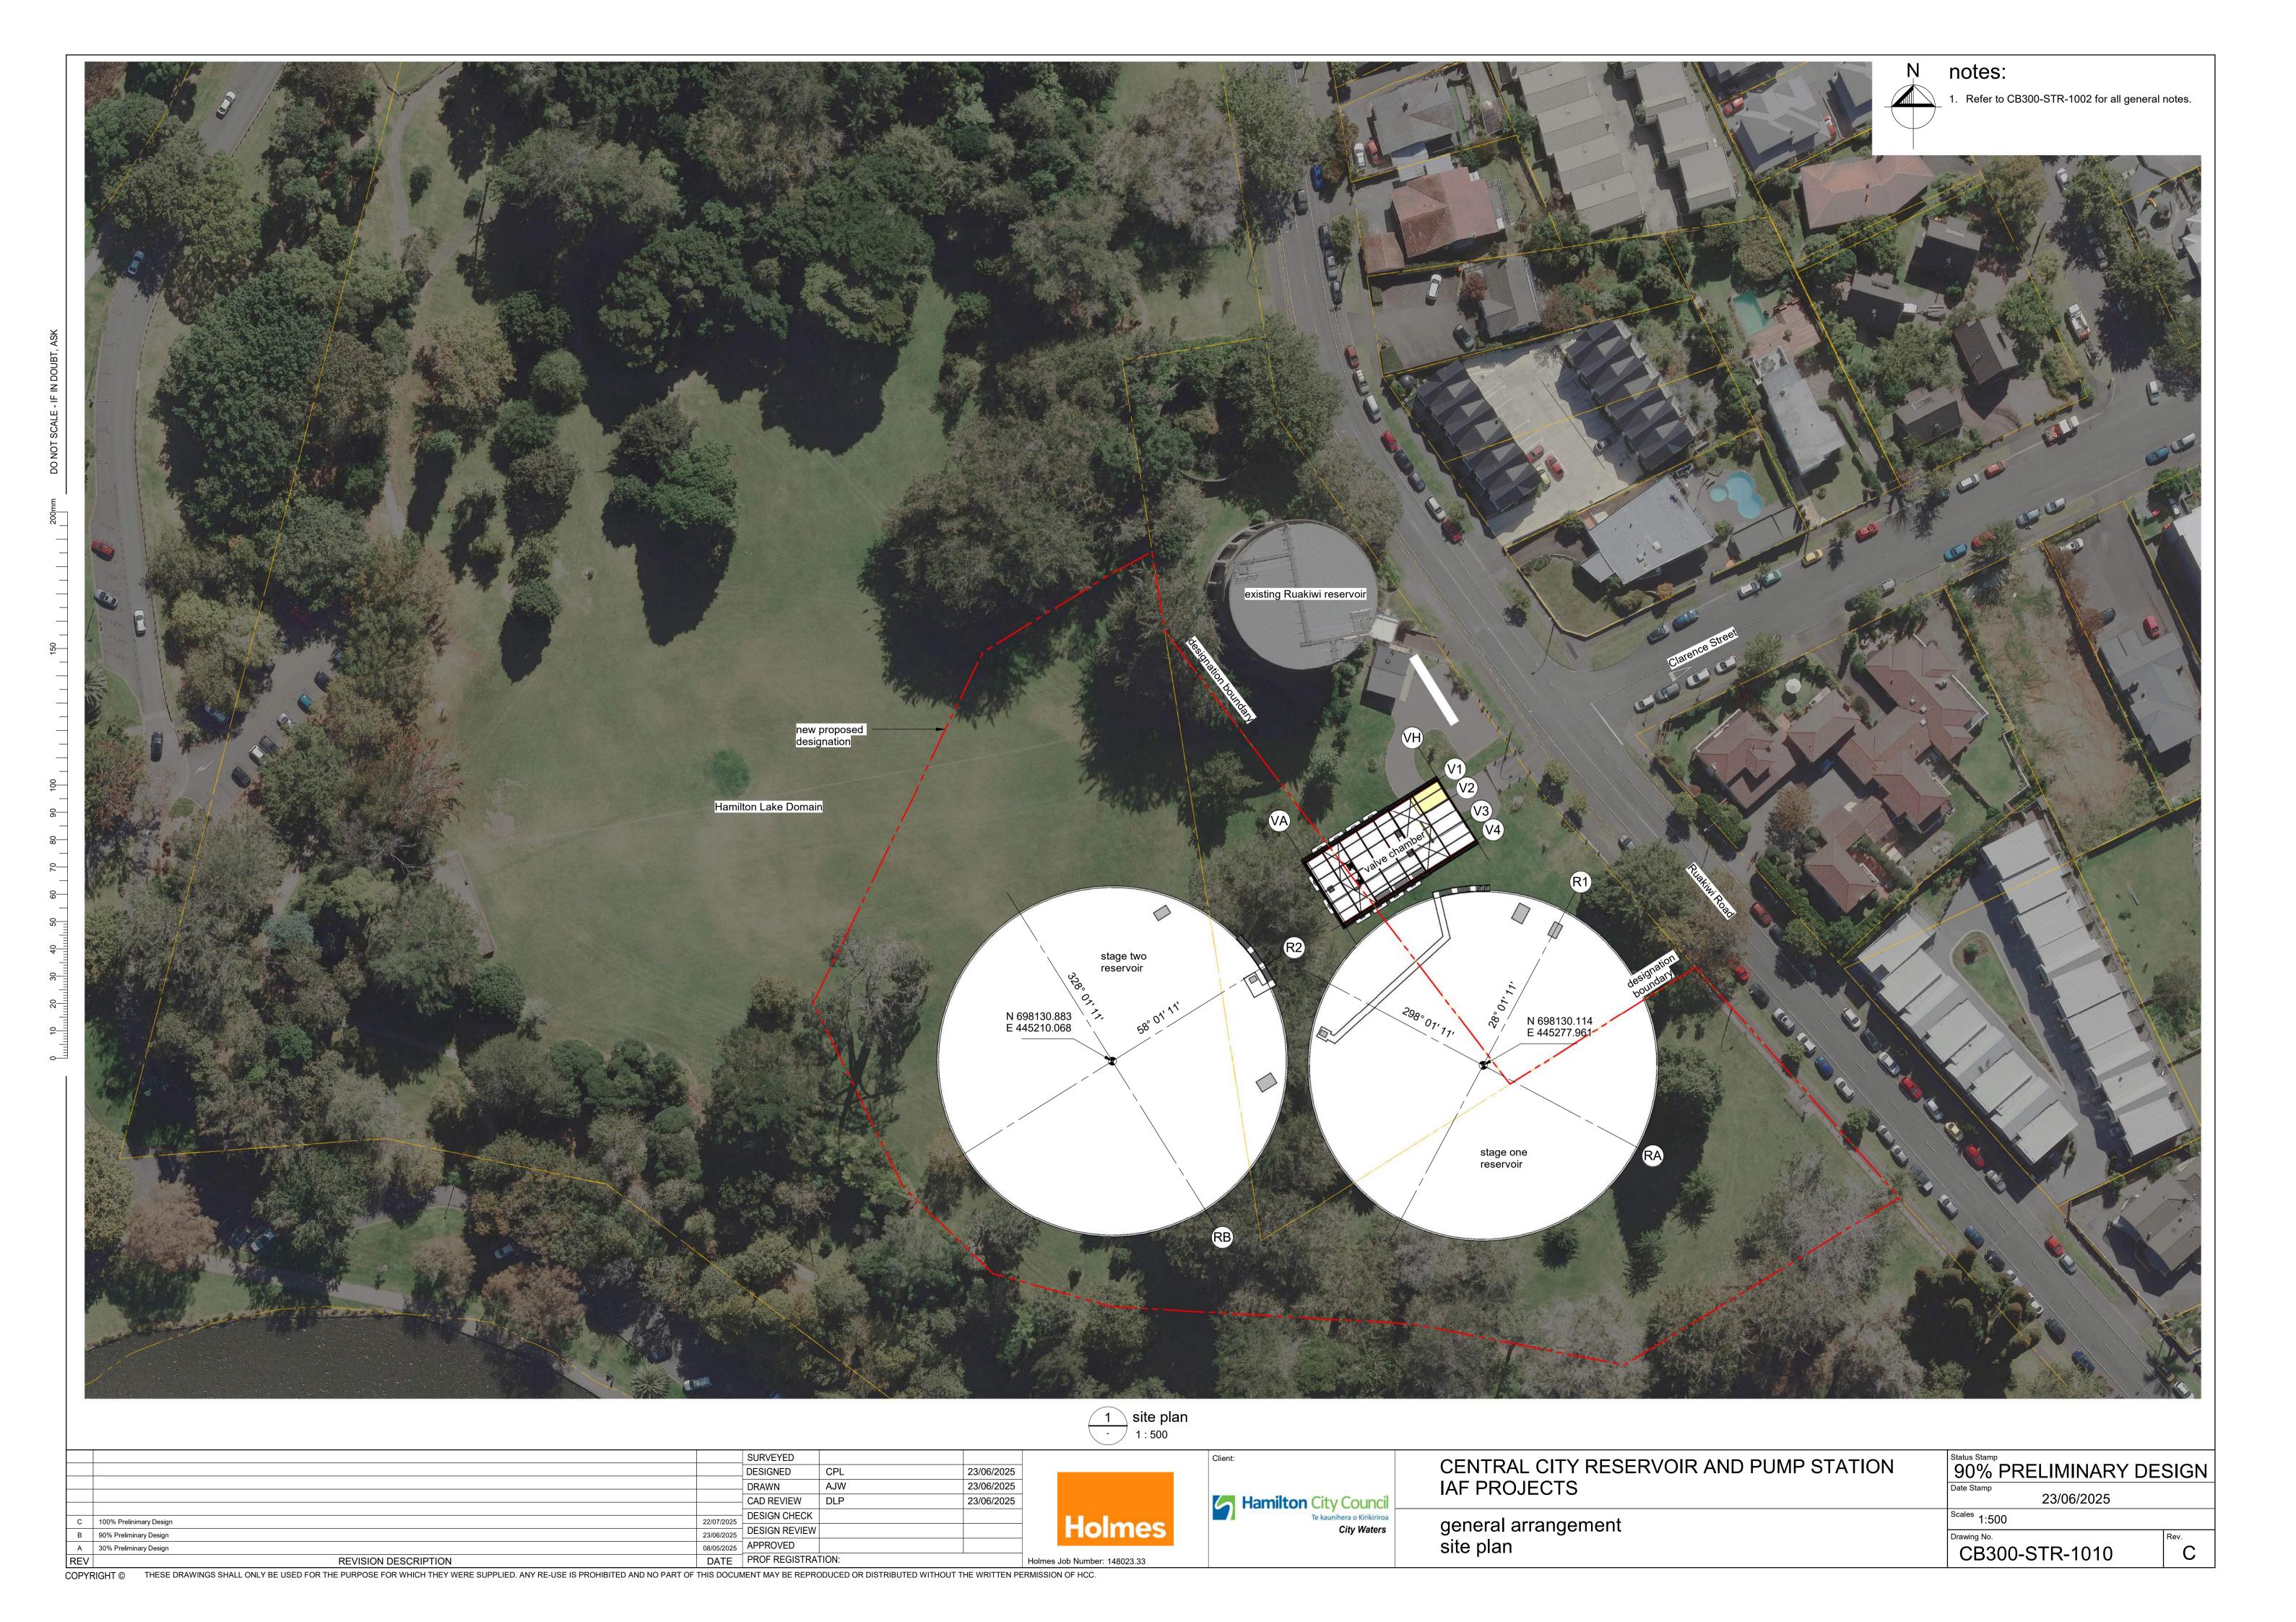


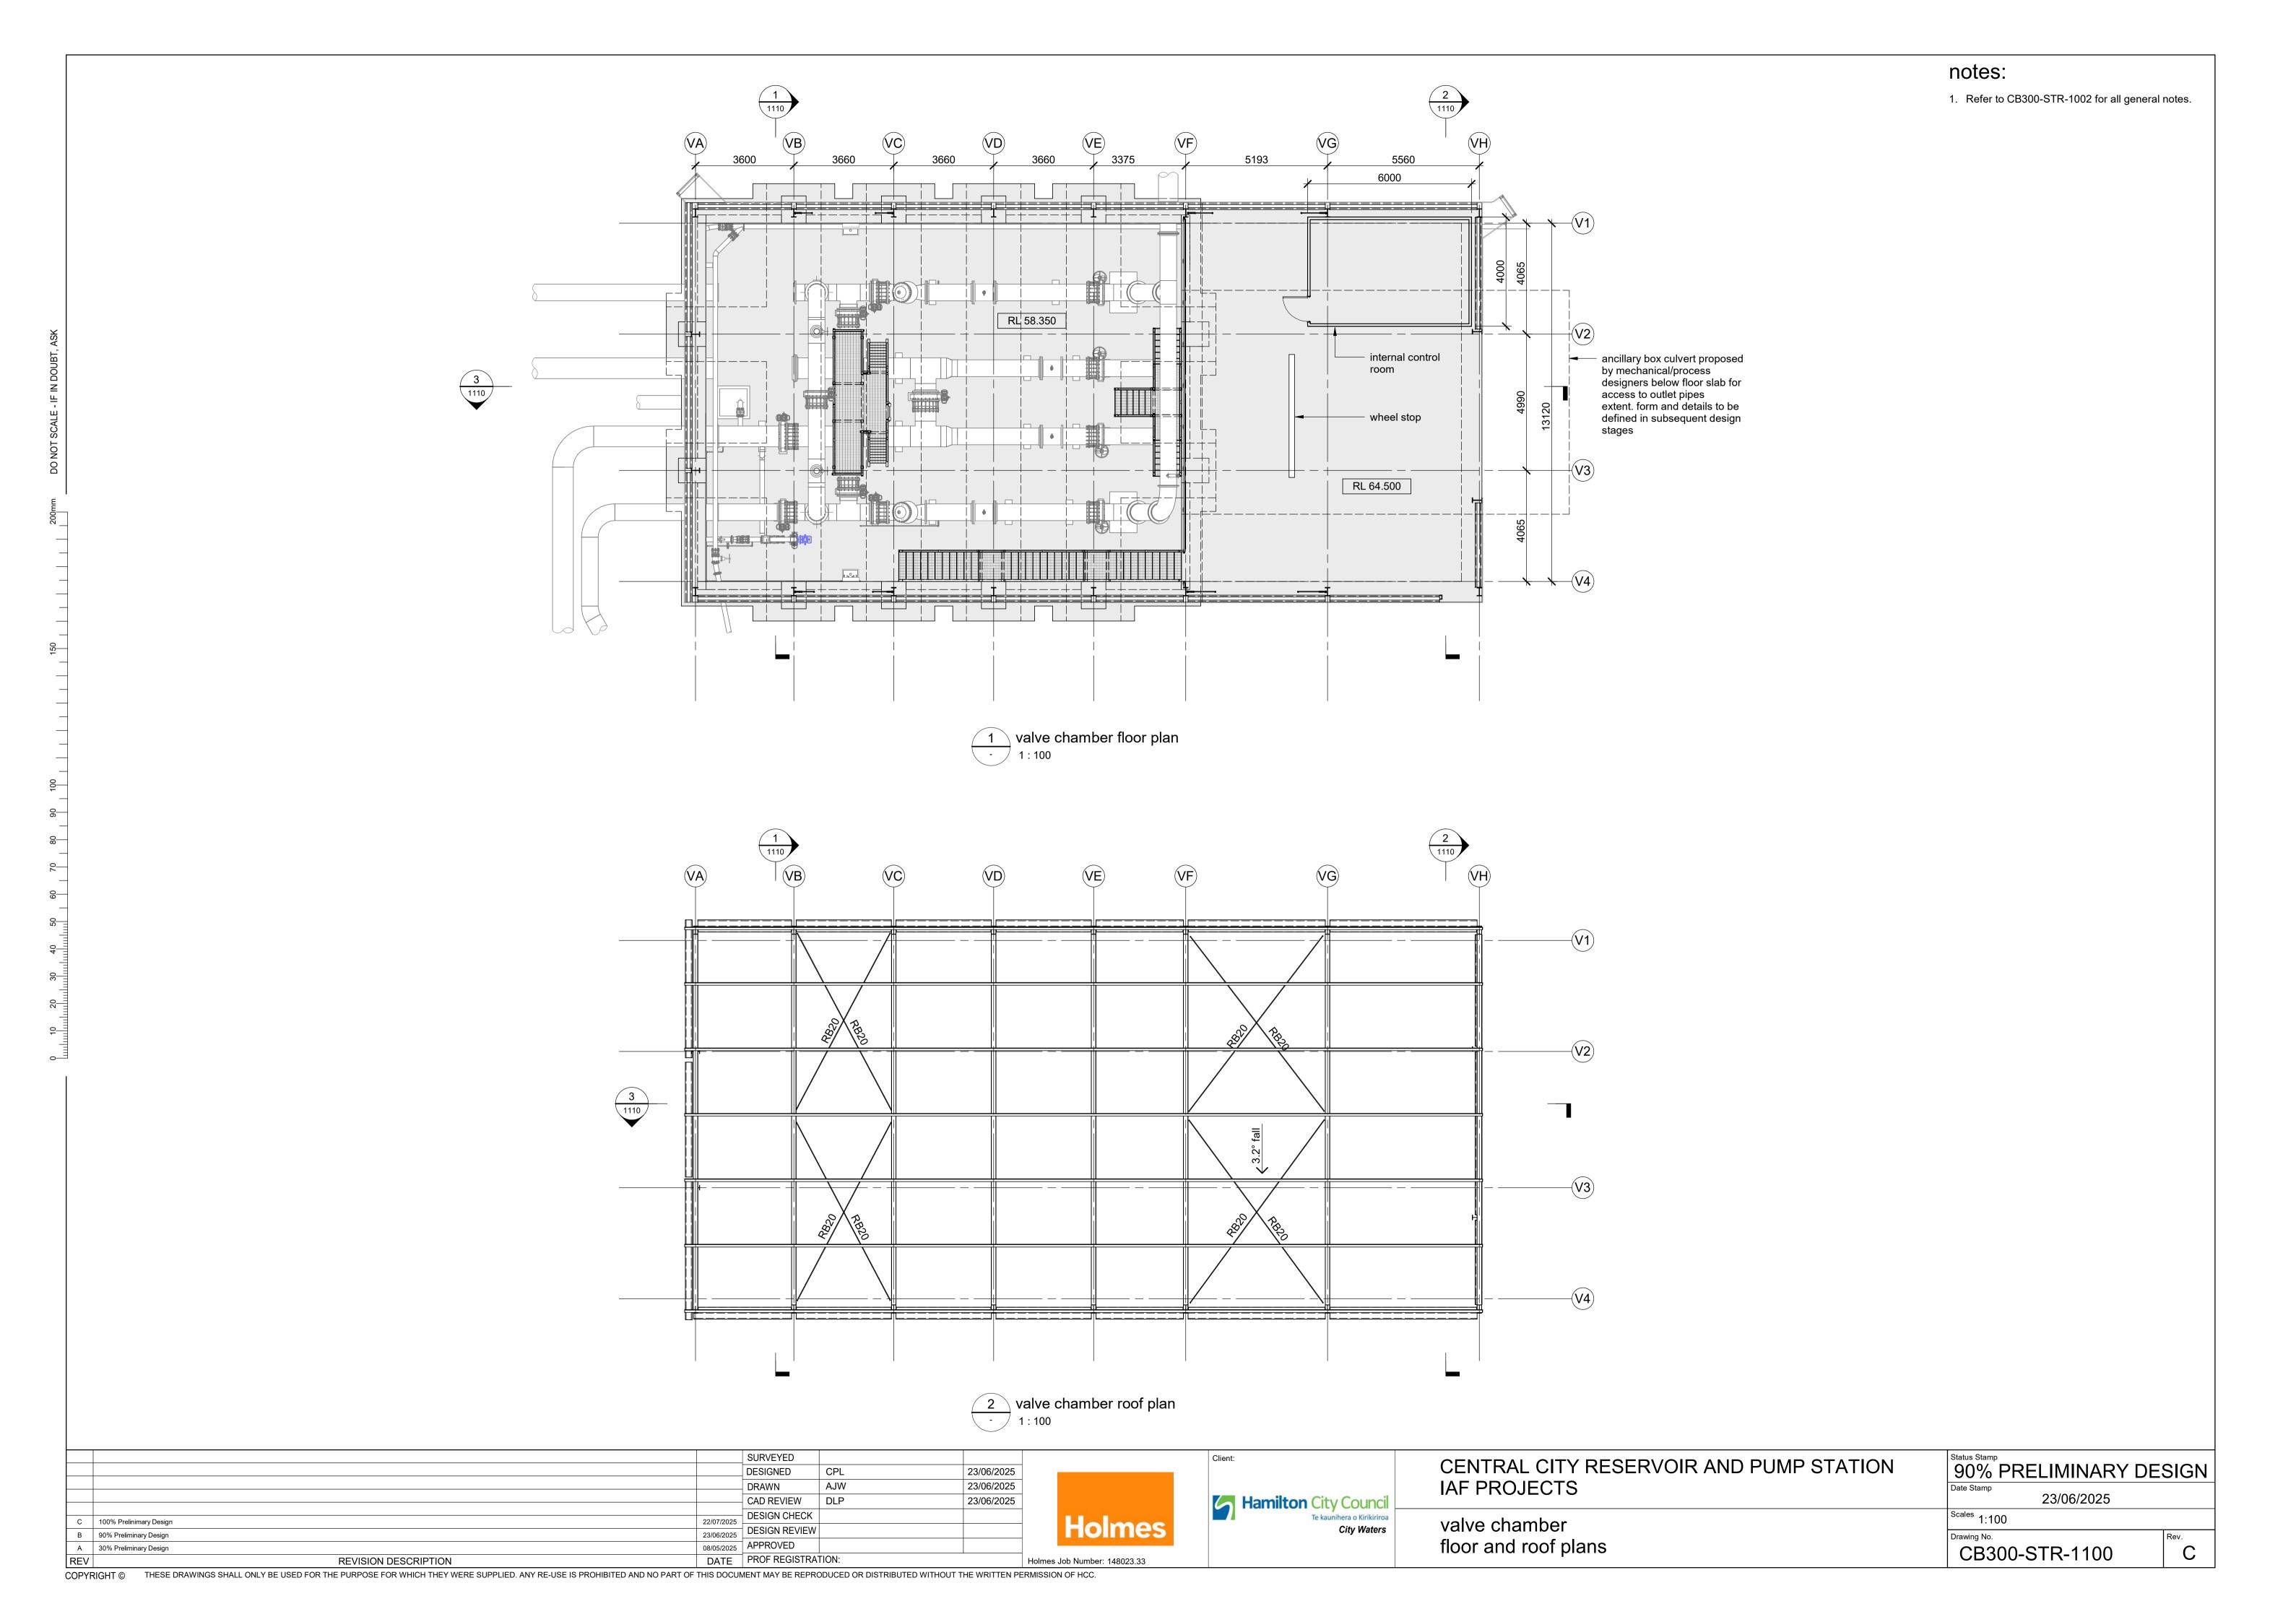

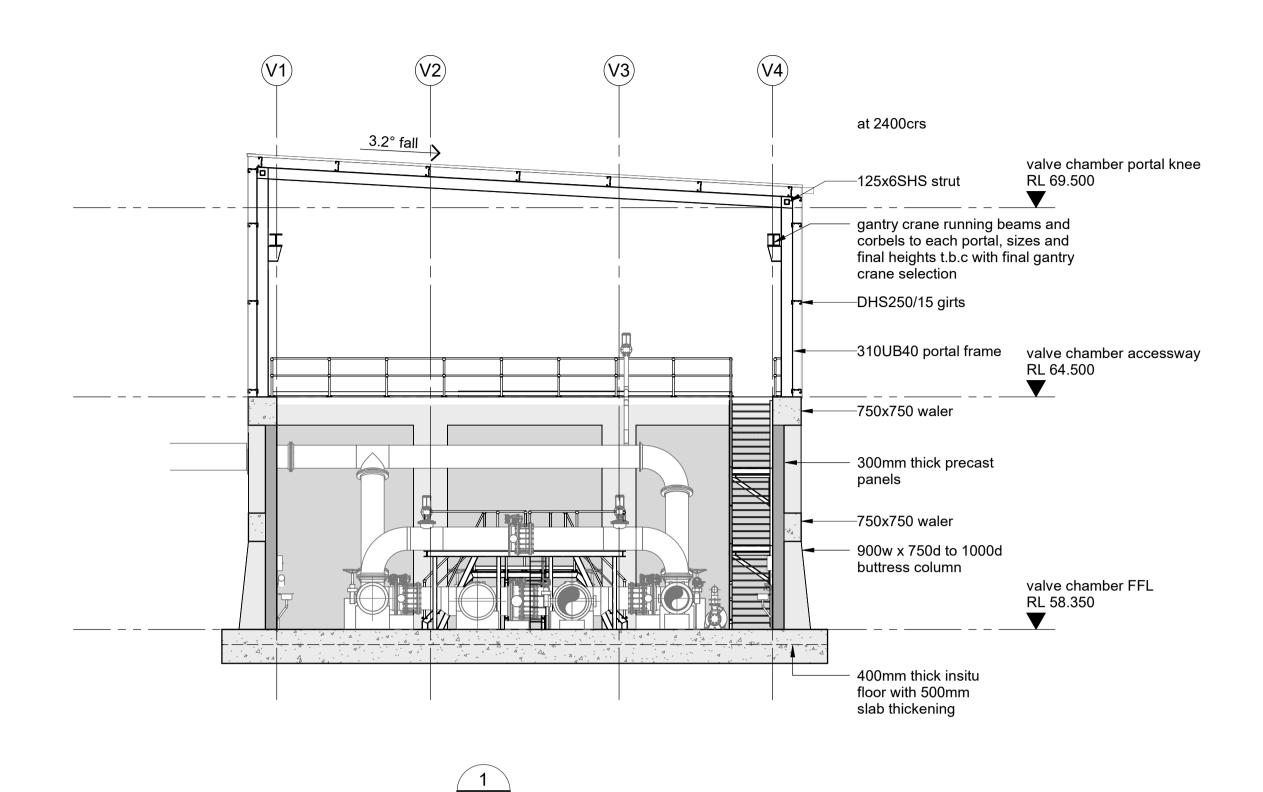



COPYRIGHT © THESE DRAWINGS SHALL ONLY BE USED FOR THE PURPOSE FOR WHICH THEY WERE SUPPLIED. ANY RE-USE IS PROHIBITED AND NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR DISTRIBUTED WITHOUT THE WRITTEN PERMISSION OF HCC.

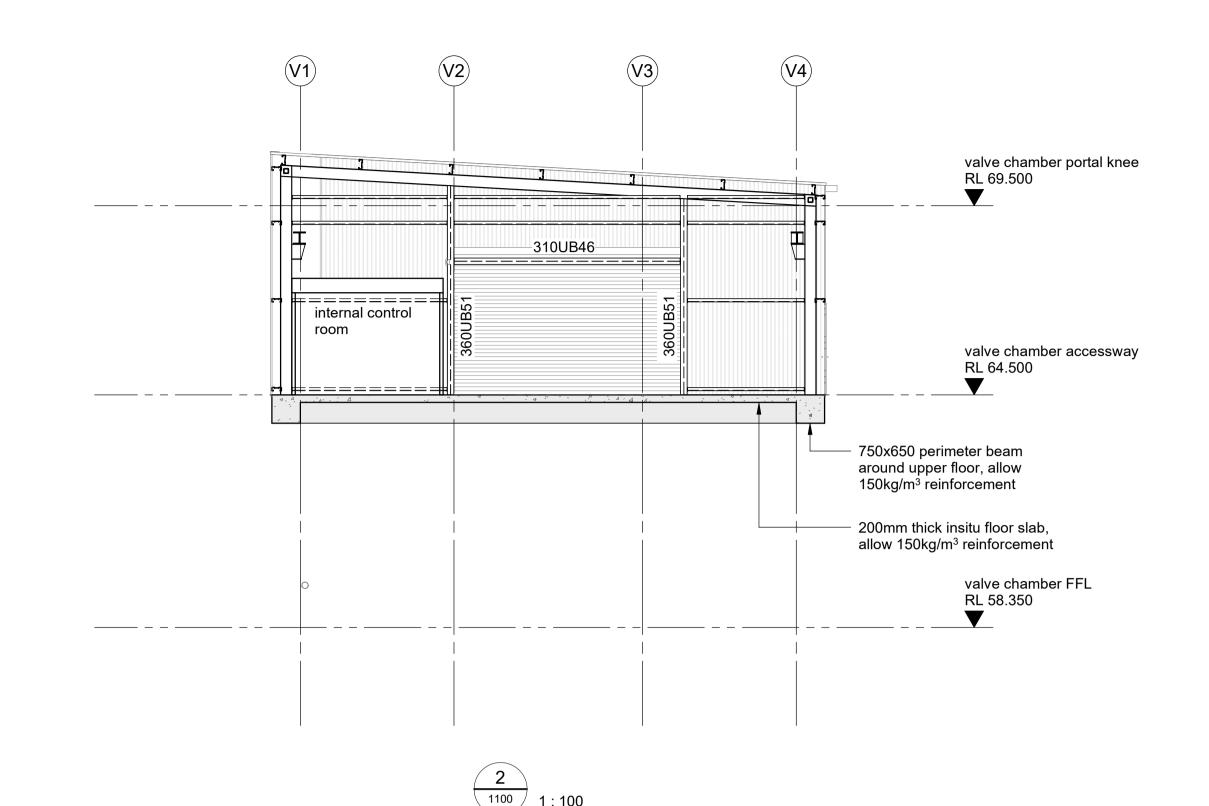

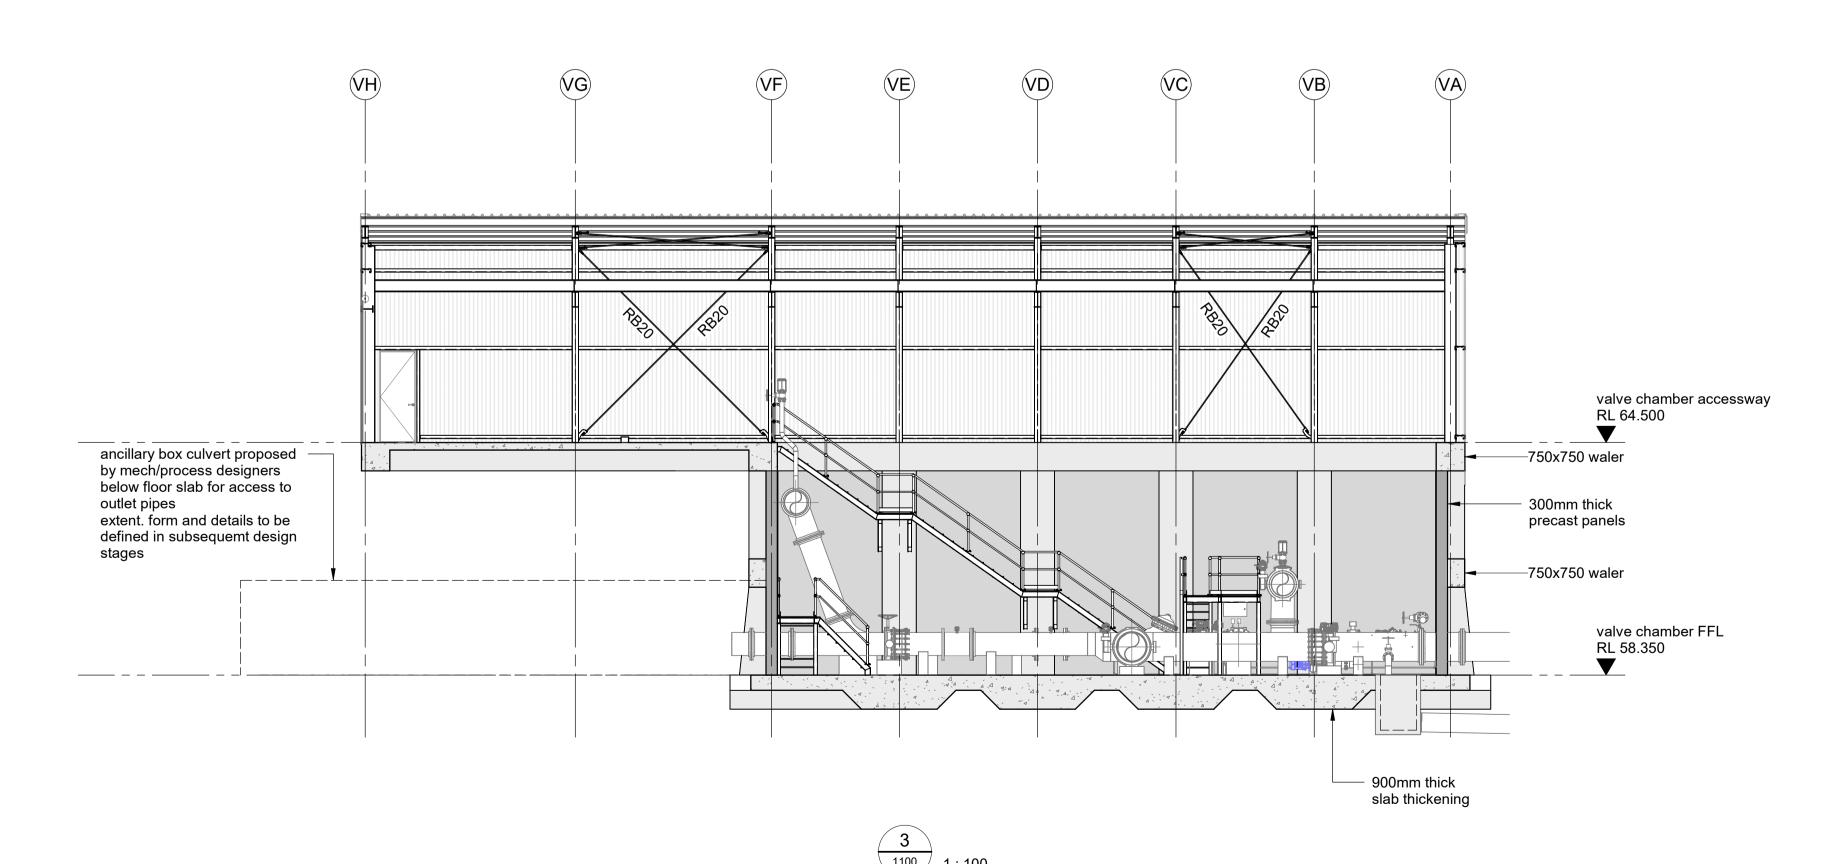



90% PRELIMINARY DESIGN SURVEYED CENTRAL CITY RESERVOIR AND PUMP STATION DESIGNED CPL 23/06/2025 IAF PROJECTS AJW 23/06/2025 DRAWN Hamilton City Council
Te kaunihera o Kirikiriroa 23/06/2025 DLP CAD REVIEW 23/06/2025 Scales 1:100 DESIGN CHECK valve chamber C 100% Prelinimary Design 23/06/2025 DESIGN REVIEW City Waters B 90% Preliminary Design typical sections 08/05/2025 APPROVED CB300-STR-1110 DATE PROF REGISTRATION: REVISION DESCRIPTION Holmes Job Number: 148023.33

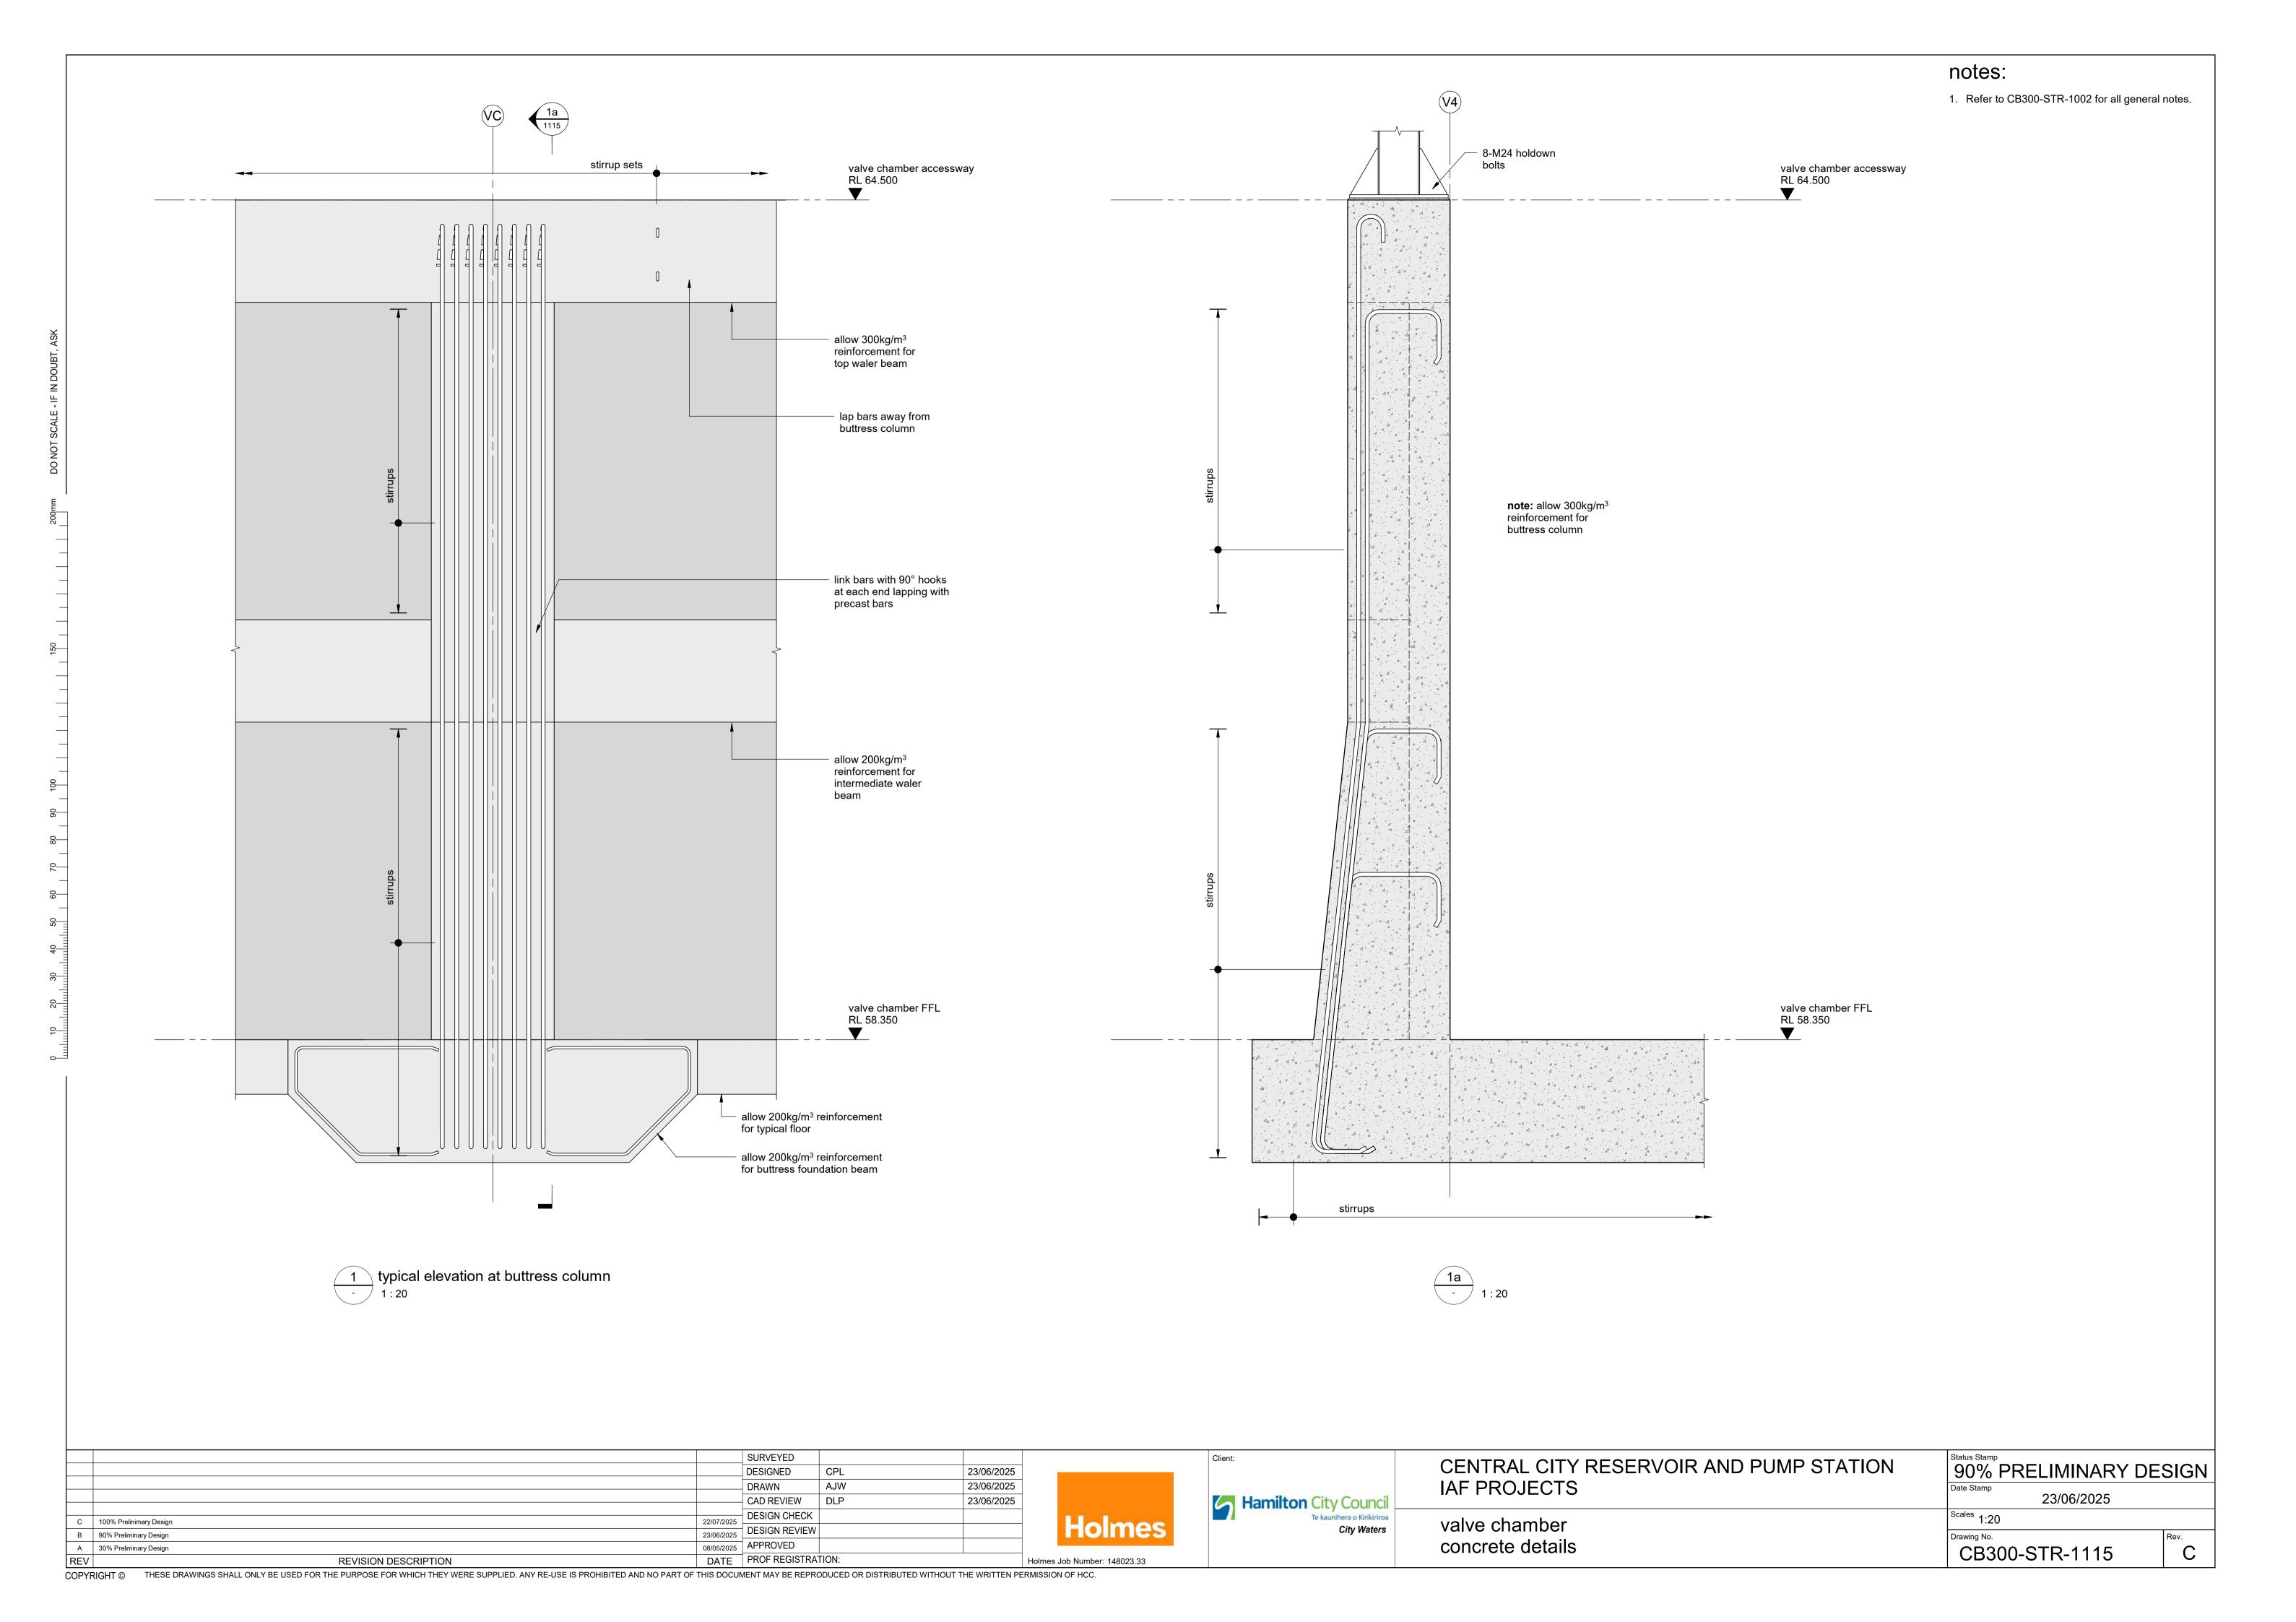


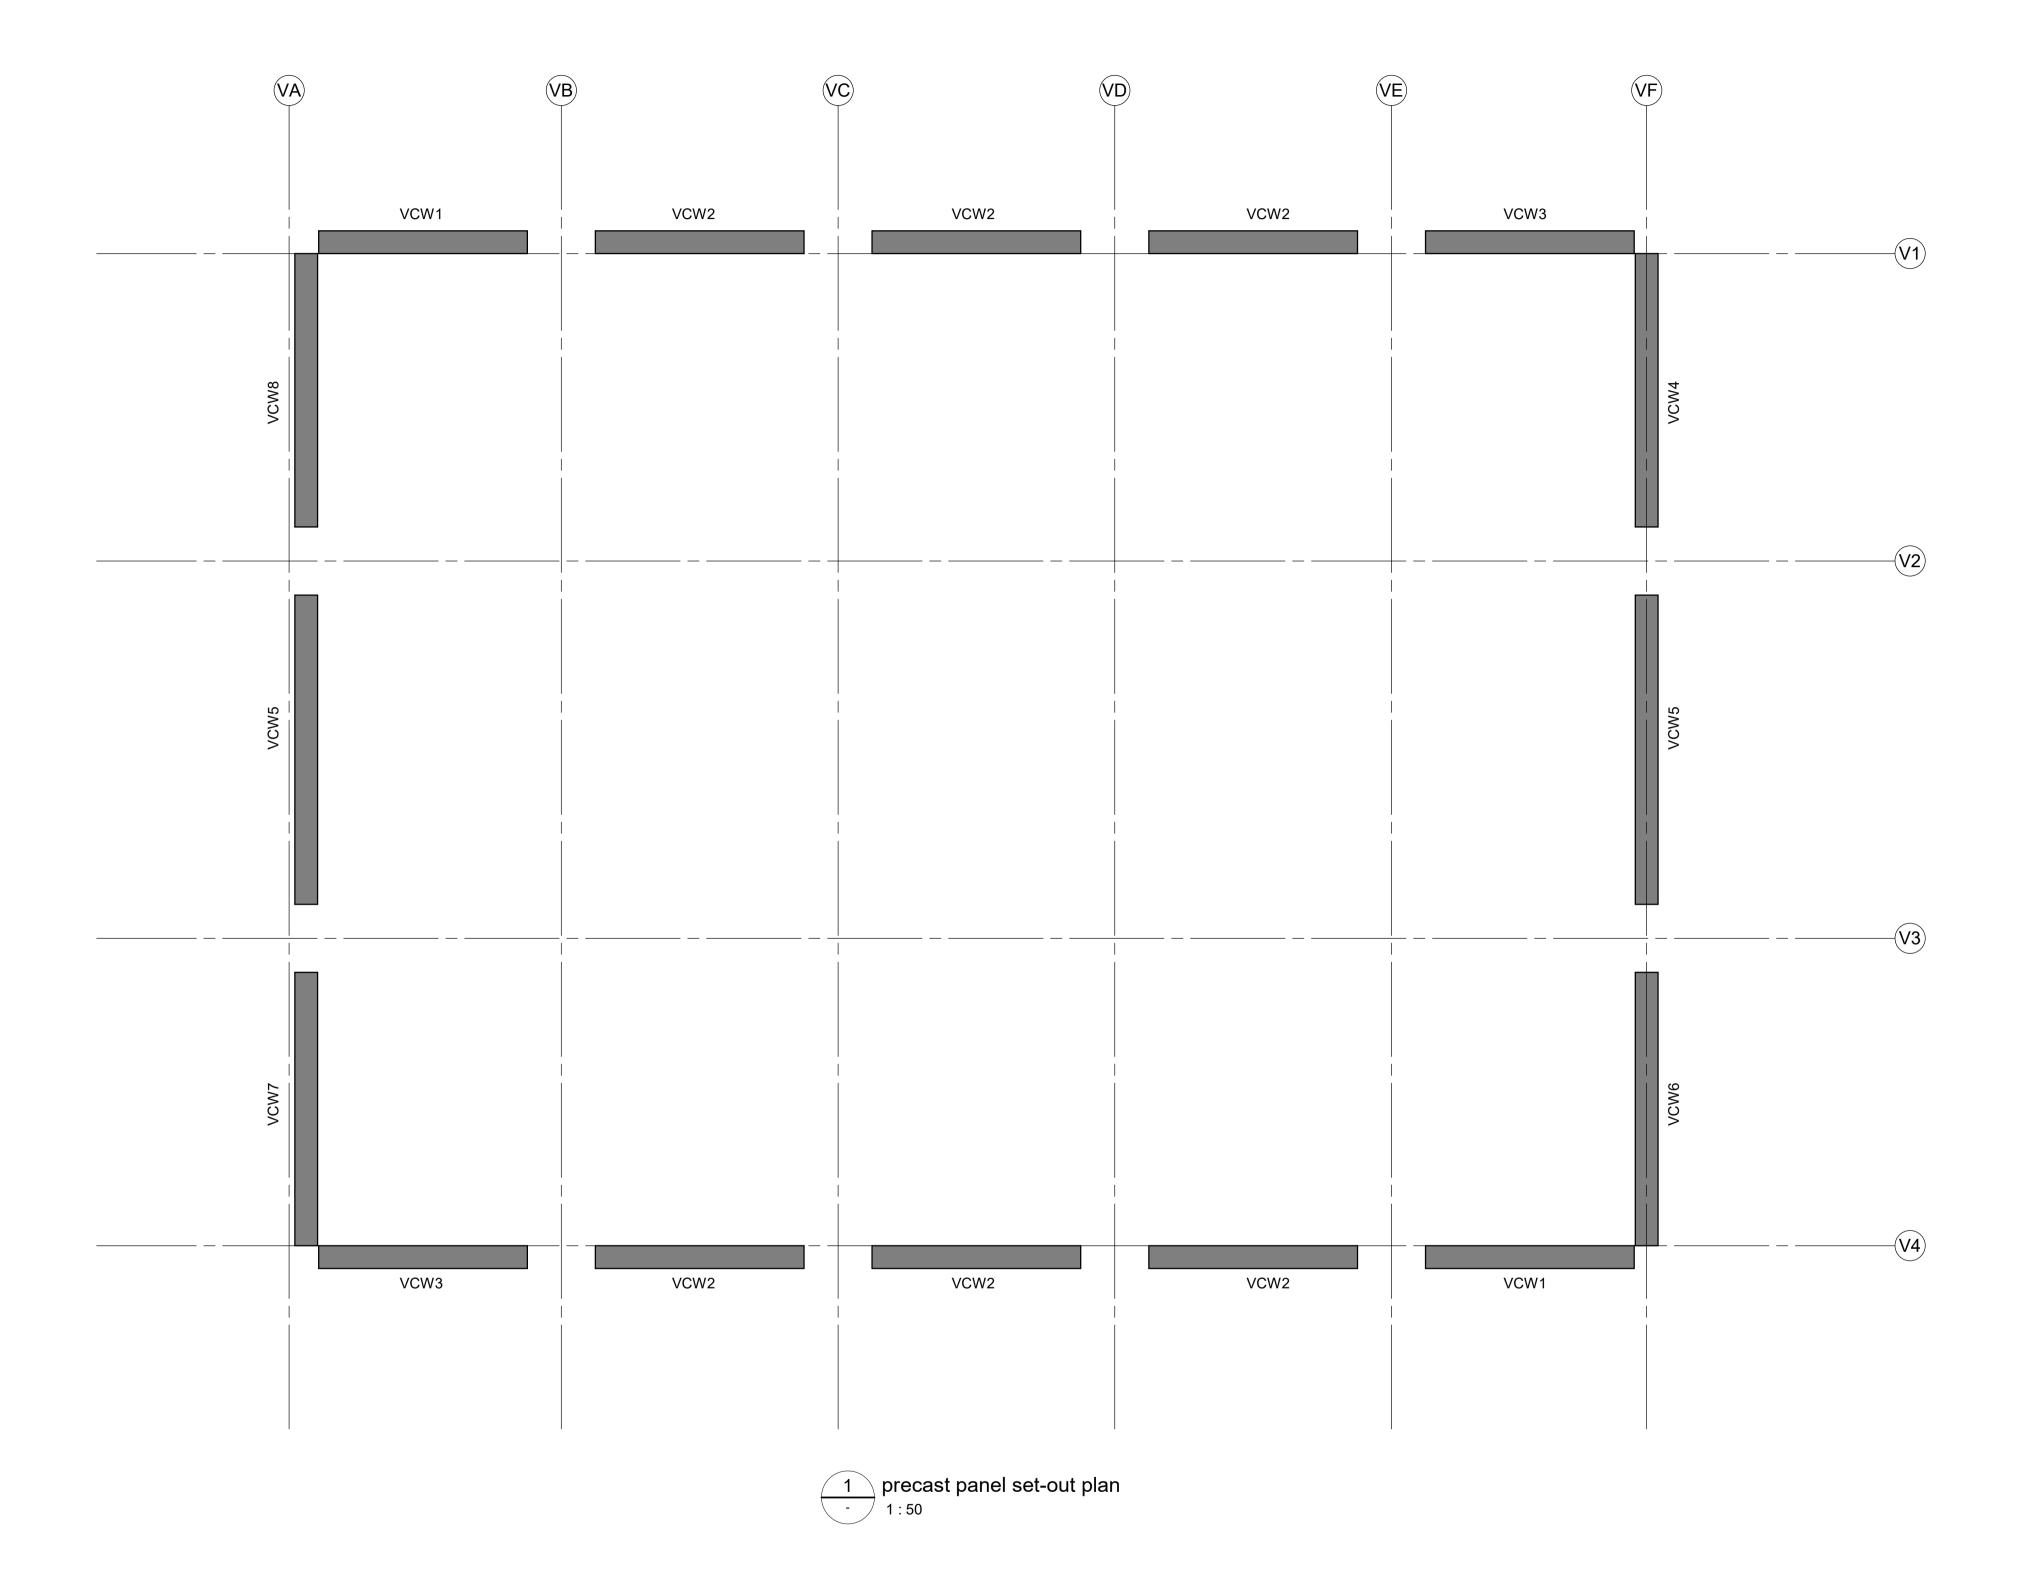



| | | | SURVEYED DESIGNED DRAWN CAD REVIEW | CPL AJW DLP | 23/06/2025 23/06/2025 23/06/2025 | | Client: Hamilton City Council | CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY D Date Stamp 23/06/2025 | DESIGN |
|------------------------------------|--|-----------------------------------|------------------------------------|--------------------------------|--|-----------------------------|-------------------------------|--|---|--------|
| C 100% Prelinimary Design | | 22/07/2025 | DESIGN CHECK | | | Holmos | Te kaunihera o Kirikiriroa | valve chamber | Scales 1:50 | |
| B 90% Preliminary Design | B 90% Preliminary Design | | DESIGN REVIE | | | пошеѕ | City Waters | | Drawing No. | Rev. |
| A 30% Preliminary Design | | 08/05/2025 | APPROVED | | | | | precast panel set-out plan | CB300-STR-1120 | |
| REV | REVISION DESCRIPTION | DATE | PROF REGIST | RATION: | H | olmes Job Number: 148023.33 | | | CD300-311\ - 1120 | |
| COPYRIGHT © THESE DRAWINGS SHALL O | ONLY BE USED FOR THE PURPOSE FOR WHICH THEY WERE SUPPLIED. ANY RE-USE IS PRO | OHIBITED AND NO PART OF THIS DOCU | JMENT MAY BE RE | PRODUCED OR DISTRIBUTED WITHOU | T THE WRITTEN PERM | IISSION OF HCC. | | | | |

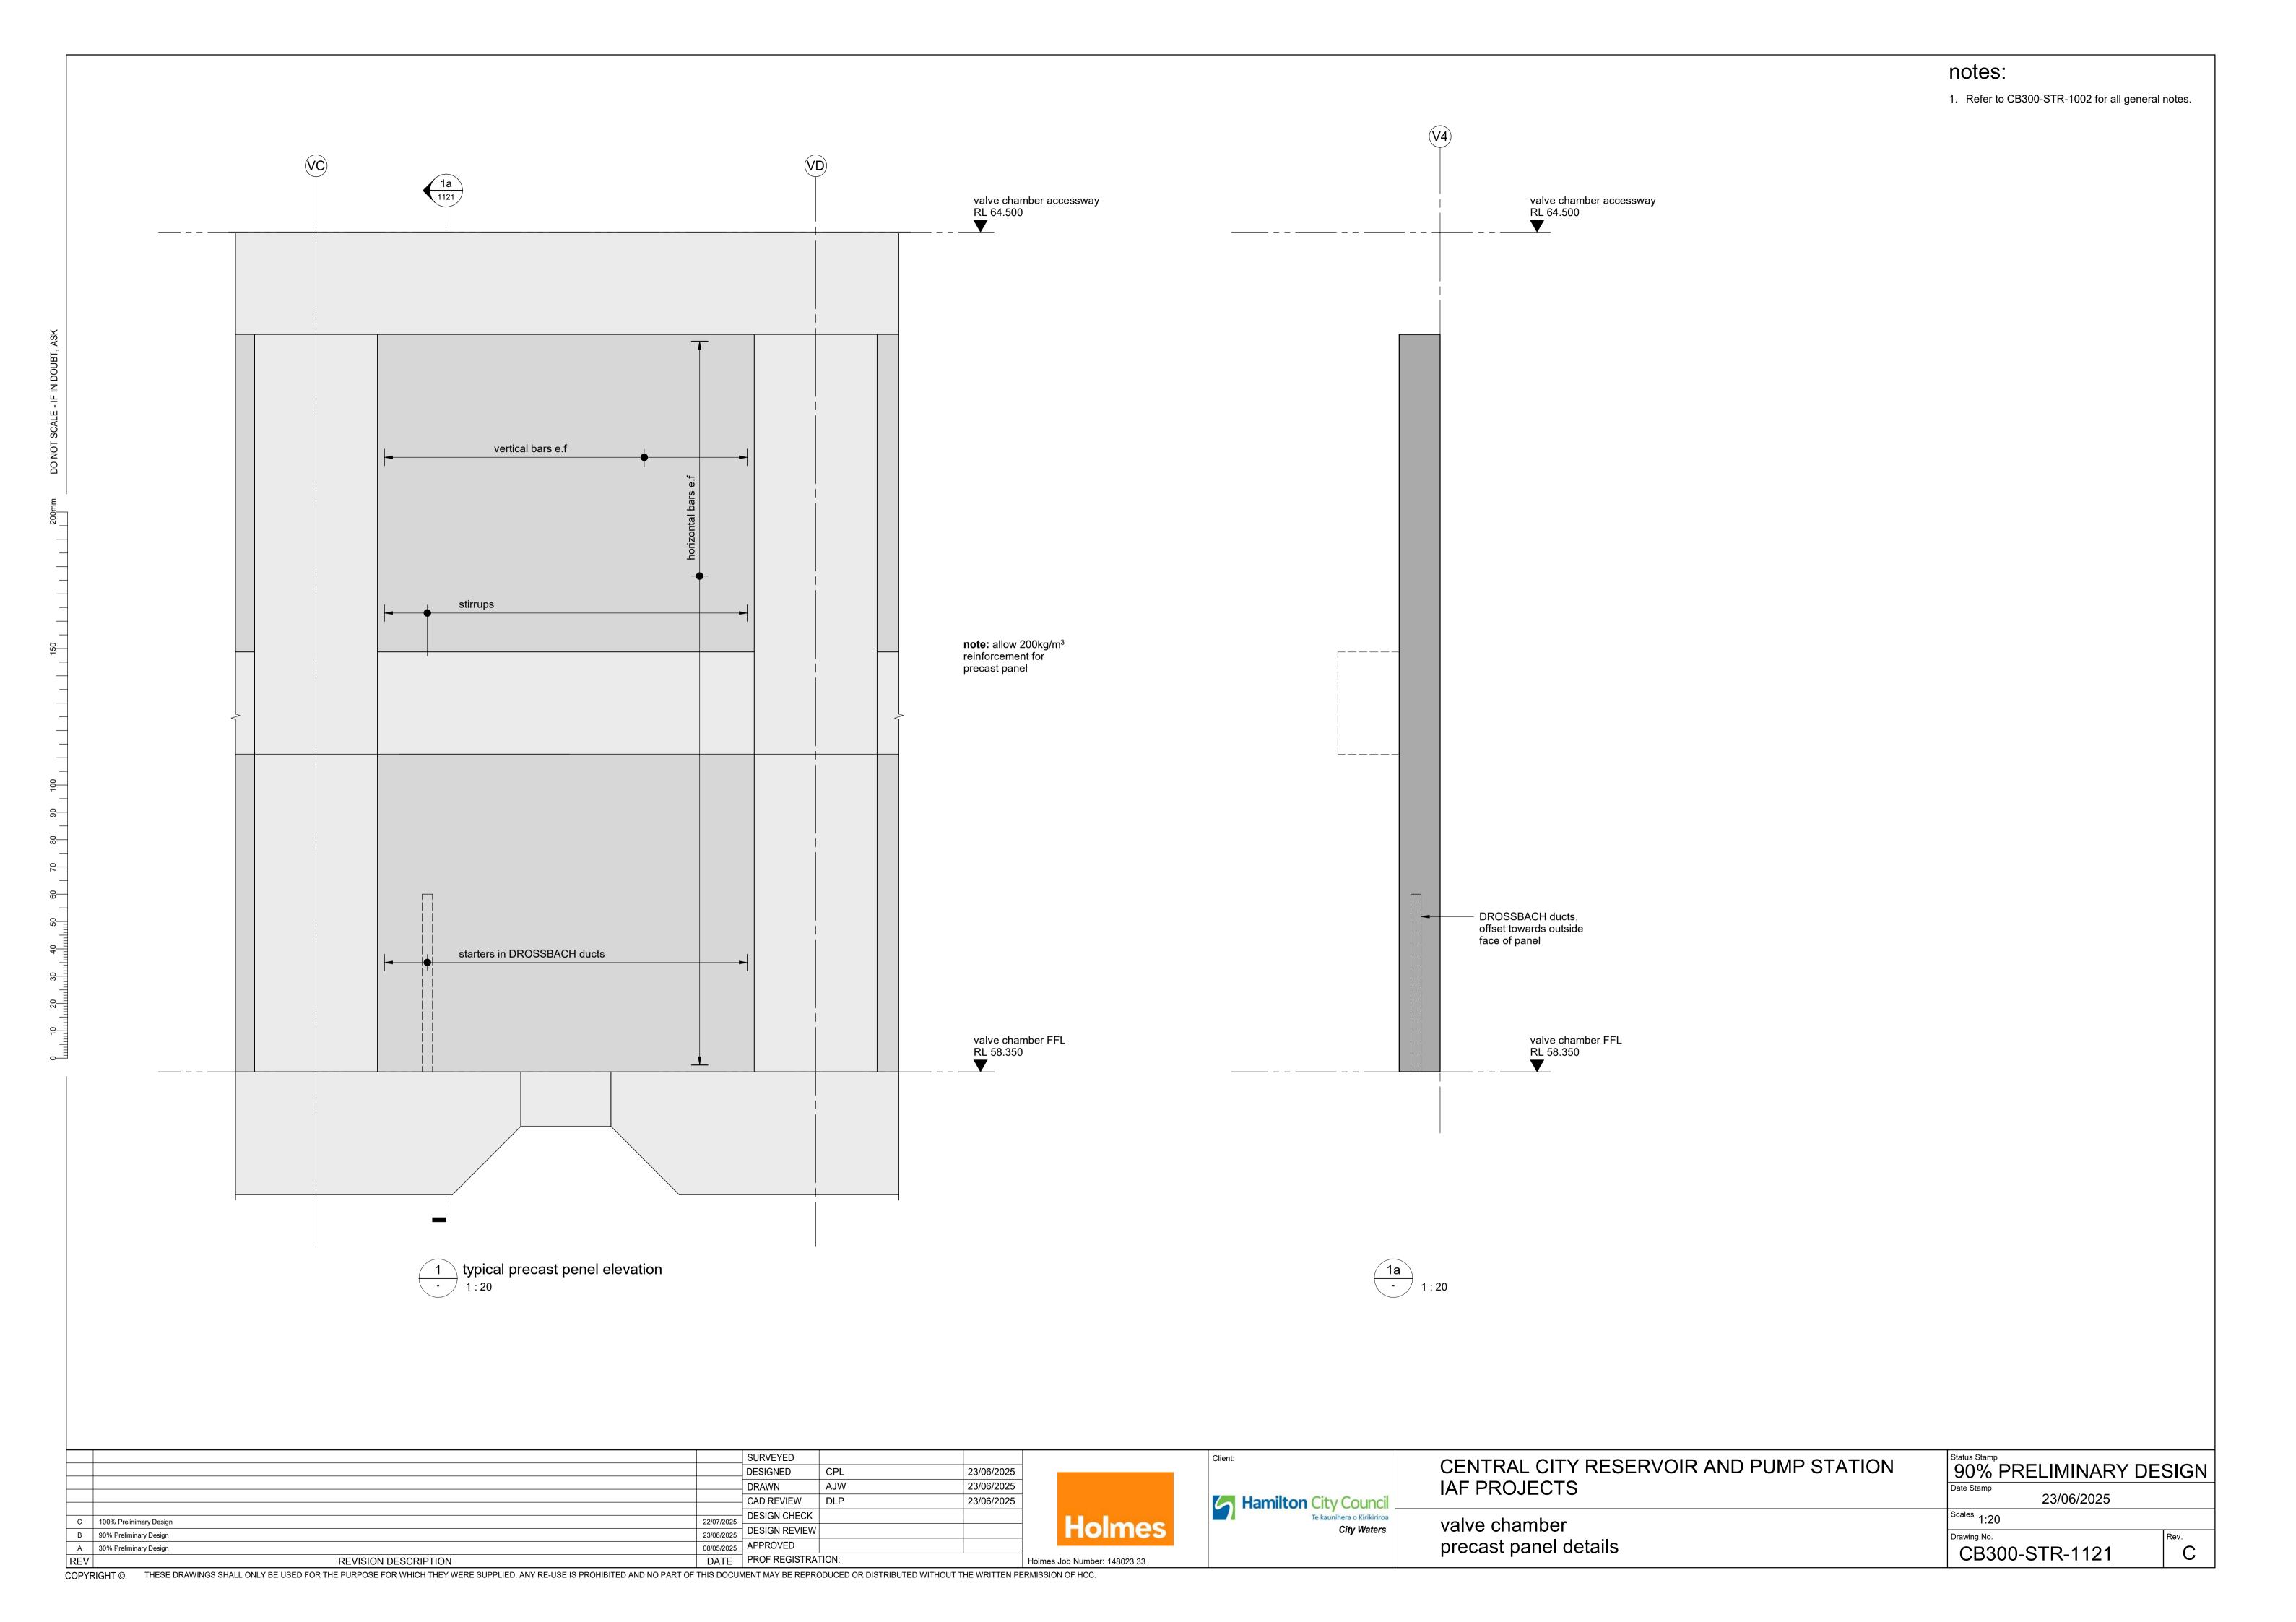

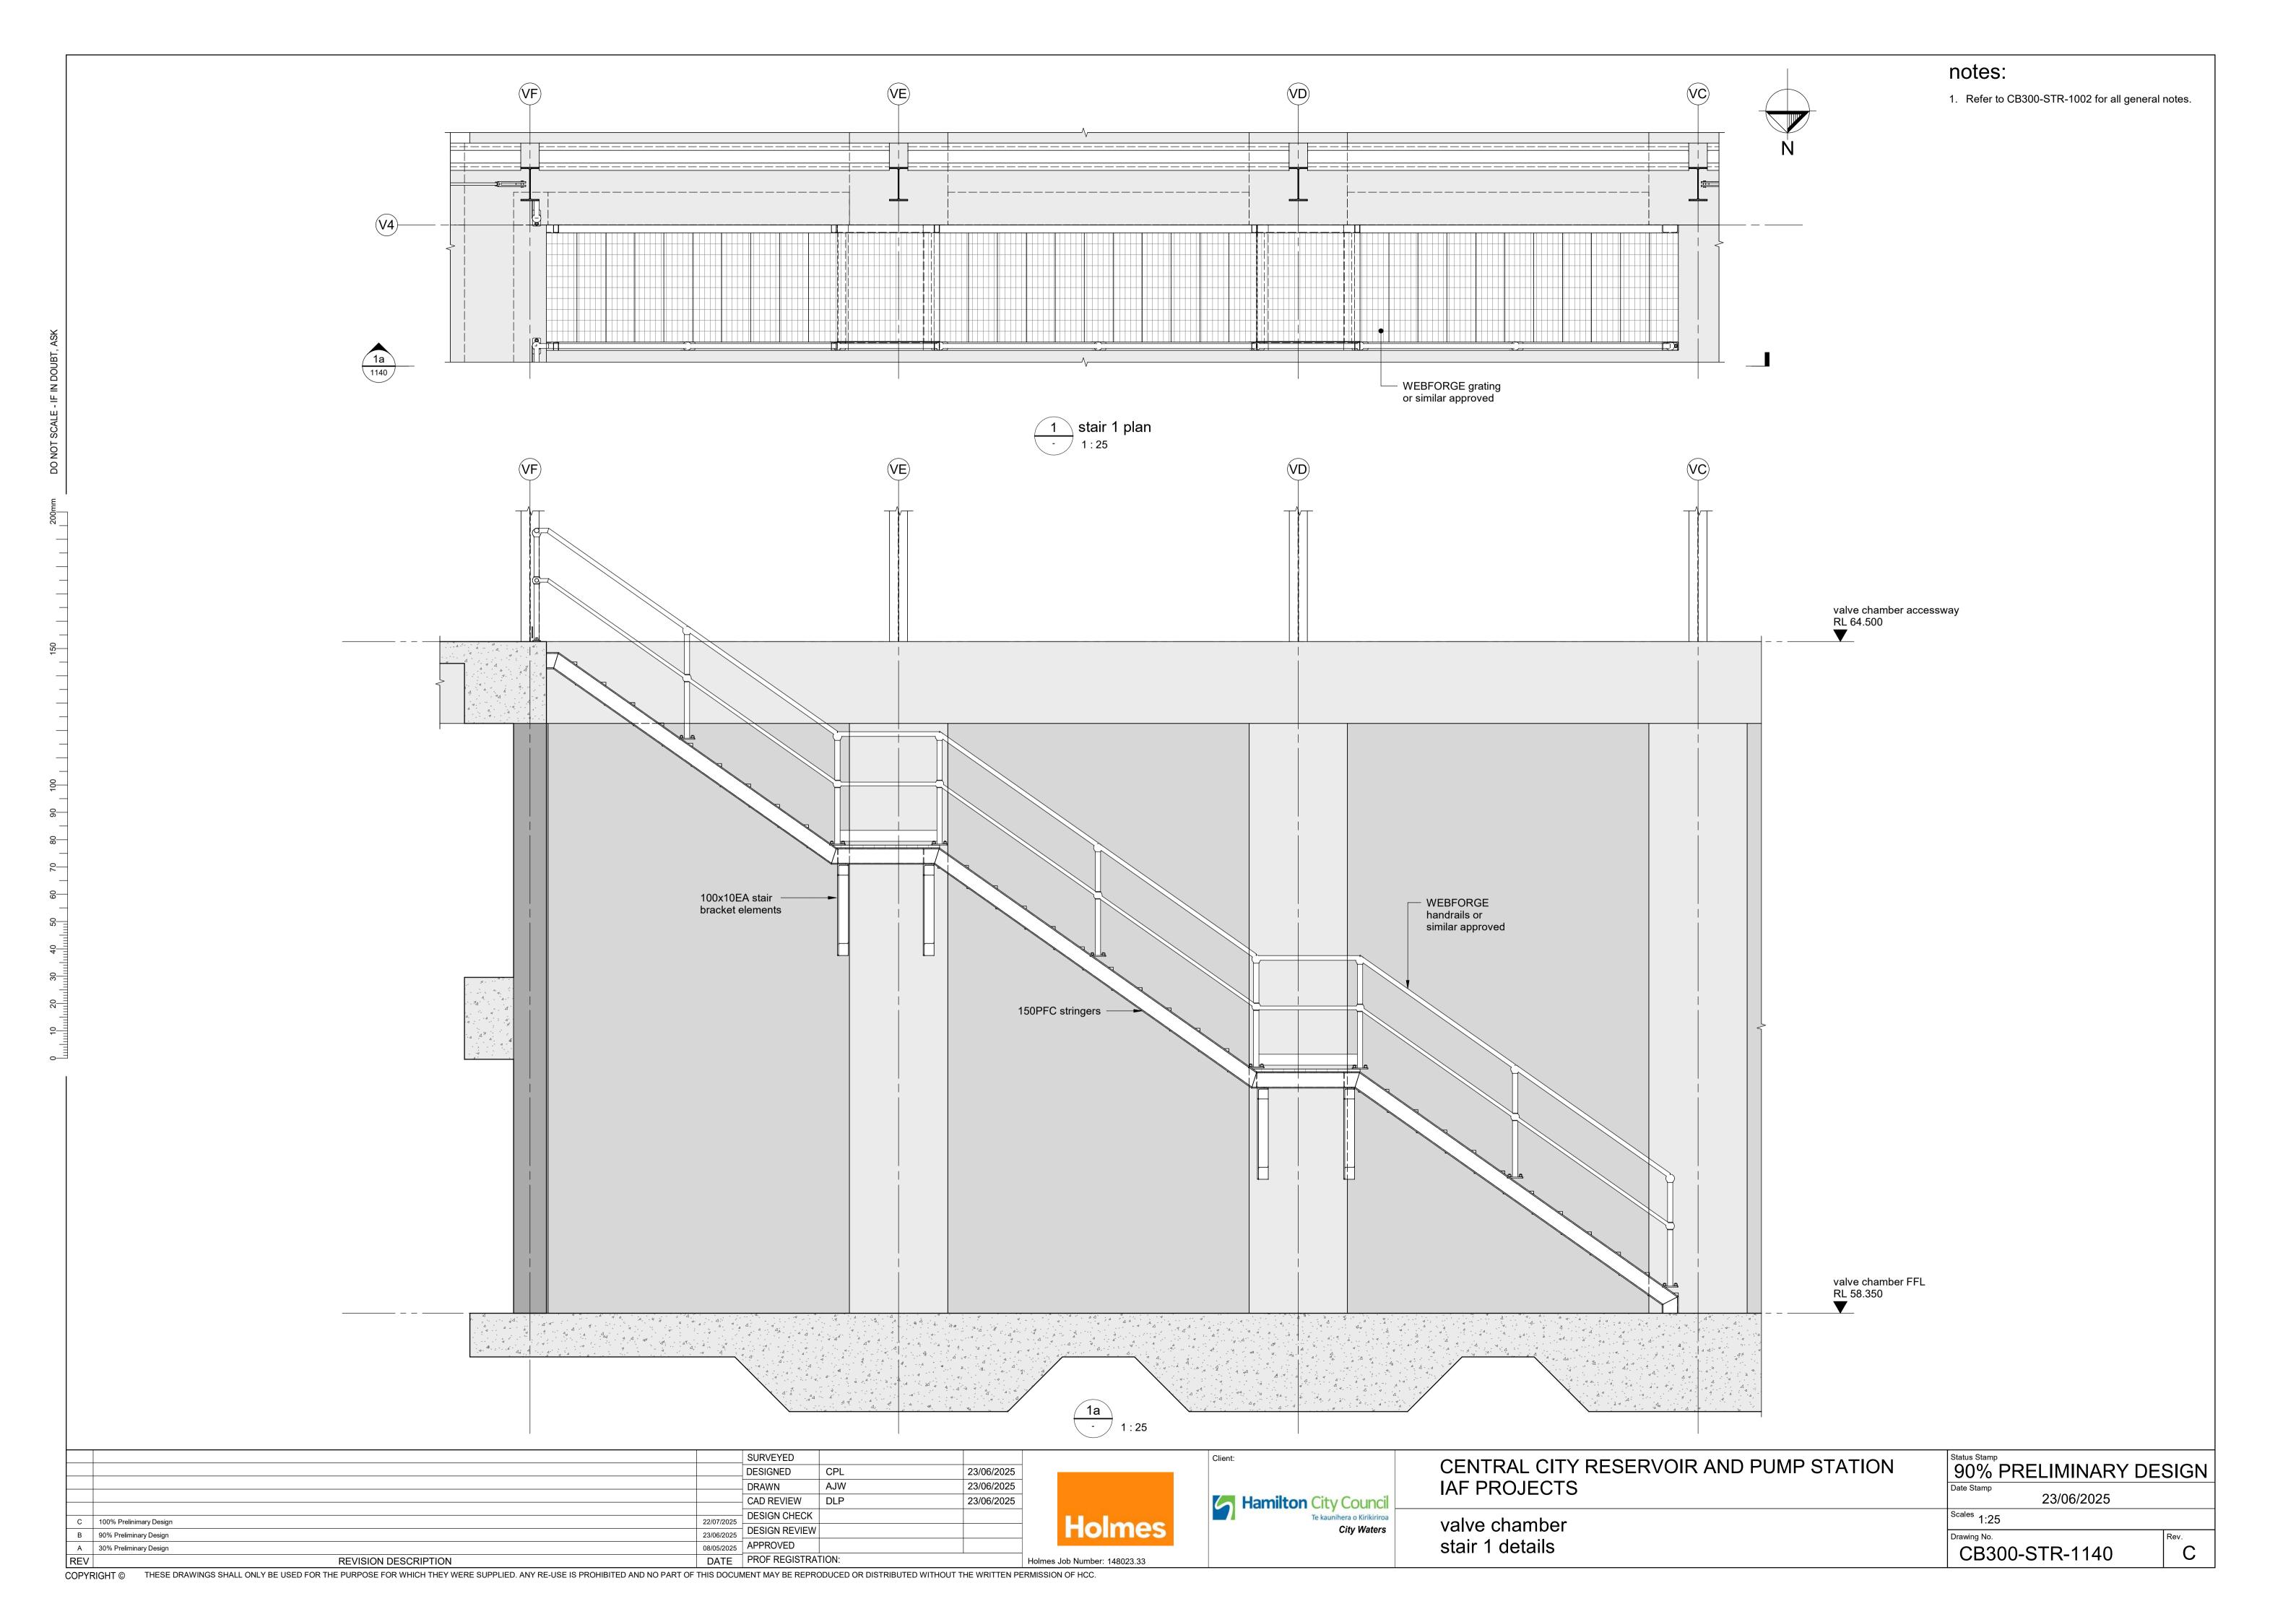

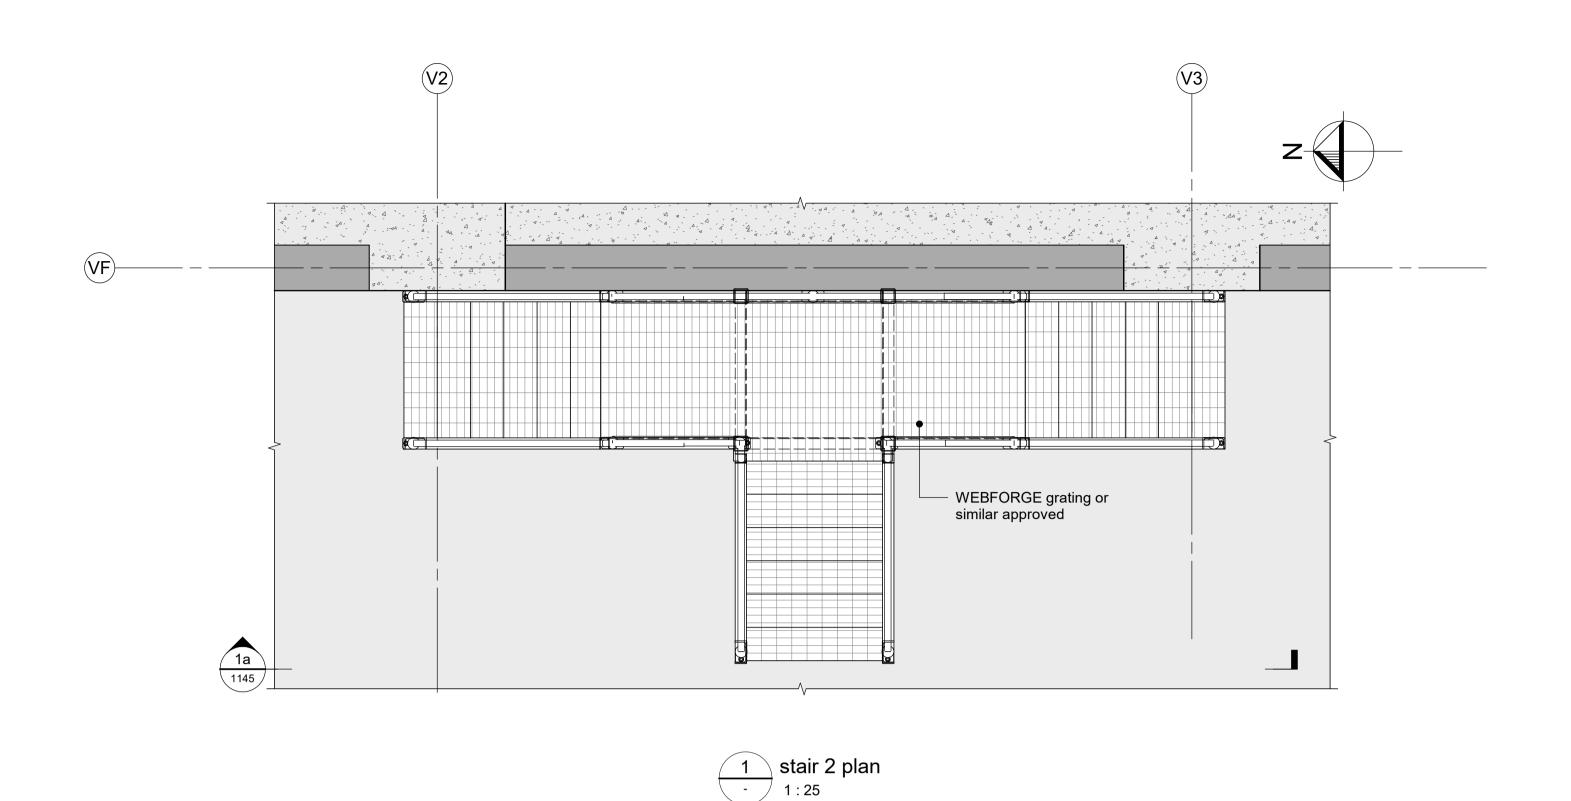

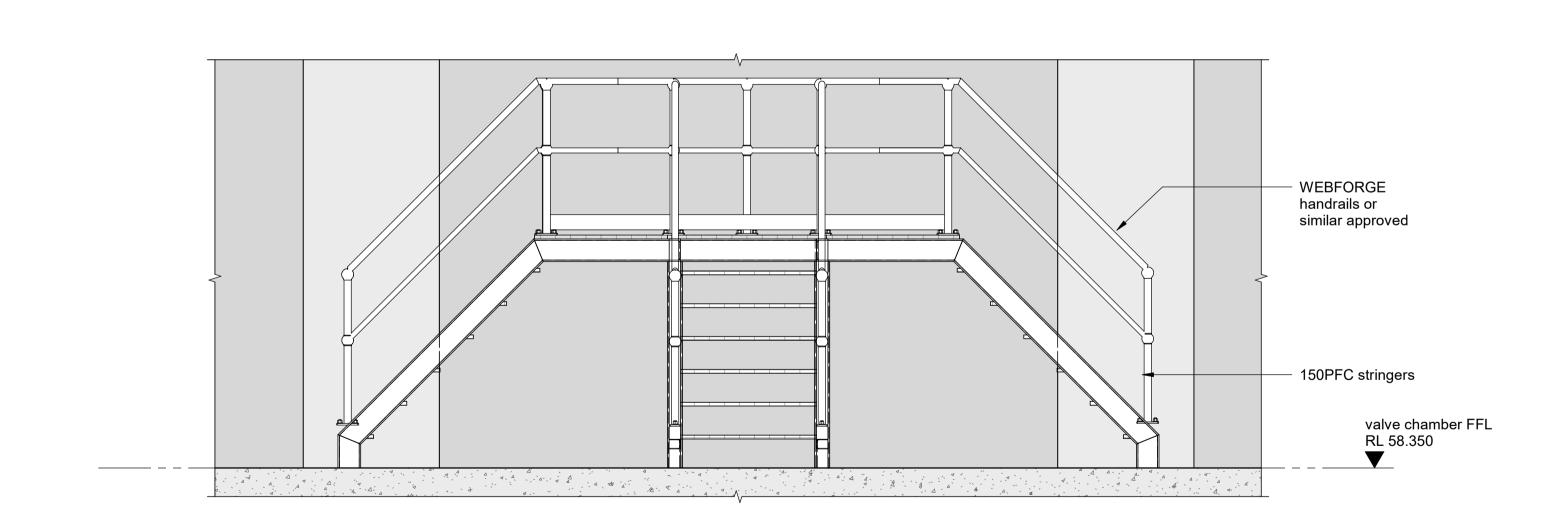



23/06/2025

23/06/2025

23/06/2025

| Holmes | |
|--------|--|

| Client: | | |
|-----------------|---|--|
| Hamilton | City Council Te kaunihera o Kirikiriroa City Waters | |
| Hamilton | Te kaunihera o Kirikiriroa | |

| CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY DESIGN | | | | |
|---|------------------------|------|--|--|--|
| IAF PROJECTS | Date Stamp 23/06/2025 | | | | |
| valve chamber | Scales 1:25 | | | | |
| | CB300-STR-1145 | Rev. | | | |

C 100% Prelinimary Design

B 90% Preliminary Design
A 30% Preliminary Design

SURVEYED DESIGNED


DRAWN


DESIGN CHECK


23/06/2025 DESIGN REVIEW APPROVED

CAD REVIEW DLP

AJW

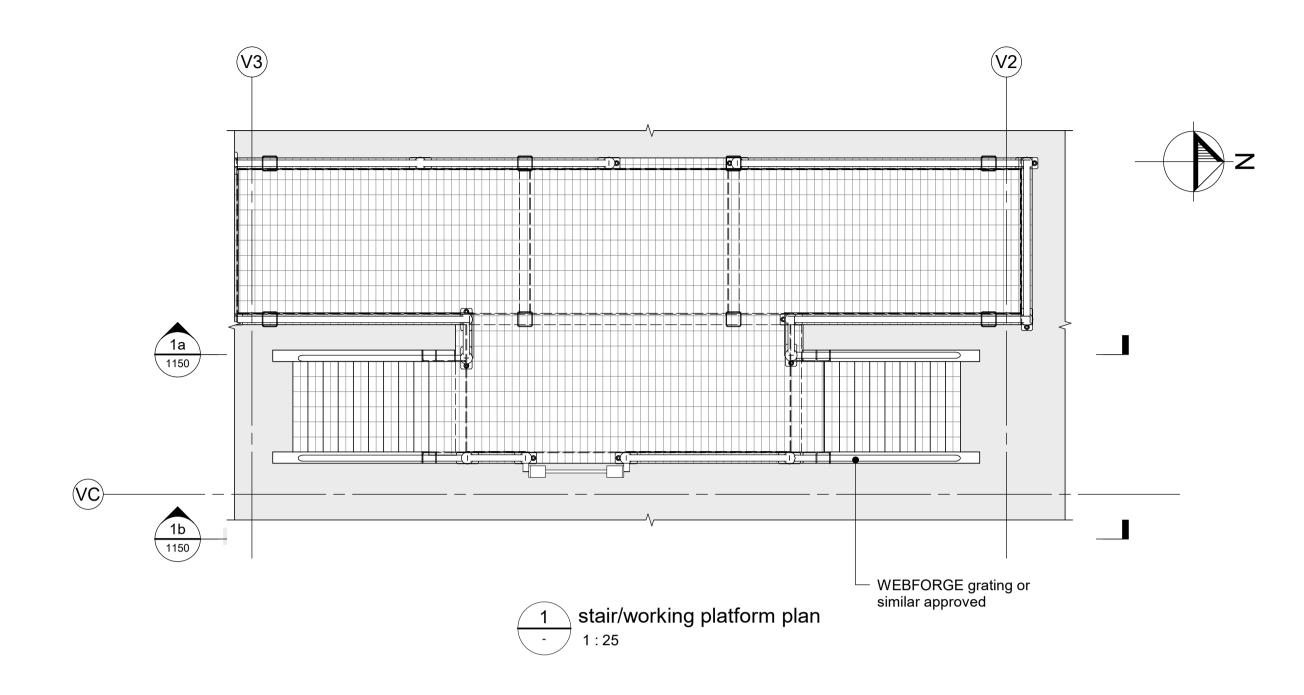

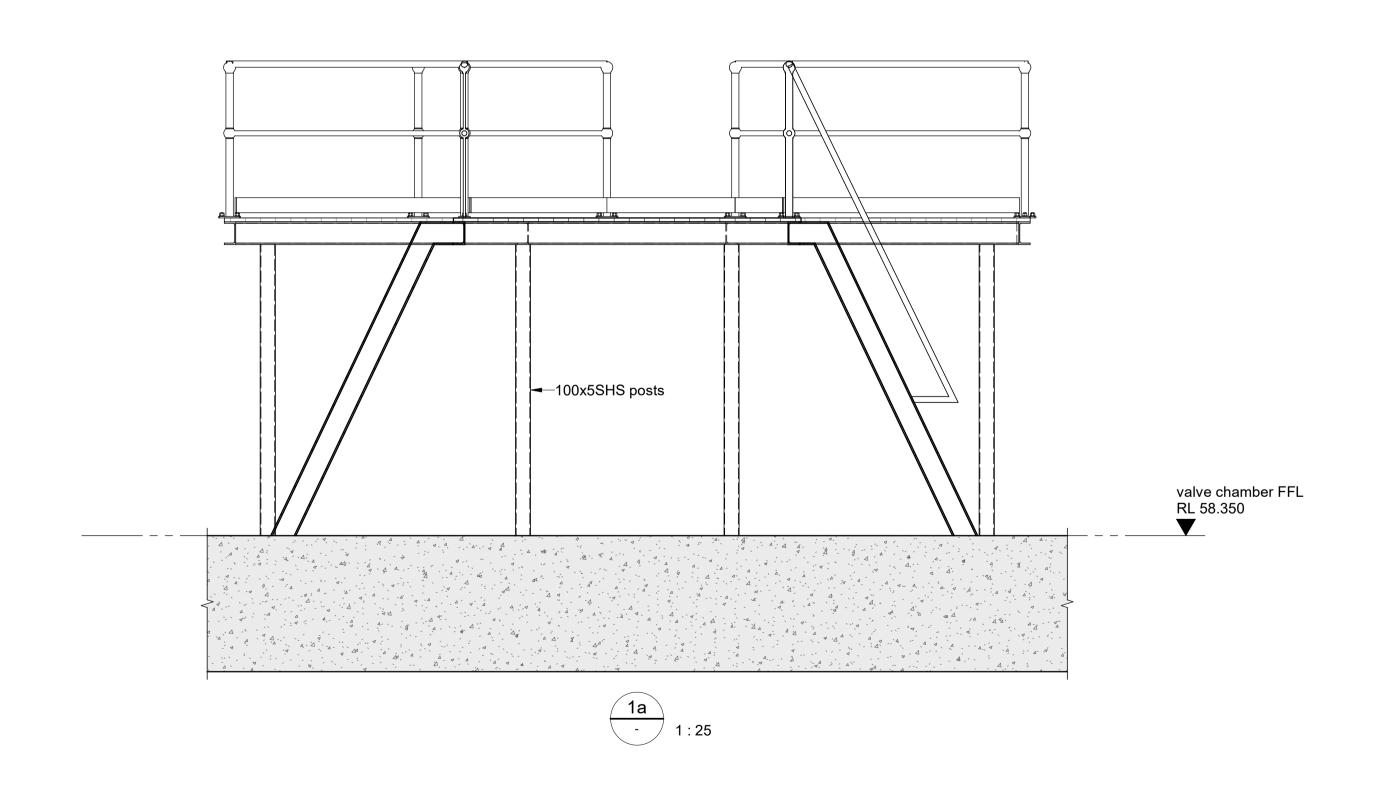

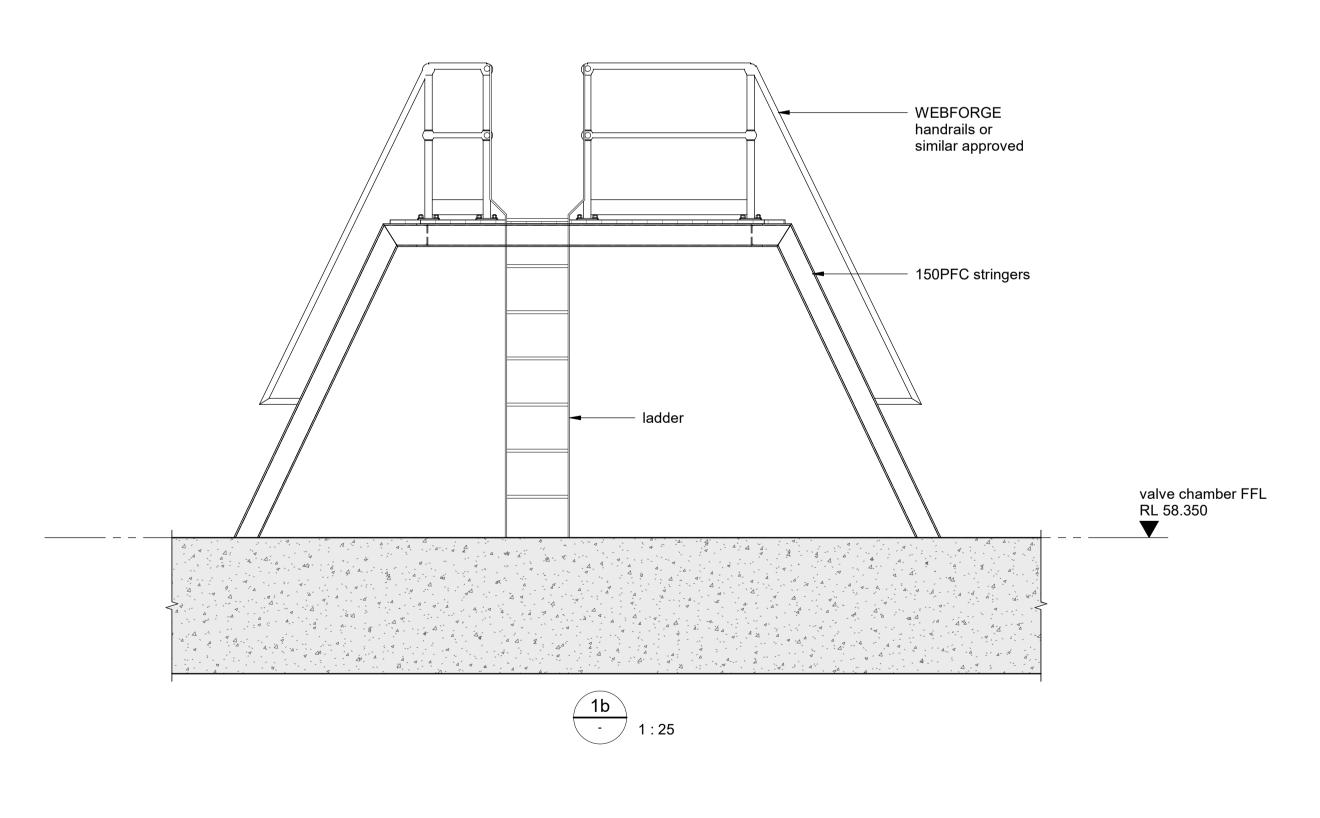


| REV | REVISION DESCRIPTION | DATE | PROF REGISTRA | TION: | ' | Holmes Job N |
|-----|-------------------------|------------|---------------|-------|------------|--------------|
| Α | 30% Preliminary Design | 08/05/2025 | APPROVED | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | | |
| С | 100% Prelinimary Design | 22/07/2025 | | | | 1 |
| | | | DESIGN CHECK | | | |
| | | | CAD REVIEW | DLP | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | |
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | SURVEYED | | | |





| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY DESIGN Date Stamp 23/06/2025 | | | |
|--|--|--|--|--|
| valve chamber | Scales 1:25 | | | |
| stair/working platform | CB300-STR-1150 Rev. | | | |

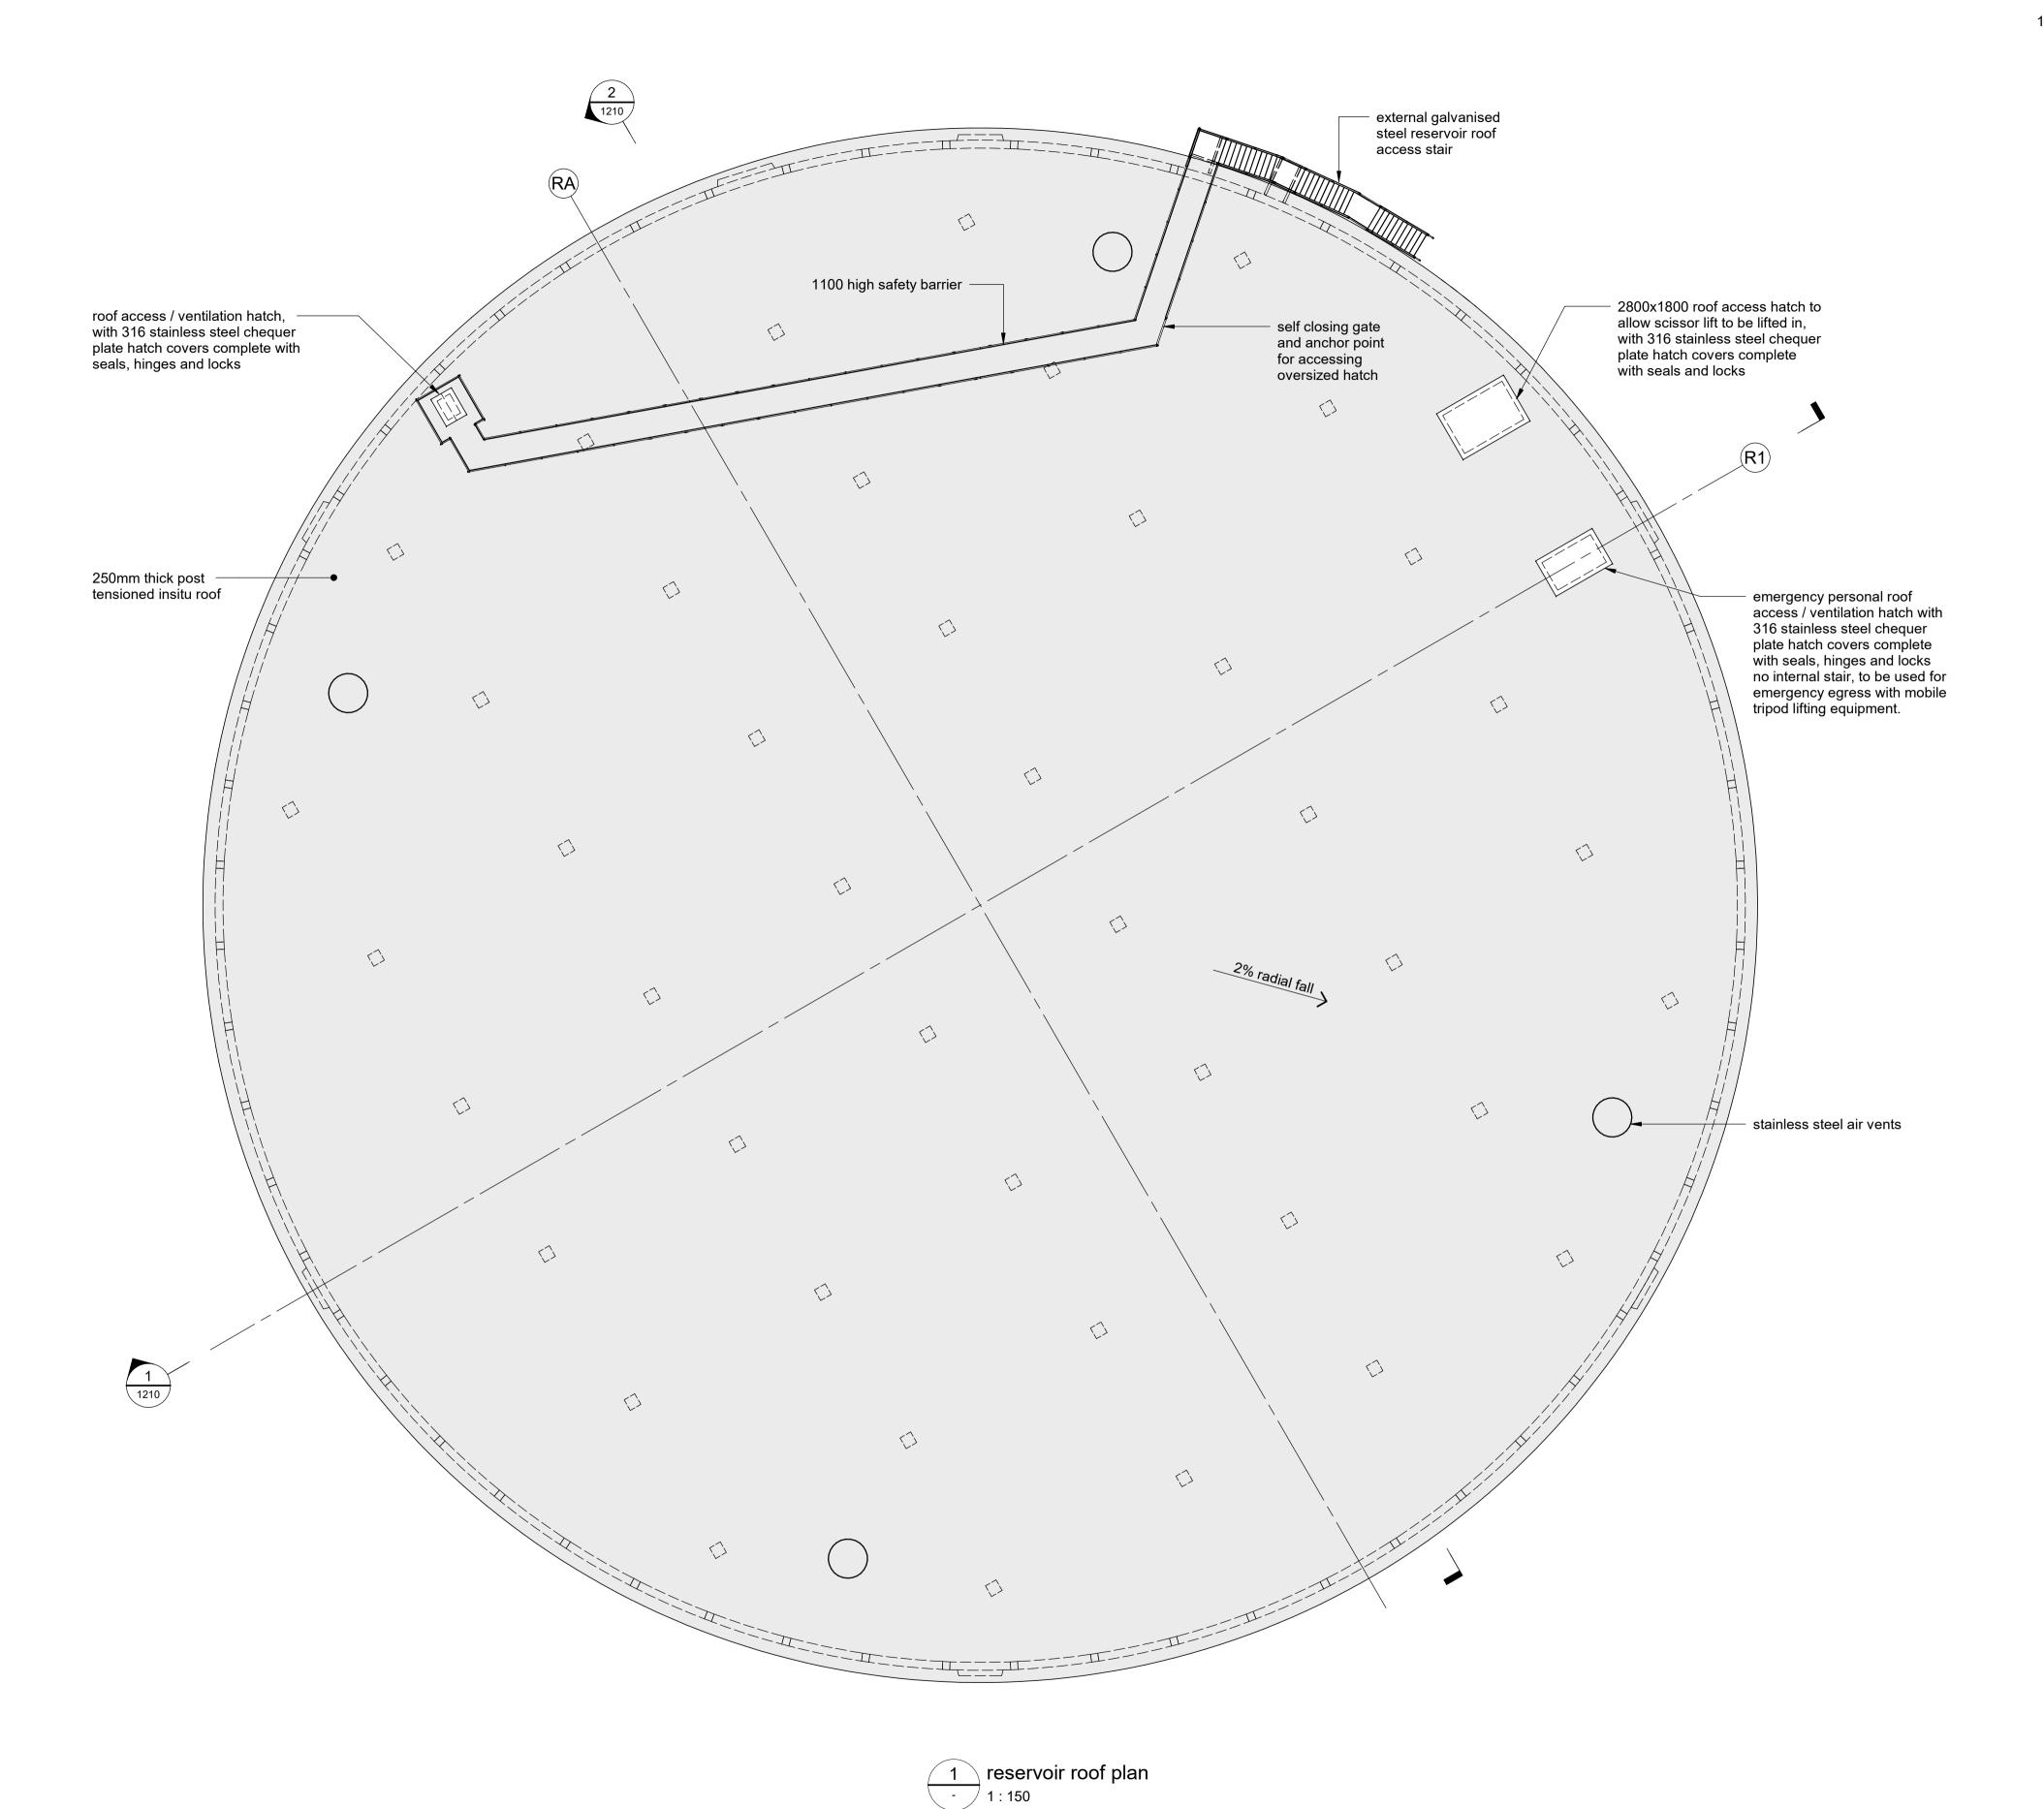

23/06/2025 23/06/2025 23/06/2025

Hamilton City Council
Te kaunihera o Kirikiriroa
City Waters

CENTRAL CITY RESERVOIR AND PUMP STATION
IAF PROJECTS

Pate Stamp
23/06/2025

Scales 1:150

Drawing No.
CB300-STR-1201

C

CENTRAL CITY RESERVOIR AND PUMP STATION
90% PRELIMINARY DESIGN
23/06/2025

CB300-STR-1201

C

REVISION DESCRIPTION DATE PROF REGISTRATION: Holmes Job Number COPYRIGHT © THESE DRAWINGS SHALL ONLY BE USED FOR THE PURPOSE FOR WHICH THEY WERE SUPPLIED. ANY RE-USE IS PROHIBITED AND NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR DISTRIBUTED WITHOUT THE WRITTEN PERMISSION OF HCC.

C 100% Prelinimary Design

B 90% Preliminary Design

SURVEYED

DESIGNED

CAD REVIEW

DESIGN CHECK

AJW

DRAWN

23/06/2025 DESIGN REVIEW

08/05/2025 APPROVED


- 1. Refer to CB300-STR-1002 for all general notes.
- 2. Post tensioning notes:
- All post-tensioning tendons to be 5-f15.2 strands, stressed to 0.7 UTS (875kN).
- B. Anchor heads to be VSL S6-5 or similar
- C. Tendon ducts assumed to be galv steel corrugated flat ducts nom. 90mm w x 20mm h.
- D. Allow for double-end stressing to all tendons.
- E. All ducts to be grouted after stressing.
- F. Tendon anchorage stressing pockets to be grouted with min 40 MPa grout.
- G. Tendons drape along their length high are walls then diverge towards centre of floor.
- H. Stressing of tendons to be done in two stages as the concrete cures.

| | | | PROF REGISTRA | | |
|---|-------------------------|------------|---------------|-----|------------|
| Α | 30% Preliminary Design | 08/05/2025 | APPROVED | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | |
| С | 100% Prelinimary Design | 22/07/2025 | | | |
| | | | DESIGN CHECK | | |
| | | | CAD REVIEW | DLP | 23/06/2025 |
| | | | DRAWN | AJW | 23/06/2025 |
| | | | DESIGNED | CPL | 23/06/2025 |
| | | | SURVEYED | | |







| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY DESIGN Date Stamp 23/06/2025 | | | |
|--|--|--|--|--|
| reservoir | Scales 1:150 | | | |
| floor reinforcing plan | CB300-STR-1205 Rev. | | | |

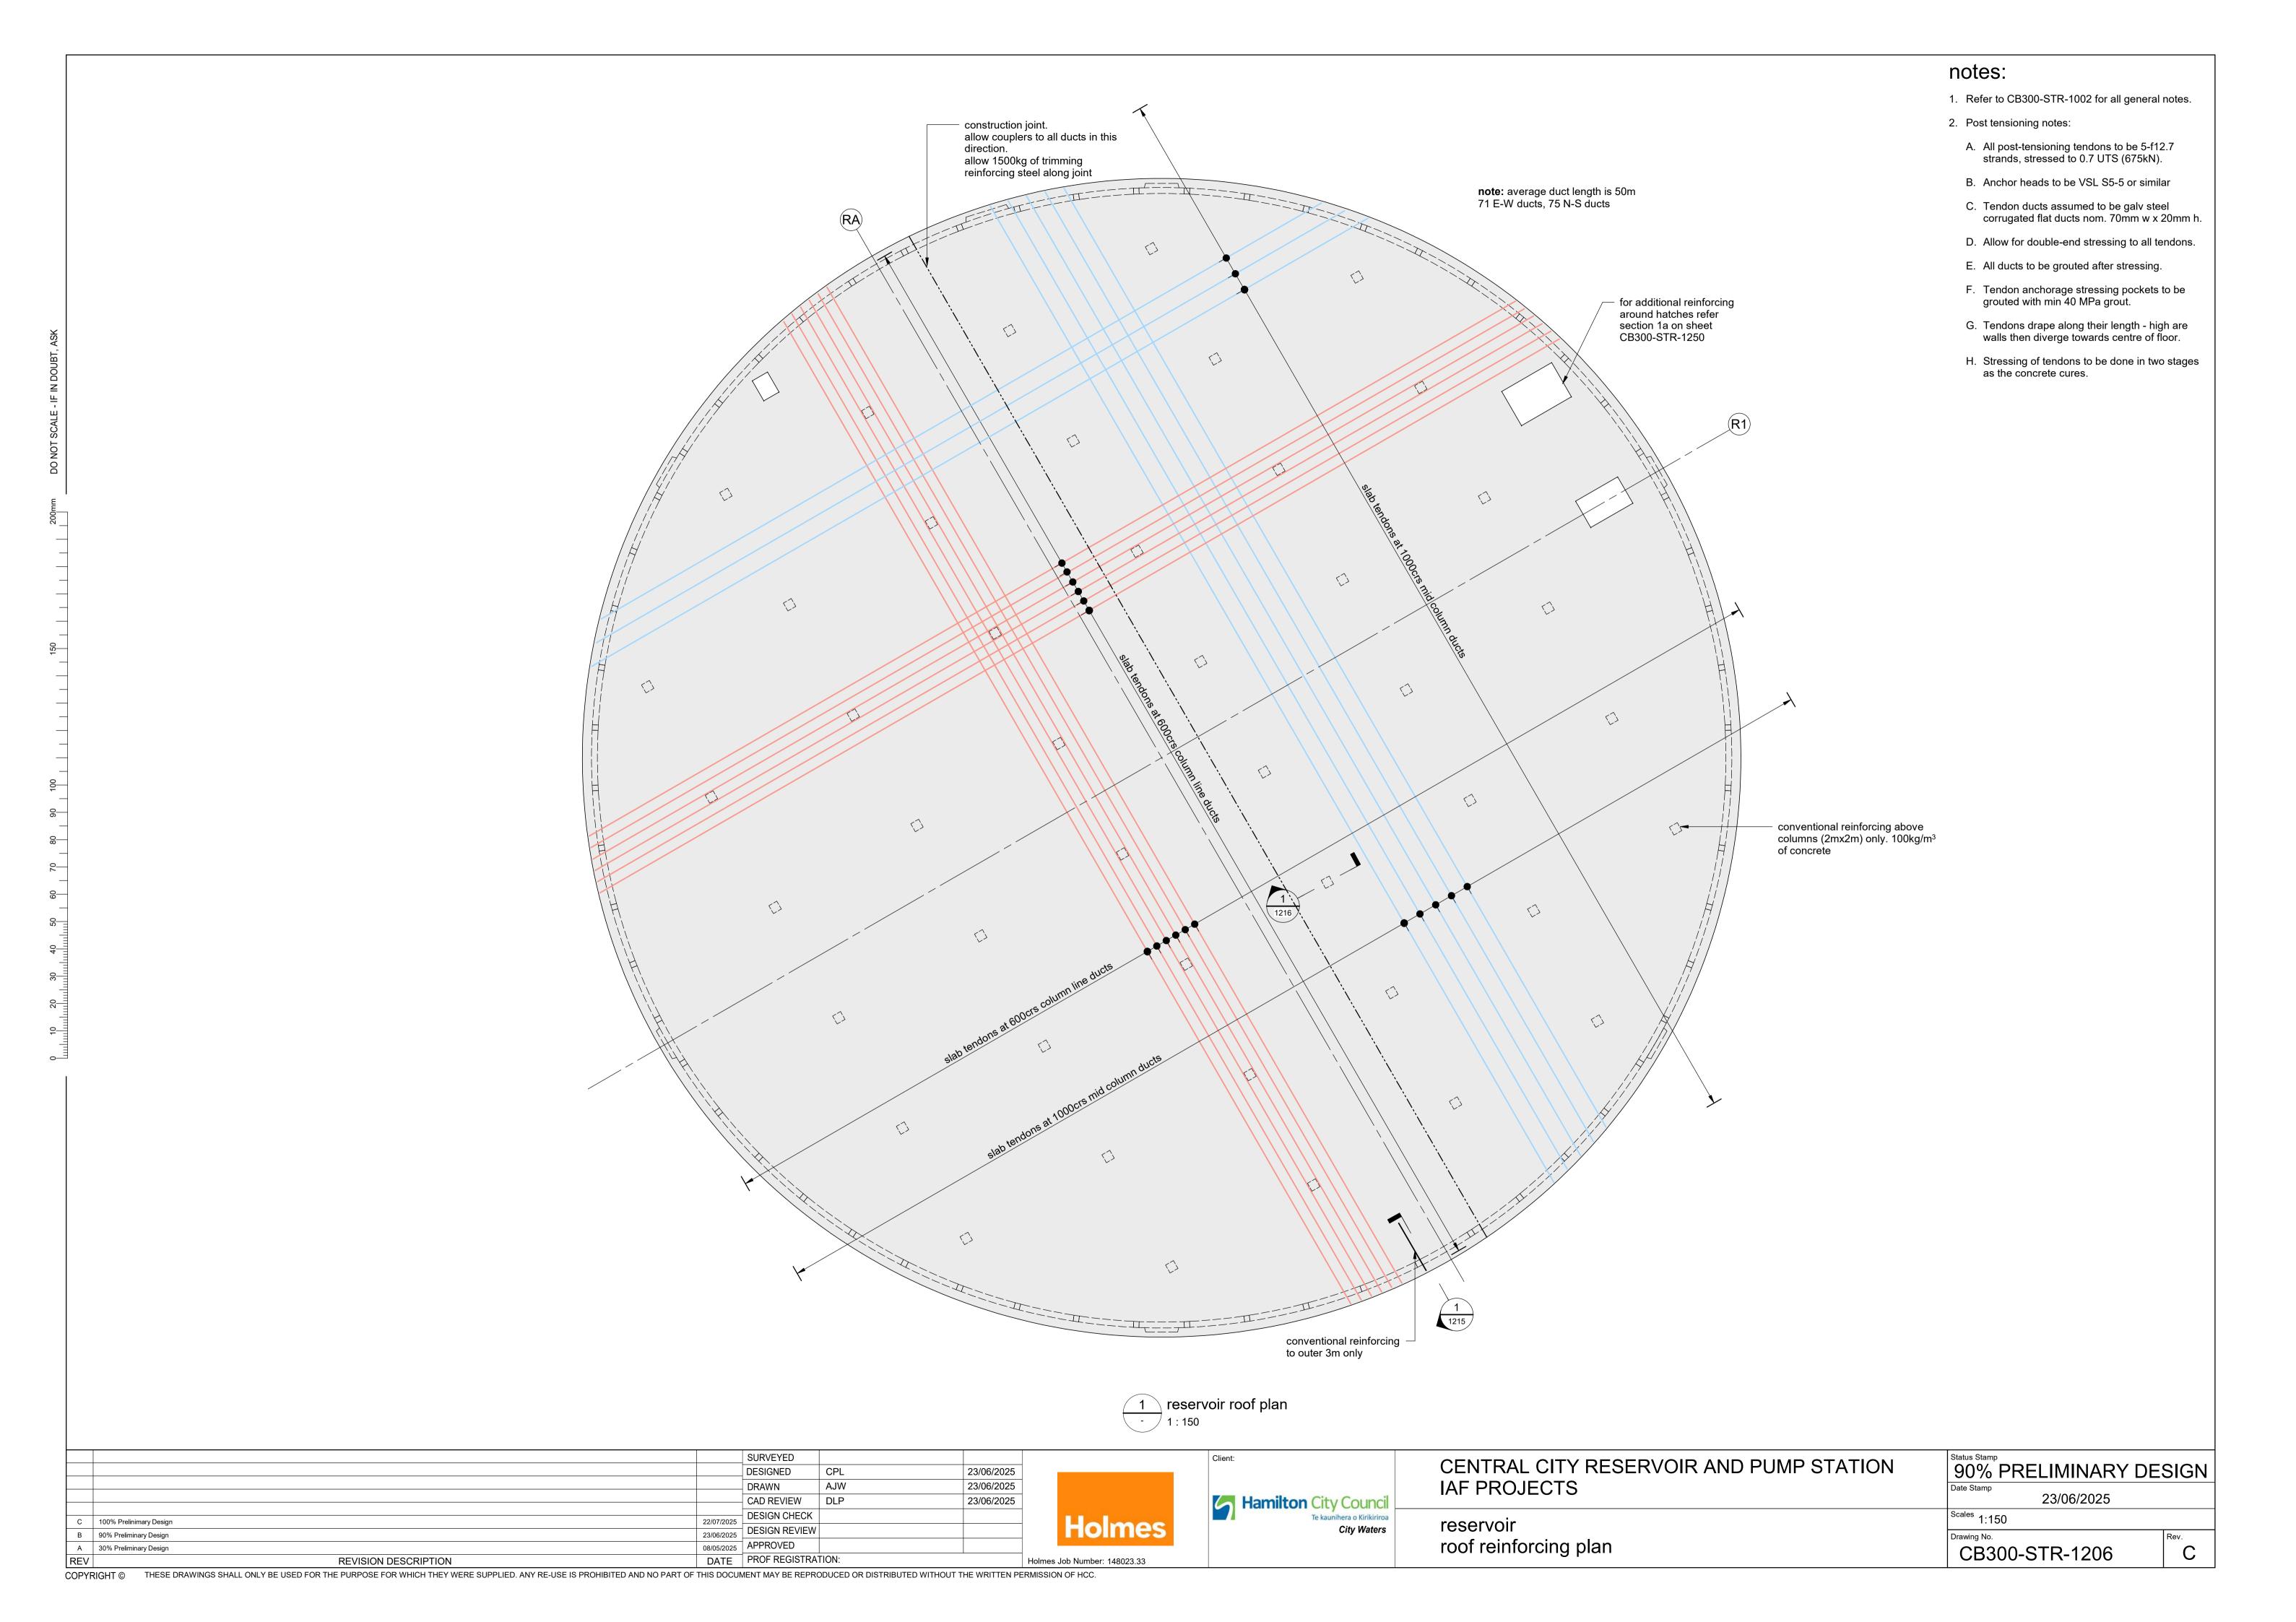




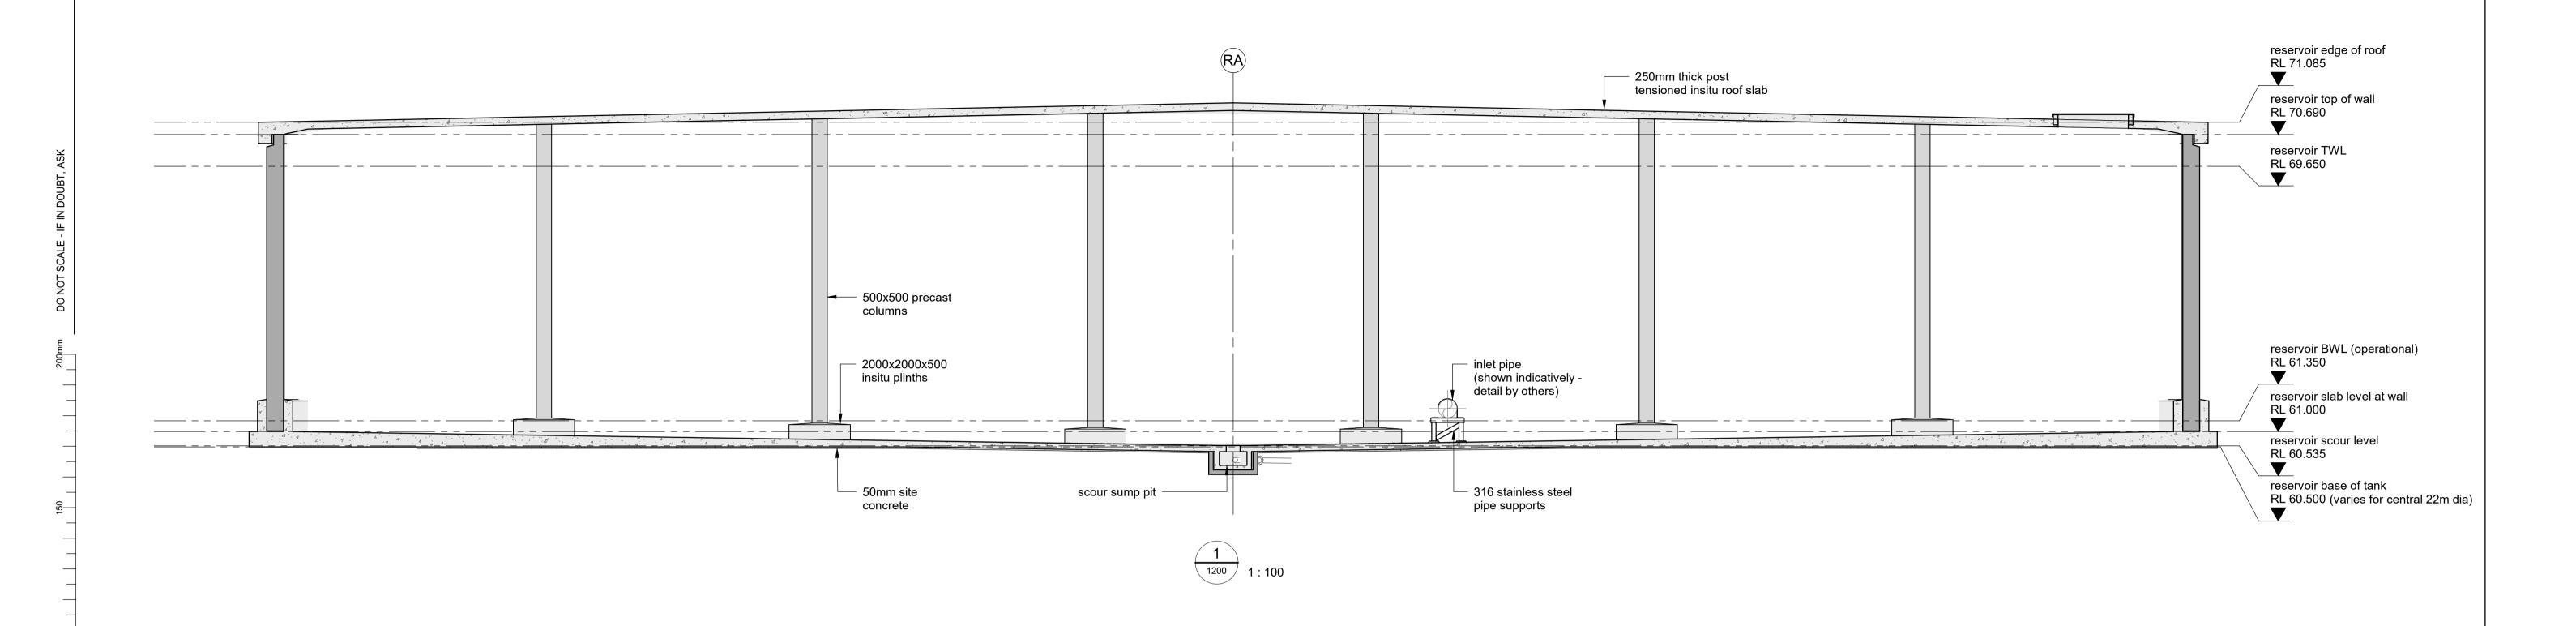


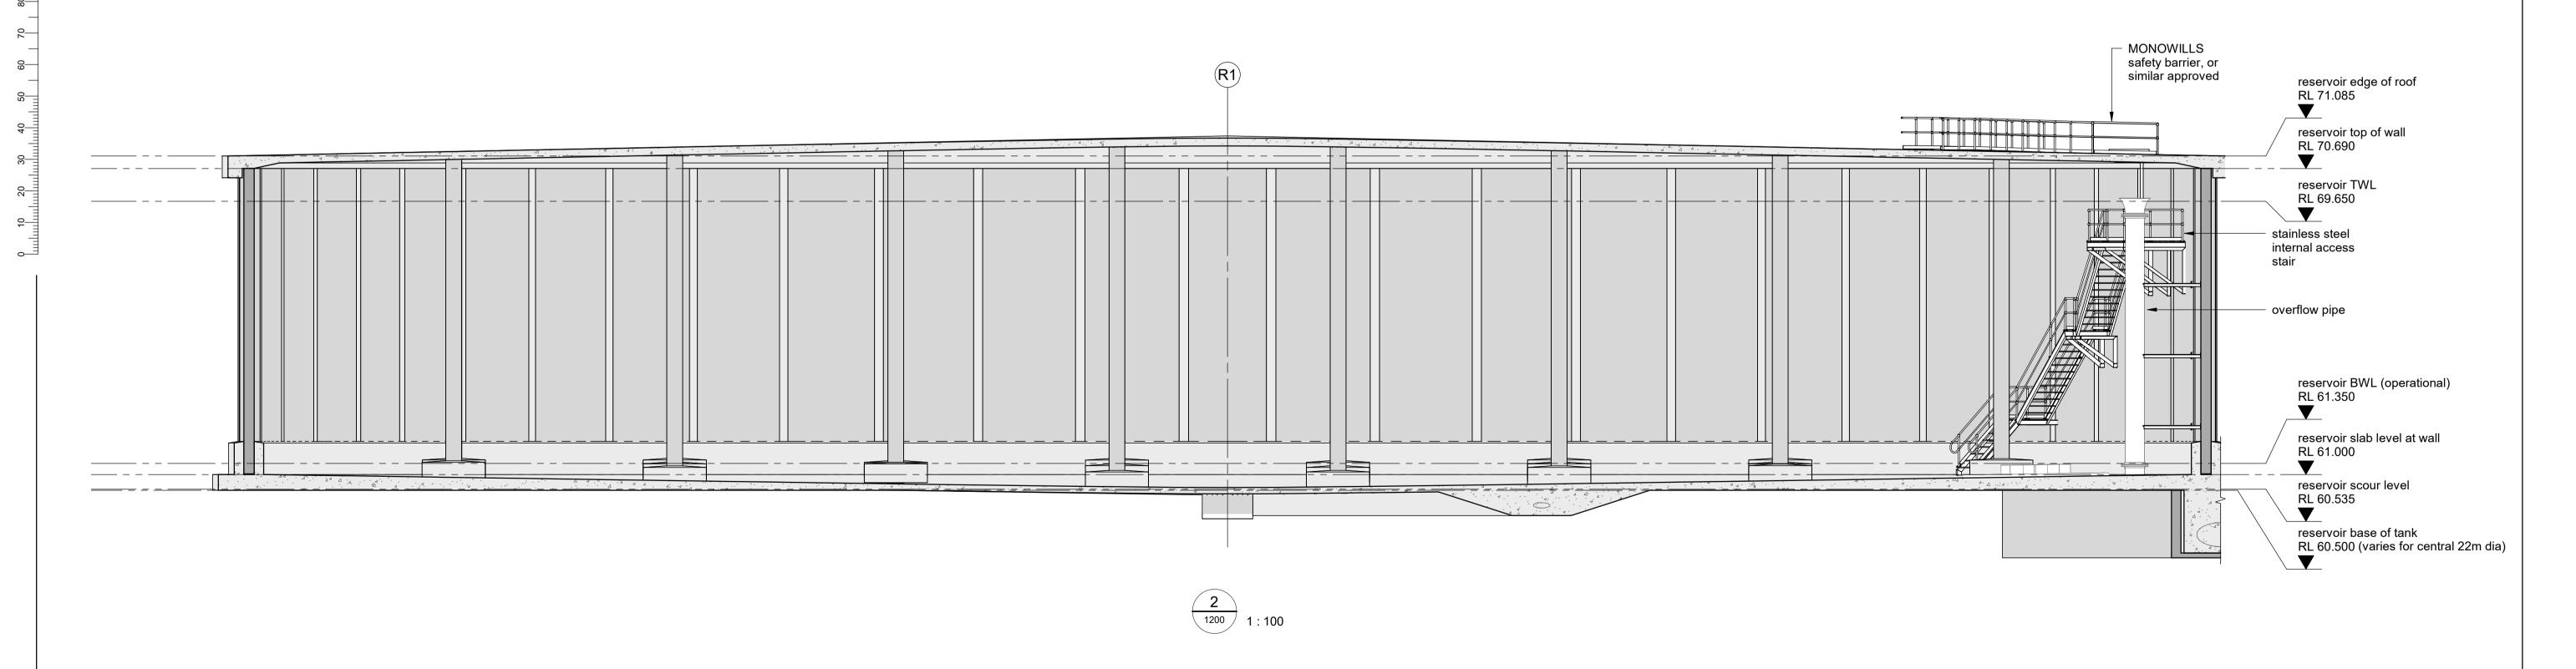


| | | | SURVEYED | | | | Client: | | Status Stamp | |
|---------------------------|----------------------|------------|--------------|----------|------------|----------------------------|--|---|-------------------|--------|
| | | | DESIGNED | CPL | 23/06/2025 | | | CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY D | /ESIGN |
| | | | | AJW | 23/06/2025 | | - and the second | IAF PROJECTS | Date Stamp | |
| | | | CAD REVIEW | DLP | 23/06/2025 | | Hamilton City Council | , | 23/06/2025 | |
| C 100% Prelinimary Design | | 22/07/2025 | DESIGN CHECK | | | Helmes | Te kaunihera o Kirikiriroa | rocomyoir | Scales 1:100 | |
| B 90% Preliminary Design | | 23/06/2025 | DESIGN REVIE | W | | Holmes | City Waters | reservoir | Drawing No. | Rev. |
| A 30% Preliminary Design | | 08/05/2025 | | APPROVED | | | | typical sections | CB300-STR-1210 | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTR | RATION: | Ho | lmes Job Number: 148023.33 | | | CD300-31R-1210 | |

- 1. Refer to CB300-STR-1002 for all general notes.
- 2. Floor foundation nibs and wall stitches to have XYPEX additive in concrete.

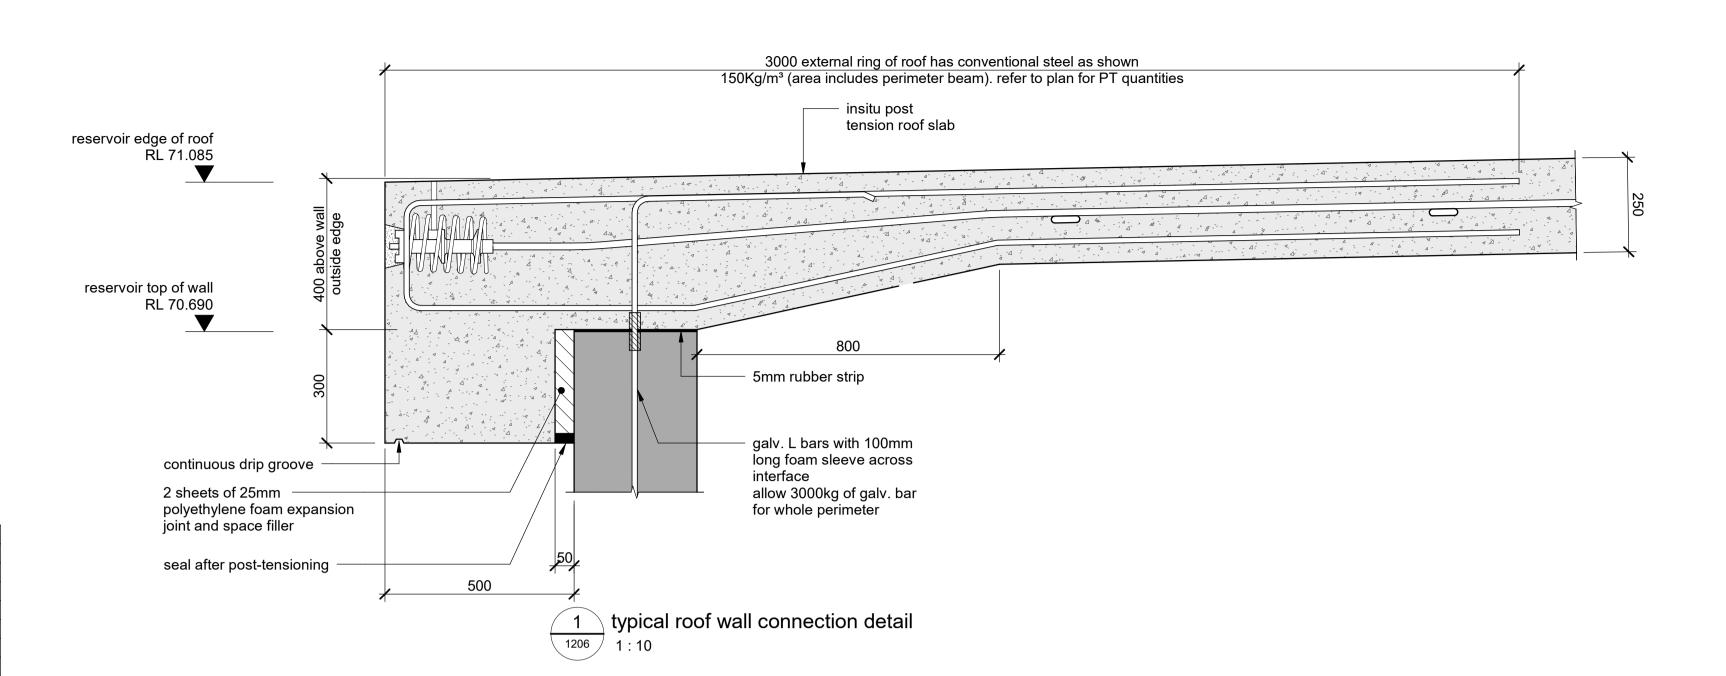

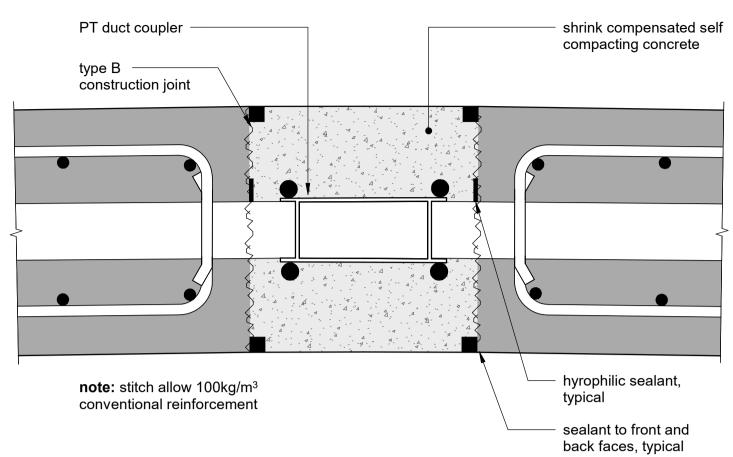


typical wall insitu stitch detail

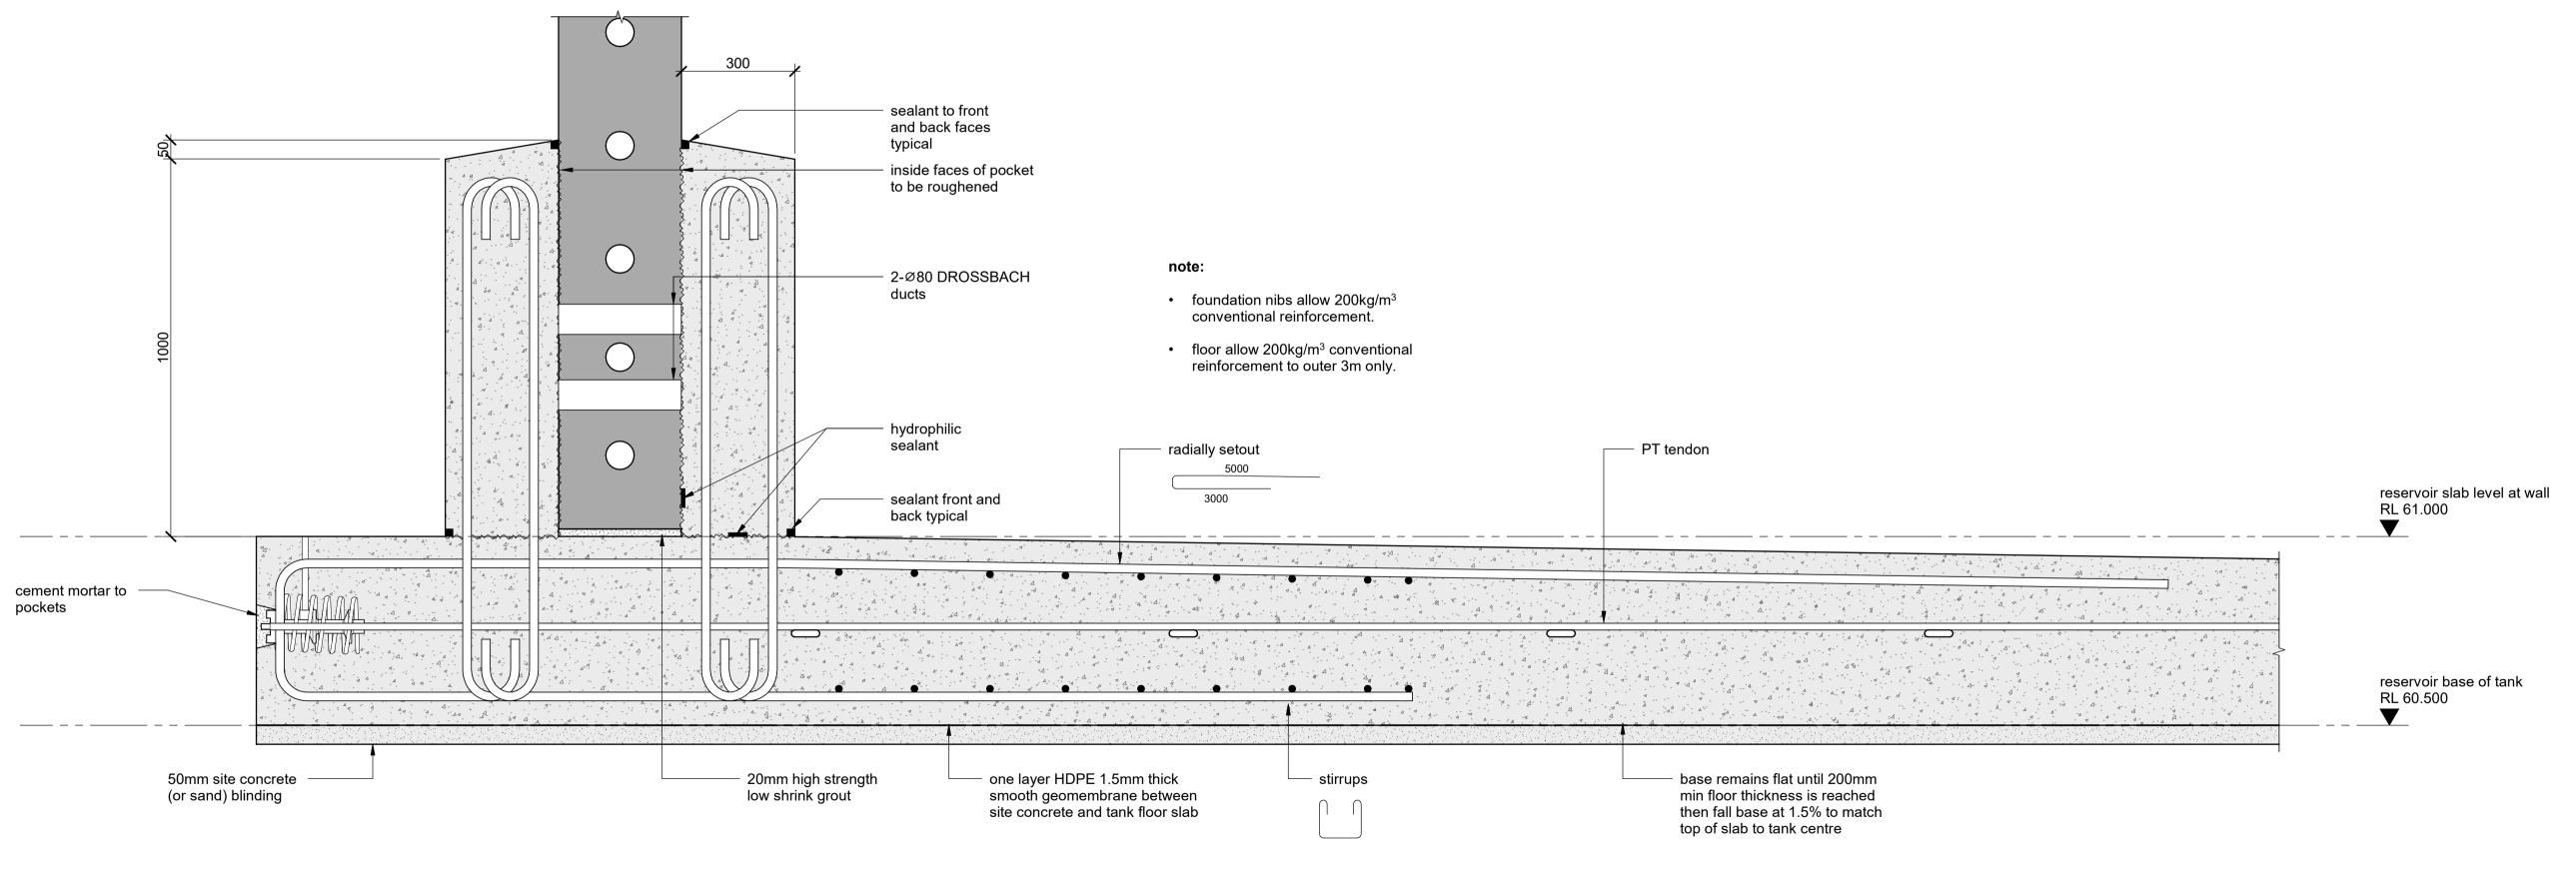

typical floor wall connection detail


| | | | 01 ID) (E) (ED | | |
|-----|-------------------------|------------|----------------|-------|------------|
| | | | SURVEYED | | |
| | | | DESIGNED | CPL | 23/06/2025 |
| | | | DRAWN | AJW | 23/06/2025 |
| | | | CAD REVIEW | DLP | 23/06/2025 |
| | | | DESIGN CHECK | | |
| С | 100% Prelinimary Design | 22/07/2025 | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | |
| Α | 30% Preliminary Design | 08/05/2025 | APPROVED | | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRA | TION: | Ho |

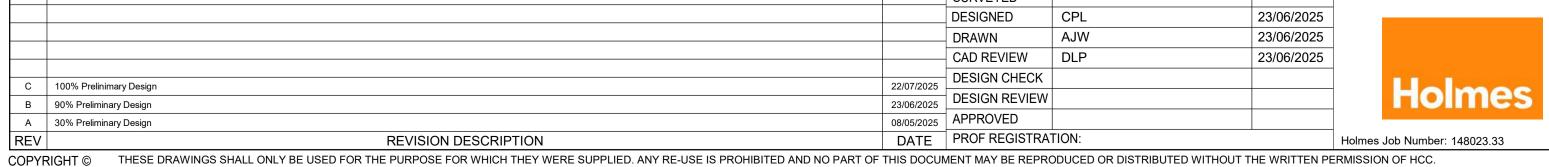




| CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY DESIGN | | | |
|---|------------------------|------|--|--|
| IAF PROJECTS | Date Stamp 23/06/2025 | | | |
| reservoir | Scales 1:5, 1:10 | | | |
| concrete details | CB300-STR-1215 | Rev. | | |



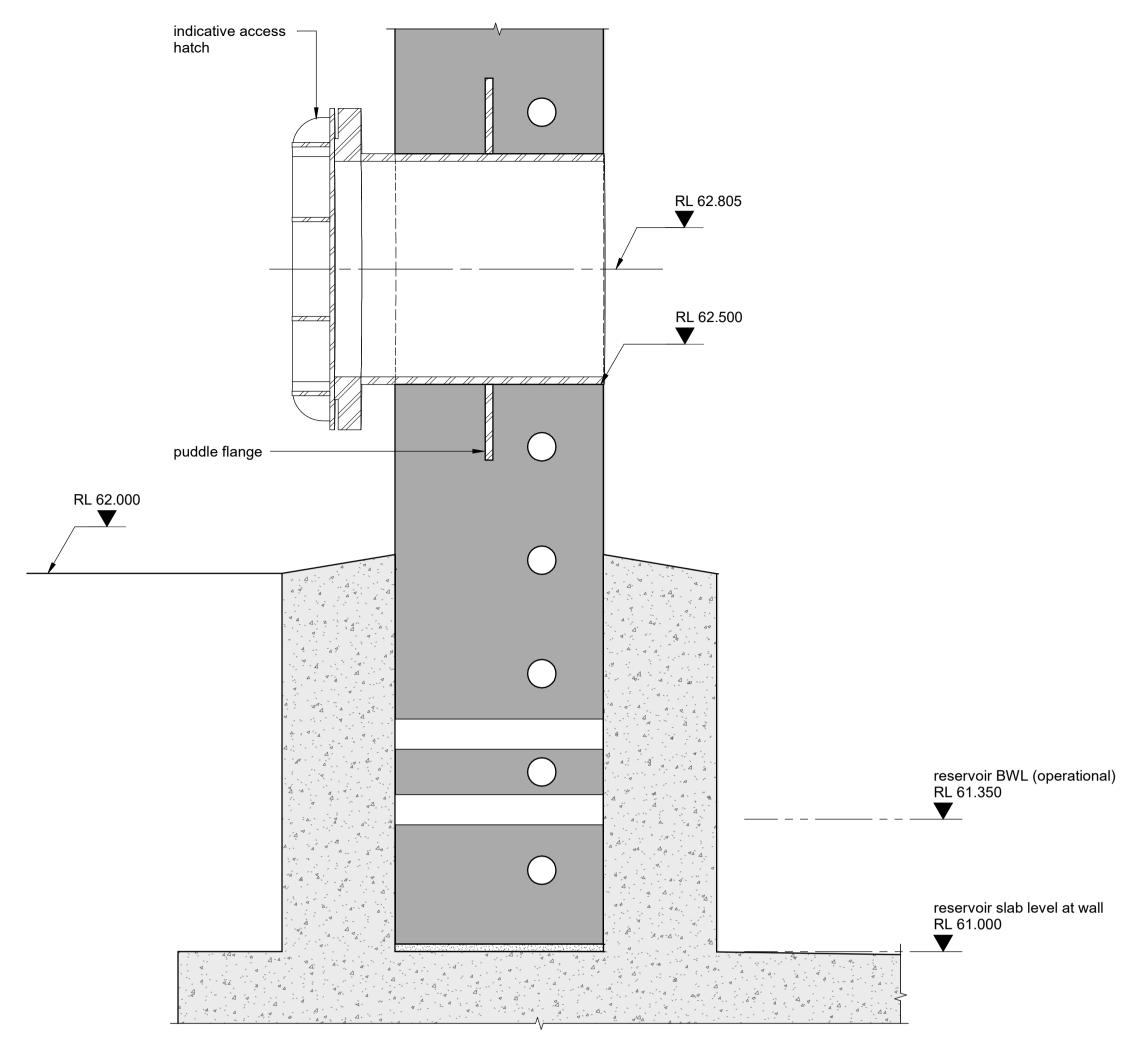

W2 wall panel section at access hatch





| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY D Date Stamp 23/06/2025 | ESIGN |
|--|---|-------|
| reservoir concrete details | Scales 1:10 Drawing No. CB300-STR-1216 | Rev. |

C 100% Prelinimary Design

B 90% Preliminary Design

DESIGNED

CAD REVIEW


DESIGN CHECK


DRAWN


23/06/2025 DESIGN REVIEW


08/05/2025 APPROVED

AJW

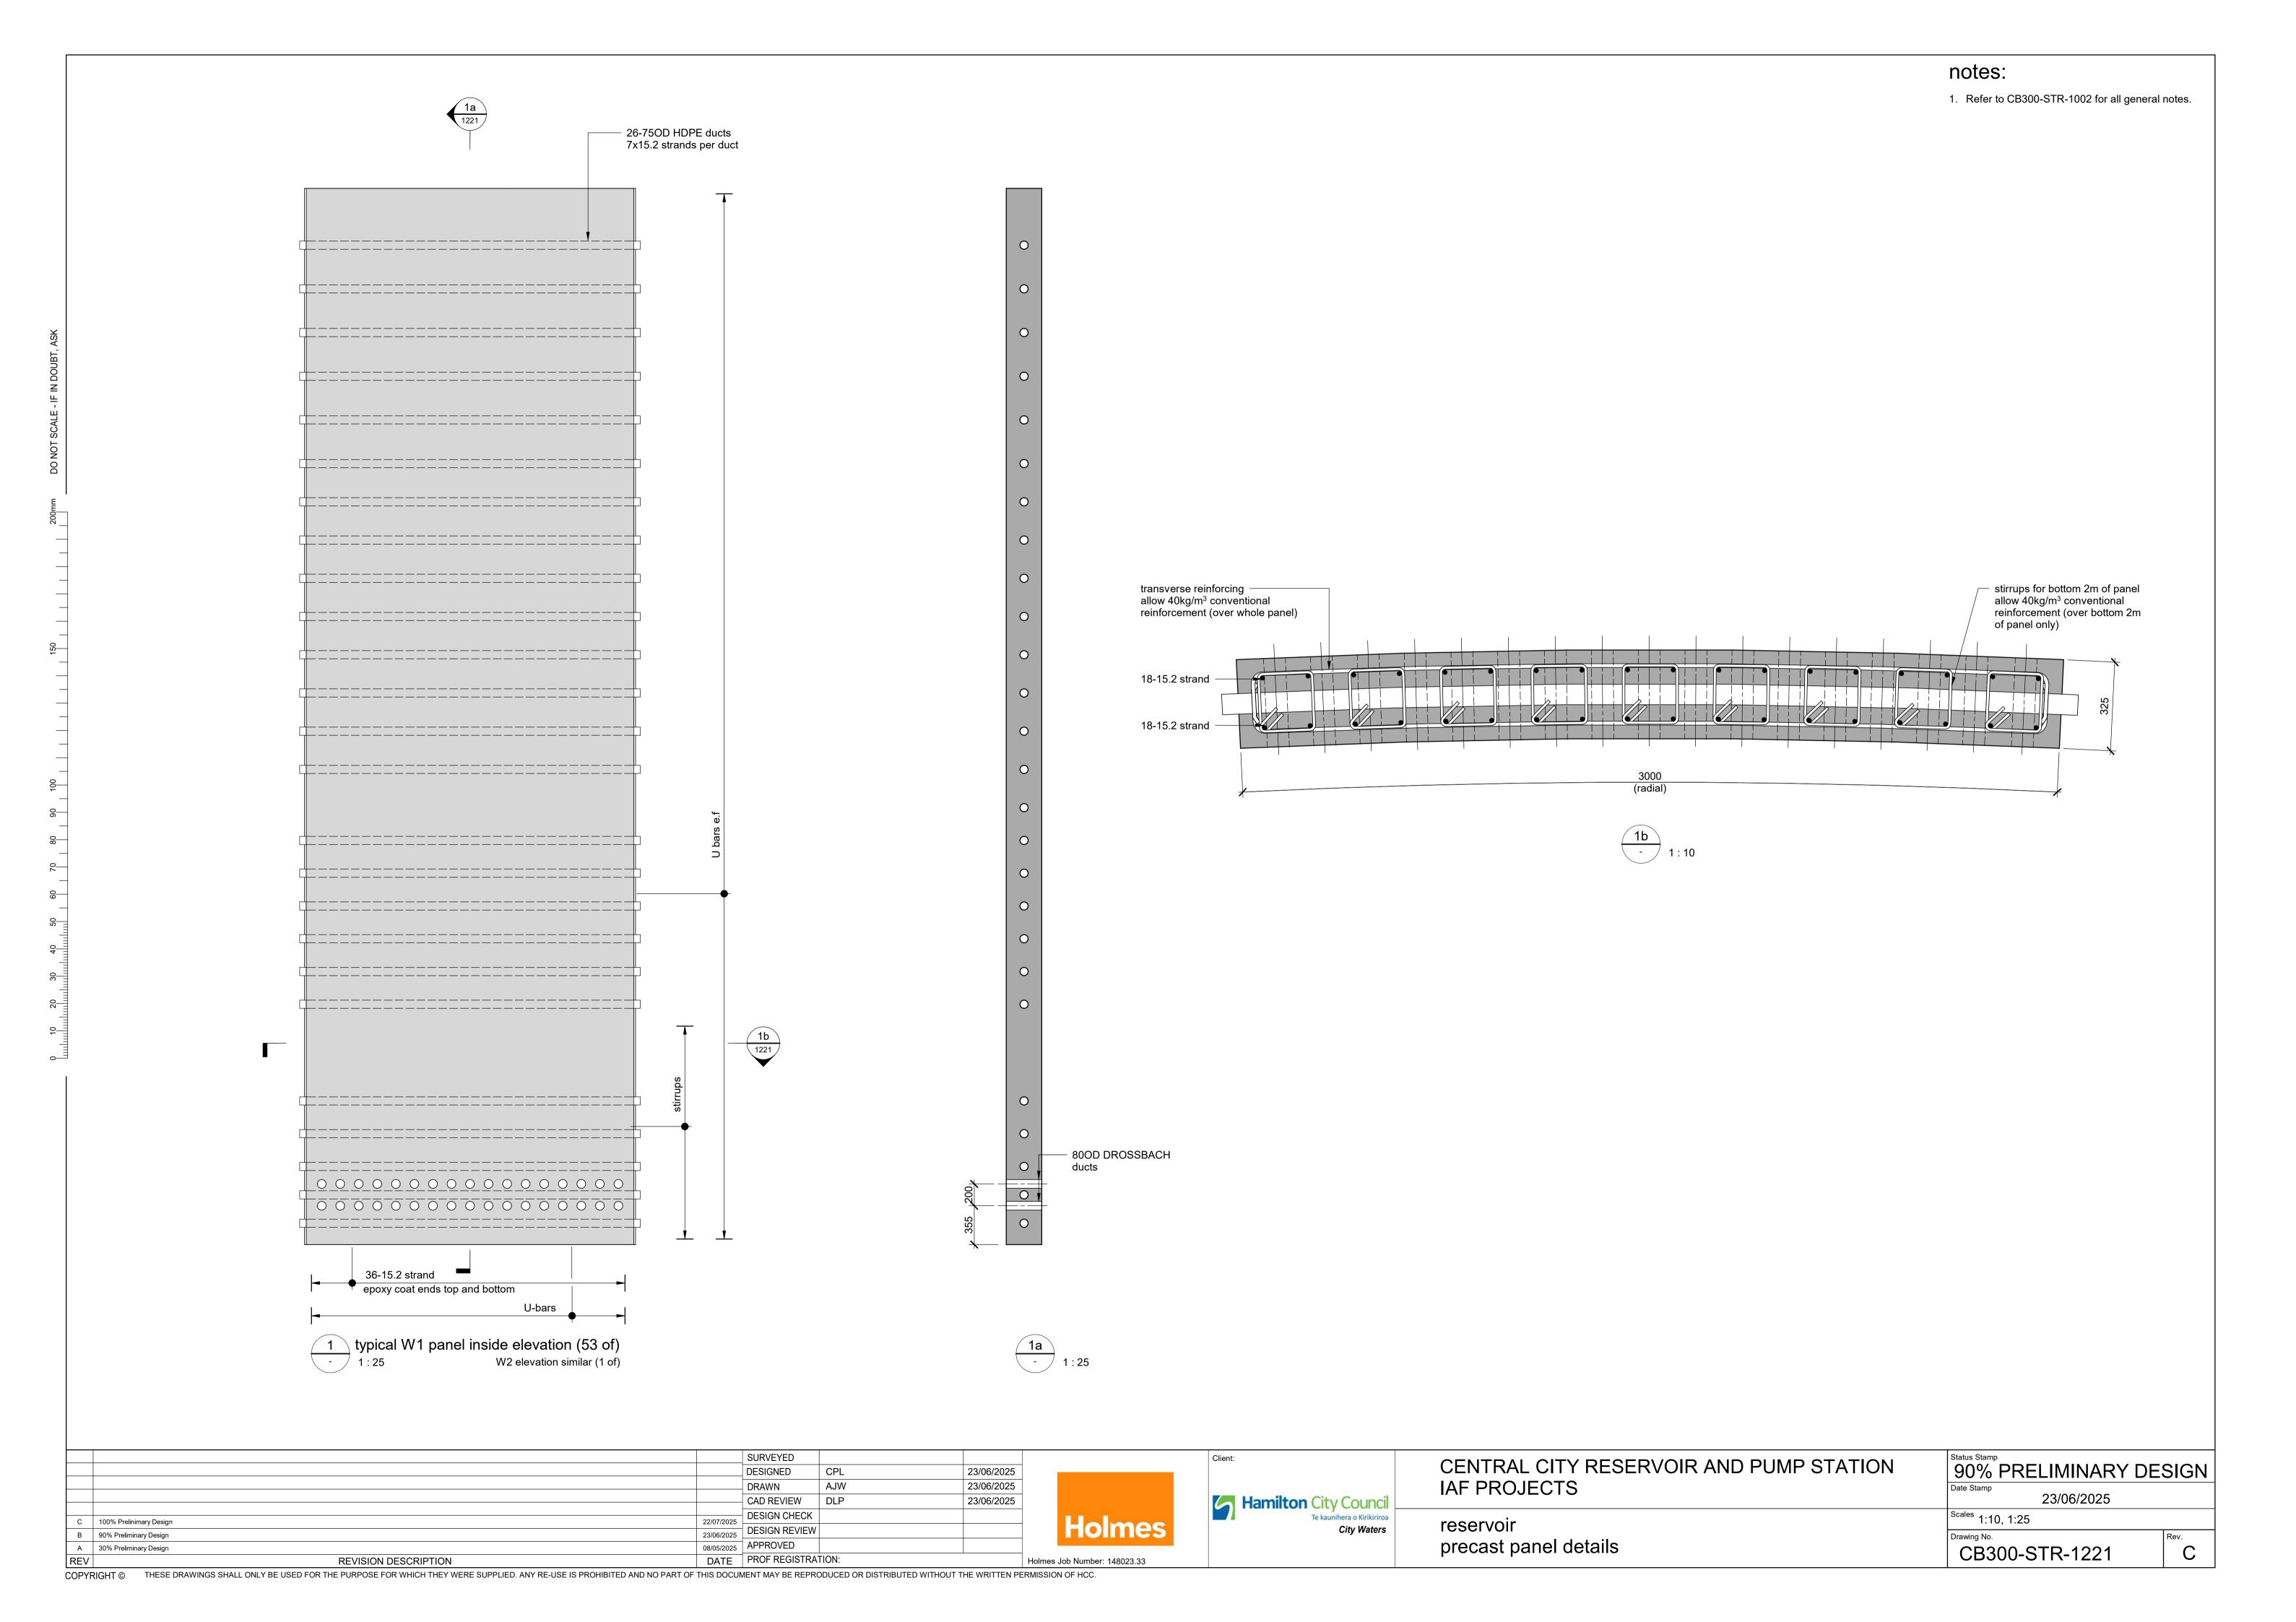



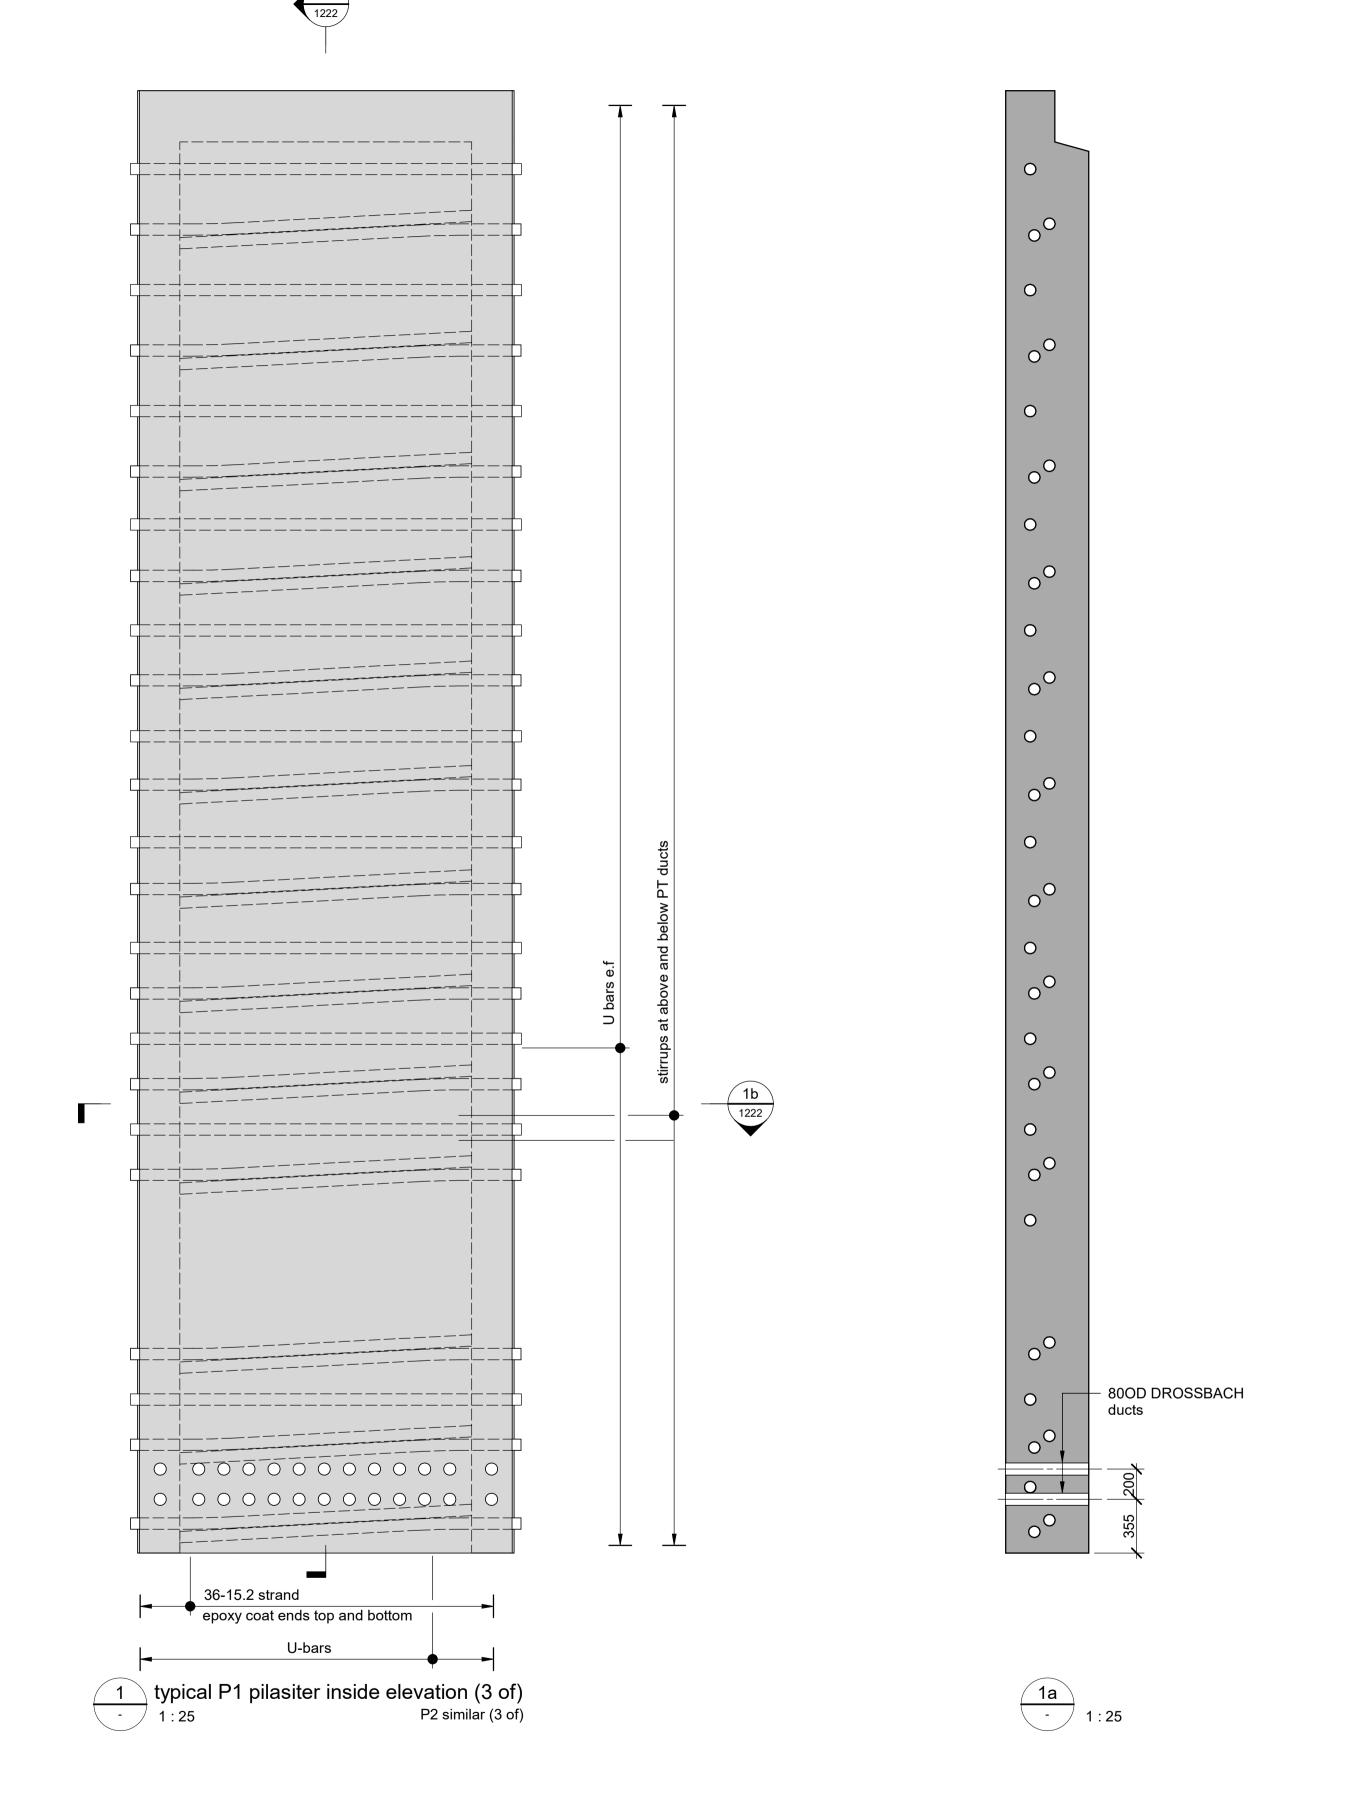

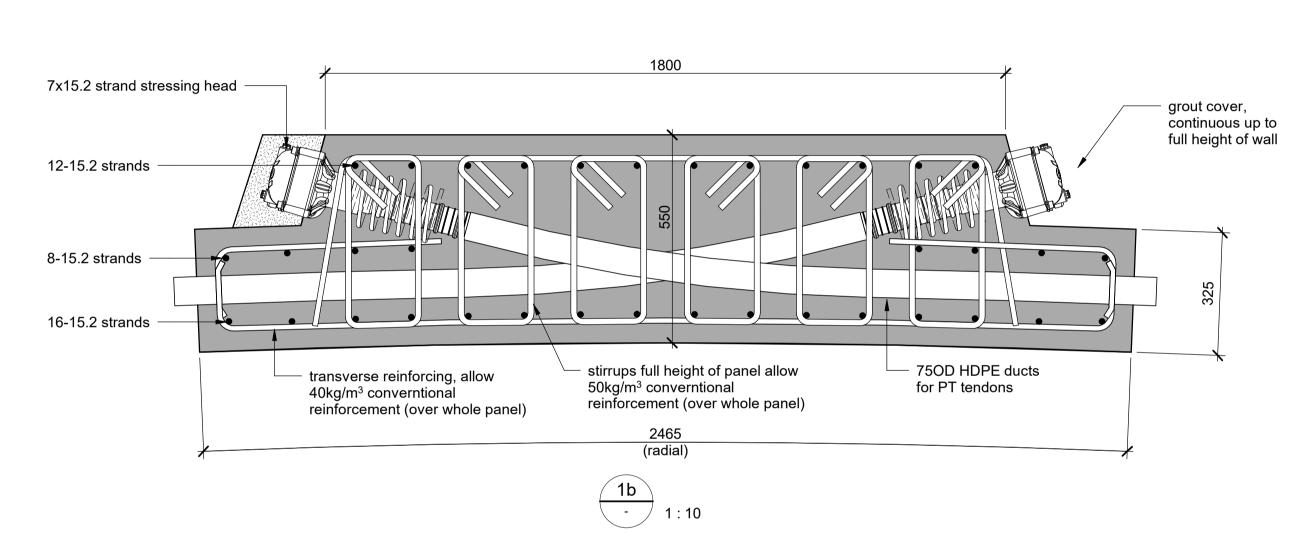

| | | | 21.5.75.75 | 1 | | _ |
|-----|-------------------------|------------|----------------|-------|------------|---|
| | | | SURVEYED | | | |
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | |
| | | | CAD REVIEW | DLP | 23/06/2025 | |
| | | | DESIGN CHECK | | | |
| ; | 100% Prelinimary Design | 22/07/2025 | | | | |
| 3 | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | | |
| ١ | 30% Preliminary Design | 08/05/2025 | APPROVED | | | |
| ٠// | REVISION DESCRIPTION | DATE | PROF REGISTRAT | ΓΙΟΝ: | | H |


COPYRIGHT © THESE DRAWINGS SHALL ONLY BE USED FOR THE PURPOSE FOR WHICH THEY WERE SUPPLIED. ANY RE-USE IS PROHIBITED AND NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR DISTRIBUTED WITHOUT THE WRITTEN PERMISSION OF HCC.




| Client: | |
|---------|--|
| 5 | Hamilton City Council Te kaunihera o Kirikiriroa City Waters |
| | City Traces |


| CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY DESIGN | | | |
|---|------------------------|------|--|--|
| IAF PROJECTS | Date Stamp 23/06/2025 | | | |
| reservoir | Scales 1:10, 1:25 | | | |
| precast panel details | CB300-STR-1222 | Rev. | | |




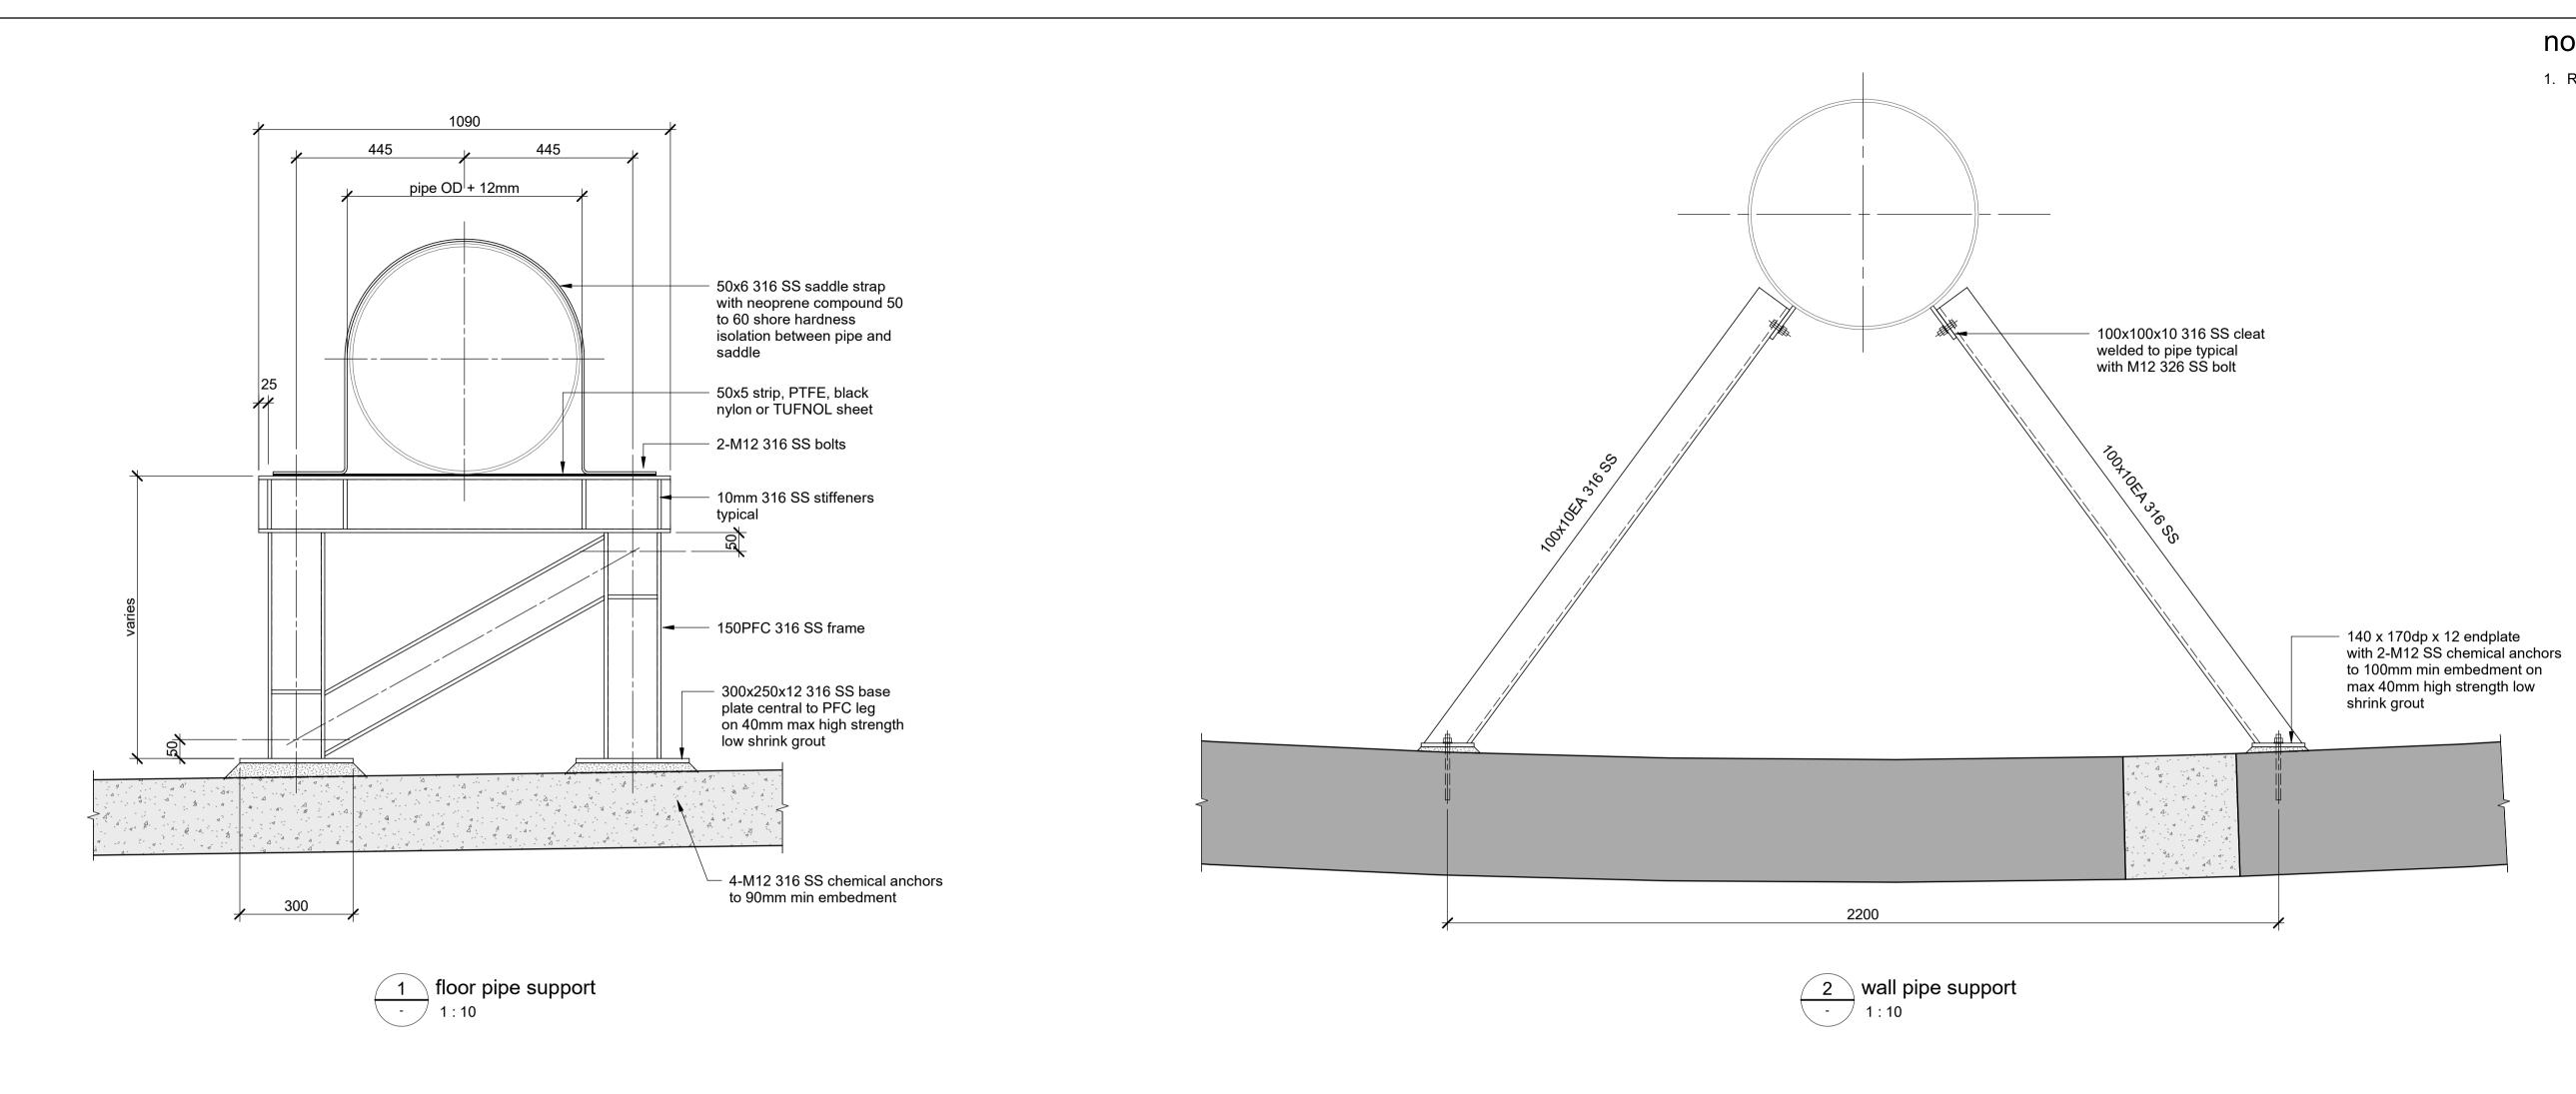

| | SURVEYED DESIGNED CPL | 23/06/2025 | Client: | CENTRAL CITY RESERVOIR AND PUMP STATION | 90% PRELIMINARY DESIGN |
|--|--|------------------------------|---|---|------------------------|
| | DRAWN AJW CAD REVIEW DLP DESIGN CHECK | 23/06/2025 23/06/2025 | Hamilton City Council | IAF PROJECTS | Date Stamp 23/06/2025 |
| C 100% Prelinimary Design B 90% Preliminary Design | 22/07/2025 23/06/2025 DESIGN REVIEW | Holmes | Te kaunihera o Kirikiriroa City Waters | reservoir | Drawing No. Rev. |
| A 30% Preliminary Design REV REVISION DESCRIPTION | 08/05/2025 APPROVED DATE PROF REGISTRATION: | Holmes Job Number: 148023.33 | | pipe supports | CB300-STR-1230 C |

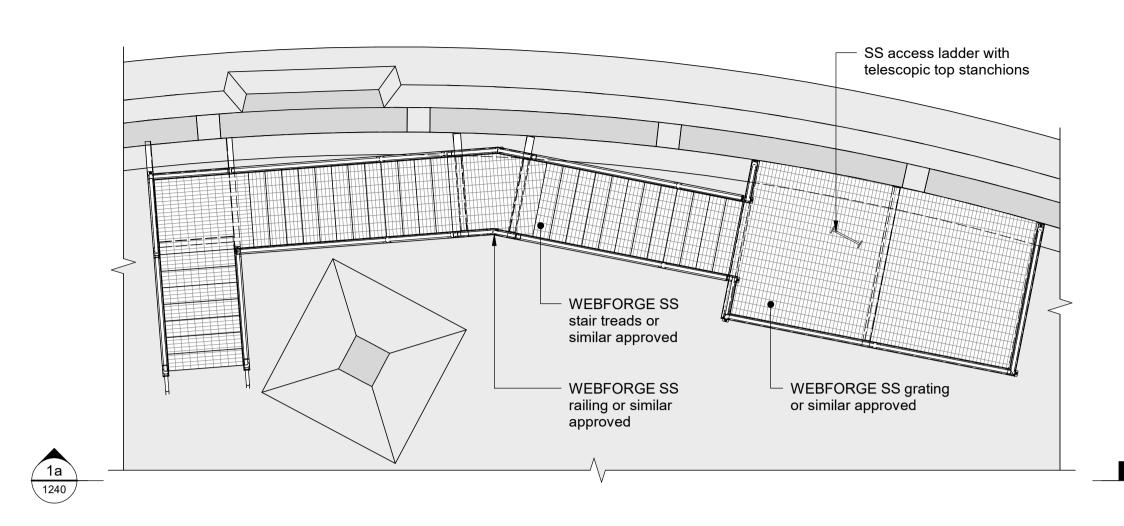



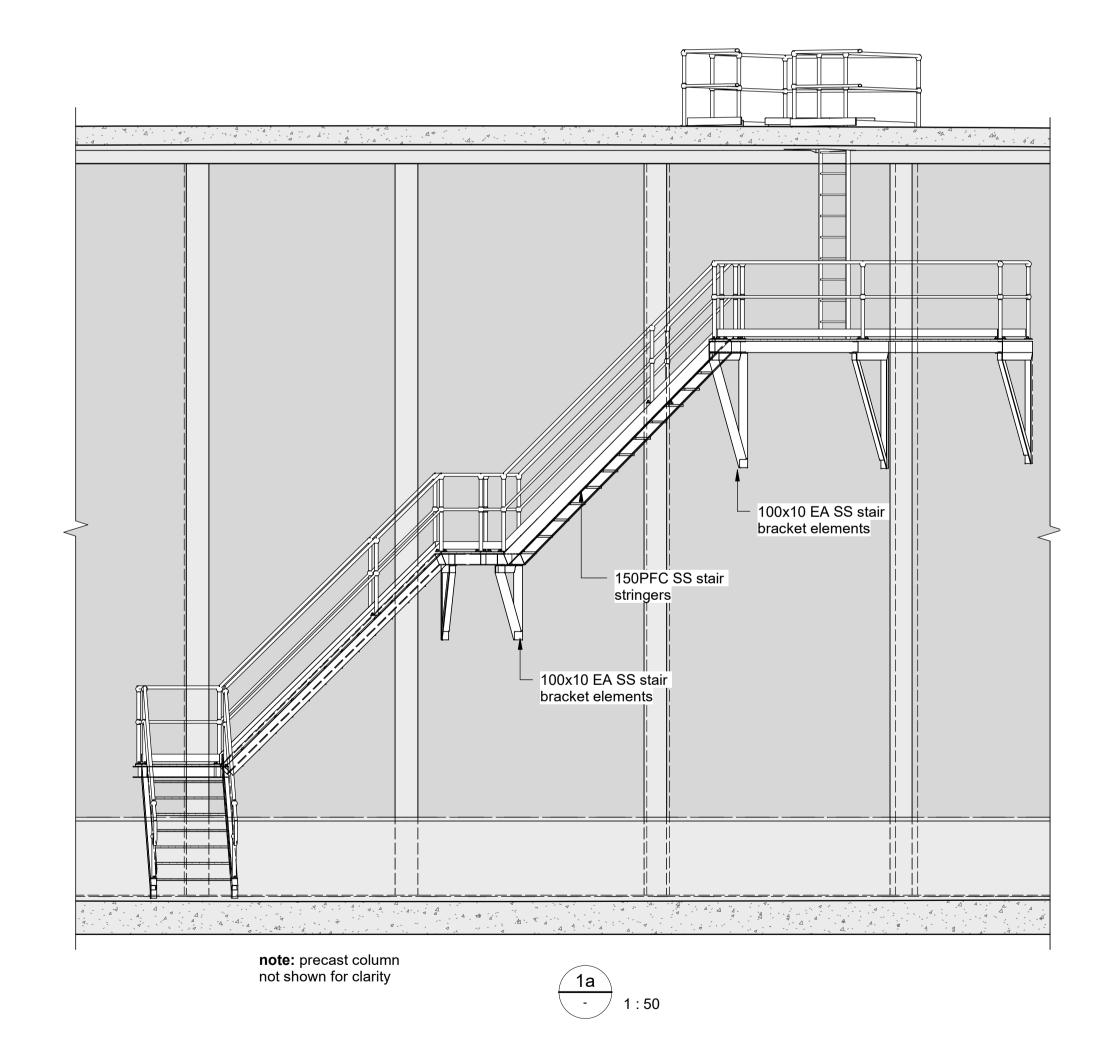



| | | | SURVEYED | | | |
|----------|-------------------------|------------|---------------|--------|------------|----------------------|
| | | | DESIGNED | CPL | 23/06/2025 | |
| | | | DRAWN | AJW | 23/06/2025 | |
| | | | CAD REVIEW | DLP | 23/06/2025 | |
| С | 100% Prelinimary Design | 22/07/2025 | DESIGN CHECK | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | 1 | | HOI |
| \vdash | 30% Preliminary Design | 08/05/2025 | APPROVED | | | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRA | ATION: | · | Holmes Job Number: 1 |






| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY Date Stamp 23/06/2025 | DESIGN |
|--|---------------------------------------|--------|
| reservoir internal stair details | Drawing No. CB300-STR-1240 | Rev. |

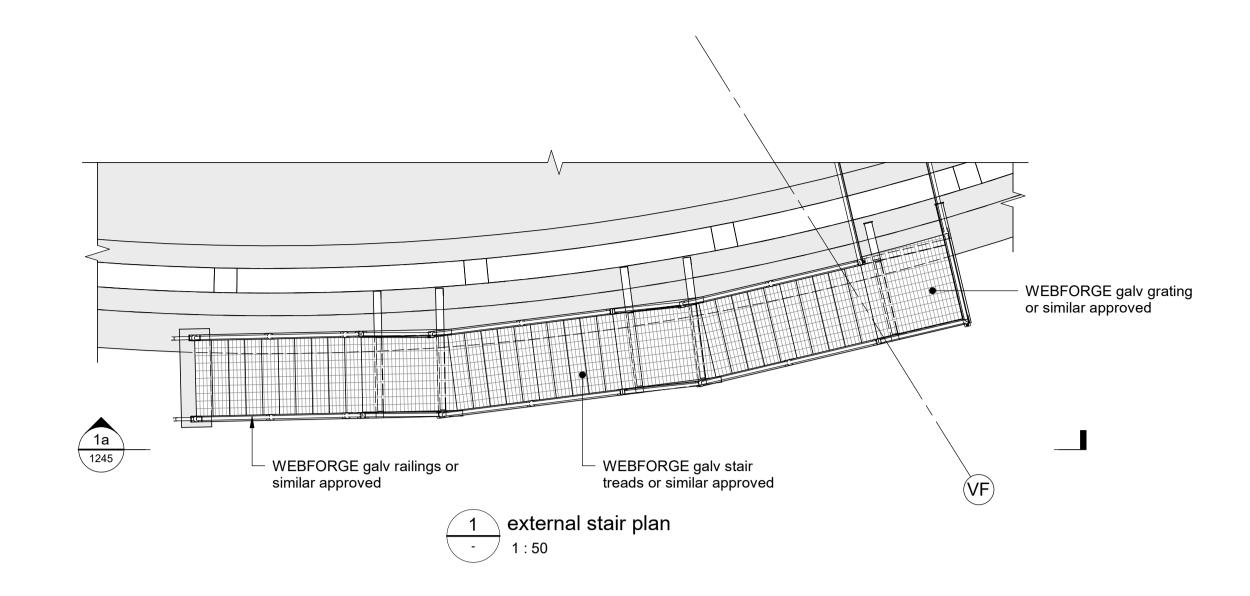

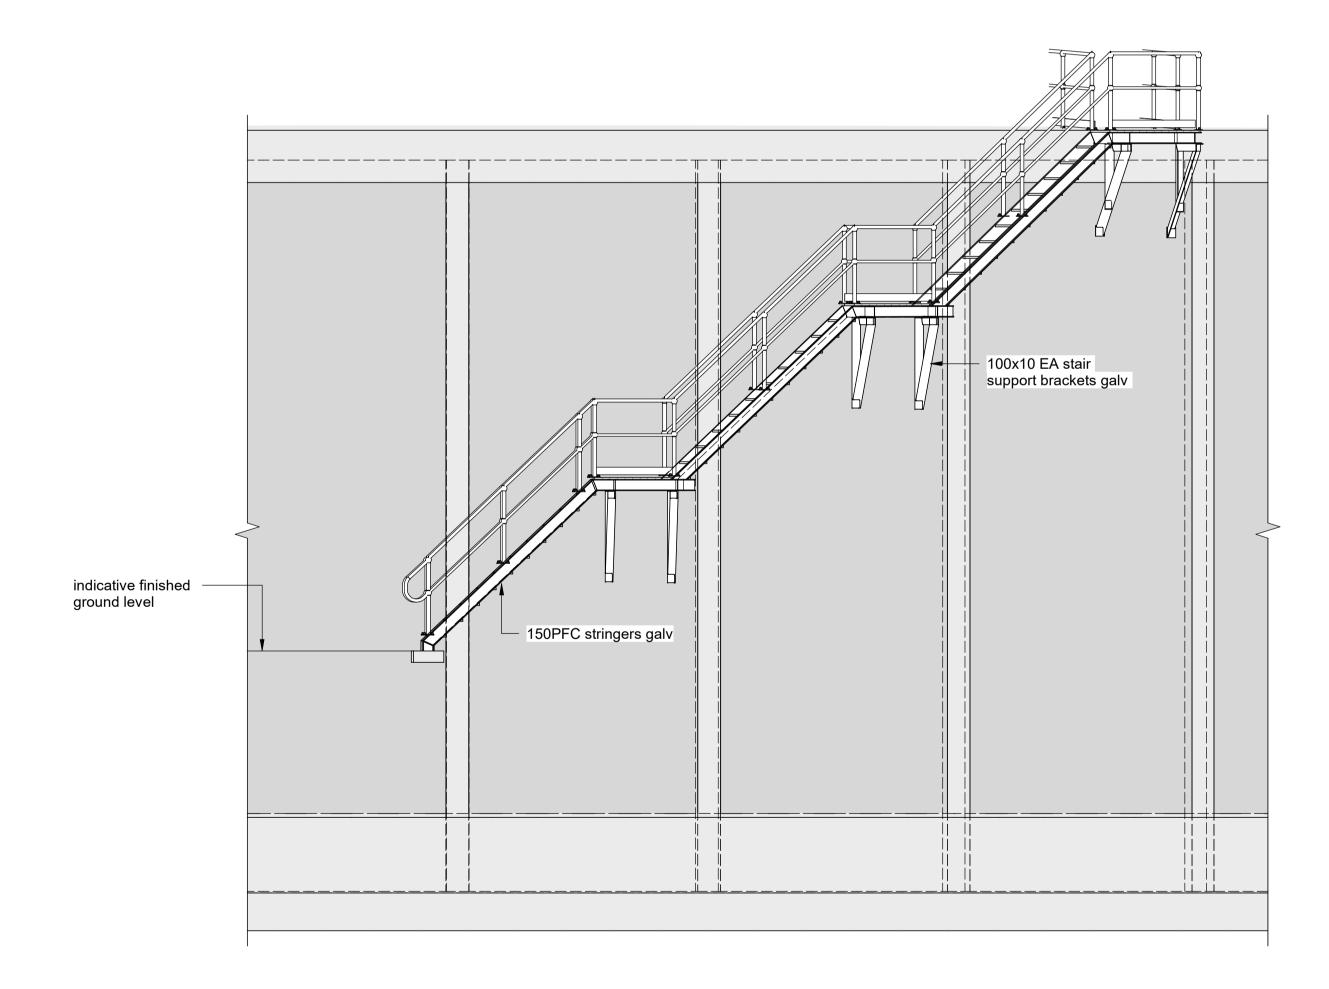



| | | | SURVEYED | | |
|-----|-------------------------|------------|----------------|-------|------------|
| | | | DESIGNED | CPL | 23/06/2025 |
| | | | DRAWN | AJW | 23/06/2025 |
| | | | CAD REVIEW | DLP | 23/06/2025 |
| | | | DESIGN CHECK | | |
| С | 100% Prelinimary Design | 22/07/2025 | | | |
| В | 90% Preliminary Design | 23/06/2025 | DESIGN REVIEW | | |
| Α | 30% Preliminary Design | 08/05/2025 | APPROVED | | |
| REV | REVISION DESCRIPTION | DATE | PROF REGISTRAT | TION: | |





| CENTRAL CITY RESERVOIR AND PUMP STATION IAF PROJECTS | 90% PRELIMINARY DESIGN Date Stamp | | | |
|--|------------------------------------|--|--|--|
| | 23/06/2025 | | | |
| reservoir | Scales 1:50 | | | |
| external stair details | CB300-STR-1245 | | | |

