


PERMEABLE PAVER REQUIREMENTS FOR Typical Paver Size

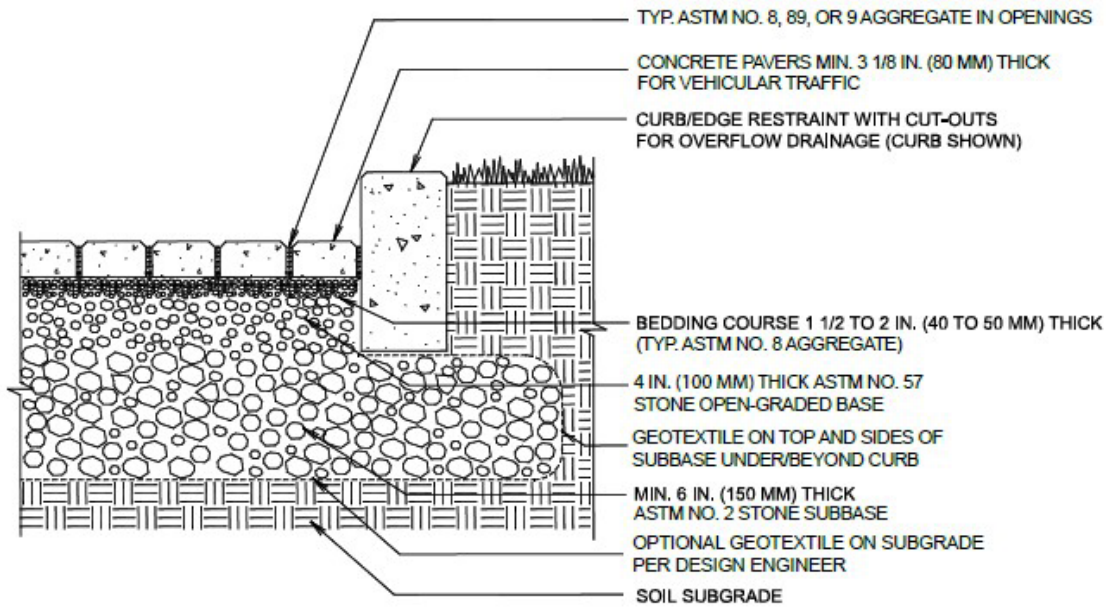

- Gap/Opening must be a minimum of 3/8 inch
- Pavers must be Interlocking (approved by Village)

Figure 4. Full exfiltration cross section allows storage and infiltration. Overflows are to swales, bioretention areas or storm sewer inlets.

***NOTE: STEPPINGSTONES AND SLABS WILL NOT BE CONSIDERED AS PERMEABLE.**