


connection diagrams Shelly 2.5

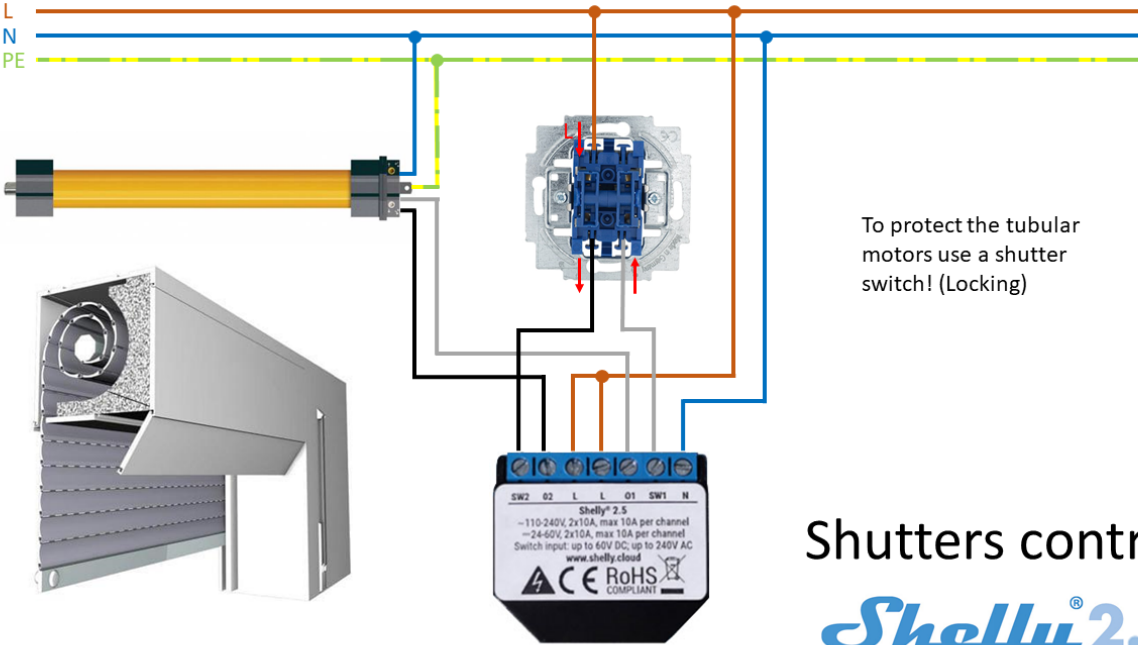


To protect the tubular motors use a shutter switch! (Locking)

Shutters control

Shelly[®] 2.5


www.shelly-support.eu

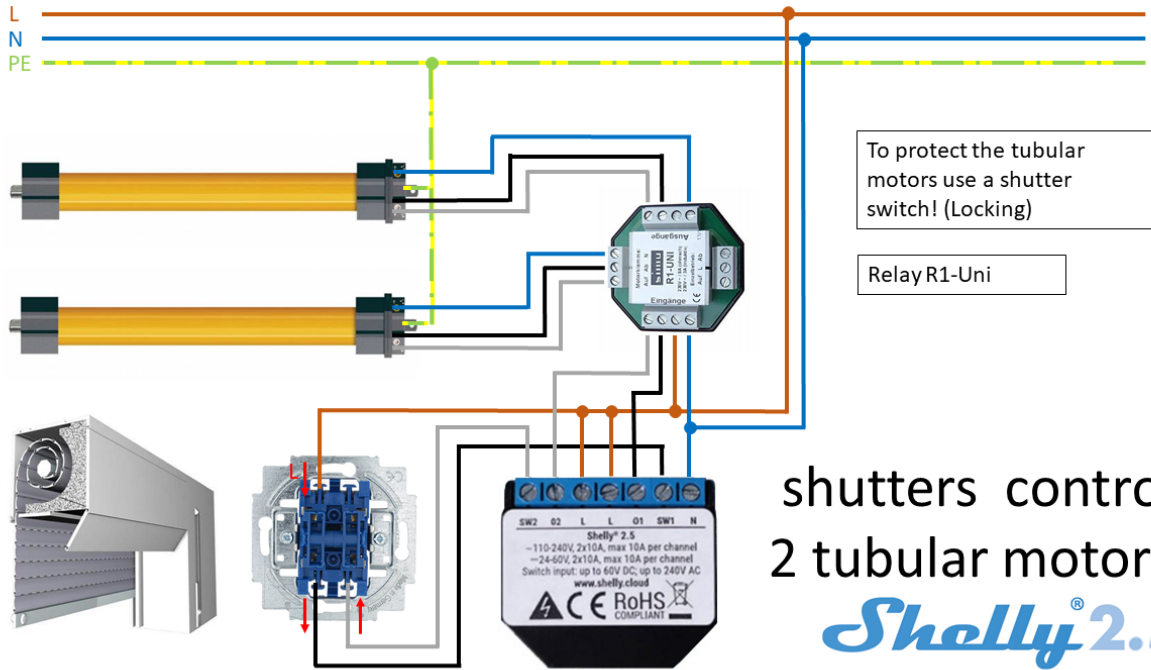


To protect the tubular motors use a shutter switch! (Locking)

Relay R1-Uni

shutters control
2 tubular motors
Shelly® 2.5


www.shelly-support.eu 

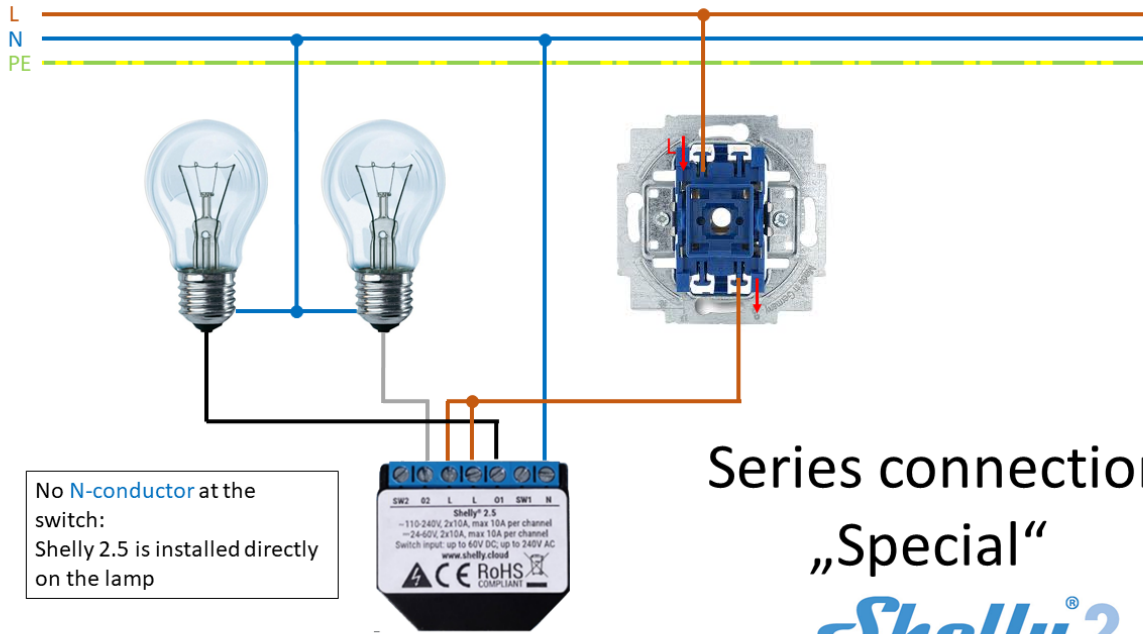

Series connection
 „Special“
Shelly[®] 2.5

www.shelly-support.eu


- Link to [N-conductor is missing](#)

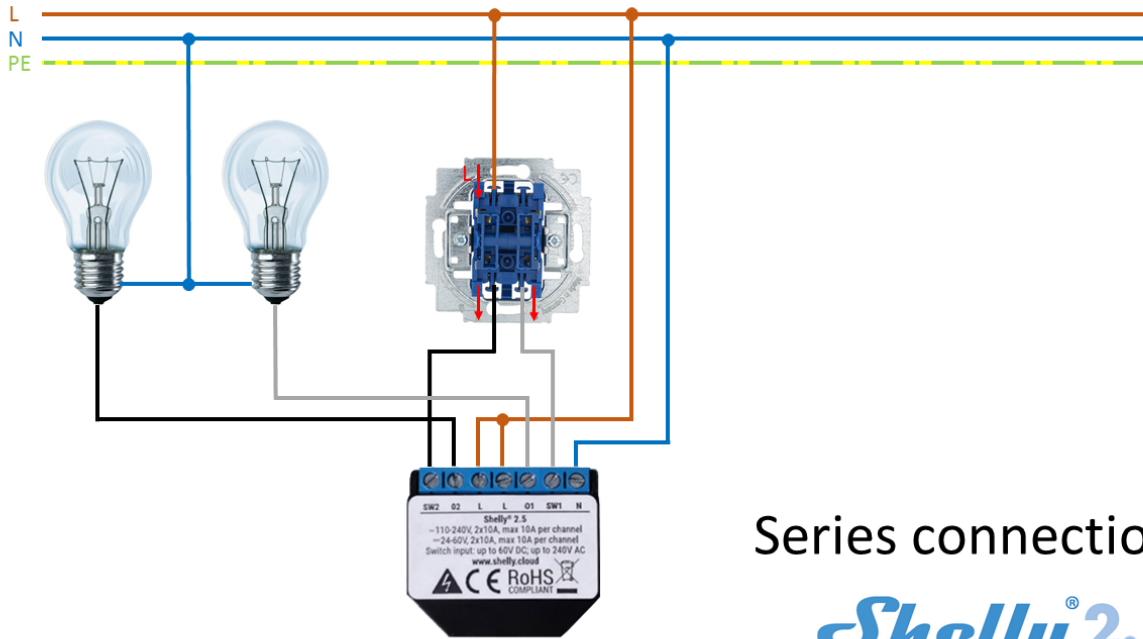

Series connection

Shelly 2.5

www.shelly-support.eu

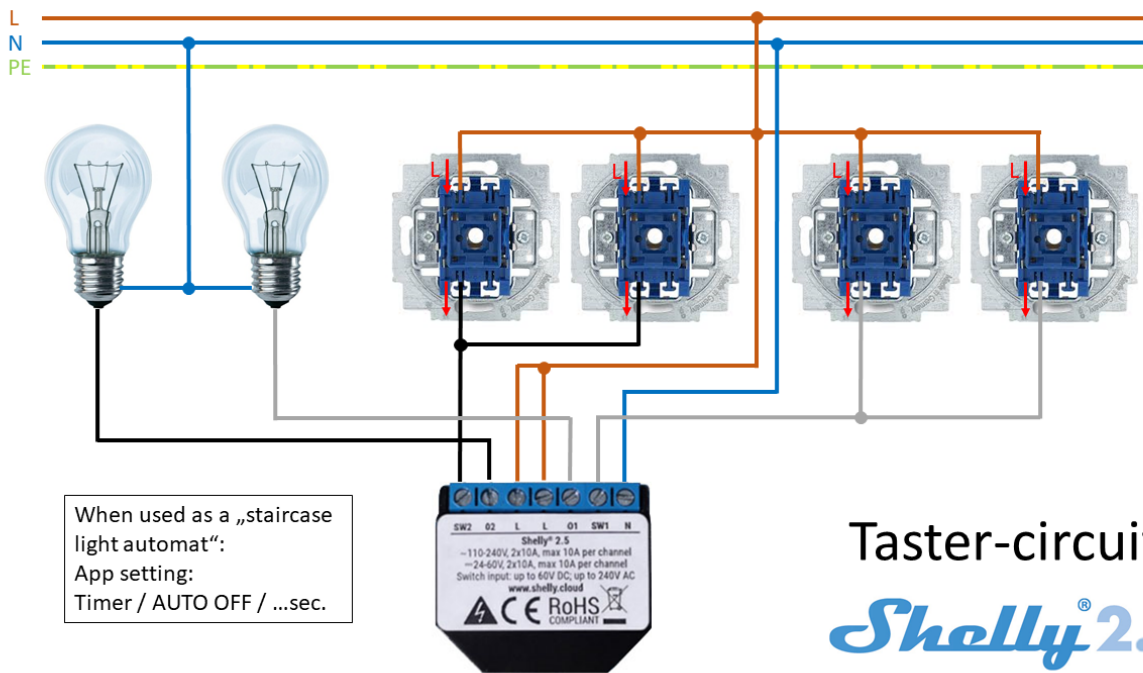


When used as a „staircase light automat“:
App setting:
Timer / AUTO OFF / ...sec.

Taster-circuit

Shelly 2.5

www.shelly-support.eu

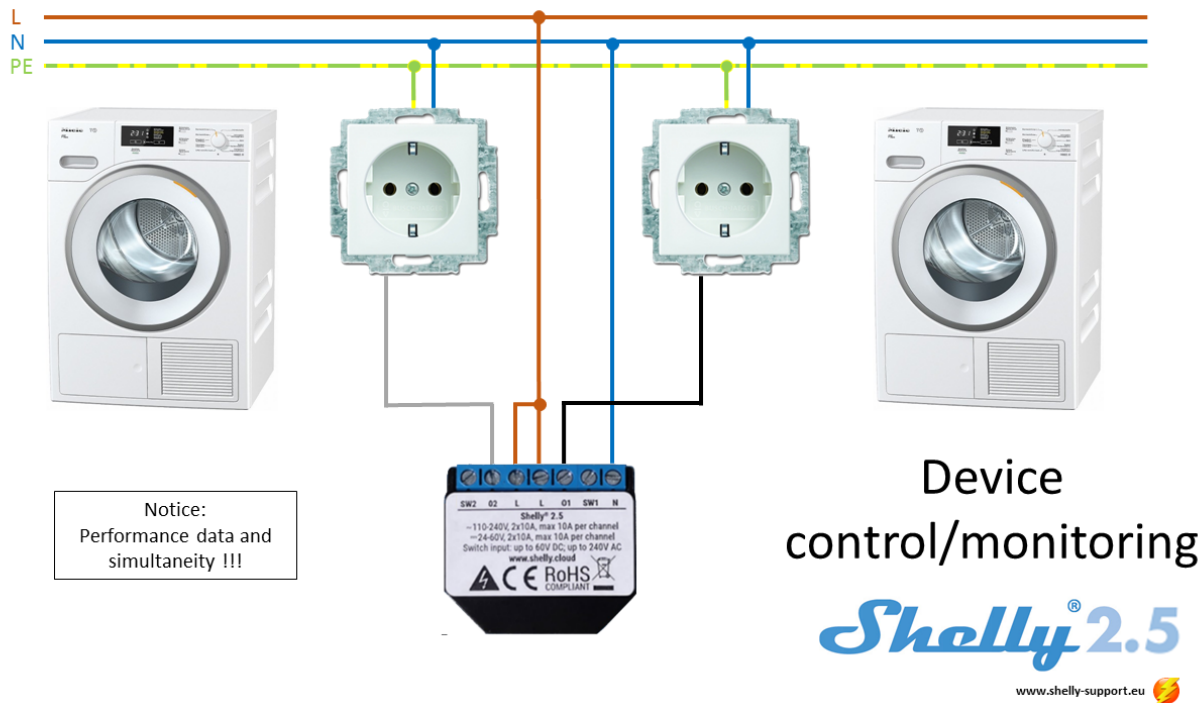

Any work on low voltage grid are dangerous and can be fatal! Therefore have this work carried out by qualified electricians!

These schemes are for understanding and are not a "do it yourself" guide! No liability for improper use!