

GENERAL NOTES

"MILL-MATERIAL" AND WORKMANSHIP SHALL CONFORM TO THE LATEST REVISION OF THE NATIONAL BUILDING CODE OF CANADA 2015, THE ALBERTA BUILDING CODE 2014 AND THE CSA-S136-16.
THE FOUNDATION SHOWN IS A SUGGESTED DESIGN FOR GENERAL GUIDANCE ONLY. CHANGES MAY BE REQUIRED DUE TO LOCAL BUILDING REGULATIONS, SOIL CONDITIONS OR OTHER FACTORS OVER WHICH PIONEER STEEL HAS NO CONTROL.
THE FOUNDATION SHALL BE CONSTRUCTED ON NATURAL UNDISTURBED SOIL CAPABLE OF SUSTAINING 100 kPa, AND SHALL BE DESIGNED TO FULLY RESIST ROTATION AT THE BASE OF THE ARCH.
SLAB-ON-GRADE SHALL BE PLACED ON WELL-COMPACTED FILL CAPABLE OF SUSTAINING 100 kPa WITHOUT SETTLEMENT.
FOR PROPER CONNECTION OF THE BUILDING AT THE FOUNDATION, BUILDING MUST BE ANCHORED TO TROUGH WITH ANGLE BRACKETS. SUBSEQUENTLY, GROUT MUST BE POURED INSIDE AND OUTSIDE THE ARCH PANEL AND AROUND THE BRACKET FORMING A SLOPE APPROXIMATELY 20 DEGREES FROM THE GROUND BEAM AND REACHING A HEIGHT OF APPROXIMATELY 6 1/2" AGAINST THE ARCH PANEL. THIS WILL CONTROL THE ROTATIONAL MOMENT.
SPECIFIC NOTES AND DETAILS SHOWN ON THIS DRAWING SHALL TAKE PRECEDENCE OVER THE BUILDING ERECTION MANUAL SUPPLIED.
STRUCTURAL DESIGN OF THE BUILDING IS BASED ON THE FULL INTERACTION OF ALL ITS COMPONENT PARTS. FAILURE TO MAKE ADEQUATE PROVISION FOR EXCESSIVE STRESSES OR INSTABILITY OCCURRING FROM WHATEVER CAUSE DURING CONSTRUCTION SHALL BE THE SOLE RISK AND RESPONSIBILITY OF THE ERECTOR.
ALL DIMENSIONS (OTHER THAN PURELY STRUCTURAL DIMENSIONS) SHOWN ON THIS DRAWING SHALL BE VERIFIED BY THE ERECTOR BEFORE PROCEEDING WITH THE WORK.
IT IS THE OWNER'S RESPONSIBILITY TO ASCERTAIN THAT THE LOADS AND FACTORS SPECIFIED UNDER "DESIGN NOTES" ARE ADEQUATE FOR THE INTENDED LOCATION AND OCCUPANCY OF THIS BUILDING, AND THAT NO LOADS OTHER THAN THOSE SHALL BE IMPOSED ON THE STRUCTURE.

MATERIAL NOTES

STEEL: GALVANIZED SHEET STEEL, STRUCTURAL QUALITY, ASTM A792
SIDE AND EAVE PANELS GRADE 50, 50 KSI, MIN. YIELD, 65 KSI, MIN. TENSILE
MIN. DESIGN THKS. (UNCOATED) 0.036" AVG. THKS. WITH COATING 0.038"
ROOF PANELS GRADE 50, 50 KSI, MIN. YIELD, 65 KSI, MIN. TENSILE
MIN. DESIGN THKS. (UNCOATED) 0.028" AVG. THKS. WITH COATING 0.030"
BOLTS: 5/16-18 X 3/4", SA GRADE 2.
CONCRETE: 20 MPa AT 28 DAYS CURE.
REBAR: DEFORMED BARS, GRADE 60.

REVISIONS

NO. DATE DESCRIPTION BY APPR.

DESIGN NOTES

THE STRUCTURE DESIGN IS BASED ON THE NBCC 2015 AND THE ALBERTA BUILDING CODE 2014:
S: ROOF SNOW LOAD = 1.46 kPa.
S_{g(50)}: GROUND SNOW LOAD = 1.7 kPa.
S_{g(10)}: ROOF SNOW LOAD = 0.1 kPa.
C_b: BIG SNOW LOAD FACTOR = 0.8.
C_w: WIND EXPOSURE FACTOR = 1.0 (LOAD CASE II - UNEXPOSED LOCATION)
C_s: SLOPE FACTOR AS IN 4.1.6.2(5), (6), (7)
C_a: ACCUMULATION FACTOR AS IN 4.1.6.2(8)
F_v: HOURLY WIND PRESSURE 1/50 = 0.40 kPa.
SEISMIC DATA = 1.0 (NORMAL IMPORTANCE - AS IN 4.1.2.1)
Sa (0.2): = 0.100
Sa (1.0): = 0.030
SOIL SITE CLASS: D (STIFF SOIL)
Fa: = 1.3
Fv: = 1.4
IE: IMPORTANCE FACTOR FOR EARTHQUAKE = 1.0 (NORMAL IMPORTANCE - AS IN 4.1.2.1)
NOTE: ACCORDING TO NBCC, A MINIMUM DISTANCE OF AT LEAST 5 m SHOULD BE MAINTAINED FROM ANOTHER EXISTING OR FUTURE BUILDING OR FROM THE PROPERTY LINE TO JUSTIFY DISREGARDING DRIFT LOADS.

DRAWN BY

C ZONG

CHECKED BY

R.N.A. SAWYER

APPROVED BY

R.N.A. SAWYER

ENGINEER'S SEAL



PIONEER STEEL
MANUFACTURERS
LIMITED

1137 Lorimar Drive
Mississauga, Ontario
Canada L5S 1M5
1-800-668-5422

This drawing is the property of
PIONEER. It is loaned subject to return
on demand. It is not to be reproduced,
copied, or otherwise disposed of, nor to
be used for any purpose except as
provided by specific agreement.

COPYRIGHT © PIONEER

BUILDING MODEL

ALPINE 35'-16'

ORDER NO.


DWG. NO.

DWG. TITLE

SCALE 3/16"=1'-0"

DATE

1 / 1

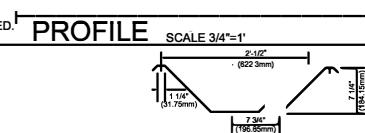

GENERAL ARRANGEMENT