### GINITRAIL NOTIS

#### I. FOUNDATION & CONCRETE

- A. Provide 1/2" expansion joint material between all concrete slabs and abutting concrete or masonry walls occuring in exterior or unheated interior areas.
- B. Frost footing 36" depth below finished grade.
- C. Place 1/2" diameter sill plate anchor bolts 7" into grouted concrete block or 7" into concrete. Space bolts at 6'-0" o.c. and within 12" of each corner and both sides of openings.
- D. Ventilation: Underfloor areas. Provide at least 2 openings or ventilators covered with corrosion resistant wire mesh not greater than 1/2" nor less than 1/16" in any dimension.
- E. Plates, Sills, and Sleepers: All plates or sills and sleepers which rest on concrete or masonry that is in direct contact with the earth shall be pressure treated wood or foundation redwood.
- F. Ends of wood girders entering masonry or concrete walls shall be provided with a 1/2" air space on tops, sides, and ends unless approved wood of natural resilience to decay or treated wood is used.
- G. A vapor barrier is NOT required within framed spaces against masonry or poured concrete walls.
- H. All furring strips attached to a concrete basement wall shall be treated lumber.
- I. Insulation of basement concrete foundation walls is required at time of finish.
- J. Minimum soil load-bearing value is 2000 lbs per square foot.

#### II. CARPENTRY

- A. Unless otherwise noted, minimum framing lumber shall be Hem Fir #2 Dry or better.
- B. Unless otherwise noted, provide:
- 1. Double header joists and trimmers at all floor openings.
- 2. Double 2" x 12" headers with 1/2" plywood between at all exterior door and window openings
- 3. Joists exceeding a nominal  $2" \times 8"$  dimensional lumber shall be supported laterally by solid blocking .
- 4. Floor construction: APA rated sturd-i-floor 24" o.c. 23/34" T & G Exposure 1. Field glued with AFG-01 adhesives and nailed.
- 5. Roof sheathing to be APA rated 24/16 Exposure 1. 7/16" thick.
- 6. In all bath and toilet areas use water resistant gypsum board for walls and ceilings, and plywood underlayment flooring with exterior glue.
- 7. All interior walls and ceilings are to be covered with 1/2" gypsum board, tape, float, and sand. (3 coats) Garage fire wall and ceilings to be covered with 5/8" firecode gypsum board. 1/2" on all others.
- C. Protection against decay and termites: Wood posts, poles, and columns shall bear upon a concrete footing and not be imbedded in concrete and shall be pressure treated wood, cedar, or redwood.
- D. The underside of a cantilever projecting above a garage door shall have the same fire protection as a garage ceiling, normally 5/8 inch type X gypsum sheathing.
- E. The header above a garage shall run the full length of the wall.

#### III. STAIRS & RAILS

- A. Stair riser and run: Stairs may be constructed with a 7 3/4" maximum rise and a 10" minimum run. Allow 6'-8" minimum headroom.
- B. Handrails: 1 1/4" minimum to 2 5/8" maximum, not less than 34" nor more than 38" above the nosing of the stair.
- C. Guardrails: Shall not be less than 36" in height. Intermediate rails not more than 5" o.c., including decks.
- D. A 11/2" x 31/2" piece may be used as handrail on exterior stairs.
- E. For a landing at the front entry, only one riser of up to 7.3/4 inches is allowed. All other exterior doors can have a maximum of 3 risers to the door before a landing is required.
- F. A landing is required at the top of a ramp leading to a door. The maximum slope of a ramp is 1:8.

#### IV. ENERGY CONSIDERATIONS

- A. Unless otherwise noted, provide:
- 1. Insulation minimums: Exterior walls R19; Ceilings/Roofs R38.00; Floors R30.00; Windows R1.79.
- 2. R-5 minimum rigid insulation at masonry foundation walls and slab on grade perimeter to 24".
- 3. Sill sealer between foundation and sill plate.
- 4. Caulking at all sash, sliding glass doors, entrance doors, and bottom plates.
- 5. Vapor barrier maximum rating of 1.0 perm in unventilated ceilings.
- 6. Attic insulation markers depth markers required every 300 sq. ft. facing the attic access.

#### V. HEATING/COOLING SYSTEMS

- A. Thermostat capable of being setback.
- B. All ductwork must be insulated; Supply = 8.0 or better. Returns in unconditioned attics and outside of the building = R-4 or better. Returns in unconditioned crawl spaces, garages or other spaces = R-2 or better.
- C. All ductwork must have all joints sealed, gasketed or taped to prevent air leakage. Duct tape is NOT allowed.
- D. HVAC Ducts and plumbing lines above an attached unheated garage shall be insulated with a minimum of R-13 insulation.

#### VI. MISCELLANEOUS

- A. Toilet Access: Water closet stool shall be located in a clear space not less than 30" in width, not less than 24" in front of the water closet (15" from W.C. center) and allowing a 4" minimum clearance on both sides of tank to any tub, shower or vanity.
- B. Fire rated doors: In 1 hour occupancy separation on the garage side, a 13/8" solid core door.
- C. Heating,  $\Lambda/C$  and Electrical: As per local requirements.

#### VI. MISCELLANEOUS (CONT.)

D. All exhaust fans to be vented to exterior of house.

E. Engineering calculations of loads for beam sizing may be required when submitting these plans for permit approval.

- F. Provide 2 2" x 4" with plywood headers above all interior door openings unless otherwise noted.
- G. All wood burning fireplaces and combustion air intakes for wood burning fireplaces shall be equipped with dampers .
- H. DO NOT SCALE DRAWINGS, written dimensions take precedence over scaled dimensions.

#### I. Smoke detectors:

- 1. In new construction, smoke detectors are required in each sleeping room AND on each level of the home.
- 2. Some hallways may not need a detector if above conditions are met.
- 3. Detectors shall be interconnected so all will sound an alarm if one operates.
- J. All walls over 10'-0" in height must have firestops every 10'-0".
- K. Provide 1/2" drywall as a draft stop on one side of one open web truss on floors every 1000 square feet.
- L. All building joints and penetrations are to be caulked, gasketed or sealed.
- M. Accessory structures closer than 6 feet to a dwelling are to be protected on the inside by 5/8" type X gypsum sheathing. A deck is considered part of the dwelling. Accessory buildings must be 6 feet from the deck or protected by gypsum as stated above.
- N. Bathrooms must have minimum ceiling height of 6 feet 8 inches including in a tub or shower.
- O. Bathrooms with a sloped ceiling must have 6 feet 8 inches in front of a toilet or lavatory.
- P. Porches, balconies, ramps, or raised floors of more than 30 inches above grade or floors below must have guards.
- Q. Retaining walls may require guards depending upon height of wall and location of nearby walking surface.
- R. Carbon monoxide detectors are required on each level including basement.

#### WATER HEATING

Electric -	Minimums:	30 g	gal -	.89 <del>E</del> F
		40	gal -	.88 <del>E</del> F
			- 1	0/55

50 gal - .86EF Gas - Minimums: 30 gal - .56EF 40 gal - .54FF

50 gal - .53<del>E</del>F

Heat traps are required on hot & cold inlets for systems with vertical risers.

Shower heads - use 2.5 gallons/minute

BUILDER MUST COMPLY WITH THE NEW STATE STATUTE FOR RADON RESISTANT CONSTRUCTION.

ALL HEADERS, ROOF TRUSSES, FLOOR TRUSSES OR 1-JOISTS SIZED BY:

ALL STEEL BEAMS SIZED BY:

© 2025 N.V. INC.

THIS PLAN AND ALL DETAILED INFORMATION WITHIN IS COPYRIGHTED
BY N.V. INC. ANY USE OF THIS PLAN IN WHOLE OR PART WITHOUT
WRITTEN PERMISSION OF N.V. INC. IS PROHIBITED.

#### DISCLAIMER

BUILDER MUST COMPLY WITH THE NEW STATE STATUTE FOR RADON RESISTANT CONSTRUCTION.

N.V. Inc. is hereby released from any and all legal claims by the purchase of these plans. This serves as an official notice to the purchaser and/or builder that they relinquish any right of legal action, responsibility, or liability against N.V. Inc, it's owners, officers, and/or employees, that may arise before, during and/or after any construction from these plans. Due to the fact that N.V. Inc. is a registered corporation in the state of Nebraska, these plans were designed and drafted to meet the specifications of codes and average conditions in said state. Because conditions and codes vary from region to region, N.V. Inc. can not guarantee the suitability of these plans to all areas. These plans must be built in compliance with all your local, county, state, and federal codes. For determining the application of these plans for your region, seek the consultation of your local building professional. It is the responsibility of the purchaser and/or builder to meet these codes during any construction from these plans. Therefore, N.V. Inc. shall not be held liable and/or responsible for the assistance, consultation, and/or work executed for the purpose of construction from these plans by a builder, contractor, and/or other professional.

CONSTRUCTION FROM THIS PLAN IS THE RESPONSIBILITY OF THE OWNER AND/OR BUILDER. NEW VENTURES, INC. IS HEREBY RELEASED OF ANY LIABILITY THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

#### TABLE R301.2 CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA

GROUND	WIND	SEISMIC DESIGN	S	UBJECT TO DAMAGE	FROM		FLOOD
SNOW LOAD	SPEED (MPH)	CATEGORY	WEATHERING	FROST LINE DEPTH	TERMITE	DECAY	HAZARDS
30 PSF	90 MPH	В	SEVERE	36"	MODERATE TO HEAVY	SLIGHT TO MODERATE	SEE LMC CH. 27.55

## TABLE R301.4 MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS

(iii poolius per square root)					
USE	LIVE LOAD				
EXTERIOR BALCONIES	60				
DECKS	40				
FIRE ESCAPES	40				
PASSENGER VEHICLE GARAGES	50				
ATTICS WITHOUT STORAGE	10				
ATTICS WITH STORAGE	20				
ROOMS OTHER THAN SLEEPING ROOMS	40				
SLEEPING ROOMS	40				
STAIRS	40				
GUARDRAILS AND HANDRAILS	200				

#### TABLE R301.6 ALLOWABLE DEFLECTION OF STRUCTURAL MEMBERS

STRUCTURAL MEMBER	ALLOWABLE DEFLECTION
RAFTERS HAVING SLOPES GREATER THAN 3/16	
WITH NO FINISHED CEILING ATTACHED TO RAFTERS	L/180
INTERIOR WALLS AND PARTITIONS	H/240
ALL OTHER STRUCTURAL MEMBERS L/240	L/240
EXTERIOR WALLS WITH PLASTER OR STUCCO FINISH	H/360
EXTERIOR WALLS - WIND LOADS WITH BRITTLE FINISHES	L/240
EXTERIOR WALLS - WIND LOADS WITH FLEXIBLE FINISHES	L/120
FLOORS - 16'-6" OR LESS	L/360
FLOORS OVER 16'-6" SPAN	L/480

GENERAL ELECTRICAL LEGEND						
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION			
$\oplus$	110 V. OUTLET	QD	FLOOD LIGHT			
$\bigoplus$	HALF SWITCHED 110 V. OUTLET	<b>メ</b> =====ギ	FLUORESCENT LIGHT			
€	220 V. OUTL <del>E</del> T	$\overline{\Diamond}$	— TRACK LIGHT			
WP⇔	WEATHER PROOF 110 V. OUTLET	$\overline{\Diamond}$	— UNDER COUNTER LIGHT			
<sup>€</sup>	GROUND FAULT 110 V. OUTLET	E	EXHAUST FAN			
	FLOOR 110 V. OUTLET	FÞ	EXHAUST FAN/LIGHT COMBO			
$\Diamond$	SURFACE MOUNT LIGHT		DADDLE FAM /LICHT FIVTUDE			
ф	* RECESSED LIGHT		PADDLE FAN/LIGHT FIXTURE			
A	WALL MOUNT LIGHT		PADDLE FAN ONLY			
PC	PULL CORD SURFACE MOUNT		PADDLE FAIN UNLY			
SD	CEILING SMOKE DETECTOR	00 🔀	CARBON MONOXIDE DETECTOR			
SD	WALL SMOKE DETECTOR	\$	TWO-WAY SWITCH			
<b>&gt;</b>	TELEPHONE	\$3	THREE-WAY SWITCH			
VIV	TELEVISION	\$4	FOUR-WAY SWITCH			

\* RECESSED LIGHT FIXTURES INSTALLED IN THE BUILDING ENVELOPE IC RATED WITH NO PENETRATIONS OR INSTALLED INSIDE A SEALED BOX




The Trade Center
6031 South 58th Street, Suite C
Lincoln, NE 68516
Phone: (402) 420-0088
Fax: (402) 420-0089
www.newventures.com

NEW RESIDENCE PLANS FOR:

DEKMX HOMES LLC


SLAB ON GRADE RANCH

NV14025 1 of 5

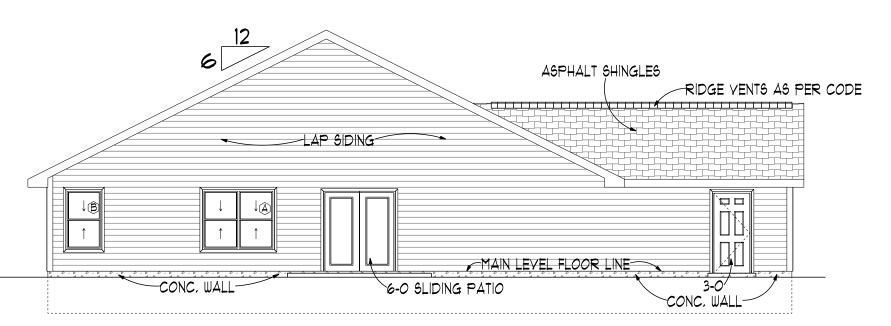


LEFT SIDE ELEVATION

SCALE: 1/8" = 1'-0"

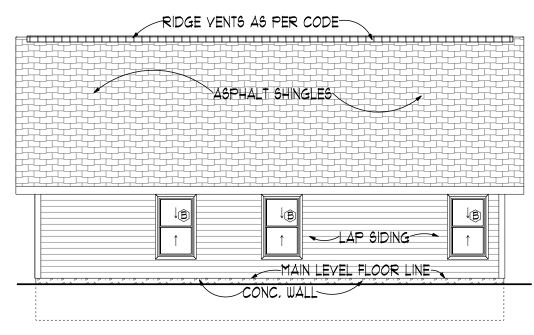


REAR ELEVATION

SCALE: 1/8" = 1'-0"

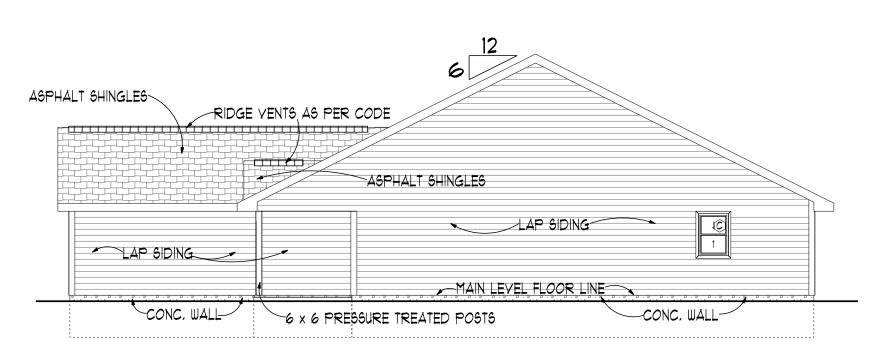


RIGHT SIDE ELEVATION

SCALE: 1/8" = 1'-0"

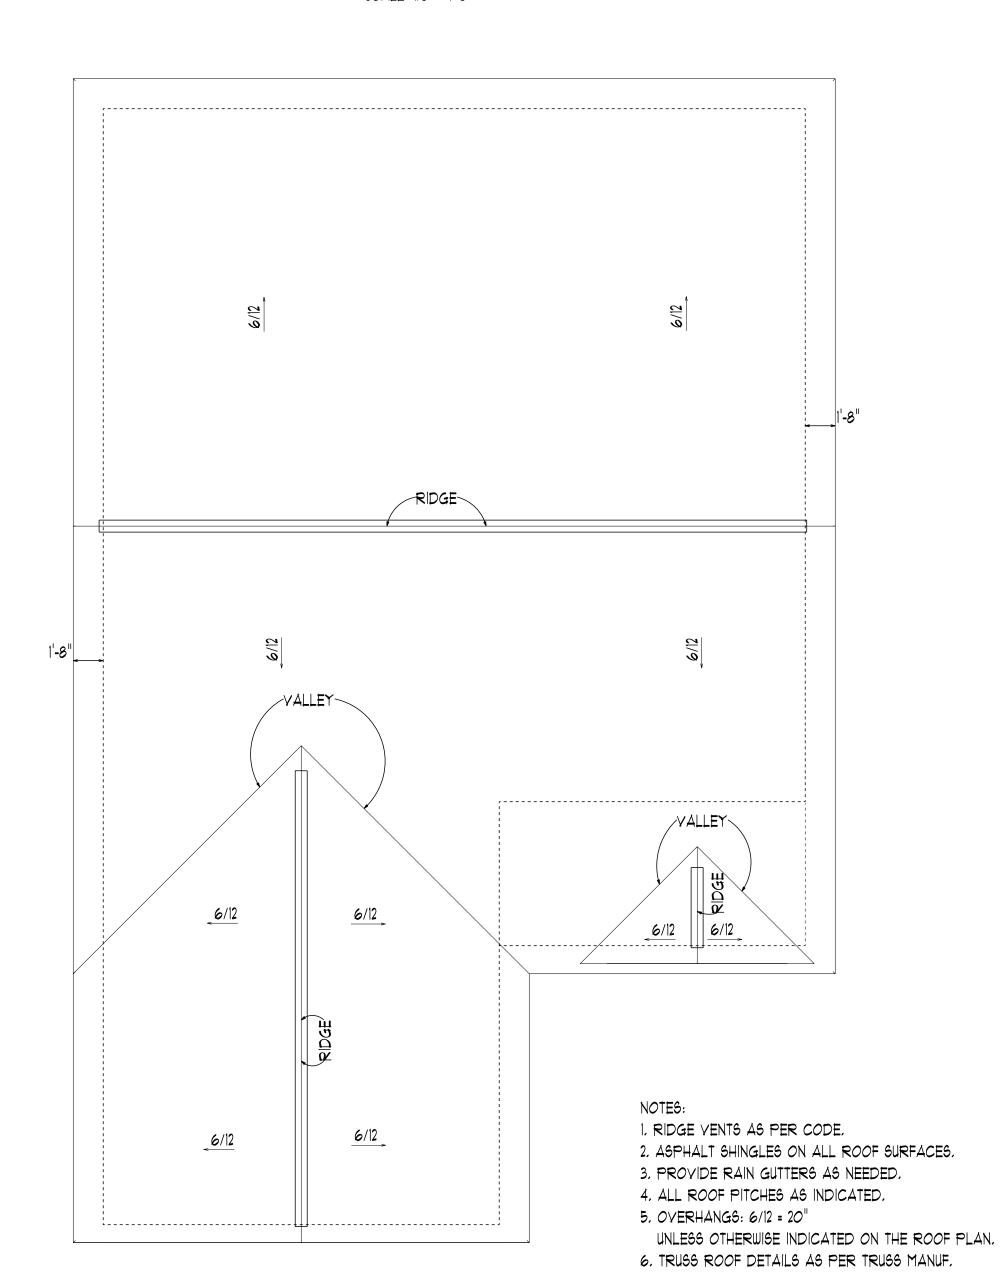

WINDOW SCHEDULE #								
KEY	NO.	SIZE	MANUF,	R.O.	GLASS SZ.	STYLE	HDR,	EGRESS
<b>(A)</b>	2	3050-2	ANDERSEN-100	6'-0" x 5'-0"	2'-5 1/4" x 2'-1 9/16"	DBL, HUNG	HDR, AS PER MANUF,	YES
(B)	4	3050	II	3'-0" x 5'-0"	2'-5 1/4" × 2'-1 9/16"	DBL, HUNG		YES
(C)	1	2636	li li	2'-6" × 3'-6"	1'-11 1/4" x 1'-4 9/16"	DBL, HUNG	(3) 2 x 12	NO

#TO BE APPROVED BY CONTRACTOR PRIOR TO ORDERING
#EXACT ROUGH OPENINGS TO BE PROVIDED BY WINDOW MANUF.

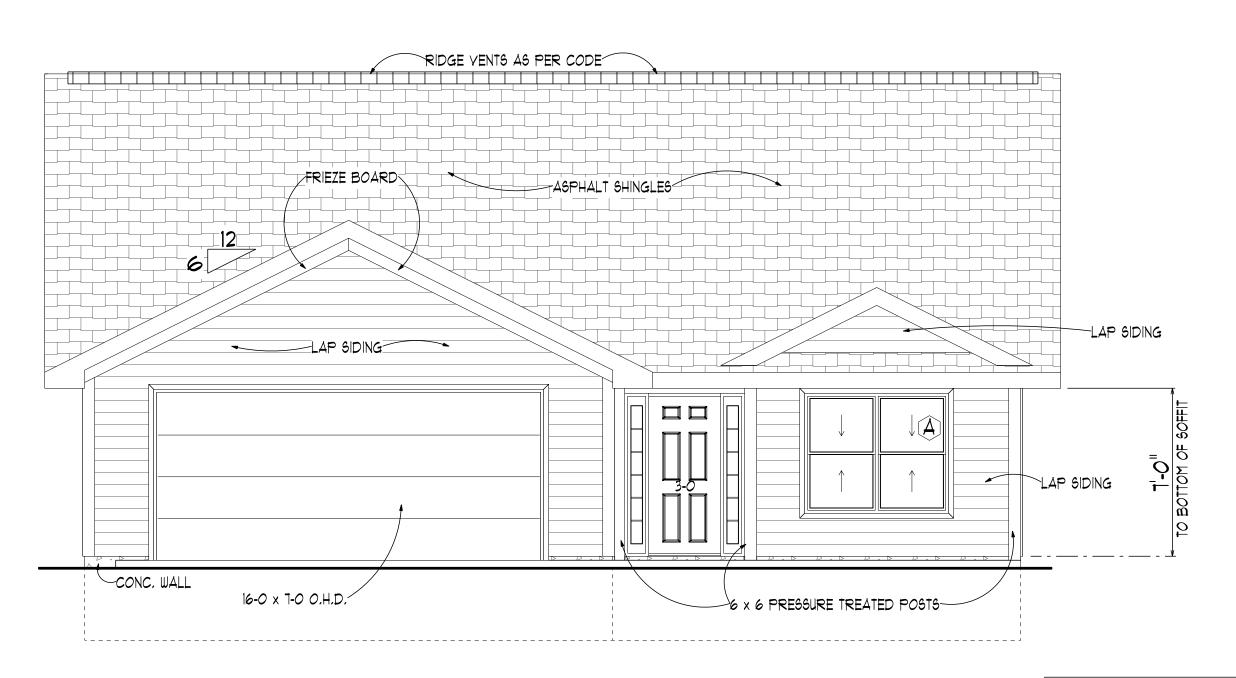

FRONT ELEVATION


SCALE: 1/4" = 1'-0"

CONSTRUCTION FROM THIS PLAN IS THE RESPONSIBILITY OF THE OWNER AND/OR BUILDER. NEW VENTURES, INC. IS HEREBY RELEASED OF ANY LIABILITY THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

Designer is not an architect or engineer and construction from these plans should not be undertaken without the assistance of a construction professional. Because site conditions may vary, designer does not warrant the suitability of these plans for use on your specific site. Consult your construction professional to determine the suitability of these plans for your specific site and application.



NV14025 DEKMX HOMES LLC S.O.G. RANCH SHT 2 OF 5

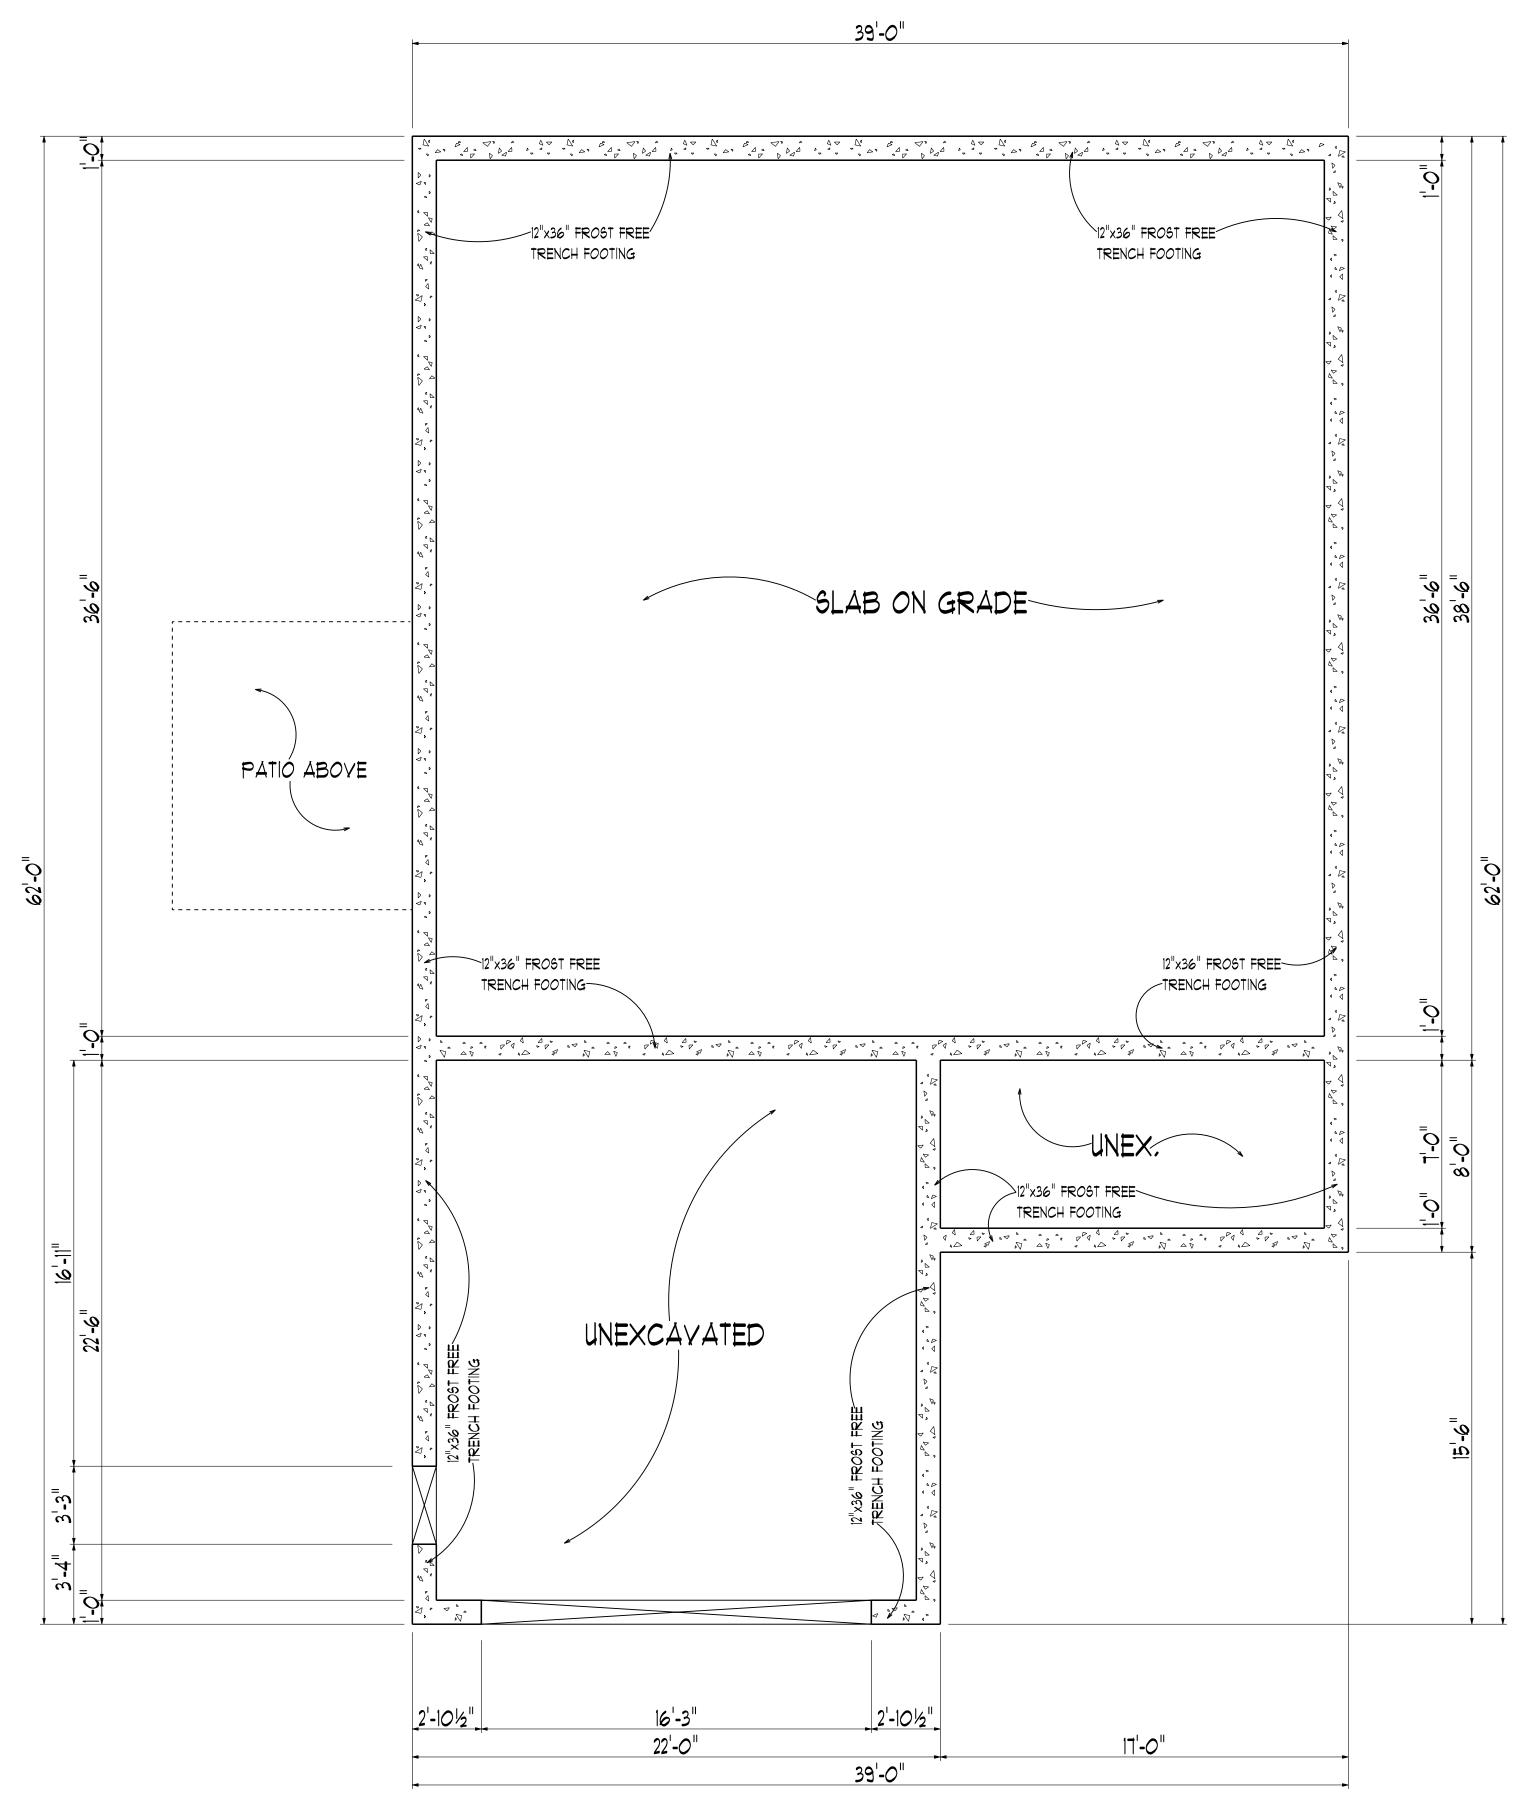

# FOUNDATION PLAN SCALE: 1/4" = 1'-0"


NOTE:
12" × 36" FROST FREE
TRENCH FOOTING UNLESS
OTHERWISE NOTED

CONSTRUCTION FROM THIS PLAN IS THE RESPONSIBILITY OF THE OWNER AND/OR BUILDER. NEW YENTURES, INC. IS HEREBY RELEASED OF ANY LIABILITY THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

Designer is not an architect or engineer and construction from these plans should not be undertaken without the assistance of a construction professional. Because site conditions may vary, designer does not warrant the suitability of these plans for use on your specific site. Consult your construction professional to determine the suitability of these plans for your specific site and application.



NV14025 DEKMX HOMES LLC S.O.G. RANCH SHT 3 OF 5

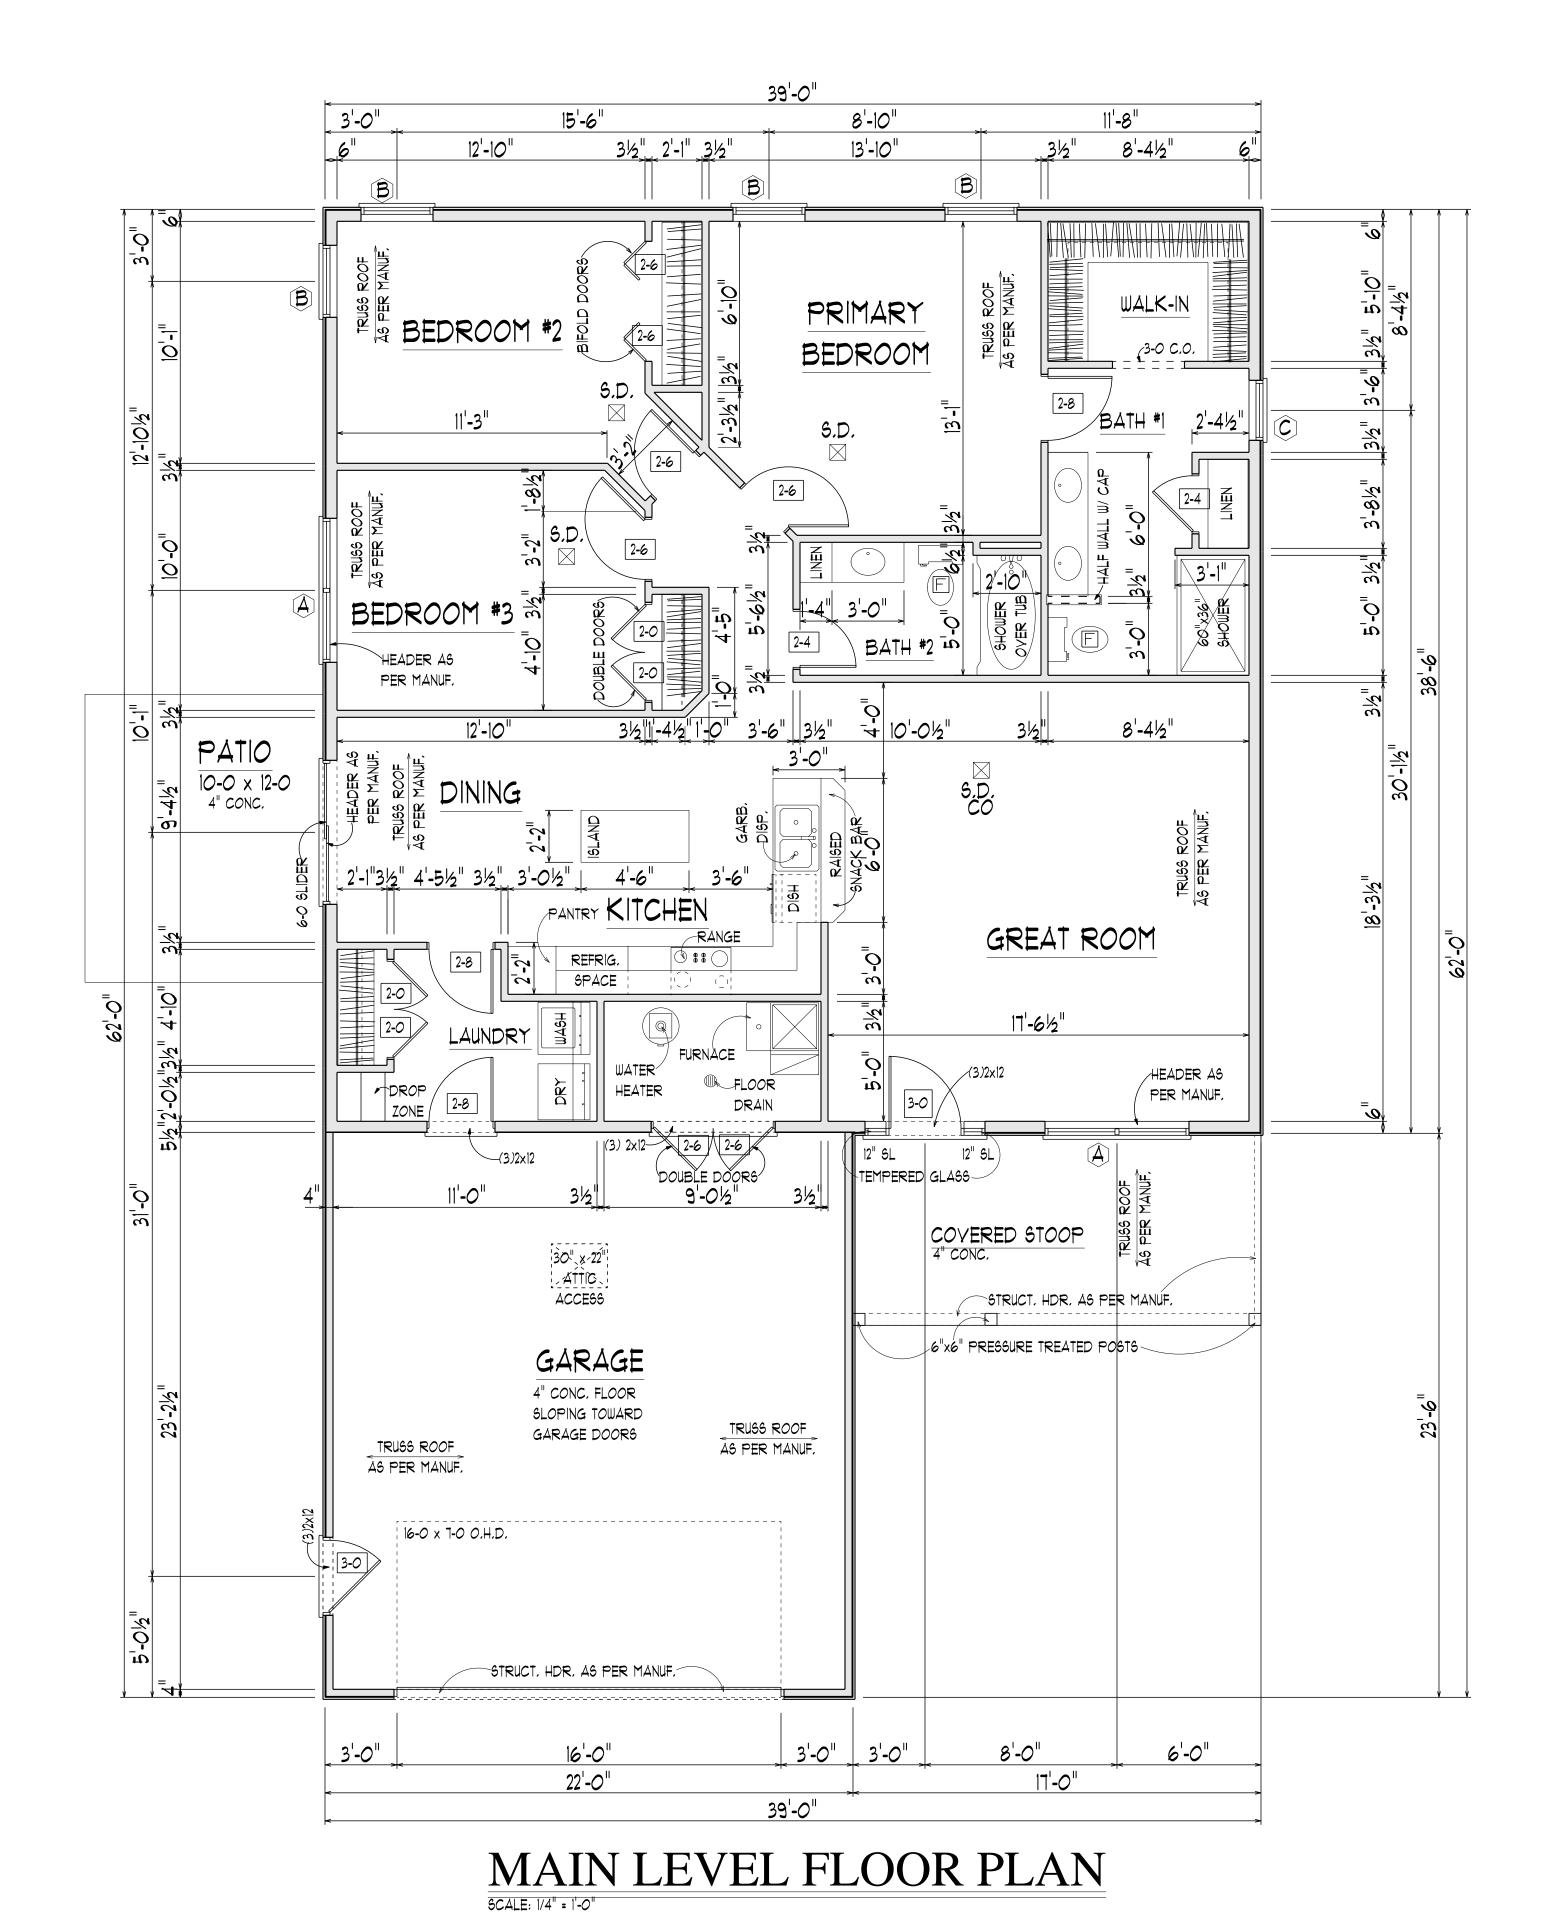

NOTE: 8'-0" CEILING HEIGHT ON MAIN LEVEL UNLESS OTHERWISE NOTED.

MAIN LEVEL 1500 SQ. FT.


Designer is not an architect or engineer and construction from these plans should not be undertaken without the assistance of a construction professional. Because site conditions may vary, designer does not warrant the suitability of these plans for use on your specific site. Consult your construction professional to determine the suitability of these plans for your specific site and application.




The Trade Center
6031 South 58th Street, Suite C
Lincoln, NE 68516
Phone: (402) 420-0088
Fax: (402) 420-0089
www.newventures.com

NV14025 DEKMX HOMES LLC S.O.G. RANCH SHT 4 OF 5

CONSTRUCTION FROM THIS PLAN IS THE RESPONSIBILITY OF THE OWNER AND/OR BUILDER. NEW VENTURES, INC. IS HEREBY RELEASED OF ANY LIABILITY THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

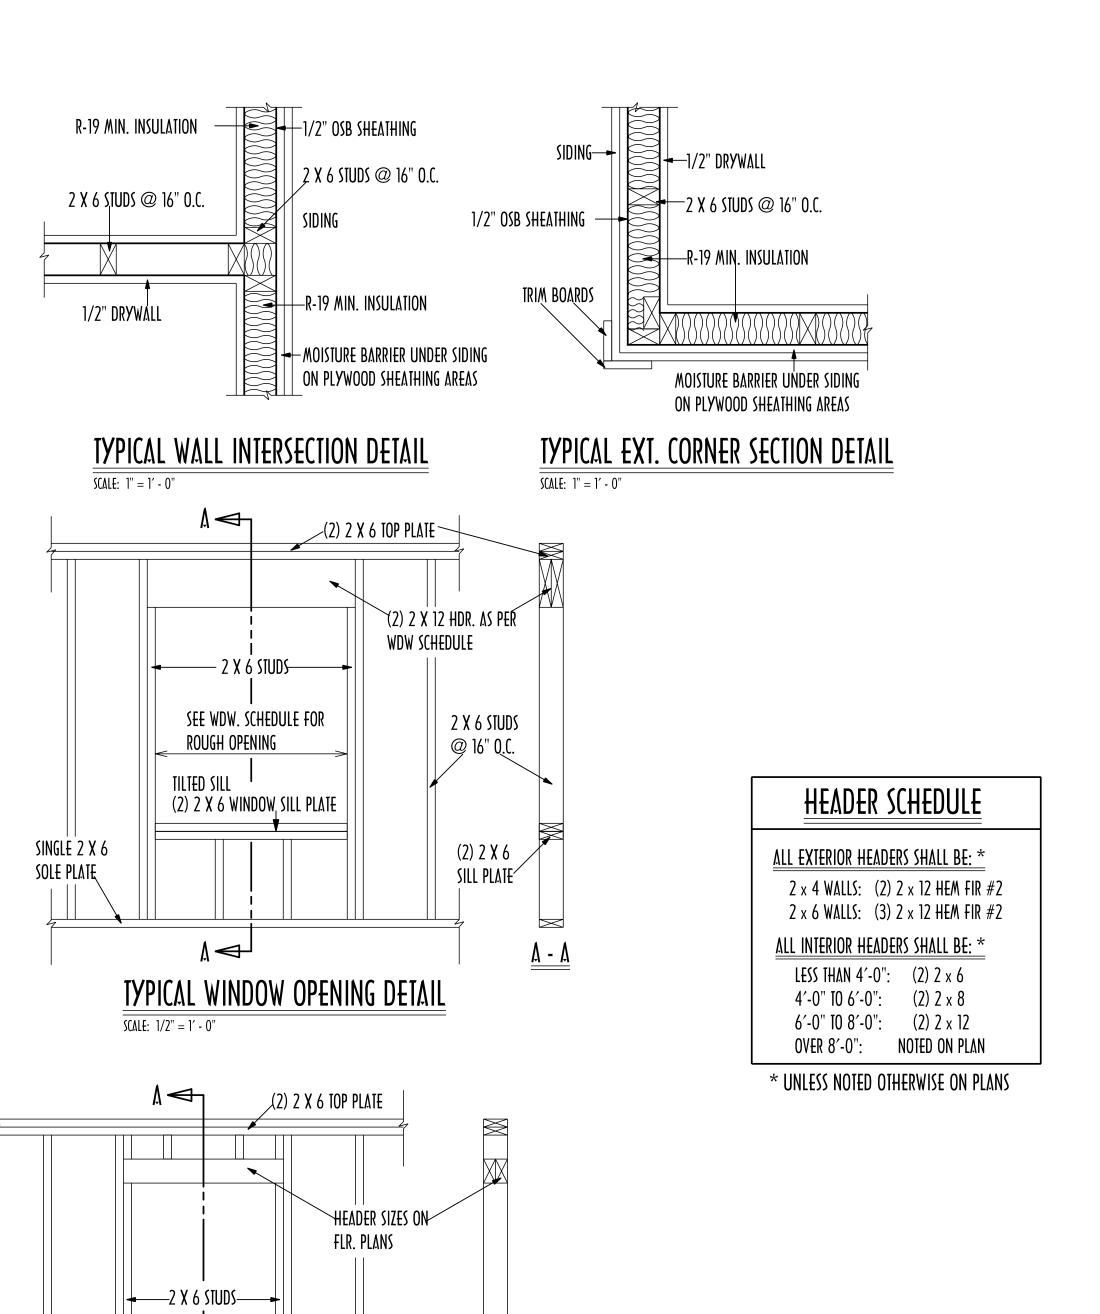

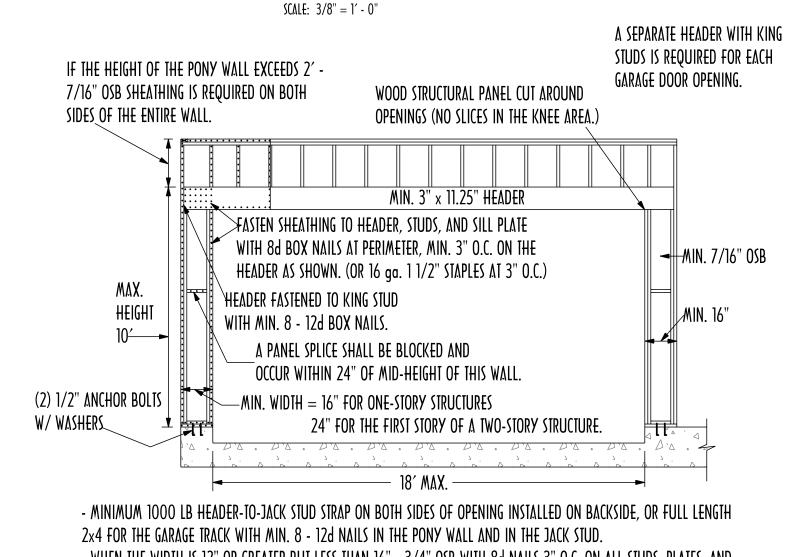

(SEE WALK-OUT WALL SECTION FOR REBAR INFORMATION)

TYPICAL GARAGE & WALL SECTION

ICE SHIELD TO EXTEND A MINIMUM OF 24" UP THE ROOF FROM

THE INSIDE EDGE OF ALL EXTERIOR WALLS

A.P.A. 24/16 RATED

SHEATHING 7/,16"

UNDEREAVE VENTS

1/2" OSB SHEATHING

6" MIN. FROM GRADE TO WOOD

36" DEEP FROST-FREE

TRENCH FOOTING

GRADE

SPACED @ 8'-0" 0.C

SIDING-

FLASHING\

2" X 6" SUB-FASCIA-

1" X 8" FASCIA<sup>—</sup>

WATER RESISTIVE BARRIER, SUCH AS 15

UNDER ALL SIDING MATERIALS

POUND FELT OR HOUSE WRAP, IS REQUIRED

15 # ROOFING FELT

PROVIDE DRAFT

STOPS IN ROOF AREA

EVERY 3000 SQ/FT

ROOF TRUSSES

AS PER MANUF.

8'-0" MAIN LEVEL CLG. 1

-BATT OR BLOWN INSULATION ON TOP;

TOTAL TO EQUAL R-49 MIN.

-2 X 6 STUDS @ 16" O.C.

——R-19 MIN. INSULATION

NON ABSORBENT EXP. JOINT

4" SAND FILL

4" CONC. FLOOR

POLY VAPOR BARRIER

,2 X 6 SILL PLATE

–1/2" DRYWALL CLG. & WALLS—

- WHEN THE WIDTH IS 12" OR GREATER BUT LESS THAN 16" - 3/4" OSB WITH 8d NAILS 3" O.C. ON ALL STUDS, PLATES, AND HEADERS IS REQUIRED. ONE 1/2" ANCHOR BOLT WITH ONE ANCHOR STRAP ON EACH END OF THE FOUNDATION STUB WALL.

\* A WALL LESS THAN 12" IN WIDTH MUST BE DESIGNED BY A LICENSED ENGINEER.

#### CITY OF LINCOLN/LANCASTER COUNTY ALTERNATE BRACE WALL PANEL AT GARAGE DOOR OPENINGS SCALE: 1/4'' = 1' - 0''

site and application. **I**/ENTURES residential design The Trade Center 6031 South 58th Street, Suite C

Designer is not an architect or engineer and construction from these plans should

not be undertaken without the assistance

ite conditions may vary, designer does not warrant the suitability of these plans


for use on your specific site. Consult your

construction professional to determine the suitability of these plans for your specific

a construction professional. Because

Lincoln, NE 68516 Phone: (402) 420-0088 Fax: (402) 420-0089 www.newventures.com

> NY14025 DEKMX HOMES LLC S.O.G. RANCH SHT 5 OF 5

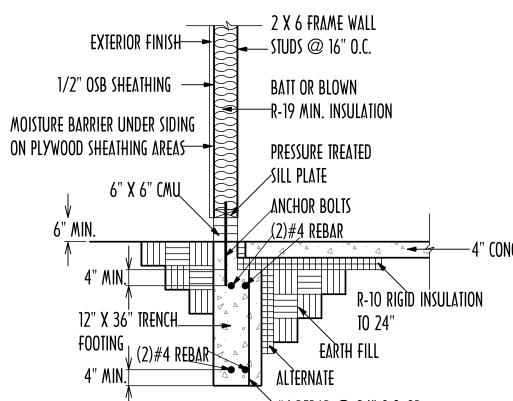

CONSTRUCTION FROM THIS PLAN IS THE RESPONSIBILITY OF THE OWNER AND/OR BUILDER, NEW YENTURES, INC. IS HEREBY RELEASED OF ANY LIABILITY THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

#### $\Lambda \longrightarrow$ TYPICAL DOOR OPENING DETAIL SCALE: 1/2'' = 1' - 0''

SEE FLR. PLANS FOR

DR. OPENING WIDTHS

SINGLE 2 X 6

SOLE PLĄTE

REBAR NOTES HORIZONTAL REINFORCEMENT SHOULD BE 18" MAX FROM TOP OF FOOTING 8'-0" HIGH WALLS: #4 REBAR @ 24" O.C. HORIZONTAL #4 REBAR @ 24" O.C. OR #5 REBAR @ 30" O.C. VERTICAL 9'-0" HIGH WALLS: #4 REBAR @ 24" O.C. HORIZONTAL #4 REBAR @ 16" O.C. OR #5 REBAR @ 24" O.C. VERTICAL <u>10'-0" HIGH WALLS:</u> #4 REBAR @ 24" O.C. HORIZONTAL #4 REBAR @ 12" O.C. OR #5 REBAR @ 18" O.C. VERTICAL \* UNLESS NOTED OTHERWISE ON PLANS

2 X 6 STUDS @ 16" O.C.

> 4" CONC. FLOOR `#4 REBAR @ 24" O.C. OR #5 REBAR @ 30" O.C. VERTICAL WALK-OUT WALL SECTION

> > SCALE: 1/2'' = 1' - 0''