




Class III


IP20

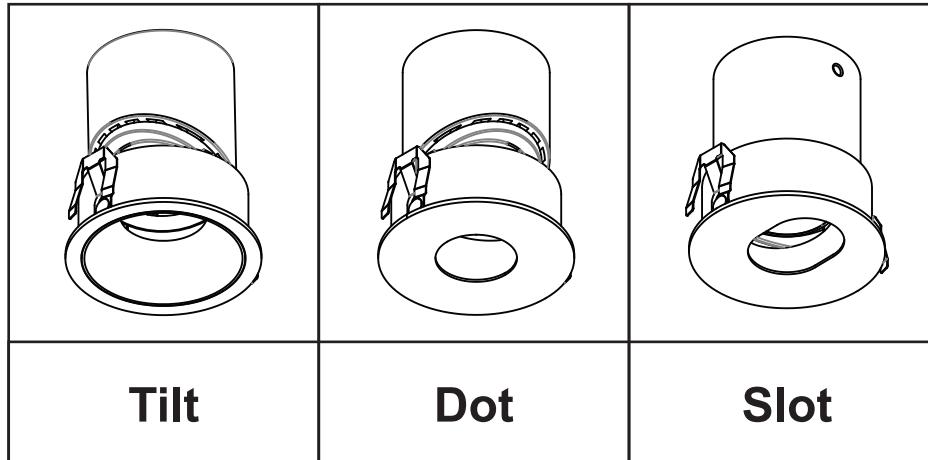


Tilt

Dot


Slot

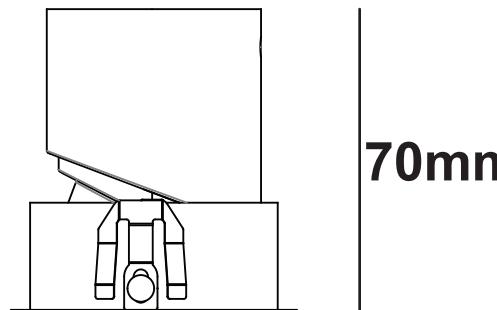


70mm

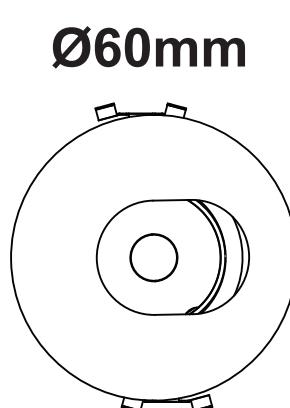

Ø60mm

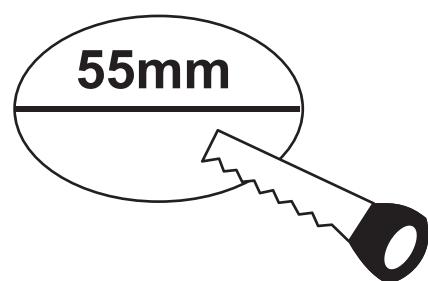



55mm

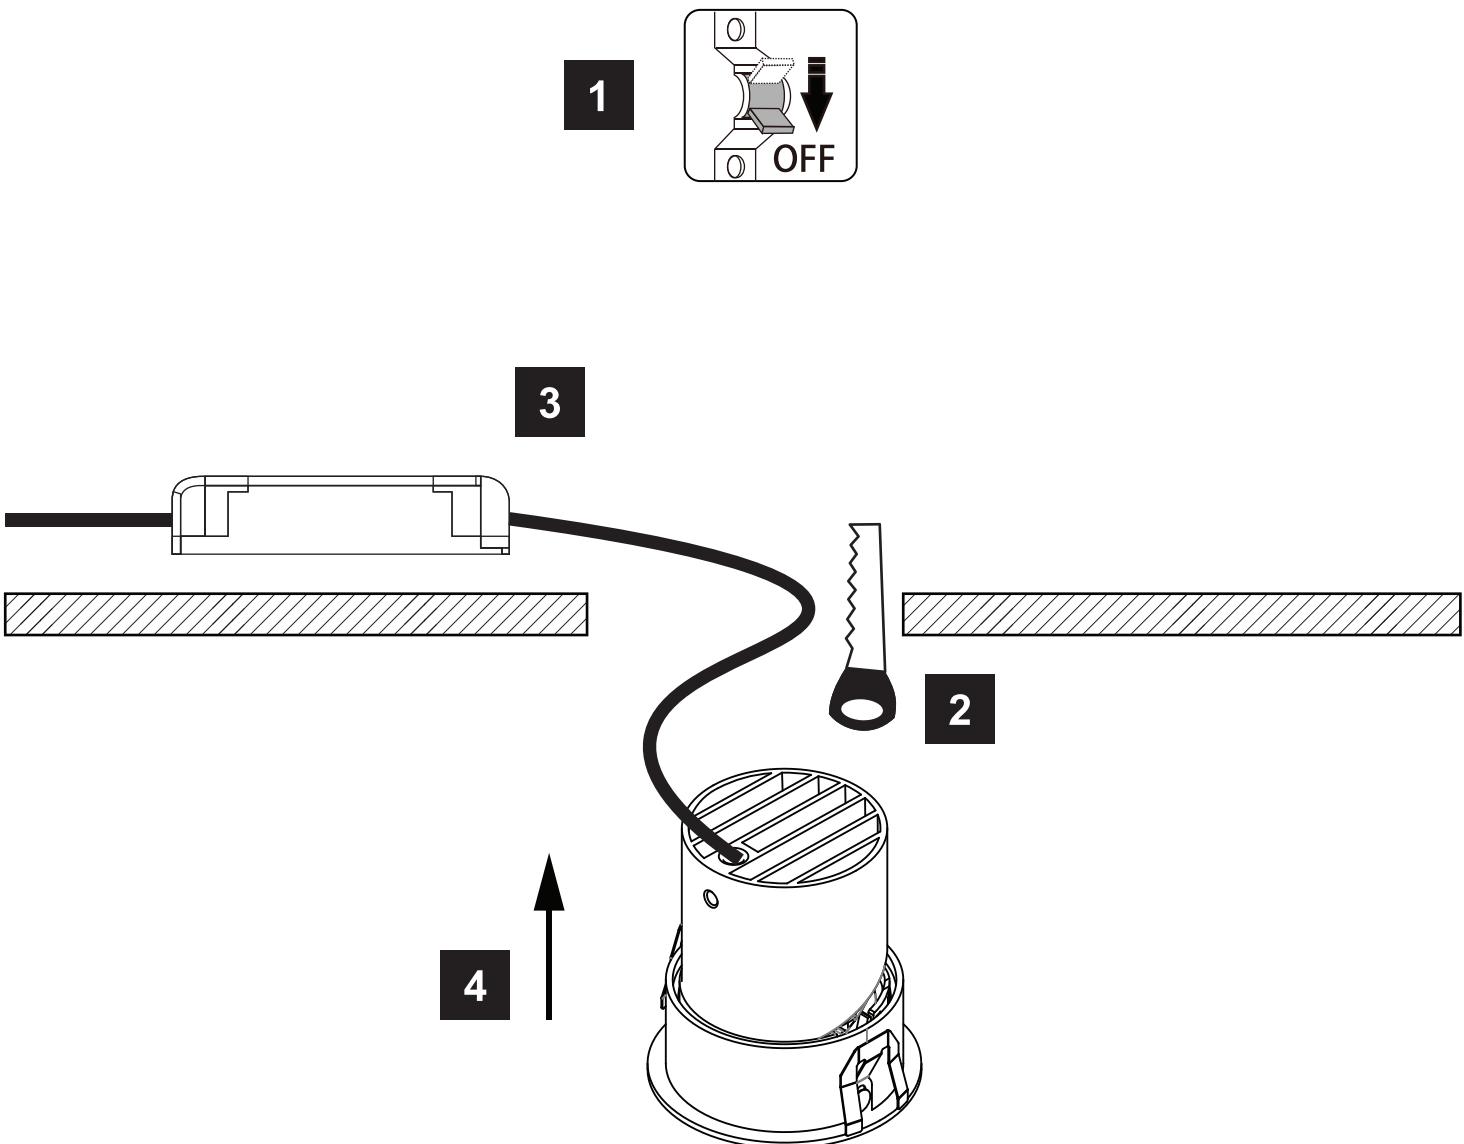

WARNING

Declared electrical work must be installed by licensed electrician.

Clearance Information - AS/NZS 3000 Wiring Rules

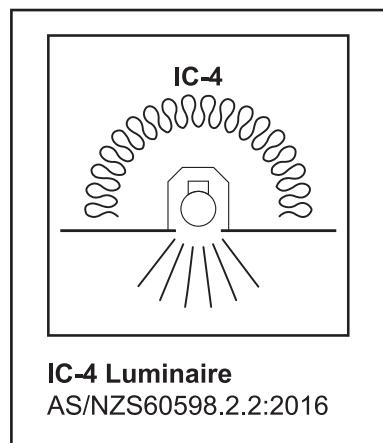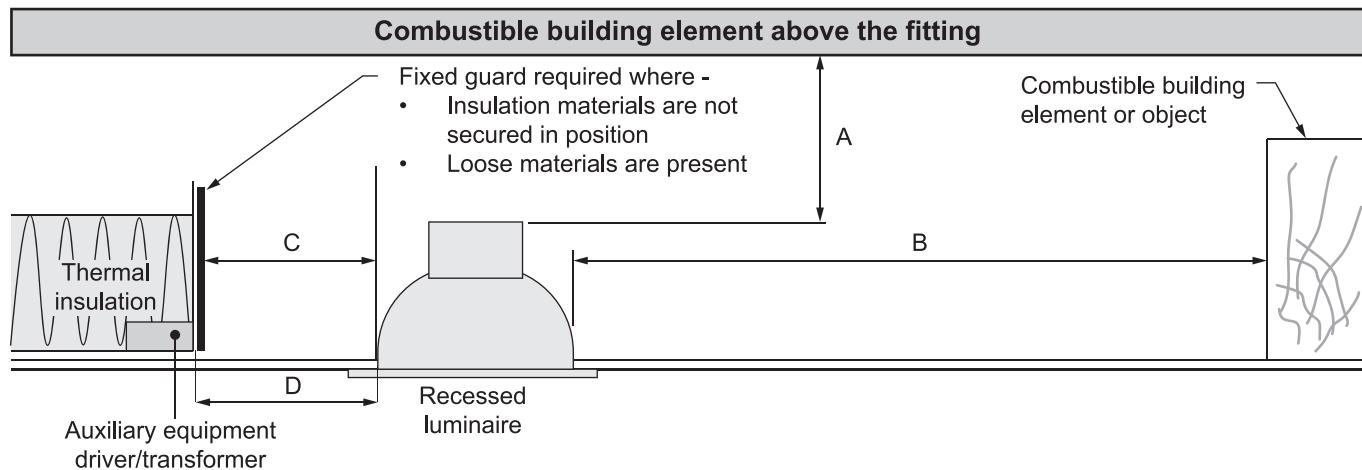

Location	Distance
A - Clearance above luminaire	0mm
B - Side clearance to Structural member	0mm
C - Clearance to thermal insulation	0mm