



The York Water Company

2/10/2025

Corina Mann – Hellam Township
Email: cmann@hellamtownship.com

Reference: Hydrant Flow Letter
Druck Valley Rd York PA 17406

In accordance with your inquiry, we wish to advise that our Company conducted a water flow test on 2/10/2025 at 10:15 AM with the flow being made from a hydrant in Hellam Township in front of Brookhaven Mobile home park and readings being made from a hydrant on Druck Valley Rd (MZD-91)

A flow of 1760 gpm reduced a static pressure of 148 psi to a residual of 134 psi. The flow was based upon a 110psi pitot reading through a 2-1/2-inch diameter nozzle using a coefficient of 0.90. We recommend that designers/engineers refer to AWWA M-17 and other guidelines for interpreting flow test results.

We wish to stress that this test only indicates the supply available at the time and location of the test and should not be construed as a warranty of the supply available by us. **Per Section 11.4 of The York Water Company (YWC) Tariff, customers may not install pumps that draw water directly from the YWC distribution system, unless specifically approved by YWC. If your project might involve the potential installation of such a pump, please contact us immediately.**


We would like to emphasize that we cannot accept responsibility for any calculations or interpretations made based on these test results.

Please feel free to reach out to us if you require further assistance or if you are interested in conducting and/or observing a test of your own. You can reach us by phone at (717) 845-3604 or via email at new.services@yorkwater.com.

Sincerely,

The New Service Department

The York Water Company

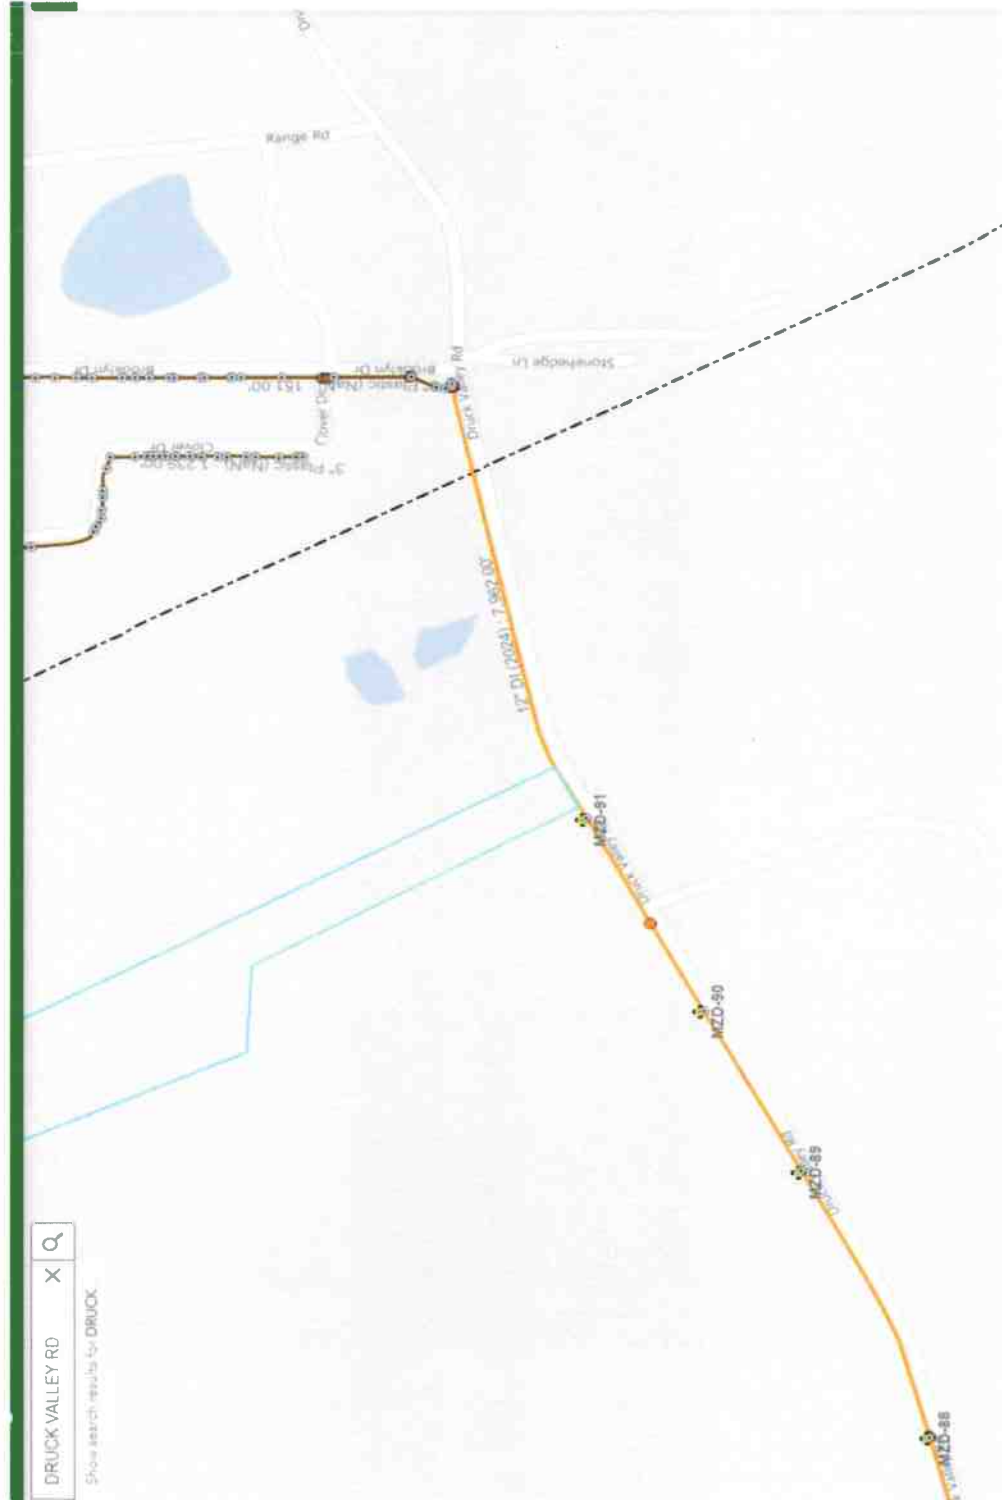



The York Water Company

Construction Department

FAX 717.843.2715

PHONE 717.845.3601

Date: February 10th, 2025

TO: Corina Mann
Hellam Township
Email: cmann@hellamtownship.com

SUBJECT: Approval letter for fire hydrant **Installation & Billing Acknowledgement** for hydrants to be installed as part of the Water Main Extension to the Brookhaven Mobile Home Park.

MEMO: I am requesting approval from **Hellam Township** to install (1) fire hydrant(s) to the following location(s) in conjunction with the Water Main Extension to the Brookhaven Mobile Home Park. Upon installation, the hydrants will be inspected to ensure proper operation and will be placed in service, at which time, billing to **Hellam Township** will begin.

1 – Install hydrant alongside Druck Valley Rd. in Hellam Township. Approx. location being intersection of Druck Valley Rd. & Stonehedge Ln. **Hydrants will be billed at \$36.36 / Hydrant / Month**

For hydrant rates go to the York Water Company Website (yorkwater.com), click on "PUC Approved Water Tariff", and go to page 46 for Gravity System hydrants and page 48 for Repumping System hydrants.

Please email approval to Elder Sterner – elders@yorkwater.com if these hydrants are to be installed.

Thank You,

Signature approval:

Elder Sterner
Construction Coordinator

Corina Mann

From: Elder Sterner <elders@yorkwater.com>
Sent: Monday, February 10, 2025 1:54 PM
To: Corina Mann
Subject: RE: Re: [External] RE: Hydrant Installment Proposal
Attachments: Druck Valley Rd - ES021025.pdf; Brookhaven Hydrant Approval Letter - Hellam.pdf

Good afternoon Corina,

Hope you're doing well.

We have finished up with the hydrant installed in hellam township and flow test results. They are in the attached document as well as the location (right outside of the mobile home park).

Attached is also the hydrant approval letter that we will need you to review and sign if everything is agreeable.

Please let me know if you have any questions.

Thank you!

Elder Sterner
Construction Coordinator
The York Water Company
130 E. Market St.
York, PA 17401

E: elders@yorkwater.com
C: (717) 668-0692

www.yorkwater.com
NASDAQ: YORW



Confidentiality Notice: This electronic mail transmission is confidential and is intended only for the party or parties to whom it is addressed. If you have received this transmission in error, or are not the intended party, please immediately return it to the sender.