


TOWN OF LOOMIS

CONSTRUCTION STANDARDS

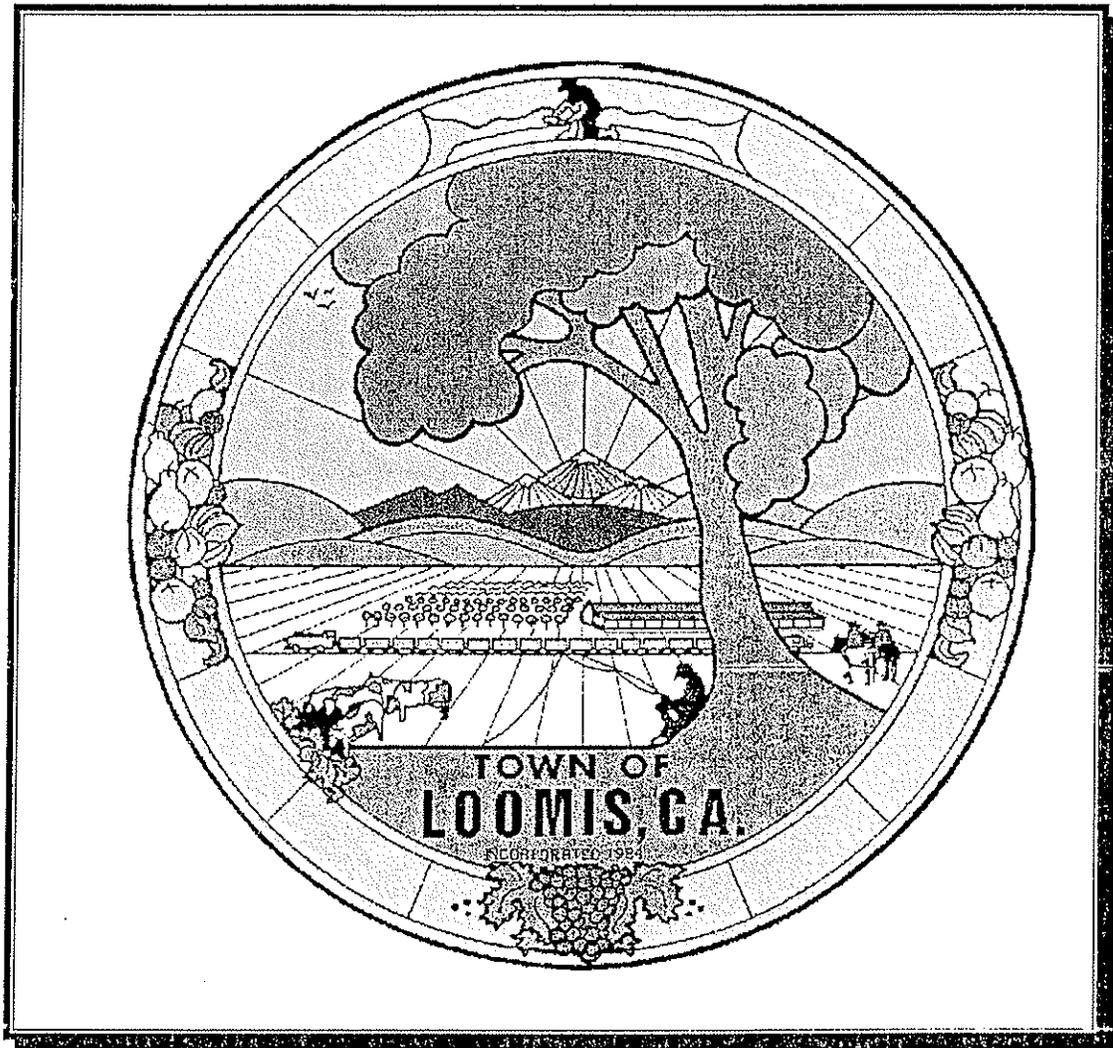

MARCH 2004
(ADOPTED BY TOWN COUNCIL JUNE 8, 2004)
RESOLUTION NO. 04-15

CONSTRUCTION STANDARDS

TABLE OF CONTENTS

ABBREVIATIONS

SECTION 1 PURPOSE AND DEFINITIONS (PD)

1-1	Purpose	PD-1
1-2	Construction Practice	PD-1
1-3	Definitions	PD-1

SECTION 2 CONTRACTOR'S AND DEVELOPER'S RESPONSIBILITIES (CD)

2-1	General	CD-1
2-2	Contractor's Responsibility	CD-1
	A. Plans	CD-1
	B. Notification	CD-1
	C. U.S.A. Markings	CD-1
	D. Testing	CD-1
	E. Cultural Resources	CD-1
	F. Hazardous Materials	CD-2
	G. Working Hours	CD-2
	H. Traffic Control	CD-2
	I. Preservation of Property	CD-3
	J. Personnel	CD-4
	K. Weather	CD-4
	L. Trenching	CD-4
	M. Trailer and Storage Material	CD-4
	N. Street Cleaning	CD-4
	O. Interruption of Parking Areas	CD-4
	P. Contractor Employee Vehicle Parking	CD-4
	Q. Construction Safety	CD-4
	R. Blasting and Explosive Requirements	CD-4
2-3	Developers Responsibilities	CD-5
	A. Improvement Plan Submittal	CD-5
	B. Plan Check and Inspection Fee	CD-6
	C. Plan Approval	CD-6
	D. Final Plans Required	CD-6

	E.	Improvement Plans Revisions During Construction	CD-6
	F.	Record Drawings	CD-7
	G.	Conflicts, Errors, and Omissions	CD-7
	H.	Change in Consulting Engineer	CD-7
	I.	Existing Utilities	CD-7
	J.	Partial Plans	CD-8
	K.	Other Agency Notifications	CD-8
	L.	Inspection Requirements	CD-8
	M.	Special Notice and Permits	CD-9
	N.	Plan Sheet Requirements	CD-10
2-4		Minimum Requirements for Model Home Building Permits	CD-13
2-5		Minimum Requirements for Production Home Building Permits	CD-14
2-6		Requirements for Subdivision Notice of Completion (N.O.C.)	CD-14
2-7		Residential Occupancies During Subdivision Building	CD-15
2-8		Guarantee and Warranty	CD-16
	A.	Subdivision Improvements	CD-16
	B.	Encroachment Permit Improvements	CD-17
	C.	Underground Warranty Work	CD-17
CONTRACTOR'S AND DEVELOPER'S DETAIL			
		Project Signature Block	CD-1

SECTION 3 STREETS (H)

3-1		General	H-1
3-2		Connection to Existing Improvements	H-1
	A.	Existing Stub Street Connection	H-1
	B.	Street Widening	H-1
	C.	Cutting of Existing Streets	H-1
3-3		Construction Staking	H-1
3-4		Installation	
	A.	SubGrade	H-1
		1. SubGrade for Sidewalk, Driveway and Ramps	H-1
		2. SubGrade for Asphalt Concrete	H-2
	B.	Aggregate Base and Subbase	H-2
	C.	Concrete	H-2
		1. Thickness	H-2
		2. Finishing	H-3
		3. Expansion Joints	H-3
		4. Grades	H-3
		5. Monolithic Sidewalk, Curb, and Gutter	H-4
		6. Curb and Gutter Installation	H-4
		7. Epoxy Work	H-4
		8. No Sidewalk at Back of Retaining Curb	H-4
	D.	Asphalt Concrete	H-4
	E.	Sound and Retaining Wall	H-4

	F.	Survey Monuments	H-5
	G.	Street Barricades	H-5
3-5	Materials		
	A.	Aggregate Base and Subbase	H-5
	B.	Asphalt Concrete	H-5
	C.	Concrete	H-5
	D.	Concrete Additives	H-5
	E.	Lime/Fly Ash	H-5
	E.	Truncated Domes	H-5

STREETS DETAILS

<i>Street Section Improvements by Residential Zoning</i>	<i>H-0</i>
<i>Cross Gutter</i>	<i>H-1</i>
<i>Curbs & Gutters</i>	<i>H-2</i>
<i>Commercial Driveways Type A-6</i>	<i>H-3</i>
<i>Commercial Frontage Entrance</i>	<i>H-4</i>
<i>Sidewalk Ramps for Type 2 Curb</i>	<i>H-5</i>
<i>Detectable Warning (Truncated Dome Panel)</i>	<i>H-6</i>
<i>Paved Swale</i>	<i>H-7</i>
<i>Asphalt Concrete Dike/Berm</i>	<i>H-8</i>
<i>Paved Median Island</i>	<i>H-9</i>
<i>Planter and Barrier Curb Details</i>	<i>H-10</i>
<i>Under Sidewalk Drain</i>	<i>H-11</i>
<i>Street Closure Timber Barricade</i>	<i>H-12</i>
<i>Sign and Barricades at end of Pavement Widening</i>	<i>H-13</i>
<i>Sidewalk Barricade</i>	<i>H-14</i>
<i>Roadway Connections (Sheet 1)</i>	<i>H-15</i>
<i>Roadway Connections (Sheet 2)</i>	<i>H-16</i>
<i>Street Classess A, B & C</i>	<i>H-17</i>
<i>Residential, Collector, Industrial & Commercial</i>	<i>H-18</i>
<i>Arterial & Frontage Road</i>	<i>H-19</i>
<i>Street Sign Name</i>	<i>H-20</i>
<i>Street Name Sign Installation on Street Light Pole</i>	<i>H-21</i>
<i>Street Sign Assembly</i>	<i>H-22</i>
<i>Street Name Sign Placement Details</i>	<i>H-23</i>
<i>Street Name Sign Placement on on Street Light</i>	<i>H-24</i>
<i>Cul-de-Sac Details</i>	<i>H-25</i>
<i>Offset Cul-de-Sac Bulb</i>	<i>H-26</i>
<i>90 Degree Intersection Elbow</i>	<i>H-27</i>
<i>Hammer-Head Design</i>	<i>H-28</i>
<i>Access Road Hammerhead for Utility Trucks</i>	<i>H-29</i>
<i>Access Road Hammerhead for Utility Trucks (Orientation 2)</i>	<i>H-30</i>
<i>Geometrics & Profiles at Road Intersections</i>	<i>H-31</i>
<i>Commercial Frontage and Driveway Regulations</i>	<i>H-32</i>

<i>Bus Turnout Details</i>	<i>H-33</i>
<i>Buss Stop</i>	<i>H-34</i>
<i>Widening Details at Major Street Intersections</i>	<i>H-35</i>
<i>Sight Distance Requirements for 84' Streets</i>	<i>H-36</i>
<i>Sight Distance Requirements for 94' Streets</i>	<i>H-37</i>
<i>Alley Details and Driveway Transitions</i>	<i>H-38</i>
<i>Visibility Requirements – Residential Streets</i>	<i>H-39</i>
<i>Boxed Survey Monument</i>	<i>H-40</i>
<i>Transverse Trench Resurfacing Section</i>	<i>H-41</i>
<i>Longitudinal Trench Resurfacing Sections (Sheet 1)</i>	<i>H-42</i>
<i>Longitudinal Trench Resurfacing Sections (Sheet 2)</i>	<i>H-42A</i>
<i>Utility Trench Paving Backfill and Embedment</i>	<i>H-43</i>
<i>Conduit for Future Town Use</i>	<i>H-44</i>
<i>Project Sign (Sheet 1)</i>	<i>H-45</i>
<i>Project Sign (Sheet 2)</i>	<i>H-45A</i>

SECTION 4 DOMESTIC WATER SUPPLY SYSTEM (W)

4-1	Introduction	W-1
4-2	Water Supply Quality	W-1
4-3	Required Fire Flows	W-1
4-4	Trench Paving	W-1

SECTION 5 SANITARY SEWER SYSTEM (SS)

5-1	General	SS-1
5-2	Trench Paving	SS-1

SECTION 6 DRAINAGE (SD)

6-1	General	SD-1
6-2	Construction Staking	SD-1
6-3	Channel Lining Installation	SD-1
	A. Surface Preparation	SD-1
	B. Reinforcement	SD-1
	C. Joints	SD-1
	1. Construction Joints	SD-1
	2. Expansion Joints	SD-1
	3. Contraction Joints	SD-2
	D. Weep Holes	SD-2

	E. Cutoff Walls	SD-2
	F. Finishing	SD-2
	G. Curing	SD-2
6-4	Drop Inlet Installation	SD-3
6-5	Manhole Installation	SD-3
	A. Bases	SD-3
	1. Precast	SD-3
	2. Cast-in-Place	SD-3
	B. Cones	SD-3
	C. Joints	SD-3
	1. Mortar Application	SD-4
	2. Plastic Sealing Compound Application	SD-4
	D. Connections	SD-4
	E. Grade Rings	SD-4
	F. Frames and Covers	SD-4
	G. Adjusting Existing Manhole Frames	SD-4
	H. Compaction	SD-4
6-6	Pipe Installation	SD-4
	A. Excavation	SD-4
	B. Trench Width	SD-5
	C. Pipe Bedding	SD-5
	D. Laying Pipe	SD-5
	1. Laying and Backfill of Polyvinyl Chloride and High Density Polyethylene Pipe (HDPE)	
	E. Pipe Laying Tolerances	SD-5
	F. Trench Backfill	SD-5
	G. Cast-in-Place	SD-6
	H. Pavement Cutting and Repaving	SD-6
6-7	Materials	SD-6
6-8	Hydrology	SD-8

DRAINAGE DETAILS

	<i>Utility Stream Crossing Detail</i>	<i>SD-1</i>
	<i>Pipe Connections Detail</i>	<i>SD-2</i>
	<i>Drop Inlet Frame and Gate Type "B", "C", Drop Inlets</i>	<i>SD-3</i>
	<i>Drop Inlet Type "B"</i>	<i>SD-4</i>
	<i>Drop Inlet Type "C"</i>	<i>SD-5</i>
	<i>Drop Inlet Gate for Type "D" & "E" Drop Inlet</i>	<i>SD-6</i>
	<i>Drop Inlet Type "D"</i>	<i>SD-7</i>
	<i>Drop Inlet Type "E"</i>	<i>SD-8</i>
	<i>Drop Inlet Type "F"</i>	<i>SD-9</i>
	<i>Drop Inlet Type "G"</i>	<i>SD-10</i>
	<i>Pipe Outfall-Access Control Rack</i>	<i>SD-11</i>
	<i>Pipe Inlet Structure and Trash Rack (30" Pipe & Smaller)</i>	<i>SD-12</i>
	<i>Pipe Inlet Structure</i>	<i>SD-13</i>
	<i>Trash Rack (33" & Larger)</i>	<i>SD-14</i>
	<i>Erosion Control Pipe Discharge</i>	<i>SD-15</i>
	<i>Erosion Control – Ditch Discharge</i>	<i>SD-16</i>

<i>Culvert Outfall</i>	<i>SD-17</i>
<i>Lined Channel Section</i>	<i>SD-18</i>
<i>Rock Lined Channel Section</i>	<i>SD-19</i>
<i>Access Ramp Detail</i>	<i>SD-20</i>
<i>Gate Type Manhole Cover</i>	<i>SD-21</i>
<i>Standard 24" Manhole Frame & Cover</i>	<i>SD-22</i>
<i>Standard Precast Storm Manhole</i>	<i>SD-23</i>
<i>Type "A" & "B" Saddle Manhole</i>	<i>SD-24</i>
<i>24" Storm Manhole</i>	<i>SD-25</i>
<i>Pipe Cover Requirements – CP, RCP, ACP, VCP & Cast-in-Place</i>	<i>SD-26</i>
<i>Pipe Cover Requirement – CSP & CAP</i>	<i>SD-27</i>
<i>Pipe Bedding & Initial Backfill</i>	<i>SD-28</i>
<i>No Dumping Public Notice Detail</i>	<i>SD-29</i>
<i>Stream Gauging Station</i>	<i>SD-30</i>

SECTION 7 GRADING (G)

7-1	General	G-1
7-2	Construction Staking	G-1
	A. Channels	G-1
	B. Erosion Control Measures	G-1
	C. Pads	G-1
	D. Retaining Walls	G-1
	E. Roadways	G-1
7-3	Installation	
	A. Channels	G-1
	B. Erosion Control Measures	G-2
	1. Broadcast Seed	G-2
	2. Drainage Areas	G-2
	3. Dust/Mud Control	G-2
	4. Inlet Filters	G-3
	5. Silt Fence	G-3
	6. Slopes	G-3
	7. Straw Bales	G-3
	C. Pads	G-3
	D. Retaining Walls	G-3
	1. Concrete/Masonry Walls	G-3
	2. Wood Retaining Walls	G-3
	E. Roadways	G-4
	1. Compaction	G-4
	2. Grade Control	G-4
	3. Stability Testing	G-4
	4. Unsuitable Materials	G-4

7-4	Materials	
	A.	Retaining Walls G-4
	B.	Tree Fencing G-4
7-5	Dust Control	G-5
	A.	Purpose G-5
	B.	Applicability G-5
	C.	Exemptions G-5
	D.	Definitions G-6
	E.	Standards G-9
	F.	Administrative Requirements G-10

GRADING DETAILS

	<i>Interior Property Line Retaining Wall</i>	G-1
	<i>Wood Retaining Wall</i>	G-2
	<i>Exterior Perimeter Property Line Grading and Walls</i>	G-3
	<i>Exterior Perimeter Property Line Grading</i>	G-3A
	<i>Masonry or Concrete Retaining Wall</i>	G-4
	<i>Masonry or Concrete Retaining Wall</i>	G-4A
	<i>Terrace Drainage for Cut and Fills</i>	G-5
	<i>Property Line Grading Interior</i>	G-6
	<i>Building and Slope Setbacks</i>	G-7
	<i>Class 1 Residential Grading and Drainage</i>	G-8
	<i>Class 2 & 3 Residential Grading & Drainage</i>	G-9

SECTION 8 LANDSCAPING & IRRIGATION (LS)

8-1	General	LS-1
8-2	Preservation of Property	LS-1
8-3	Personnel	LS-1
8-4	Weather	LS-1
8-5	Irrigation Installation	
	A.	Backfilling LS-1
	B.	Control Wiring LS-1
	C.	Irrigation Controller LS-2
	D.	PVC/Brass Pipe LS-2
	E.	Sprinkler Heads LS-3
	F.	Trenching LS-3
	G.	Valves LS-4
	H.	Valve Boxes LS-4
	I.	Water Service and Meter LS-4
8-6	Planting Installation	
	A.	Soil Preparation and Fine Grading LS-4
	B.	Tree, Shrub and Ground Cover Planting LS-5
	C.	Hydromulch Seeding LS-6
	D.	Seeding LS-6

	E. Sod Planting	LS-7
8-7	Irrigation Materials	
	A. Backflow Prevention Device	LS-7
	B. Electrical	LS-7
	C. Irrigation Controller	LS-8
	D. Pipes and Fittings	LS-9
	E. PVC Pipe Cement	LS-10
	F. Sprinkler Heads	LS-10
	G. Sprinkler Risers	LS-10
	H. Valves and Valve Boxes	LS-10
8-8	Planting Materials	
	A. Backfill	LS-11
	B. Fertilizer	LS-11
	C. Herbicide	LS-11
	D. Hydromulch Seed	LS-11
	E. Imported Topsoil	LS-12
	F. Mulch	LS-12
	G. Plant Stock and Ground Cover	LS-12
	H. Seed	LS-13
	I. Soil Amendment	LS-14
	J. Tree Stakes and Ties	LS-14
8-9	Irrigation Testing	LS-14
8-10	Maintenance Period	LS-15
8-11	Cleaning Up	LS-16
8-12	Final Inspection and Acceptance	LS-16
8-13	Guarantee	LS-17

LANDSCAPING DETAILS

<i>Tree Planting</i>	<i>LSC-1</i>
<i>Tree Planting on Slope</i>	<i>LSC-2</i>
<i>Groundcover Planting</i>	<i>LSC-3</i>
<i>Shrub Planting Detail</i>	<i>LSC-4</i>
<i>Shrub Planting on Slope</i>	<i>LSC-5</i>
<i>Pipe Trenching Detail</i>	<i>LSC-6</i>
<i>Pipe Trenching Under Pavement</i>	<i>LSC-7</i>
<i>Thrust Block Detail</i>	<i>LSC-8</i>
<i>Above Grade Emitters</i>	<i>LSC-9</i>
<i>Pop-Up Spray Head</i>	<i>LSC-10</i>
<i>Gate Valve--3" & Smaller</i>	<i>LSC-11</i>
<i>Quick Coupling Valve</i>	<i>LSC-12</i>
<i>Tree Bubbler</i>	<i>LSC-13</i>
<i>Electric Control Valve and Gate Valve</i>	<i>LSC-14</i>
<i>Below Grade Electric Control and Gate Valve</i>	<i>LSC-15</i>
<i>Flow Sensor Detail</i>	<i>LSC-16</i>
<i>Concrete Walk</i>	<i>LSC-17</i>
<i>Asphaltic Concrete Walk</i>	<i>LSC-18</i>
<i>Asphaltic Concrete Bikepath</i>	<i>LSC-19</i>
<i>Exposed Aggregate Paving</i>	<i>LSC-20</i>

<i>Decomposed Granite</i>	<i>LSC-21</i>
<i>Collapsible Bollard</i>	<i>LSC-22</i>
<i>Bike Path Striping/Bollard Installation</i>	<i>LSC-23</i>
<i>Pressure Treated Redwood Headerboard</i>	<i>LSC-24</i>
<i>Post & Cable</i>	<i>LSC-25</i>
<i>Redwood Fence</i>	<i>LSC-26</i>
<i>Chain Link Fence (Detail 1)</i>	<i>LSC-27</i>
<i>Chain Link Fence (Detail 2)</i>	<i>LSC-27A</i>

**SECTION 9
STREET LIGHTS & SIGNALS
SIGNS, STRIPING, AND MARKINGS (SL)**

9-1	General	SL-1
9-2	Street Lights Required	SL-1
9-3	Developer's Responsibility	SL-1
9-4	Utility Company Authorization	SL-1
9-5	General Plan Details	SL-1
9-6	Design Standards	SL-1
9-7	Street Light Design Details	SL-1
	A. Intersection	SL-1
	B. Cul-de-sacs	SL-2
	C. Pedestrian Lanes	SL-2
	D. Spacing	SL-2
	E. Street Light Poles	SL-2
	F. Street Lights on Existing Utility Owned Poles	SL-2
	G. Luminaries	SL-3
	H. Service	SL-3
	I. Pullboxes	SL-3
	J. Conductors	SL-3
	K. Photo Cell	SL-4
	L. Conduit	SL-4
	M. Electrical Equipment and Work	SL-4
	N. Foundations	SL-4
	O. Lighting Poles	SL-4
	P. Luminaries	SL-5
	Q. Lamps	SL-6
	R. Ballasts	SL-6
	S. Wiring	SL-7
	T. Fuses	SL-7
	U. Photoelectric Unit	SL-7
	V. Service	SL-7
	W. Painting	SL-8
	X. Cleanup	SL-9
	Y. Acceptance Test	SL-9

9-8	Master Planning		SL-9
		SIGNS	
9-9	General		SL-10
		OVERHEAD SIGN STRUCTURES	
9-10	Material		SL-11
9-11	Sign Panels & Fastening Hardware		SL-11
		ROADSIDE SIGNS	
9-12	Material		SL-12
9-13	Metal Pole		SL-12
9-14	Sign Panel Fastening Hardware		SL-13
9-15	Sign Panel Installation		SL-13
		MARKERS AND DELINEATORS	
9-16	Description		SL-13
9-17	Reflectors		SL-13
		TRAFFIC STRIPES AND PAVEMENT MARKINGS	
9-18	Description		SL-13
9-19	Tolerances & Appearances		SL-14
		THERMOPLASTIC TRAFFIC STRIPES	
9-20	Material		SL-15
9-21	Application		SL-15
		PAVEMENT MARKERS	
9-22	Description		SL-15
9-23	Non-Reflective Pavement Markers		SL-15
9-24	Placement		SL-15
		SIGNALS, LIGHTING AND ELECTRICAL SYSTEMS	
9-25	General		SL-16
9-26	Equipment List and Drawings		SL-16
9-27	Maintaining Existing & Temporary Electrical System		SL-16
9-28	Foundations		SL-16
9-29	Standard, Steel, Pedestal and Post		SL-16
9-30	Conduit Material		SL-17
9-31	Conduit Use		SL-17
9-32	Conduit Installation		SL-17
9-33	Pull Boxes		SL-17
9-34	Cover Marking		SL-18
9-35	Conductors		SL-18
9-36	Conductor Identification		SL-18

9-37	Multiple Circuit	SL-18
9-38	Signal Interconnect Cable	SL-18
9-39	Wiring	SL-19
9-40	Wiring Installation	SL-19
9-41	Connectors and Terminals	SL-19
9-42	Splicing	SL-19
9-43	Splice Insulation	SL-19
9-44	Fused Splice Connectors	SL-19
9-45	Bonding and Grounding	SL-19
9-46	Service	SL-19
9-47	Testing	SL-20
9-48	Ground	SL-20
9-49	Functional Testing	SL-20
9-50	Controller Cabinet Assembly	SL-20
9-51	Emergency Vehicle Preemption Equipment	SL-21
9-52	Vehicle Signal Faces	SL-21
9-53	Signal Sections	SL-21
9-54	Light Emitting Diode Signal and Pedestrian Module	SL-21
9-55	Backplates	SL-21
9-56	Programmed Visibility Vehicle Visibility Signal Faces (PVDISPLAY)	SL-21
9-57	Front Screen	SL-21
9-58	Pedestrian Signal Faces	SL-21
9-59	Signal Mounting Assemblies	SL-21
9-60	Vehicle Detectors Construction Materials	SL-22
9-61	Vehicle Detectors Installation Details	SL-22
9-62	Detector Loop Circuitry	SL-24
9-63	Pedestrian Push Button Assemblies	SL-24
9-64	High Pressure Sodium Luminaries	SL-24
9-65	Photoelectric Controls	SL-24
9-66	Wiring	SL-24
9-67	Remove Electrical Equipment	SL-24

STREET LIGHTING STANDARD DETAILS

<i>Intersection Lighting</i>	<i>SL-1</i>
<i>Street Light Locations at Major Arterials and Major Industrial</i>	<i>SL-2</i>
<i>Typical Service & Wiring Schedule</i>	<i>TS-1</i>
<i>Typical Pole and Equipment Schedule</i>	<i>TS-2</i>
<i>Typical Conductor Schedule</i>	<i>TS-3</i>
<i>Typical Controller/Service Cabinet Pad Detail</i>	<i>TS-4</i>
<i>Typical Loop Detector Layout</i>	<i>TS-5</i>

ABBREVIATIONS

The following abbreviations are used within these Construction Specifications:

AASHO:	American Association of State Highway and Transportation Officials
AB:	Aggregate Base
ABS:	Acrylonitrile-Butadiene-Styrene
AC:	Asphalt Concrete and Alternating Current
ASB:	Aggregate Subbase
ANSI:	American National Standards Institute
ARV:	Air Release Valve
ASTM:	American Society for Testing and Materials
AWG:	American Wire Gauge
AWWA:	American Water Works Association
BCR:	Beginning of Curb Return
BO:	Blow Off
C & G:	Curb and Gutter
C-C:	Center to Center
C.F.:	Cubic Foot
CIP:	Cast-in-place
C/L:	Centerline
C.M.P.:	Corrugated Metal Pipe
Const.	Construction
CST:	Construction
Ctrs:	Centers
Cu. Ft.:	Cubic Feet
DET:	Detail
Dia.:	Diameter
DIP:	Ductile Iron Pipe
DLC:	Detector Lead-in Cable
DR:	Drainage
Dwg:	Drawing
EVA:	Emergency Vehicle Access
Fdn.:	Foundation
FL:	Flowline
Ga.:	Gauge
Gal.:	Gallon
Galv.:	Galvanized
GR:	Grading

Horz.:	Horizontal
Hz:	Hertz
IBOC:	Internal Battery Operated Clock
ID:	Inside Diameter
LED:	Lighted Electronic Display
LS:	Landscaping
LMA:	Luminare Mast Arm
MAS:	Mast-Arm Side mount
MAT:	Mast -Arm Top mount
Max.:	Maximum
Mil.:	Millimeter
Min.:	Minimum
M.P.:	Metal Plate
No.:	Number
O.C.:	On Center
OD:	Outside Diameter
OSHA:	Occupational Safety & Health Act
P.C.C.:	Portland Cement Concrete
PEU:	Photoelectric Unit
P.O.C.:	Point of Connection
PPB:	Pedestrian Push Button
ppm	parts per million
psi:	pounds per square inch
PVC:	Polyvinyl Chloride
PWD:	Public Works Director/Department
RCP:	Reinforced Concrete Pipe
RCV:	Remote Control Valve
Rwd.:	Redwood
R.P.:	Radius Point
R/W:	Right-of-Way
Sch.:	Schedule
SDMH:	Storm Drain Manhole
SMA:	Signal Mast Arm
SS:	Sanitary Sewer System
SSMH:	Sanitary Sewer Manhole
ST:	Street
STD:	Standard

TS: Traffic Signals and Markings
Typ.: Typical

UBC: Uniform Building Code
UL: Underwriters' Laboratory, Inc.
U.S.A.: Underground Service Alert

VA: Volts ampere
Var.: Variable
VCP: Vitriified Clay Pipe Bell and Spigot
Vert.: Vertical

WWF: Welded Wire Fabric
WWM: Welded Wire Mesh

All references to specifications, standards or other publications refer to the current issue.

SECTION 1

PURPOSE AND DEFINITIONS (PD)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 1

PURPOSE AND DEFINITIONS

1-1 PURPOSE - The purpose of these Construction Standards is to provide minimum standards to be applied to improvements which are to be dedicated to the public and accepted by the Town for maintenance or operation and certain private works, as well as improvements to be installed within existing rights-of-way and easements. This is necessary in order to provide for coordinated development of required facilities to be used by and for the protection of the public. These Standards shall apply to, regulate, and guide preparation of traffic impact studies and the design and preparation of plans for construction of streets, alleys, drainage, traffic signals, site access, and related public improvements, and shall set guidelines for all private works which involve drainage, grading, and related improvements.

1-2 DESIGN PRACTICE - Because it is virtually impossible to anticipate all situations that may arise or to prescribe standards applicable to every situation, any items or situations not included in these Construction Standards shall be designed in accordance with accepted engineering practice, the Town of Loomis Construction Standards, the State of California "Highway Design Manual" and "Traffic Manual", and as specified by the Town Engineer.

The Town Engineer may require additional standards and/or regulations not inconsistent herewith when deemed necessary to protect the health, safety, and welfare of the public.

1-3 DEFINITIONS - Whenever the following terms or titles are used in these standards, or in any document or instrument where these standards govern, the intent and meaning shall be as herein defined:

- A. **Applicant** - shall mean the same as the Developer or his consulting engineer working on his behalf.
- B. **Building Division** - Shall mean the Building Division of the Town of Loomis.
- C. **City/Town** - Shall mean the Town of Loomis and it's applicable Departments.
- D. **Town Engineer** - Shall mean the Town Engineer/Director of Public Works of the Town of Loomis acting either directly or through the staff of the appropriate Divisions of the Department of Public Works or their authorized representatives.
- E. **Consulting Engineer** - Shall mean any person or persons, firm, partnerships or corporation legally authorized to practice civil, mechanical, or electrical engineering in the State of California who prepares or submits improvement plans and specifications to the Department of Public Works of the Town of Loomis for approval.
- F. **Contractor** - Shall mean any person or persons, firm, partnership, corporation, or combination thereof, licensed to perform the type of work involved, who has entered into a contract with any person, corporation or company, or his or their legal representatives, for the construction of any improvement or portions of any improvement within the Town of Loomis.

- G. **Department of Public Works** - Shall mean the Department of Public Works of the Town of Loomis.
- H. **Developer** - Shall mean any persons, firm, partnership, corporation, or combination thereof, financially responsible for the work involved.
- I. **Development** - Shall mean the act or process of any construction on properties as well as subdivision improvement.
- J. **Engineering Division** - Shall mean the Engineering Division of the Town of Loomis.
- K. **Improvements** - Refers to street work, sidewalk, curb, gutter, driveways, water mains, sanitary sewer, storm drainage, street lighting, traffic signals, public utilities, landscaping, irrigation, parks, fences and other facilities to be constructed or installed by the developer within an existing or future public right of way or easement and other improvements which the Department of Public Works is responsible for performing plancheck or inspection.
- L. **Laboratory** - Shall mean any testing agency or testing firm which has been approved by the Department of Public Works.
- M. **Manual of Traffic Controls** - Shall mean the "Manual of Traffic Controls for Construction and Maintenance Work Zones," of the State of California, Department of Transportation, latest edition.
- N. **Soils Report** - Shall mean a report as prepared by any person or persons, firm, partnership, or corporation legally licensed to prepare "Soils Reports" in the State of California.
- O. **Construction Standards** - Shall mean the latest edition of the "Standard Construction Specifications" adopted by the Town of Loomis Town Council and any amendments thereto governing the construction of roads, streets, storm drainage, concrete structures, traffic signals, street lighting and other facilities within the Town of Loomis.
- P. **Standard Drawings** - Shall mean the standard drawings as set forth in the Improvement Standards and included herein, approved by the Town Engineer and as amended.
- Q. **State** - As used in State Specifications, shall mean the Town of Loomis.
- R. **State Highway Design Manual** - Shall mean the "Highway Design Manual" of the State of California, Department of Transportation, latest edition.
- S. **State Standard Plans** - Shall mean the Standard Plans of the State of California, Department of Transportation, latest edition.
- T. **State Standard Specifications** - Shall mean the "Standard Specifications" of the State of California, Department of Transportation, latest edition.
- U. **State Traffic Manual** - Shall mean the "Traffic Manual" of the State of California,

Department of Transportation, latest edition.

- V. **Subdivision Ordinance** - Shall mean the "Subdivision Ordinance" of the Town Code as adopted by the Town Council of the Town of Loomis.
- W. **Zoning Ordinance** - Shall mean the "Zoning Ordinance" of the Town Code as adopted by the Town Council of the Town of Loomis.

SECTION 2

CONTRACTOR'S AND DEVELOPER'S RESPONSIBILITIES (CD)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 2

CONTRACTOR'S AND DEVELOPER'S RESPONSIBILITIES

2-1 GENERAL -- All improvements within the Town of Loomis's right-of-way shall be installed in accordance with the approved improvement plans and specifications, the Town of Loomis Improvement Standards, and the State of California Department of Transportation Standard Specifications, hereinafter referred to as the Caltrans Standard Specifications. The Contractor shall follow all applicable Town, County, State and Federal laws and regulations relating to construction of the improvements.

2-2 CONTRACTOR'S RESPONSIBILITY-- It shall be the Contractor's responsibility for:

- A. Plans** -- Perform construction per plans signed and approved by all required Town of Loomis Departments. Any additions, deletions or changes to the approved plans shall be submitted to said departments for review and approval prior to construction. All plans must include all information as noted as per standard.
- B. Notification** -- The Contractor shall schedule a preconstruction meeting with the Public Works Department (PWD) and any other departments reviewing and inspecting the improvements. The meeting shall take place a minimum of 48 hours prior to the start of construction, without exception.
- C. U.S.A. Markings** -- White paint shall be used to indicate areas to be marked by Underground Service Alert (U.S.A.). Any areas not marked shall not be included in the U.S.A. and the Contractor shall not excavate in these areas. The Contractor will be responsible for any damage resulting from excavation in unmarked areas. The Contractor, or Applicant who requested the USA markings shall be responsible for the removal of the USA markings upon completion of the work, at the discretion of the Town Engineer.
- D. Testing** -- Constructed utilities shall be tested in accordance with these Improvement Standards.
- E. Cultural Resources** -- The Contractor shall stop construction if cultural resources are discovered during excavation operations. It is possible that previous activities have obscured surface evidence of cultural resources. If signs of an archeological site, such as any unusual amounts of stone, bone or shell are uncovered during grading or other construction activities, work shall be halted within 100 feet of the find and the Town Planning Department shall be notified immediately. A qualified archaeologist shall be consulted for an on-site evaluation. Additional mitigation may be required by the archaeologist.

F. Hazardous Materials -- Should construction operations uncover hazardous materials, or materials which the Contractor believes may be hazardous waste that is required to be removed to a Class I, Class II or Class III disposal site in accordance with provisions of existing law, the responsible Fire District, (Loomis, Penryn or South Placer) shall be contacted immediately. The area which contains the hazardous materials shall be marked off until an investigation by a member of the Fire District is conducted.

G. Working Hours -- In accordance with the Town of Loomis's noise ordinance, the hours of project construction shall be limited to the following:

7:00 AM to 7:00 PM	Monday through Friday
8:00 AM to 7:00 PM	Saturday
No Work	Sunday and Holidays

There may be additional limitations placed on working hours specified in the project's approved plans, conditions of approval, special provisions, or encroachment permit.

The inspection fee charged by the Town of Loomis is projected to cover all costs incurred by the Department of Public Works for construction inspection. Once the fees are exhausted, the Town of Loomis shall charge for remaining construction inspections on a time and material basis.

Any deviation to the above working hours requires approval of the Town Engineer and Planning Department.

H. Traffic Control -- A traffic control plan shall be submitted whenever required by the Town Engineer. Traffic control plans shall not be required, when in the opinion of the Town Engineer, the situation is adequately covered by the State of California Standard Plans, or State of California Manual of Traffic Controls for Construction and Maintenance Work Zones (latest edition), or the Work Area Traffic Control Handbook (WATCH Manual). For situations detailed in different manuals, the Standard Plans, then the Manual of Traffic Controls for Construction and Maintenance Work Zones shall take precedence. In addition to the manuals, the following measures shall apply:

I. Start of Construction -- Construction within Town rights-of-ways shall not start until all equipment required on the traffic control plan, the Caltrans Traffic Control Manual or the WATCH Manual, have been erected, all required permits from other agencies have been obtained and the Contractor has obtained acceptance from the Town Engineer. Parties not obtaining prior acceptance shall be subject to a stop-work order from the Town. The approved traffic control plans shall take precedence over the Standard Plans unless otherwise directed by the Engineer.

2. **Lane Changes and Closures** -- Lanes shall be closed using metal sign stands (each including all three flags), delineators or cones, or barricades, as indicated in the Caltrans Traffic Control Manual, WATCH Manual, or on the approved traffic control plan.

A lighted arrow board may be employed as an additional lane change measure. Barricades placed in the excavation section adjacent to a traffic lane shall be placed at a maximum of 50 feet intervals. Warning signs attached to a barricade are not acceptable.

Lane closures are permitted from 8:30 AM to 4:00 PM unless otherwise noted on the approved traffic plan, or as directed by the Town Engineer. No road shall be closed unless approved by the Town Engineer.

3. **Flag persons** - Flag persons shall be equipped as required in the governing manual with bright colored or fluorescent vests or clothing, flags and/or stop/slow paddles and other equipment as needed. During darkness, clothing shall be reflectorized and shall be visible for one thousand feet and the flag person shall be equipped with a flashlight with an orange cone.
 4. **Adjacent Roadway Excavation** -- Where excavation adjacent to an existing roadway results in an elevation difference of greater than 0.16 foot, the excavated area shall be filled with compacted aggregate base (3/4 inch minus), flush with the adjacent roadway at a slope not to exceed 4:1 (horizontal to vertical) prior to the end of each workday. Native fill may be used with the approval of the Town Engineer.
 5. **Steel Plates** -- Steel plates shall not be used over open trench areas without the approval of the Town Engineer. All steel plates shall be adequately pinned to eliminate shifting. All excavations covered by steel plates shall be shored. No steel plates shall be used on roads with vehicle speeds over 30 mph. Temporary pavement (cut-back) shall be used for a transition on each edge of the plate. A ("Rough Road") or ("Bump") sign shall be installed 200 feet ahead of the steel plate. The sign may be mounted to an operable, lighted barricade for a maximum of 24 hours. The sign shall be mounted to a 4"x4" post for a period exceeding 24 hours.
 6. **Sidewalk Removal** -- Lighted barricades with construction ribbon are required where construction requires the removal of sidewalk or curb and gutter. Wooden lathe with flagging or cones shall not be allowed. Signs indicating "Sidewalk Closed" shall be installed at the ends of construction areas, where required by the Town Engineer.
- I. **Preservation of Property** -- The Contractor shall take extreme care to protect existing site and adjacent improvements from damage. The Contractor shall be responsible for any damage resulting from the construction and shall repair or make replacement at their own expense.

- J. **Personnel** -- Only personnel licensed in the particular trade undertaken shall be employed for the construction work.
- K. **Weather** -- Construction work shall not commence or progress when the weather jeopardizes a safe working environment or the quality of the project in any manner.
- L. **Trenching** -- Prior to excavation of trenches 5 feet or deeper, the Contractor shall submit the following to the Town Engineer:
 - 1. A copy of the company's annual CAL OSHA trenching permit.
 - 2. A copy of the company's letter informing CAL OSHA of the time the trenching is commencing and the location of the work.
- M. **Trailer and Material Storage** -- Dumpsters, construction materials or equipment shall not be placed in the Town of Loomis right-of-way without first obtaining an Encroachment Permit from the PWD. Use of the Town right of way should not be requested if there is adequate storage space on-site. Construction offices or material trailers shall not be placed within the Town right-of-way.
- N. **Street Cleaning** -- Where dirt or mud are tracked onto public street pavement, the Contractor shall clean the streets daily, or as directed by the Town Engineer. If the Contractor fails to keep the streets clean, the Town may clean the areas and bill the appropriate company.
- O. **Interruption of Parking Areas** -- Where parking needs to be interrupted by construction work, the Contractor shall place Type II barricades with "No Parking" notices behind the curb, adjacent to the respective parking area, a minimum of 24 hours prior to the start of construction. Information on the notice shall include the date and times that parking is prohibited and shall be legible from a distance of 25 feet. Barricades/notices shall be placed at a minimum interval of one per parking space.
- P. **Contractor Employee Vehicle Parking** -- The Contractor's employee parking shall be limited to designated areas on-site, and shall not encroach into designated wetland areas, tree protected zones or any other areas protected by jurisdictional boundaries, Conditions of Approval or Town ordinances.
- Q. **Construction Safety** -- Construction safety within the Town of Loomis shall be governed by the Construction Safety Orders of the Occupational Safety and Health Standards of Title 8 of the California Code of Regulations.
- R. **Blasting and Explosive Requirements** -- The Contractor shall have a valid California State Blasting License issued from the State of California Department of Industrial Relations, Occupational Safety and Health Administration, and a Town of Loomis Business License. Additionally, the Contractor shall obtain a Placer

County "Explosives Application/Permit" prior to any and all blasting within the limits of the Town of Loomis. The Contractor shall have on file, and keep current, the required insurance documents established by the Permit.

The Contractor shall notify the following Town Departments 24 hours in advance of blasting:

Sheriffs Department:	(916) 652-2400
Public Information Office: (Town Clerk)	(916) 652-1840
Public Works Dept.:	(916) 652-1840

2-3 DEVELOPER'S RESPONSIBILITY-- It shall be the Developer's responsibility for:

A. Improvement Plan Submittal -- The initial submittal of improvement plans to the Department of Public Works shall consist of the following:

1. 3 sets of plans, complete and in accordance with these Improvement Standards, along with any required specifications, computation, test data, and other material requested by the Town Engineer.
2. Two copies of the watershed map and drainage calculations in accordance with Town requirements.
3. An itemized cost estimate for all improvements. The improvements to be included on the estimate are as follows:
 - a. All public facilities. (Public facilities include all improvements within the street right-of-way and public improvements outside of the right-of-way which are to be maintained by the Town.)
 - b. All on-site underground storm drainage systems.
 - c. All on-site/off-site underground utilities.
 - d. Earth excavation quantities.
 - e. Retaining and sound walls.
4. The plan check and inspection fee in accordance with the latest fee schedule adopted by the Town Council.
5. The name, address, and telephone number of the developer.
6. Utility letters in accordance with Section 5.

Should there be required alterations or revisions to the plans as submitted, the Town Engineer will return one copy with the corrections marked or indicated thereon. If the plans submitted are not prepared in accordance with these

Improvement Standards or are not in keeping with the standards of the profession, the Town Engineer may return them deeming them incomplete and no further action will be done until the required information is submitted.

- B. Plan Check and Inspection Fee** -- When improvement plans are initially submitted to the Town Engineer for checking, the total plan check fee for the development will be required to initiate checking of plans. The fee shall be in accordance with the latest fee schedule as adopted by the Town Council. It should be noted that the Plan Check and Inspection fees are estimates and that the actual cost of Town Services over the amount on deposit will be billed to the Developer/Contractor based on a time and material basis.
- C. Plan Approval** -- No plans will be approved nor construction authorized until such time as the Town Engineer signifies his approval by his signature on the set of plans and not unless such changes, corrections, or additions are resubmitted to the Town Engineer for approval as previously prescribed for the original plans. At such time as the Consulting Engineer preparing the plans has made the necessary revisions and paid the total plan check and inspection fee and any other applicable Town fees, the Town Engineer will sign the mylar title sheet in the space provided, after the Consulting Engineer and all other agencies have signed them. The Town Engineer's approval is valid for a period of twelve months. Should work not commence within the twelve month period, the plans shall be resubmitted for re-approval. A plan check fee may be required to cover the cost of rechecking.
- D. Final Plans Required** -- The Consulting Engineer shall deliver three sets of prints from the approved tracings to the Town Engineer's Office. Copies of the final utility letters shall be included with the approved plans delivered to the Town Engineer.
- E. Improvement Plan Revisions During Construction** -- Should changes become necessary during construction, the Consulting Engineer shall first obtain the consent of the Town Engineer and shall then resubmit the title sheet and the plan sheets affected for approval. The changes on the plans shall be made in the following manner:

 - 1. The original proposal shall not be eradicated from the plans but shall be lined out.
 - 2. In the event that eradicating the original proposal is necessary to maintain clarity of the plans, approval must first be obtained from the Town Engineer.
 - 3. The changes shall be clearly shown on the plans with the changes and approval noted on a revision signature block, conforming to the Standard Details.
 - 4. The changes shall be identified by the revision number in a triangle delineated on the plans adjacent to the change and on the revision signature block.

Minor changes which do not affect the basic design or contract may be made upon the authorization of the Town Engineer but said changes must be shown on "as built" plans when the contract is completed.

- F. **Record Drawings** -- Computer generated CADD drawing (latest version), Mylar Record Drawings, and one set of blue line prints, are to be submitted to PWD within two weeks of completion of the improvements and are required within 90 days of the filing of the Notice of Completion Departmental Approval Form. Certification by Consulting Engineer of finished pad elevations of subdivision lots shall be required prior to final approval of subdivision improvements.

As Built Plans -- The Consulting Engineering shall keep an accurate record of all approved deviations from the plans and shall provide a copy of these records to the Town Engineer in mylar set and digital form upon completion of the work before final approval of the completed subdivision improvements. These are to be utilized with the Inspector's plans for preparing a complete and accurate set of "as built" plans for the permanent records of the Town.

Certification by the Consulting Engineer of the finished pad elevations of subdivision lots shall be required prior to final approval of the subdivision improvements.

- G. **Conflicts, Errors, And Omissions** -- Excepted from approval are any features of the plans that are contrary to, in conflict with, or do not conform to any California State Law, Loomis Town Code or Resolution, conditions of approval, or generally accepted good engineering practice, in keeping with the standards of the profession, even though such errors, omissions, or conflicts may have been overlooked in the Town Engineer's review of the plans.

- H. **Change In Consulting Engineer** -- If the developer elects to have a registered civil engineer or licensed land surveyor other than the engineer who prepared the plans provide the construction staking, he shall provide the Town Engineer in writing the name of the individual or firm one week prior to the staking of the project for construction. The Developer shall then be responsible for providing all professional engineering services which may be required during construction, the preparation of revised plans for construction changes, and the preparation of "as built" plans upon completion of the construction.

In the Developer's notification of a change in the firm providing construction staking, he shall acknowledge that he accepts responsibility for design changes and "as built" information as noted above.

- I. **Existing Utilities** -- All existing utilities are to be shown on the plans. In addition, the Consulting Engineer shall submit prints of the preliminary and approved plans to the utility companies involved. This is necessary for the utilities to properly plan their relocation projects and needed additional facilities. Copies of the transmittal letters to the utility companies shall be provided to the Town Engineer. The transmittal letters shall indicate all utility pole conflicts which require relocation.

The conflict shall be referenced to stationing and distance from centerline. In addition, the following note shall appear on the first page of the plans: No pavement work will occur within the road right-of-way prior to completion of utility pole relocation.

- J. **Partial Plans** -- Where the improvement plans submitted cover only a portion of ultimate development, the plans submitted shall be accompanied by the approved tentative plan or a study plan if there is no approved tentative plan showing topographic features of the ultimate development at an adequate scale to clearly show the proposed improvements.
- K. **Other Agency Notifications** -- The Consulting Engineer is responsible for obtaining the approval and necessary permits of governmental or County agencies when their facilities are involved or their approval is required.
- L. **Inspection Requirements** -- Any improvement constructed to the Town Improvement Standards for which it is intended that the Town will assume maintenance responsibility shall be inspected during construction by the Town Engineer or his authorized representatives. Each phase of construction shall be inspected and approved prior to proceeding to subsequent phases. The Town requires a pre-construction meeting 72 hours prior to start of work. No exceptions.

Private on-site grading and drainage shall be inspected during construction by the Town Engineer or his authorized representatives.

Any improvements constructed without inspection as provided above or constructed contrary to the order or instructions of the Town Engineer will be deemed as not complying with the Town Improvement Standards and will not be accepted by the Town for maintenance purposes.

The Consulting Engineer shall notify the Town Engineer when the Contractor first calls for grades and staking and shall provide the Town Engineer with a copy of all cut sheets.

Within ten days after receiving the request for final inspection, the Town Engineer shall inspect the work. The Contractor, Consulting Engineer, and Developer will be notified in writing as to any particular defects or deficiencies to be remedied. The Contractor shall proceed to correct any such defects or deficiencies at the earliest possible date.

At such time as the work has been completed, a second inspection shall be made by the Town Engineer to determine if the previously mentioned defects have been repaired, altered, and completed in accordance with the plans. At such time as the Town Engineer approves the work and accepts the work for the Town, the Contractor, Consulting Engineer, and Developer will be notified in writing as to the date of final approval and acceptance.

On assessment districts and projects where the Town participates in the costs thereof, quantities will be measured in the presence of the Town Engineer, Consulting Engineer, and Contractor and witnessed accordingly.

M. Special Notices And Permits -- The Consulting Engineer shall be responsible to the Contractor to give the following notices and have in his possession the following permits and plans:

1. Contractor shall be in receipt of Town approved plans prior to construction.
2. Contractor shall notify all utility companies involved in the development prior to beginning of work.
3. Contractor shall notify "Underground Service Alert" 48 hours in advance before any digging.
4. Contractor shall be responsible for the protection of all existing monuments and/or other survey monuments and shall notify Town Engineer of any damaged or removed Town, State, or Bureau monuments.
5. Contractor shall notify the Sewer District, Water Agency, Fire District and any other agency required to approve the project for permit and payment of required fees for sewer taps.
6. The Contractor shall verify all street names with the Town Engineer before ordering street signs.
7. Contractor shall be responsible for conducting his operation entirely outside of any floodplain and wetland boundaries. Floodplain and wetland boundaries shall be clearly delineated by fencing in the field prior to construction.
8. Contractor shall be responsible for conducting his operation entirely outside of any no grading area. These areas shall be clearly delineated by fencing in the field prior to construction.
9. Where work is being done in an off-site easement, the Contractor shall notify the property owner 48 hours prior to commencing work, and provide a right-of-entry approval letter.
10. Where plans call for the retention of oak trees within a project, the Contractor shall be responsible for properly screening and flagging areas around oak trees to prevent damage during construction in accordance with the Loomis Zoning Code requirements for development around oak trees.
11. Where work being done requires the issuance of a permit by a State agency including but not limited to the State Department of Transportation, Department of Fish and Game, etc.

12. Contractor shall notify the water agency for permit and payment of received fees established or included in a pipeline extension agreement for inspection prior to water line work.

N. Plan Sheet Requirements

1. Paper Details -- All improvement plans shall be prepared on plan and profile sheets 22" or 24" x 36", F.A.S. sheets, Plate "A" plan and profile paper, or special consulting engineer's sheets which have been accepted by the Town. Scales: Horizontal 1" = 20', 40', or 50'; Vertical 1" = 2', 4', or 5', but only the scale, horizontal or vertical, for which the sheet was intended shall be used.
2. Drafting Standards -- All plans approved by the Town may be microfilmed. Therefore, certain drafting standards have become necessary to produce legible film and subsequent prints. All line work must be clear, sharp, and heavy. Letters and numerals must be 1/8 inch minimum height, well formed, and sharp. Numerals showing profile elevations shall not be bisected by station grid lines. Dimension lines shall be terminated by sharp solid arrowheads.
3. Title Sheet -- On subdivision or improvement plans exceeding three sheets in a set, a title sheet shall be prepared showing the following:
 - A.* The entire subdivision or parcel and project.
 - B. Assessment district limits (if any).
 - C. Town limits.
 - D. Street names and widths.
 - E. Section lines, grant lines, and corners.
 - F. Adjacent subdivisions, including names, lots lines, and lot numbers.
 - G. Property lines.
 - H. Public easements.
 - I.* Location map.
 - J. Scale of drawings.
 - K.* Index of sheets.
 - L. Legend of symbols.
 - M.* Signature block conforming to Standard Drawing CD-1 and situated at the lower right hand corner of the sheet.
 - N. Separate title sheets shall be received for each phase of work.

Improvement plans consisting of three or less sheets and encroachment plans shall not be required to provide a title sheet but shall be required to show all of the above in the plans.

* Shall be shown on the front sheet of encroachment plans and plans consisting of three or less sheets.

4. Title Block -- Each sheet within the set of drawings shall have an approved title block showing the sheet title, number, date, scale, and the Consulting Engineer's name, signature, and license number.

The preferred location is across the right hand end of the sheets. This will facilitate the common method of plan storage by allowing the plan information to be viewed with the plans rolled up.

5. Drainage, Sewer, Water, And Grading Layout -- On all plans, the storm drainage, sanitary sewer, and domestic water systems shall be shown on an overall plan layout. In addition, the storm drainage and sanitary sewer systems shall be shown on the street plans. Separate grading plans will be required for all subdivisions. On all other plans, an overall plan layout will not be required but the above facilities shall be shown within the development and on the street plans.

All plans showing the domestic water systems shall include signature blocks and be approved by the Town Engineer, Water District and Fire District and for encroachment approval by the Town Engineer. The signature block shall conform to Standard Details and shall be situated near the lower right hand corner of the first sheet of the water plans.

Where wells are included as a part of the water system, the layout of the well site shall be drawn to a scale no smaller than 1 inch equals 5 feet, with the layout covering an area at least 50 feet in all directions from the well location.

6. Plan Details -- In addition to the other requirements of these Improvement Standards, the following details shall be shown on plans submitted for approval. This does not in any way exempt the Consulting Engineer preparing plans from the responsibility of preparing neat, accurate, and comprehensive plans in keeping with the standards of the profession.
 - A. Right-of-Way -- Right-of-Way lines, the boundaries of lots fronting on the street, drainage easements, utility easements, planting easements, section lines and corners, land grant lines, and temporary construction easements, both existing and proposed, shall be shown on the plans. All right-of-way and easement lines shall be properly dimensioned.
 - B. Topography -- All pertinent topographic features shall be shown, such as street lines, medians, driveways (on both sides of the street when within 40 feet of the median ending), curbs, sidewalks, shoulders, location and size of storm and sanitary sewer lines, high water and frequent inundation levels, water lines, gas lines, telephone conduits, other underground utilities, existing structures, houses, trees (6" and larger) and other foliage, traffic signals, street lights and pullboxes, underground electrical conduits, drainage ditches, utility poles, fire hydrants, retaining walls, masonry structures, and all other features of the area which may affect the design requirements for the area. When a potential utility conflict exists, "as built" elevations of the utilities shall be verified by the Consulting Engineer.

- C. Contours and Elevations -- Existing contours or supporting elevations shall be shown on all plans submitted for subdivision, commercial improvements, or planned unit developments.
- D. Profiles -- The plans shall show the existing profile of all roadway centerline, edges of pavement, curb and gutter flow lines, drainage ditches, storm and sanitary sewers. All profiles of proposed improvements shall state centerline elevations at 50 foot intervals and rate of grades, vertical curves, and other vertical alignment data. When curb and gutters are designed for reconstructed Town roads, elevations shall be shown at the edge of the outside traveled way, or if the road has a full paved section, shall also be shown two feet from the proposed lip of gutter. Any warped surface and vertical curve shall set elevations at 25 foot intervals. All profiles shall be coordinated with Town stationing. The Consulting Engineer shall contact the Town for such stationing. The plans shall show the existing ground profile for a minimum distance of 200 feet beyond temporary street endings to facilitate setting proper vertical alignment within the proposed improvement limits. The 200 foot minimum shall be increased when requested by the Town Engineer.
- E. Stationing and Orientation -- The stationing on plan and profile shall read from left to right. Stationing shall increase from south to north or from west to east. Plans shall be so arranged that the North arrow points toward the top or upper 180 degrees, insofar as practical.
- F. Bench Marks (Vertical Control) -- The bench marks and datum shall be clearly delineated on the plans both as to location, description, and elevations. The datum shall be 1929 North American Datum (U.S. & G. S.). Consulting Engineers may contact the Town for location and elevation of the nearest official bench mark.
- G. Typical Sections -- A typical section for each type of facility within the improvement, setting out the structural features, shall be a part of the plans.
- H. Cross Sections -- Cross sections shall be included in the plans, where determined necessary by the Town Engineer. When, in limited areas, unusual topographic features or special conditions occur that would affect the work, individual cross sections may be shown on the pertinent plan sheet.
- I. Special Notes -- Special notes shall be clearly indicated, and it shall be conspicuously noted on the plans that all construction work and installations shall conform to the Town of Loomis Standards and that all work is subject to the approval of the Town Engineer. Notes shall contain a statement regarding obtaining encroachment permits from other agencies when applicable.

- J. Horizontal Control -- All projects shall staked and designed per State Plane Coordinates (Zone II). Please contact Town for list of Control points within Town Limits.

7. Required Notes -- A list of Town required notes shall be obtained from the Town engineer and shall be attached to the original tracings for all development plans submitted to the Town for approval.

2-4 MINIMUM REQUIREMENTS FOR MODEL HOME BUILDING PERMITS

Model home building permits may be issued when the following items are completed and verified:

- A. The pad grades have been certified by a registered Civil Engineer or a licensed Land Surveyor and approved by the Town Engineer for the model home lots.
- B. All property corners for each of the model home lots shall be staked to the satisfaction of the Town Engineer. If curb and gutter and sidewalk has been placed at the time for model home permits are applied, the front property corners shall be marked.
- C. All utilities, utility crossings and utility extensions to each lot, located within the roadway, shall be installed except as provided for, within development agreement. Utilities include, but are not limited to: natural gas, electric, cable, telephone, water, sewer and storm drain.
- D. Approved fire protection plan to be submitted to Town prior to start of construction.
- E. If construction of the model homes will begin between April 16 and October 14, then a minimum 20 foot wide road with a minimum 4-inch road base, compacted to withstand the imposed load of 32 tons, must be completed to provide continuous access to a maintained public street to the satisfaction of the Town Engineer.

If construction will begin and/or continues from October 15 to April 15, then all roads within the subdivision providing access to the model homes must be paved and connected to a maintained public street to the satisfaction of the Town Engineer.

If the subdivider intends to obtain an alternative access to the model homes from an adjacent maintained public street, the subdivider shall obtain an encroachment permit from the Town Engineer.

The Town Engineer may require all work and construction on the model homes to cease at any time until all or additional portions of the subdivision improvements are finished in order to protect the health, safety or welfare of the public and workers.

2-5 MINIMUM REQUIREMENTS FOR PRODUCTION HOME BUILDING PERMITS

Production home building permits may be issued once the subdivision has been verified to be substantially complete. The subdivision shall be deemed to be substantially complete by the Town Engineer when the following items are completed or verified, except as provided for, within Development Agreements:

- A. All surface street improvements (sidewalks, curbs, gutters, ramps, driveways and street paving) are installed.
- B. Raise and pave all manholes and water valves. All water, sewer and storm drainage components shall be tested, approved and operational. This includes conformance to the Fire District's minimum flows for all fire hydrants.
- C. Install all underground gas, electric, telephone and TV cable facilities and backfill trenches.
- D. Street lighting system tested and accepted.
- E. Submit lot pad certifications for grade and compaction.
- F. Mark lot corners in Town sidewalk or curb and gutter and at the back of lots.
- G. Install erosion control measures.
- H. Install street name and traffic signs and striping.
- I. Construct all common lot retaining walls per the improvement plans. Construct sound walls at lots for which permits are applied.
- J. Assure final subdivision map is recorded.

2-6 REQUIREMENTS FOR SUBDIVISION NOTICE OF COMPLETION (N.O.C.)

Prior to acceptance of public improvements, the following items shall be completed and verified by the Public Works Department:

- A. The Contractor shall notify all required Town departments and agencies for a final inspection of constructed improvements. Following a final inspection of the project, the responsible agency shall issue the Contractor a final punchlist. The Contractor shall repair or address all items on the punchlist.
- B. Project Design Engineer to submit Record Drawings on CADD, mylars and one set of prints to the Public Works Department, within 90 days following filing of Notice of Completion, without exceptions.

- C. Receive lot pad elevation and compaction certifications and forward to the Town Engineer.
- D. Developer receives sign-off of the "Notice of Completion Departmental Approval Form" by all required departments and delivers to the PWD.
- E. Developer has paid all outstanding plan check and inspection fees.
- F. Developer has posted a Maintenance Bond to cover one year construction maintenance warranty period. Maintenance bond to be 50% of final construction cost for public improvements, only.
- G. On all Town owned and/or maintained sound walls the developer is required to submit written certification that anti-graffiti paint coat has been placed on all sound walls.
- H. Temporary fencing erected to enclose the frontage of model home areas shall be removed from the Town right-of-way.

2-7 **RESIDENTIAL OCCUPANCIES DURING SUBDIVISION BUILDING** -- Upon the occupancy of one or more homes, the occupant(s) shall have a safe, clean, unobstructed travelway, including sidewalks, in accessing and exiting the area of their home, applying to newly constructed streets within the subdivision extending to the closest existing street. The following minimum standards are to be met:

- A. Streets shall be thoroughly cleaned, back of walk to back of walk at the end of each work day.
- B. No building materials, portable toilets or construction equipment shall be stored within the street right-of-way.
- C. Piles of landscaping related materials (such as cobbles, bark or gravel) may be staged in the streets for immediate removal. If stored overnight, a lighted barricade shall be placed to each side of the pile, toward traffic. The pile shall not extend into the street from the curb, further than the width of a parked car.
- D. Unoccupied cul-de-sacs or other sections of streets for which there is no public access necessary shall be barricaded. Barricades shall be Type III (or fencing as approved by the Town Engineer).
- E. Temporary fencing erected to enclose the model home areas shall not be placed further into the street than the top of the Town curb. The fencing shall not be anchored into the sidewalk, curb or gutter. The fencing shall be removed prior to issuance of a Notice of Completion.
- F. All other requirements within the Subdivision Ordinance and Building Division regulations for approval of occupancy shall apply.

2-8 **GUARANTEE AND WARRANTY**-- The Contractor shall guarantee and warrant all materials supplied as being fit for the purposes intended. The Contractor shall guarantee and warrant all work performed as having been accomplished in a proper and workman-like manner.

Should any failure of work occur within the warranty period, the Contractor shall promptly make the needed repairs at the Contractor's own expense. Should such failure of work result in excessive maintenance by the Town, or in the opinion of the Town, the failure is best left un-repaired, the Contractor shall incur the additional maintenance cost. The cost shall be equal to the annual maintenance cost divided by the current prime rate.

Should the Contractor not make or undertake the necessary repairs within 30 days of having received written notification from the Town Engineer, the Town may make the repairs and the Contractor shall pay the entire cost thereof. In emergency cases, where in the opinion of the Town Engineer (provided a reasonable attempt has been made to notify the Contractor) delay would cause serious loss or damages, or a serious hazard to the public, the repairs may be made without prior notice to the Contractor, and the Contractor shall pay the entire cost thereof.

The procedures for review, repair and release of guarantee and warranty obligations shall be as follows:

A. Subdivision Improvements -- The guarantee and warranty shall continue for a period of one (1) year after Notice of Completion for all work installed under a Subdivision Agreement. The Subdivision Agreement shall be binding in its entirety.

The following procedures shall be followed for completion of the guarantee and warranty for subdivision improvements:

1. All necessary Town departments shall complete their guarantee and warranty inspections during approximately the tenth month following the Notice of Completion and prepare and deliver a final punchlist to the Contractor by approximately the end of the tenth month.
2. Within 30 days of receipt of the final punchlist (during the eleventh month), the Contractor shall repair or address all items indicated. All Town departments issuing a punchlist shall then be notified for reinspection of repairs.
3. Within 30 days of notifying the Contractor (by the end of the eleventh month), the Town departments shall reinspect the repaired improvements. Upon the Town's approval of the repairs, the maintenance bond will be allowed to expire, at the conclusion of one year following the Notice of Completion. If the Contractor does not complete the required work by the end of the eleventh month, the list of repairs will be referred to the Town Attorney's office for further management.

B. Encroachment Permit Improvements -- The guarantee and warranty shall continue for a period of 6 months after approval from all Town departments affected, for all work installed and completed under an Encroachment Permit. The Encroachment Permit shall be binding in its entirety. The following procedures shall be followed for completion of the guarantee and warranty for Encroachment Permit improvements:

1. All necessary Town departments shall complete their guarantee and warranty inspections during the last two weeks of the fifth month following the date of the Town's acceptance of the work. The Contractor shall be issued a punchlist upon the conclusion of the two week inspection period.
2. The Contractor shall complete the required repair work by the end of the sixth month following the initial approval of the work
3. Within 30 days of notification, the Town departments shall re-inspect repaired improvements, and upon approval of the repaired improvements, shall notify the Public Works Department.

C. Underground Warranty Work within Town Street Right-of-Way -- All underground work done as a result of the one year warranty inspection shall comply with the following:

1. All backfill in Town streets shall be two sack, concrete slurry.
2. The asphalt concrete patch shall conform to the Standard Details.
3. Depending upon the extent of asphalt concrete patching necessary and at the discretion of the Public Works Inspector, a slurry seal or one inch asphalt concrete overlay of the entire street width in the area of the patches may be required.

TOWN OF LOOMIS
DEPARTMENT OF PUBLIC WORKS APPROVAL

PLANS ARE ACCEPTED FOR USE AS WORKING DOCUMENTS. UNDISCOVERED ERRORS AND OMISSIONS SHALL BE CORRECTED AT THE DEVELOPER'S EXPENSE AS DISCOVERED. THIS APPROVAL EXPIRES ONE (1) YEAR FROM THE APPROVAL DATE UNLESS AN EXTENSION IS APPROVED IN WRITING BY THE DEPARTMENT OF PUBLIC WORKS OR CONSTRUCTION HAS BEEN INITIATED. EXPIRATION WILL RESULT IN A REQUIREMENT TO RESUBMIT THE PLANS FOR PLAN CHECK, PAYMENT OF CURRENT FEES AND COMPLIANCE WITH CURRENT TOWN STANDARDS. ANY REVISIONS TO THESE PLANS SHALL BE SUBMITTED FOR REVIEW AND APPROVAL.

TOWN ENGINEER

DATE

REVISION BLOCK

REVISION													
DATE													
TOWN APPROVAL													
AGENCY APPROVAL													

NOTE: ADD THE REQUIRED AGENCY APPROVAL BLOCK(S).

APPROVED BY:

Brian J. Fraciao

BRIAN J. FRACIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



TOWN OF LOOMIS

SIGNATURE BLOCK

CD-1

DEPARTMENT OF PUBLIC WORKS

REVISED:

SECTION 3

STREETS (H)

**CONSTRUCTION
IMPROVEMENT STANDARDS**

SECTION 3

STREETS

3-1 GENERAL -- Street surface improvements shall include: barricades, bikeways, bridges, bollards, curb, curb & gutter, driveways, pavement, ramps, sidewalk, survey monuments and tunnels. These improvements shall be installed in accordance with the approved improvement plans, these Improvement Standards and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the Caltrans Standard Specifications.

3-2 CONNECTION TO EXISTING IMPROVEMENTS -- Connection to existing surface improvements require that the following conditions be met:

- A. Existing Stub Street Connection -- The Developer shall be responsible for removing and reconstructing a portion of the existing roadway to make a satisfactory connection, as required by the Town Engineer.
- B. Street Widening -- When widening to complete a partial street along a development project, the Developer shall be responsible for saw cutting and removing a narrow strip along the outside portion of the pavement to provide a clean and stable pavement section for constructing against. The width from centerline shall be shown on the approved plans or as determined in the field, and verified by the Town Engineer.
- C. Cutting of Existing Streets -- Before any cuts are made in an existing street by the Contractor, or any governmental agency, Public Works shall receive notification and a set of the approved plans.

3-3 CONSTRUCTION STAKING -- Construction staking shall be provided by the Developer for all surface improvements. Such staking shall provide the station and offset, as well as the cut to the nearest hundredth (0.01) of a foot for concrete and paving and (.10) of a foot for rough grading. Stakes shall be provided at a minimum of every 50 feet in tangent sections and every 25 feet in curved sections. If approved, vertical curves shall be staked every 10 feet. Monuments shall have straddle ties placed. The Town Inspector must be supplied with two (2) sets of cut sheets prior to construction, without exception.

3-4 INSTALLATION

A. Subgrade

- 1. Subgrade for Sidewalk, Driveways and Ramps -- Subgrade for Town concrete flatwork and curbs back of Type 1 and 2 curb and gutter shall be processed to 90% relative compaction and shall be tested and certified by the Developer's licensed geotechnical engineer. Written certification shall be provided to the Town Engineer prior to the placement of concrete. Aggregate bases shall be required under the sidewalk.

Sidewalk subgrade exposed upon the removal of existing sidewalk shall remain intact unless it is determined by the Town's Inspector to be unstable. In this event, it shall be processed per the preceding paragraph.

2. Subgrade for Asphalt Concrete paving and Type 1 and Type 2 Curb and Gutter -- Subgrade shall be processed to 95% relative compaction and shall be tested and certified by the Developer's licensed geotechnical engineer. Written certification shall be provided to the Town Engineer prior to the placement of aggregate base or subbase.
- B. Aggregate Base and Subbase -- Roadway aggregate base and base for sidewalk, curb and gutter shall not be placed until the following items of construction within the Town street right-of-way are completed:
1. Installation of underground sewer and water systems and testing or televising, and approval of same by the agency Inspector.
 2. Installation of the underground storm drain system and approval of same by the Inspector.
 3. Installation of electric, natural gas, telephone and cable TV crossings.
 4. Backfill and compaction testing of all trenches related to the above and approval of same by the Inspector.

All aggregate base and subbase (AB and ASB) shall be installed per provisions in Sections 25 and 26 of the Caltrans Standard Specifications. AB and ASB shall be compacted to 95% relative compaction. If required by the PWD Inspector, AB and ASB shall be tested for compaction by the Developer's licensed geotechnical engineer. Written certification shall be provided to the PWD Inspector. An oil seal is not required on the AB surface.

Aggregate base shall be installed as a base for asphalt concrete paving and Type 1 and 2 curb and gutter and where specified on the approved plans unless lime and fly ash treatment is used.

Where valley gutters are placed (excluding Type A-7 driveways) the same rock base section used for the adjacent pavement shall be used for the valley gutter.

- C. Concrete -- All concrete (curbs, curb & gutters, driveways, curb ramps and sidewalks) shall be installed per provisions in Section 73 of the Caltrans Standard Specifications and per the Standard Details and per the following provisions:
1. Thickness -- All residential and commercial sidewalk adjoining the curb and gutter shall be a minimum of four inches thick. All meandering residential and commercial sidewalk shall be four inches thick, except across commercial driveway locations which shall be six inches thick.
- All commercial driveways, including valley gutters and five foot wide sidewalks in the A-6 driveways, shall be a minimum of 6 inches thick, with number 4, grade 60 rebar, on 18 inch centers each way as required by Town Engineer. Rebar shall be set on 2 inch concrete dobies/rebar supports at three foot maximum spacing each way. The dobies shall include wire ties.

2. Finishing -- Concrete shall not be placed or finished in the rain. It shall be the Contractor's responsibility to schedule construction operations accordingly.

All gutters shall be flow tested with water during the pour to assure proper drainage.

All concrete surfaces shall be completed with a medium broom finish unless otherwise specified. A heavy broom finish is not allowed. A concrete finish not conforming to the Caltrans Standard Specifications with regard to blemishes and alignment tolerances shall be cause for rejection of the work.

A four foot by four foot section of truncated domes shall be placed at the back of curb line, immediately behind the curb and gutter, centered in the opening to the street (regardless of slope) at every newly constructed access ramp. The domed section shall consist of four, two foot square panels and shall be attached together as a four foot by four foot panel at the factory. The truncated domes shall not be placed on the sloped portion of the ramp. See Section 3-5 of these Construction Standards for truncated dome materials requirements.

3. Expansion joints, deep tool joints and score marks -- Expansion joints shall be placed at 60 foot intervals and at curb returns in curb, gutter and sidewalk sections. The joint material shall be 1/4 inch cellulose fiber per the Caltrans Standard Specifications. Deep tool joints and score marks shall be placed at the following intervals for the sidewalk widths indicated (all deep tool joints shall be 2 inches deep):

Required Spacing For Deep Tool and Score Mark

Sidewalk Width (ft.)	Deep Tool Spacing (ft.)	Score Mark Spacing (ft.)
4	12	4
5	10	5
6	12	6
8	8	n/a
10	10	n/a

A deep tool joint shall be placed at the back of the curb for the total length of all monolithic curb, gutter and sidewalk.

All barrier curb and valley gutters shall include deep tool joints at 12 foot intervals and expansion joints at 60 foot intervals.

Expansion joint material shall not be placed against an existing or cured surface, but shall only be set with wet concrete on both sides.

4. Grades -- All sidewalks (including portions through driveways and curb ramps) shall be constructed with a minimum cross slope of 1% and a maximum of 2%.

The maximum grade allowed in the direction of pedestrian travel is 8%. In the case of steep longitudinal street grades, 20 feet is the maximum transition length required to obtain a 8% grade. If a 8% grade cannot be obtained in 20 feet, the maximum grade may be increased to 8.33% in 20 feet or more. The maximum required transition length is 25 feet. Any change to maximum grades require prior approval by Town Engineer.

For access ramp landings, the maximum allowable grade is 1% minimum and 2% maximum, perpendicular to the street. Parallel to the street, the grade of the landing shall conform to the longitudinal grade of the street.

5. Monolithic Sidewalk, Curb and Gutter -- All adjoining sidewalk, curb and gutter shall be poured monolithic.
 6. Curb and Gutter Installation In An Existing Street -- In an existing street, a minimum width of 24 inches of existing asphalt concrete paving shall be removed outside the proposed gutter lip and the lip poured against a form board. The resulting patch between the gutter lip and the existing pavement shall be 6 inches thick, or the thickness of the existing pavement, whichever is greater.
 7. Epoxy Work -- Where concrete curb is epoxied to a concrete or asphalt concrete surface, 95% of the surface, below and within the boundaries of the curb, shall be coated with epoxy. If extruded concrete curb is removed for pavement widening, the asphalt concrete pavement shall be patched with asphalt concrete fines to the satisfaction of the Public Works Inspector. Epoxy shall be two part and conform to the Caltrans Standard Specifications.
 8. No Sidewalk at Back of Retaining Curb -- At any Town curb ramp, no pedestrian surface (i.e., concrete, asphalt concrete, paving stones, etc.) adjacent to the back of sidewalk, shall be constructed within 3 feet behind the retaining curb. This area shall be finished with landscaping only.
- D. Asphalt Concrete -- All asphalt concrete (AC) shall be installed per provisions in Section 39 of the Caltrans Standard Specifications.

Existing AC surfaces shall be cut to a neat, straight line parallel with the street centerline and the exposed edge shall be tacked with emulsion prior to paving. The exposed base material shall be graded and recompact prior to paving.

Asphalt concrete shall not be installed in the rain. It shall be the Contractor's responsibility to schedule construction operations accordingly.

- E. Sound and Retaining Walls -- Construction of sound and retaining walls shall conform to the approved plans on those sound and retaining walls owned and/or maintained by Town. An anti-graffiti coating shall be applied to the Town side of all sound and retaining walls bounding the Town right-of-way and as owned and/or maintained by Town. The coating shall be Prosoco Graffiti Stop, two coat application, Krystalkote, or approved equal. The

Public Works Inspector shall be furnished a letter certifying that the coating has been applied per these Improvement Standards, prior to the Notice of Completion.

- F. Survey Monuments -- All street survey monuments shall be installed per the Standard Details except as otherwise provided by the Town Engineer. Surface monuments shall be driven flush with the surface pavement. All lot property corners which fall within concrete sidewalks shall be installed in accordance with Standard Details.

All rear lot property corners shall be marked with a 1/2 inch rebar, 12 inches long, the top flush with finish grade. All lot corners at the street shall be marked with a sawcut score mark, a minimum of 2 inches long and 1/4 inch deep, at the back of the Town sidewalk or back of curb, whichever applies, or as indicated on the recorded parcel or final map.

- G. Street Barricades -- All street and sidewalk barricades shall conform to Standard Details.

3-5 MATERIALS

- A. Aggregate Base and Subbase -- All aggregate base and subbase (AB and ASB) materials shall be Class 2 as specified on the approved improvement plans and shall conform to provisions in Sections 25 and 26 of the Caltrans Standard Specifications. Asphalt concrete grindings may be used as AB or ASB provided the Contractor supplies the Town documentation that the material meets the Class 2 specifications.
- B. Asphalt Concrete -- All asphalt concrete (AC) materials shall be Type B as specified on the approved improvement plans and shall conform to provisions in Section 39 of the Caltrans Standard Specifications. The top lift finish course shall have 1/2 inch rock gradation, lower lifts may be 3/4 inch gradation. A surface course of 3/8 inch may be used over utility trenches in existing streets, upon pre-approval of the Public Works Inspector.
- C. Concrete -- All concrete (curbs, curb & gutters, sidewalks) shall be Class A, 6 sack mix, Type II and shall conform to provisions in Section 90 of the Caltrans Standard Specifications, unless otherwise noted in the Construction Details.
- D. Concrete Additives -- Concrete additives shall conform to the Caltrans Standard Specifications and shall only be used upon the approval of the PWD Inspector.
- E. Lime/Fly Ash -- On a case by case basis, lime/fly ash subgrade treatment may be an acceptable substitute for placement of compacted aggregate base material.

Prior to plan approval, the Developer shall submit a proposal for lime/fly ash sections and compaction efforts, accompanied by recommendations from a licensed geotechnical engineer, to the Town Engineer for review.

- F. Truncated Domes -- Truncated dome panels shall be of vitrified polymer composite construction, embedded type, manufactured by Armor Tile Tactile Systems, Buffalo, New York, or approved equal. The dimensions and orientation of the truncated domes within the panel shall conform to Caltrans Standard Plans.

STREETS STANDARD DETAILS

<u>Title</u>	<u>Plate No.</u>
Street Section Improvements by Residential Zoning.....	H-0
Cross Gutter.....	H-1
Curbs & Gutters.....	H-2
Commercial Driveways Type A-6.....	H-3
Commercial Frontage Entrance.....	H-4
Sidewalk Ramps for Type 2 Curb.....	H-5
Detectable Warning (Truncated Dome Panel).....	H-6
Paved Swale.....	H-7
Asphalt Concrete Dike/Berm.....	H-8
Paved Median Island.....	H-9
Planter and Barrier Curb Details.....	H-10
Under Sidewalk Drain.....	H-11
Street Closure Timber Barricade.....	H-12
Sign and Barricades at end of Pavement Widening.....	H-13
Sidewalk Barricade.....	H-14
Roadway Connections (Sheet 1).....	H-15
Roadway Connections (Sheet 2).....	H-16
Street Classess A, B & C.....	H-17
Residential, Collector, Industrial & Commercial.....	H-18
Arterial & Frontage Road.....	H-19
Street Sign Name.....	H-20
Street Name Sign Installation on Street Light Pole.....	H-21
Street Sign Assembly.....	H-22
Street Name Sign Placement Details.....	H-23
Street Name Sign Placement on on Street Light.....	H-24
Cul-de-Sac Details.....	H-25
Offset Cul-de-Sac Bulb.....	H-26
90 Degree Intersection Elbow.....	H-27
Hammer-Head Design.....	H-28
Access Road Hammerhead for Utility Trucks.....	H-29
Access Road Hammerhead for Utility Trucks (Orientation 2).....	H-30
Geometrics & Profiles at Road Intersections.....	H-31
Commercial Frontage and Driveway Regulations.....	H-32
Bus Turnout Details.....	H-33
Buss Stop.....	H-34
Widening Details at Major Street Intersections.....	H-35
Sight Distance Requirements for 84' Streets.....	H-36
Sight Distance Requirements for 94' Streets.....	H-37
Alley Details and Driveway Transitions.....	H-38
Visibility Requirements – Residential Streets.....	H-39

Boxed Survey Monument.....	H-40
Transverse Trench Resurfacing Section.....	H-41
Longitudinal Trench Resurfacing Sections (Sheet 1).....	H-42
Longitudinal Trench Resurfacing Sections (Sheet 2).....	H-42A
Utility Trench Paving Backfill and Embedment.....	H-43
Conduit for Future Town Use.....	H-44
Project Sign (Sheet 1).....	H-45
Project Sign (Sheet 2).....	H-45A

STREET SECTION BY RESIDENTIAL ZONING
PUBLIC STREETS

ZONING = RA (4.6)

NO. OF PARCELS	STREET WIDTH (FT)	STRUCTURAL SECTION	SHOULDER WIDTH (FT)	R/W (FT)	CLASS
0-4	20	AC/AB	5	50	C
5-15	24	AC/AB	5	50	A&B
16-50	24	AC/AB	8	50	A&B
OVER 50	36	AC/AB	8	50	RESIDENTIAL

ZONING = RE (2.3)

NO. OF PARCELS	STREET WIDTH (FT)	STRUCTURAL SECTION	SHOULDER WIDTH (FT)	R/W (FT)	CLASS
0-4	20	AC/AB	5	50	C
5-50	24	AC/AB	8	50	A&B
OVER 50	36	AC/AB	8	50	RESIDENTIAL

ZONING = RR (1.0)

NO. OF PARCELS	STREET WIDTH (FT)	STRUCTURAL SECTION	SHOULDER WIDTH (FT)	R/W (FT)	CLASS
0-4	20	AC/AB	5	50	C
5-50	24	AC/AB	8	50	A&B
OVER 50	36	AC/AB	8	50	RESIDENTIAL

ZONING = RS-20, RS-10, RS-10a, RS-7, RS-5, RM-5 & RM-3.5

NO. OF PARCELS	STREET WIDTH (FT)	STRUCTURAL SECTION	SHOULDER WIDTH (FT)	R/W (FT)	CLASS
0-4	28	AC/AB	SW, C&G	50	A&B
5-50	28	AC/AB	SW, C&G	50	RESIDENTIAL
OVER 50	36	AC/AB	SW, C&G	50	RESIDENTIAL

PRIVATE STREETS ONLY - THE STANDARD 50-FOOT WIDE ROADWAY EASEMENT MAY BE REDUCE (NO LESS THAN 30 FEET) IF THE TOWN DETERMINES THAT:

- THERE WILL BE 4 OR LESS EXISTING AND PROPOSED PARCELS USING THIS ROAD EASEMENT,
- THE ROAD DOES NOT PROVIDE ACCESS FOR FUTURE DEVELOPMENT IN THE AREA,
- THE DEVELOPMENT ADHERES TO THE GENERAL PLAN AND ZONING ORDINANCE,
- THAT THERE IS ADEQUATE AND USEABLE WIDTH OF AT LEAST 20 FEET (FOR A 30' PROPOSED ROAD EASEMENT, AT LEAST 10' FOR A 40' PROPOSED ROAD EASEMENT) ON THE ADJACENT PROPERTY FOR FUTURE EASEMENT AND ROAD IMPROVEMENTS,
- THE REDUCED EASEMENT WIDTH WILL PROVIDE THE REQUIRED STREET, SHOULDER AND DRAINAGE SWALE IMPROVEMENTS, AND PROVIDE FOR SAFETY, OBSTRUCTION AVOIDANCE AND UTILITY IMPROVEMENTS,
- WILL ADHERE TO THE TOWN AND OTHER AGENCIES REVIEW REQUIREMENTS (WHICHEVER IS MORE STRINGENT)

PROVED BY:



BRIAN J. FRAGAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER





TOWN OF LOOMIS
STREET SECTION
IMPROVEMENTS BY
RESIDENTIAL ZONING
DEPARTMENT OF PUBLIC WORKS


H-0

REVISED:


REINFORCING STEEL TO BE EXTENDED
12" MIN. & SPLICED ACCORDING TO
STATE SPECIFICATION.

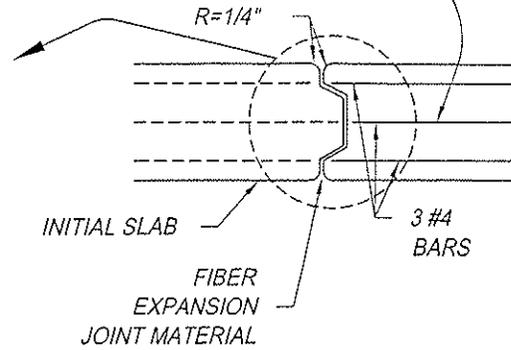

CONTACT JOINT DETAIL

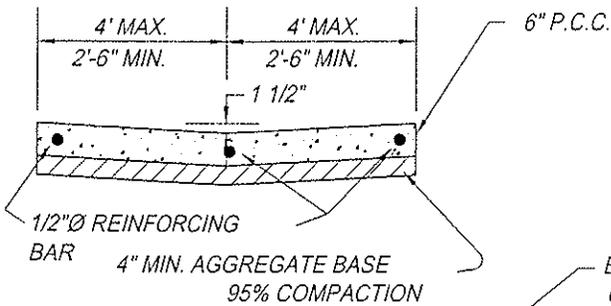

SECTION A-A

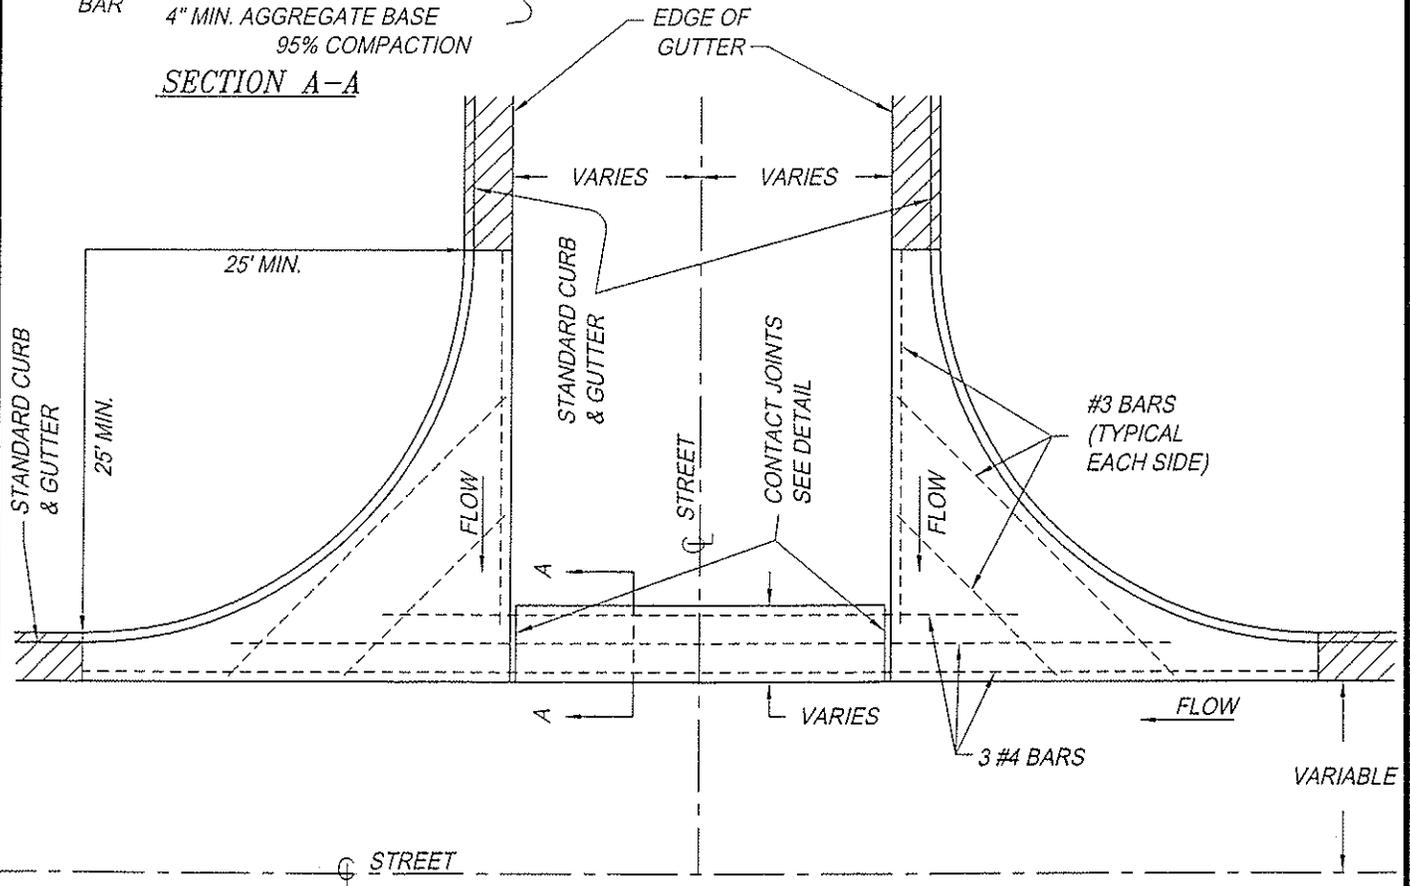


NOTE: 4" MIN. AGGREGATE BASE TO BE
PLACED WITHIN LIMITS OF CROSS
GUTTER. (95% RELATIVE COMPACTION)

APPROVED BY:
Brian J. Fragia
BRIAN J. FRAGIA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
REVISED:



TOWN OF LOOMIS
CROSS GUTTER
DEPARTMENT OF PUBLIC WORKS


H-1

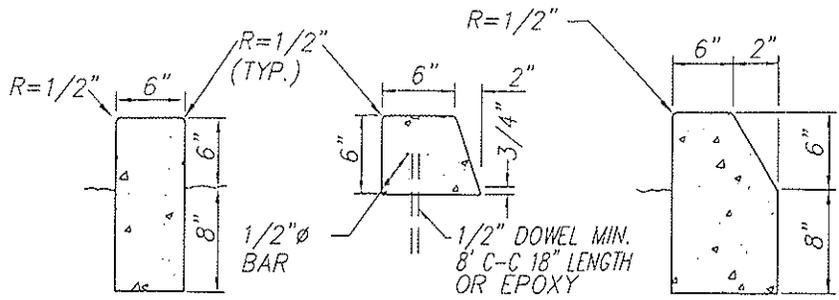


TYPE 3

TYPE 4

TYPE 5

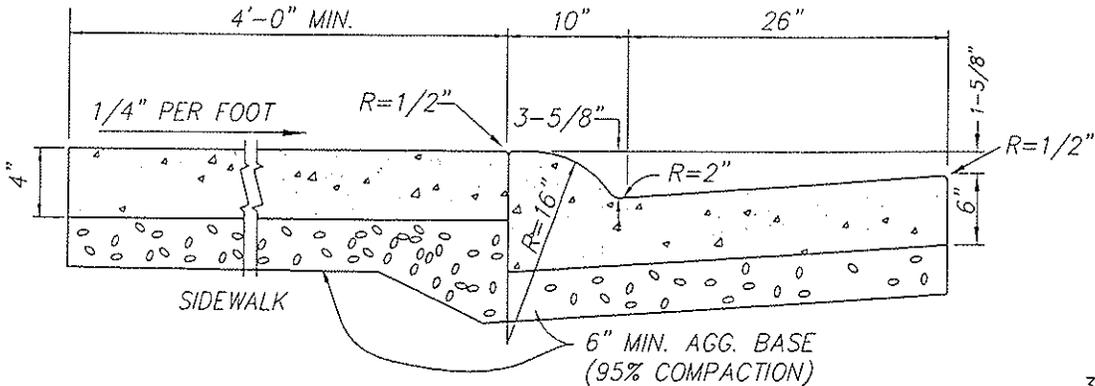

TYPE 1
ROLLED CURB

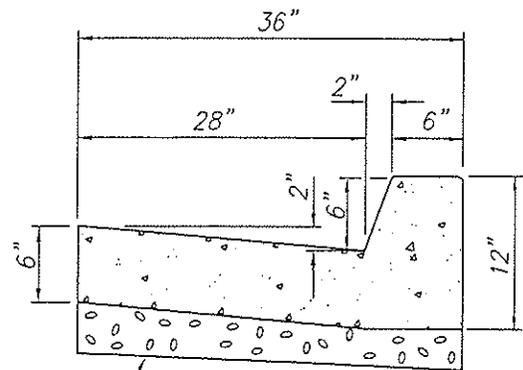

6" MIN. AGG. BASE
(95% COMPACTION)

TYPE 2
VERTICAL CURB

NOTES:


1. LOCATE 1-1/2" DEEP SCORES AT 10 FOOT INTERVALS W/ 1/2" SCORES AT 5 FOOT INTERVALS. ALL CONCRETE TO BE CLASS A (6 SACK). EXPANSION JOINT FELT EVERY 20' WITHIN SIDEWALK SECTIONS.
2. CURB HEIGHT OTHER THAN 6" IS NOT DESIRABLE AND SHOULD BE SUBJECT TO APPROVAL OF THE TOWN ENGINEER.
3. MEANDERING SIDEWALKS NOT TO INCLUDE AGGREGATE BASE (CASE BY CASE) AS APPROVED BY THE TOWN ENGINEER.

APPROVED BY:
Brian J. Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS
CURBS & GUTTERS
DEPARTMENT OF PUBLIC WORKS

H-2

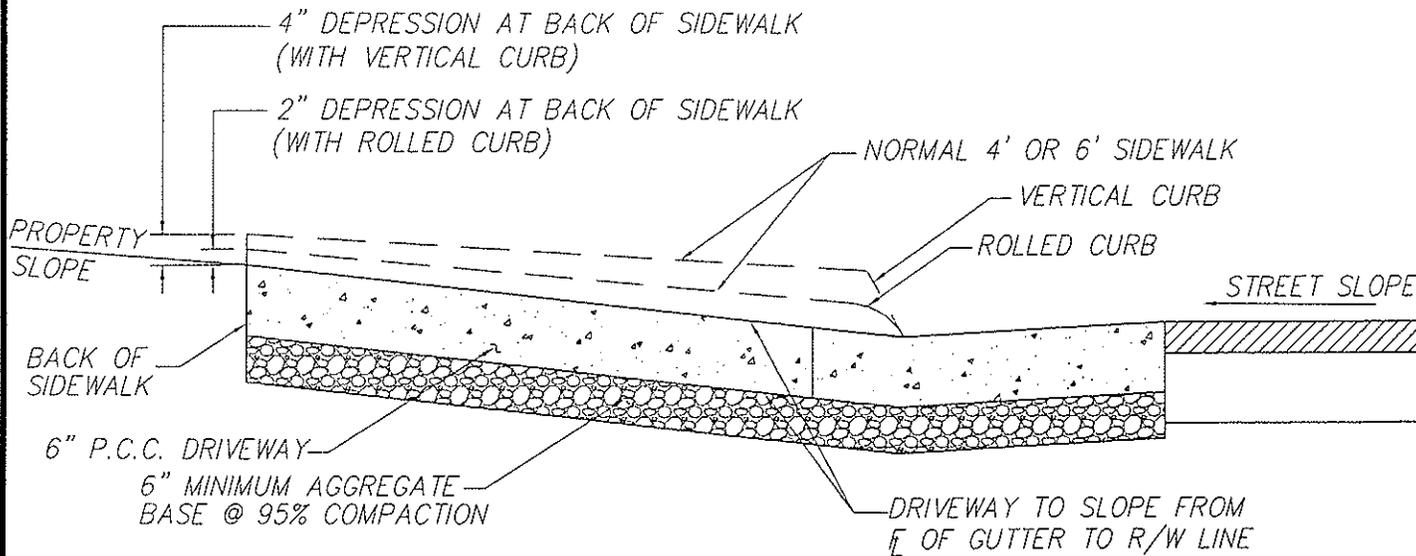

TYPICAL DRIVEWAY SECTION

NOTE: THE PROPERTY SLOPE FOR THE FIRST 20' FROM THE BACK OF THE SIDEWALK MUST BE DESIGNED SO THAT THE ALGEBRAIC DIFFERENCE OF THE PROPERTY SLOPE AND STREET SLOPE WILL NOT EXCEED 7% WITH VERTICAL CURB AND 10% WITH ROLLED CURB. IF PROPERTY SLOPE IS NEGATIVE, IT IS NOT TO EXCEED 5% FOR THE FIRST 20' FROM THE BACK OF THE SIDEWALK.

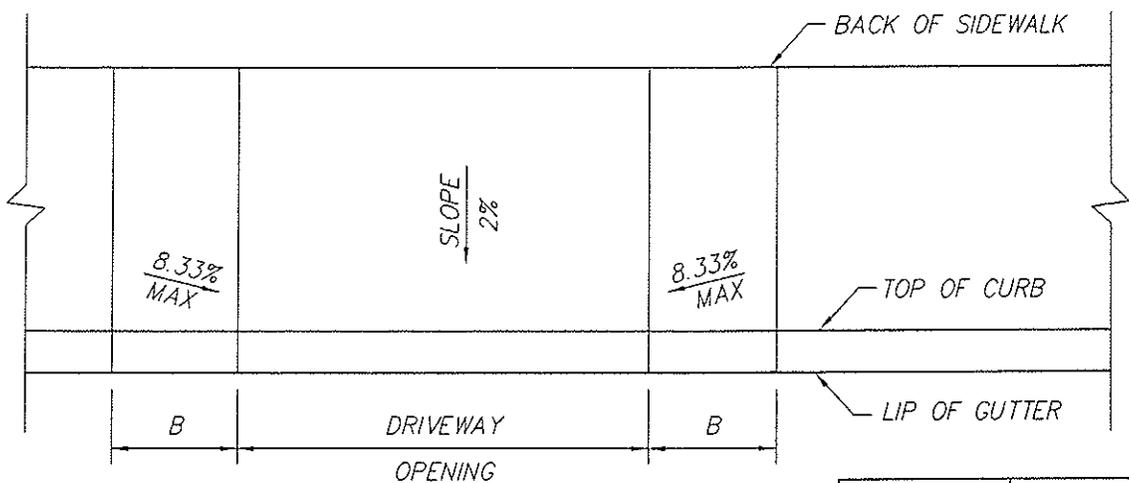

CURB TYPE	TRANSITION
ROLLED	4'
VERTICAL	6'


- NOTES:**
1. FOR CURB HEIGHT OTHER THAN STANDARD, THE MAXIMUM 8.33% SLOPE CONTROLS TRANSITION LENGTH B.
 2. ALL SUBGRADE WITHIN TOWN RIGHT OF WAY SHALL BE SCARIFIED PROCESSED AND COMPACTED TO 95%

APPROVED BY:
Brian J. Fraglio
 BRIAN J. FRAGLIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
**COMMERCIAL DRIVEWAYS
 TYPE A-6**
 DEPARTMENT OF PUBLIC WORKS

H-3

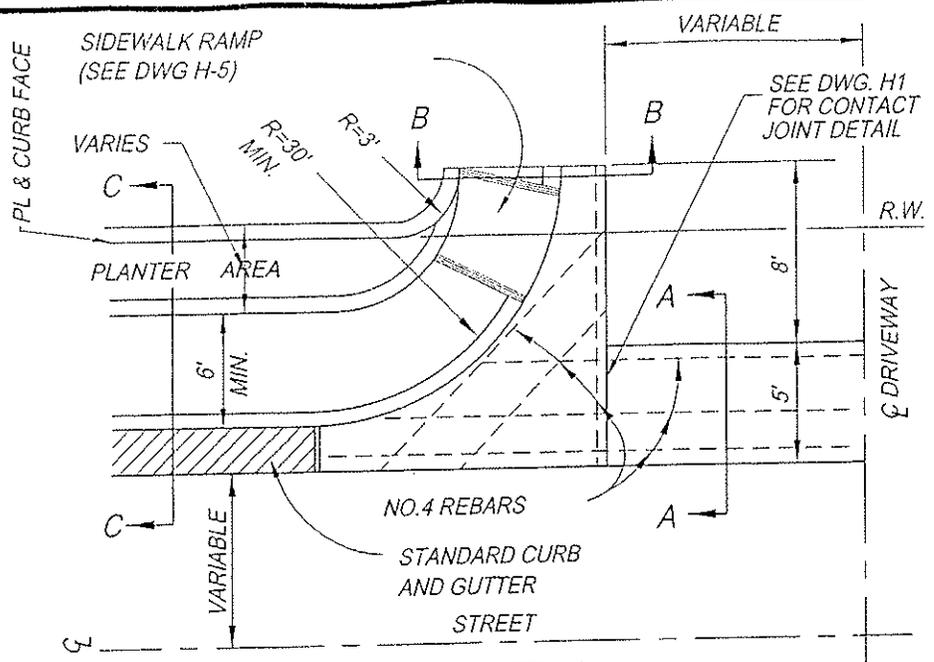


PLAN VIEW

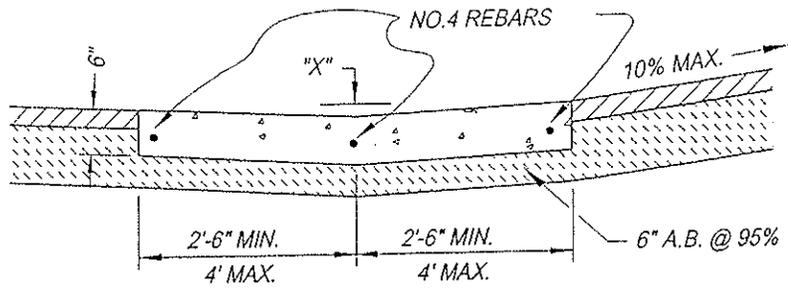


- NOTES:**
1. CROSS CUTTERS AND SPANDREL ARE REQUIRED FOR ALL COMMERCIAL ENTRANCES.
 2. SEE STD. DWG H-1 FOR CROSS GUTTER DETAILS, H-10 FOR PLANTER DETAILS.

"X" = 1-1/2" FOR 5' WIDE X-GUTTERS
 "X" = 2" FOR 8' WIDE X-GUTTERS

SECTION A-A

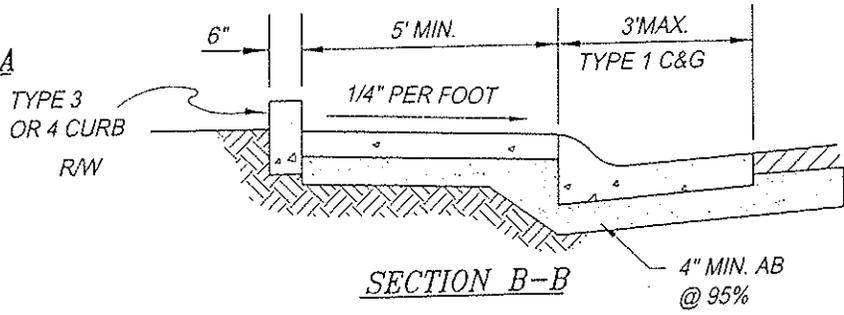

SECTION B-B

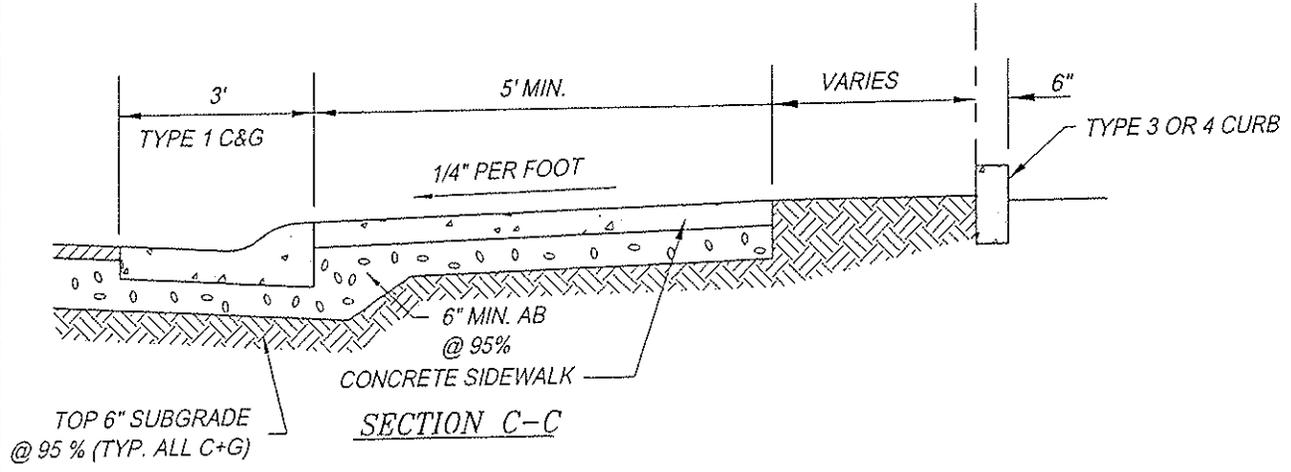


SECTION C-C

APPROVED BY:
Brian J. Fragala
 BRIAN J. FRAGALA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
**COMMERCIAL FRONTAGE
 ENTRANCE**
 DEPARTMENT OF PUBLIC WORKS


H-4

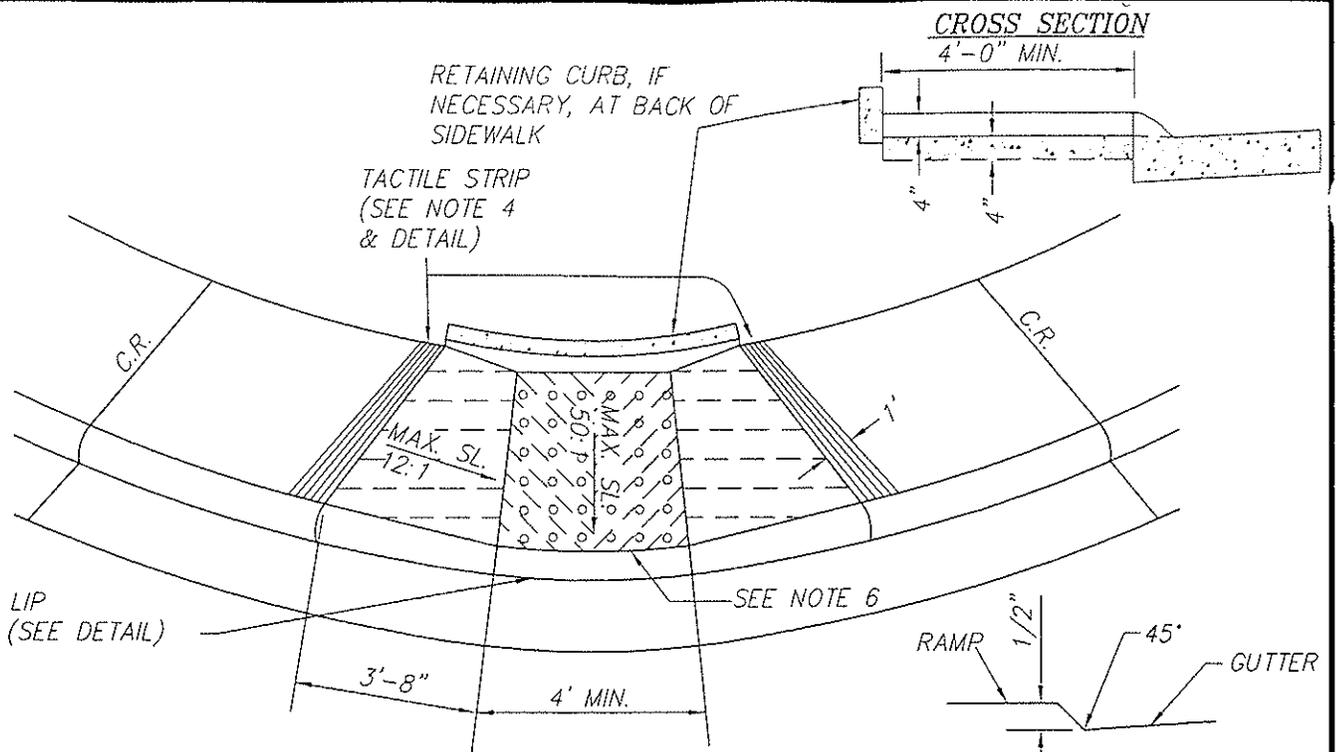

**SIDEWALK RAMP
AT CENTER OF CURB RETURN**

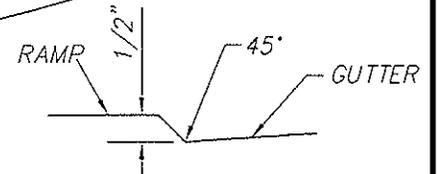

**TYPICAL DETAIL
FOR LIP OF RAMP**

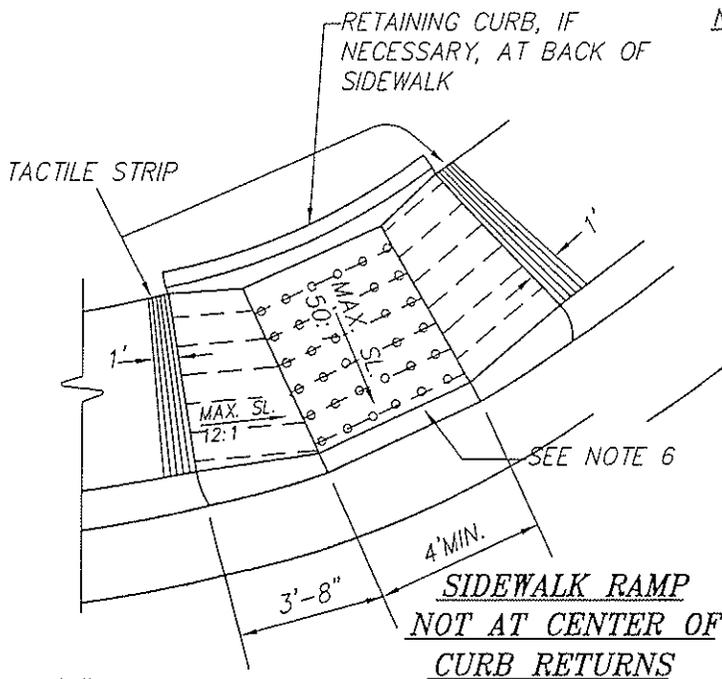


**SIDEWALK RAMP
NOT AT CENTER OF
CURB RETURNS**

NOTES:

1. TWO RAMPS SHALL BE INSTALLED AT EACH CORNER OF INTERSECTIONS OF STREETS OF 84' OR GREATER WHERE CONDITIONS PERMIT.
2. SINGLE RAMPS SHALL BE CONSTRUCTED AT THE CENTER OF CURB RETURNS FOR ALL OTHER INTERSECTIONS OR AS DETERMINED BY THE TOWN ENGINEER FOR SPECIAL CONDITIONS.
3. TRUNCATED DOMES PER STATE STD. PLAN RNSP A88-1. SEE SEC. 71-4 C.2 AND 71-5 OF STATE CONST. STDS. FOR REQUIRED PRODUCT OR APPROVED EQUAL INFORMATION.
4. RAMPS SHALL HAVE A HEAVY BROOM FINISH TRANSVERSE TO THE SLOPE OF THE RAMP AND A TACTILE STRIP 1' (ONE FT.) WIDE ALONG THE PERIMETER.
5. RETAINING CURB (TYPE 3) SHALL BE INSTALLED WHERE LOT SLOPE IS TOWARD THE SIDEWALK. (TO PREVENT SHEET FLOW ACROSS SIDEWALK)

1/2" FOR TACTILE STRIP
1-1/4" FOR RAMP

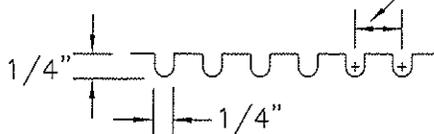

**TYPICAL DETAIL
FOR GROOVES**

APPROVED BY:
Brian J. Fraggio
BRIAN J. FRAGGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS
**SIDEWALK RAMPS
FOR TYPE 2 CURBS**

H-5


REVISED:

DEPARTMENT OF PUBLIC WORKS

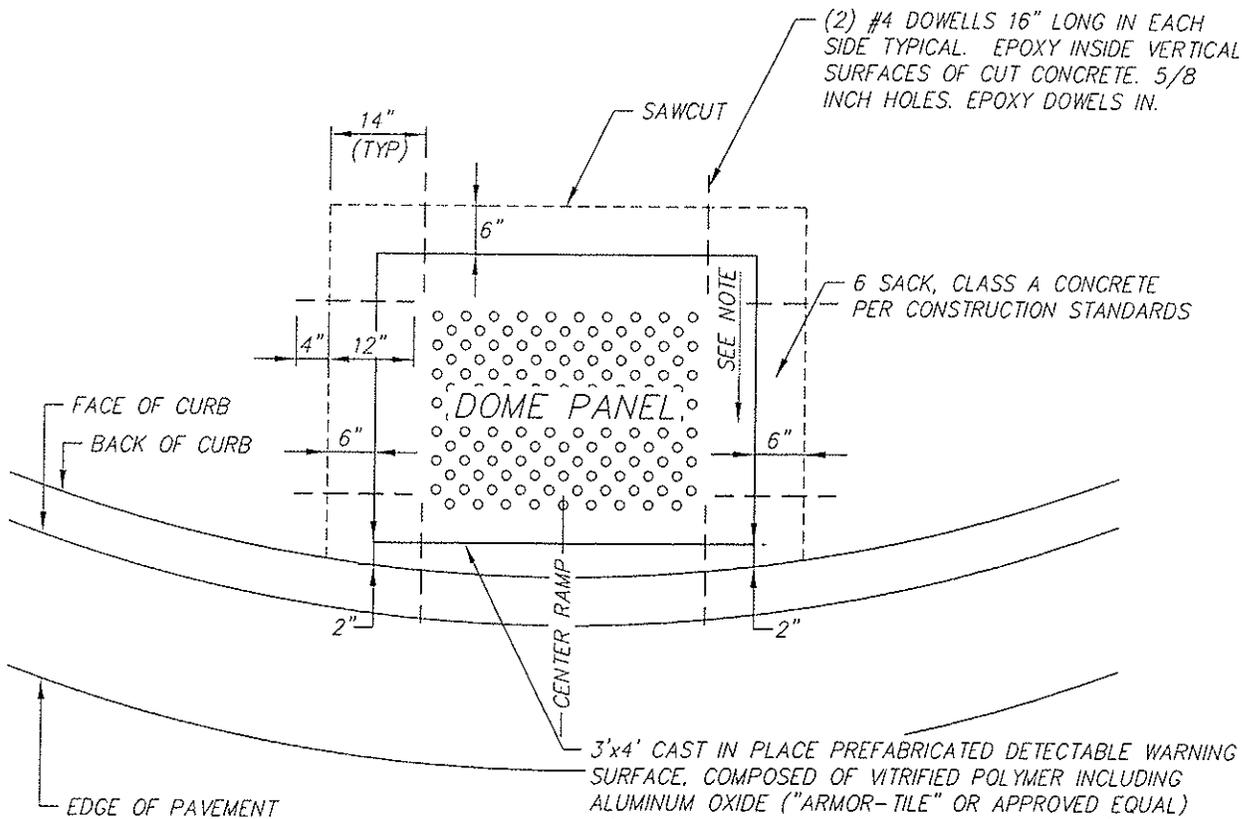

3'x4' CAST IN PLACE PREFABRICATED DETECTABLE WARNING SURFACE, COMPOSED OF VITRIFIED POLYMER INCLUDING ALUMINUM OXIDE ("ARMOR-TILE" OR APPROVED EQUAL) COLOR TO BE SAFETY YELLOW. DOMES TO BE 'IN-LINE', PARALLEL TO CURBING, WITH A HEIGHT OF 0.2", BASE DIA. OF 0.9", AND TOP DIAMETER OF 0.45", SPACED 1.66" O.C. (2.35" O.C. ON THE DIAGONAL). FIELD SURFACE AND TOP OF DOMES TO HAVE A DOTTED TEXTURE FOR A SLIP RESISTANCE. DENSITY OF DOTS IN FIELD AREA TO BE 30 PER SQUARE INCH MINIMUM.


NOTE:
PRIOR TO RETROFITTING TRUNCATED DOME PANEL, ASSURE GRADES CONFORM TO CITY REQUIREMENTS.

APPROVED BY:

 BRIAN J. FRAGLIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
**DETECTABLE WARNING
 (TRUNCATED DOME PANEL)
 RETROFIT OR REPLACEMENT**
 DEPARTMENT OF PUBLIC WORKS

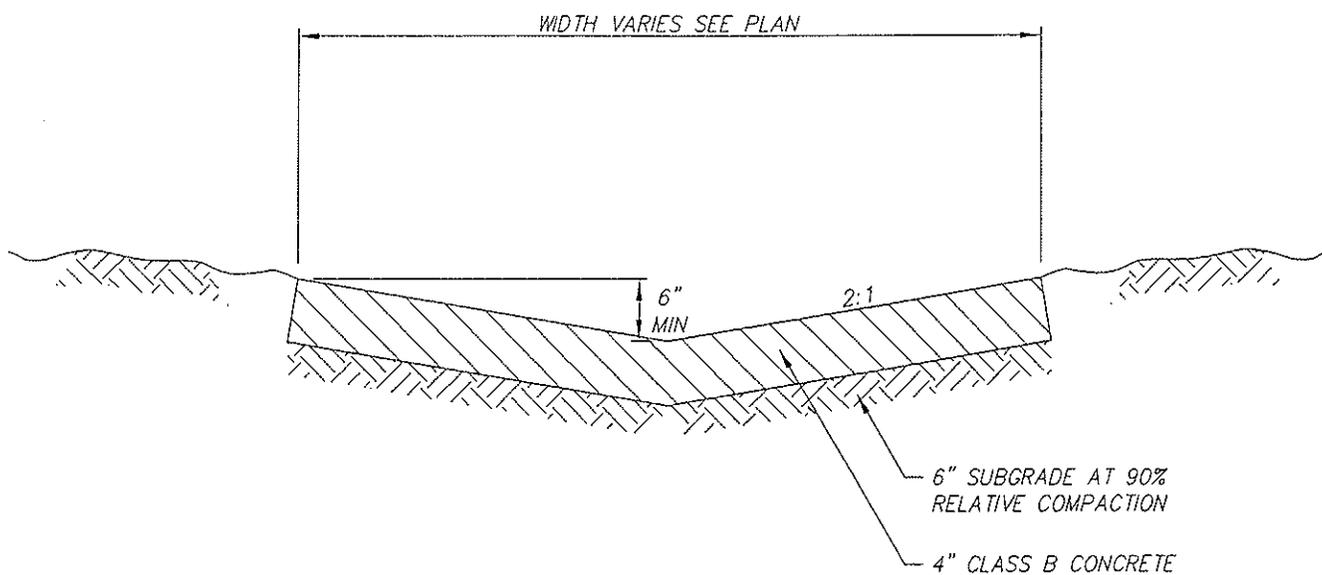H-6



NOTES:

1. EXPANSION JOINTS AT 20 FT O.C.

APPROVED BY:

Brian J. Fragiolo
 BRIAN J. FRAGIOLA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS


PAVED SWALE

DEPARTMENT OF PUBLIC WORKS

H-7

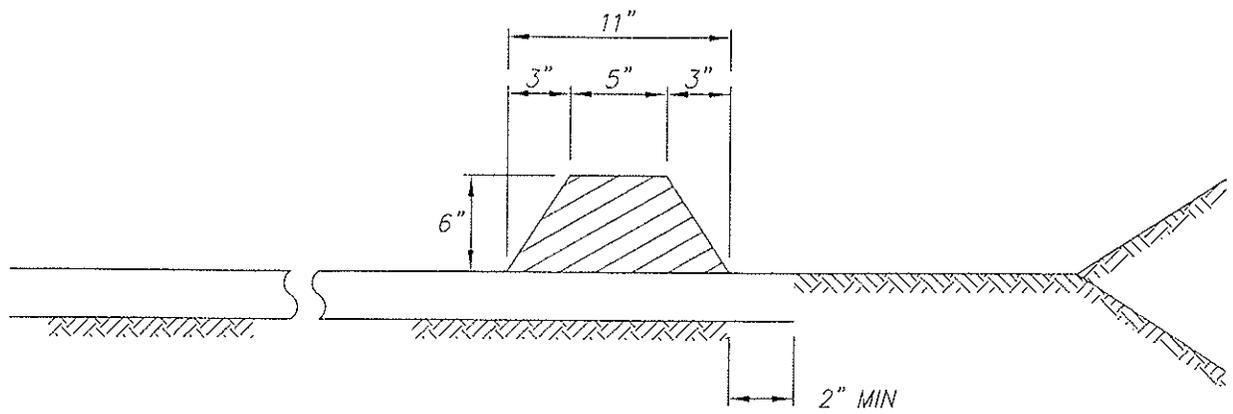

TYPE A

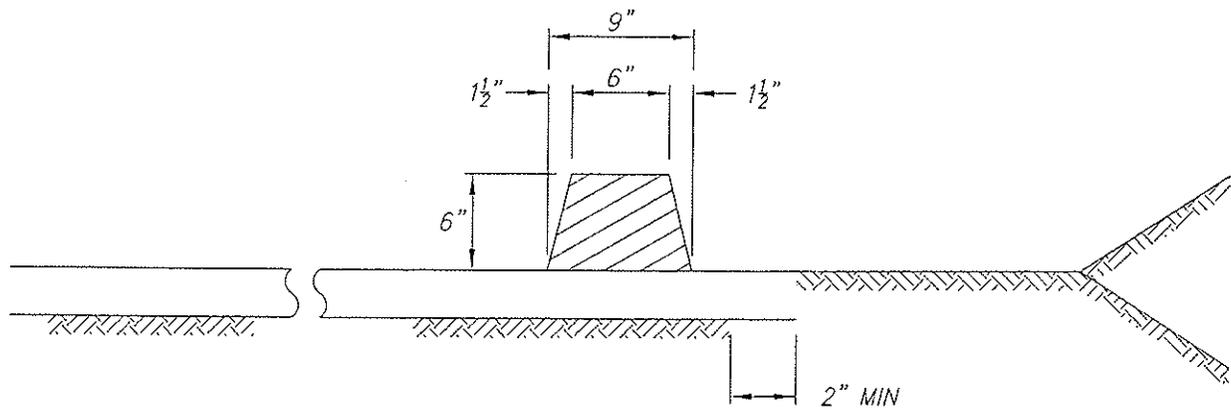

TYPE B

APPROVED BY:

Brian J. Fraglio

BRIAN J. FRAGLIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

**ASPHALT CONCRETE
DIKE/BERM**

DEPARTMENT OF PUBLIC WORKS

H-8

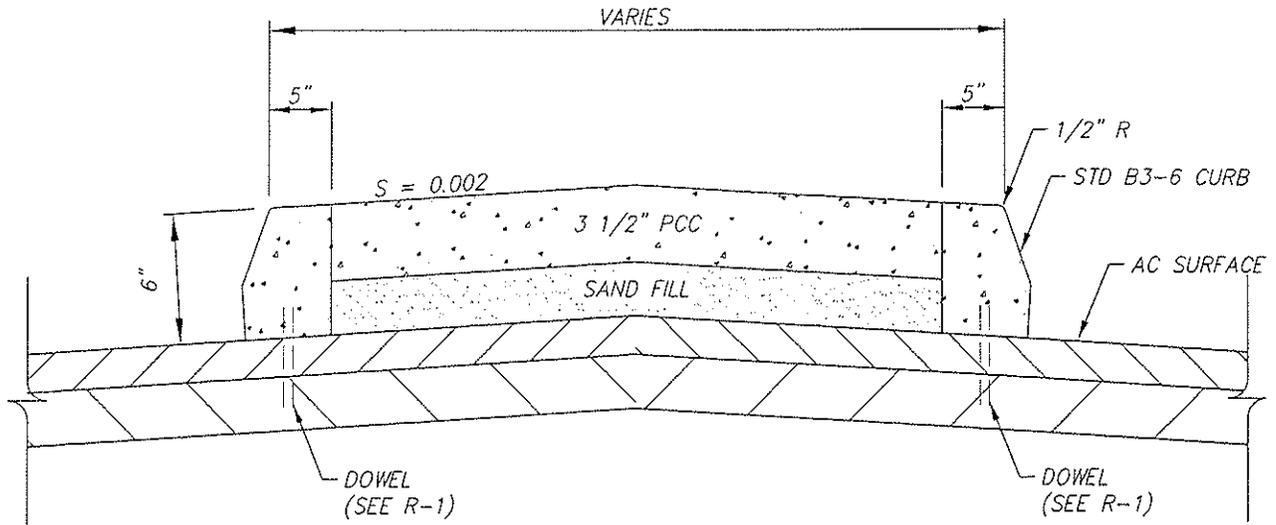

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

PAVED MEDIAN
 ISLAND


DEPARTMENT OF PUBLIC WORKS

H-9

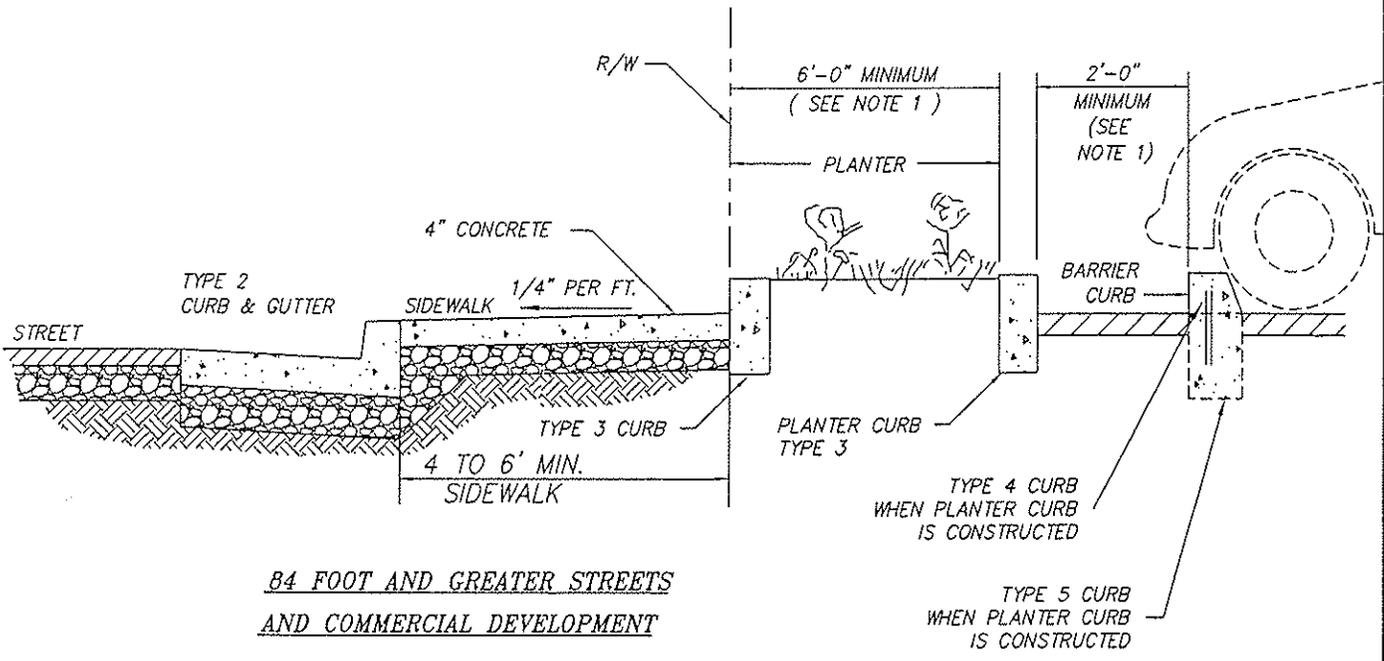

NOTES:


1. PLANTER CURBS ARE OPTIONAL. IF REQUIRED PLANTER WIDTH IS INCREASED A MINIMUM OF 2'-6" OR MORE.
2. PLANTER CURBS MAY BE OMITTED ONLY IF LAWN IS PLANTED TO BACK OF SIDEWALK AND CONTINUOUS BARRIER CURB IS PLACED AT LOCATION SHOWN.

APPROVED BY:

 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
 PLANTER AND BARRIER
 CURB DETAILS
 DEPARTMENT OF PUBLIC WORKS

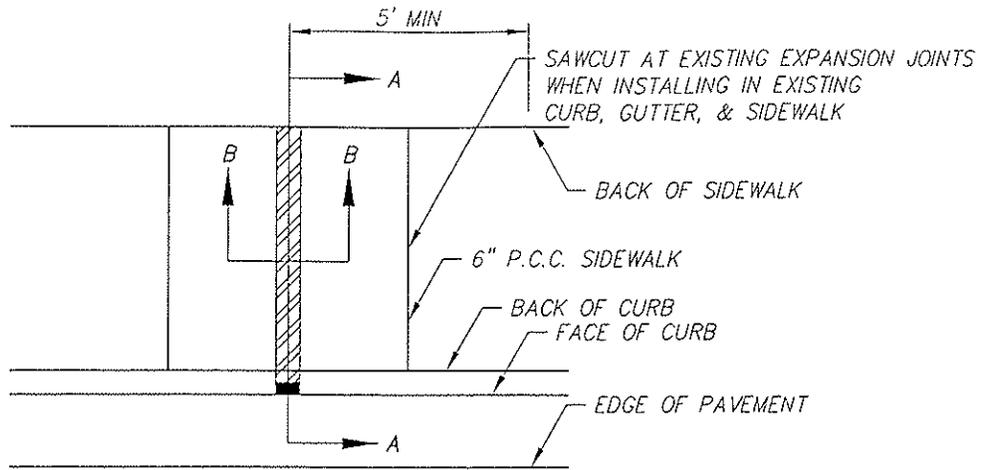
H-10



PLAN VIEW

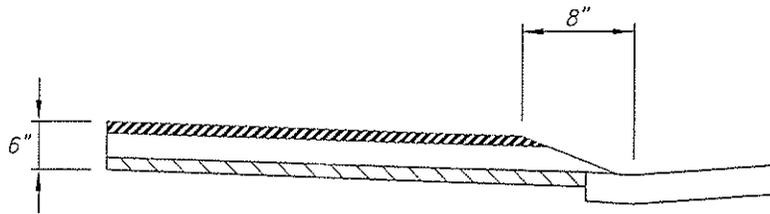

SECTION A-A

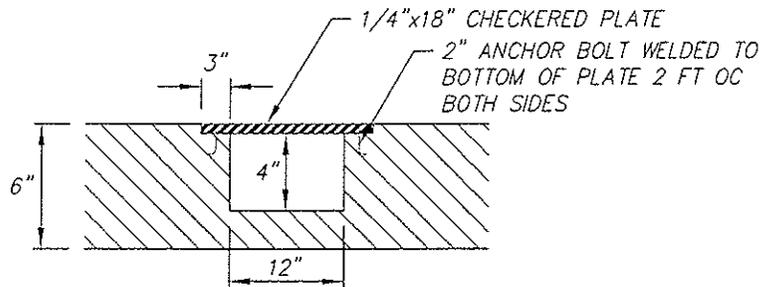

SECTION B-B

NOTES:

1. GALVANIZED FABRICATION AND ASSEMBLY.
2. FOR INSTALLATION IN EXISTING SIDEWALK, SAWCUT 12 INCH. EACH SIDE OF DRAIN.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

**UNDER SIDEWALK
 DRAIN**


DEPARTMENT OF PUBLIC WORKS

H-11

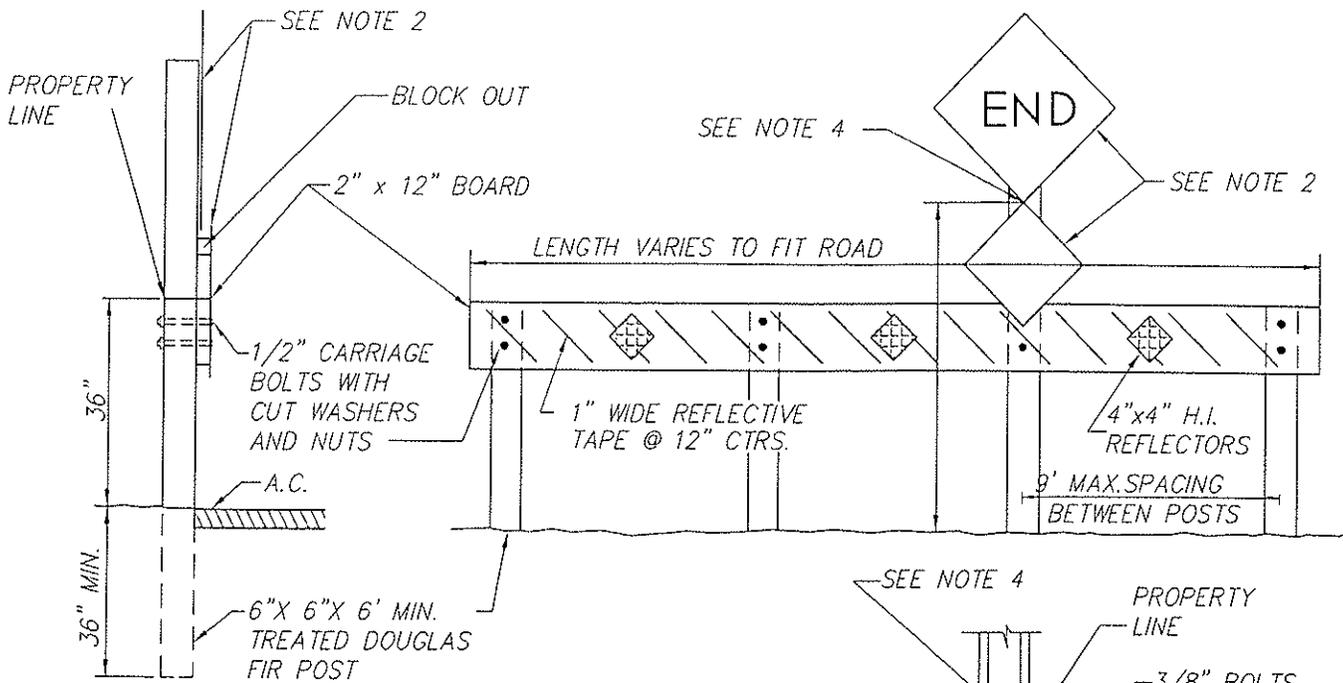

NUMBER AND SIZE OF SIGNS

R/W WIDTH	W31 SIGN		C2 SIGN	
	SIZE	NO.	SIZE	NO.
< 50'	24"	1	36" x 24"	1
50' - 60'	24"	2	48" x 30"	1
80' - 84'	24"	2	48" x 30"	1
100' - 110'	24"	2	48" x 30"	1

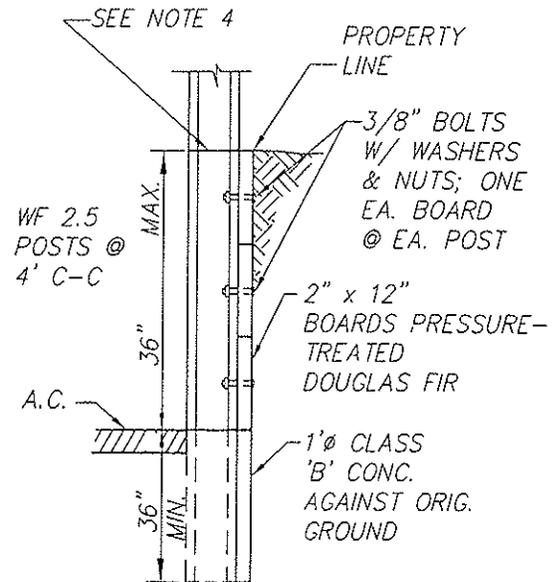

STREET ENDING IN CUT WHERE SLOPE NOT OBTAINABLE

NOTES:

1. WHERE PERMISSION HAS BEEN GRANTED TO CLOSE AN EXISTING PUBLIC STREET, TO TRAFFIC, A C2 "ROAD CLOSED" SIGN MAY BE REQUIRED ON THE CENTERLINE OF THE ROAD IN ADDITION TO THE W31 "END" SIGNS.
2. 24" x 24" W31 SIGNS AND 18" x 18" RED TYPE N MARKERS. BLOCK OUT AS NECESSARY FOR TYPE N MARKER TOP MOUNTING BOLT (BOTTOM MOUNTING BOLT NORMALLY THROUGH BARRIER RAIL. RED TYPE N MARKERS TO HAVE SOLID RED REFLECTIVE BACKGROUND W/O ADDED REFLECTORS.
3. ALL EXPOSED SURFACES SHALL BE PAINTED WITH 2 (TWO) COATS OF WHITE PAINT CONFORMING TO SECTION 91-3.02 OF THE STATE SPECIFICATIONS.
4. POST AT CENTER OR NEAREST TO CENTER ON RIGHT HAND SIDE TO BE EXTENDED TO PROVIDE MOUNTING FOR SIGNS.
5. POST SHALL BE PRESSURE TREATED PER STATE SPEC. 58-1.02

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER





TOWN OF LOOMIS
**STREET CLOSURE
 TIMBER BARRICADE**

H-12


REVISED:

DEPARTMENT OF PUBLIC WORKS

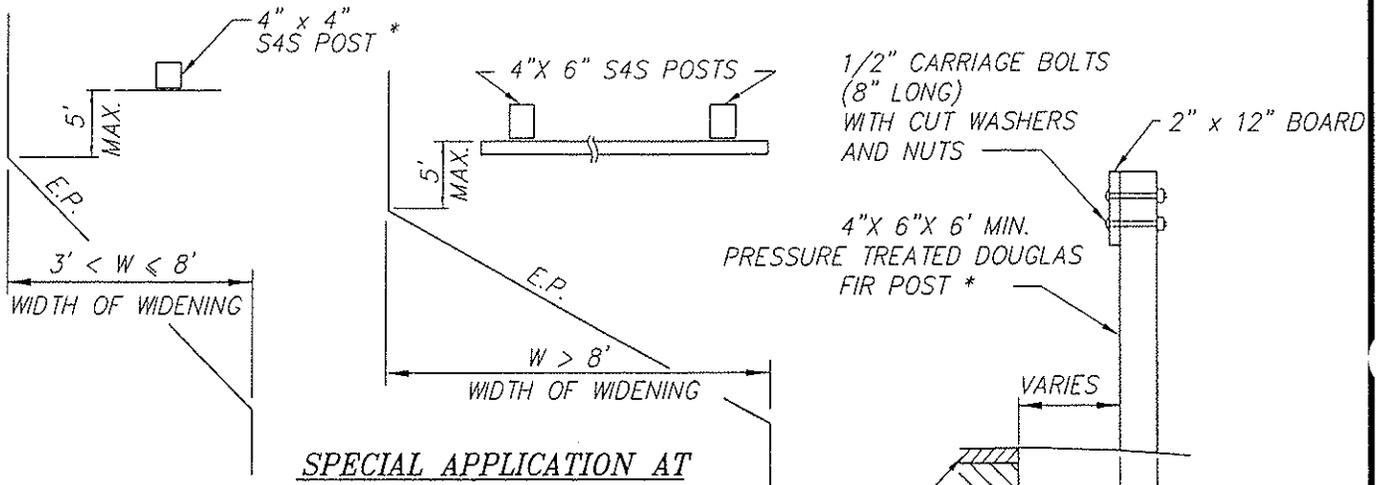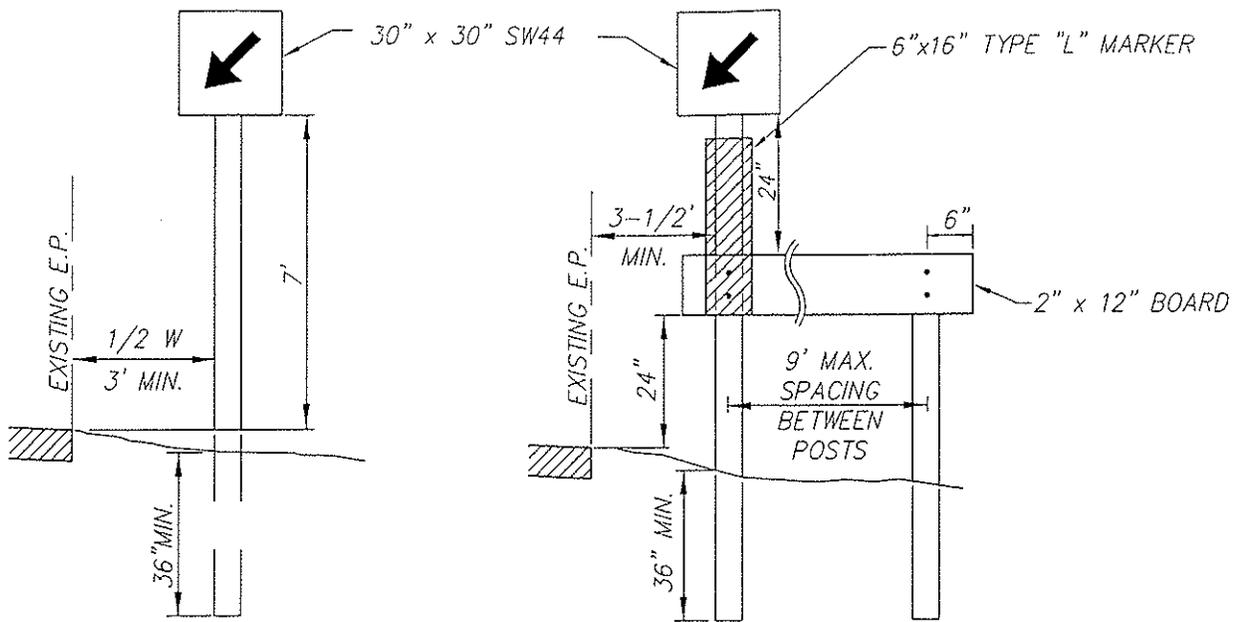

SPECIAL APPLICATION AT DIRECTION OF ENGINEER

**W4-2 IN LIEU OF TYPE F DELINEATOR AT DIRECTION OF ENGINEER.

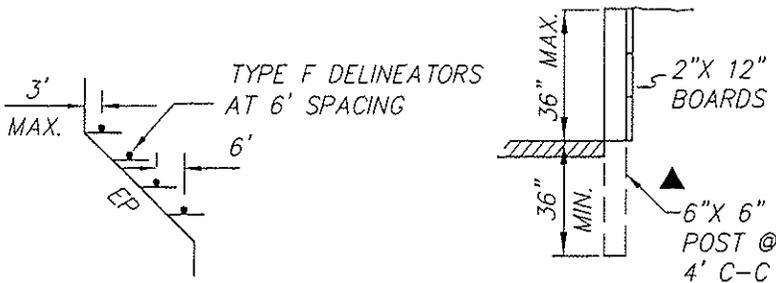

STREET WIDENING AT CUT WHERE SLOPE NOT OBTAINABLE

▲ POST AT SIDE NEAREST THE EDGE OF PAVEMENT TO BE OF SUFFICIENT HEIGHT TO PROVIDE FOR THE MOUNTING OF REQUIRED SIGNS.

3/8" BOLTS W/ WASHER NUTS @ EA. BOARD & POST

ALL EXPOSED SURFACES SHALL BE PAINTED WHITE IN CONFORMANCE WITH THE REQUIREMENTS OF SECTIONS 91-3.01 AND 91-3.02 OF THE STATE STANDARD SPECIFICATIONS.

* STATE OF CALIFORNIA SPECIFICATIONS 58-1.02

APPROVED BY:


Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
SIGNS AND BARRICADES
AT END OF
PAVEMENT WIDENING
 DEPARTMENT OF PUBLIC WORKS

H-13

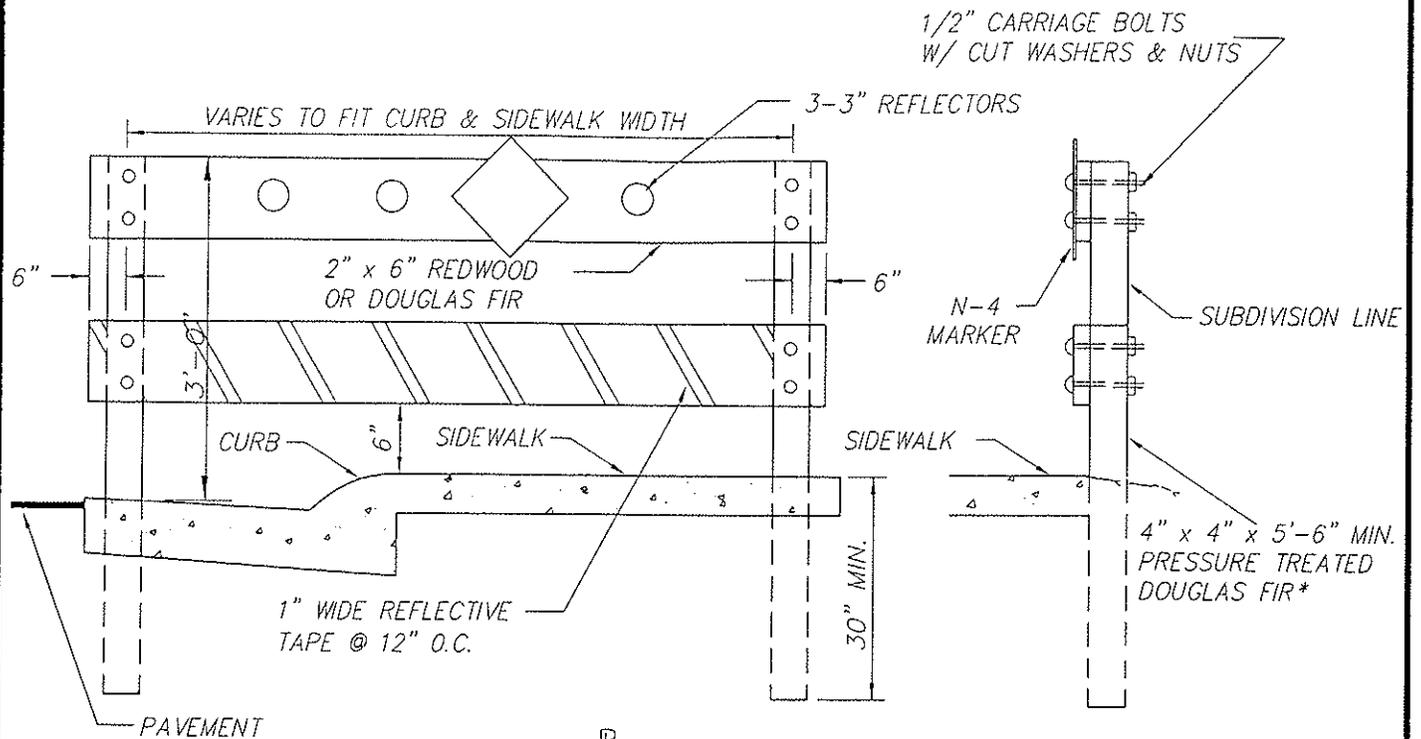

1" WIDE REFLECTIVE TAPE @ 12" O.C.

6WF2.5 AT 4' C-C

SIDEWALK

36" MIN.

2" x 12" (AS NEEDED)
ATTACH TO 6WF2.5 WITH 3/8" BOLT
W/WASHER & NUTS - ONE EACH BOARD
AT EACH POST

**STREET ENDING
IN CUT WHERE
SLOPE NOT
OBTAINABLE**

NOTES:

1. SIDEWALK BARRICADES TO BE ERECTED AT EACH LOCATION WHERE SATISFACTORY PROVISION CAN NOT BE MADE FOR PEDESTRIANS TO CONTINUE BEYOND THE TERMINUS OF A SIDEWALK.
2. ALL EXPOSED SURFACES TO BE PAINTED WITH TWO (2) COATS OF WHITE PAINT CONFORMING TO SECTION 91-3.02 OF STATE SPECIFICATIONS.

* STATE OF CALIF. SPECIFICATION #58-1.02

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

SIDEWALK BARRICADE

H-14

DEPARTMENT OF PUBLIC WORKS

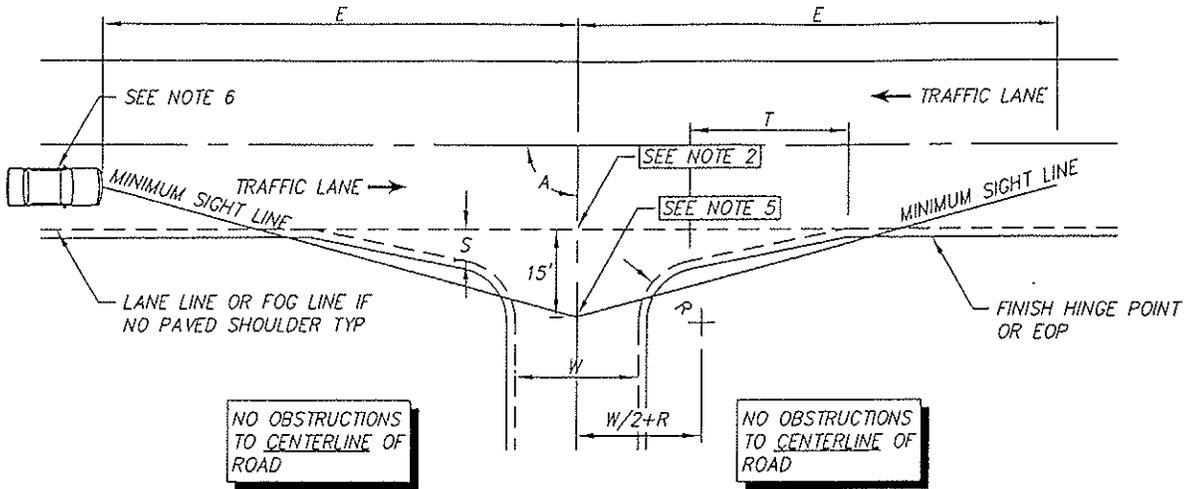

NOTES:

1. INTERSECTING ROW LINES AT ROADWAY CONNECTIONS SHALL BE JOINED BY A 25 FT OR GREATER RADIUS CURVE TO ALLOW FOR ROADWAY IMPROVEMENTS.
2. SETBACK = 15 FT MIN. FROM EDGE OF TRAVELED WAY. THIS ASSUMED 6 FT TO STOP BAR, 1 FT FOR STOP BAR, AND 8 FT FROM THE FRONT OF BUMPER TO THE DRIVER. THIS SETBACK MAY BE REQUIRED TO BE INCREASED UP TO 30 FT DUE TO INTERSECTION LAYOUT.
3. IN BOTH DIRECTIONS OF TRAVEL ALONG THE CROSSROAD, SIGHT DISTANCE (E) IS TO BE MEASURED ALONG THE CROSSROAD CL FOR TWO LANE CROSSROADS, AND ALONG THE CL OF THE NEAREST LANE TO THE ROAD FOR MULTI-LANE ROADS.
4. WHERE RESTRICTIVE CONDITIONS DO NOT ALLOW COMPLIANCE WITH THE SPECIFIED SIGHT DISTANCE REQUIREMENTS, THE ENGINEER MAY APPROVE A REDUCTION OF THE CORNER SIGHT DISTANCE TO THE MINIMUM STOPPING SIGHT DISTANCE AS OUTLINED IN THE CALTRANS HIGHWAY DESIGN MANUAL.
5. DRIVER'S EYE LOCATION ASSUMED TO BE 3.5' ABOVE PAVEMENT.
6. ASSUMED TO BE 4.25' ABOVE THE PAVEMENT.

RESIDENTIAL DESIGN SPEED SERVING LESS THAN 5 LOTS (mph)								
	25	30	35	40	45	50	55	60
A	60' TO 120'							
E	275'	330'	385'	440'	495'	550'	605'	660'
S	3'	3'	3'	3'	4'	4'	5'	5'
R	15'	15'	20'	20'	25'	25'	25'	25'
T	VARIABLE - 25 FT. MIN.							
W	AS APPROVED							

MULTIPLE RESIDENTIAL DESIGN SPEED COMMERCIAL & OR PUBLIC SERVING 5 OR MORE LOTS (mph)								
	25	30	35	40	45	50	55	60
A	80' TO 100'							
E	275'	330'	385'	440'	495'	550'	605'	660'
S	8'	8'	12'	12'	12'	12'	12'	12'
R	25'	30'	35'	40'	45'	50'	50'	50'
T	50'	75'	100'	150'	200'	250'	250'	250'
W	CONFORM TO ROAD SECTION							

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS
 ROADWAY CONNECTIONS
 SHEET 1

H-15

REVISED:

DEPARTMENT OF PUBLIC WORKS

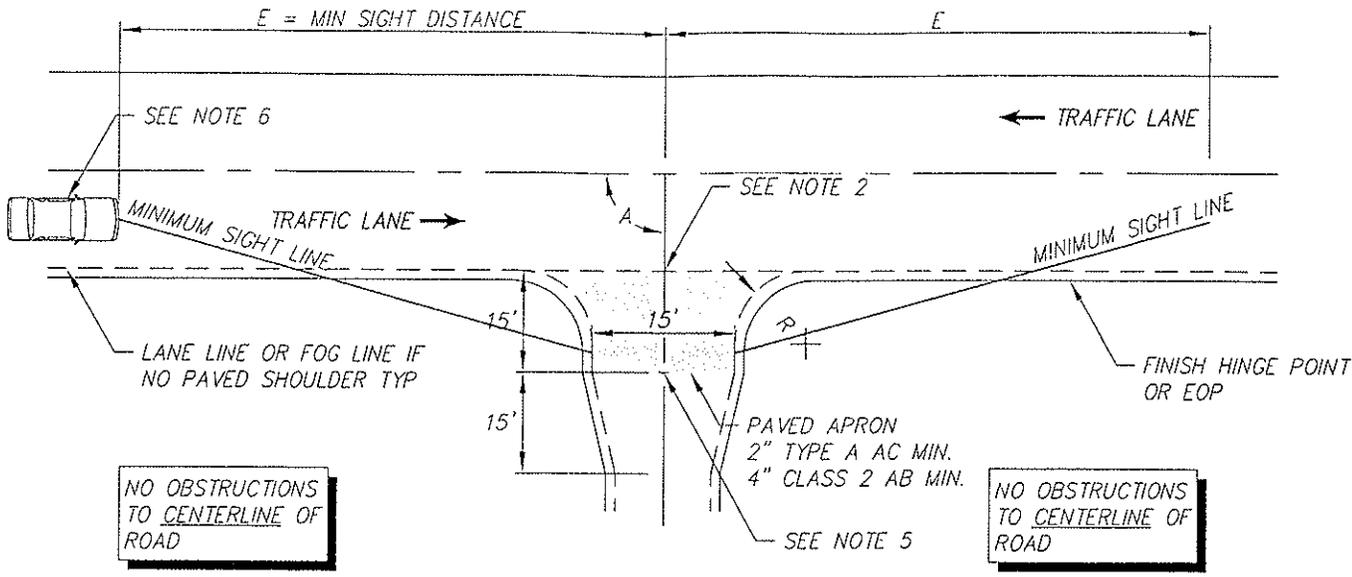

NOTES:

1. THIS PLATE IS ONLY TO BE USED WITH SINGLE RESIDENTIAL DRIVEWAYS CONNECTING TO ROADS WITH DESIGN SPEEDS OF 25 MPH OR LESS. SHARED RESIDENTIAL DRIVEWAYS SHALL BE DESIGNED TO MEET REQUIREMENTS OUTLINED IN SHEET 1. SINGLE RESIDENTIAL DRIVEWAYS CONNECTING TO ROADS WITH DESIGN SPEEDS ABOVE 25 MPH AND ALL OTHER CONNECTING DRIVES AND ROADS SHALL BE DESIGNED TO MEET THE APPLICABLE REQUIREMENTS OF SHEET 1.
2. DRIVER'S EYE LOCATION ASSUMED TO BE 3.5' ABOVE PAVEMENT.
3. ASSUMED TO BE 4.25' ABOVE THE PAVEMENT.

2. SETBACK = 15 FT MIN. FROM EDGE OF TRAVELED WAY. THIS ASSUMED 6 FT TO STOP BAR, 1 FT FOR STOP BAR, AND 8 FT FROM THE FRONT OF BUMPER TO THE DRIVER. THIS SETBACK MAY BE REQUIRED TO BE INCREASED UP TO 30 FT DUE TO INTERSECTION LAYOUT.
3. IN BOTH DIRECTIONS OF TRAVEL ALONG THE CROSSROAD, SIGHT DISTANCE (E) IS TO BE MEASURED ALONG THE CROSSROAD CL FOR TWO LANE CROSSROADS, AND ALONG THE CL OF THE NEAREST LANE TO THE ROAD FOR MULTI-LANE ROADS.
4. THE RETURN RADIUS (R) SHALL BE DESIGNED SUCH THAT EMERGENCY FIRE VEHICLE ACCESS IS PROVIDED FOR BOTH DIRECTIONS WITHOUT REQUIRING THE VEHICLE TO SWING INTO OPPOSING TRAFFIC LANES. THE MINIMUM RADIUS SHALL BE 10 FT.

SINGLE FAMILY RESIDENTIAL DRIVEWAY CONNECTING TO ROADS WITH DESIGN SPEED ≤ 25 mph

A	60' TO 120'
E	200'
R	10 FT MIN - SEE NOTE 4


APPROVED BY:

 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 ROADWAY CONNECTIONS
 SHEET 2
 DEPARTMENT OF PUBLIC WORKS

H-16

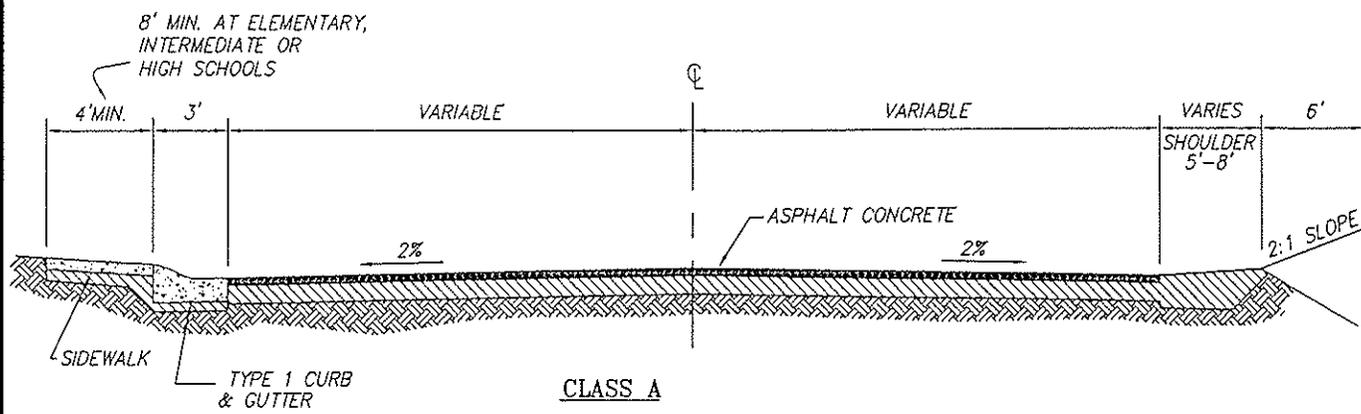


CLASS A
CLASS B


SAME AS CLASS A - EXCEPT SIDEWALKS MAY BE OMITTED

NOTES:

1. DESIGN AND CONSTRUCTION SHALL BE SUBJECT TO THE APPROVAL OF THE PUBLIC WORKS DEPARTMENT.
2. COBBLE TO BE USED IN DITCHES AS SPECIFIED BY TOWN ENGINEER.

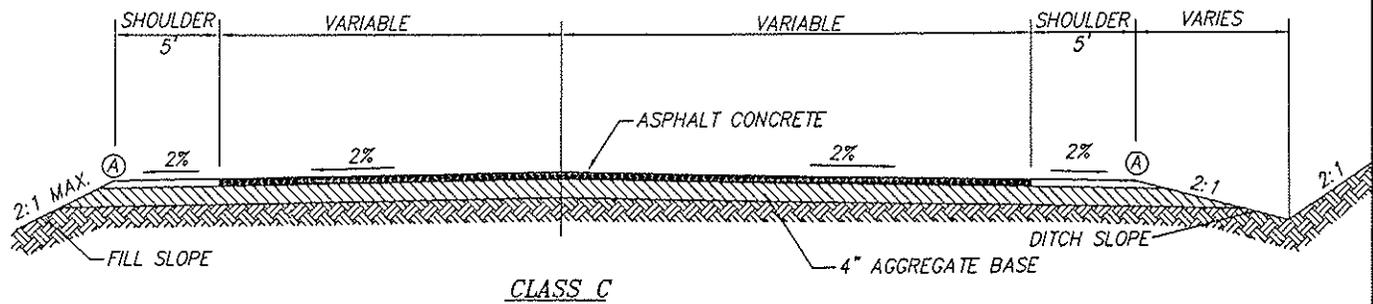

CLASS C

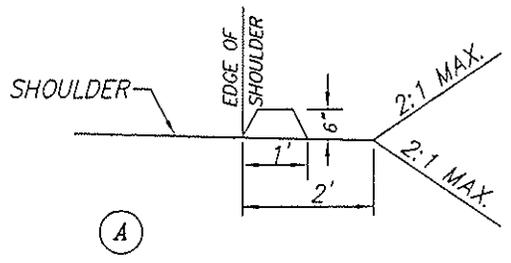


APPROVED BY:
Brian J. Fragia
BRIAN J. FRAGIA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
REVISED:




TOWN OF LOOMIS
STREET CLASSES
"A", "B" & "C"
DEPARTMENT OF PUBLIC WORKS

H-17

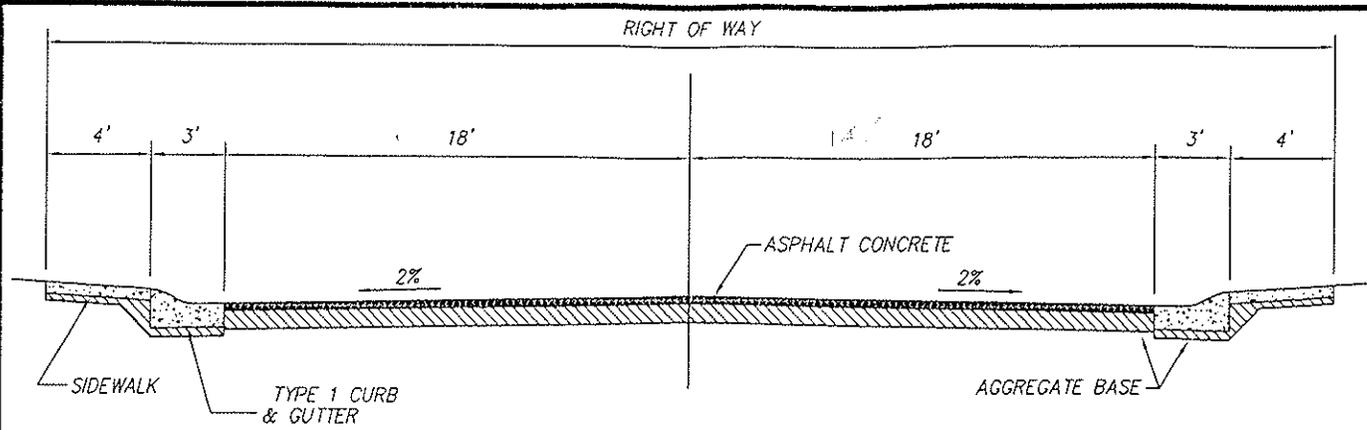


NOTE: TYPE 1 CURB & GUTTER MAY BE USED IN SINGLE FAMILY DEVELOPMENTS

50 FOOT STREET
(MINOR AND PRIMARY RESIDENTIAL)

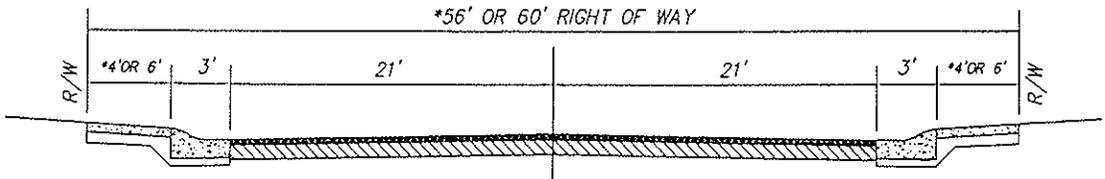


56 OR 60 FOOT STREET
(COLLECTOR INDUSTRIAL/COMMERCIAL)
(NO PARKING/BIKE LANES)

VERTICAL CURB (TYP.)

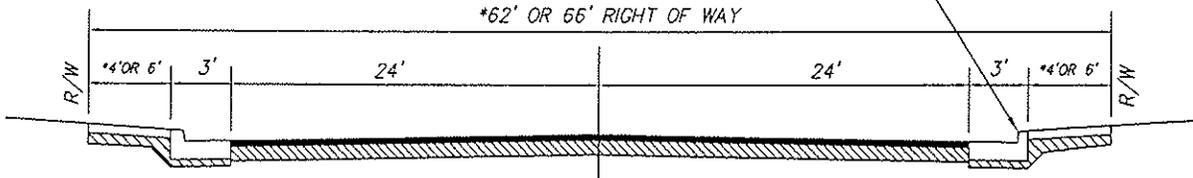

62 OR 66 FOOT STREET
(COLLECTOR INDUSTRIAL/COMMERCIAL)
(2 LANE TWO-WAY LEFT TURN)
(ON STREET PARKING/NO BIKE LANES)

VERTICAL CURB (TYP.)

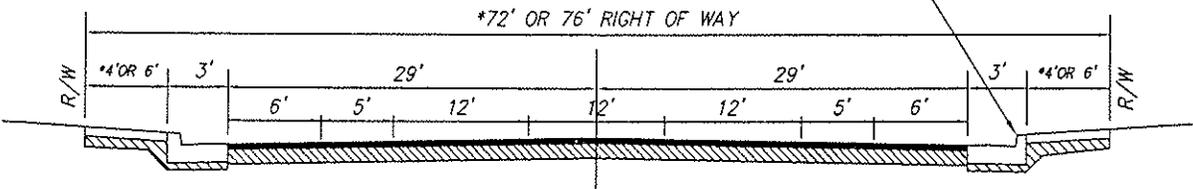

72 OR 76 FOOT STREET
(COLLECTOR APPROACH TO 84 AND 110 FOOT STREETS)
(ON-STREET PARKING AND BIKE LANE)

NOTES:


- *SIDEWALK MAY BE 4' WIDE ONLY IN SINGLE FAMILY & DUPLEX RESIDENTIAL AREAS, AND INDUSTRIAL AREAS.
- VERTICAL CURB (TYPE 2) REQUIRED AS SPECIFIED IN IMPROVEMENT STANDARDS

APPROVED BY:
Brian J. Fraga
BRIAN J. FRAGA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
REVISED:




TOWN OF LOOMIS
TYPICAL SECTIONS:
RESIDENTIAL STREETS
COLLECTOR STREETS
INDUSTRIAL & COMMERCIAL
DEPARTMENT OF PUBLIC WORKS

H-18

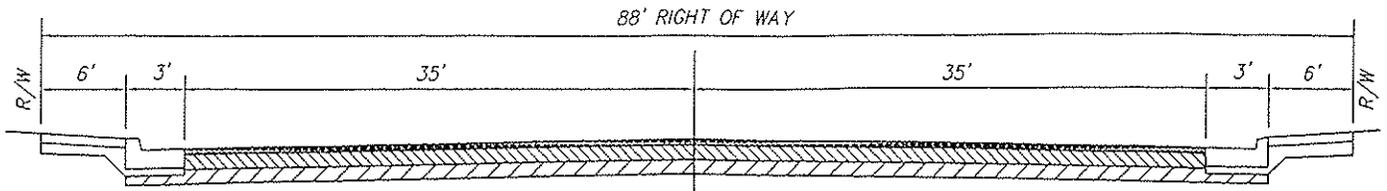


88 FOOT STREET
 (MINOR ARTERIAL)
 (4 LANE - ADD 12' FOR ON-STREET PARKING)
 (ADD 12' FOR EACH ACCEL/DECEL LANE)

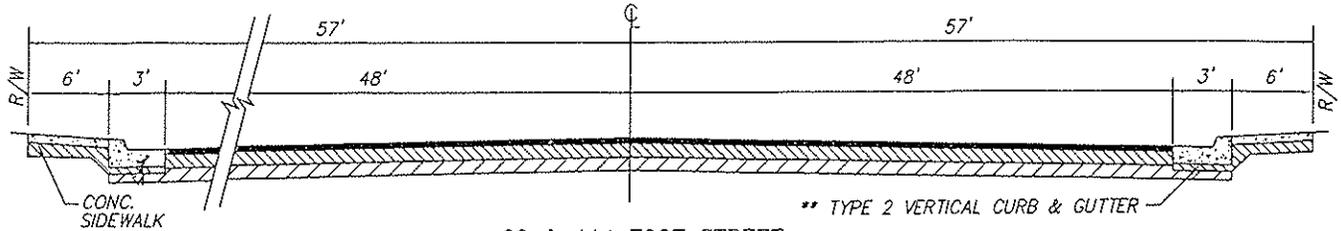


90 & 114 FOOT STREET
 (MAJOR/MINOR ARTERIAL)

** TYPE 2 CURB & GUTTER REQUIRED AS SPECIFIED IN IMPROVEMENT STANDARDS

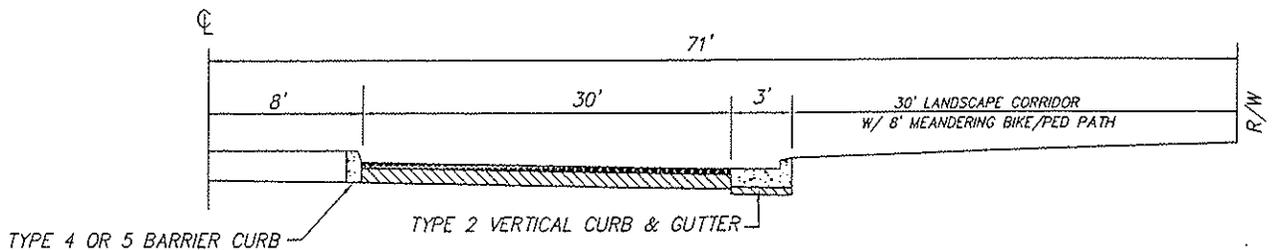

142 FOOT LANDSCAPED STREET (HALF SECTION)
 (MAJOR ARTERIAL)

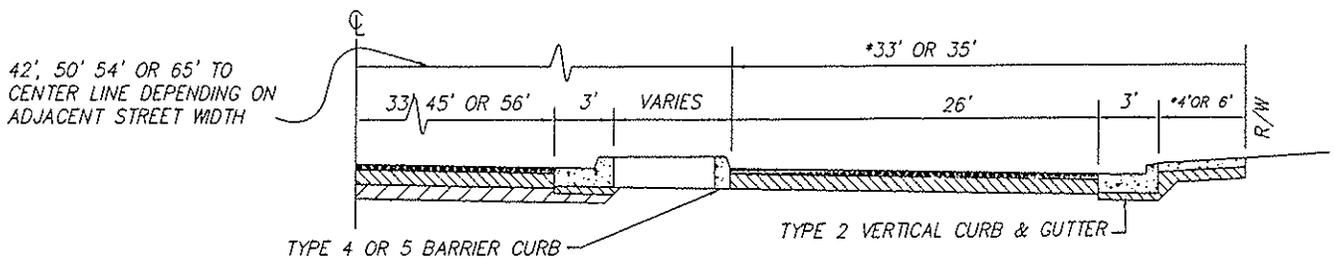

FRONTAGE ROAD

NOTES:

1. *SIDEWALK MAY BE 4' WIDE ONLY IN SINGLE FAMILY & DUPLEX RESIDENTIAL AREAS ONLY.
2. R/W TO BE MOVED BACK OF CURB FOR MEANDERING SIDEWALKS.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS


TYPICAL SECTIONS
 ARTERIAL & FRONTAGE RD.

DEPARTMENT OF PUBLIC WORKS

H-19

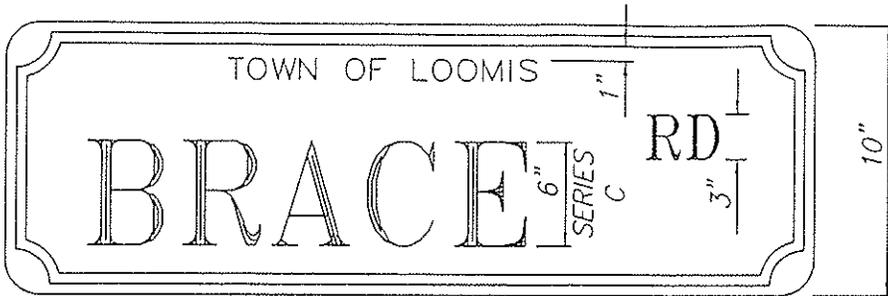

STREET NAME SIGN DETAIL

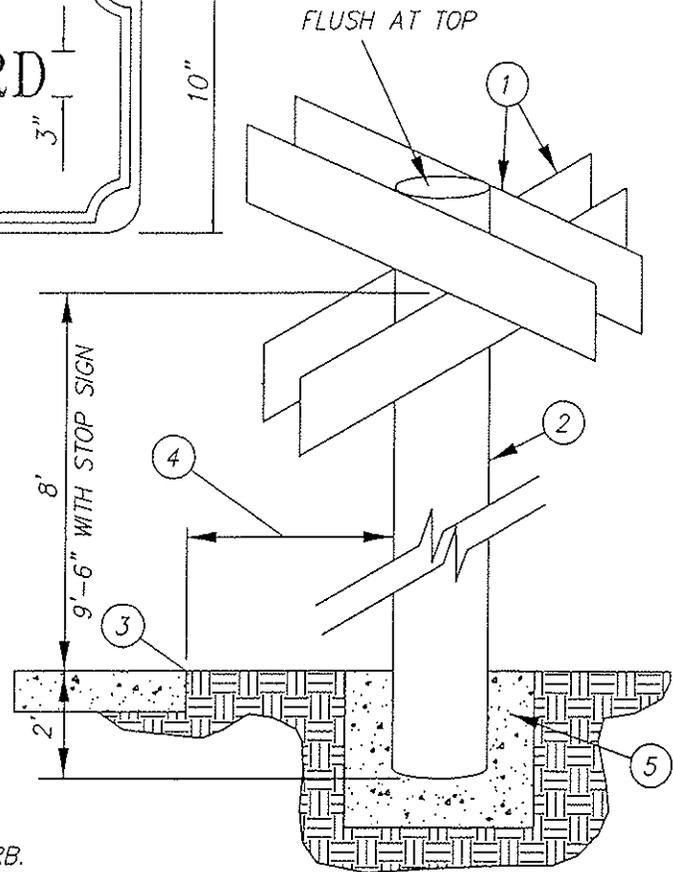

NOTES:

1. STREET NAME SIGNS.
2. 2" GALVANIZED STEEL PIPE.
3. BACK OF SIDEWALK
4. 18 INCHES BACK OF WALK, 24 INCHES BACK OF CURB.
5. TWO SACK CONCRETE IN POST HOLE.
6. BLANK: EIGHT INCH HIGH, 0.080 GAUGE ALUMINUM, 24, 30 OR 36 INCHES LONG.
FINISH: REFLECTORIZED, BLUE, HIGH INTENSITY BACKGROUND, SHEETED WITH, 3M ELECTRONIC CUTABLE WHITE FILM (OR AS APPROVED EQUAL BY THE ENGINEER), SIGN ATTACHMENT: (2) $\frac{5}{16}$ INCH GALVANIZED MACHINE BOLTS/NUTS (THROUGH POST).
7. UPPER AND LOWER CASE LETTERS, SIX INCHES HIGH, THESE AND ALL TEXT ON THIS SIGN SHALL BE HIGH INTENSITY WHITE.
8. BLOCK NUMBER, $1\frac{3}{4}$ INCHES HIGH, SERIES C, HIGHWAY FONT.
9. ST, AVE, CT, WY, CIRCLE, DR, ETC., TWO INCH UPPER CASE SERIES C, HIGHWAY FONT.
10. ARROW, $1\frac{3}{4}$ INCHES BY VARIABLE LENGTH, HIGHWAY FONT.
11. BLANK: TEN INCHES HIGH, 0.080 GAUGE ALUMINUM, 24, 30, OR 36 INCHES LONG, FINISH: BLUE REFLECTIVE BACKGROUND. ALL BACKGROUND AND TEXT ON THIS SIGN SHALL BE ENGINEER GRADE REFLECTIVE, ATTACHMENT: (2) $\frac{5}{16}$ INCH GALVANIZED MACHINE BOLTS WITH NUTS (THROUGH POST). IN THE EVENT THE STREET NAME IS TOO LONG FOR THE SIGN, SERIES B TEXT SHALL BE USED IN LIEU OF SERIES C.
12. FOUR INCH HIGH, SERIES C, UPPER CASE LETTERS, HIGHWAY FONT.
13. TWO INCH HIGH, SERIES C, UPPER CASE LETTERS, HIGHWAY FONT.

NOTE:

POST AND MOUNTING REQUIREMENTS FOR ALL OTHER TRAFFIC SIGNS SHALL BE THE SAME AS ABOVE UNLESS OTHERWISE SPECIFIED ON THE APPROVED PLANS. STREET LIGHT MASTS MAY BE USED IN LIEU OF POSTS UPON THE APPROVAL OF THE TOWN ENGINEER.

APPROVED BY:

Brian J. Fraciao
 BRIAN J. FRACIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS

STREET SIGN NAME

H-20


REVISED:

DEPARTMENT OF PUBLIC WORKS

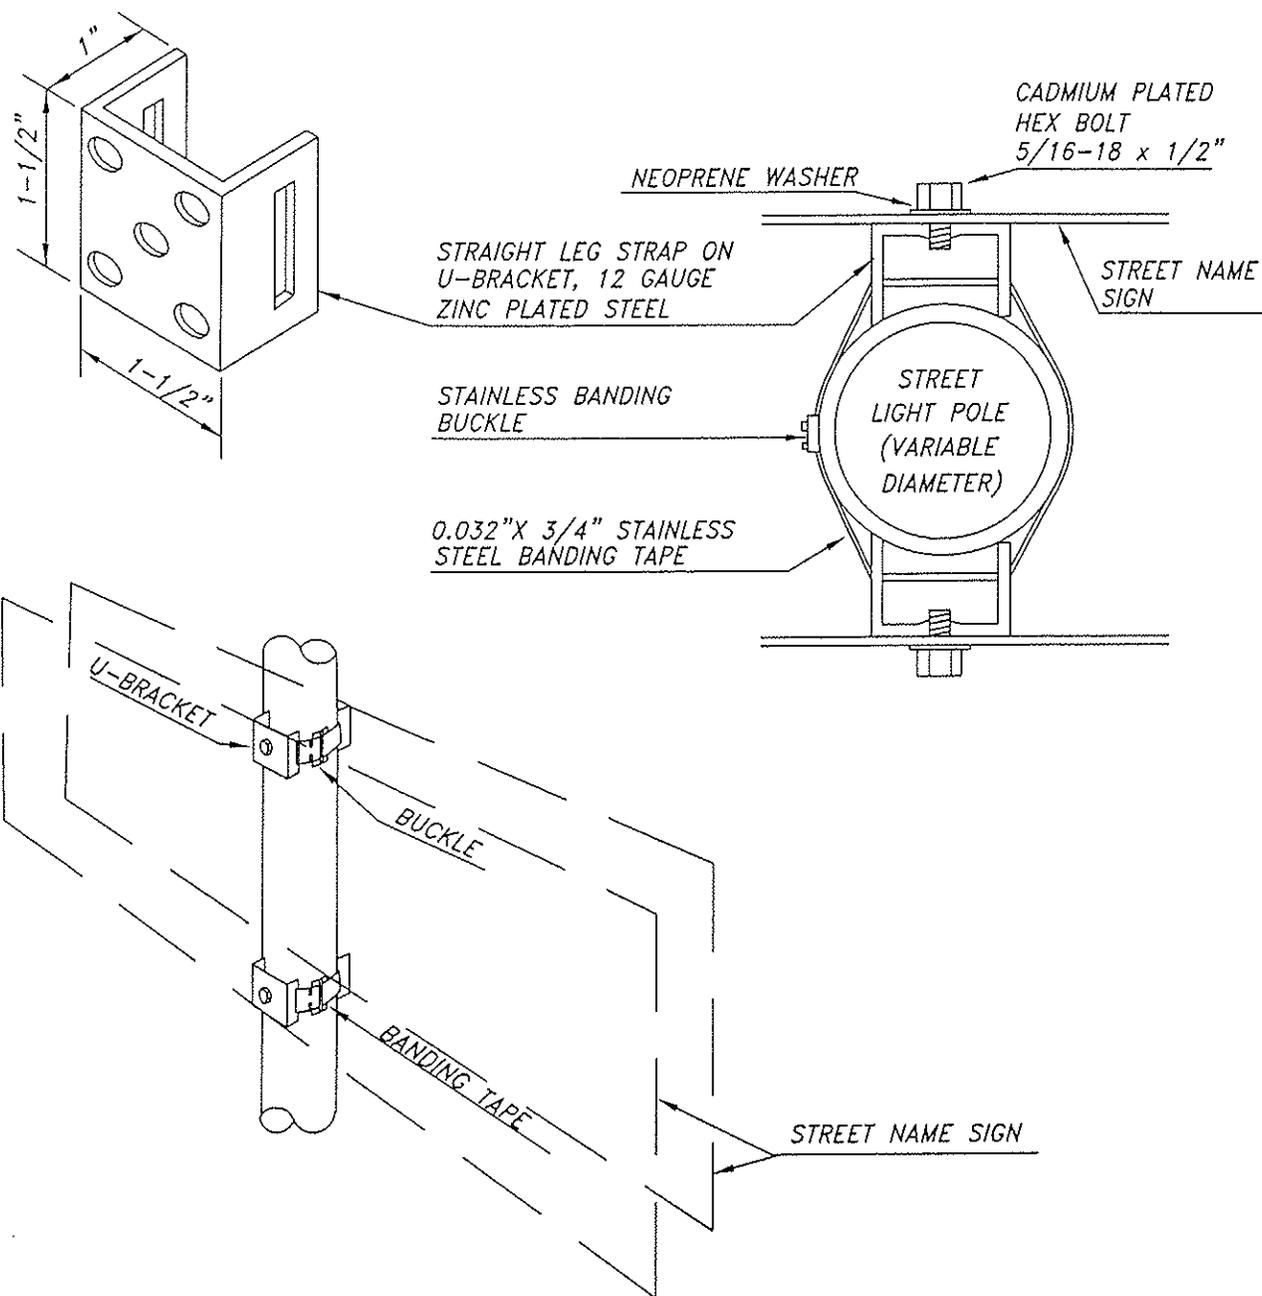

NOTE: DETAIL SHOWN IS FOR TWO SIGN INSTALLATION. FOUR SIGN INSTALLATION MAY BE MADE, WHERE APPLICABLE, BY FASTENING A SECOND PAIR OF SIGNS IN THE SAME MANNER.

STANDARD CLEARANCE TO BOTTOM OF LOWEST SIGN IS 7 FEET.

APPROVED BY:

 BRIAN J. FRACIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 STREET NAME SIGN
 INSTALLATION
 ON STREET LIGHT POLE
 DEPARTMENT OF PUBLIC WORKS

H-21

2-WAY ASSEMBLY

(USE W/ 2 STREET BLADES SINGLE FACED)

- (1) CAP 2" SINGLE FACE 2-WAY
- (1) 2-WAY ROD 6" BLADE (7 1/2")
- (1) 2-WAY ROD 8" BLADE (9 1/2")
- (2) SINGLE FACE PLAIN SEPARATOR
- (1) DOME NUT FOR SINGLE FACE
- (2) 3/16" X 1/2" SIGN END BOLT SET

4-WAY ASSEMBLY

(USE W/ 4 STREET BLADES SIGLE FACED)


- (1) CAP 2" SINGLE FACE 2-WAY
- (1) 4-WAY ROD 6" BLADE (13 1/2")
- (1) 4-WAY ROD 8" BLADE (17 1/2")
- (1) 4-WAY ROD 9" BLADE (19 1/2")
- (2) SINGLE FACE PLAIN SEPARATOR
- (2) SINGLE FACE LOCKING SEPARATOR
- (1) DOME NUT FOR SINGLE FACE
- (4) 3/16" X 1/2" SIGN END BOLT SET

ADDITIONAL HARDWARE

THEFT PROOF 1/2" CAP NUT FOR CENTER ROD.

STYLE 556

CAP FOR 2" OR 2 1/2" STD. PIPE
SPECIFY CENTER HOLE TAPPED OR
UNTAPPED.

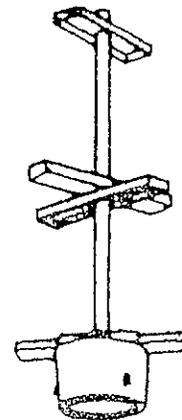

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS

STREET SIGN ASSEMBLY


H-22

REVISED:

DEPARTMENT OF PUBLIC WORKS

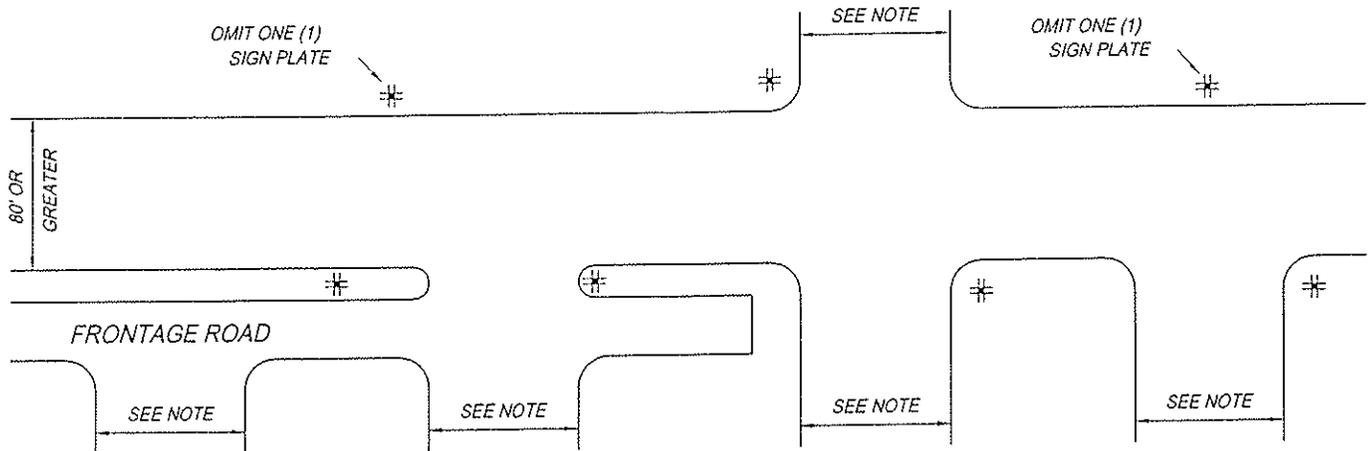

STREETS HAVING 80' OR GREATER R/W WIDTH

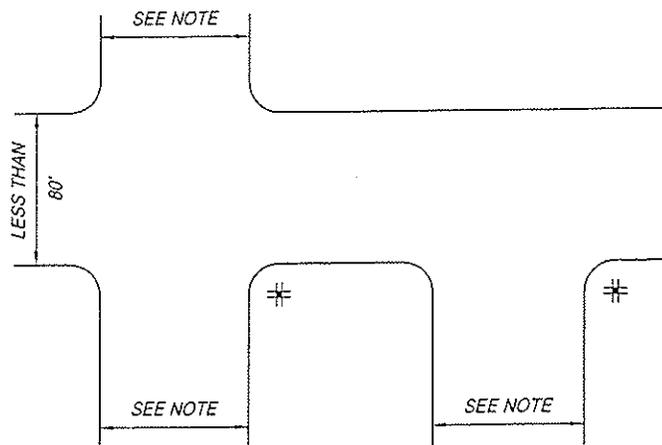

STREETS HAVING LESS THAN 80' R/W WIDTH

LEGEND:

⊕ STANDARD STREET NAME SIGN INSTALLATION. FOUR (4) SIGN PLATES ON 1-3/4" x 1-3/4" UNISTRUT POST, 4x4 POST OR ON STREET LIGHT POLE.

NOTE: INTERSECTING STREETS WITH EQUAL OR LESSER RW WIDTH

APPROVED BY:

Brian J. Fraglio

BRIAN J. FRAGLIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS
STREET NAME
SIGN PLACEMENT
DETAILS

DEPARTMENT OF PUBLIC WORKS

H-23

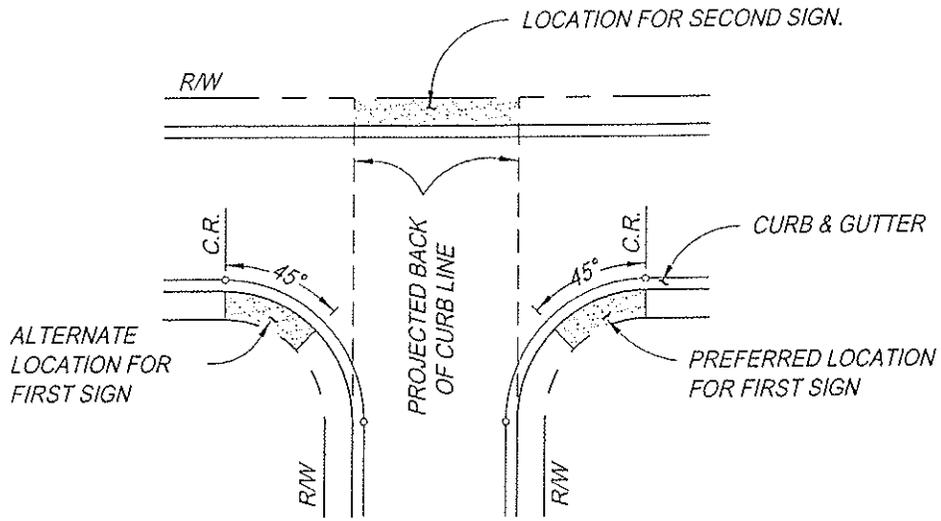

NOTE: STREET NAME SIGNS MAY BE INSTALLED ON STREET LIGHT POLES WHEN THEY ARE LOCATED WITHIN THE LIMITS DEFINED ON THIS DETAIL.

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO,
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS
STREET NAME
SIGN PLACEMENT
ON STREET LIGHT
DEPARTMENT OF PUBLIC WORKS

H-24


RADI REQUIREMENTS

STREET R/W WIDTH	(R)	(T)
50'	50'	50'
56'	50'	50'
62'	65'	65'
72'	75'	75'

R/W LINE & BACK OF SIDEWALK

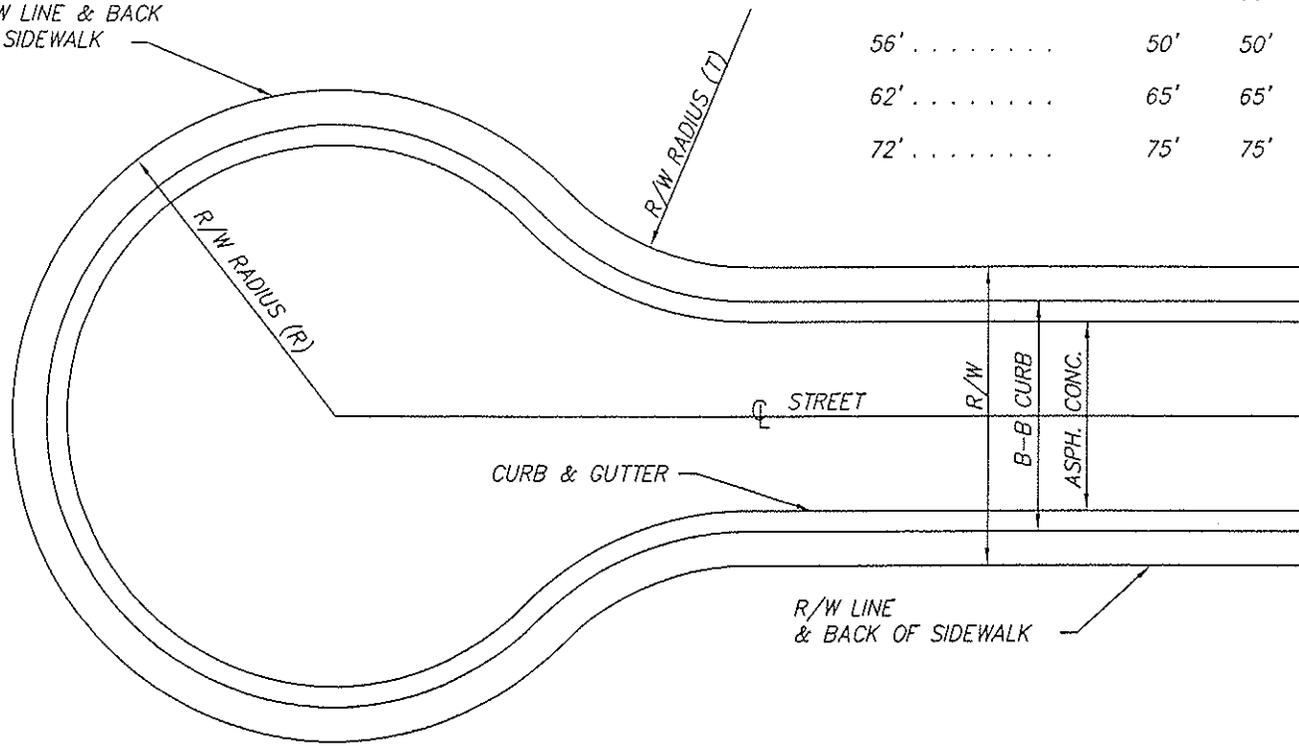


NOTE: A STANDARD CODE W53 (NOT A THROUGH STREET) SIGN IS TO BE POSTED AT THE ENTRANCE TO ALL CUL-DE-SACS GREATER THAN 500' IN LENGTH

APPROVED BY:

 BRIAN J. FRACIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 CUL-DE-SAC DETAILS
 DEPARTMENT OF PUBLIC WORKS

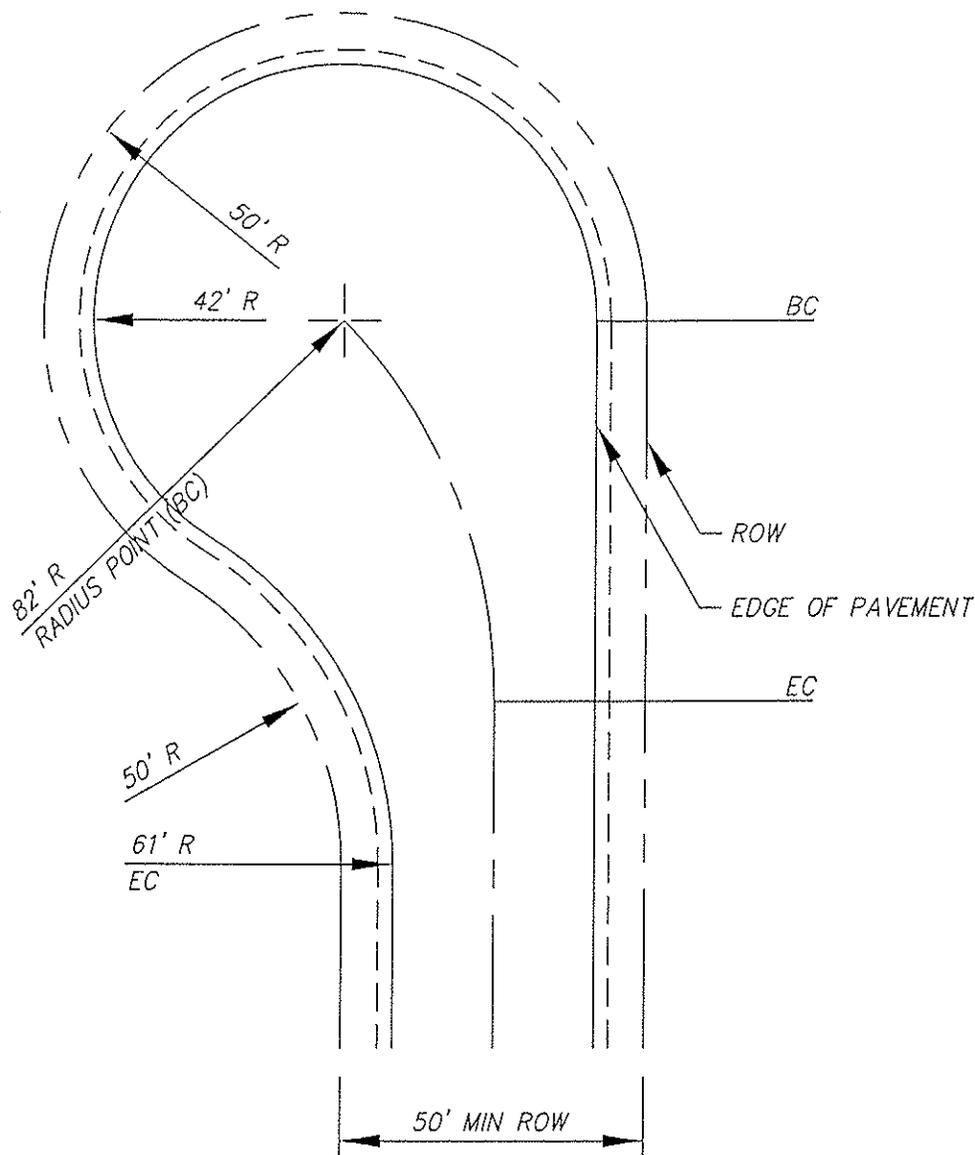H-25




NOTE:
 COMMERCIAL AND INDUSTRIAL
 APPLICATIONS WILL REQUIRE A
 SPECIAL DESIGN APPROVED BY
 THE ENGINEER.

PROVED BY:
Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 OFFSET CUL-DE-SAC
 BULB
 DEPARTMENT OF PUBLIC WORKS

H-26

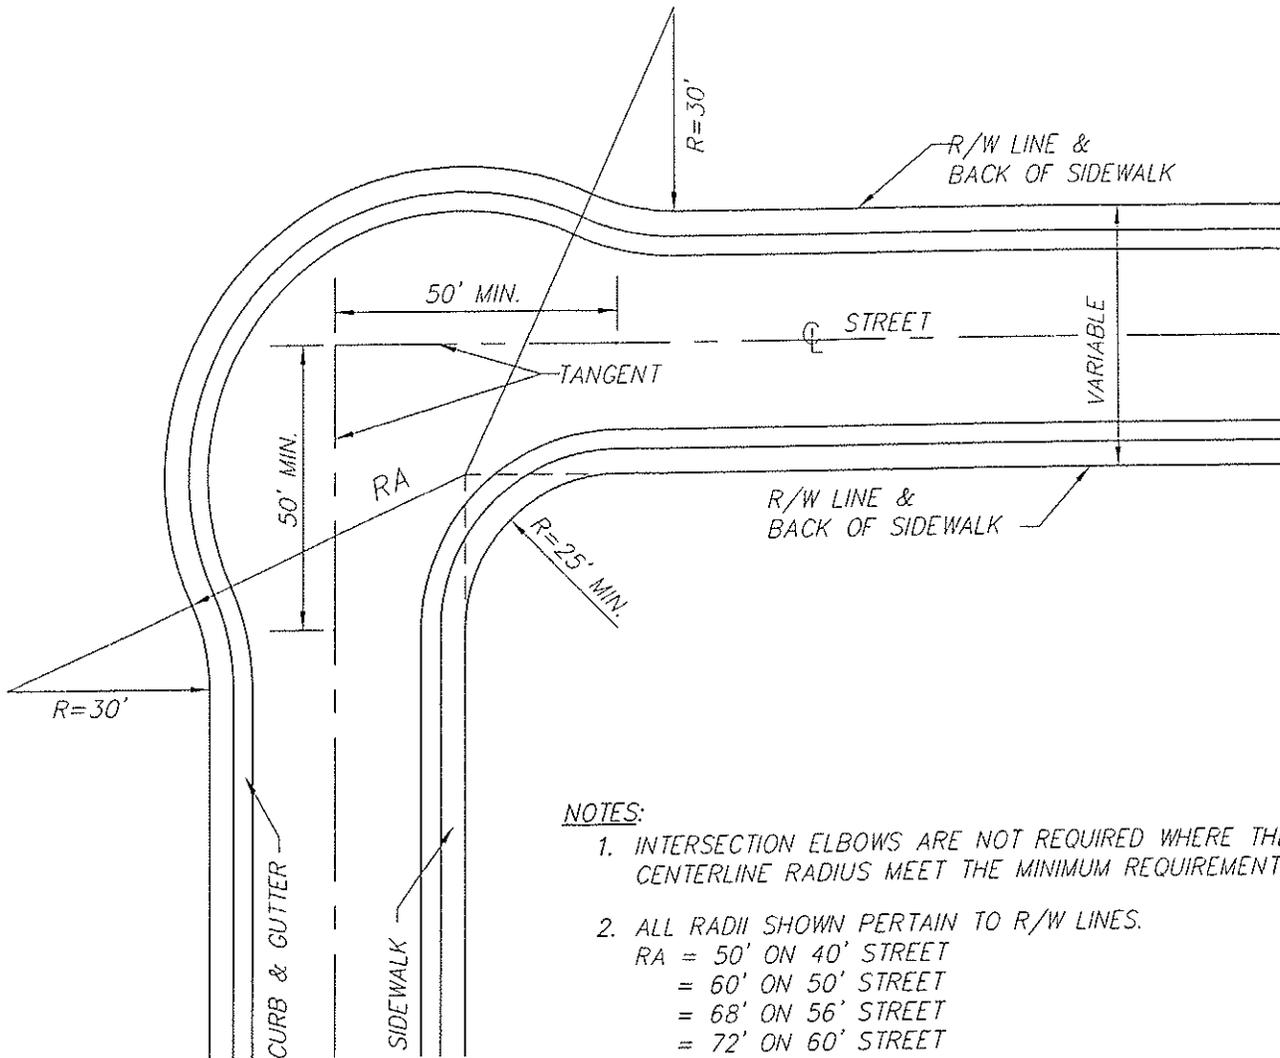

NOTES:

1. INTERSECTION ELBOWS ARE NOT REQUIRED WHERE THE CENTERLINE RADIUS MEET THE MINIMUM REQUIREMENTS
2. ALL RADII SHOWN PERTAIN TO R/W LINES.
 RA = 50' ON 40' STREET
 = 60' ON 50' STREET
 = 68' ON 56' STREET
 = 72' ON 60' STREET
3. A MINIMUM OF 50' OF TANGENT IS REQUIRED FROM THE POINT OF INTERSECTIONS OF THE CENTERLINES.
4. INTERSECTION ANGLE SHALL BE 90° ± 5° EXCEPT AS APPROVED BY TOWN ENGINEER.

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO,
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS
90° INTERSECTION
ELBOW

DEPARTMENT OF PUBLIC WORKS

H-27

A STANDARD 24"x24"
 CODE W31 (END) SIGN &
 A STANDARD 18"x18" RED
 TYPE N MARKER SHALL BE
 INSTALLED AT THE END
 OF THE HAMMER-HEAD.
 (SEE SECTION 4-24)

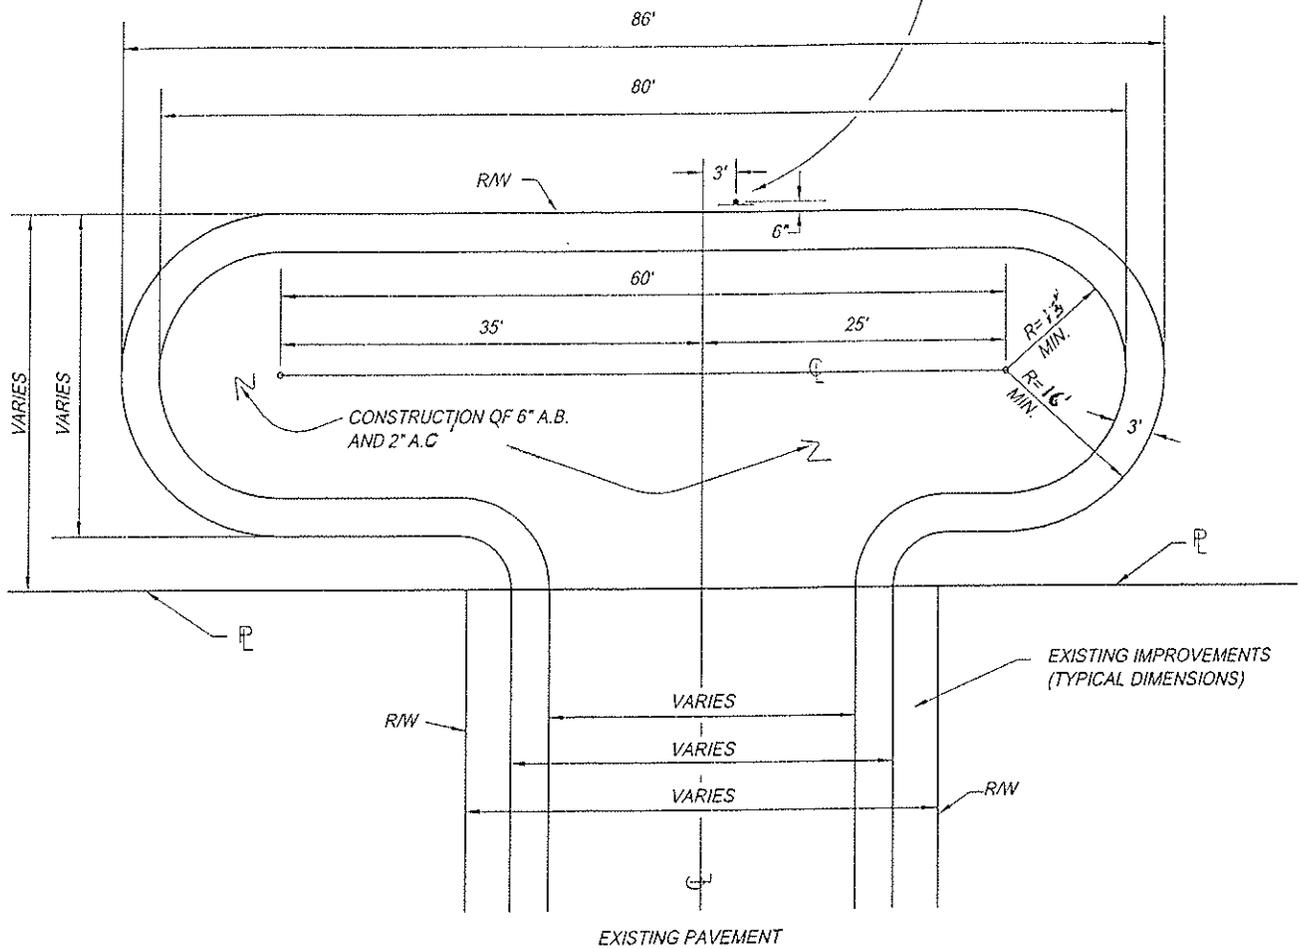

NOTES:

1. HAMMER-HEAD DESIGN USED WHERE TEMPORARY CUL-DE-SAC CAN NOT BE CONSTRUCTED.
2. OTHER HAMMER-HEAD DESIGN USED TO BE APPROVED BY TOWN ENGINEER.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS
 HAMMER-HEAD
 DESIGN

DEPARTMENT OF PUBLIC WORKS

H-28

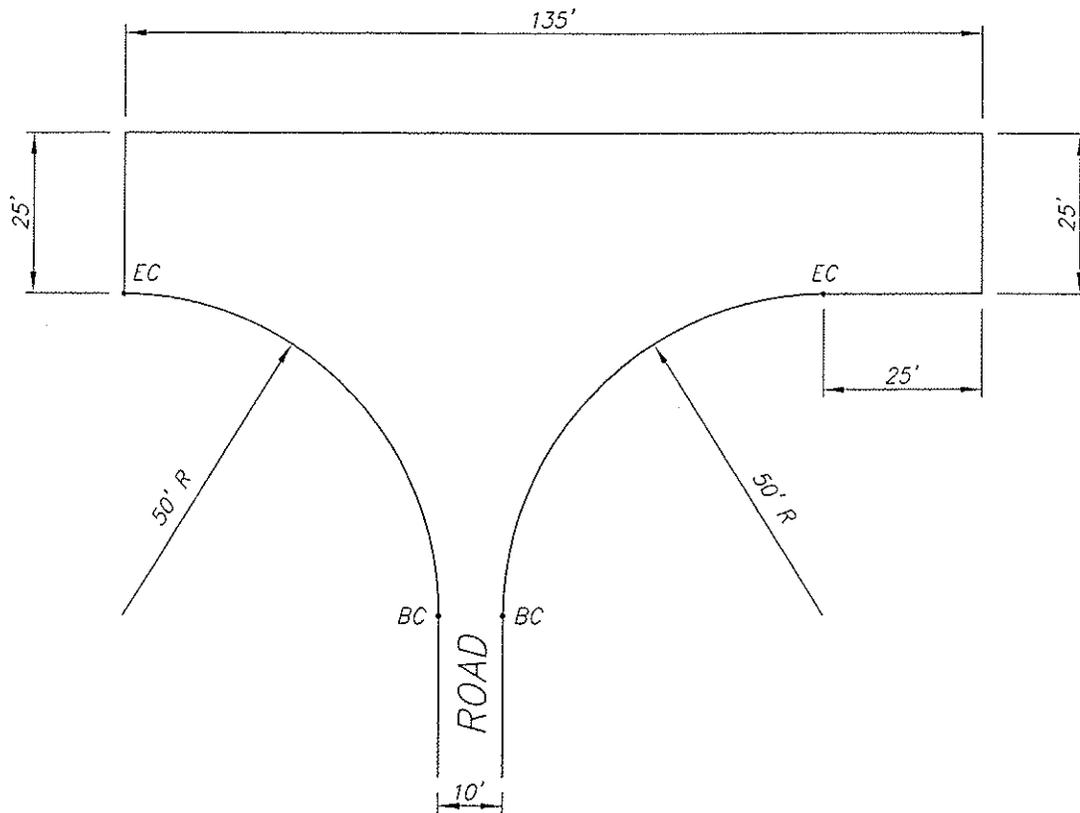

ORIENTATION 1

APPROVED BY:

Brian J. Fragio


BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
ACCESS ROAD
HAMMERHEAD
FOR UTILITY TRUCKS
DEPARTMENT OF PUBLIC WORKS

H-29

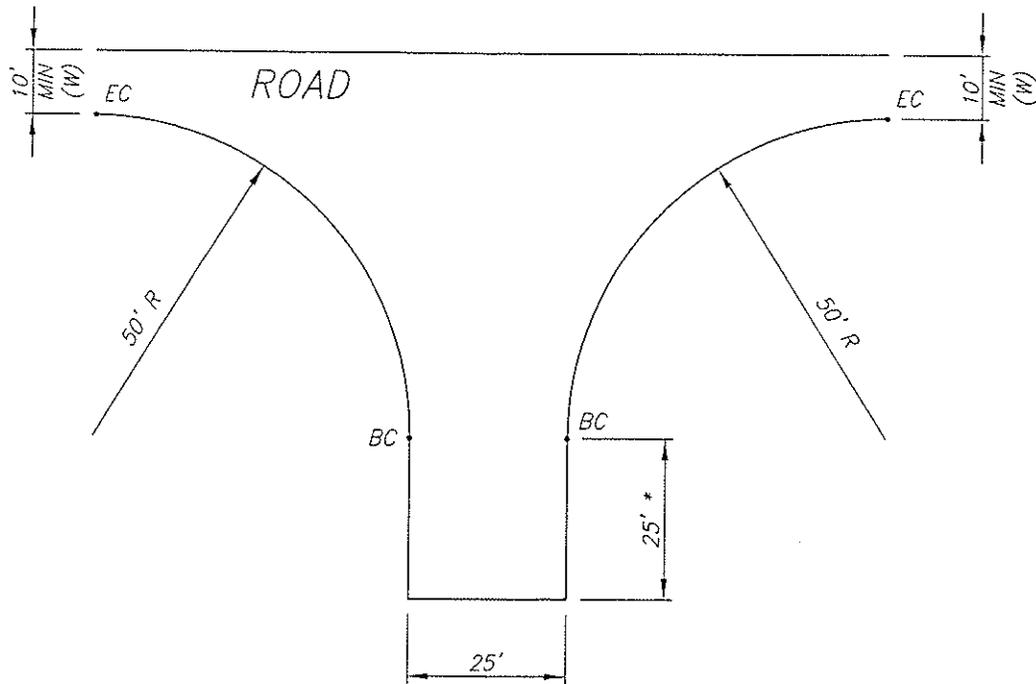

ORIENTATION 2

* FOR ROADS WHERE $W > 10'$,
THIS DIMENSION MAY BE REDUCED
BY $W-10'$ MAX REDUCTION IS $25'$

APPROVED BY:

Brian Fragio


BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS
ACCESS ROAD
HAMMERHEAD
FOR UTILITY TRUCKS
DEPARTMENT OF PUBLIC WORKS

H-30

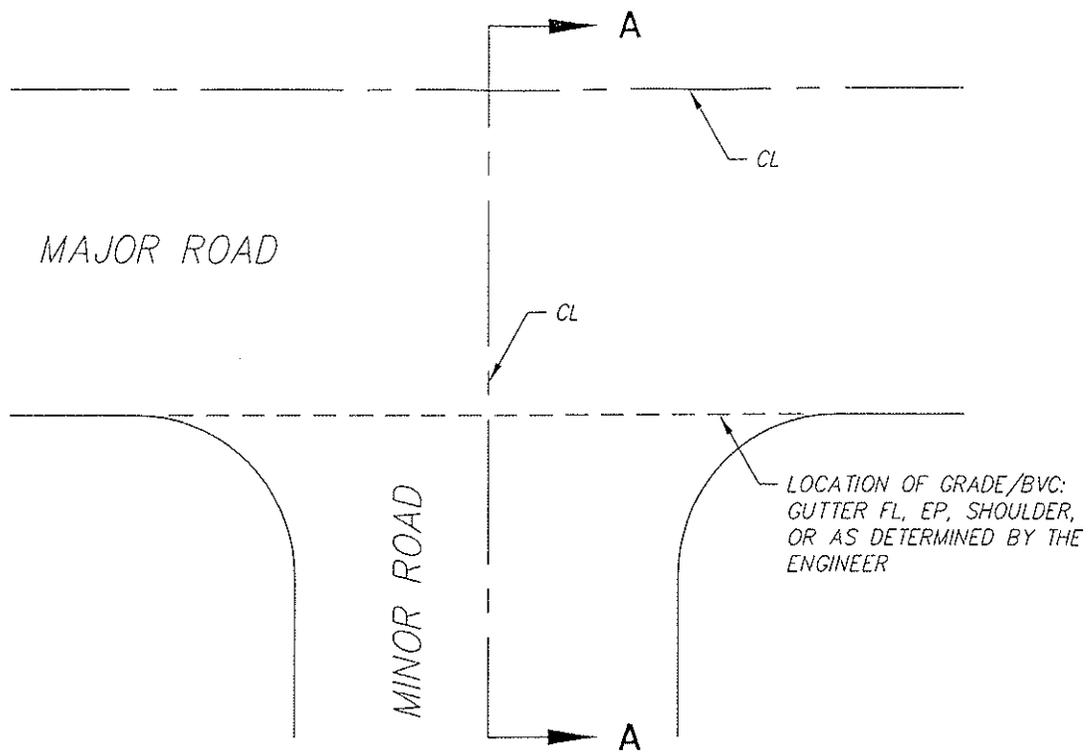

PLAN VIEW

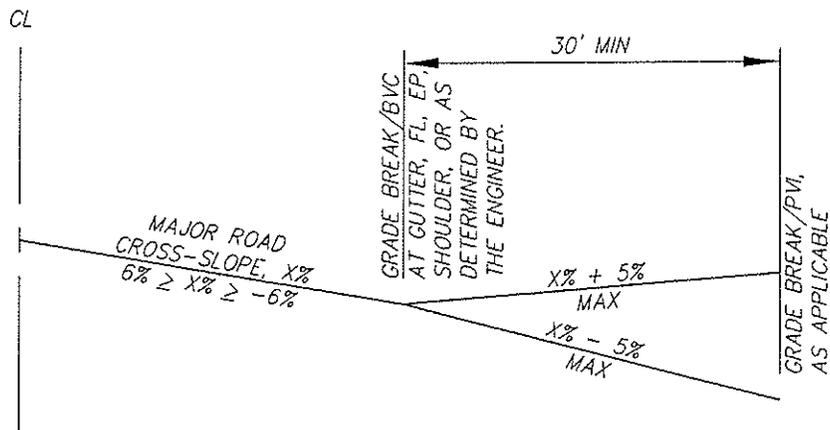

SECTION A-A

NOTE:

GRADE BREAK LOCATION SHALL BE OUTSIDE OF TRAVELED WAY OF MAJOR ROAD

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

**GEOMETRICS & PROFILES
 AT ROAD INTERSECTIONS**

DEPARTMENT OF PUBLIC WORKS

H-31

<u>FRONTAGE</u> (EACH STREET)	<u>MAXIMUM NUMBER OF</u> <u>DRIVEWAYS</u>
45' TO 99'	ONE STD. DRIVEWAY
100' TO 400'	TWO STD. DRIVEWAYS
OVER 400'	TWO DRIVEWAYS OR MEET APPROVAL OF THE DIRECTOR

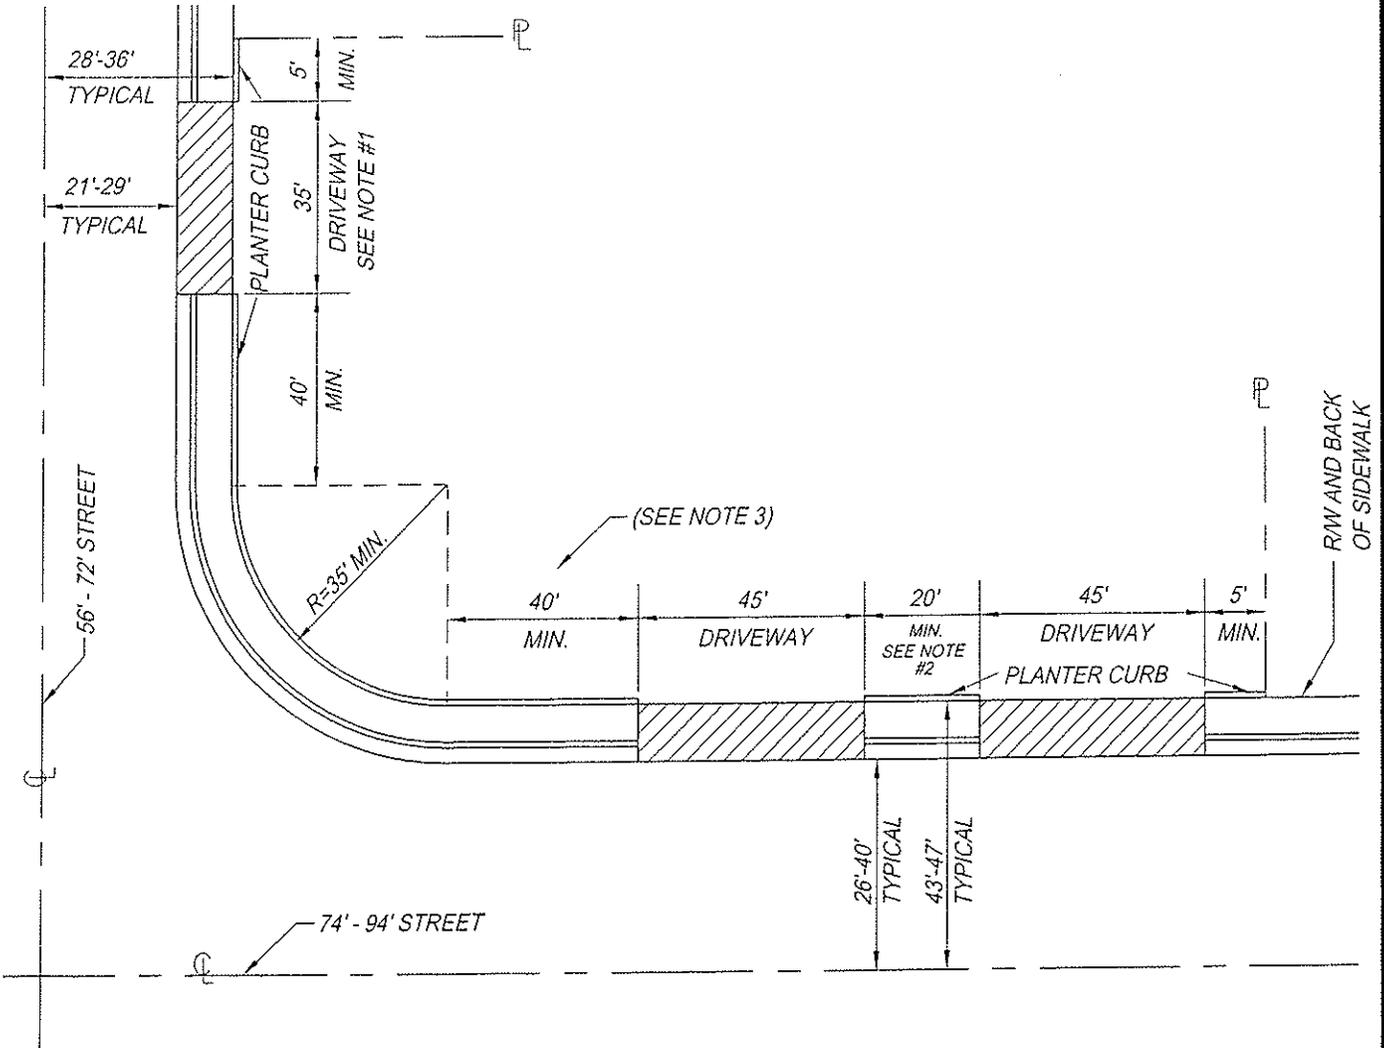

NOTES:

1. 25' TO 35' WIDTH DRIVEWAYS MAY BE APPROVED ON 56 TO 72 FOOT STREETS.
2. 20' MINIMUM ALLOWABLE DISTANCE BETWEEN DRIVEWAYS FOR LESS THAN 200' FRONTAGE AND 40' MINIMUM ALLOWABLE DISTANCE BETWEEN DRIVEWAYS FOR FRONTAGES OF 200' AND OVER.
3. ALL EXCEPTIONS TO THIS STANDARD MUST BE APPROVED BY THE TOWN ENGINEER.

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:




TOWN OF LOOMIS
COMMERCIAL FRONTAGE
AND
DRIVEWAY REGULATIONS
DEPARTMENT OF PUBLIC WORKS

H-32


BUS TURNOUT ON 94 THRU 130 FOOT STREETS

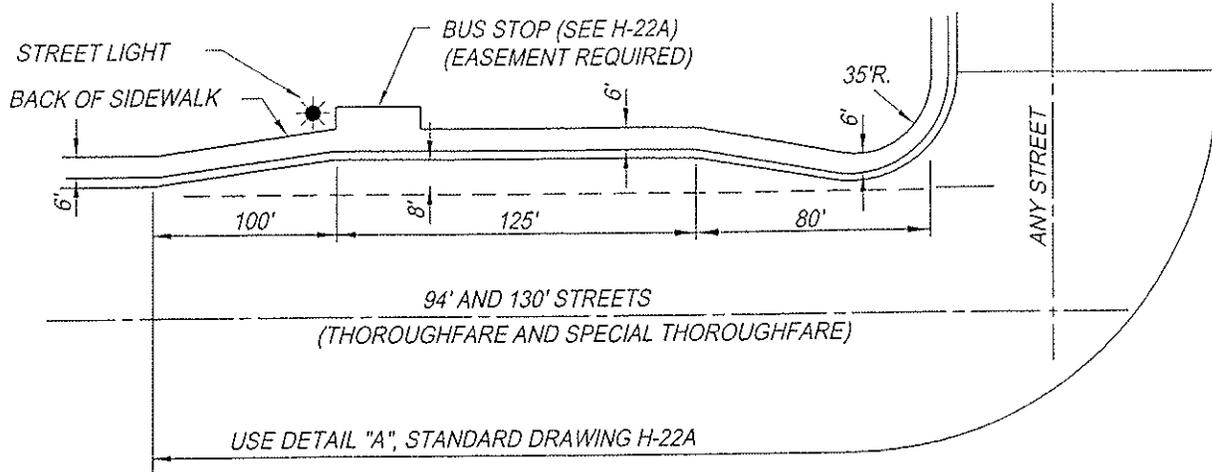

BUS TURNOUT ON 84 FOOT STREETS OR LESS

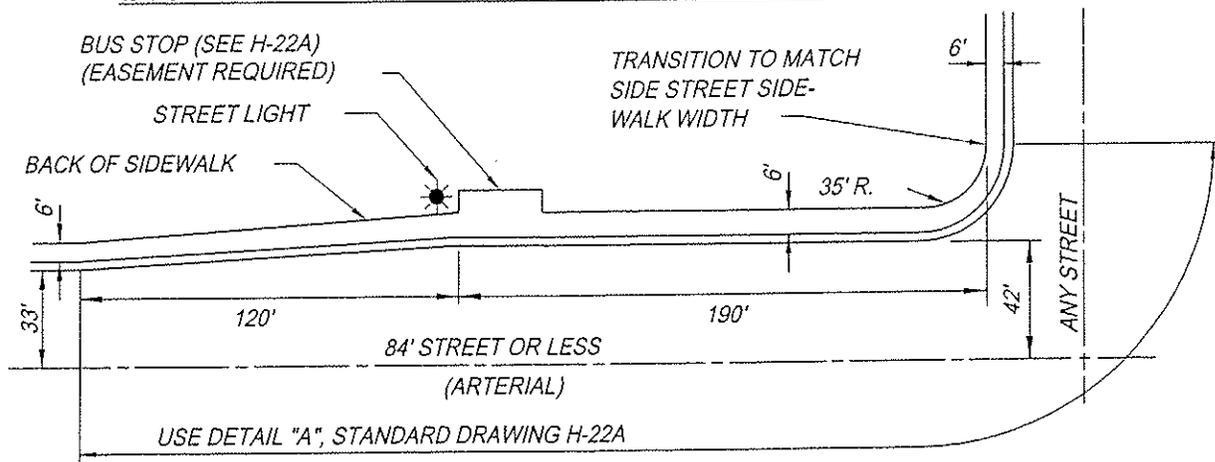

TYPICAL MID-BLOCK BUS TURNOUT

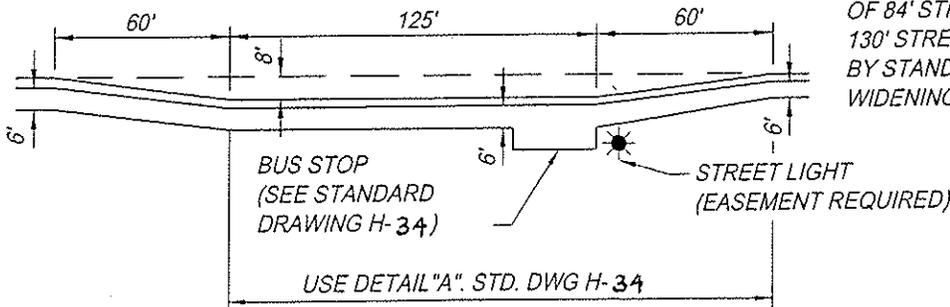

NOTES:

1. BUS STOPS AT INTERSECTIONS OF 84' STREETS, 110' STREETS & 130' STREETS ARE PROVIDED FOR BY STANDARD INTERSECTION WIDENING. SEE DWG H-23

NOTES (CONT.)

2. THE DIMENSIONS SHOWN ARE MINIMUM STANDARDS. THE DIRECTOR MAY DETERMINE LONGER WIDENING TO BE NECESSARY AT CERTAIN SPECIAL CASES OR IMPORTANT INTERSECTIONS WHERE DOCUMENTATION WAS MADE PRIOR TO SUBMITTAL OF PLANS.

APPROVED BY:

Brian J. Fragaio

BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:





TOWN OF LOOMIS

BUS TURNOUT DETAILS

DEPARTMENT OF PUBLIC WORKS

H-33

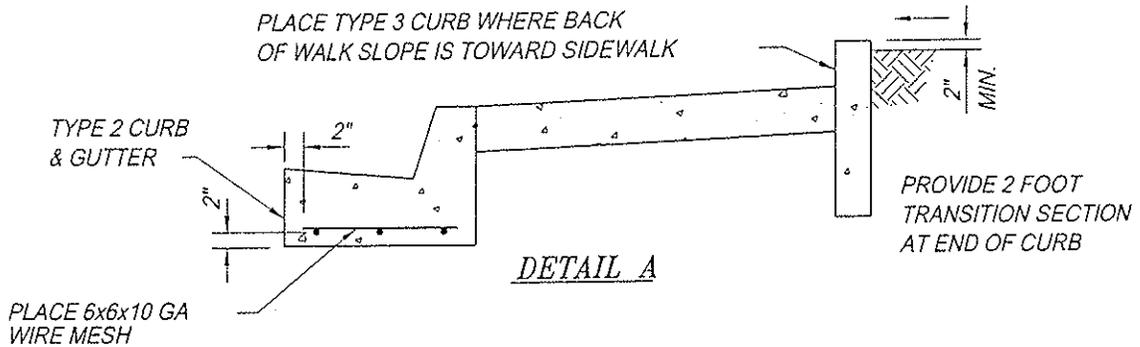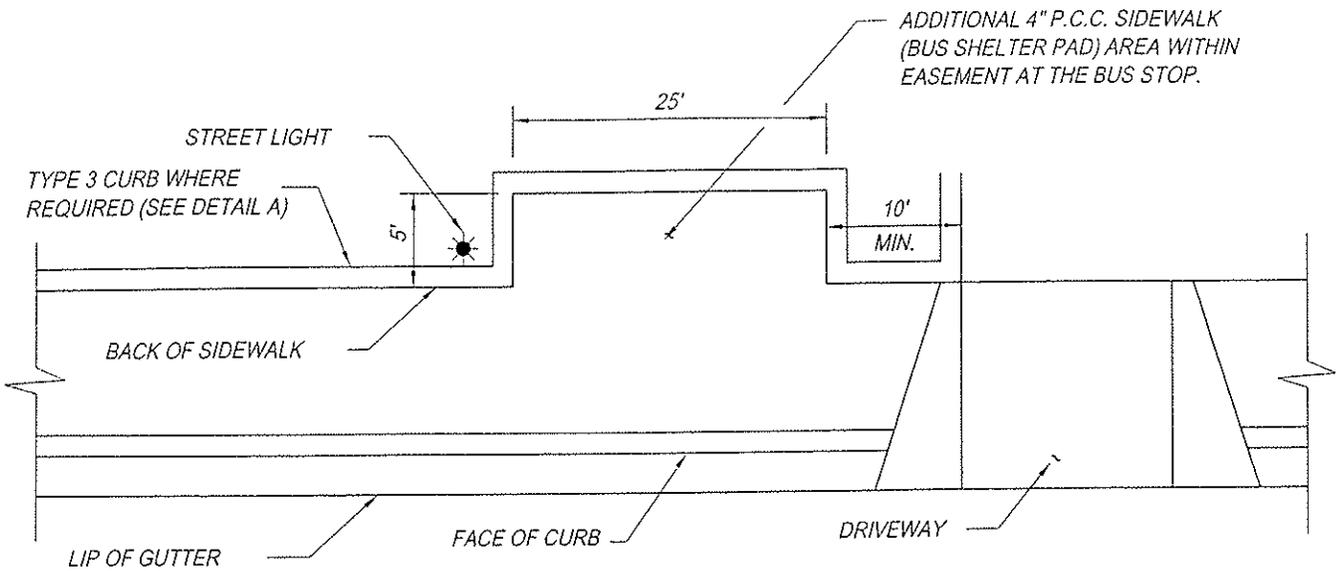

NOTES:

1. DETAIL 'A' SECTION SHALL BE USED FOR 100 FEET EACH SIDE OF BUS STOPS WITHOUT TURNOUTS. THE WIRE MESH REINFORCING STEEL SHALL BE CONTINUED ACROSS ANY DRIVEWAYS WITHIN THE 100 FOOT DISTANCE FROM THE BUS STOP.
2. SEE STANDARD DRAWING H-22 FOR APPLICATIONS OF DETAIL 'A' AT BUS STOP TURNOUTS.
3. PLACE UNDER-SIDEWALK DRAINS (STD. DWGS H-) AT ALL BEHIND-SIDEWALK DRAINAGE CATCH POINTS.

APPROVED BY:

Brian J. Fragiad
 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS

BUS STOP


DEPARTMENT OF PUBLIC WORKS

H-34



REVISED:

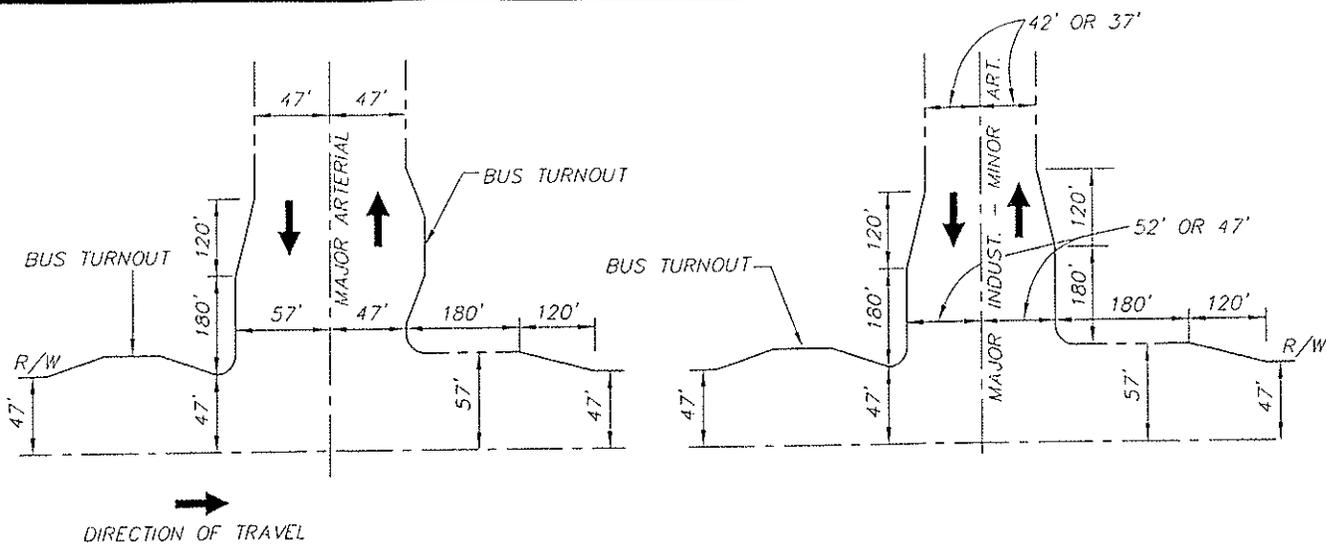

→
DIRECTION OF TRAVEL

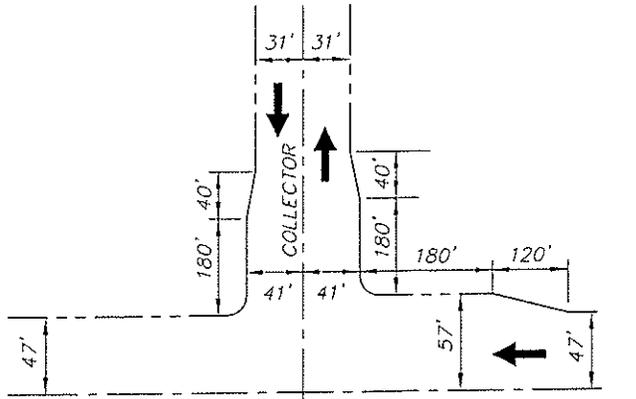


MAJOR ARTERIAL 94' (OR MORE) STREET

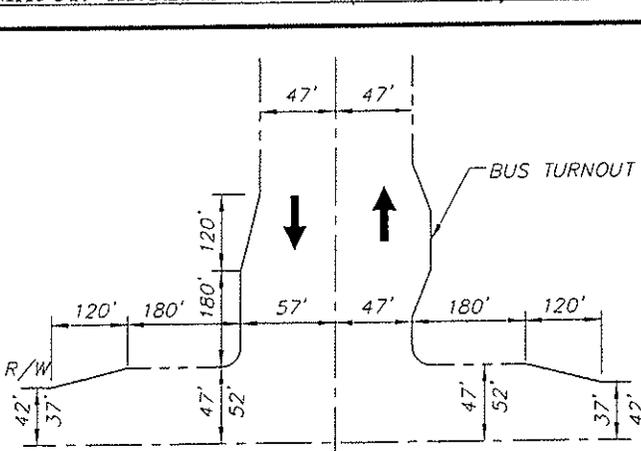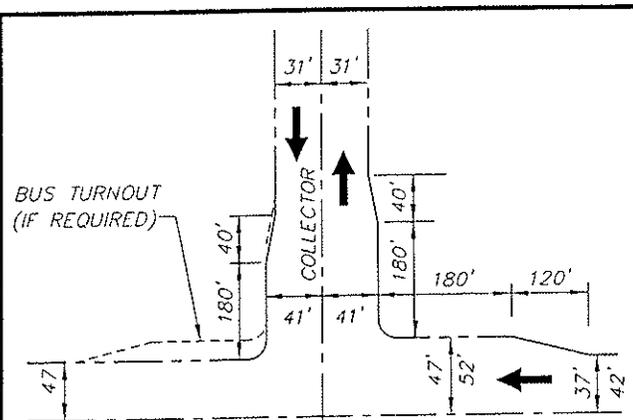

→
DIRECTION OF TRAVEL

MAJOR INDUSTRIAL & MINOR ARTERIAL (84' OR LESS)

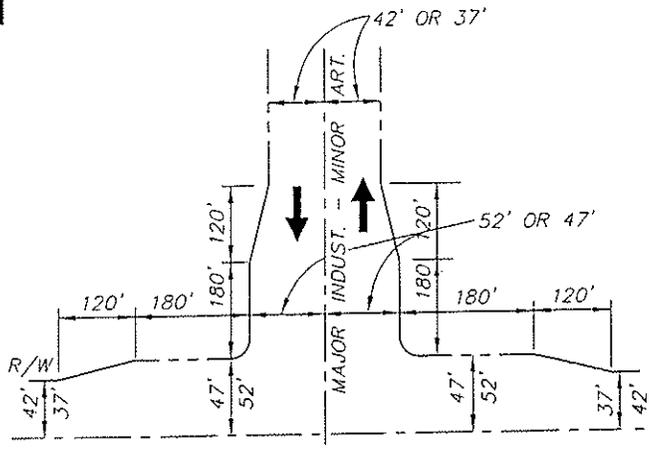

- NOTES:**
1. RADIUS AT CORNERS OF ALL INTERSECTIONS IS 35' MIN.
 2. WIDENING NOT USUALLY REQUIRED AT COLLECTOR/ COLLECTOR AND SMALLER INTERSECTIONS.
 3. SEE BUS TURNOUT STANDARD FOR DIMENSIONS.
 4. INCLUDES 50' MINOR OR COLLECTOR STREET INTERSECTING ARTERIAL.
 5. SEE DETAILS ON H-24 & H-25.
 6. ANY MODIFICATIONS TO THESE STANDARDS MUST BE APPROVED BY THE TOWN ENGINEER.


APPROVED BY:

 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 WIDENING DETAILS AT
 MAJOR STREET INTERSECTIONS
 DEPARTMENT OF PUBLIC WORKS


H-35

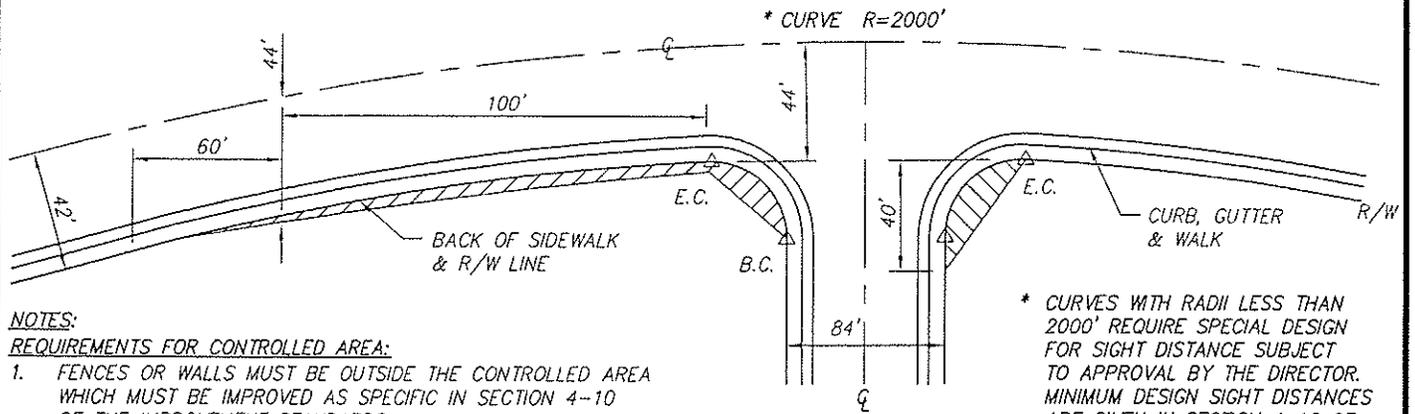

NOTES:

REQUIREMENTS FOR CONTROLLED AREA:

1. FENCES OR WALLS MUST BE OUTSIDE THE CONTROLLED AREA WHICH MUST BE IMPROVED AS SPECIFIC IN SECTION 4-10 OF THE IMPROVEMENT STANDARDS.
2. LAWN ONLY MAY BE PLANTED IN CONTROLLED AREA IF THERE IS NO FENCE OR WALL.
3. CONTROLLED AREA DIMENSIONS TO BE PER APPROVED OF TOWN ENGINEER

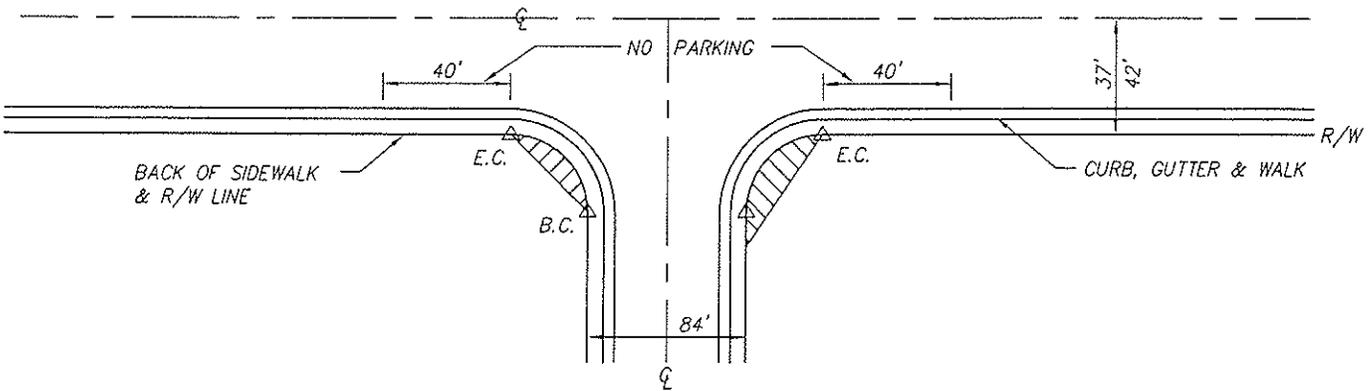

LEGEND:

CONTROLLED AREA



CURB RETURN



APPROVED BY:

Brian J. Fragaio
 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS
**SIGHT DISTANCE
 REQUIREMENTS FOR
 84' STREETS**

DEPARTMENT OF PUBLIC WORKS

H-36

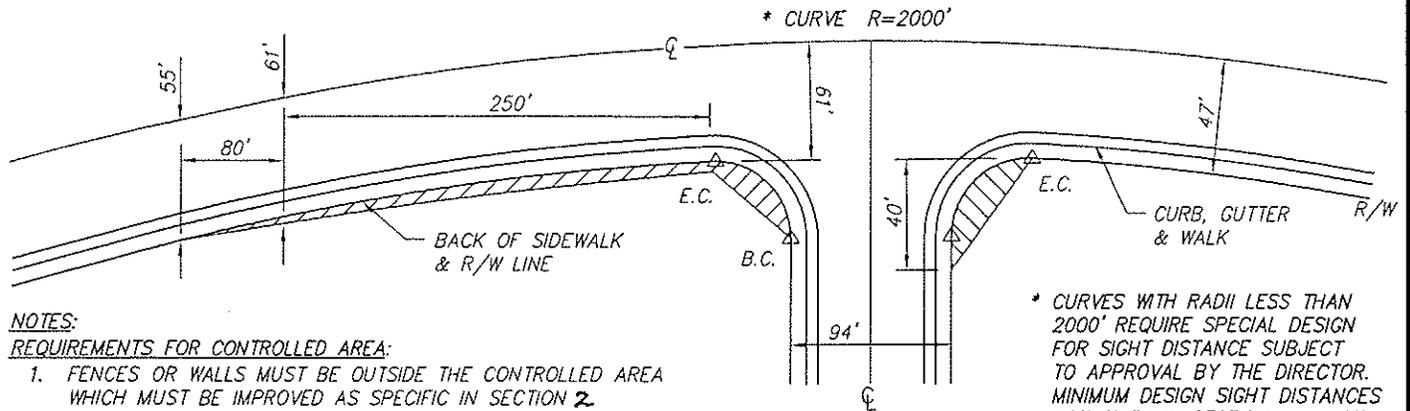


NOTES:

REQUIREMENTS FOR CONTROLLED AREA:

1. FENCES OR WALLS MUST BE OUTSIDE THE CONTROLLED AREA WHICH MUST BE IMPROVED AS SPECIFIC IN SECTION 2 OF THE IMPROVEMENT STANDARDS.
2. LAWN ONLY MAY BE PLANTED IN CONTROLLED AREA IF THERE IS NO FENCE OR WALL.
3. CONTROLLED AREA DIMENSIONS TO BE PER APPROVED OF TOWN ENGINEER

* CURVES WITH RADII LESS THAN 2000' REQUIRE SPECIAL DESIGN FOR SIGHT DISTANCE SUBJECT TO APPROVAL BY THE DIRECTOR. MINIMUM DESIGN SIGHT DISTANCES ARE GIVEN IN SECTION 2 OF THE IMPROVEMENT STANDARDS.

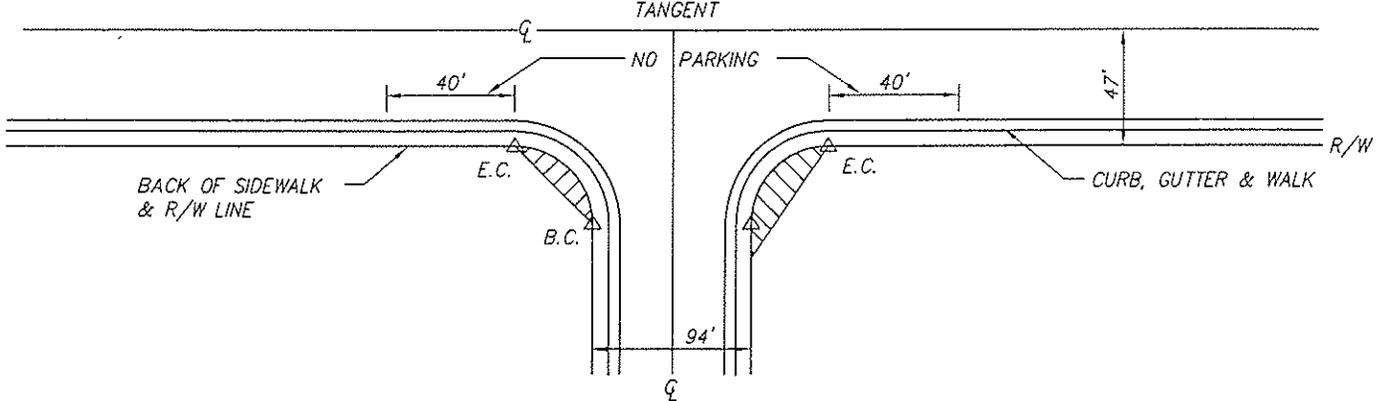

LEGEND:

CONTROLLED AREA



CURB RETURN



APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO,
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



REVISED:



TOWN OF LOOMIS
**SIGHT DISTANCE
 REQUIREMENTS FOR
 94' STREETS**

DEPARTMENT OF PUBLIC WORKS

H-37

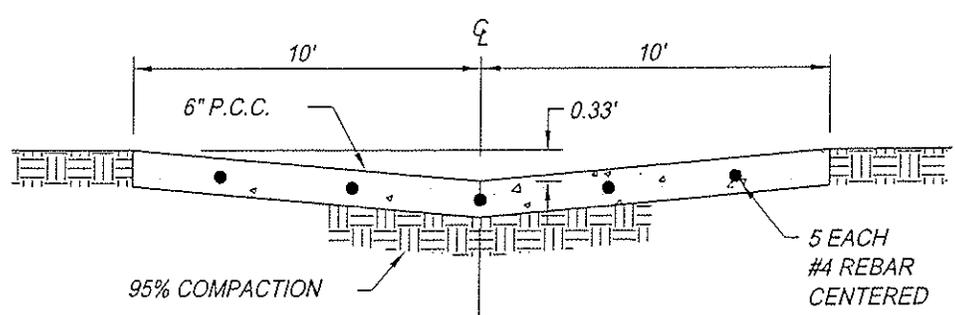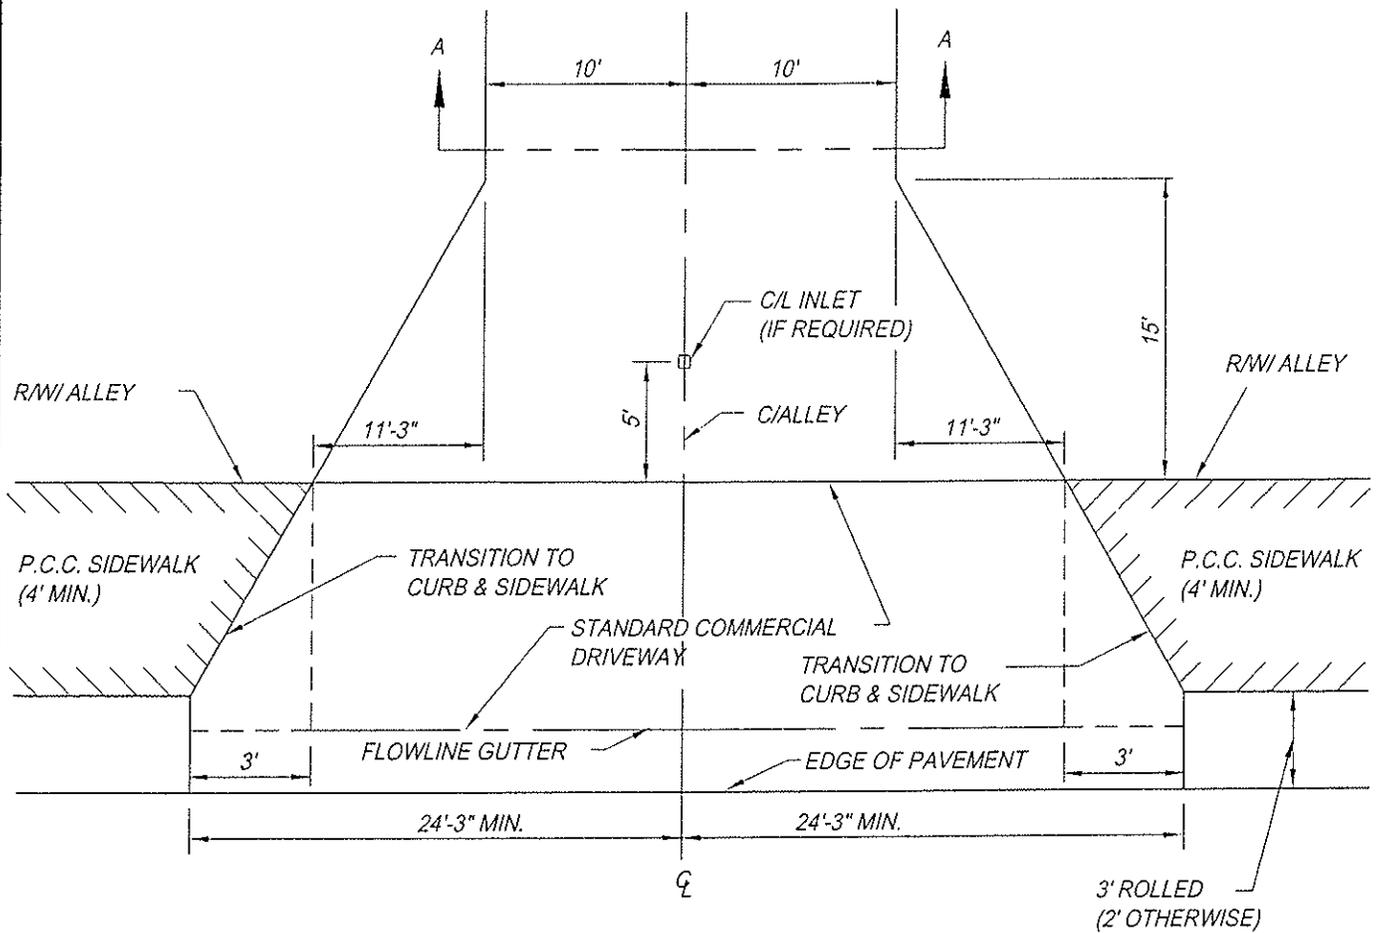


SECTION A-A

APPROVED BY:
Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 ALLEY DETAILS
 AND
 DRIVEWAY TRANSITIONS
 DEPARTMENT OF PUBLIC WORKS

H-38

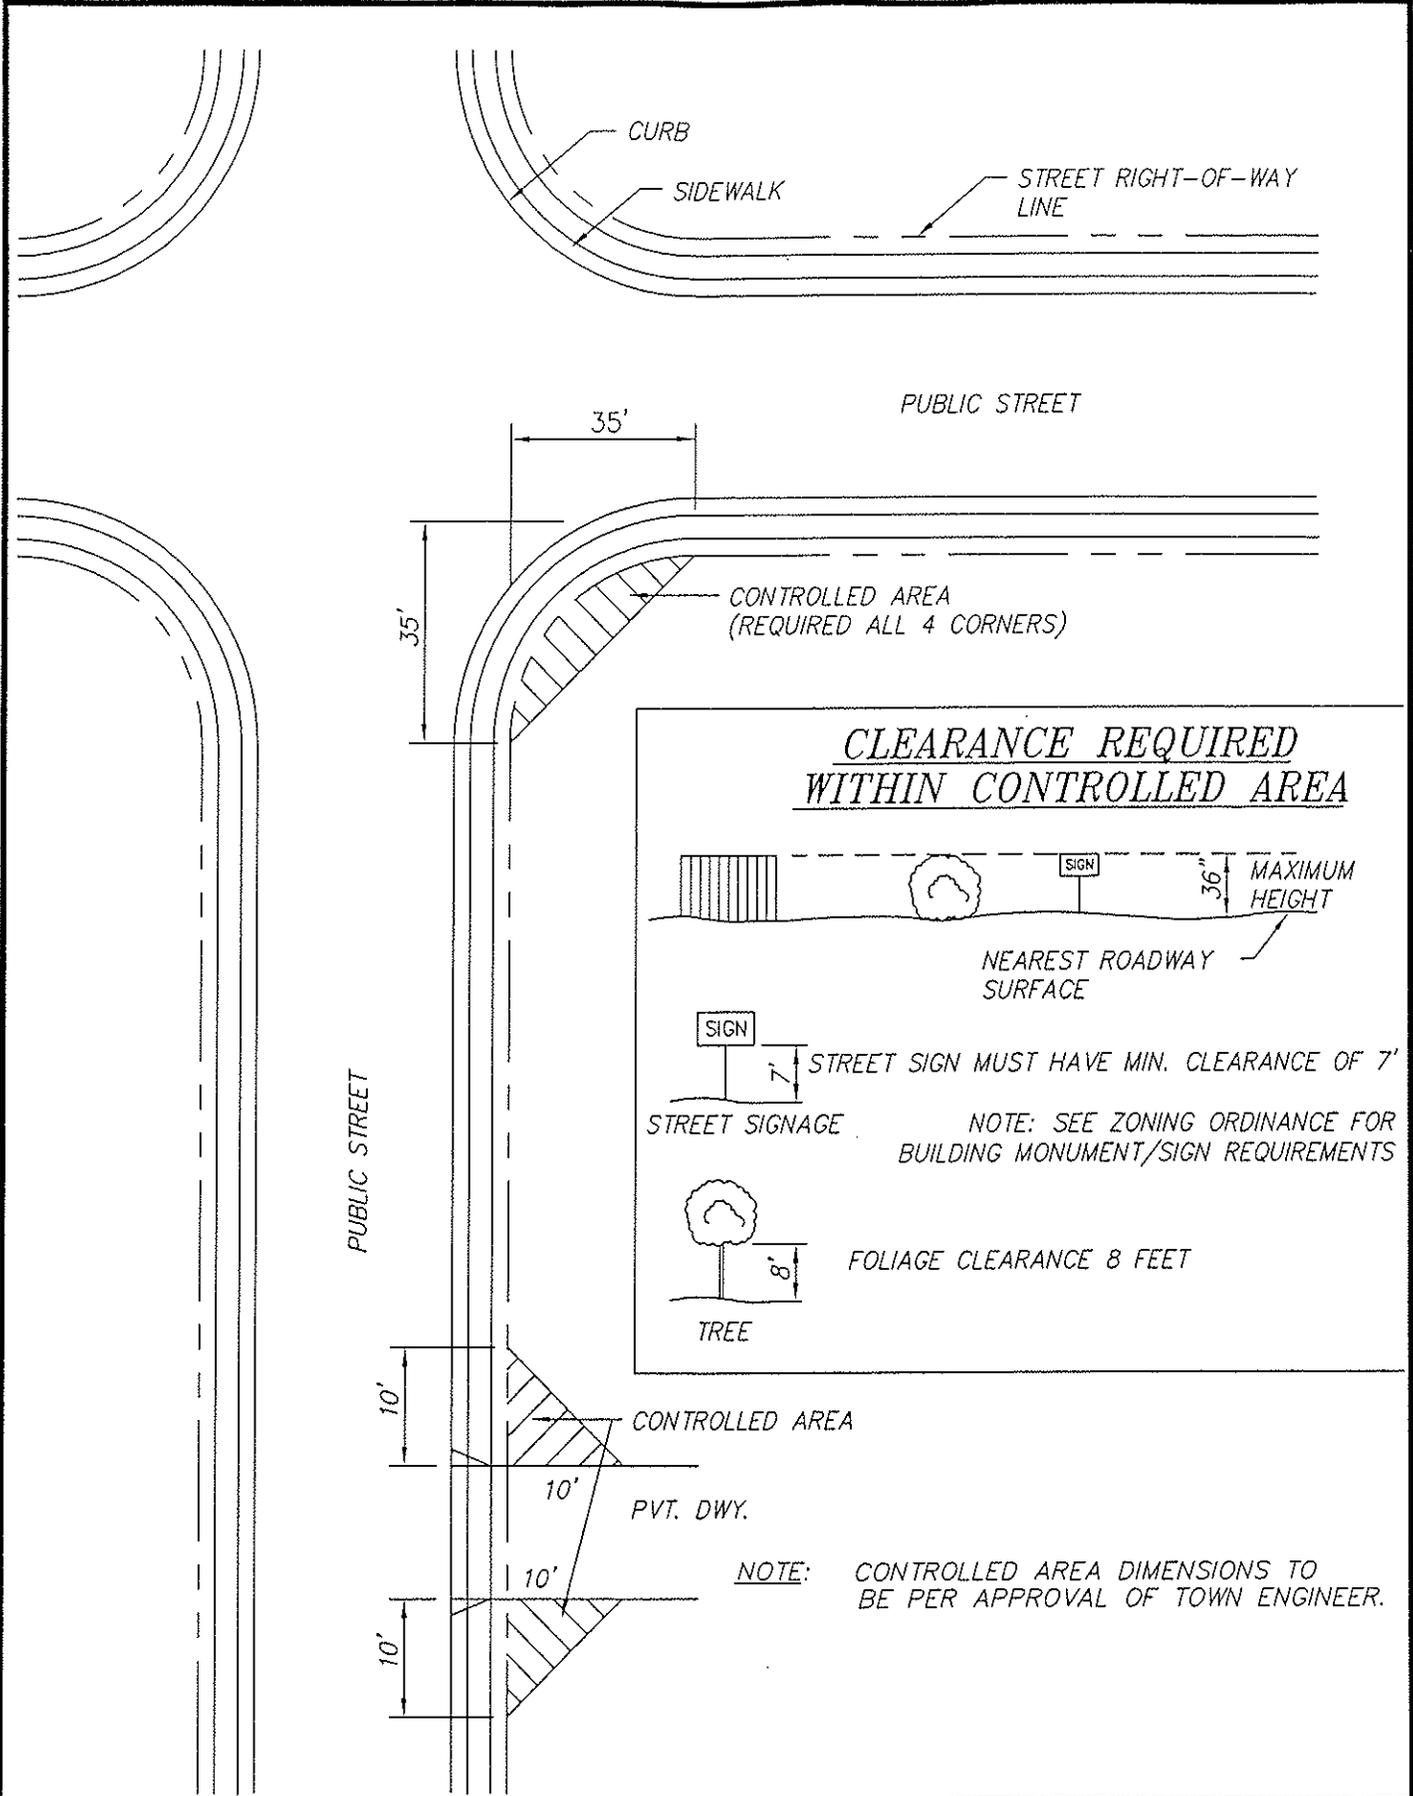


APPROVED BY:
Brian J. Fragio
 BRIAN J. FRAGIO,
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 VISIBILITY
 REQUIREMENTS
 RESIDENTIAL STREETS
 DEPARTMENT OF PUBLIC WORKS

H-39

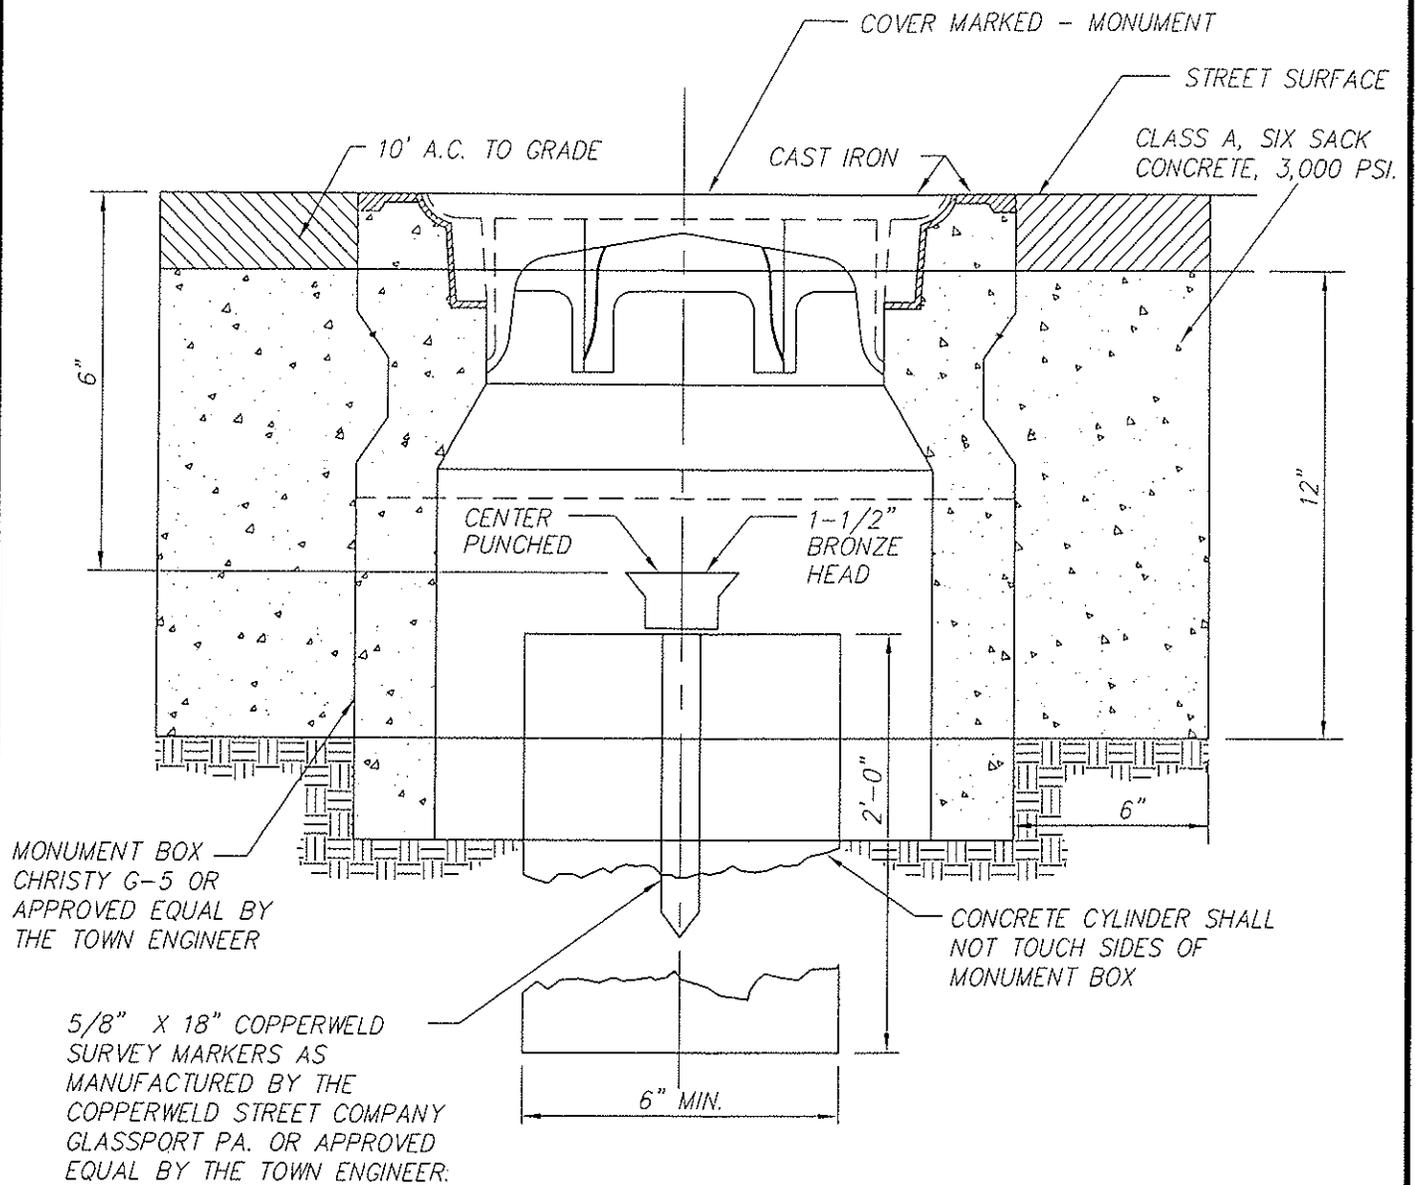

- NOTE:**
1. BOX SURVEY MONUMENT TO BE LOCATED AS PER DIRECTION OF TOWN ENGINEER.
 2. NO FINAL ACCEPTANCE OF THE CONSTRUCTION SHALL BE ISSUED UNTIL THE SURVEY MONUMENTS ARE IN PLACE & THE CENTERLINE MONUMENT TIES ARE FURNISHED TO THE TOWN ENGINEER'S OFFICE.

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

**BOXED SURVEY
MONUMENT**

H-40

DEPARTMENT OF PUBLIC WORKS


TYPE ① NEWLY PAVED SURFACES (LESS THAN 5 YEARS OLD)
MAJOR THOROUGHFARES

WITH HIGH QUALITY RIDING SURFACES
 BORING OR JACKING ONLY
 NO PAVEMENT CUTTING PERMITTED.

TYPE ② ANY ROAD SURFACED WITH ASPHALT CONCRETE,
CHIP SEAL, OR OTHER ASPHALTIC MATERIAL


STRUCTURAL SECTION:

- ① CHIP SEAL OR OTHER ASPHALTIC MATERIAL AS DIRECTED BY TOWN ENGINEER
- ② 3" AC MIN (2 LIFTS) OR MATCH EXISTING ROAD WHICHEVER IS GREATER
- ③ 8" CLASS 2 AB MIN. OR MATCH EXISTING ROAD STRUCTURAL SECTION DEPTH, WHICHEVER IS GREATER 95% RELATIVE COMPACTION
- ④ APPROVED COVER & BACKFILL

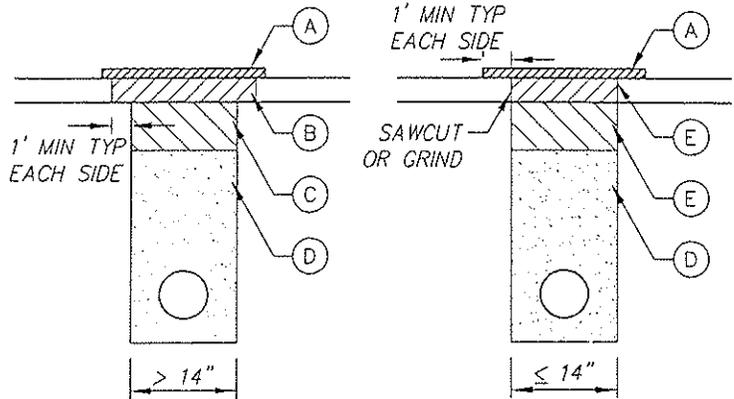


- ⑤ MATCH EXISTING STRUCTURAL SECTION

TYPE ③ UNSURFACED ROAD, SHOULDER, OR OTHER UNSURFACED
AREAS SUBJECT TO TRAFFIC LOADS

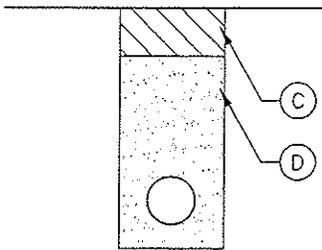

TYPE ④ OUTSIDE OF ROADWAY PRISM (NOT SUBJECT TO
TRAFFIC)

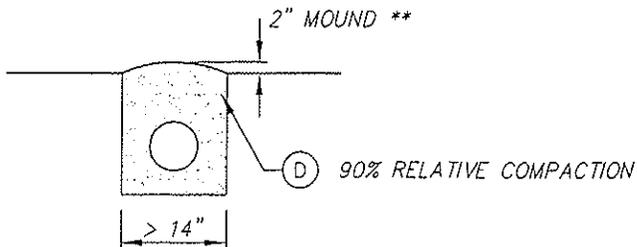

** - MOUND NOT REQUIRED FOR TRENCHES ≤ 14 INCHES WIDE

APPROVED BY:

Brian J. Fragia
 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



TOWN OF LOOMIS

**TRANSVERSE TRENCH
 RESURFACING SECTIONS**

H-41

REVISED:

DEPARTMENT OF PUBLIC WORKS


TYPE ① NEWLY PAVED SURFACES AND MAJOR THOROUGHFARES WITH HIGH QUALITY RIDING SURFACES

1. BORING AND JACKING - NO PAVEMENT CUTTING.
2. ANY CUTTING MUST BE REQUESTED IN WRITING TO THE DIRECTOR OF PUBLIC WORKS AND APPROVED IN WRITING BY THE DIRECTOR. RESTORATION SHALL BE AS DIRECTED BY THE DIRECTOR AND MAY INCLUDE:
 - A. COMPLETE ROAD OVERLAY AFTER TRENCHING, 0.2 FT. MIN. THICKNESS OR AS SPECIFIED ON THE PERMIT.
 - B. COMPLETE ROAD RECONSTRUCTION TO MATCH EXISTING.
3. ANY OTHER RESTORATION MUST BE REQUESTED IN WRITING TO THE DIRECTOR OF PUBLIC WORKS AND APPROVED IN WRITING BY THE DIRECTOR.


TYPE ② ROADS SURFACED WITH ASPHALT CONCRETE OLDER THAN 5 YEARS OR SURFACE TREATMENT (CHIP SEAL OR OTHER MATERIAL), OLDER THAN 3 YEARS

STRUCTURAL SECTION:

- ① CHIP SEAL OR OTHER ASPHALTIC MATERIAL AS DIRECTED BY TOWN ENGINEER, MINIMUM OF 2 FT. EITHER SIDE OF TRENCH LIMITS. IF $X > 3$ SEAL TO EOP
- ② 3" AC OR MATCH EXISTING WHICHEVER IS GREATER
- ③ 8" CLASS 2 AB MIN. OR MATCH EXISTING ROAD STRUCTURAL SECTION DEPTH, WHICHEVER IS GREATER 95% RELATIVE COMPACTION
- ④ APPROVED COVER & BACKFILL

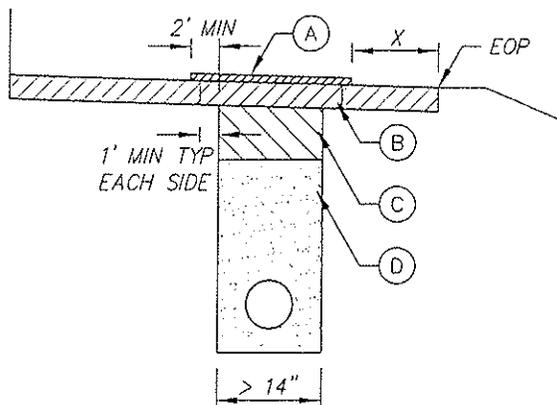

TYPE ③ UNSURFACED ROAD, SHOULDER OR OTHER AREAS SUBJECT TO TRAFF

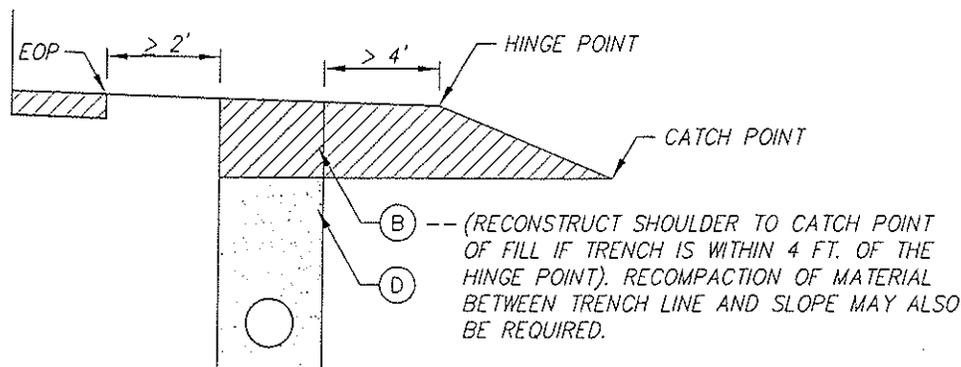

APPROVED BY:

Brian J. Fragiaco

BRIAN J. FRAGIACO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS
LONGITUDINAL TRENCH
RESURFACING SECTIONS
SHEET 1
DEPARTMENT OF PUBLIC WORKS

H-42

TYPE (D) OUTSIDE ROADWAY PRISM NOT SUBJECT TO TRAFFIC

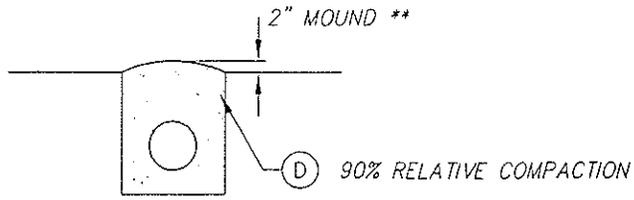

** - MOUND NOT REQUIRED FOR TRENCHES \leq 14 INCHES WIDE

APPROVED BY:

BRIAN J. FRAGALA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS
LONGITUDINAL TRENCH
RESURFACING SECTIONS
SHEET 2
DEPARTMENT OF PUBLIC WORKS

H-42A

EXISTING STREET

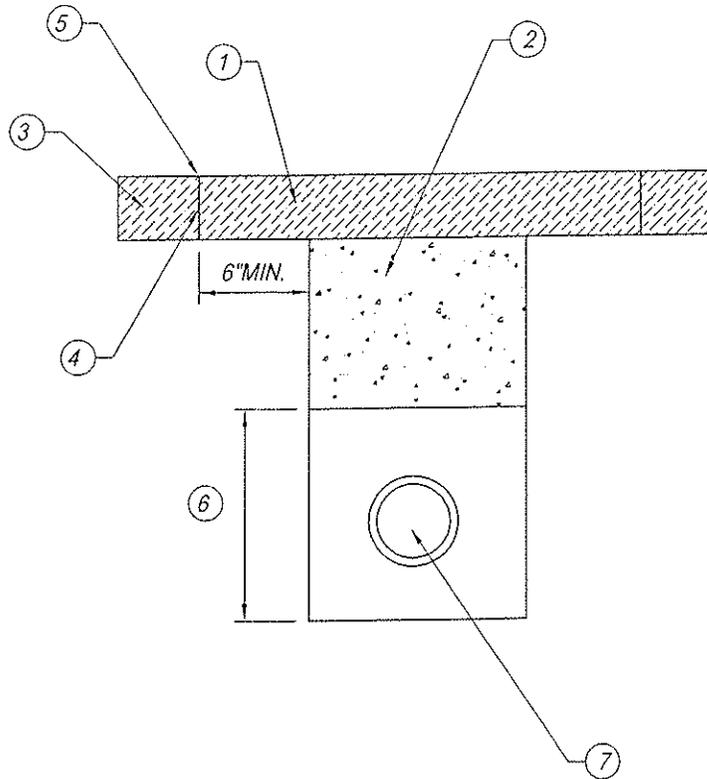

NOTES:

- ① ASPHALT CONCRETE PATCH, SIX INCHES THICK OR THAT OF EXISTING, WHICHEVER IS MORE.
- ② 24 INCHES OF TWO SACK CONCRETE SLURRY PER CALTRANS STANDARD SPEC. 19-3.062. OR APPROVED EQUAL.
- ③ EXISTING STREET PAVEMENT.
- ④ TACK COAT ON ALL VERTICAL PAVEMENT SAWCUTS.
- ⑤ SAWCUT TYPICAL EACH SIDE OF TRENCH IN EXISTING STREET.
- ⑥ PIPE EMBEDMENT. PER APPROVAL OF TOWN ENGINEER.
- ⑦ PIPE OR CONDUIT.

APPROVED BY:

Brian J. Fraciao

BRIAN J. FRACIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

UTILITY TRENCH PAVING
BACKFILL AND EMBEDMENT


DEPARTMENT OF PUBLIC WORKS

H-43

BACKFILL WITH 3/4" CLASS 2
AGGREGATE BASE AND
COMPACT TO 90 %.

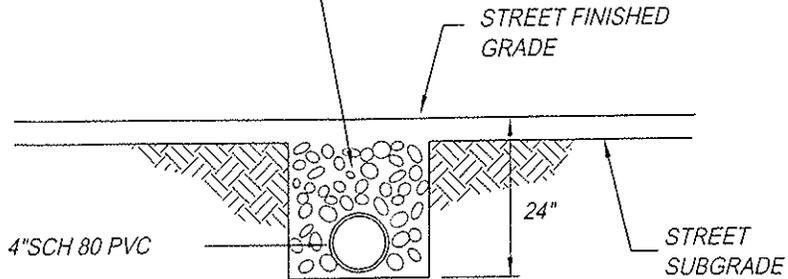

SECTION A-A:
NO SCALE

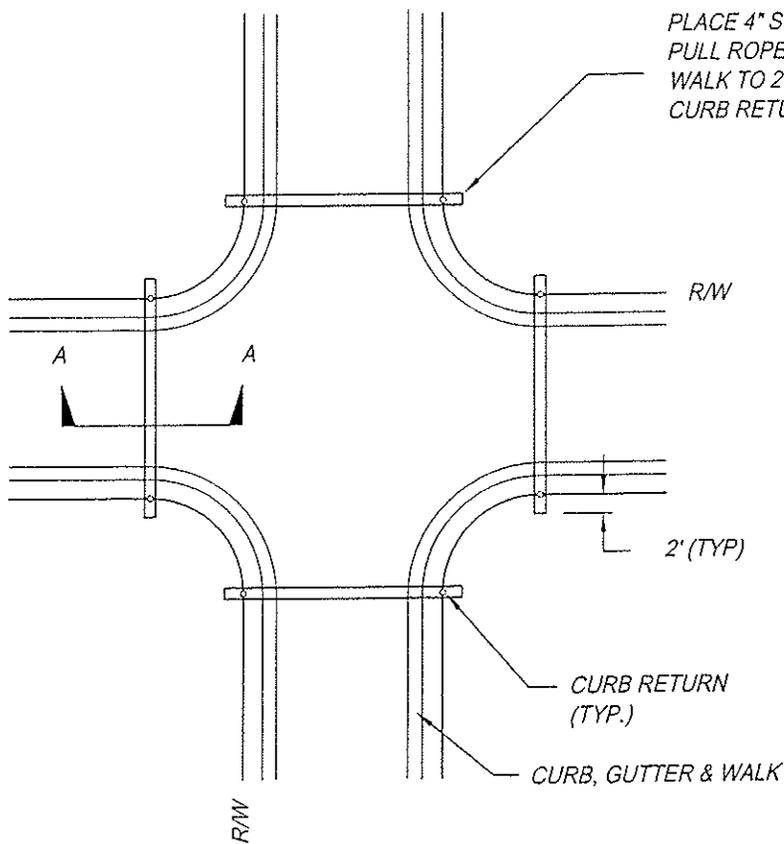

PLACE 4" SCH. 80 PVC PIPE WITH
PULL ROPE FROM 2' BEHIND
WALK TO 2' BEHIND WALK AT ALL
CURB RETURNS. CAP ENDS.

TYPICAL STREET INTERSECTION:
NO SCALE

APPROVED BY:

BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:




TOWN OF LOOMIS
CONDUIT FOR FUTURE
TOWN USE

DEPARTMENT OF PUBLIC WORKS

H-44

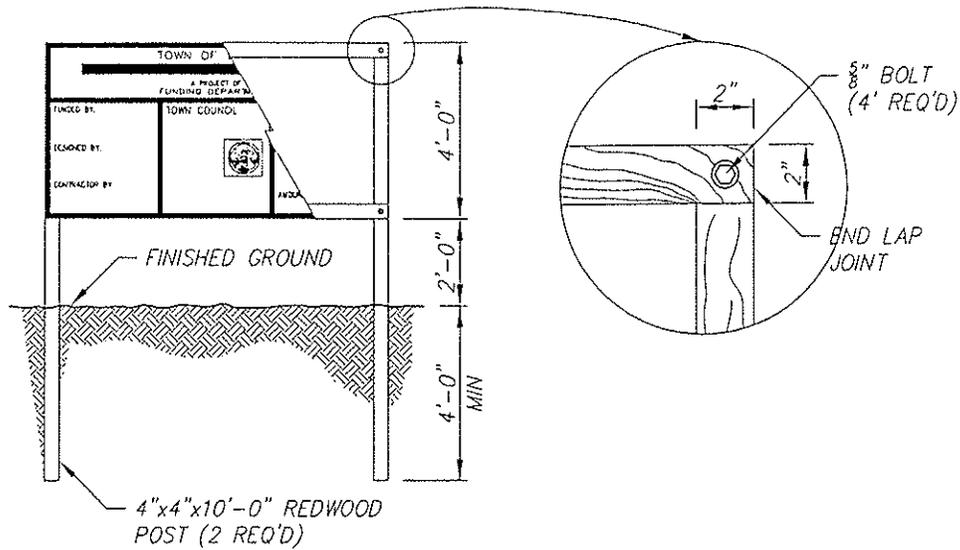

FRONT PROFILE

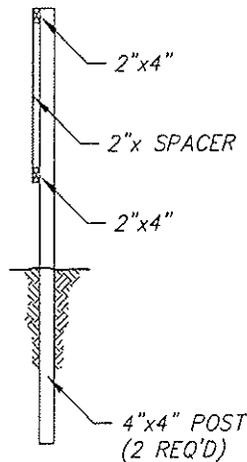

SIDE PROFILE

NOTES:

1. SEAL SHALL BE SUPPLIED BY THE CITY.
2. ALL LETTERS SHALL BE PAINTED BLACK AND 'FUTURA' STYLE.
3. SIGN SHALL BE BOLTED TO (2) 4" x 4" x 10'-0" LONG REDWOOD POSTS.
4. SIGN SHALL BE LOCATED IN THE FIELD BY THE TOWN INSPECTOR
5. CONTRACTOR SHALL REMOVE THE SIGN AS DIRECTED BY THE ENGINEER.
6. CONTRACTOR SHALL BE NOTIFIED AT THE PRE-CONSTRUCTION MEETING ON THE NECESSARY WORDING TO BE PAINTED ON THE PROJECT SIGN.

APPROVED BY:

Brian J. Fraga
 BRIAN J. FRAGA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



TOWN OF LOOMIS

PROJECT SIGN
 SHEET 2

DEPARTMENT OF PUBLIC WORKS

H-45A

REVISED:

SECTION 4

DOMESTIC WATER SUPPLY SYSTEM (W)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 4

DOMESTIC WATER SUPPLY SYSTEM

4-1 INTRODUCTION

Design of water facilities shall conform to the requirements set forth in the PCWA Improvement Standards Technical Provisions and Standard Drawings, "Latest Edition" and the following provisions.

The applicant shall enter into all permits and/or agreements and pay any required fees in order to construct the water facilities.

4-2 WATER SUPPLY QUALITY

The quality of water shall conform to the Environmental Protection Agency Drinking Water Regulations.

4-3 REQUIRED FIRE FLOWS

Fire Flows shall be reviewed and approved by the Fire District.

4-4 TRENCH PAVING

Trench paving shall conform to Standard Drawing Details H-41 to H-44.

SECTION 5

SANITARY SEWER SYSTEM (SS)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 5

SANITARY SEWER SYSTEM

5-1 GENERAL – Design of sewer facilities shall conform to the requirements set forth in the South Placer Municipal Utility District Standard Specifications and Improvement Standards “Latest Editorial”.

The applicant shall enter into all permits and/or agreements and pay any required fees in order to construct the sewer facilities.

5-2 TRENCH PAVING - Trench paving shall conform to Standard Drawing Details H-41 to H-44.

SECTION 6

DRAINAGE (SD)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 6

DRAINAGE

6-1 GENERAL -- Drainage improvements are to include: culverts, drop inlets, lined channels, manholes, outlet structures and storm drain pipe. These improvements shall be installed in accordance with the approved improvement plans, these Improvement Standards and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the Caltrans Standard Specifications. The Town Inspector must be supplied with two (2) sets of cut sheets prior to construction, without exception.

6-2 CONSTRUCTION STAKING -- Construction staking shall be provided by the Developer for all drainage improvements. Such staking shall provide the station and offset, as well as the cut to the nearest hundredth of a foot, 0.01 foot. Stakes shall be provided at a minimum of every 50 feet in tangent sections and every 25 feet in curved sections. The Town Inspector shall be provided with two (2) sets of cut sheets prior to construction, without exception.

6-3 CHANNEL LINING INSTALLATIONS -- Channel lining installations shall conform to Standard Details SD-18 and 19 and to the following specifications:

- A. Surface Preparation** -- The surfaces of the areas to be lined shall be evenly graded to the lines and grade and sections as indicated on the approved plans. The surfaces shall be moistened thoroughly to prevent moisture from being drawn from the freshly placed lining. All surfaces on which lining is to be placed shall be free from water, mud and debris and shall be firm enough to prevent contamination of the fresh lining by earth or other foreign material. Prior to placing any lining, the contractor shall verify line and grade of the excavated channel.
- B. Reinforcement** -- Welded wire fabric shall be embedded in the concrete so that it will be a minimum of 1 inch clear from either face of the concrete, unless otherwise noted.
- C. Joints**
- 1. Construction Joints** -- Shall be square and edged with a 1/4 inch radius edging tool. The edge shall be thoroughly wetted before the next section of lining is placed. Construction joints shall be constructed whenever the operation is halted for a period exceeding 30 minutes. Welded wire fabric reinforcing shall extend through the construction joint.
 - 2. Expansion Joints** -- Transverse expansion joints shall be edged with a 1/4 inch radius edging tool and shall be constructed at intervals of not more than 50 feet. All expansion joints shall be filled with premolded expansion joint filler material.

3. Contraction Joints -- Transverse contraction joints shall be constructed as intervals of 10 feet and shall be scored by troweling a groove 5/8 inch in depth and 1/4 inch in width. All joints shall be true to a uniform line and neat appearance.

D. Weep Holes -- On channels with side lining extending more than 18 inches vertically above the channel toe, weep holes shall be constructed at intervals of 10 feet, midway between contraction joints on each side of the channel. The weep hole elevation shall be 12 inches above the adjacent toe of slope.

The holes shall be backed by a minimum of 1 cubic foot of aggregate material tied in a burlap bag. The aggregate shall extend at least 6 inches above and below and to each side of the weep hole, and at least 10 inches into the side slope. The side and back of the burlap sack shall be protected from being coated by mortar or concrete during the lining placing operation.

On the day following the lining placement, each weep hole shall be rodded to assure it has not been blocked. The weep hole shall then be cut to fit the channel slope.

E. Cutoff Walls -- Cutoff walls shall be constructed around the perimeter at each end of the channel lining and at all locations where the new lining meets structures or existing lining, and at all other locations shown on the approved plans. The cutoff walls shall be a minimum of 6 inches thick and 18 inches in depth, as measured from the surface of the lining. The welded wire fabric shall be bent down into the cutoff walls. Cutoff walls, locations, and details require a design submitted to be approved by the Town Engineer prior to construction.

F. Finishing -- Poured in place concrete lining shall be spread and tamped until it is thoroughly compacted and mortar flushes to the surface. After striking off to grade, the concrete shall be hand floated with wooden floats not less than 4 inches in width and 30 inches in length. The entire surface shall then be broomed with a fine texture hair push-broom to produce a uniform surface. Brooming shall be done when the surface is sufficiently set to prevent deep scarring and shall be accomplished by drawing the broom parallel to the expansion and contraction joints.

All mortar blown channel lining shall be placed as early as practicable to the required depth. The surface shall then be checked with a straight-edge, and any low spots or depressions shall be brought up to the proper grade by placing additional mortar in such a manner that the finished surface will be reasonably smooth and uniform. Any base material shall then be struck off with a finishing tool to provide a finished equivalent to a broomed concrete surface.

G. Curing -- Channel lining shall be sprayed uniformly with a white pigmented or clear curing compound. The method and rate of application shall conform to Section 90-7.01B of the Caltrans Standard Specifications.

6-4 DROP INLET INSTALLATION -- Drop inlet installations shall conform to Standard Details SD-3 to SD-10 and to provisions in Sections 51 and 52 of the Caltrans Standard Specifications. The interior of the drop inlet shall have an Ordinary Surface Finish; rock pockets shall be grouted and brushed; exposed top surfaces shall have a Class I Surface Finish.

6-5 MANHOLE INSTALLATION

A. Bases

1. **Precast** -- Precast bases shall be placed on a foundation of 1/2 inch minus crushed rock, a minimum of 4 inches thick, compacted to 90 percent relative compaction.. Elevation differentials of inlets and outlets shall conform to the approved improvement plans. Openings in the base shall align true with all inlet and outlet pipes. Stubs or couplings provided in precast bases shall be of the same material as the pipe to which they connect, unless otherwise approved by the PWD Inspector.
2. **Cast-in-Place** -- The cast-in-place base portion shall not be placed higher than 6 inches above the outside tops of the main incoming and outgoing pipes. Minimum and maximum wall thicknesses for the cast-in-place sections shall conform to the following table:

<u>Manhole Diameter</u>	<u>Minimum Wall Thickness</u>	<u>Maximum Wall Thickness</u>
48"	5"	7"
60"	6"	8"
72"	7"	9"

Inside diameters of cast-in-place base portions shall equal the diameter of the manhole specified. Standard precast manhole riser sections and/or cones shall be placed above the cast-in-place section to bring the manhole rim to finish grade.

Concrete in the cast-in-place portion shall be placed neat against undisturbed earth.

- B. **Cones** -- Cone tops shall be placed within 6 to 18 inches of final street grade. Where depth is insufficient for cones, flat slab tops shall be used. Lifting rings in precast cones shall be plugged with dry packed mortar.
- C. **Joints** -- Joints in precast manhole sections shall be made with either mortar or plastic sealing compound.

1. **Mortar Application** -- All joint surfaces and the face of the manhole base shall be thoroughly cleaned and wetted before applying mortar. Both the inside and outside of mortared joints shall be plastered with mortar and the inside brushed to a smooth finish with a wet brush. Special precautions shall be taken to ensure that the entire joint space is filled with mortar and is watertight.
 2. **Plastic Sealing Compound Application** -- All joint surfaces and the face of the manhole base shall be thoroughly cleaned before applying plastic sealing compound. The sealing compound shall be protected from dirt during application. Ends of the compound shall be joined end-to-end and not joined by overlapping. Sufficient compound shall be used to cause a visual "squeeze-out" of the compound material when adjacent sections are seated. Squeeze-out material on the inside of the manhole shall be neatly trimmed flush with the inside surface.
- D. Connections** -- Pipe connections to drainage manholes shall be made so that the pipe is flush with the inside face of the manhole. These connections shall be finished so that entrances are smooth. Unless the manhole is cast around the pipe, connections shall be made with dry packed cement mortar. Pipe connections shall not be made into the cone section of the manhole unless shown on the approved plans.
- E. Grade Rings** -- Grade adjustments shall be made using precast grade rings. Precast rings shall be a minimum of 2 inches in height and a maximum of 12 inches in height.
- F. Frames and Covers** -- The tops of frames and covers shall be set 1/8 inch below finish grade pavement in the street and two inches above finish grade in an unimproved area. Per the Standard Details, a 12 inch deep by 12 inch wide concrete collar shall be placed around the casting, covered by 0.10 foot of asphalt concrete paving in a street area. The concrete collar shall be class A, six sack, 3,000 psi. All joints between the frame, grade rings, dome, barrels and base shall be sealed with non-shrink mortar, or an approved plastic sealing material. Inside the manhole, all joints where the sealing material is not flush with the inside wall shall be grouted with non-shrink mortar and finished/wet-brushed.
- G. Adjusting Existing Manhole Frames** -- The frame shall be supported above the grade ring or dome by spacers, or by suspending with timber and wires. After the concrete collar is poured, any space between the frame and grade ring or dome shall be filled with non-shrink mortar, the inside wall of the riser finished/wet-brushed.
- H. Compaction** -- Compaction around storm drain manholes shall conform to structural backfill requirements per Caltrans Standard Specifications Section 19-3.

6-6 **PIPE INSTALLATION** -- All drainage improvements shall be conform to the following requirements:

- A. Excavation** -- Pipeline excavations shall be open-cut trenches, unless otherwise Specified on the approved improvement plans. Excavations shall apply to all

applicable Federal and State safety requirements. All work shall be conducted in such a manner as to prevent damage to the work or adjoining property.

Wherever the trench bottom is unstable, the area shall be excavated and an adequate amount of 1/2 inch crushed rock shall be compacted in place to provide a stable base for the pipe.

B. Trench Width -- Minimum trench width shall be the outside pipe diameter plus 12 inches, except for cast-in-place.

C. Pipe Bedding -- Pipes shall be placed on a firm bed of imported material conforming to Engineered Standards. Unless unstable pipe bedding subgrade needs to be removed, pipe bedding shall only be placed on native, undisturbed soil. Prior to placing pipe bedding, the trench bottom shall be free of any loose material.

D. Laying Pipe -- The pipe shall be laid up-stream with the bell or groove end of the pipe placed up-stream. The interior of the pipe shall be kept clean as the work progresses. For mortared joint, precast concrete pipe, the inside of each joint shall be wet swabbed with a brush until no mortar protrudes on the inside of the pipe. After mortaring, the exterior of each pipe joint shall be covered with a heavy paper membrane for protection. Pipe shall not be laid, when, in the opinion of the PWD Inspector, trench or weather conditions are unsuitable.

1. Laying and Backfill of Polyvinyl Chloride (PVC) and High Density Polyethylene Pipe (HDPE) -- Laying and backfill for these pipes shall conform to Caltrans Standard Specifications, and manufacturer's recommendations, ASTM D-2321 with the following modifications:

3. Due to the light weight characteristic of the pipe, extreme care shall be taken to avoid displacing the pipe during the backfilling operation. Following placement of the pipe on the required bedding and to the required grade, the pipe shall be stabilized in place with ballast. At a minimum, this shall be accomplished by loading the pipe down slowly and carefully with piles of embedment material to a minimum of one foot above the pipe on each joint and midway on each length. The pipe shall be kept centered in the trench during this operation.

b. The trench shall then be backfilled with embedment material 6 to 12 inches above the pipe, prior to continuing with the trench backfill operations.

c. Last joint to RCP pipe.

3. Pipe Laying Tolerances -- The pipes shall be laid true to line and grade with allowed tolerances of 0.03 foot above or below the design grade and 0.10 foot left or right of the design alignment.

3. Trench Backfill -- Initial backfill material shall be placed immediately after pipe joints have been completed, inspected and passed by the PWD Inspector. The material shall be carefully placed so as not to disturb or damage the pipe, and shall

be brought up evenly on both sides. Trench backfill shall be placed in 8" to 12" lifts depending on soil conditions, compaction equipment and methods.

- G. **Cast-in-Place Concrete Pipe** -- Cast-in-place concrete pipe shall conform to provisions in Section 63 of the Caltrans Standard Specifications.
- 3. **Pavement Cutting and Repaving** -- When the trenchline is in an existing pavement area, the pavement shall be sawed or scored and broken ahead of trenching operations. The proper tools and equipment shall be used in marking and removing so that the pavement will be cut accurately to a neat and parallel line 12 inches wider on each side than the trench width required. All cuts in Portland Cement concrete pavements shall be sawcut with equipment approved by the PWD Inspector.

Repaving shall be done in such a manner as to accurately match the cut pavement area with a similar pavement material.

6-7 MATERIALS

- A. **Backfill Material** -- All drain pipe backfill material shall conform to Engineered Standards and may require testing for Town Engineer approval.
- 3. **Drop Inlets** -- All drop inlets shall conform to Standard Details SD-3 to SD-10. Concrete to be Class "A", reinforcing steel to conform to provisions in Section 52 of the Caltrans Standard Specifications.
- C. **Lined Channels** -- All lined channels shall conform to Standard Details SD-18 and 19 and the following materials:
 - 1. **Air Blown Mortar** -- Air blown mortar shall conform to provisions in Section 53 of the Caltrans Standard Specifications.
 - 3. **Concrete** -- Concrete shall be either Class "A" concrete with Type II cement, sacked concrete, or doweled and sacked concrete. The minimum weight of sacked concrete shall be 60 pounds per sack.
 - 3. **Curing Compound** -- Curing Compound shall conform to provisions in Section 90-7.01B of the Caltrans Standard Specifications.
 - 4. **Expansion Joint Filler** -- Premolded expansion joint fillers shall be a minimum of 3/8 inch thick and conform to ASTM Designation D 1751.
 - 5. **Grouted Cobbles** -- Grouted cobbles shall require Class "A" concrete with the cobble mixture as follows: all retained on the 1-1/2" sieve; not more than 40 percent passing the 4" sieve; and 10" maximum size.
 - 3. **Weep Holes** -- All weep holes shall be 2 inches in diameter and made of: galvanized steel pipe, schedule 40 or better; PVC pipe, schedule 40 or better; or, ABS pipe, schedule 40 or greater.

7. **Welded Wire Fabric** -- Welded wire fabric to conform to ASTM Designation A 185.
3. **Manholes** -- All precast manhole barrels, risers, cones, flat tops and grade rings shall conform to ASTM Designation C478 and shall conform to dimensions shown on Standard Detail SD-23.
 3. **Bases** -- Bases shall be either precast or cast-in-place. Precast bases shall conform to ASTM Designation C478. Cast-in-place bases shall be Class "A", concrete with Type II cement. Slump shall not exceed 4 inches as determined by the slump cone method of ASTM Designation C143 or an equivalent slump as determined by Test Method No. California 533.
 2. **Cones** -- All cones shall conform to ASTM Designation C478.
 3. **Joints** -- Joints shall be made with either non-shrinking mortar or with plastic sealing compounds conforming to Federal Specifications SS-S-00210.
 3. **Manhole Frames and Covers** -- All castings for manhole frame castings, covers and other purposes shall be of cast iron and conform to ASTM Designation A 48, Class 30 and shall conform to dimensions shown on Standard Detail SD-22.
 5. **Mortar** -- Mortar used in finishing manholes and joints shall be non-shrinking and consist of 1 cubic foot of Portland Cement to 2 cubic feet of concrete sand.
 6. **Pipe Connections** -- Pipe connections for precast concrete tongue and groove pipe shall be made using mortar, as designated above.
- E. **Outlet and Inlet Structures** -- All outlet structures shall conform to Standard Details SD-15 to SD-17.
- F. **Slurry Cement Backfill** -- Slurry cement backfill shall conform to the requirements of Section 19 of the Caltrans Standard Specifications.
- G. **Storm Drain Pipe** -- Storm drain pipe shall conform to the following:
 1. **Acrylonitrile-Butadiene Styrene (ABS)** -- ABS pipe shall meet the requirements of ASTM Designation D2680.
 2. **Cast-in-Place Concrete Pipe** -- Concrete shall be Class "A", 6 sack with Type II cement and shall conform to the requirements of Sections 63 and 90 of the Caltrans State Specifications.
 3. **High Density Polyethylene Pipe (HDPE)** -- HDPE shall be Type "S", conforming to Section 64 of the Caltrans Standard Specifications. Joint connections shall be water tight. A listing of approved manufacturers include ADS, Inc., Hancor or approved equal.

4. **Polyvinyl Chloride Pipe (PVC)** -- PVC shall conform to the following standards based on pipe diameter:

<u>Pipe Diameter</u>	<u>ASTM Designation</u>
10" through 15"	D3034, SDR 35
18" through 27"	F794, F2241, SDR 51
30" through 48"	F794

All PVC pipe joints shall be integral wall bell and spigot configuration, factory formed. All rubber rings shall conform to ASTM Designation F477.

5. **Precast Reinforced Concrete Pipe (RCP)** -- RCP shall conform to ASTM Designation C76 for Class I, II, III, IV or V. The class of pipe shall be based on the designation conforming to the approved plans.

Joints for RCP shall be tongue and groove, bell and spigot, or other approved type, and shall be of such a design that when properly laid, they shall have a smooth and uniform interior surface. Each joint shall be sealed to prevent leakage. Sealing materials shall consist of either cement mortar, rubber gasketed joints or resilient materials conforming to Section 65 of the Caltrans Standard Specifications.



6. **Alternate Pipe Materials** -- Alternate pipe materials such as spiral rip aluminum, aluminum coated steel or other materials may be submitted for approval by the Town Engineer with soils analysis and other technical data.
7. All non-rigid pipe including and not limited to HDPE pipe shall be mandrel tested (5%).

6-8 HYDROLOGY


Refer to the Placer County Flood Control District Stormwater Management Manual for general hydrologic guidelines and rainfall Depth Duration Frequency data. All modeling and signing to be approved by DPW prior to approving development drawings.

STORM DRAIN STANDARD DETAILS

<u>Title</u>	<u>Plate No.</u>
Utility Stream Crossing Detail.....	SD-1
Pipe Connections Detail	SD-2
Drop Inlet Frame And Grate Type "A", "B", "C" Drop Inlet.....	SD-3
Drop Inlet Type "B"	SD-4
Drop Inlet Type "C"	SD-5
Drop Inlet for type "D" and "E" Drop Intlets	SD-6
Drop Inlet Type "D"	SD-7
Drop Inlet Type "E"	SD-8
Drop Inlet Type "F"	SD-9
Drop Inlet Type "G"	SD-10
Pipe Outfall - Access Control Rack	SD-11
Pipe Outfall - Access Control Rack (30" Pipe and smaller).....	SD-12
Pipe Inlet Structure.....	SD-13
Trash Rack (33" Pipe and larger).....	SD-14
Erosion Control Pipe Discharge	SD-15
Erosion Control - Ditch Discharge	SD-16
Culvert Outfall	SD-17
Lined Channel Section	SD-18
Rock Lined Channel Section	SD-19
Access Ramp Detail	SD-20
Grate Type Manhole Cover	SD-21
Standard 24" Manhole Frame and Cover	SD-22
Standard Precast Storm Manhole.....	SD-23
Type "A" and "B" Saddle Manhole	SD-24
24" Storm Manhole	SD-25
Pipe Cover Requirements - CP, RCP, ACP, VCP and Cast-In-Place.....	SD-26
Pipe Cover Requirements CSP and CAP	SD-27
Pipe Bedding and Initial Backfill.....	SD-28
No Dumping Public Notice Detail	SD-29
Stream Gauging Station.....	SD-30

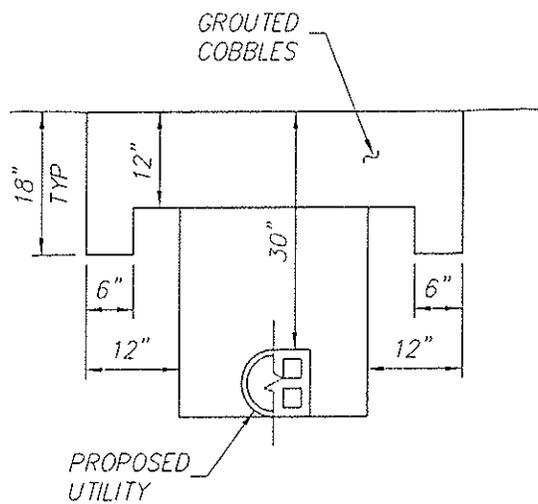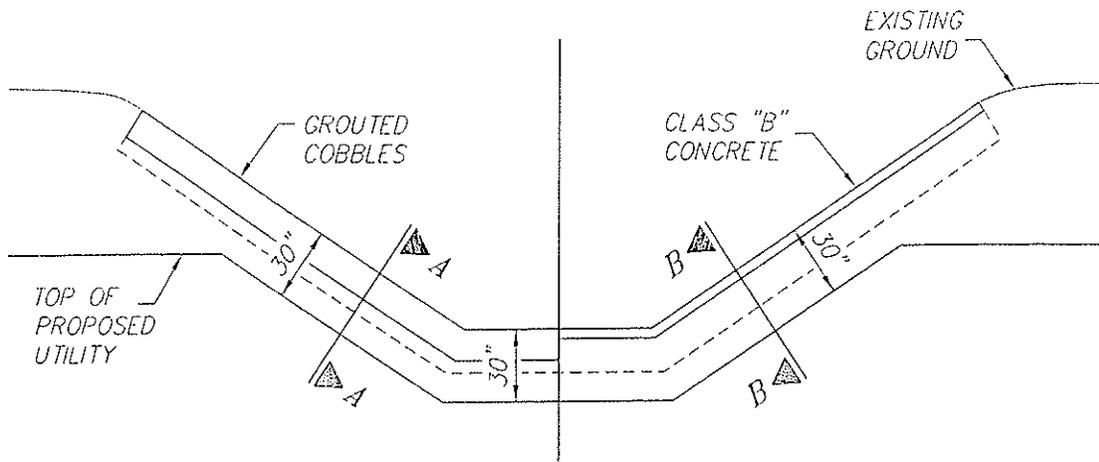

SECTION A-A

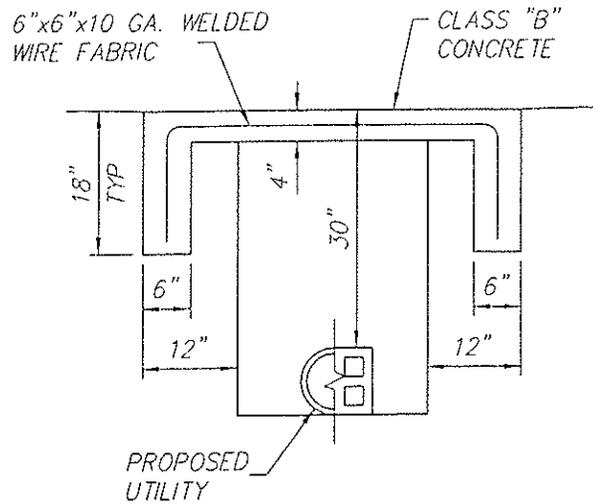

SECTION B-B

NOTES:

1. ALL UTILITY CROSSINGS OF EXISTING STREAMS SHALL BE AT LEAST 30" BELOW EXISTING CHANNEL SIDES AND BOTTOMS. DEEPER PLACEMENT MAY BE REQUIRED IF FUTURE CHANNEL IMPROVEMENTS ARE ANTICIPATED.
2. THE CUT SHALL BE SEALED AS SHOWN WITH GROUTED COBBLES, CLASS "B" CONCRETE OR OTHER APPROVED MATERIAL TO A WIDTH 12" EACH SIDE OF THE UTILITY TRENCH. ALL NATURAL STREAMS, AS SHOWN ON THE NATURAL STREAMS PLAN, SHALL UTILIZE GROUTED COBBLES.

APPROVED BY:

Brian J. Fragia

BRIAN J. FRAGIA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

**UTILITY STREAM
CROSSING DETAIL**


DEPARTMENT OF PUBLIC WORKS

SD-1

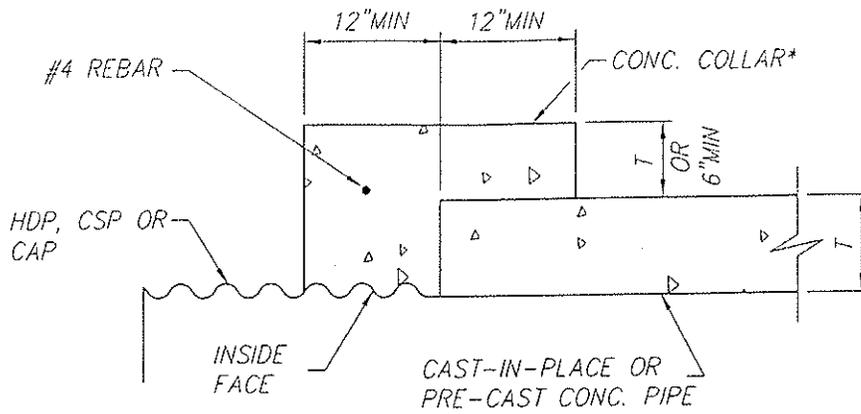


CAST-IN-PLACE OR PRE-CAST
CONCRETE PIPE TO CSP OR CAP


*TRANSITION OF PIPE MATERIAL
AT MANHOLES IS PREFERRED

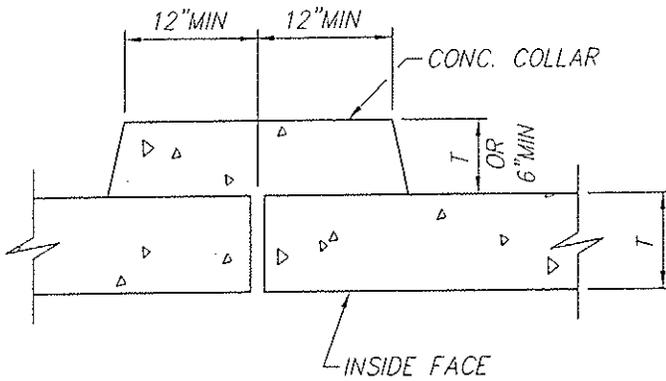

CONCRETE PIPE TO CONCRETE PIPE
WITHOUT STANDARD JOINT

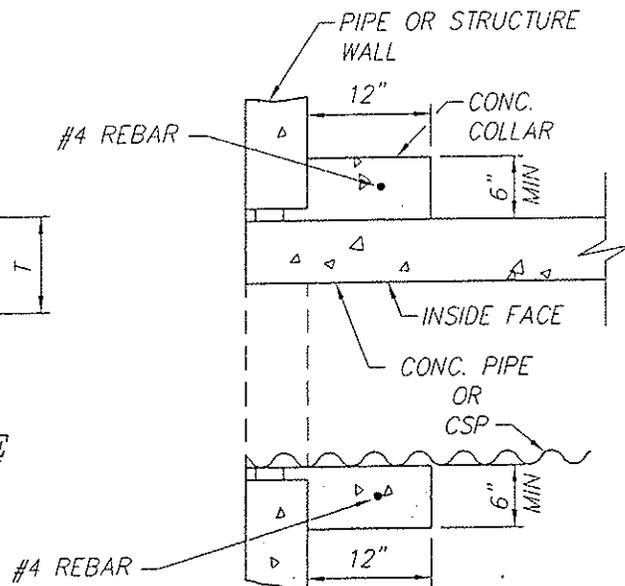

CONCRETE PIPE, CAP
CSP INTO EXISTING
PIPE OR STRUCTURE

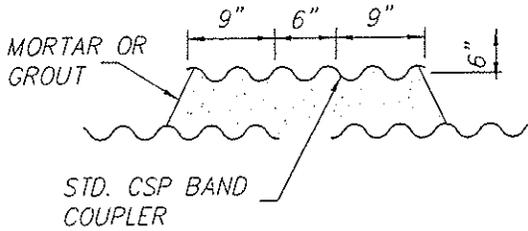

PIPES OF
DISSIMILAR METALS

APPROVED BY:

Brian Fragiad
BRIAN J. FRAGIAD
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:






TOWN OF LOOMIS

PIPE CONNECTIONS
DETAIL

SD-2

DEPARTMENT OF PUBLIC WORKS

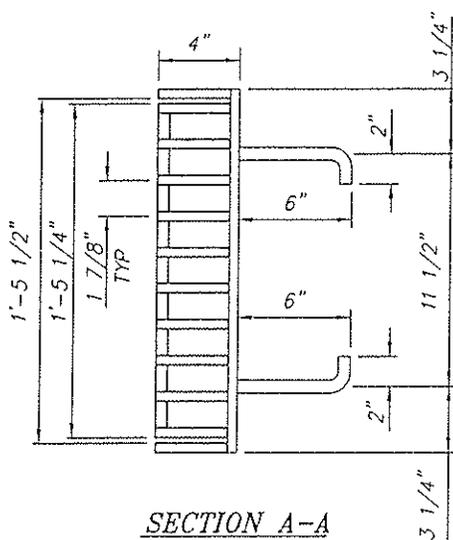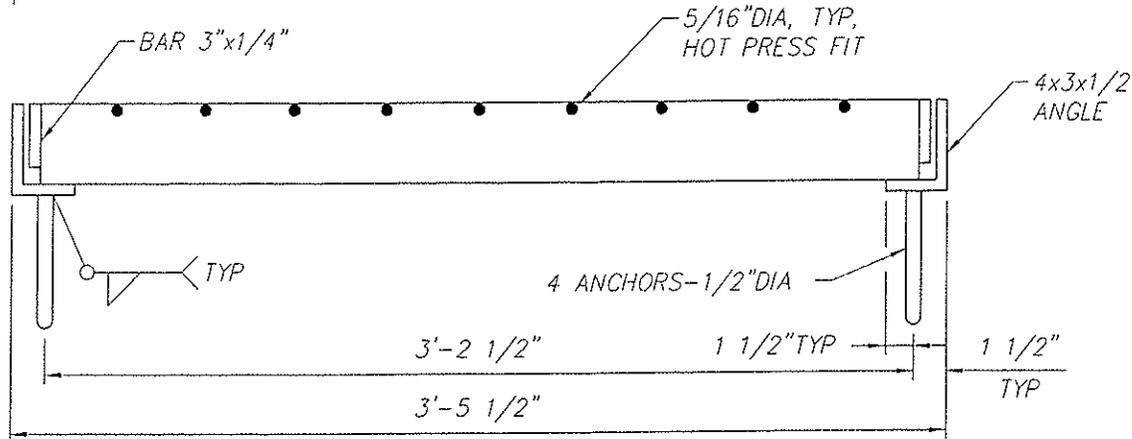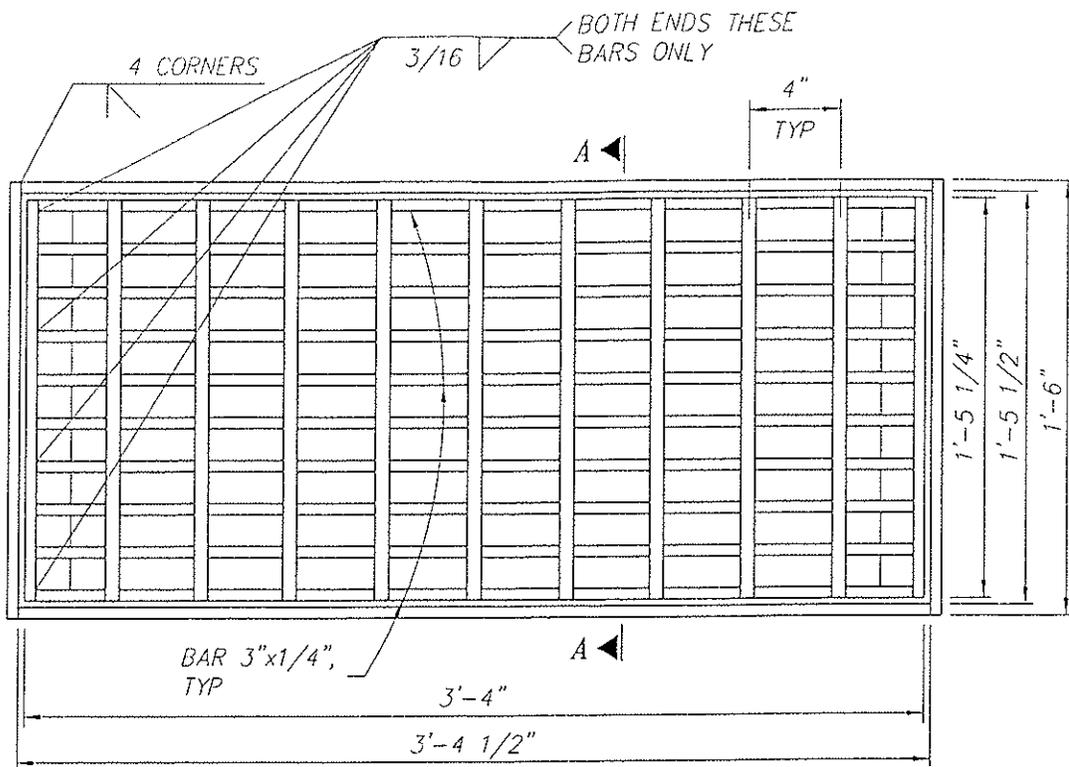

NOTE: AT THE CONTRACTOR'S OPTION, END SPACING OF 5/16" CROSS RODS MAY BE 2". INTERIOR SPACING SHALL REMAIN 4".

APPROVED BY:

Brian J. Fraciac
 BRIAN J. FRACIAC
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:








TOWN OF LOOMIS


DROP INLET FRAME AND GRATE
 TYPE "B", "C", DROP INLETS

DEPARTMENT OF PUBLIC WORKS

SD-3

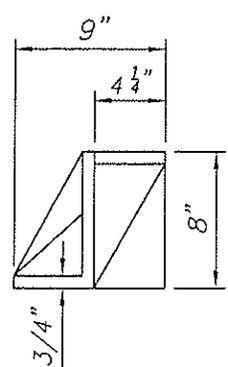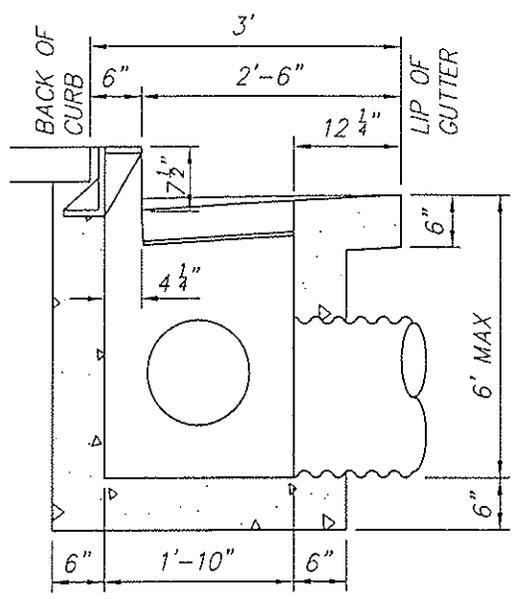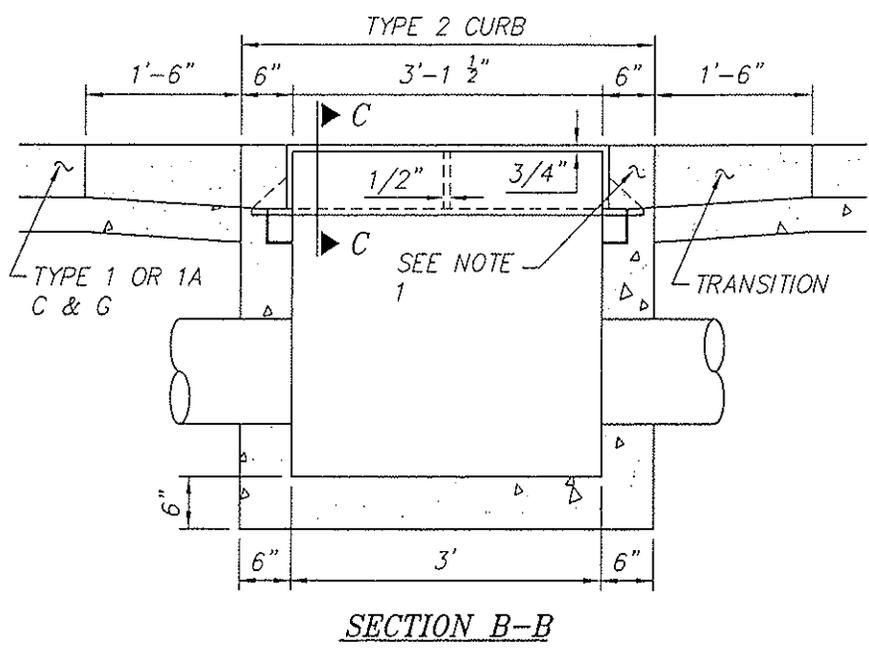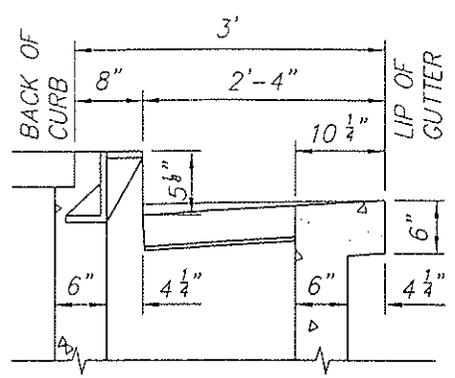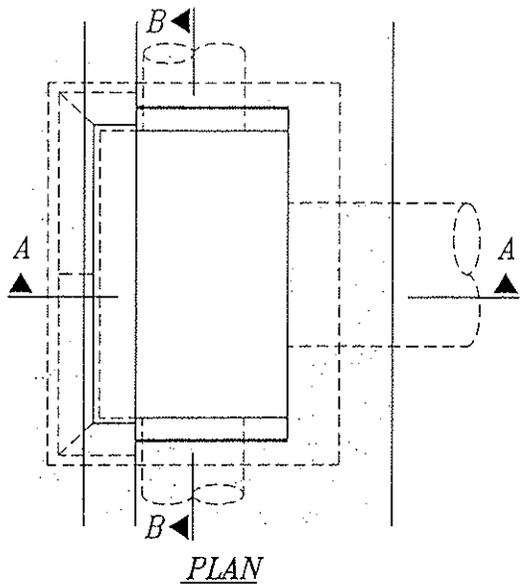


- NOTES:
1. CONSTRUCT 6" OF VERTICAL CURB BEFORE BEGINNING TRANSITION ON TYPE 1 C & G.
 2. SEE DRAWING SD-5 FOR GUTTER DEPRESSION
 3. BOTTOM OF INLET SHALL BE PLACED PRIOR TO OR AT THE SAME TIME AS SIDE WALLS.
 4. FRAME AND GRATE SHALL CONFORM TO DRAWING SD-3.
 5. OPEN-BACK HOOD SHALL BE CAST IRON. TOP OF HOOD SHALL HAVE THE "NO DUMPING FLOWS TO CREEK" STAMP.
 6. REINFORCING STEEL OR MESH TO BE USED FOR DEPTHS GREATER THAN 4'.

APPROVED BY:

 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
 DROP INLET
 TYPE "B"
 DEPARTMENT OF PUBLIC WORKS

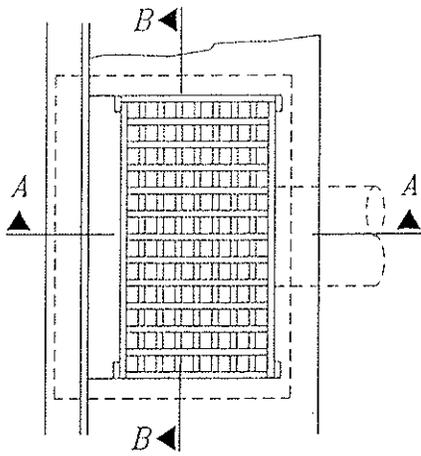
SD-4




PLAN

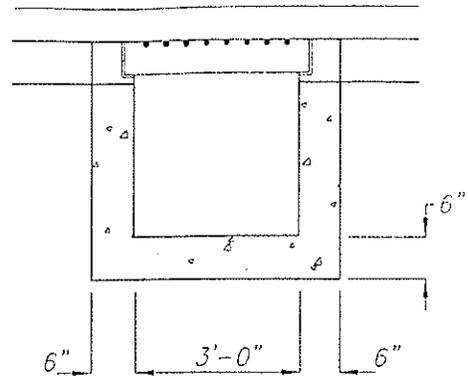


SECTION B-B

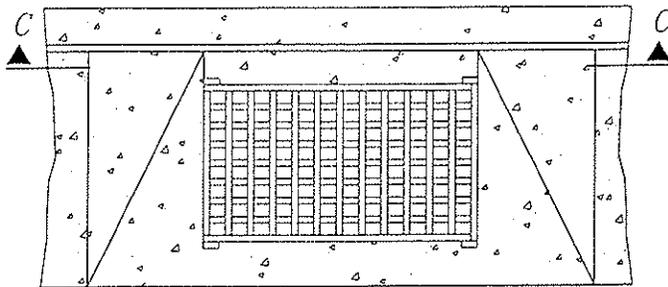


PLAN
STANDARD DEPRESSION

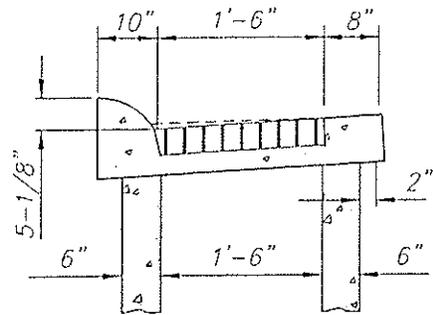

TYPE 1 CURB SECTION A-A

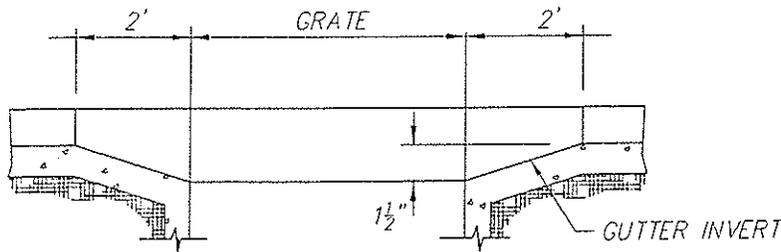

STANDARD DEPRESSION SECTION C-C

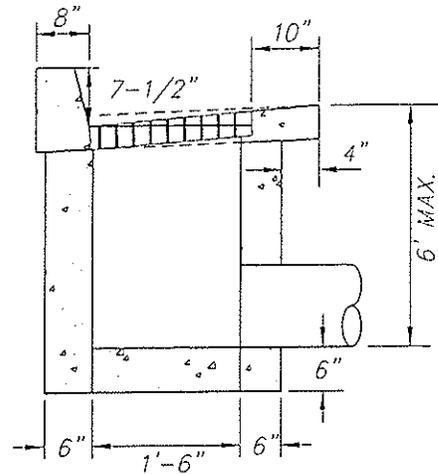

TYPE 2 CURB SECTION A-A

NOTES:

1. BOTTOM OF INLET SHALL BE PLACED PRIOR TO OR AT THE SAME TIME AS SIDE WALLS.
2. FRAME AND GRATE SHALL CONFORM TO DRAWING SD-3.
3. REINFORCING STEEL OR MESH TO BE USED IN DEPTHS GREATER THEN 4'

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER






TOWN OF LOOMIS

**DROP INLET
TYPE "C"**

SD-5

REVISED:

DEPARTMENT OF PUBLIC WORKS

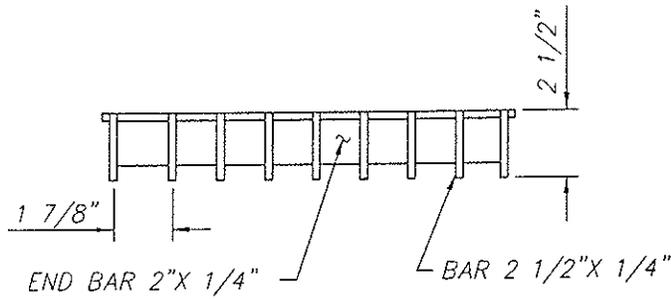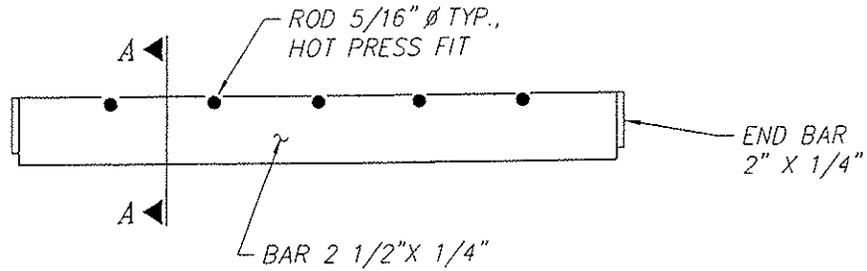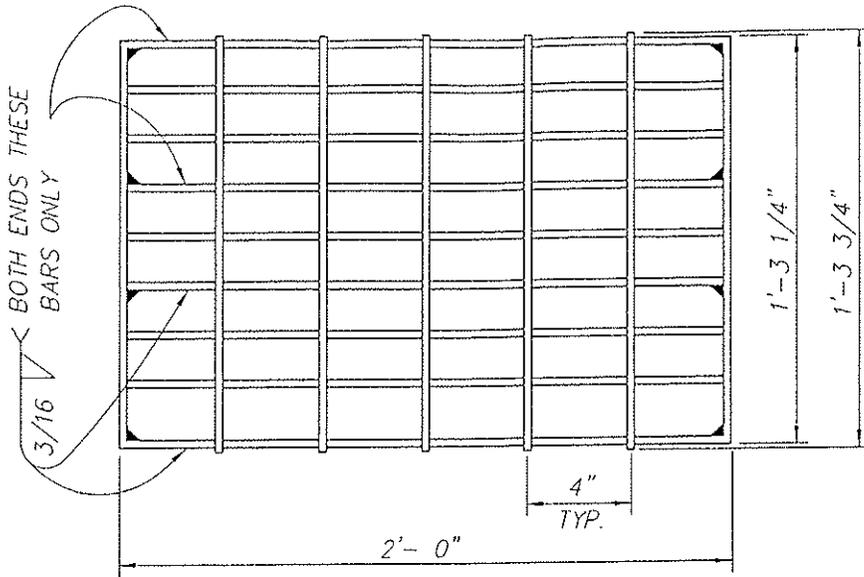

SECTION A-A

NOTES:

1. INSTALLED GRATE SHALL BE PERMANENTLY SECURED TO FRAME WITH 12" LENGTH OF GALVANIZED CHAIN.
2. AT THE CONTRACTOR'S OPTION, END SPACING OF 5/16" CROSS RODS MAY BE 2". INTERIOR SPACING SHALL REMAIN AT 4".

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER






REVISED:




TOWN OF LOOMIS
DROP INLET GRATE
FOR TYPE "D" & "E"
DROP INLETS

DEPARTMENT OF PUBLIC WORKS

SD-6

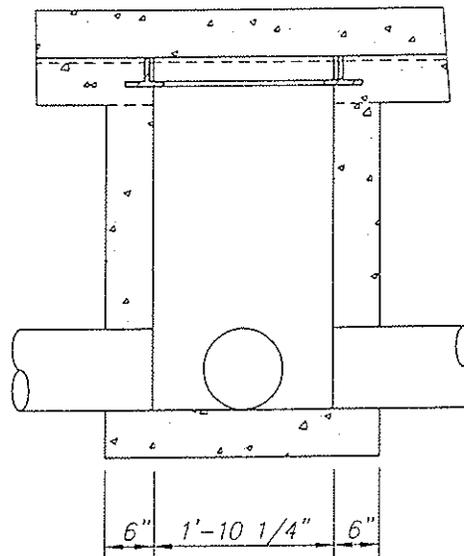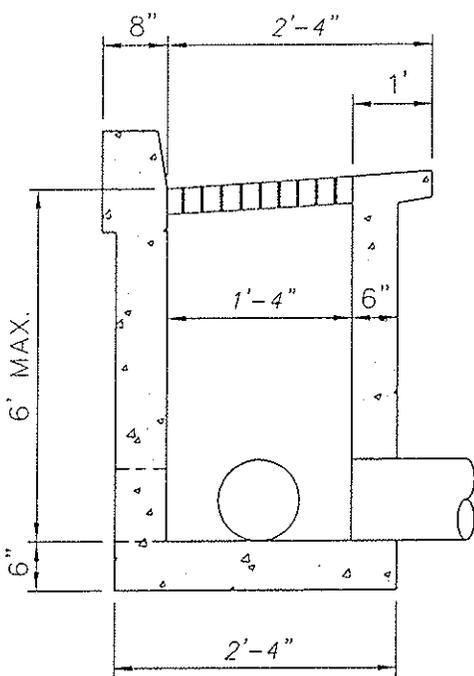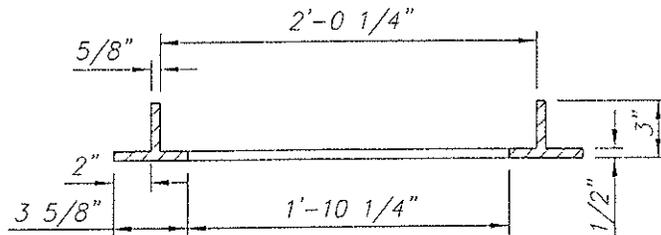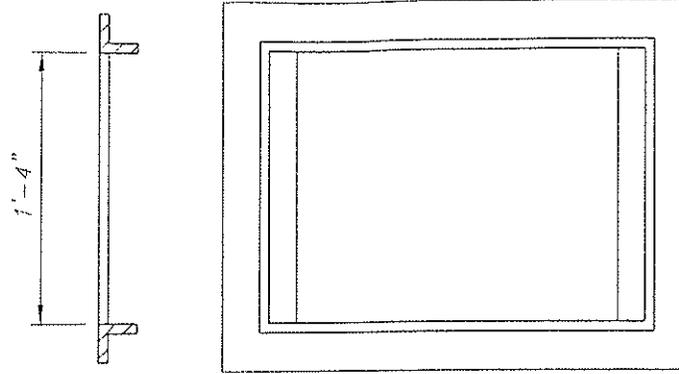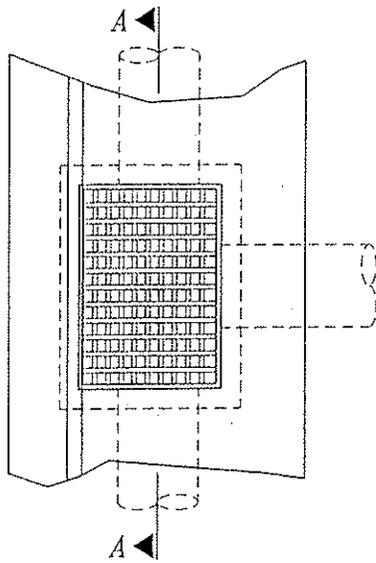

SECTION A-A

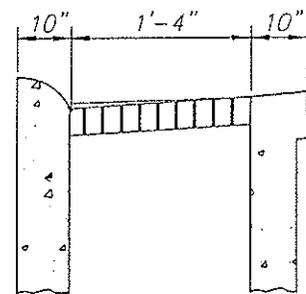

TYPE 1 CURB

TYPE 2 VERTICAL CURB

NOTES:

1. SEE DRAWING SD-5 FOR GUTTER DEPRESSION
2. SEE DRAWING SD-6 AND SD-8 FOR FRAME & GRATE DETAIL.
3. 12" LENGTH OF 1/4" GALVANIZED CHAIN TO BE PERMANENTLY AFFIXED TO THE GRATE AND ONE CORNER OF THE INLET FRAME ADJACENT TO THE CURB.
4. BOTTOM OF INLET SHALL BE PLACED PRIOR TO OR AT THE SAME TIME AS SIDE WALLS.

APPROVED BY:

Brian J. Fragiad
 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:





TOWN OF LOOMIS

**DROP INLET
 TYPE "D"**


DEPARTMENT OF PUBLIC WORKS

SD-7

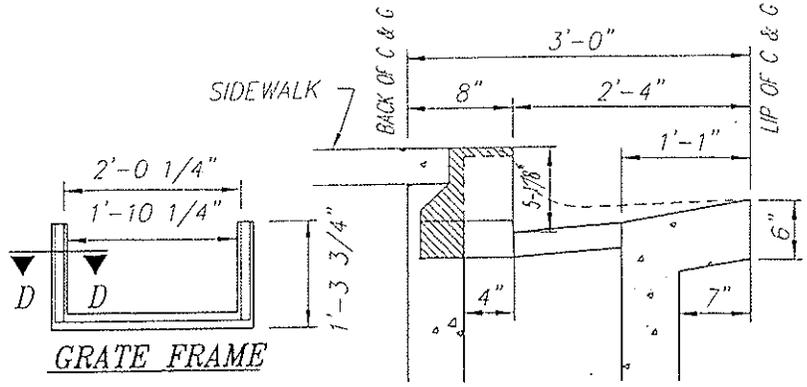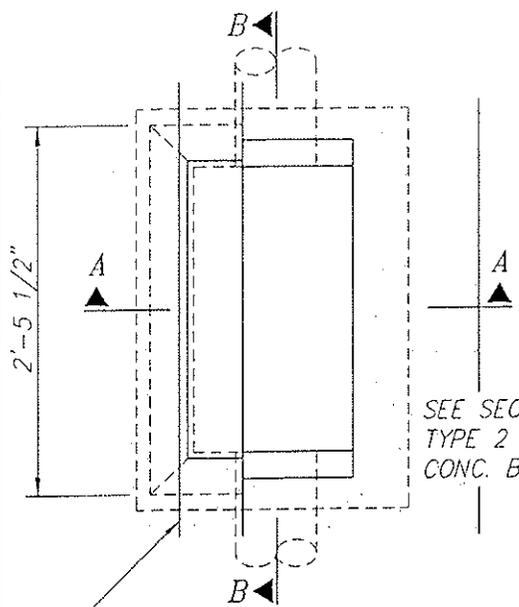


SEE SECTION A-A,
TYPE 2 C&G, FOR
CONC. BOX DETAILS


**TYPE 1 CURB
SECTION A-A**

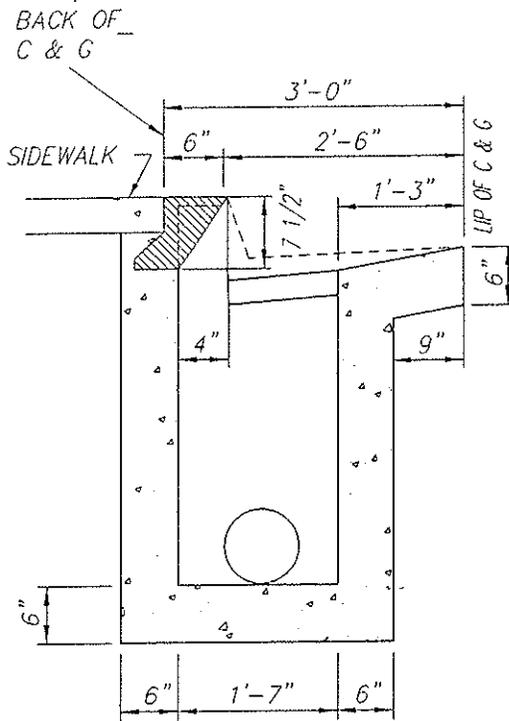


**TYPE 2 CURB
SECTION A-A**

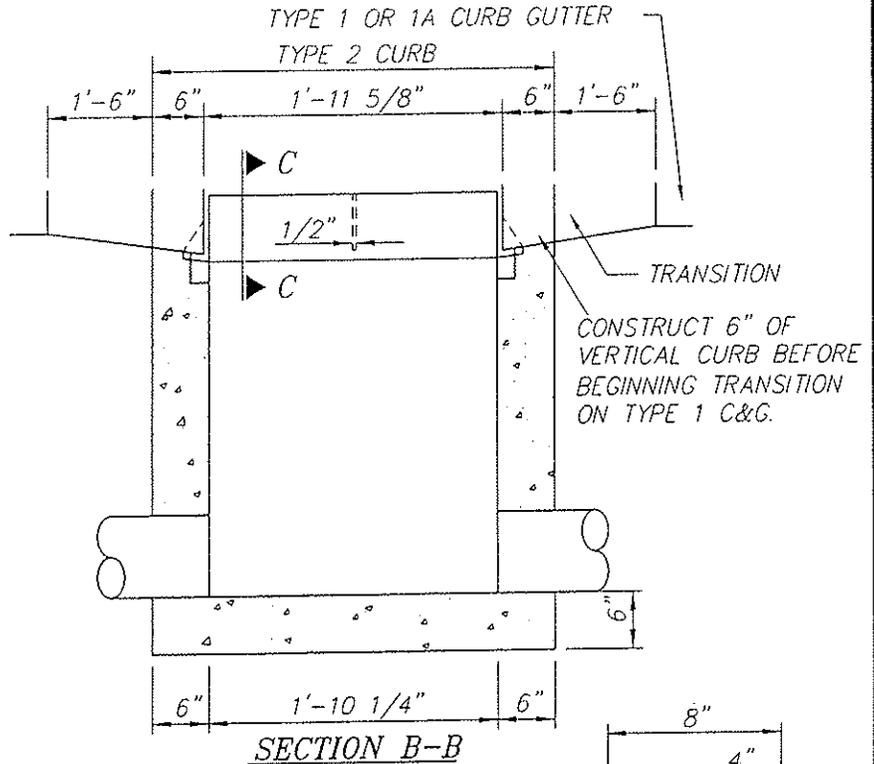

SECTION B-B

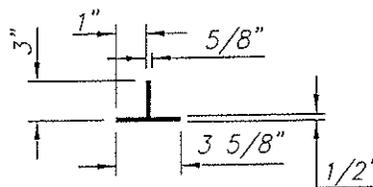

SECTION D-D

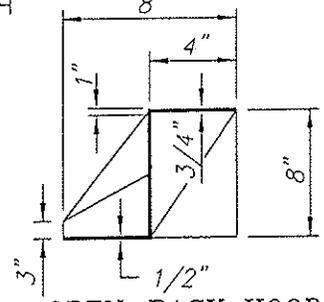

**OPEN-BACK HOOD
SECTION C-C**

NOTES:

1. SEE DRAWING SD-5 FOR GUTTER DEPRESSION
2. BOTTOM OF INLET SHALL BE PLACED PRIOR TO OR AT THE SAME TIME AS THE SIDEWALLS.
3. SEE DRAWING SD-6 FOR GRATE DETAIL.
4. THIS STRUCTURE IS TO SERVE ONLY TO PICK UP GUTTER DRAINAGE OR AS A JUNCTION BOX FOR SMALL PIPES IN A LONGITUDINAL DIRECTION ONLY.
5. 12" LENGTH OF 1/4" GALVANIZED CHAIN TO BE PERMANENTLY AFFIXED TO THE GRATE AND ONE CORNER OF THE INLET FRAME ADJACENT TO THE CURB.
6. OPEN-BACK HOOD & GRATE FRAME SHALL BE CAST IRON.

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS



**DROP INLET
TYPE "E"**

DEPARTMENT OF PUBLIC WORKS


SD-8

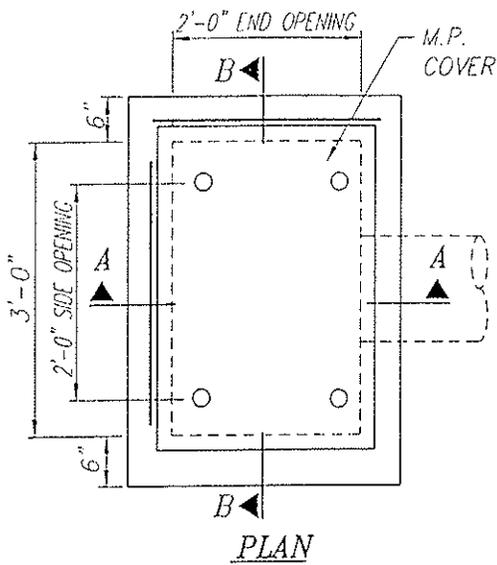

1-1/4"x1-1/4"x3/16"
L
AT 15 FILLET WELD
TO COVER

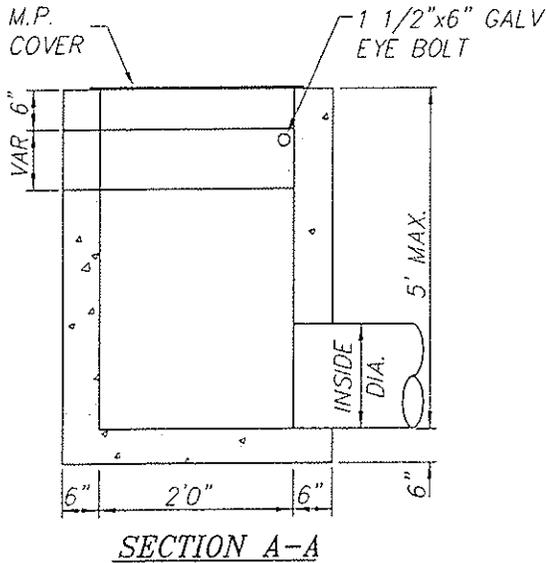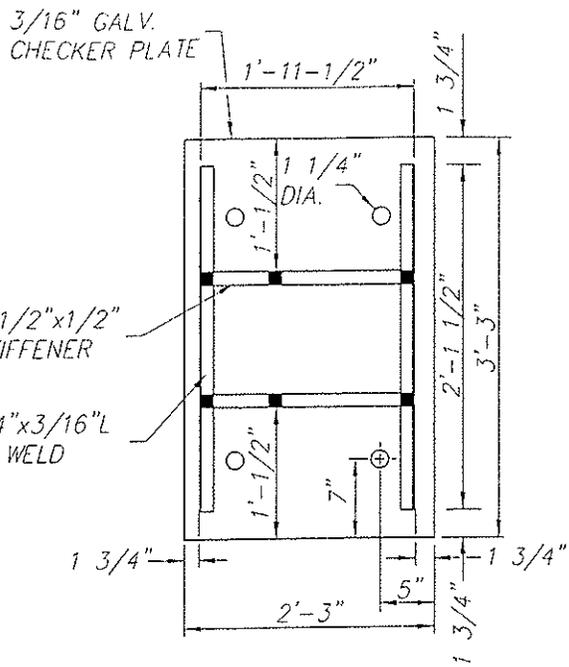

PLACE 1/2" DIA. HORIZONTAL BAR IN CENTER OF SIDE OR END OPENING GREATER THAN 6"

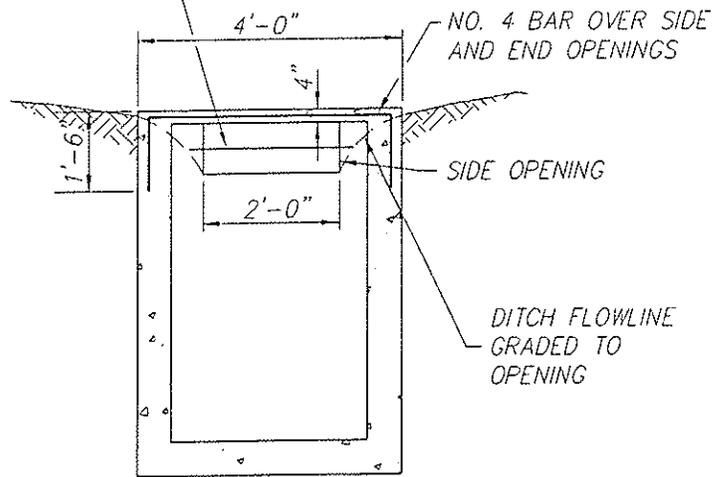

NOTES:

1. TOP OF WALLS TO BE FINISHED TO A FLAT PLANE TO PROVIDE EVEN BEARING FOR PLATE COVER.
2. PROVIDE 1/4" x 18" GALV. CHAIN WELD TO COVER AND EYE BOLT.
3. PROVIDE END OR SIDE OPENINGS AS SHOWN ON PLAN OR CROSS SECTION AND EYE BOLT.
4. METAL PLATE COVER TO BE GALVANIZED.

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

**DROP INLET
TYPE "F"**


DEPARTMENT OF PUBLIC WORKS

SD-9


MIN. WEIGHT OF PRECAST REINFORCED CONCRETE COVER IS 80 LBS.

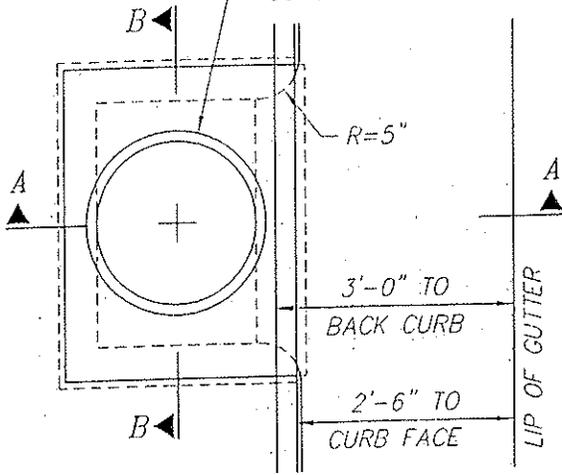


PLAN

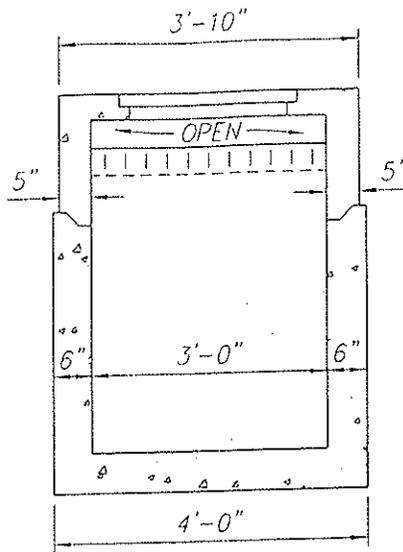


SECTION B-B

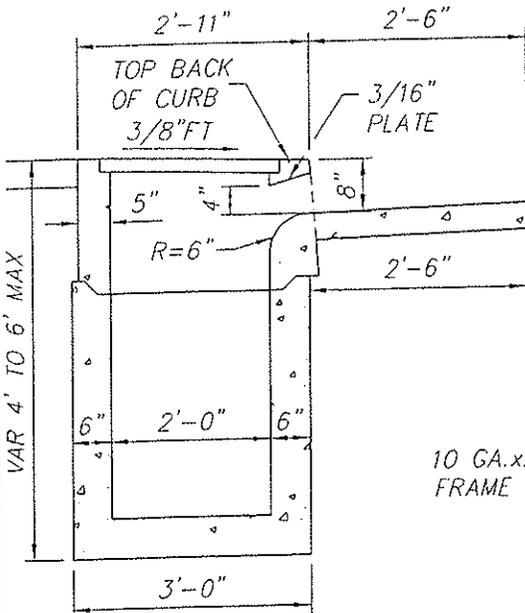


SECTION A-A

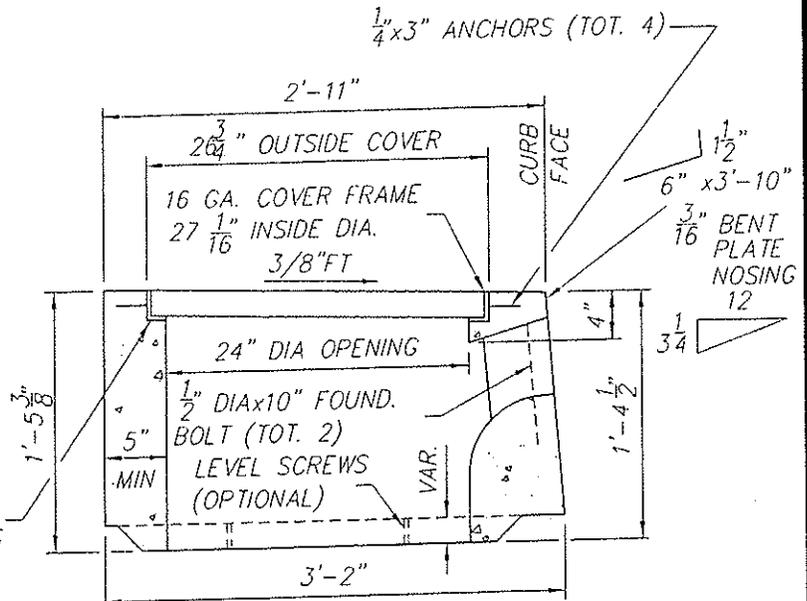

CURB INLET DETAIL

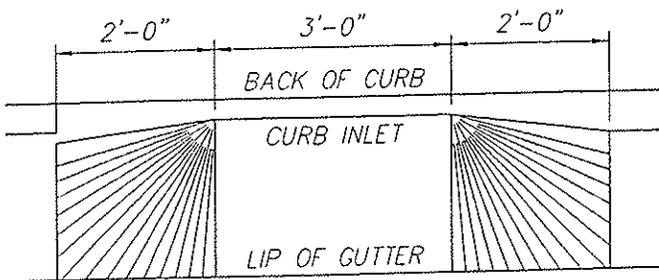

GUTTER TRANSITION PLAN

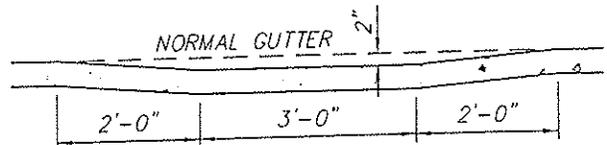

GUTTER TRANSITION ELEVATION

NOTES:

1. CURB INLET ASSEMBLY MAY BE PRECAST CONCRETE, FIBER GLASS FORMLINER WITH CLASS "B" P.C.C. OR FORMED AND CAST-IN-PLACE P.C.C.
2. ALL METAL SHALL BE HOT DIPPED GALV. ASTM A123.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS



**DROP INLET
 TYPE "G"**

DEPARTMENT OF PUBLIC WORKS


SD-10

TRASH RACK LATCH LINKAGE, SEE TABLE AT RIGHT FOR SIZE OF SQUARE TUBING STOCK FOR FABRICATION

FASTEN LATCH LINKAGE TO ANCHOR WITH CHAIN AND PADLOCK

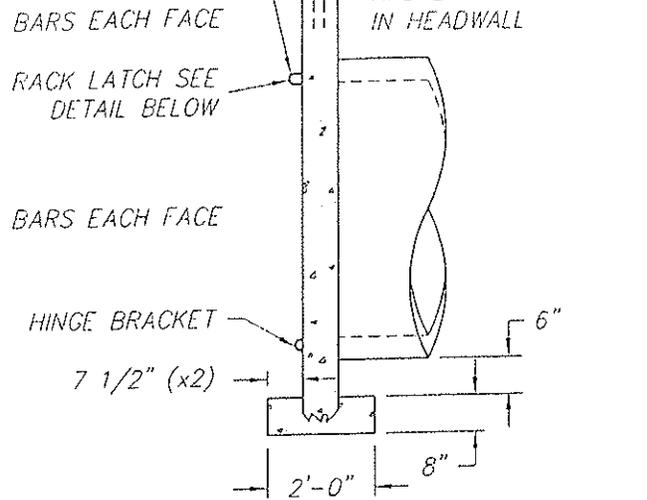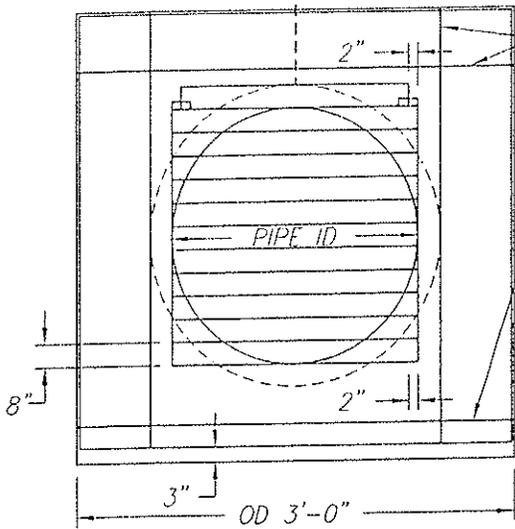

LATCH LINKAGE - SEE TABLE FOR SIZE OF SQUARE TUBING STOCK FOR FABRICATION

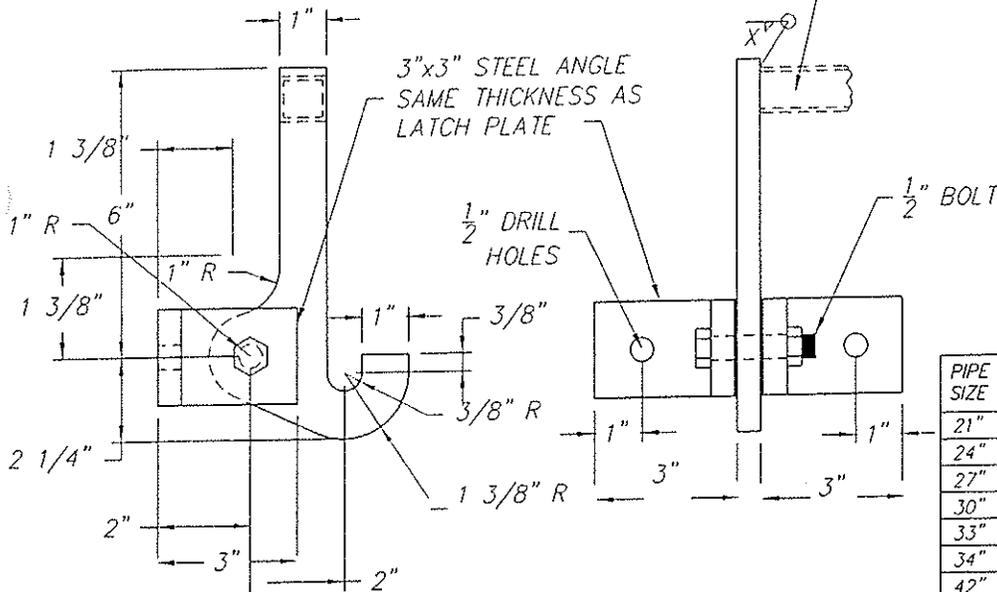

PIPE SIZE	RACK BAR SIZE	LATCH PLATE THICKNESS	LATCH PLATE SIZE
21"	#4	1/4"	1", .095" THICK
24"	*	*	*
27"	#5	*	*
30"	*	3/8"	*
33"	#6	*	*
34"	*	*	1", .133" THICK
42"	#7	*	*
48"	*	1/2"	*
54"	*	*	*
60"	#8	*	*
66"	*	*	*
72"	*	*	*
84"	*	*	*

NOTES:

- ENTIRE RACK TO BE WELDED REINFORCING STEEL OR ROUND BARS OF EQUAL DIA WITH HORIZONTAL BARS BEING 8" CENTER TO CENTER
- USE CLASS "B" CONCRETE.
- ROOM SHALL BE PROVIDED DOWNSTREAM TO LAY RACK FLAT.
- FASTEN LATCH BRACKET, TO HEADWALL WITH 1/2"x6" BOLTS
- WHEN RACK BAR SHALL BE TIGHT AGAINST THE TOP OF THE HINGE BRACKET SO THAT THE RACK CANNOT BE LIFTED OFF THE LATCH.
- FABRICATE HINGE BRACKET FROM #4 RE-BAR.
- ALL REINFORCING STEEL SHALL HAVE 2" EMBEDMENT EXCEPT AS NOTES

APPROVED BY:

Brian J. Fraciao
 BRIAN J. FRACIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

PIPE OUTFALL-ACCESS
 CONTROL RACK

DEPARTMENT OF PUBLIC WORKS


SD-11

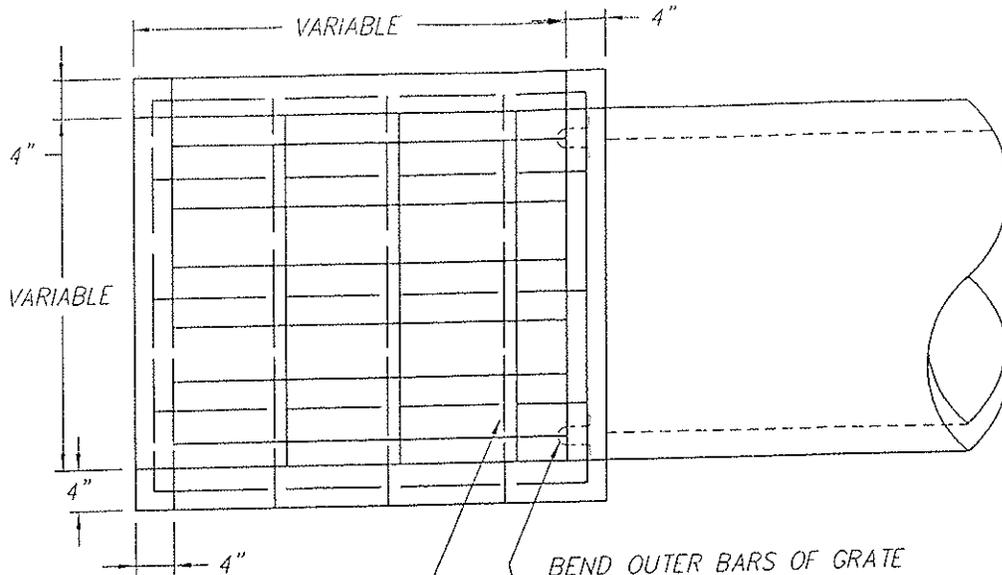

TOP VIEW

BEND OUTER BARS OF GRATE INTO AN 'EYE' AND CONNECT TO 'EYE' OF 'U' BARS SET INTO WALL.

CONSTRUCT TRASH RACK OF #5 BARS
8" CENTERS VERTICAL AND
16" CENTERS HORIZONTAL.

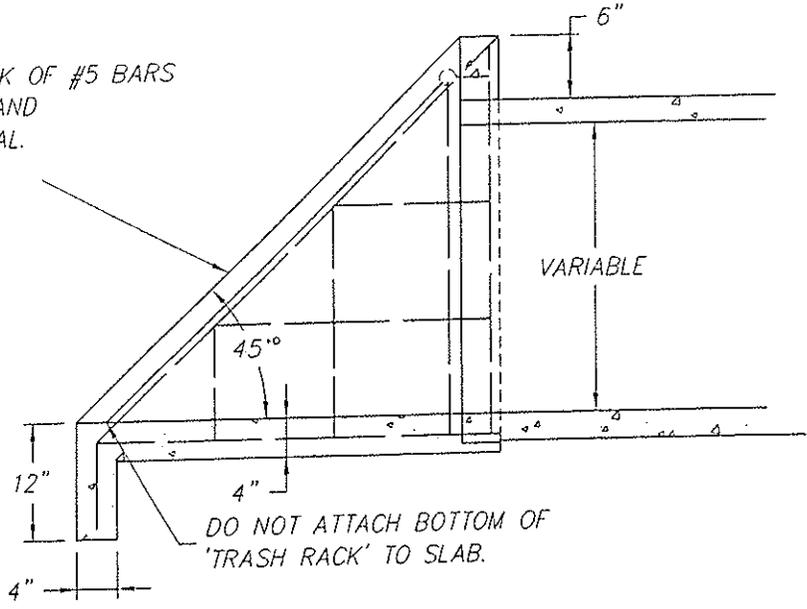

SIDE VIEW

NOTE: ALL REINFORCING TO BE #4 @ 12"
USE CLASS 'B' CONCRETE

APPROVED BY:


Brian J. Fragio
BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS
PIPE INLET STRUCTURE
AND TRASH
RACK (30" PIPE & SMALLER)
DEPARTMENT OF PUBLIC WORKS

SD-12


REVISED:

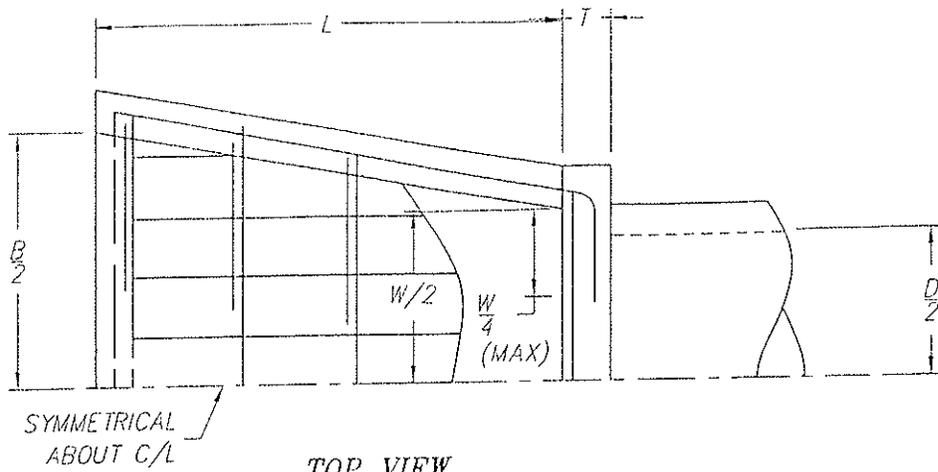

TOP VIEW

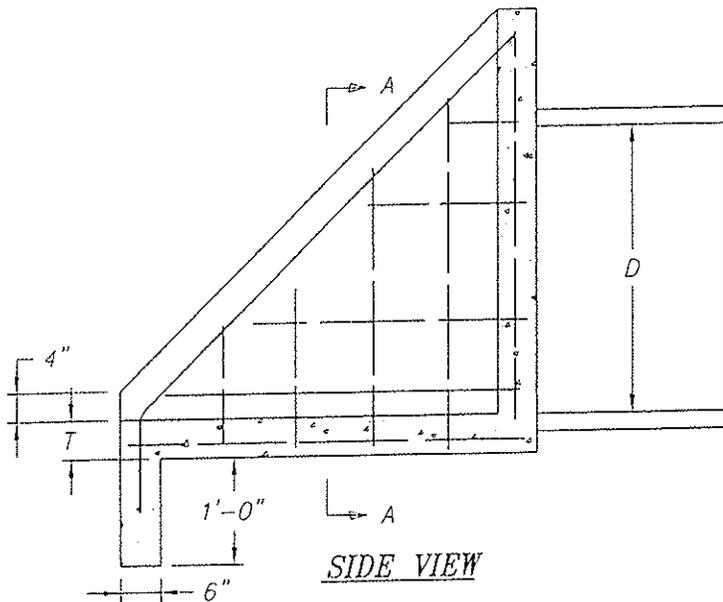

SIDE VIEW

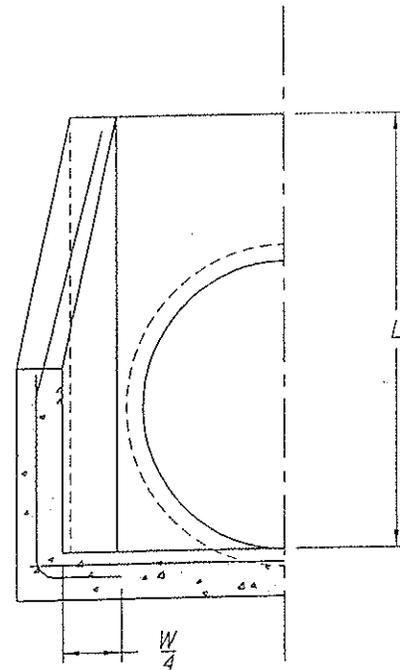

HALF SECTION A-A

DIMENSIONS AND REINFORCING

D	W	B	L	T	ALL REINFORCING
33"	3'-3"	5'-3"	4'-0"	6"	#3 \odot 12"
36"	3'-8"	5'-8"	4'-2"	6"	#3 \odot 12"
42"	4'-4"	6'-4"	4'-8"	6"	#3 \odot 12"
48"	4'-10"	7'-2"	5'-2"	8"	#6 \odot 12"
54"	5'-4"	8'-0"	6'-0"	8"	#6 \odot 12"
60"	6'-0"	8'-10"	6'-6"	8"	#6 \odot 12"

NOTES:

- "B" MAY BE REDUCED IF REQUIRED BY CHANNEL DIMENSIONS.
- REINFORCING BAR SPACING SHOWN IS MAXIMUM SPACING.
- USE CLASS 'B' CONCRETE.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS


PIPE INLET STRUCTURE

DEPARTMENT OF PUBLIC WORKS


SD-13

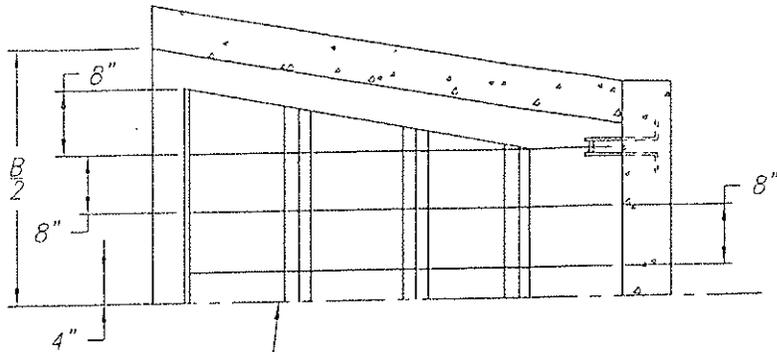

SYMMETRICAL ABOUT C/L
TOP VIEW

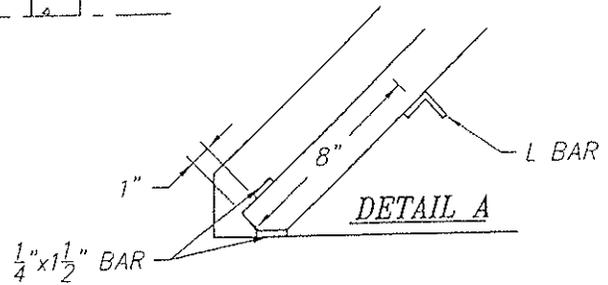


DETAIL A

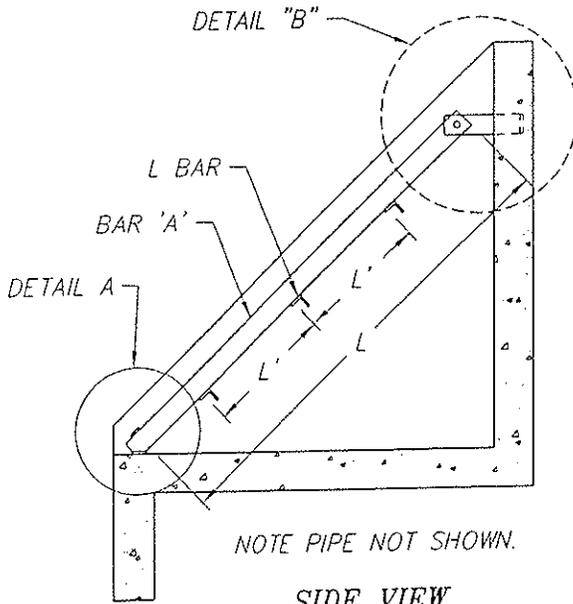

NOTE PIPE NOT SHOWN.

SIDE VIEW

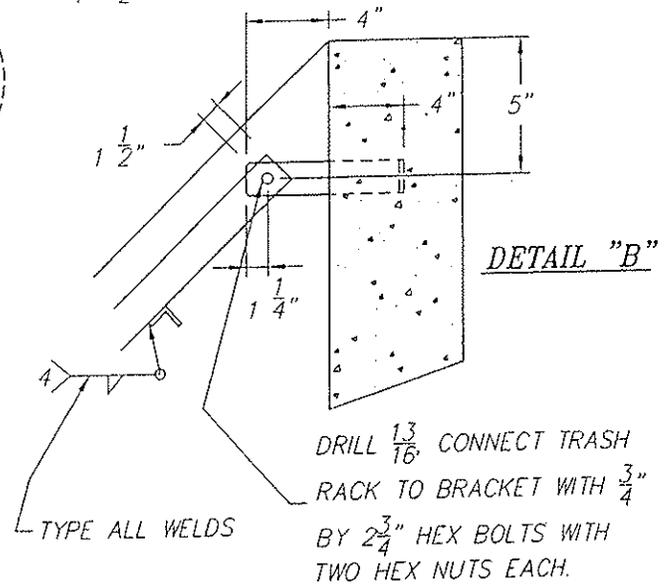

DETAIL B

DRILL $\frac{13}{16}$ CONNECT TRASH RACK TO BRACKET WITH $\frac{3}{4}$ BY $2\frac{3}{4}$ HEX BOLTS WITH TWO HEX NUTS EACH.

TRASH RACK DIMENSIONS

DIA.	NUMBER & SIZE		L	L'	S	H
	BAR 'A'	L BAR				
33"	8-3/8" x 2-1/2"	3-2 x 2 x 1/4	3'-1"	1'-10"	8"	3'-8"
36"	8-3/8" x 2-1/2"	3-2 x 2 x 1/4	3'-4"	1'-11"	8"	3'-10"
42"	9-3/8" x 2-1/2"	3-2 x 2 x 1/4	5'-11"	2'-3"	9"	4'-4"
48"	9-3/8" x 2-1/2"	4-2 x 2 x 1/4	6'-7"	1'-9"	10"	4'-10"
54"	10-3/8" x 3"	4-3 x 3 x 1/4	7'-9"	2'-1.5"	10.5"	5'-8"
60"	11-3/8" x 3-1/2"	4-3 x 3 x 1/4	8'-5"	2'-4"	11"	6'-2"

NOTES:

1. THIS TRASH RACK MAY BE USED WITH PIPE INLET STRUCTURES.
2. MATERIAL TO CONFORM TO ASTM DESIGNATION A-36.
3. 'S' MAY VARY WITH 'B' SEE PLATE.
4. ALL FILLET WELDS TO BE 3/16"
5. 2 HINGES REQUIRED FOR 33, 36 & 42 INCH PIPES.
3 HINGES REQUIRED FOR 48, 54 & 60

APPROVED BY:

Brian J. Fragaio
BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:





TOWN OF LOOMIS

**TRASH RACK
(33" PIPE & LARGER)**

DEPARTMENT OF PUBLIC WORKS


SD-14

B ← A ←
TOP VIEW

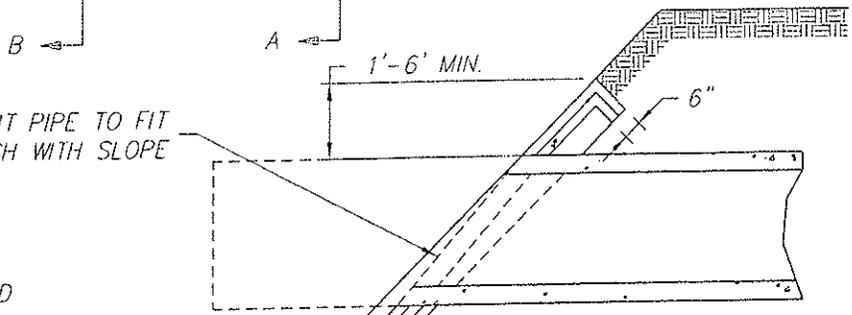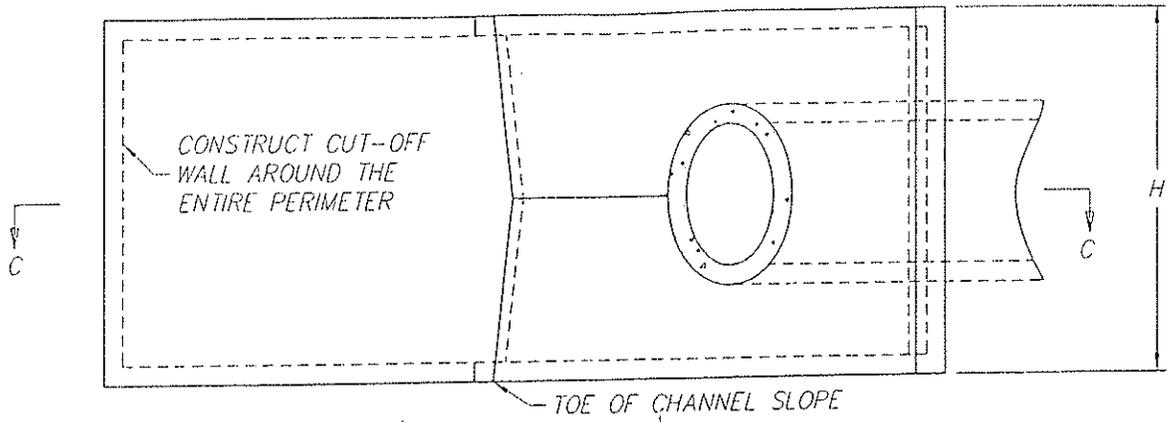


NOTES:


1. USE CLASS 'B' CONCRETE OR GROUTED COBBLES AS SPECIFIED
2. 6'x6'x10 GA. WIRA MESH THROUGHOUT CONCRETE

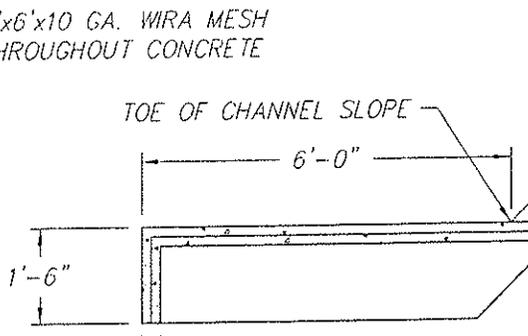


SECTION C-C

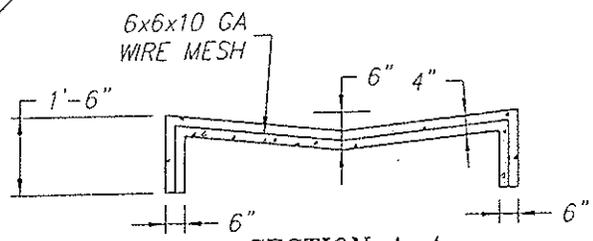


SECTION A-A

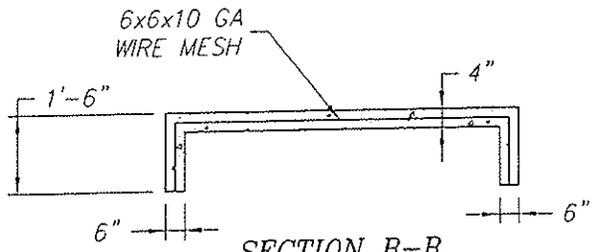

SECTION B-B

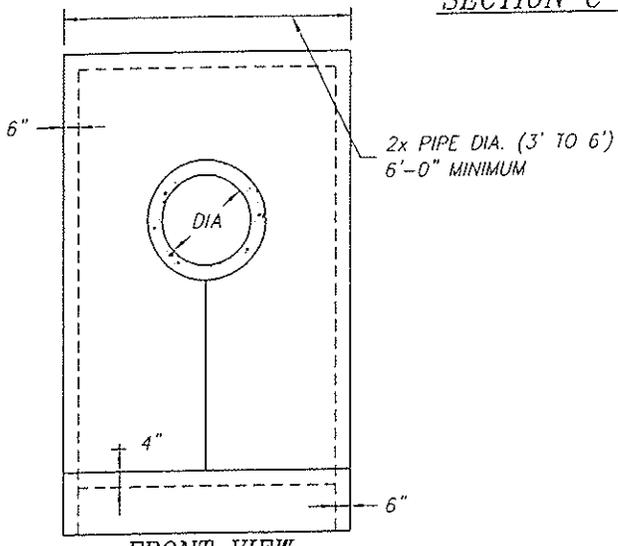

FRONT VIEW



APPROVED BY:

 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
**EROSION CONTROL
 PIPE DISCHARGE**
 DEPARTMENT OF PUBLIC WORKS

SD-15

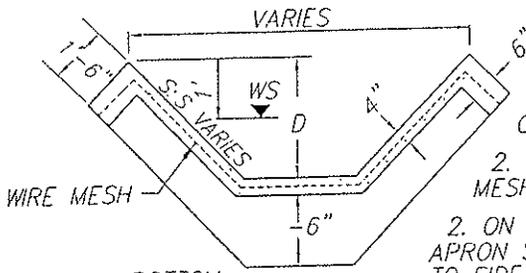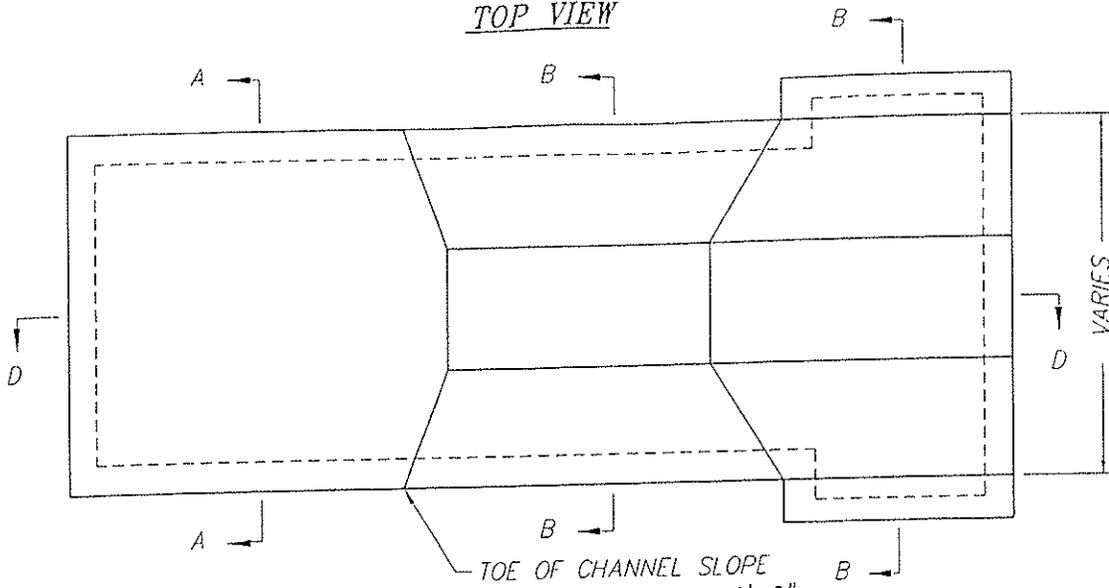
TOP VIEW




- NOTES:**
1. USE CLASS 'B' CONCRETE OR GROUTED COBBLES AS SPECIFIED.
 2. 6 X 6 X 10 GA WIRE MESH THROUGHOUT CONC.
 2. ON LINED CHANNELS, APRON SHALL CONNECT TO SIDE LINING.

B = DITCH BOTTOM WIDTH OR AS SHOWN ON PLANS


SECTION C-C

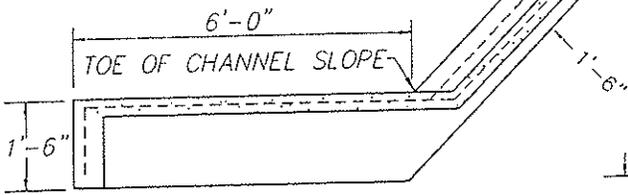


SECTION D-D

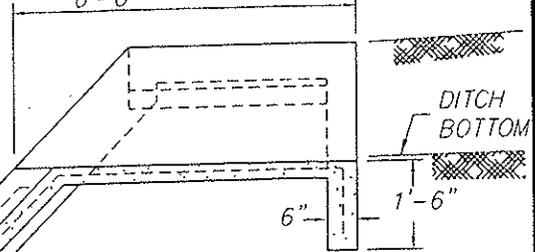


SECTION A-A

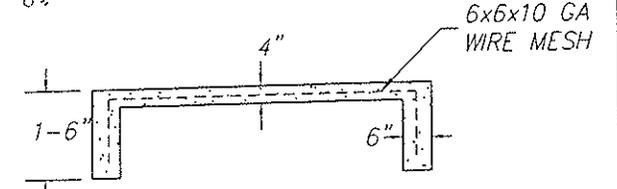

SECTION B-B

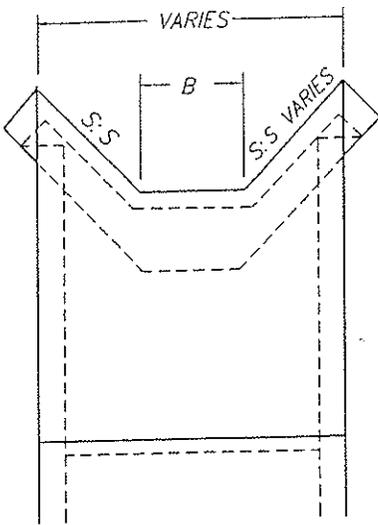



FRONT VIEW

APPROVED BY:

 BRIAN J. FRAGOLA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
**EROSION CONTROL
 - DITCH DISCHARGE**
 DEPARTMENT OF PUBLIC WORKS

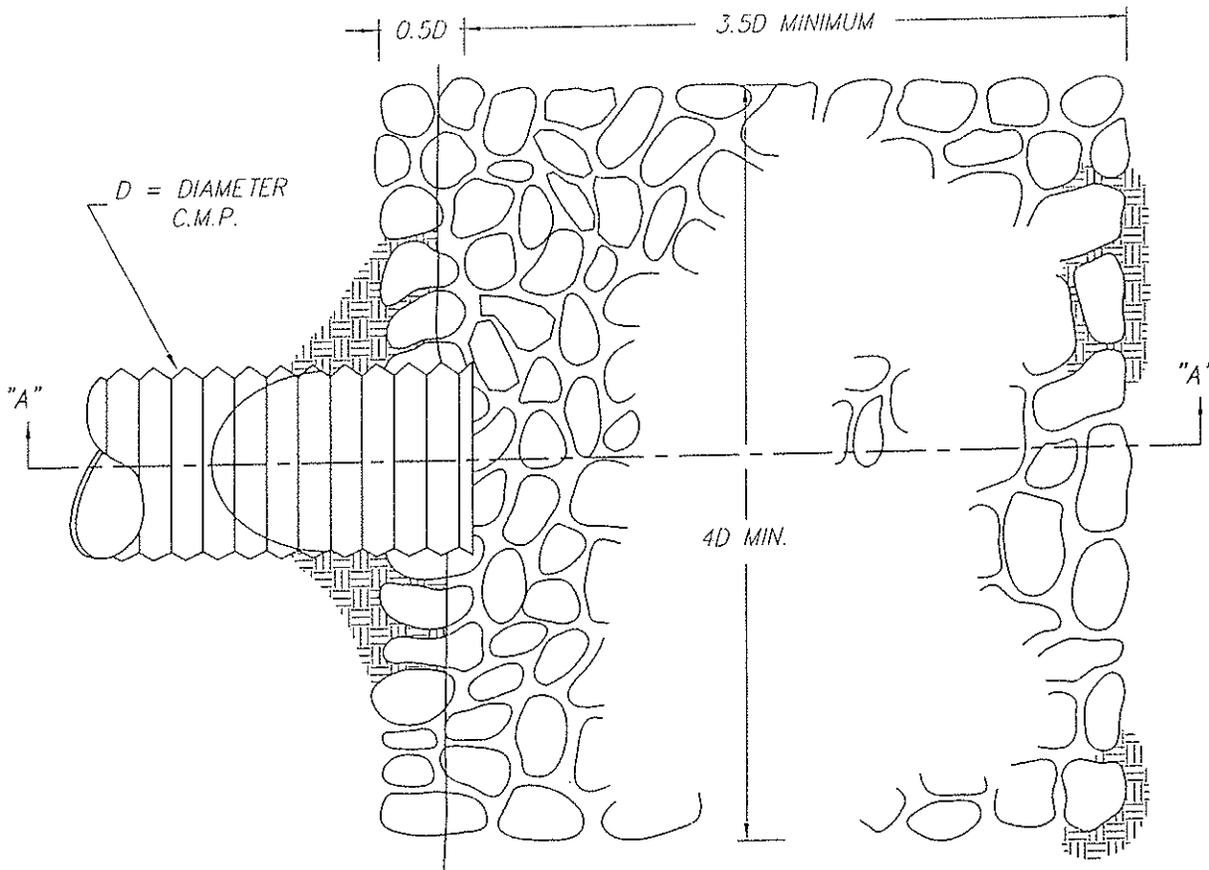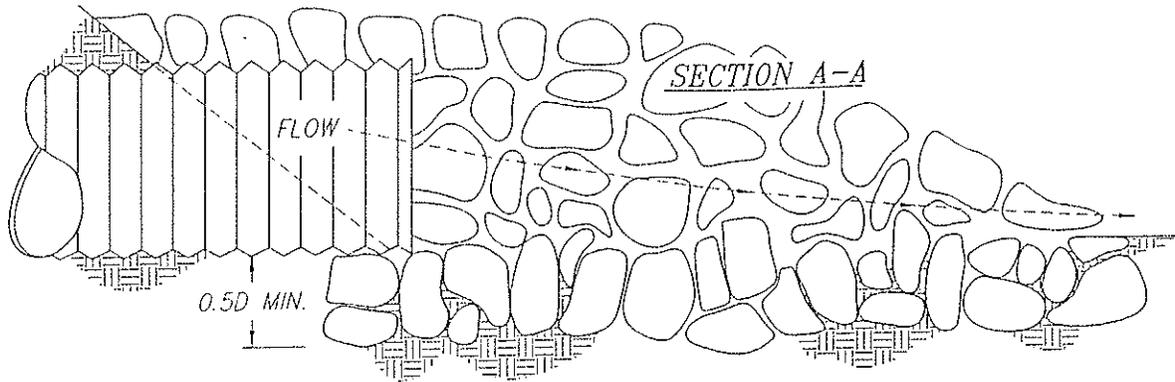SD-16



NOTE: 50% OF ROCK SHALL BE LARGER THAN 0.5D AND SHALL CONFORM TO SECTION 72 OF THE GENERAL SPECIFICATIONS OR REFER TO CHART D AND TABLE 2 OF "BANK AND SHORE PROTECTION IN THE CALIFORNIA HIGHWAY PRACTICE PAGES 112 AND 113.

APPROVED BY:

Brian J. Fragiaco

BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:






TOWN OF LOOMIS



CULVERT OUTFALL

DEPARTMENT OF PUBLIC WORKS

SD-17

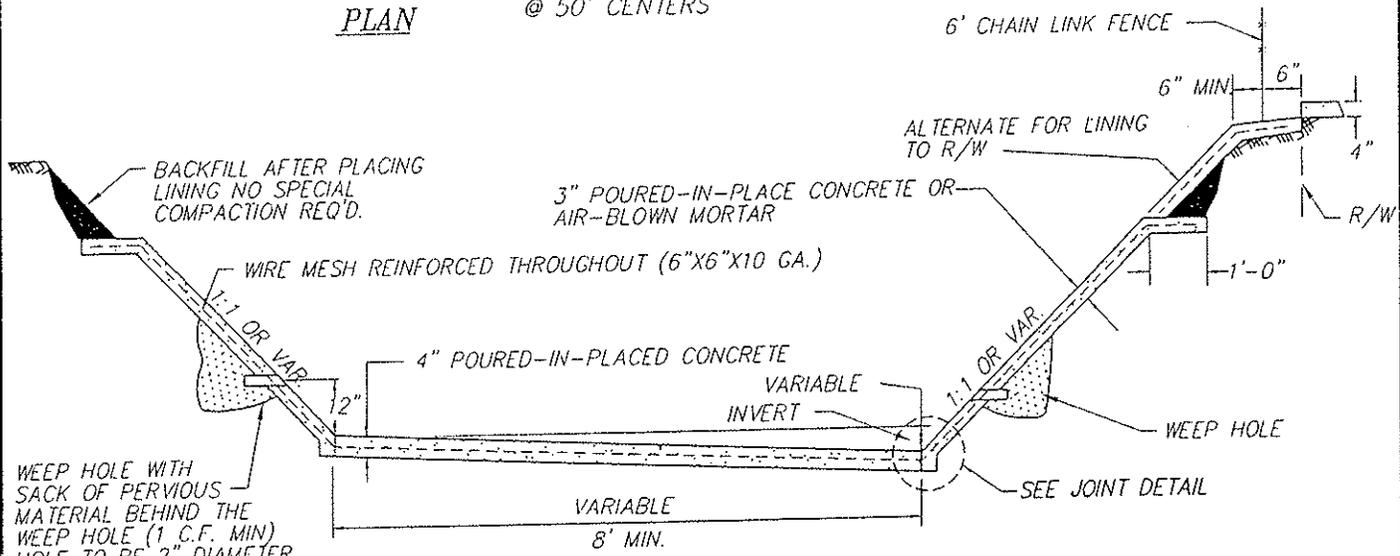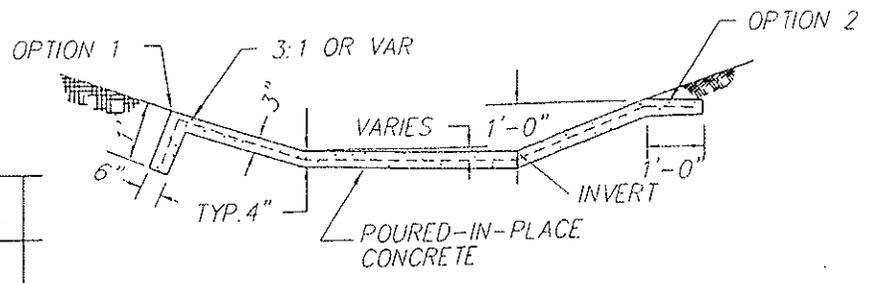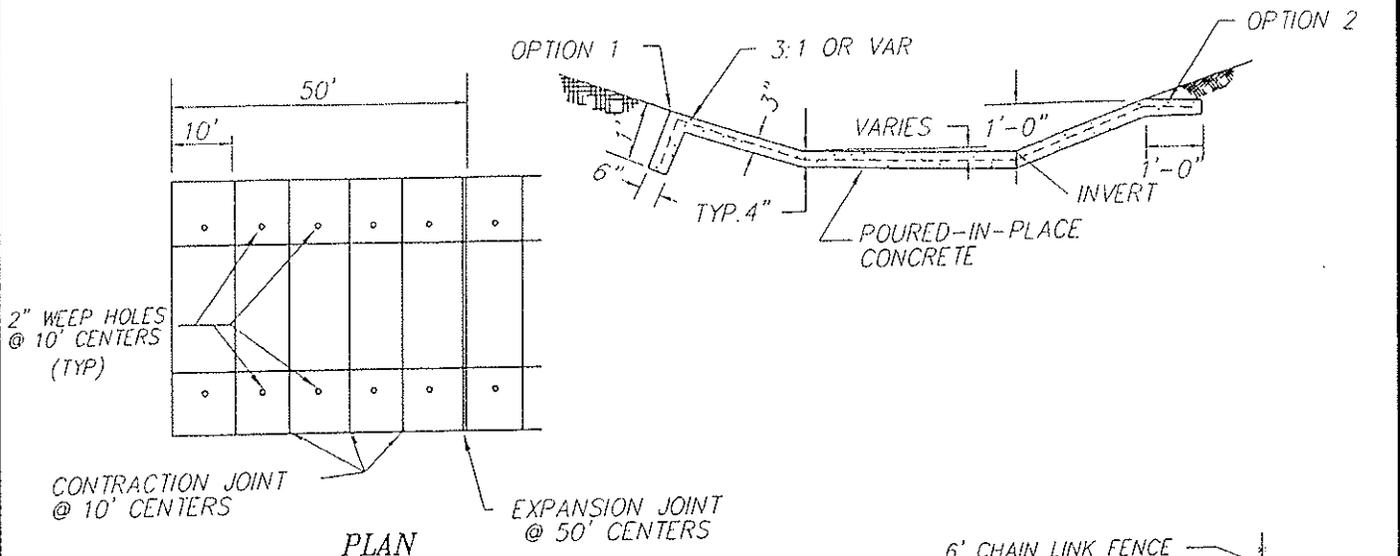

SECTION

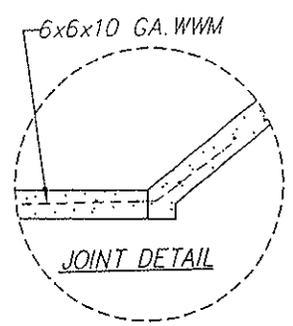

CUTOFF WALL

TO BE PLACED ALONG ENTIRE END OF LINED SECTION AT BEGINNING AND AT END OF LINING

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

LINED CHANNEL SECTION

DEPARTMENT OF PUBLIC WORKS


SD-18

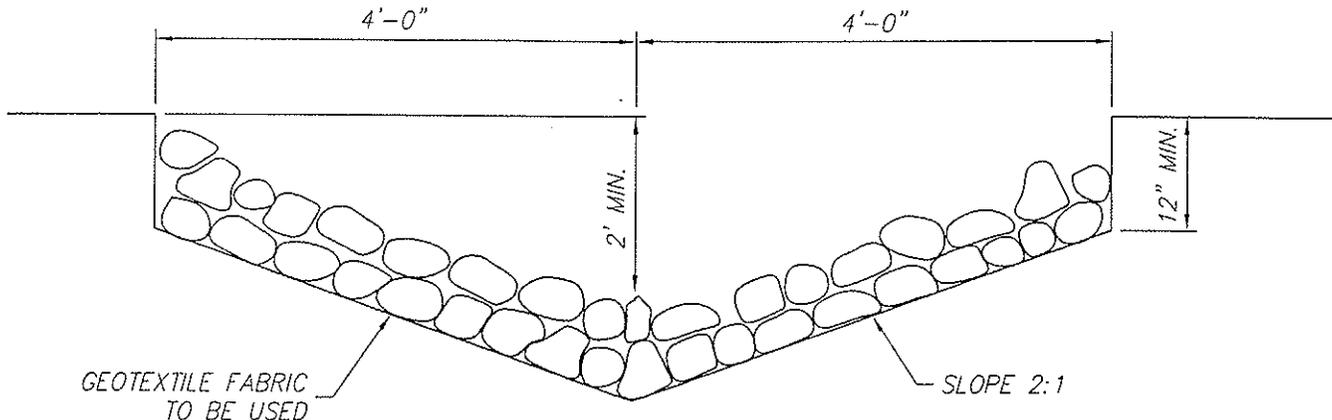

GEOTEXTILE FABRIC
TO BE USED

SLOPE 2:1

COBBLE LINED - "V" DITCH

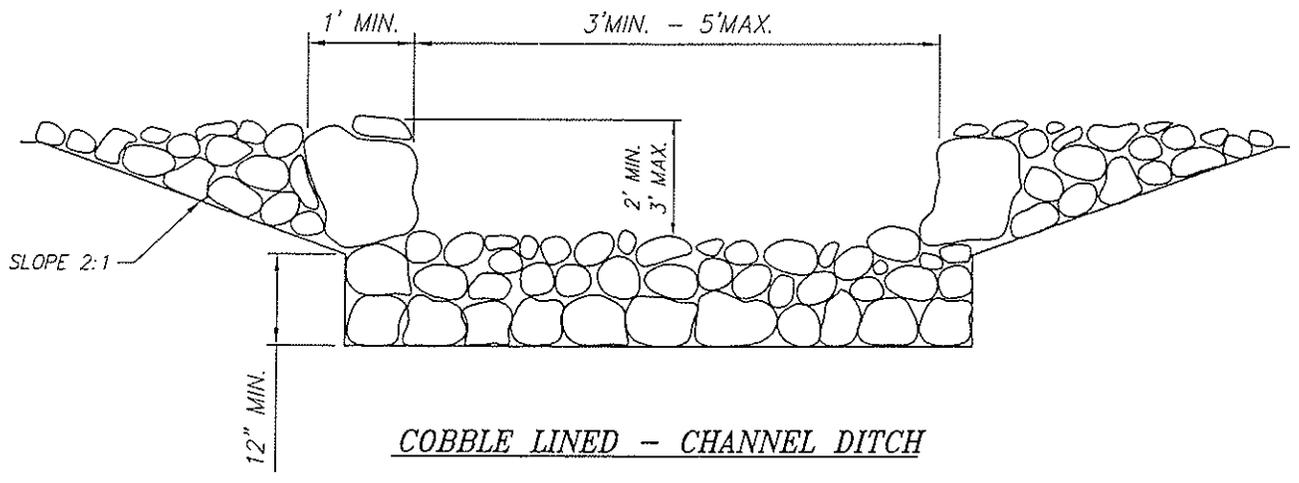


SLOPE 2:1

2' MIN.
3' MAX.

12" MIN.

COBBLE LINED - CHANNEL DITCH


NOTE: 6" MIN. COBBLE SIZE

APPROVED BY:

 BRIAN J. FRAGIOLA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
**ROCK LINED CHANNEL
 SECTIONS**
 DEPARTMENT OF PUBLIC WORKS

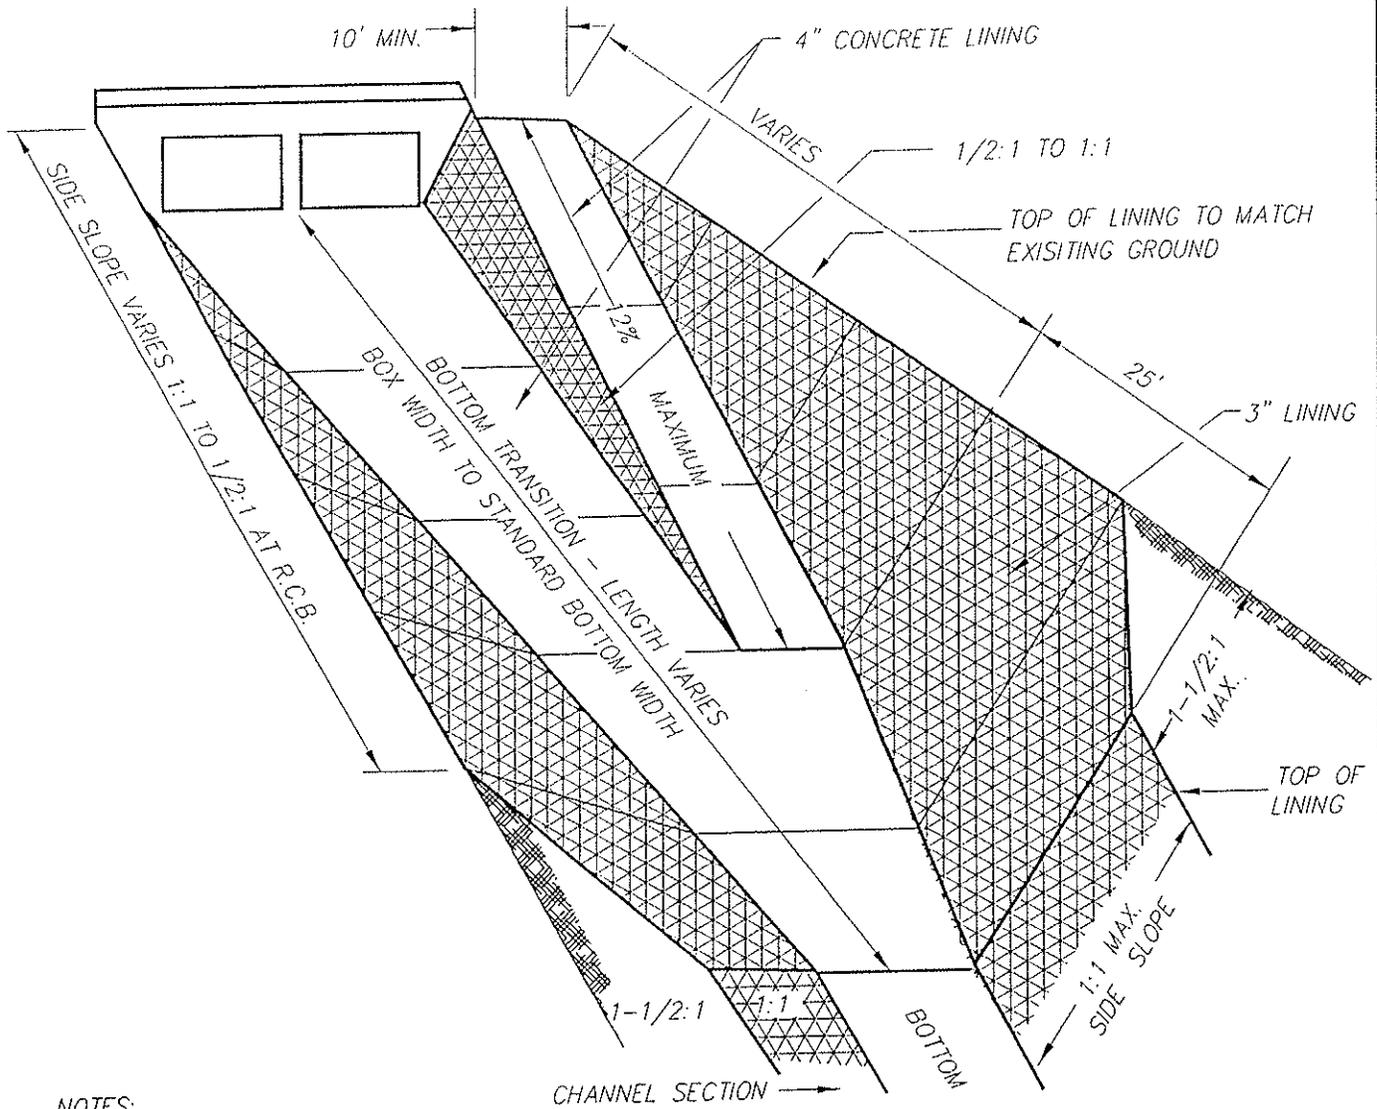SD-19



NOTES:

1. BOTTOM TRANSITION
25' MINIMUM LENGTH
WITH NO RAMP.
2. WEEP HOLES AND JOINTS
AS REQUIRED FOR ALL
LINED CHANNEL SECTIONS.
3. LOW SIDE OF CHANNEL
TO BE OPPOSITE RAMP.
4. SIDE SLOPE LINING MAY BE
DELETED ON CHANNELS WITH
BOTTOM LINING ONLY

APPROVED BY:

Brian J. Fragiaco
 BRIAN J. FRAGIACO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

ACCESS RAMP DETAIL

DEPARTMENT OF PUBLIC WORKS

SD-20

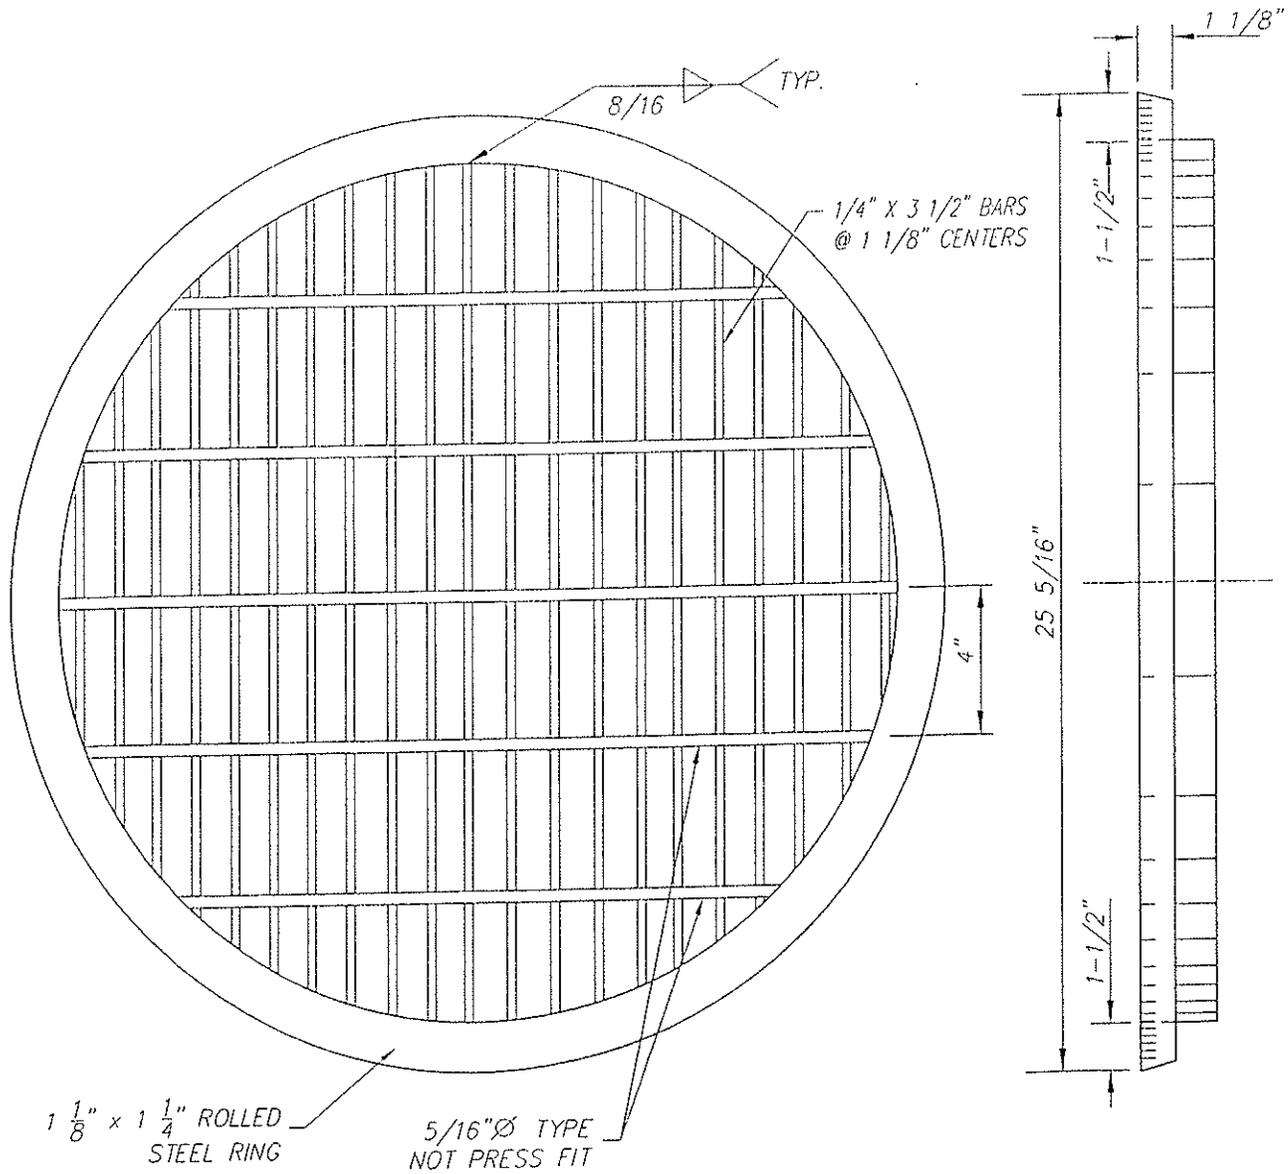

NOTES:

1. MANHOLE COVER SHALL FIT FRAME SHOWN ON DRAWING SD-22.
2. SEATING SURFACES SHALL BE MACHINED AS SHOWN IN DETAIL ON DRAWING SD-22.
3. THIS COVER MAY BE USED ONLY WITH APPROVAL OF ENGINEER
4. GALVANIZE AFTER FABRICATION.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

GRATE TYPE MANHOLE
 COVER

DEPARTMENT OF PUBLIC WORKS

SD-21

LETTERING TO READ
"STORM DRAIN"

PICK HOLE


1 1/4"

4 - 1" DIA.
HOLES EQUALLY
SPACED OR 29"
BOLT CENTER

ITEM	APPROXIMATE WEIGHT (LBS.)
ASSY.	270
FRAME	142
COVER	128


MATERIAL: CAST IRON

A.S.T.M. GRID PATTERN

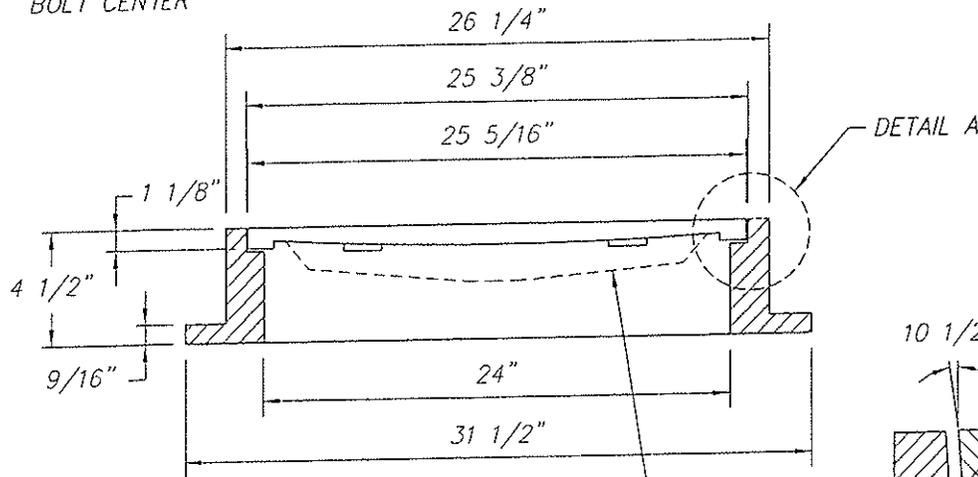


NOTE: ALL MATERIALS TO BE MADE IN U.S.A.

OPTIONAL RIBS

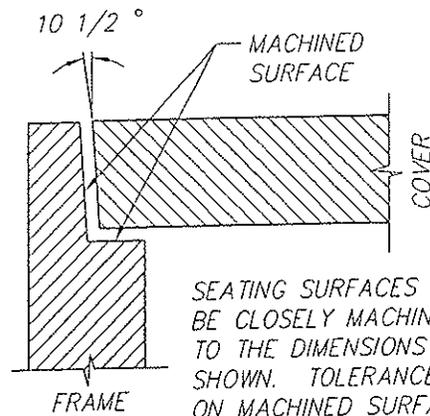

SEATING SURFACES SHALL
BE CLOSELY MACHINED
TO THE DIMENSIONS
SHOWN. TOLERANCES
ON MACHINED SURFACES
SHALL NOT EXCEED 1/64"

DETAIL A

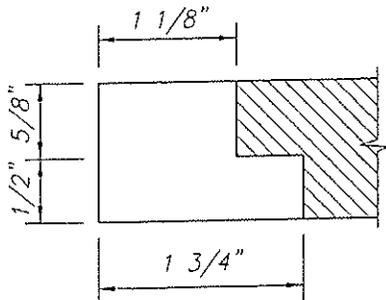

SECTION THROUGH CENTER OF PICK HOLE

APPROVED BY:

Brian J. Fragiolo
BRIAN J. FRAGIOLA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

STANDARD 24" MANHOLE
FRAME & COVER

DEPARTMENT OF PUBLIC WORKS

SD-22

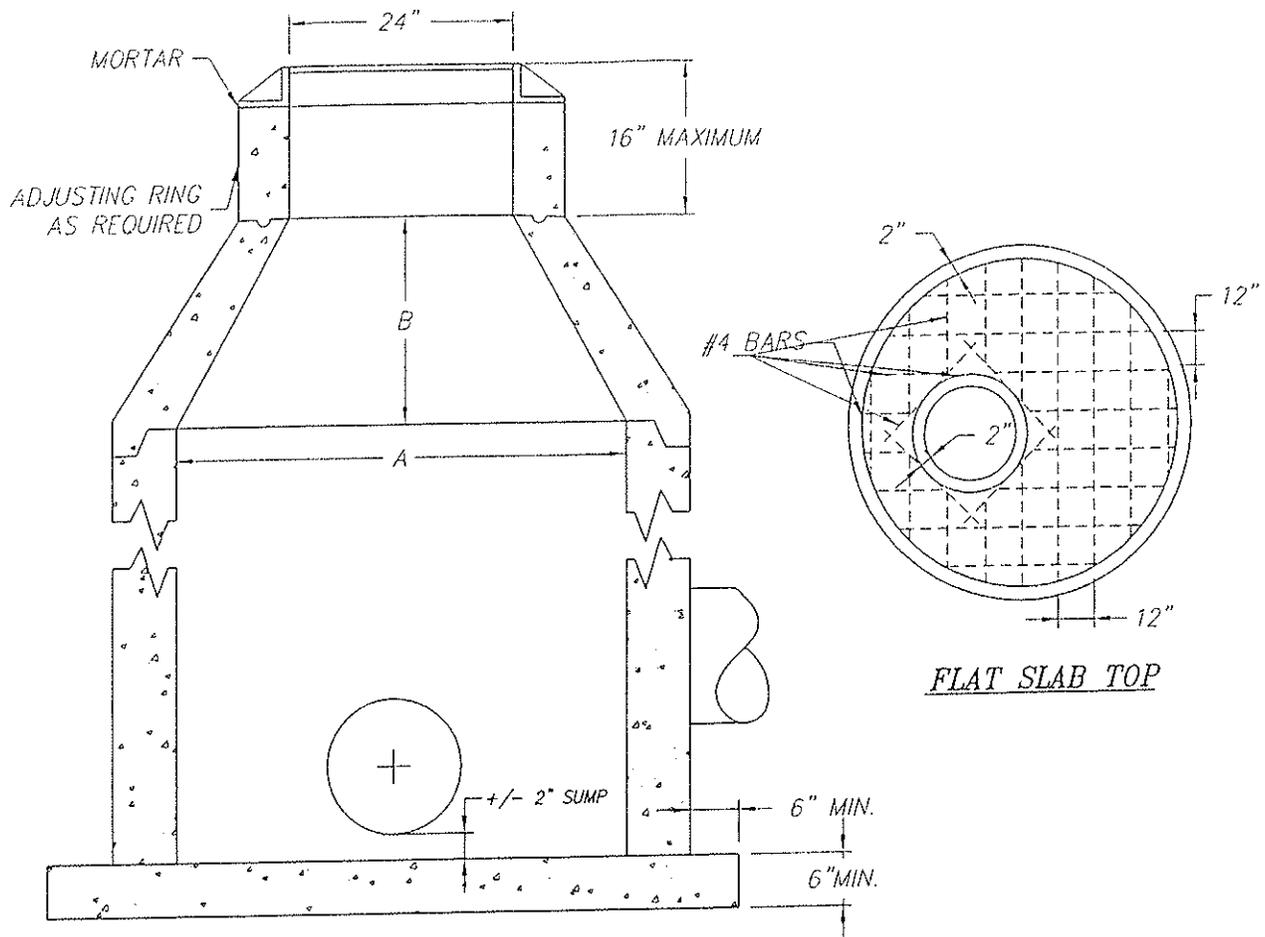

SUMP SHALL BE 2" DEEP (TYP.), MEASURED FROM FROM INVERT OF OUTFALL PIPE. SUMP NOT REQUIRED IF DIAMETER OF OUTFALL PIPE IS 24" OR LARGER, OR IF M.H. IS NOT WITHIN PUBLIC R/W OR OTHER AREA WITH VEHICULAR ACCESS. A 12" DEEP SUMP WILL BE REQUIRED IN ALL MANHOLES DISCHARGING DIRECTLY TO WATERWAYS OR OPEN SPACES.

NOTES:

1. ECCENTRIC CONES SHALL BE USED IF SHOWN ON THE PLANS.
2. JOINTS MAY BE EITHER KEYPED OR TONGUE AND GROOVE.
3. A MINIMUM OF 6" OF UNDISTURBED MANHOLE WALL SHALL REMAIN BETWEEN ENTERING PIPES


TABLE OF DIMENSIONS

M.H.	A	B	T MIN
48"	48"	16"	6"
60"	60"	30"	8"
72"	72"	42"	8"

DIMENSION "B" IS A MINIMUM DIMENSION AND MAY BE GREATER IF DEPTH PERMITS.

RISER SECTIONS, CONES, AND ADJUSTING RINGS SHALL CONFORM TO ASTM DESIGNATION C-478

FRAME SHALL BE SECURED TO RISER OR FLAT SLAB TOP WITH CEMENT MORTAR CLASS A CONCRETE

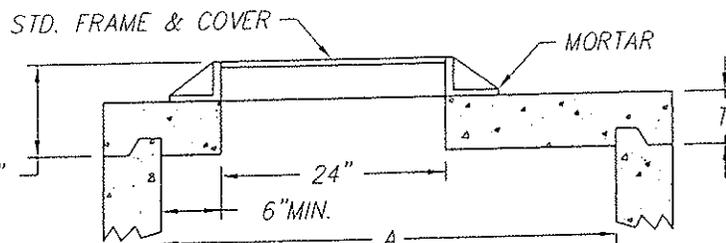

FLAT SLAB SHALL BE USE WHEN DEPTH DOES NOT PERMIT USE OF TAPER UNIT

APPROVED BY:

Brian J. Fraga
 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS

STANDARD PRECAST
 STORM MANHOLE

SD-23


DEPARTMENT OF PUBLIC WORKS

REVISED:

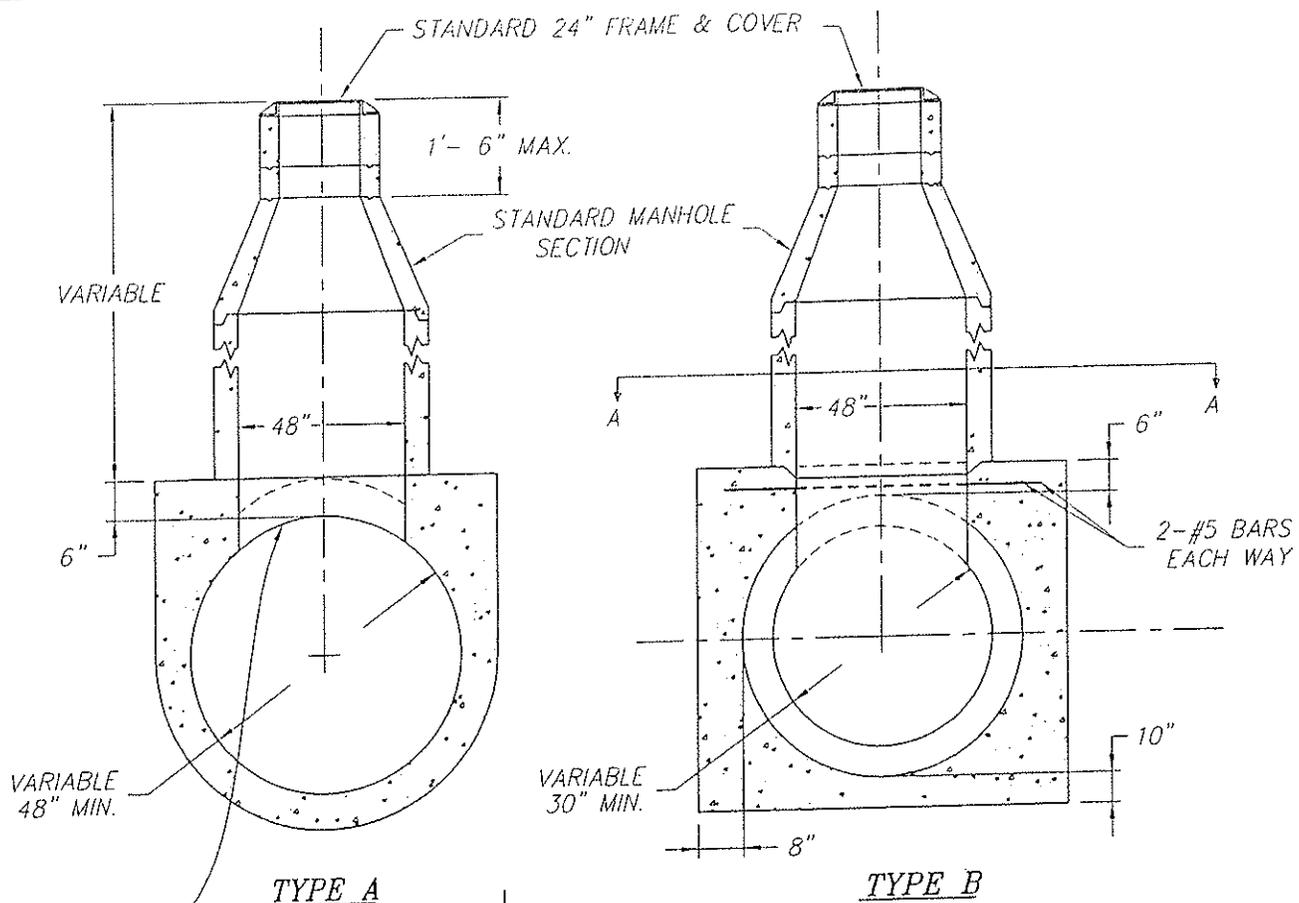

NOTE:
 REMOVE CONCRETE IN
 MANHOLE OPENING AND
 CONSTRUCT RISER BASE,
 WHILE CONCRETE IS STILL
 FRESH.

PLACE RISER SECTION AFTER
 CONCRETE HAS SET. (CLASS A
 CONCRETE).

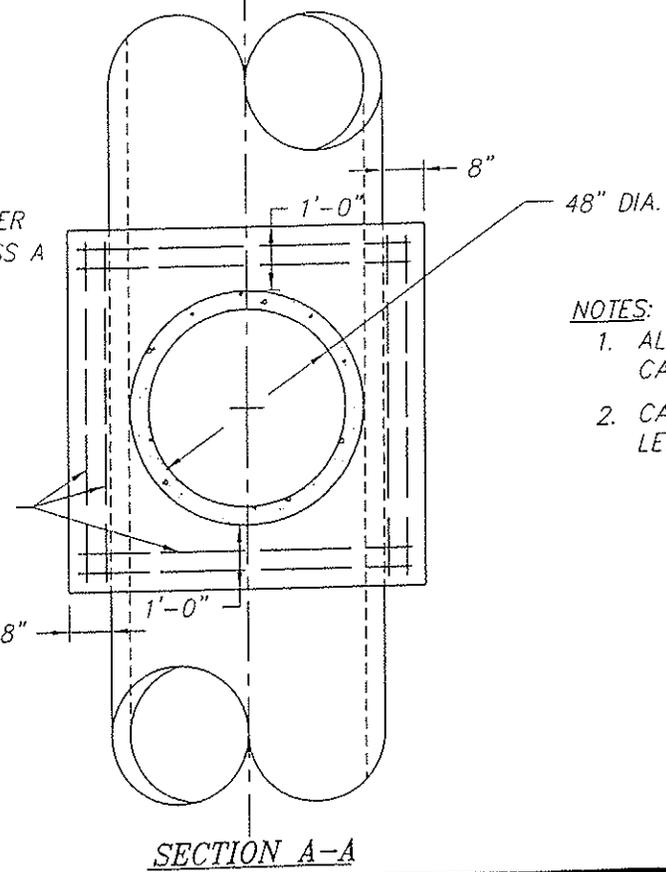


- NOTES:**
1. ALL PIPE OTHER THAN CAST-IN-PLACE PIPE.
 2. CAST-IN-PLACE PIPE LESS THAN 48" DIA.

APPROVED BY:
Brian J. Fragiad
 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 TYPE "A" & "B"
 SADDLE MANHOLE
 DEPARTMENT OF PUBLIC WORKS

SD-24

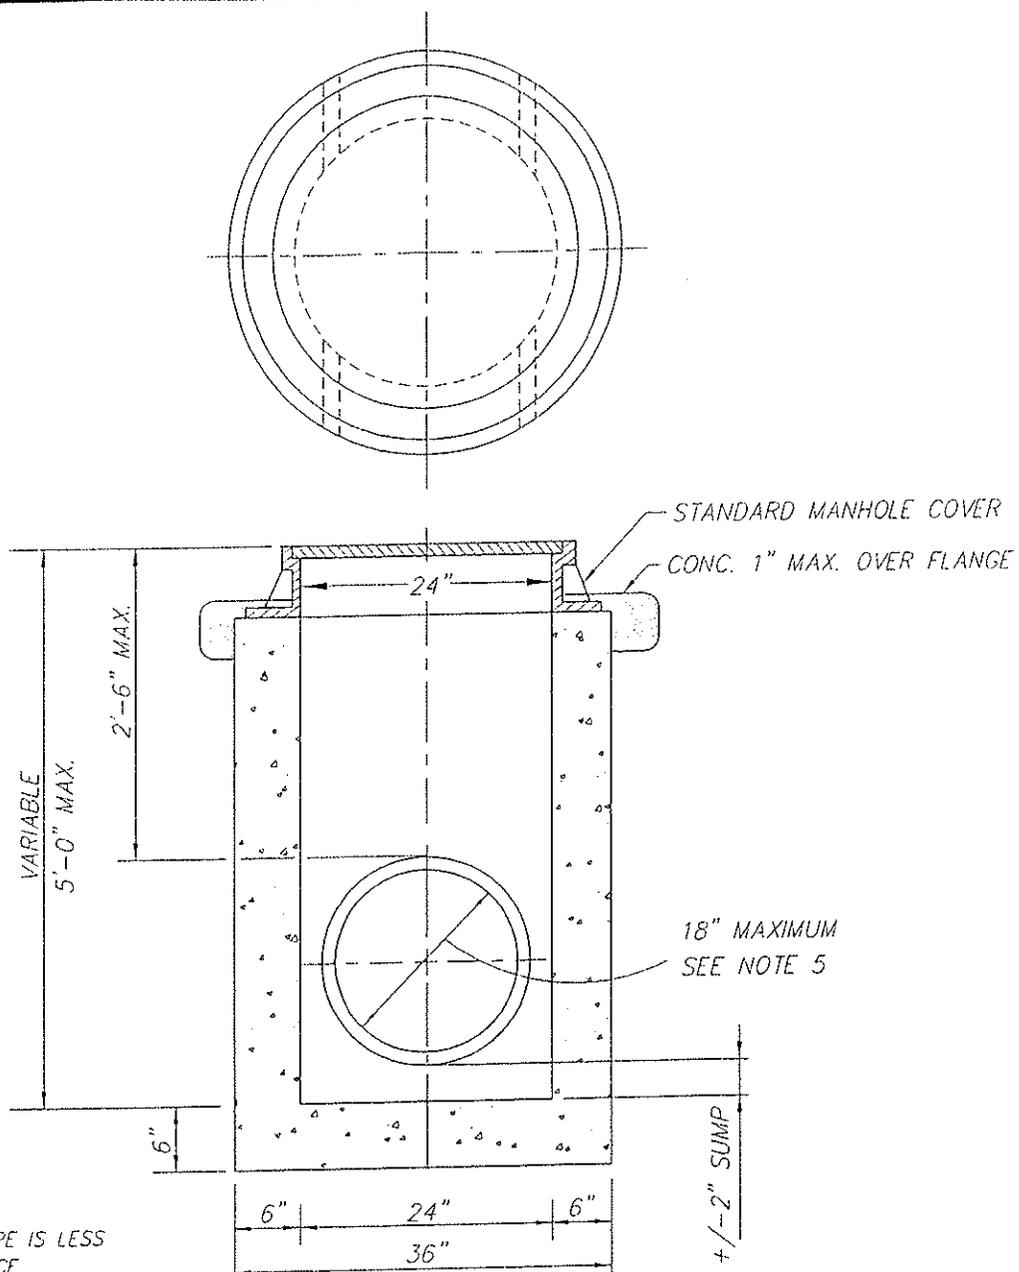

NOTES:

1. USED WHERE TOP OF PIPE IS LESS THAN 30" BELOW SURFACE
2. WALL THICKNESS OF MANHOLE DOES NOT APPLY WHEN CLASS II R.C.P. IS USED.
3. USED CLASS "A" CONCRETE OR CLASS II R.C.P.
4. WHEN MANHOLE IS CAST-IN-PLACE, WALL THICKNESS SHALL NOT VARY MORE THAN 1 INCH FROM THAT SHOWN
5. WHEN USED AT ANGLE POINTS, MAX. PIPE SIZE TO BE 12 INCHES.
6. 2" SUMP TO BE MEASURED FROM INVERT OF OUTFALL PIPE.
7. SUMP NOT REQUIRED WHEN MANHOLE LOCATED IN AREA WITHOUT VEHICULAR ACCESS.
8. ALL MANHOLE COVERS TO BE MADE IN U.S.A.

APPROVED BY:

Brian J. Fragiolo
 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

24" STORM MANHOLE

SD-25

DEPARTMENT OF PUBLIC WORKS

MAXIMUM TRENCH DEPTH
MEASURED SURFACE TO BOTTOM OF TRENCH INFEET

DIAMETER	C-14 CONC. PIPE -CLASS-			REINFORCED CONCRETE PIPE -CLASS-					CAST IN PLACE
	1	2	3	I	II	III	IV	V	
10	12	17	29	NOT PERMITTED					NO LIMIT
12	12	17	21		8	12	30		
15	12	17	20		10	15	35		
18	11	17	19		11	16	38		
21	11	17	19		12	17	39		
24	11	16	19		12	18	39		
27	11	16	18		13	19	39		
30	11	15	17		14	19	38		
33	11	15	16		14	20	38		
36	10	13	14		13	17	27	69	
42	NOT PERMITTED				14	18	29	62	
48					15	19	30	60	
54					16	20	31	58	
60					16	21	31	57	
66				15	17	22	32	56	
72				15	18	23	33	56	45
									35
									30

NOTES:

- ALL DEPTHS SHOWN FOR FLEXIBLE PAVEMENT AND TRENCH WIDTH EQUAL TO O.D. OF PIPE PLUS 16" FOR PIPE 33" AND SMALLER IN INSIDE DIAMETER. TRENCH WIDTH EQUALS O.D. OF PIPE PLUS 24" FOR PIPE 36" AND LARGER IN INSIDE DIAMETER. TRENCH WIDTH MEASURED AT TOP OF PIPE.
- THIS DETAIL SHALL BE A GUIDE ONLY. THE CITY REQUIRES THAT A NCPI LOAD CALCULATION BE RUN ON ALL PIPES FOR TRENCH LOAD DESIGN.

MINIMUM TRENCH DEPTH
MEASURED SURFACE TO
TOP OF PIPE IN INCHES

TYPE	CLASS	MIN. COVER	
		STREET	OFF ST.
C-14 CONC. PIPE	1	30	12
	2	27	12
	3	24	12
REIN. CONCRETE PIPE	I	27	12
	II	24	12
	III	18	12
	IV	12	12
	V	12	12

CAST IN PLACE CONCRETE PIPE	—	12	12
--------------------------------------	---	----	----

APPROVED BY:

Brian J. Fragaio
BRIAN J. FRAGIAO,
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
PIPE COVER REQUIREMENTS-CP,
RCP, ACP
& CAST-IN-PLACE

DEPARTMENT OF PUBLIC WORKS

SD-26


MAXIMUM TRENCH DEPTH
MEASURED SURFACE TO BOTTOM OF TRENCH IN FEET

THICKNESS IN INCHES DIA IN INCHES	CORRUGATED STEEL PIPE (C.S.P.)**					CORRUGATED ALUMINUM PIPE (C.A.P.)*				
	0.064	0.079	0.109	0.138	0.168	0.060	0.075	0.105	0.135	0.165
10						40				
12	100					35	40	50		
15	100					32	35	40		
18	100					26	30	35		
21	91	100				21	25	30		
24	80	100				13	21	30		
27	64	80				13	20	27		
30	64	80	100			12	19	25	30	
33	53	66	93				16	20	27	
36	53	66	93	100			15	18	25	30
42	46	57	80	100			13	15	20	29
48	40 48	50 70	70 66	90	100			15	18	27
54	43	44 62	62 75	80	98			13	15	25
60	39	49	56 69	72	88				10	20
66	36	44	51 62	64	78				10	18
72	32	41	56	55	68					15

NOT PERMITTED

MAXIMUM TRENCH DEPTH MEASURED SURFACE TO TOP OF PIPE IN INCHES		
(C.S.P.)		(C.A.P.)*
50' TO 60' R/W STREETS	MAJOR STREETS	OFF STREET ONLY
6	9	9
		9
		10
		10
	9	12
6	10	15
5	12	18
5	14	20
5	16	24


- NOTES:**
- **--NORMAL PIPE CORRUGATION PROFILE IS 2 2/3"x1" THE CORRUGATION OF THE PIPES WITHIN THE SHADED AREA SHALL HAVE PROFILE OF 3" x 1"
 - *--ALUMINUM PIPE IS NOT PERMITTED IN PUBLIC STREET RIGHT OF WAY.
 - WHEN FLOW VELOCITY EXCEEDS FIVE (5) F.P.S. THICKER METAL SHALL BE PROVIDED.

APPROVED BY:

 BRIAN J. FRAGLIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
 PIPE COVER REQUIREMENT-
 CSP&CAP
 DEPARTMENT OF PUBLIC WORKS

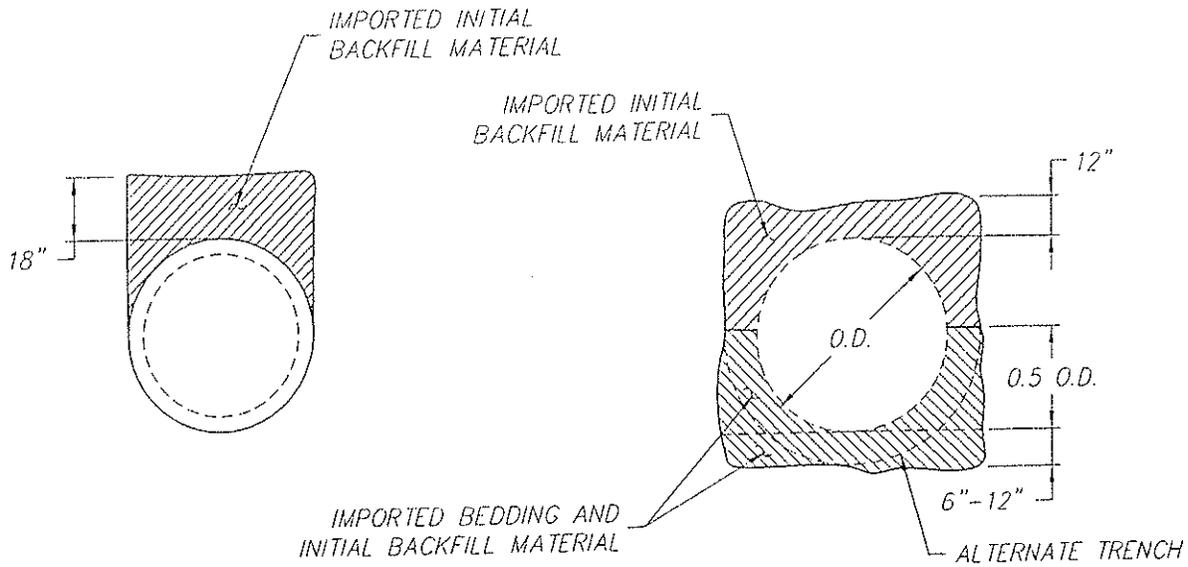SD-27



CAST-IN-PLACE
CONCRETE PIPE

PIPES 24" OR GREATER
IN DIAMETER

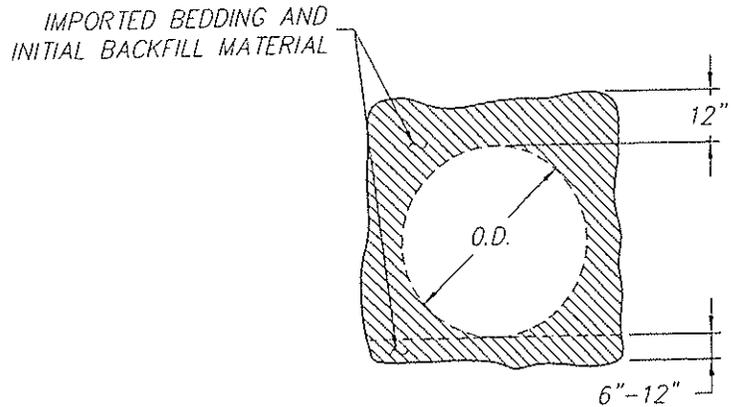

PIPES LESS THAN 24"
IN DIAMETER

NOTES:

1. CAST-IN-PLACE CONCRETE PIPE REQ'S APPROVAL OF TOWN ENGINEER. AND DETAILED SOILS REPORT.
2. INITIAL BEDDING AND BACKFILL MATERIAL SHALL CONFORM TO WATER AND SEWER TRENCH DETAIL.
3. BEDDING AND INITIAL BACKFILL TO CONFORM TO MANUFACTURER'S SPECIFICATION.
4. GEOTEXTILE WRAP MAY BE REQUIRED BY SOILS ENGINEER OR TOWN ENGINEER DUE TO SOILS CONDITION.

APPROVED BY:

Brian J. Fraga
 BRIAN J. FRAGA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS
 PIPE BEDDING &
 INITIAL BACKFILL

SD-28

REVISED:

DEPARTMENT OF PUBLIC WORKS

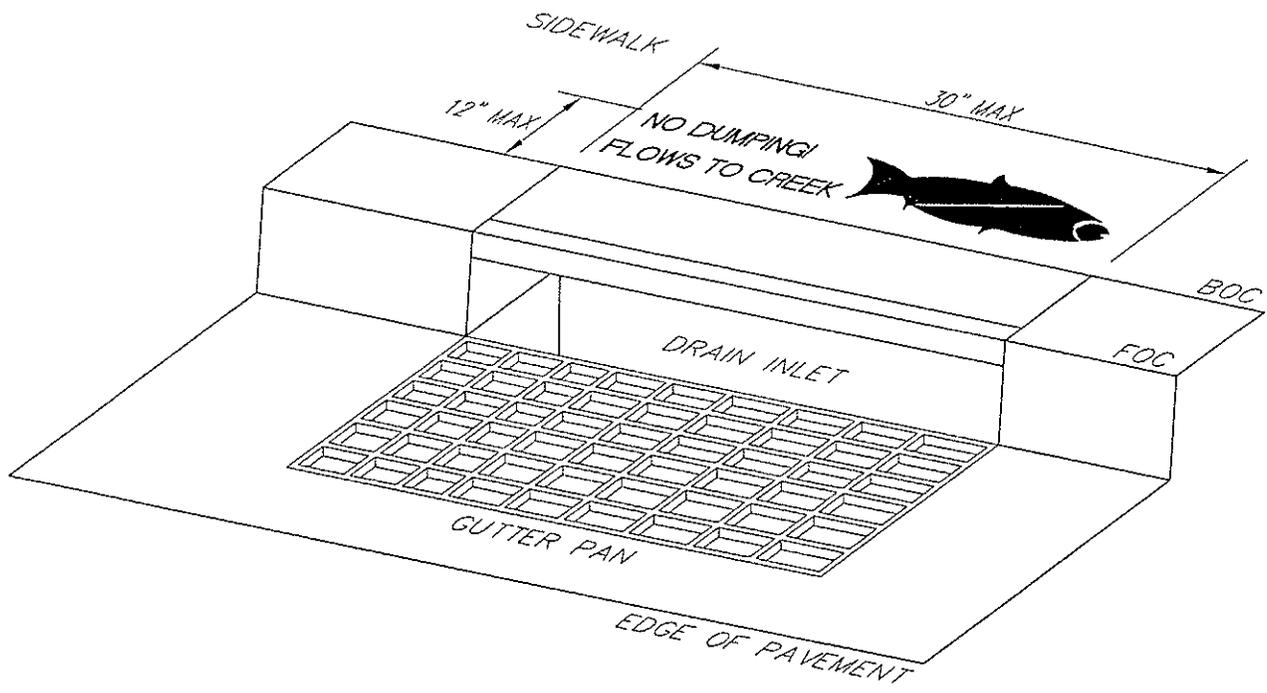

NOTES:

1. LETTERING SHALL BE 1 1/4 TO 1 1/2 INCHES HIGH. THE MESSAGE AND SYMBOL SHALL BE DEPRESSED 1/8 TO 1/4 INCH INTO THE CONCRETE. THE FISH SYMBOL SHALL BE A MINIMUM OF 11 INCHES LONG AND 3 1/2 INCHES HIGH.
2. THE STAMP SHALL BE APPROVED BY THE PUBLIC WORKS INSPECTOR PRIOR TO ITS USE.
3. THIS DETAIL SHALL APPLY TO ALL DRAIN INLET DESIGNS. WHERE THE SIDEWALK DOES NOT ADJOIN THE BACK OF CURB, THE NOTICE SHALL BE STAMPED IN THE CONCRETE BACKUP, BEHIND THE DRAIN INLET. WHERE THE DRAIN INLET IS PLACED IN A "V" GUTTER WITHOUT A CURB INLET, THE NOTICE SHALL BE STAMPED ON ONE SIDE OR THE OTHER, PARRALLEL TO THE LENGTH OF THE INLET.
4. THE MESSAGE SHALL BE FREE OF BLEMISHES, LEGIBLE AND ACCEPTABLE TO THE PUBLIC WORKS INSPECTOR.

APPROVED BY:


Brian J. Fragia
 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS
 "NO DUMPING"
 PUBLIC NOTICE DETAIL
 DEPARTMENT OF PUBLIC WORKS

SD-29

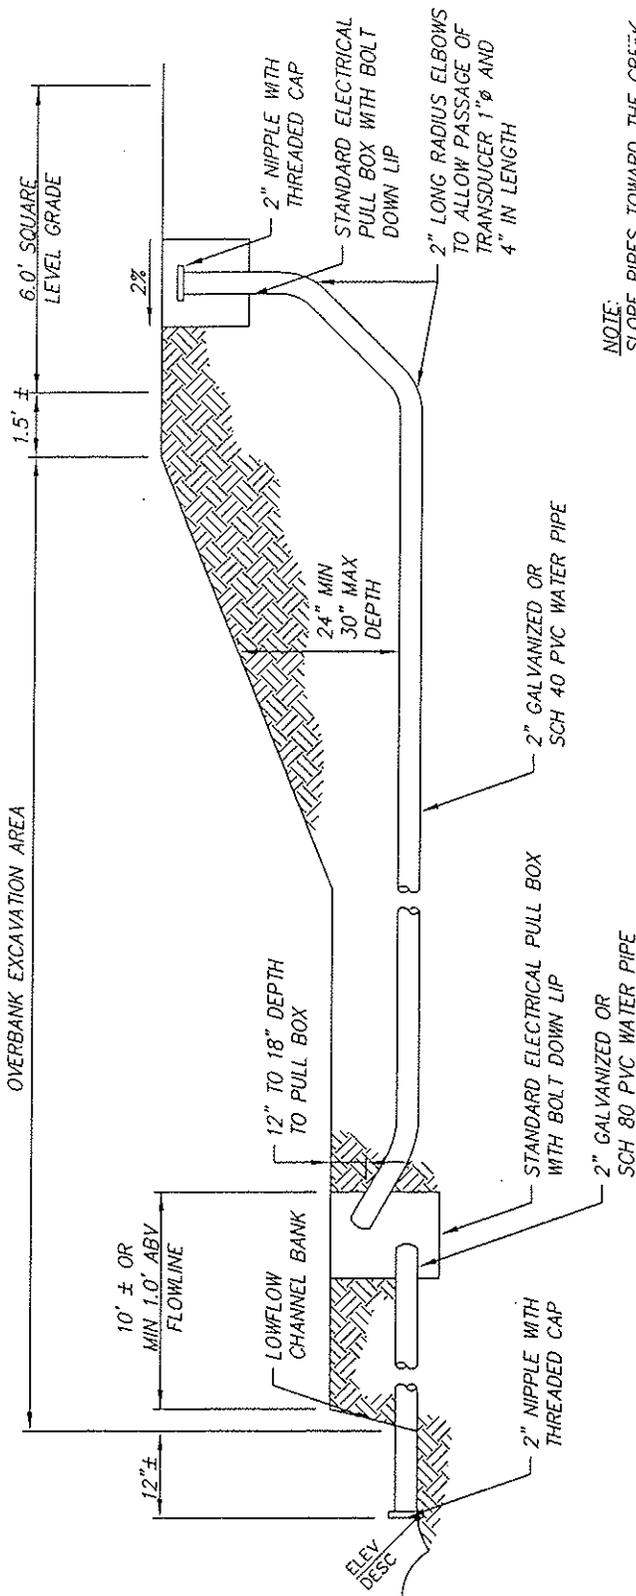

NOTE:
SLOPE PIPES TOWARD THE CREEK

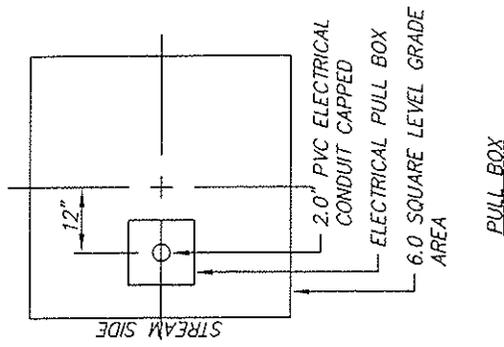

NOTES:

1. EACH STREAM GAUGING CONDUIT WILL HAVE FOUR COMMON PRINCIPAL COMPONENTS, AN ELECTRICAL PULL BOX WITH 2% SLOPE TOWARD THE STREAM SIDE. THE STREAM SIDE.
 - a) A PAD GRADE AREA 6.0 FEET SQUARE WITH 2% SLOPE TOWARD THE STREAM SIDE. ELECTRICAL PULL BOX WILL BE INSTALLED 12 INCHES OFF CENTER OF THE PAD TOWARD THE STREAM SIDE.
 - b) TWO INCH ELECTRICAL PVC CONDUIT SCH 40 OR BETTER COMMENCING AT THE ELECTRICAL PULL BOX ON THE PAD AND TERMINATING IN AN ELECTRICAL PULL BOX 10 FEET ± FROM THE LOW FLOW CHANNEL BANK OF 1 FOOT ± ABOVE THE LOW FLOW. THE CONDUIT SHOULD INCLUDE ONLY LONG RADIUS ELBOWS TO DROP IT DOWN TO THE APPROPRIATE ELEVATION. THE LONG RADIUS ELBOW SHOULD EXTEND OUT BEYOND THE 6.0 FEET PAD AREA BOUNDARY. A PULL STRING SHALL BE BLOWN INTO THE CONDUIT FROM THE ELECTRICAL PULL BOX ON THE PAD AREA TO THE ELECTRICAL PULL BOX ADJACENT TO THE LOW FLOW CHANNEL.
2. STANDARD ELECTRICAL PULL BOXES 2 FOOT SQUARE WITH BOLT DOWN LIDS WILL BE USED.
3. LOCATION OF THIS STRUCTURE SHOULD BE ON THE UPSTREAM SIDE OF THE BRIDGE AND BE ACCESSIBLE BY FOOT AT ALL POINTS FROM LEVEL GRADE AREA TO THE TERMINATION AT THE LOW FLOW CHANNEL. TRUCK ACCESS IS NECESSARY TO THE 6.0 SQUARE FOOT PAD AREA BUT NOT TO OTHER POINTS ALONG THE CONDUIT. ALONG WITH THIS PHYSICAL ACCESS CONCOMITANT RIGHTS OF ACCESS AND/OR EASEMENTS WILL BE GRANTED BY PROPERTY OWNER TO ALLOW FOR MAINTENANCE OF ACCESS AND/OR EASEMENTS WILL BE GRANTED BY PROPERTY OWNER TO ALLOW FOR MAINTENANCE OF TOWN EQUIPMENT INSTALLED ON THIS SITE.

APPROVED BY:

Brian J. Fraggio
 BRIAN J. FRAGGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

STREAM GAUGING
STATION

DEPARTMENT OF PUBLIC WORKS

SD-30

SECTION 7

GRADING (G)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 7

GRADING CONSTRUCTION

7-1 GENERAL -- Grading improvements shall include: excavation and embankment work for channels, pads and roadways, erosion control measures and retaining walls. These improvements shall be installed in accordance with the approved improvement plans, these Improvement Standards, the latest edition of the Uniform Building Code (UBC), the Loomis Grading Ordinance and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the Caltrans Standard Specifications. Prior to the start of any grading projects, 50 yards and greater, the Town Engineer will require a grading permit and may require a soils report.

7-2 CONSTRUCTION STAKING -- Construction staking shall be provided by the Developer for all grading improvements as indicated below: The Town Inspector shall be supplied with two (2) sets of cut sheets prior to construction, without exception.

- A. Channels -- Channel staking shall provide the station and offset, as well as the cut to the nearest tenth of a foot, 0.1 foot. Stakes shall be provided at a minimum of every 50 feet in tangent sections and every 25 feet in curved sections.
- B. Erosion Control Measures -- Erosion control measures shall be staked as needed.
- C. Pads -- Pad staking shall provide the station and offset, as well as the cut to the nearest tenth of a foot, 0.1 foot. Stakes shall be provided at each property corner, front and rear.
- D. Retaining Walls -- All retaining walls shall be staked for line and grade to the nearest tenth of a foot, 0.1 foot.
- E. Roadways -- Roadway excavation staking shall provide the station and offset, as well as the cut to the nearest tenth of a foot, 0.1 foot. Minimum staking intervals shall be 50 feet in tangent sections and 25 feet in curves. Stakes shall also be placed at curve beginnings, ends, point of reverse curvature, point of compound curve, horizontal angle points and at changes of grade.

7-3 INSTALLATION -- All grading improvements shall be installed per provisions in Chapter 70 of the UBC, per recommendations of site specific geotechnical reports and geotechnical engineer, per provisions in Sections 16 through 19 of the Caltrans Standard Specifications, Town of Loomis Grading Ordinance, per the approved plans and per the following specifications:

- A. Channels -- All fill areas in channels shall receive suitable fill material to be compacted to a minimum of 90 percent relative compaction or more depending on proposed use after development. Suitable fill material will be determined by the Developer's geotechnical engineer. Unsuitable materials shall be removed from the channel and replaced with suitable backfill material based on recommendations provided by the Developer's licensed geotechnical engineer.

B. Erosion Control Measures -- Construction activities occurring between October 1 and April 15 shall have erosion and sediment control measures in place, or capable of being placed within 24 hours. The Contractor shall ensure that the construction site is prepared prior to the onset of any storm. Waterways under the jurisdiction of governmental agencies other than the Town of Loomis may be subject to additional erosion control measures or criteria and is the responsibility of the Developer/Owner. Town of Loomis erosion control provisions shall include:

1. Broadcast Seed -- Where required, broadcast seed shall be applied as follows:

Brando Brome	12 lbs/acre
Rose Clover	9 lbs/acre

Areas with sandy, dry soil shall receive:

Zorro Annual Fescue	6 lbs/acre
Rose Clover	9 lbs/acre

A fertilizer consisting of 16-20-0 shall be applied at a rate of 500 pounds per acre. If hydroseeding/mulching is used, seed quantities shall be increased by 30 percent.

2. Drainage Areas -- All bare areas, regardless of slope, within 50 feet of perennial and intermittent drainage swales shall be covered with straw and pressed in place.

No grading or trenching, except as required for erosion or sediment control, shall occur within 35 feet from the centerline of perennial and intermittent drainage swales between October 1 and April 15 unless approved by the Engineering Division, as well as any other governmental agency which may have additional jurisdiction and/or requirements.

3. Dust/Mud Control

- a. Adjacent Streets -- Adjacent street frontages shall be kept clean by sweeping and /or other method at least once a day to remove silt and other dirt which is evident from construction activities.
- b. Construction Vehicles -- The Contractor is responsible for cleaning construction vehicles leaving the site on a daily basis to prevent dust, silt, mud and dirt from being released or tracked offsite.
- c. Grading Spoils -- Dry stockpiles of soil shall be watered to prevent the generation of airborne dust. Trucks transporting dry soil shall be covered with tarpaulins.

- d. Water -- Water shall be sprayed on all exposed earth surfaces during clearing, grading, earth moving and other site preparation activities. The exposed earth shall be watered throughout the day to minimize dust. The Contractor shall obtain a hydrant permit from the Water Agency.
- e. Wind Allowances -- Grading activities shall be restricted or halted when winds exceed 15 miles per hour as deemed necessary by the PWD Inspector.
- 4. Inlet Filters -- Drain inlet filters may be employed in lieu of straw bales. Mesh filters attached to the top of the drain inlet grate shall not be allowed. The type of filter used shall be preapproved by the Public Works Inspector.
- 5. Silt Fence -- Silt fences may be employed in lieu of, and are preferred over, straw bales. Adequate supply shall be on-site by September 25.
- 6. Slopes -- All slopes greater than 10:1 shall be covered with broadcast straw at a rate of 50 bales or 4,000 pounds per acre. Slopes exceeding 4:1 shall have straw pressed in place.

All slopes along building frontages (from the building setback line to the Town right-of-way) exceeding 4:1 shall have erosion netting installed.

Slopes steeper than 4:1 and adjacent to Town of Loomis right-of-way, flood plains, natural drainages, park land or designated open space shall require broadcast seeding and covered with straw matting.

- 7. Straw Bales -- Straw bales, if utilized, shall be stockpiled on the site at a rate of 1.5 bales per acre by September 25. Measures shall be provided to keep straw dry.
- C. Pads -- All pads shall be compacted to a minimum of 90 percent relative compaction. Unsuitable materials shall be removed from the pad areas per the recommendations of the Developer's licensed geotechnical engineer. The Developer shall submit a letter from the Geotechnical Engineer stating that the grading was performed in substantial conformance with the geotechnical report (and subsequent updates).

D. Retaining Walls

- 1. Concrete/Masonry Walls -- All concrete or masonry walls are to be installed per the manufacturers or design engineer's recommendations. (see G-1, G-3, G-4 and G-4a). Structural stamp plans shall be submitted and reviewed by the Town.
- 2. Wood Retaining Walls -- All wood retaining walls shall be installed in accordance with Standard Details G-2.

E. Roadways

1. Compaction -- Relative compaction of not less than 95 percent shall be obtained for a minimum depth of 0.5 feet below the subgrade grading plane for the width between the outer edges of shoulders, including curb and gutter areas, whether in excavation, embankment or at original ground level. All other material shall be compacted to a relative compaction of 90 percent, including subgrade prior to placement of aggregate base under sidewalk areas.
2. Grade Control -- When the next layer to be placed on the subgrade is an asphalt concrete pavement, asphalt concrete base or asphalt concrete subbase, the subgrade grading plane at any point shall not vary more than 0.05 foot above or below the grade established by the project surveyor.
3. Stability Testing -- The Contractor shall proof roll the subgrade areas with a full, 3,000 gallon water truck prior to placement of aggregate base or aggregate subbase. The equipment used for proof rolling shall be approved by the PWD Inspector.
4. Unsuitable Materials -- Any unsuitable material encountered within 2 feet below subgrade or 2 feet below original ground shall be removed and replaced with a suitable backfill material. Suitable backfill materials and methods for placement are to be reviewed and approved by the on-site geotechnical engineer. Other methods for subgrade stability may be used upon review and approval of the Developer's geotechnical engineer.

7-4 MATERIALS

A. Retaining Walls

1. Concrete/Masonry Walls -- All concrete or masonry walls are to conform to materials and specifications provided by the wall manufacturer or designing engineer.
2. Wood Retaining Walls -- All wood retaining wall materials are to be in accordance with Standard Detail G-2.

B. Tree Fencing

1. Signs -- The size of each sign shall be a minimum of 2 feet by 2 feet and shall contain the following language:

WARNING
THIS FENCE SHALL NOT BE REMOVED
OR RELOCATED WITHOUT WRITTEN
AUTHORIZATION FROM THE
PLANNING DEPARTMENT

DUST CONTROL

- A. PURPOSE – To reduce the amount of particulate matter entrained in the ambient air as a result of anthropogenic (man-made) fugitive dust sources by requiring actions to prevent, reduce, or mitigate fugitive dust emissions.
- B. APPLICABILITY – The provisions of this rule shall apply to any activity of man-made condition capable of generating fugitive dust.
- C. EXEMPTIONS – The provisions of this rule shall not apply to:
1. Agricultural activities conducted and maintained for commercial agricultural purposes.
 2. Active operations conducted during emergency life-threatening situations, or in conjunction with any officially declared disaster or state of emergency.
 3. Active operations conducted by essential service utilities to provide electricity, natural gas, telephone, water and sewer during periods of service outages and emergency disruptions.
 4. Any contractor subsequent to the time the contract ends, provided that such contractor implemented the required control measures during the contractual period.
 5. Weed abatement operations, fire hazard abatement, or vegetation clearing for fire defense purposes ordered by a county agricultural commissioner or any state, county, or municipal fire department, or required by local ordinance. The provisions of this clause does not exempt the owner of any property from controlling fugitive dust emissions emanating from disturbed surface areas which have been created as a result of the weed abatement actions.
 6. Unpaved roads, provided such roads:
 - a. Are not within and part of a property under development or construction, or an access road to such a property; or
 - b. Are public unpaved roads, except for public road construction or maintenance.
 7. Any active operation, open storage pile, or disturbed surface area for which necessary fugitive dust preventive or mitigating actions are in conflict with the federal Endangered Species Act.
 8. Non-routine or emergency maintenance of flood control or irrigation channels, canals, and water spreading basins.
 9. The provisions of Section E, "Standards" shall not apply to blasting operations that have been permitted by the California Division of Industrial Safety.
 10. The provisions of Section F.2.e. shall not apply to earth coverings of public paved roadways where such coverings are approved by a local government agency for the protection of the roadway, and where such coverings are used as roadway crossings for haul vehicles.

11. The provisions of Section E.3. shall not apply to any facility having non-fugitive particulate matter emissions that are permitted by the District in accordance with Rule 501, General Permit Requirements.
12. Quarrying and surface mining operations, or to sand and gravel mining, rock crushing, and aggregate and sand processing operations, provided that a permit has been issued by the District in accordance with Rule 501, General Permit Requirements, for such operations.
13. The provisions of Section F. shall not apply to any facility permitted by the District in accordance with Rule 501, General Permit Requirements.

D. DEFINITIONS

1. ACCESS ROAD – Any road extending from a public thoroughfare onto the property of a construction project or development project.
2. ACTIVE OPERATIONS – Any activity capable of generating fugitive dust, including, but not limited to, earth-moving activities, construction/demolition activities, or heavy- and light-duty vehicular movement on disturbed surface areas, including inactive disturbed surface areas, and unpaved roads within a construction or a development project site or an access road.
3. AGRICULTURAL ACTIVITY – Any activity, operation, facility, or appurtenances thereof, including, but not limited to, the cultivation and tillage of the soil, dairying, the production, cultivation, growing, and harvesting of any agricultural commodity including timber, viticulture, apiculture, or horticultural, the raising of livestock, fur bearing animals, fish, or poultry, and game birds, and any practices performed by a farmer or on a farm incident to or in conjunction with those farming operations, including preparation for marketing, delivery to storage or to market, or delivery to carriers for transportation to market.
4. ASBESTOS – Asbestiforms of the following minerals: chrysotile (fibrous serpentine), crocidolite (fibrous riebeckite), amosite (fibrous ummingtonite-grunerite), fibrous tremolite, fibrous actinolite, and fibrous anthophyllite.
5. ASBESTOS AIRBORNE TOXIC CONTROL MEASURE FOR CONSTRUCTION, GRADING, QUARRYING, AND SURFACE MINING OPERATIONS – A regulation adopted as section 93105, title 17, California Code of Regulations (CCT) by the California Air Resources Board per Health and Safety Code section 39666, which requires the adoption of regulations to reduce emissions of identified airborne toxics to the lowest level achievable.
6. BULK MATERIAL – Any material which can emit dust when stored, disturbed, or handled, and is generally un-packaged, including sand, gravel, soil, aggregate material less than two inches in length or diameter, and other organic or inorganic particulate matter.
7. CHEMICAL STABILIZERS – A non-toxic chemical dust suppressant which must not be used if prohibited for use by the Regional Water Quality Control Board, the California Air Resources Board, the Environmental Protection Agency, or any applicable law, rule or regulation; and should meet any specifications, criteria, or tests

required by any federal, state, or local water agency. Unless otherwise indicated, the use of a non-toxic chemical stabilizer shall be of sufficient concentration and application frequency to maintain a stabilized surface.

8. CONSTRUCTION/DEMOLITION ACTIVITIES – Any on-site mechanical activities preparatory to or related to the building, alteration, rehabilitation, demolition or improvement of property, including, but not limited to the following activities; grading, excavation, loading, crushing, cutting, planing, shaping or ground breaking.
9. CONTRACTOR – any person who has a contractual arrangement to conduct an active operation for another person.
10. DISTURBED SURFACE AREA – A portion of the earth's surface that has been physically moved, uncovered, destabilized, or otherwise modified from its undisturbed natural soil condition, thereby increasing the potential for emission of fugitive dust. This definition excludes those areas that have;
 - a. Been restored to a natural state, such that the vegetative ground cover and soil characteristics are similar to adjacent or nearby natural conditions;
 - b. Been paved or otherwise covered by a permanent structure; or
 - c. Sustained a vegetative ground cover over at least 95% of an area for a period of at least 6 months.
11. DUST SUPPRESSANTS – Water, hygroscopic materials, or non-toxic chemical stabilizers used as a treatment materials to reduce fugitive dust emissions.
12. EARTH-MOVING ACTIVITIES – Include, but are not limited to, grading, earth cutting and filling operations, loading or unloading of dirt or bulk materials, adding to or removing from open storage piles of bulk materials, or soil mulching.
13. FUGITIVE DUST – any solid particulate matter that becomes airborne without first passing through a stack of duct directly or indirectly as a result of the activities of man (i.e. anthropogenic), including the raising and/or keeping of animals.
14. GEOGRAPHIC ULTRAMAFIC ROCK UNIT – A geographic area that is designated as an ultramafic rock unit or ultrabasic rock unit on maps identified in the California Air Resources Board's Asbestos Airborne Toxic Control Measure or Construction, Grading, Quarrying, and Surface Mining Operations.
15. INACTIVE DISTURBED SURFACE AREA – Any disturbed surface area upon which active operations have not occurred or are not expected to occur for a period of seven (7) consecutive days.
16. NATURALLY-OCCURRING ASBESTOS – Asbestos that have not been processed in an asbestos mill.

17. NON-ROUTINE – Any non-periodic active operation that occurs no more than three times per year, lasts less than 30 cumulative days per year, and is scheduled less than 30 days in advance.
18. OPEN STORAGE PILE – Any accumulation of bulk materials with 5 percent or greater silt content which is not fully enclosed, covered or chemically stabilized, and which attains a height of three feet or more and a total surface area of 150 or more square feet. Silt content level is assumed to be 5 percent or greater unless a person can show, by sampling and analysis in accordance with ASTM Method C-136 or other equivalent method approved in writing by the Executive Officer of the California Air Resources Board, that the silt content is less than 5 percent.
19. PARTICULATE MATTER – Any material, except uncombined water, which exists in a finely divided form as a liquid or solid at standard conditions.
20. PAVED ROAD – An improved street, highway, alley, public way, or easement that is covered by typical roadway materials excluding access roadways that connect a facility with a public paved roadway and are not open to through traffic.

Public paved roads are those open to public access and that are owned by any federal, state, county, municipal or any other governmental or quasi-governmental agencies. Private paved roads are any paved roads not defined as public.
21. PM10 – Is particulate matter with an aerodynamic diameter smaller than or equal to a nominal 10 microns as measured by an applicable reference test method or methods found in Article 2, Subchapter 6, Title 17, California Code of Regulations (commencing with Section 94100)
22. PROPERTY LINE – The boundaries of an area in which either a person causing the emission or a person allowing the emission has the legal use or possession of the property. Where such property is divided into one or more sub-tenancies, the property line(s) shall refer to the boundaries dividing the area of all sub-tenancies.
23. ROAD CONSTRUCTION AND MAINTENANCE – Activities undertaken to build roads, highways, railroads, bridges, culverts, drains and other works incidental to road or highway construction, and maintenance activities that involve grading or excavation. Road construction and maintenance does not include the construction or rest stops, maintenance buildings, or parking lots.
24. SERPENTINE – any form of the following hydrous magnesium silicate minerals; antigorite, lizardite, and chrysotile.
25. SILT – Any aggregate material with a particle size less than 74 micrometers in diameter that passes through a No. 200 Sieve.
26. SIMULTANEOUS SAMPLING – the operation of two PM10 samplers in such a manner that one sampler is started within five minutes of the other, and each sampler is operated for a consecutive period which must be not less than 290 minutes and not more than 310 minutes.

27. STABILIZED SURFACE – mean:
 - a. Any disturbed surface area or open storage pile, that is resistant to wind-driven fugitive dust.
 - b. Any unpaved road surface in which any fugitive dust plume emanating from vehicular traffic does not exceed 20 percent opacity.
28. TRACK-OUT/CARRY-OUT – Any and all bulk materials that adhere to and agglomerate on the exterior surface of motor vehicles and/or equipment (including tires) that may then fall onto a paved road.
29. ULTRAMAFIC ROCK – An igneous rock composed of 90 percent or greater of one or a combination of the following iron/magnesium-rich, dark-colored silicate minerals: olivine, pyroxene, or more rarely amphibole. For the purposes of this section, "ultramafic rock" includes the following rock types: dunite, pyroxenite, and peridotite; and their metamorphic derivatives.
30. UNPAVED ROADS – Any unsealed or unpaved roads, equipment paths, or travel ways that are not covered by one of the following: concrete, asphaltic concrete, recycled asphalt, or asphalt. Public unpaved roads are any unpaved roadway owned by Federal, State, county, municipal or other governmental or quasi-governmental agencies. Private unpaved roads are all other unpaved roadways not defined as public.
31. VISIBLE EMISSIONS – Visible emissions means any particulate matter that is visually detectable without the aid of instruments other than corrective lenses.
32. VISIBLE ROADWAY DUST – Any sand, soil, dirt, or other solid particulate matter which is visible upon paved road surfaces and which can be removed by a vacuum sweeper, or a wet sweeper under normal operating conditions.
33. WIND-DRIVEN FUGITIVE DUST – Visible emissions from any surface area that is generated by wind action alone.

E. STANDARDS

1. VISIBLE EMISSIONS NOT ALLOWED BEYOND PROPERTY LINE – A person shall not cause or allow the emissions of fugitive dust from any active operation, open storage pile, or disturbed surface area, such that the presence of such dust remains visible in the atmosphere beyond the property line of the emission source.
2. VISIBLE EMISSIONS FROM ACTIVE OPERATIONS – In addition to the requirements of Rule 202, VISIBLE EMISSIONS, a person shall not cause or allow fugitive dust generated by active operations, an open storage pile, or disturbed surface area, such that the fugitive dust is of such opacity as to obscure an observer's view to a degree equal to or greater than does smoke as dark or darker in shade as that designated as No. 2 on the Ringelmann Chart (i.e. 40% opacity), as published by the United States Bureau of Mines.
3. CONCENTRATION LIMIT – A person shall not cause or allow PM10 levels to exceed 50 micrograms per cubic meter, 24 hour average, when determined, by simultaneous sampling, as the difference between upwind and downwind samples collected on high-volume particulate matter samplers or other EPA-approved equivalent method for PM10 monitoring. Sampling shall be conducted in accordance with the procedures specified in Section G.

4. TRACK-OUT ON TO PAVED PUBLIC ROADWAYS – Visible roadway dust as a result of active operations, spillage from transport trucks, and the track-out of bulk material onto public paved roadways shall be minimized and removed:
 - a. The track-out of bulk material onto public paved roadways as a result of operations, or erosion, shall be minimized by the use of track-out and erosion control, minimization, and preventative measures, and remove within one hour from adjacent streets such material anytime the track-out extends for a cumulative distance of greater than 50 feet onto any paved public road during active operations; and
 - b. All visible roadway dust tracked-out upon public paved roadways as a result of active operations shall be removed at the conclusion of each work day when active operations cease, or every twenty-four (24) hours for continuous operations. Wet sweeping or a HEPA filter equipped vacuum device shall be used for roadway dust removal.
 - c. Any material tracked-out, or carried by erosion, and clean-up water, shall be prevented from entering waterways or storm water inlets as required to comply with the Town's water quality control requirements under the National Pollutant Discharge Elimination System Permit.
 - d. Track-out control in geologic ultramafic rock units or in identified naturally-occurring asbestos, serpentine, or ultramafic rock areas, shall comply with the requirements of the California Air Resources Board's Asbestos Airborne Toxic Control Measure or Construction, Grading, Quarrying, and surface mining operations.

F. ADMINISTRATIVE REQUIREMENTS

1. MINIMUM DUST CONTROL REQUIREMENTS – The following dust mitigation measures are to be initiated at the start and maintained throughout the duration of the construction or grading activity, including any road construction or maintenance activities:
 - A. Unpaved areas subject to vehicle traffic must be stabilized by being kept wet, treated with a chemical dust suppressant, or covered. In geologic ultramafic rock units, or when naturally occurring asbestos, ultramafic rock, or serpentine is to be disturbed, the cover material shall contain less than 0.25 percent asbestos as determined using the bulk sampling method for asbestos; and
 - B. The speed of any vehicles and/or equipment traveling across unpaved areas must be no more than fifteen (15) miles per hour unless the road surface and surrounding area is sufficiently stabilized to prevent vehicles and equipment traveling more than 15 miles per hour from emitting dust exceeding Ringelmann 2 or visible emissions from crossing the project property line; and
 - C. Storage piles and disturbed areas not subject to vehicular traffic must be stabilized by being kept wet, treated with a chemical dust suppressant, or covered when material is not being added to or removed from the pile.
 - D. Prior to any ground disturbance, including grading, excavating, and land clearing, sufficient water or a chemical dust suppressant, must be applied to the area to be

disturbed to prevent emitting dust exceeding Ringelmann 2 and to minimize visible emissions from crossing the property line.

- E. Construction vehicles leaving the site shall be cleaned to prevent dust, silt, mud, and dirt, from being released or tracked offsite.
 - F. When wind speeds are high enough to result in dust emissions crossing the property line, despite the application of dust mitigation measures, grading and earthmoving operations shall be suspended.
 - G. No trucks are allowed to transport excavated material on-site unless the trucks are maintained such that no spillage can occur from holes or other openings in cargo compartments; and loads are either covered with tarps; or wetted and loaded such that the material does not touch the front, back or sides of the cargo compartment at any point less than six inches from the top of the cargo compartment.
 - H. In geologic ultramafic rock units, or when naturally-occurring asbestos, ultramafic rock, or serpentine is disturbed, all equipment must be washed down before moving from the property onto a paved public road.
 - I. In geologic ultramafic rock units, or when naturally-occurring asbestos, ultramafic rock, or serpentine is to be disturbed, upon completion of the project disturbed surface shall be stabilized using one or more of the following methods:
 - (i) Establishment of vegetative cover;
 - (ii) Placement of at least three (3.0) inches of non-asbestos-containing material;
 - (iii) Paving;
 - (iv) Any other measure deemed sufficient to prevent wind speeds of ten (10) miles per hour or greater from causing visible dust emissions.
2. WIND-DRIVEN FUGITIVE DUST CONTROL – A person shall take action(s) such as surface stabilization, to minimize wind-driven dust from inactive disturbed surface areas.
3. REQUIREMENTS FOR NATURALLY OCCURRING ASBESTOS AREAS: No person shall engage in any road construction or maintenance operations or construction or grading operations where the area to be disturbed is greater than one (1.0) acre without complying with the requirements of the State's Asbestos Airborne Toxic Control Measure or Construction, grading, Quarrying, and Surface Mining Operations where:
- (a) Any portion of the area to be disturbed is located in a geographic ultramafic rock unit; or
 - (b) Any portion of the area to be disturbed has naturally-occurring asbestos, serpentine, or ultramafic rock as determined by the person, owner/operator, or the Air Pollution Control Officer (APCO).
 - (c) Naturally-occurring asbestos, serpentine, or ultramafic rock is discovered by the owner/operator, a registered geologist, or the APCO, in the area to be disturbed after the start of any construction or grading operation.
4. COMPLIANCE WITH STANDARDS – Any person conducting active operations, or who is responsible for man-made condition of open storage piles, or disturbed surface areas, including disturbance as result of the raising and/or keeping of animals or by vehicles, and including inactive disturbed surface areas, shall take all measures to comply with the

Standards of Section E. The property owner, contractors, and any person, that conducts active operations that result in conditions generating fugitive dust is responsible for complying with the provisions of this rule.

5. REASONABLE PRECAUTIONS – The APCO in determining compliance with Section E will take into consideration causative factors, the fugitive dust control measures taken to comply with Section E, the extent that all reasonable fugitive dust control measures are implemented prior to a violation, and the timeliness and extent of corrective actions taken. If both preventative and corrective measures were taken and were reasonable under the circumstances, as determined by the APCO, the APCO may find that enforcement action is not warranted.

G. MONITORING AND RECORDKEEPING

1. MONITORING

- A. Sampling to determine compliance with the particulated matter concentration limit of Section E.3. is only required when deemed necessary by the APCO.
- B. The conduct of sampling to demonstrate compliance with Section E.3. may be required, with reasonable notice, of the person discharging emissions, or sampling may be conducted by the Town with the costs of sampling, not to exceed actual costs, borne by the person discharging emissions.
- C. Samplers shall be operated, maintained, and calibrated in accordance with 40 Code of Federal Regulations (CFR), Part 50, Appendix J, or appropriate EPA-published document for EPA-approved equivalent method(s) for PM₁₀.
- D. Samplers shall be placed upwind and downwind of key activity areas and as close to the property line as feasible, such that other sources of fugitive dust between the sampler and the property line are minimized.
- E. Procedures for the conduct of simultaneous sampling to determine compliance with Section E.3., and the reporting of results, shall be approved by the APCO.

2. TEST METHODS

- A. Ultramafic Rock- The ultramafic rock composition of any material shall be determined using standard analysis techniques including, but not limited to, color index assessment, microscopic examination, petrographic analysis or rock thin sections, or chemical analysis techniques, such as X-ray fluorescence spectrometry or inductively coupled plasma analysis.
- B. Bulk Sampling Methods: ARB Test Method 435, or an alternative asbestos bulk test method approved in writing by the executive officer of the California Air Resources Board, shall be used to determine the asbestos content of a bulk sample. For the purposes of determining compliance with this section, references in ARB Test Method 435 to "serpentine aggregate" shall mean "gravel" or other "bulk materials" to be tested for asbestos content.

3. RECORDKEEPING



- A. Record of control implementation: Any person engaged in any active operation subject to this rule shall maintain records of actions to stabilize surface areas sufficient to establish location, type and date of treatment. Records shall be maintained and be

readily accessible for two (2) years after the date of each entry and shall be provided to the District upon request and shall be open for inspection during unscheduled audits during normal business hours.

- B. Sampling Recordkeeping Requirements: Any person subject to this rule shall maintain for at least two (2) years all of the following records and such additional records required by the State's Asbestos Airborne Toxic Control Measures or Construction, Grading, Quarrying, and Surface Mining Operations when this regulation applies. Results of any air sampling or air monitoring conducted at the request of the APCO;
- C. The results of any asbestos bulk sampling that meets any of the following conditions:
 - 1. The asbestos bulk sampling was conducted by the owner/operator to document that cover material in geologic ultramafic rock units, or when naturally-occurring asbestos, ultramafic rock, or serpentine is to be disturbed, contains less than 0.25 percent asbestos.
 - 2. The asbestos bulk sampling was done at the request of the APCO.

GRADING STANDARD DETAILS

<u>Title</u>	<u>Plate No.</u>
Interior Property Line Retaining Walls	G-1
Wood Retaining Wall	G-2
Exterior Perimeter Property Line Grading and Walls	G-3
Exterior Perimeter Property Line Grading	G-3A
Masonry or Concrete Retaining Wall	G-4
Masonry or Concrete Retaining Wall	G-4A
Terrace Drainage For Cut and Fills	G-5
Property Line Grading Interior	G-6
Building & Slope Setbacks	G-7
Class 1 Residential Lot Grading & Drainage	G-8
Class 2 & 3 Residential Lot Grading & Drainage	G-9

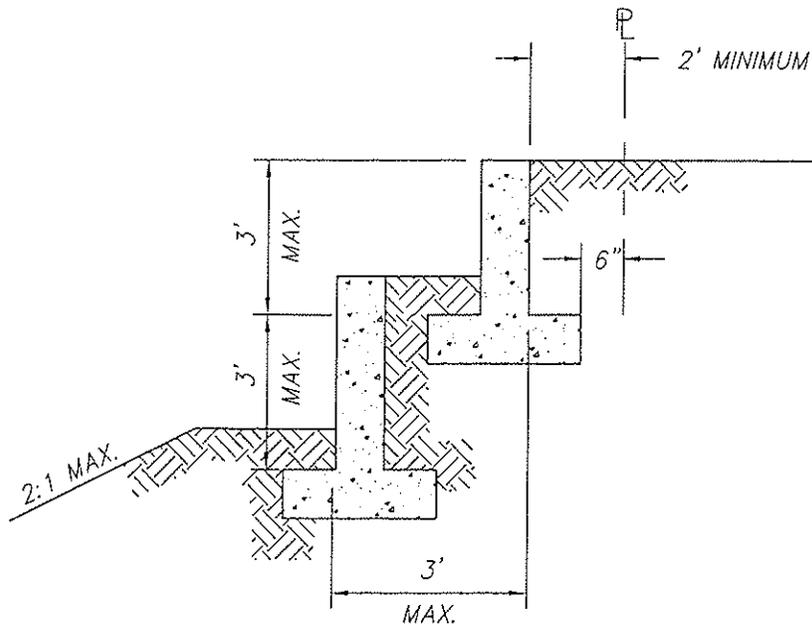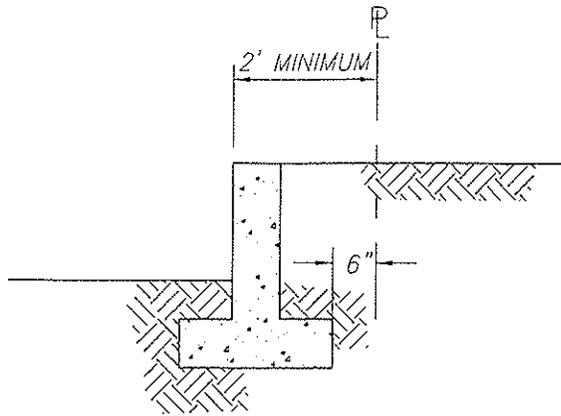

RETAINING WALLS

NOTES: 1. NO DOUBLE RETAINING WALLS TO BE CONSTRUCTED ON SIDE YARDS FOR LOTS TO BE IN CONFORMANCE TO F.H.A. STANDARDS.

2. FENCE LOCATION SHALL BE ON THE PROPERTY LINE 6" MIN. OUTSIDE OF THE FOOTING EDGE.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS
 INTERIOR
 PROPERTY LINE
 RETAINING WALLS

G-1

REVISED:

DEPARTMENT OF PUBLIC WORKS

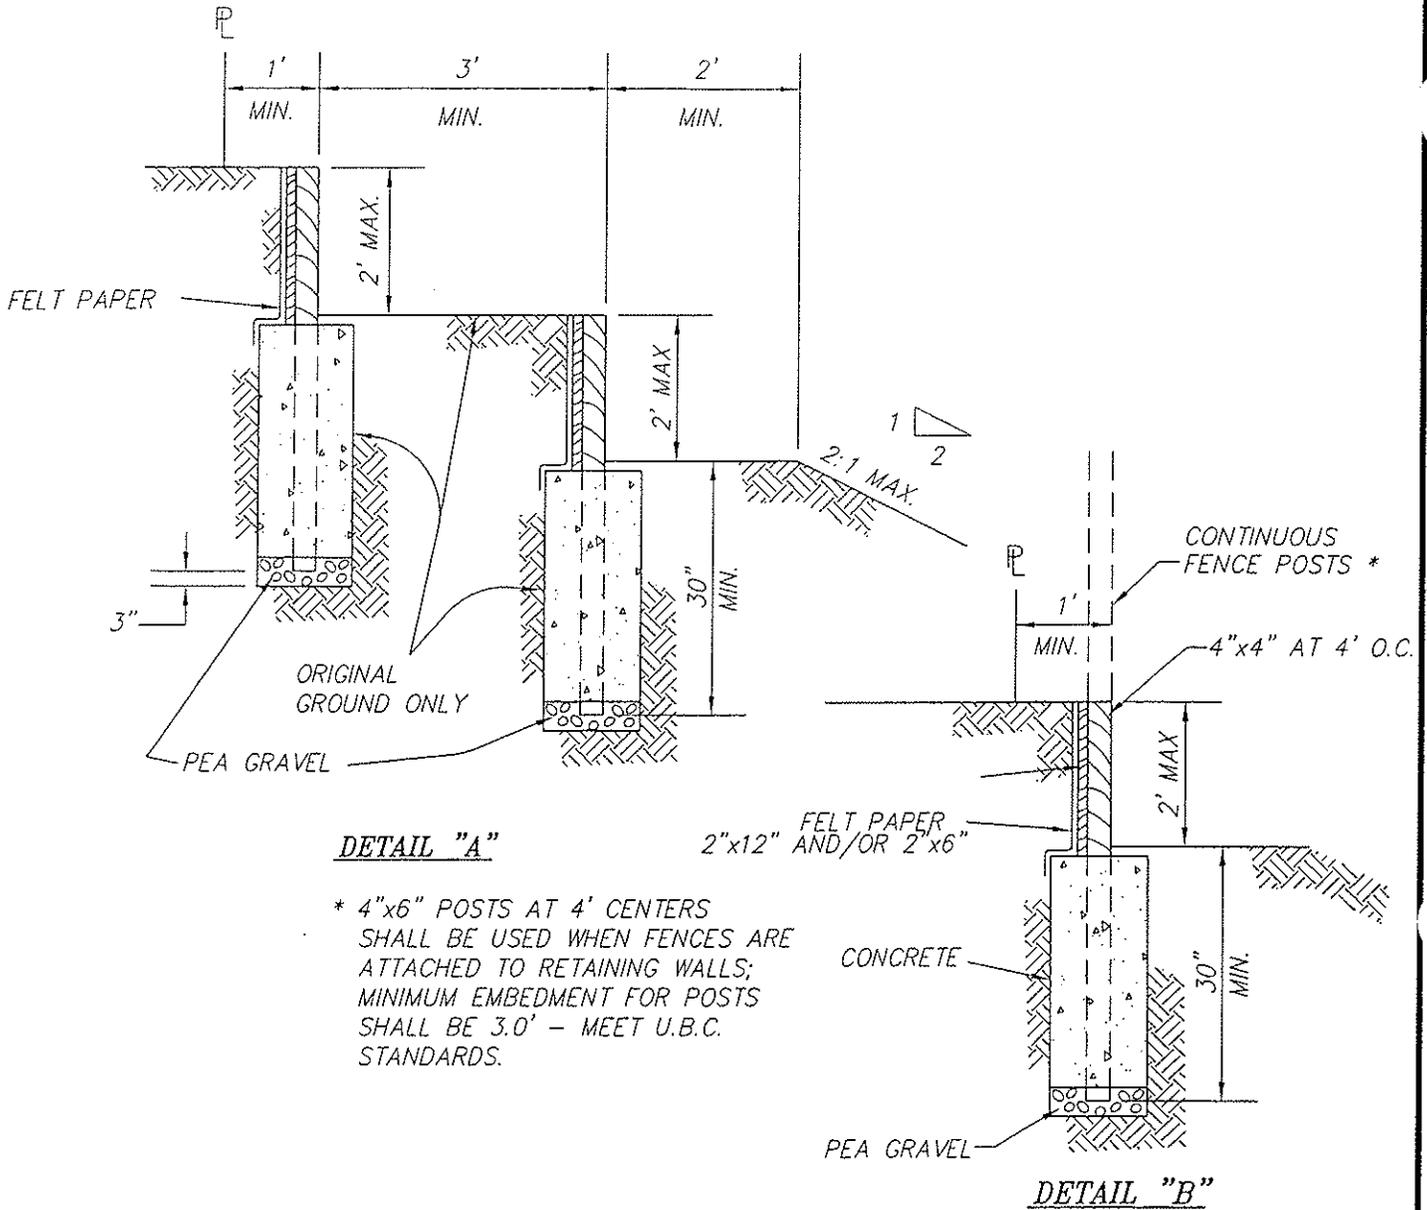

NOTES:

1. ALL MATERIAL FOR WOODEN WALLS SHALL BE PRESSURE TREATED DOUGLAS FIR.
2. ALL WOODEN MATERIALS SHALL BE GRADE NO. 2 OR BETTER WITH NO OPEN GRAIN MATERIAL ALLOWED.
3. WOODEN WALLS SHALL NOT BE USED ADJACENT TO STREET RIGHT-OF-WAYS.
4. CONCRETE, CONCRETE BLOCK AND OTHER WALL DETAILS SHALL BE SUBMITTED TO THE TOWN ENGINEER FOR APPROVAL.
5. A BUILDING PERMIT SHALL BE OBTAINED FOR ALL RETAINING WALLS >4' IN HEIGHT(UBC 2308(b)).
6. A BUILDING PERMIT SHALL BE OBTAINED FOR ALL TERRACED WALLS >4' IN HEIGHT(UBC 2308(b)).
7. REINFORCED CONCRETE OR MASONRY WALLS ARE REQUIRED IF EXISTING STRUCTURES ARE LOCATED LESS THAN 10' FROM THE HIGHER WALL (SEE DETAIL "A").

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER




TOWN OF LOOMIS

WOOD RETAINING WALL


G-2

DEPARTMENT OF PUBLIC WORKS


REVISED:

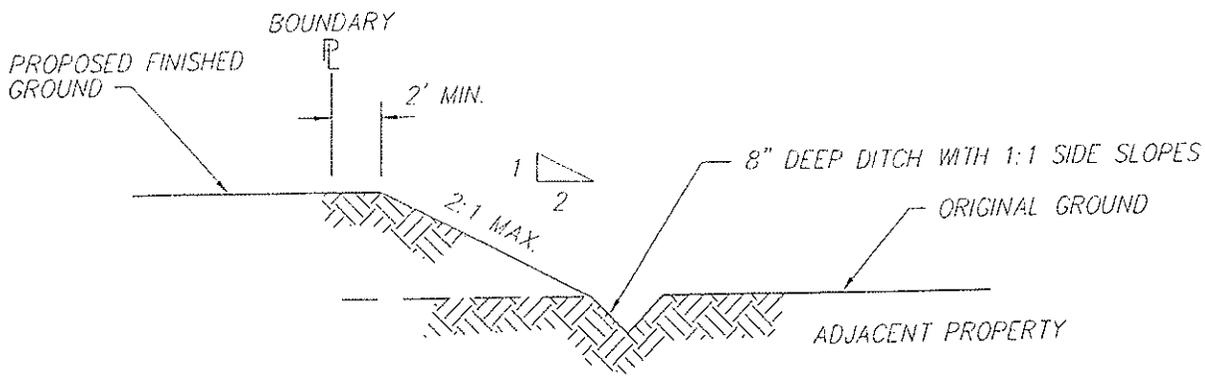

MOST DESIRABLE
ALTERNATE "A"

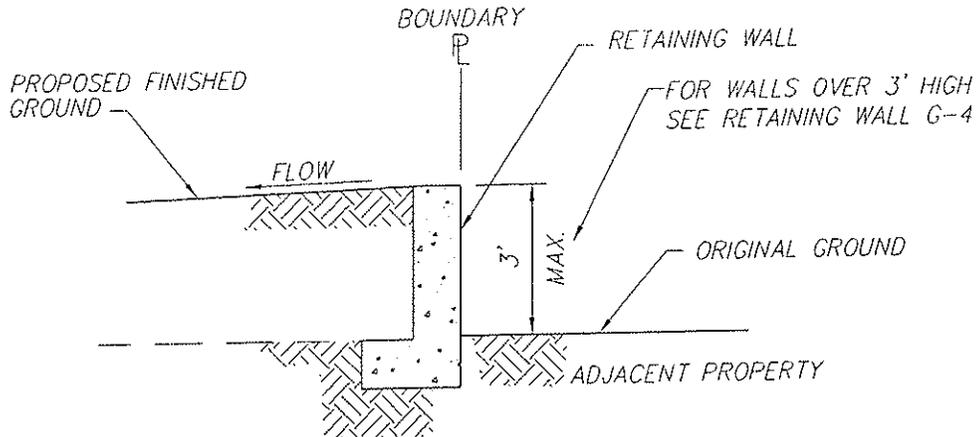

ALTERNATE "B"

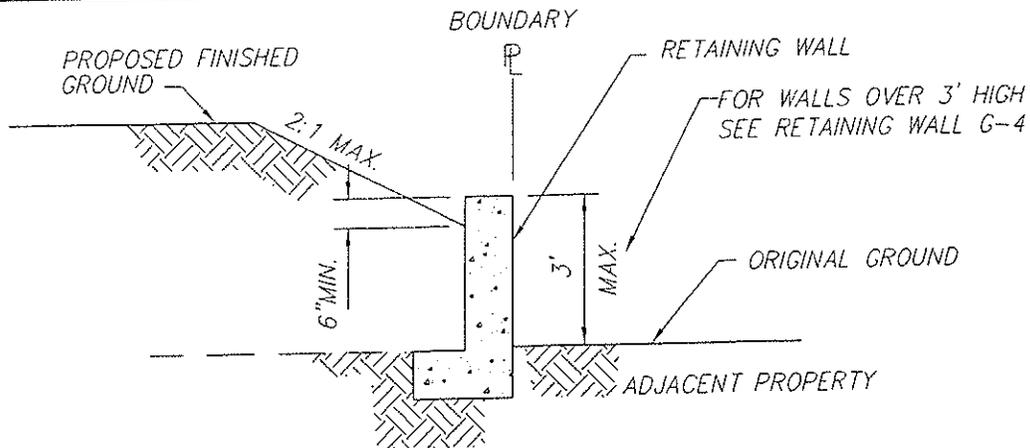

ALTERNATE "C"

NOTES:

1. SEE G-3A FOR CUTS ADJACENT TO EXTERIOR PERIMETER PROPERTY LINES.
2. ALTERNATE "A" REQUIRES CONSTRUCTION EASEMENT FROM ADJACENT PROPERTY OWNER.
3. RIGHT OF ENTRY FROM ADJACENT PROPERTY OWNER IS REQUIRED FOR ALTERNATES "B" & "C".

APPROVED BY:


Brian J. Fragia
BRIAN J. FRAGIA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



TOWN OF LOOMIS
EXTERIOR PERIMETER
PROPERTY LINE
GRADING & WALLS
DEPARTMENT OF PUBLIC WORKS

G-3


REVISED:

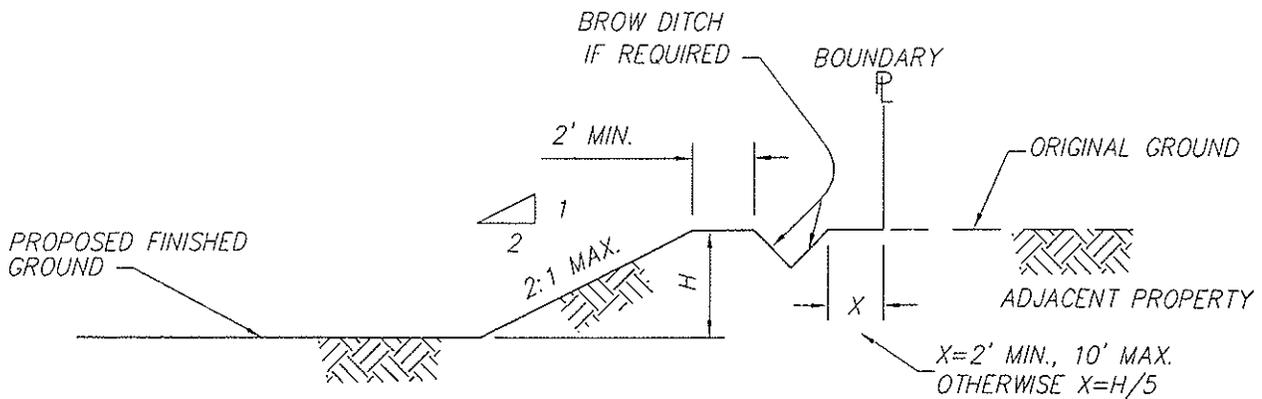

CUT AREAS
(OPTIONAL)

NOTES:

1. IF BROW DITCH IS NOT REQUIRED, X=2' MIN. FROM THE TOP OF THE SLOPE.
2. IF REQUIRED BY TOWN ENGINEER.

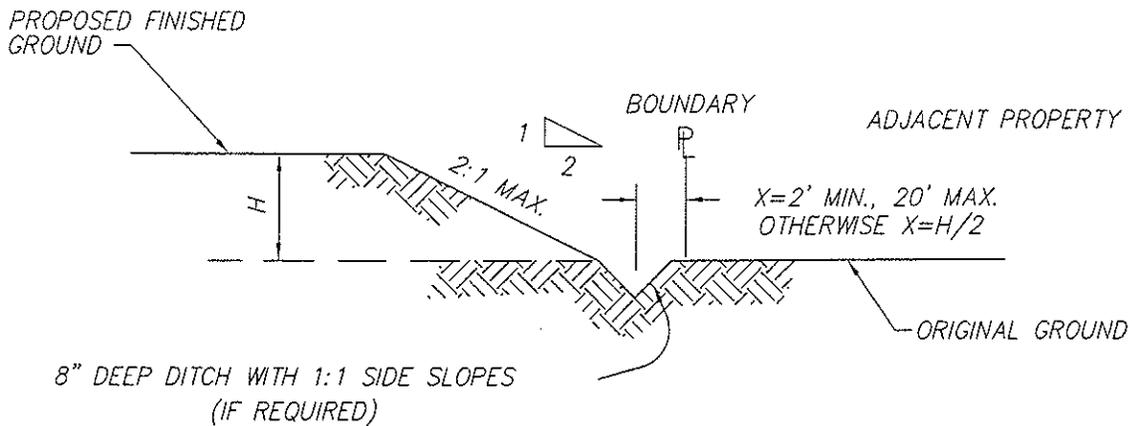

FILL AREAS

ALTERNATE "D"

NOTE:

WHENEVER POSSIBLE THE PROPERTY LINE FENCE SHALL BE AT THE TOP OF THE SLOPE.

APPROVED BY:

Brian J. Fraga
BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
**EXTERIOR PERIMETER
PROPERTY LINE
GRADING**
DEPARTMENT OF PUBLIC WORKS

G-3A

DESIGN NOTES:


1. THE DESIGN REQUIRES A NON-SATURATED BACKFILL. SURFACE AND SUBSURFACE DRAINAGE CONTROL IS REQUIRED TO PREVENT SATURATION OF THE BACKFILL, OR TO RELIEVE HYDROSTATIC PRESSURES. DRAINAGE CONTROL SHALL BE AS SPECIFIED IN THE CONSTRUCTION DRAWINGS, PROJECT PLANS OR AS DIRECTED BY THE TOWN ENGINEER.
2. THE DESIGN IS BASED ON THE FOLLOWING ASSUMPTIONS:
 - A. ALLOWABLE SOIL BEARING 2500 PSF
 - B. EQUIVALENT FLUID WEIGHT 35 PCF
 - C. SOIL FRICTION FACTOR 0.3
 - D. SURCHARGE OVER HEEL 250 PSF
 - E. SOIL DENSITY 125 PCF
 - F. LEVEL BACKFILL

THESE ASSUMPTIONS SHOULD BE VERIFIED BY THE PROJECT GEOTECHNICAL ENGINEER PRIOR TO CONSTRUCTION.

CONSTRUCTION NOTES:

1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3,000 psi IN 28 DAYS.
2. REINFORCING STEEL SHALL BE GRADE 60.
3. THE BACK OF WALL SHALL BE SPRAYED WITH A WATER SEAL COMPOUND.
4. LAP ALL HORIZONTAL STEEL AT LEAST 40 BAR DIAMETERS AT SPLICES.
5. USE CONCRETE MASONRY BLOCK TYPE N PER ASTM C-90.
6. MORTAR SHALL BE TYPE S OR M AND SHALL CONFORM TO ASTM C 270.
7. GROUT SHALL BE A 6 SACK MIX AND SHALL CONFORM TO ASTM C 476.
8. FULLY GROUT (SOLID) ALL CELLS AND CONSOLIDATE PER 1996 U.B.C.
9. $f'm = 2,500$ psi. NO SPECIAL INSPECTION IS REQUIRED.
10. THE FOUNDATION SOIL SHALL BE FIRM AND COMPACTED TO 95% OF MAXIMUM DRY DENSITY, AS DETERMINED BY ASTM D-1557.
11. COMPACTION WITHIN 3 FEET OF THE BACK FACE OF THE WALL SHALL BE ACHIEVED BY LIGHTWEIGHT MECHANICAL TAMPERS, ROLLERS, OR VIBRATORY SYSTEM ONLY.
12. NO BACKFILL SHALL BE PLACED AGAINST THE WALL UNTIL THE CONCRETE OR GROUT HAS REACHED THE DESIGN STRENGTH.
13. OMIT MORTAR FROM VERTICAL JOINT IN FIRST COURSE ABOVE PROPOSED GROUND LINE AT 32" CENTERS FOR WEEP HOLES. FILL ALL CELLS WITH GROUT.
14. SEE DETAIL G-4A

APPROVED BY:

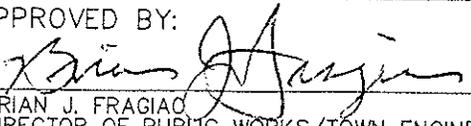
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS


**MASONRY OR CONCRETE
RETAINING WALL**

DEPARTMENT OF PUBLIC WORKS

G-4

NOTES:

1. FOR ALL CUT OR FILL SLOPES WHERE H (HEIGHT) IS GREATER THAN 30 FT., TERRACES SHALL BE CONSTRUCTED AS RECOMMENDED BY GEOTECH ENGINEER. THIS PLATE SHALL BE USED AS A GUIDE.
2. THE MAXIMUM HEIGHT (A) OF EACH SLOPE BETWEEN TERRACE SHALL BE 25 FT.
3. DRAINAGE SWALES ON TERRACES SHALL HAVE A MINIMUM LONGITUDINAL GRADE OF 4% AND A MAXIMUM OF 12% AND CAPACITY FOR A TEN YEAR STORM AND SHALL BE PAVED PER PLATE 53.
4. DOWN DRAINS OR DRAINAGE OUTLETS SHALL BE PROVIDED AT APPROXIMATELY 300 FT. INTERVALS ALONG DRAINAGE TERRACE.
5. UPPER PORTION OF ALL CUT/FILL SLOPES SHALL BE ROUNDED, THE 4 FT. MIN. ROUNDED LENGTH SHALL BE INCREASED WITH INCREASED SLOPE HEIGHT AS REQUIRED BY THE TOWN ENGINEER.

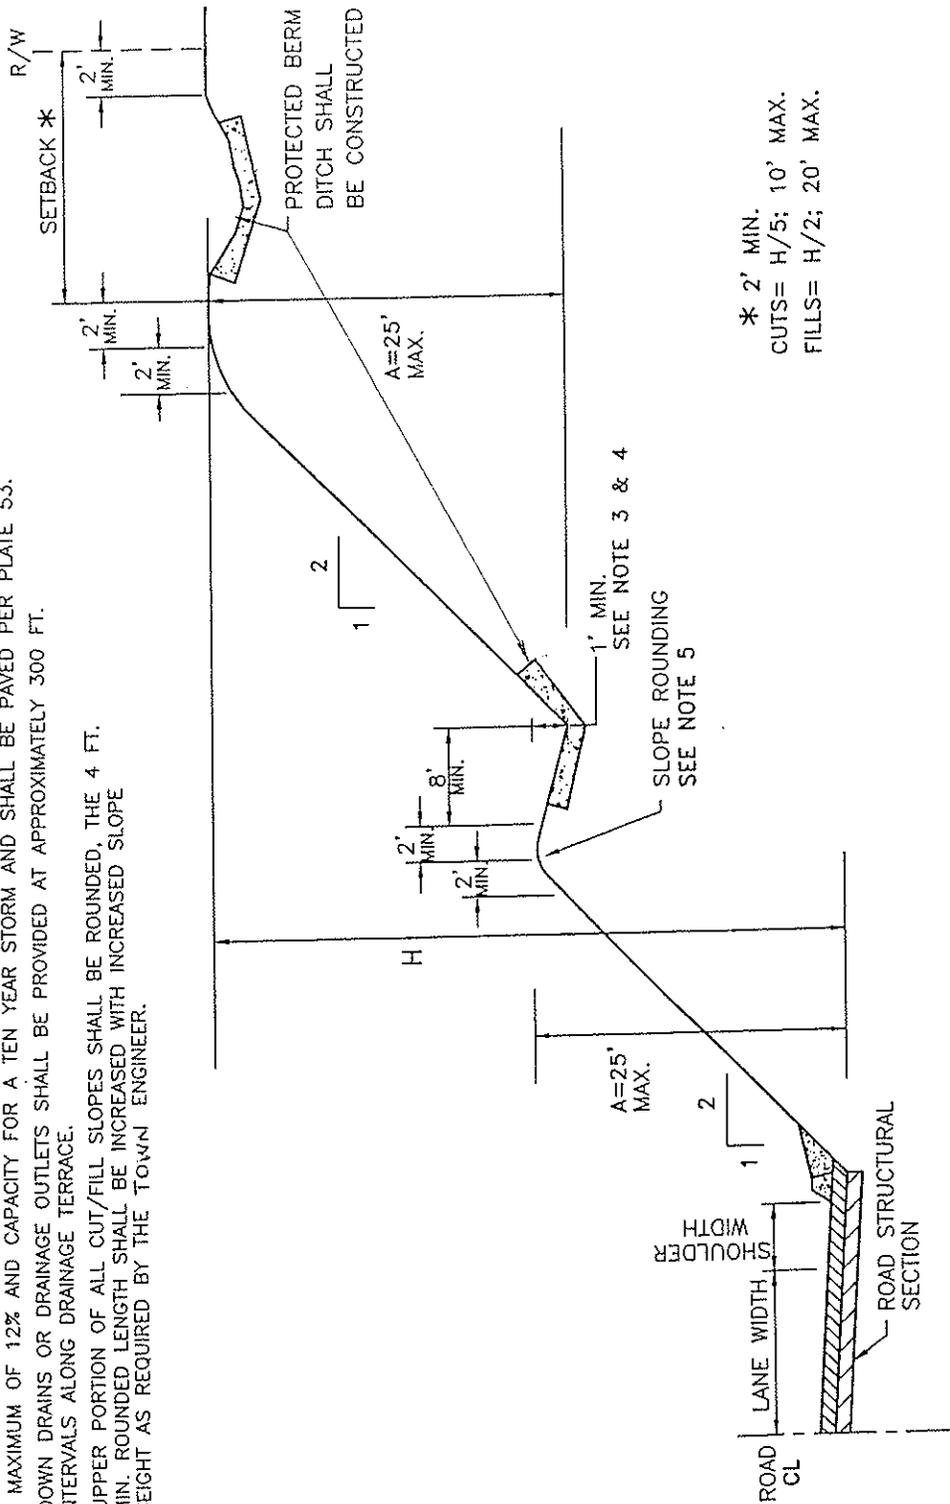

* 2' MIN.
CUTS= H/5; 10' MAX.
FILLS= H/2; 20' MAX.

APPROVED BY:

Brian J. Fragiad

BRIAN J. FRAGIAD
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

TERRACE DRAINAGE
FOR CUT AND FILLS


DEPARTMENT OF PUBLIC WORKS

G-5

NOTES:

1. THE SETBACKS SHOWN ON THIS PLATE ARE FOR USE WITH PROPOSED GRADED SUBDIVISIONS FOR INTERIOR PROPERTY LINES ONLY. SEE G-3 & G-3A FOR REQUIRED SETBACKS ALONG SITE BOUNDARY LINES.
2. DIMENSION B MUST BE LARGE ENOUGH TO ALLOW FOR DRAINAGE AROUND BUILDINGS. THE SLOPE GRADING TO BE COMPLETED AS PART OF THE BUILDING CONSTRUCTION.
3. DRAINAGE DITCH MAY BE REQUIRED AT TOP OF SLOPE.
4. DURING ROUGH GRADING BUILDING PADS SHALL BE GRADED TO MINIMIZE EROSION OF SITE AND SLOPES AND TO PROVIDE FOR FINAL GRADING AT BUILDING STAGE TO PROVIDE -2% SLOPE AWAY FROM BUILDING AS WELL AS ADEQUATE DRAINAGE ON LOT.

H	A MIN.	B
≤ 2'	1'	H/2 BUT 2' MIN., 15' MAX.
> 2 AND ≤ 10'	2'	
> 10'	H/5 BUT 2' MIN., 10' MAX.	

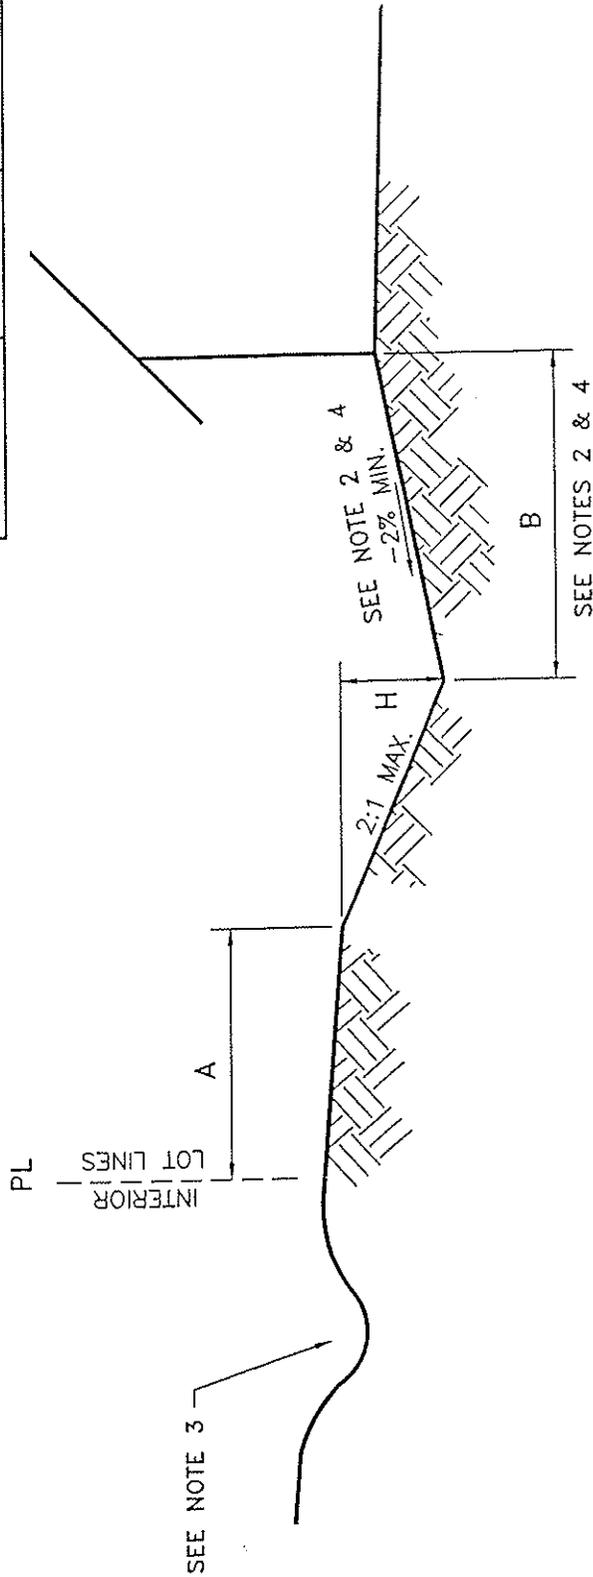

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
PROPERTY LINE GRADING
INTERIOR
DEPARTMENT OF PUBLIC WORKS

G-6


NOTES:

1. REFER TO GRADING ORDINANCE FOR ALLOWABLE CUT, FILL, & ETC.


2. BROW DITCHES MAY BE REQUIRED AT TOP OF SLOPES.

3. IF S IS LESS THAN 7 FT., POOL WALL TO BE CAPABLE OF SUPPORTING THE WATER WITHOUT SOIL SUPPORT.


4. FINAL LOCATION OF BUILDING SHALL CONFORM TO THIS REQUIREMENT AT THE BUILDING STAGE. SITE GRADING FOR PADS SHALL ALLOW FOR THIS REQUIREMENT.

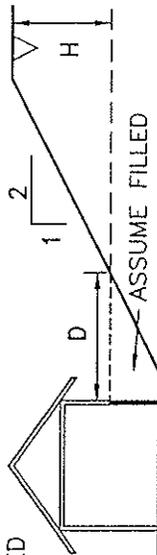

$D=H/2$
 $D=5'$ MIN.
 $D=15'$ MAX.

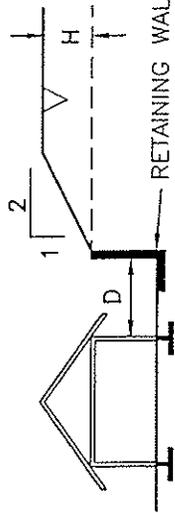


$D=H/2$
 $D=5'$ MIN.

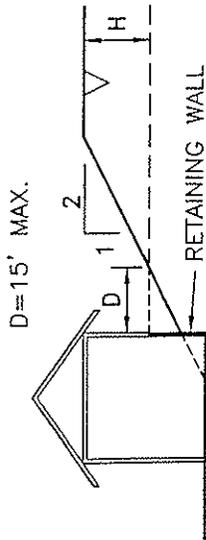


$D=15'$ MAX.


$D=H/2$
 $D=5'$ MIN.
 $D=15'$ MAX.

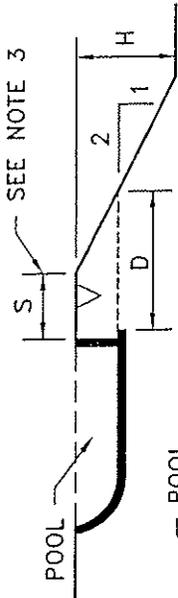


$D=H/6$
 $D=2.5'$ MIN.
 $D=20'$ MAX.

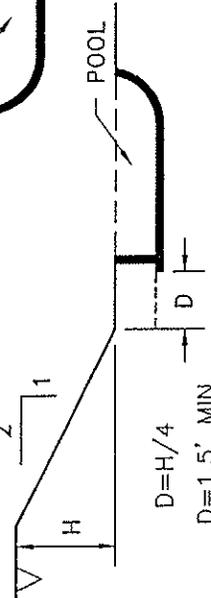

$D=H/4$
 $D=1.5'$ MIN.
 $D=7.5'$ MAX.

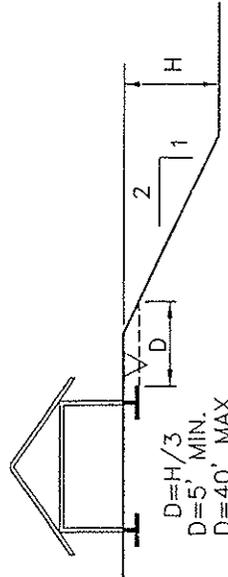


$D=H/3$
 $D=5'$ MIN.
 $D=40'$ MAX.

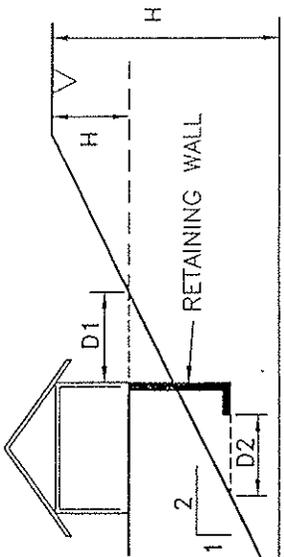

$D1=H/2$
 $D=5'$ MIN.
 $D=15'$ MAX.

$D2=H/3$
 $D=5'$ MIN.
 $D=40'$ MAX.

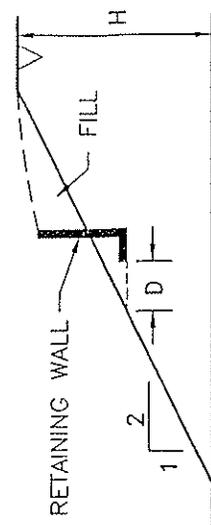

$D=H/3$
 $D=5'$ MIN.
 $D=40'$ MAX.

APPROVED BY:

Brian Fragio

BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



TOWN OF LOOMIS
 BUILDING & SLOPE
 SETBACKS


G-7

DEPARTMENT OF PUBLIC WORKS

REVISED:

NOTES:

1. AFTER HOUSE CONSTRUCTION, LOT GRADING SHALL PROVIDE FOR ADEQUATE RELEASE POINTS FOR ALL BACK LOT DRAINAGE WITH A MINIMUM 1% SLOPE.
2. ALL GRADING FOR SINGLE FAMILY RESIDENTIAL LOTS SHALL CONFORM WITH CLASS 1 REQUIREMENTS
3. MINOR SWALES AROUND BUILDINGS WHICH WILL CARRY WATER ONLY FROM THE ONE LOT ARE TO BE CONSTRUCTED AS PART OF THE BUILDING CONSTRUCTION. SWALES AND DRAINAGE SYSTEMS WHICH WILL CARRY WATER FROM MORE THAN ONE LOT SHALL BE SHOWN ON THE IMPROVEMENT PLANS AND CONSTRUCTED AS PART OF THE IMPROVEMENTS.

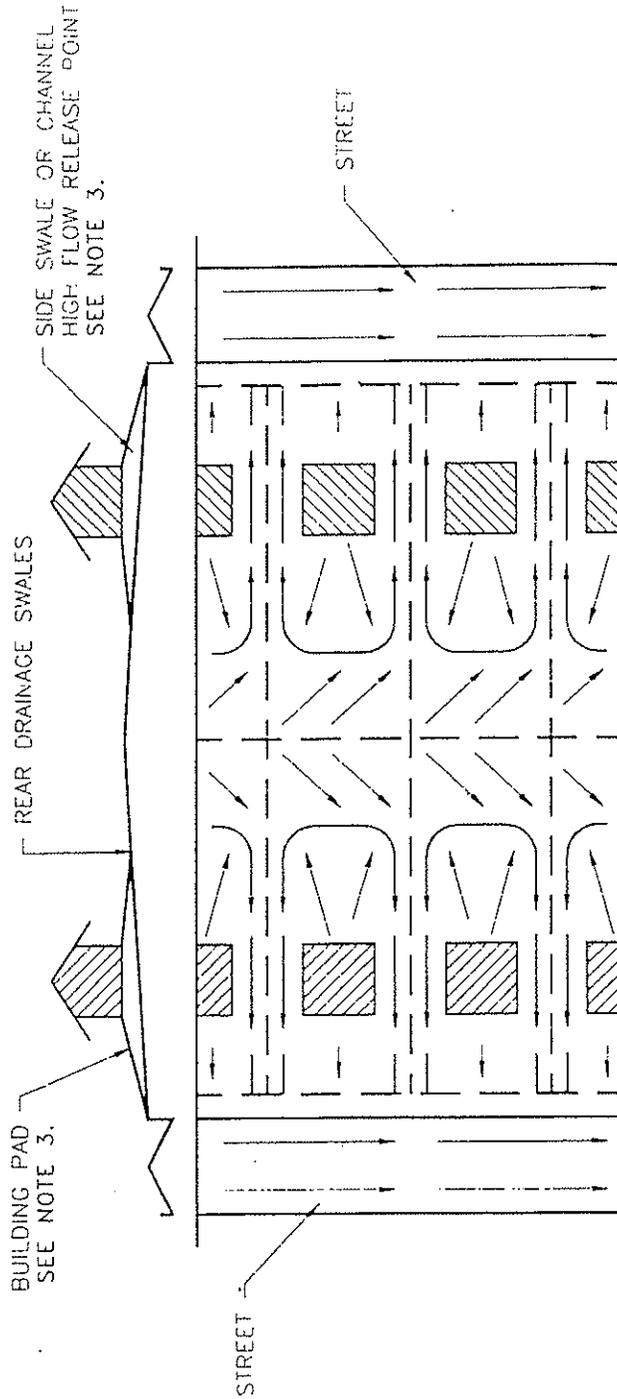

CLASS 1

APPROVED BY:

Brian Fragio
BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS
CLASS 1 RESIDENTIAL
LOT GRADING & DRAINAGE
LOT AREA < 1 ACRE
DEPARTMENT OF PUBLIC WORKS

G-8

NOTES:

1. CLASS 2 AND CLASS 3 GRADING REQUIRE SPECIFIC APPROVAL FROM THE ENGINEER AND ONLY WHEN CLASS 1 GRADING IS NOT FEASIBLE. CLASS 2 IS PREFERRED LOT GRADING OVER CLASS 3.
2. AFTER HOUSE CONSTRUCTION, LOT GRADING SHALL PROVIDE FOR ADEQUATE RELEASE POINTS FOR ALL BACK LOT DRAINAGE WITH A MINIMUM 1% SLOPE.
3. MINOR SWALES AROUND BUILDINGS WHICH WILL CARRY WATER ONLY FROM THE ONE LOT ARE TO BE CONSTRUCTED AS PART OF THE BUILDING CONSTRUCTION. SWALES AND DRAINAGE SYSTEMS WHICH WILL CARRY WATER FROM MORE THAN ONE LOT SHALL BE SHOWN ON THE IMPROVEMENT PLANS AND CONSTRUCTED AS PART OF THE SUBDIVISION IMPROVEMENTS.
4. EACH LOT SHALL HAVE A STORM DRAIN INLET.
5. REAR LOT STORM DRAINS SHALL BE LOCATED IN A DRAINAGE EASEMENT AND SHALL BE MAINTAINED BY THE PROPERTY OWNER OR HOMEOWNER'S ASSOCIATION (IF APPLICABLE).

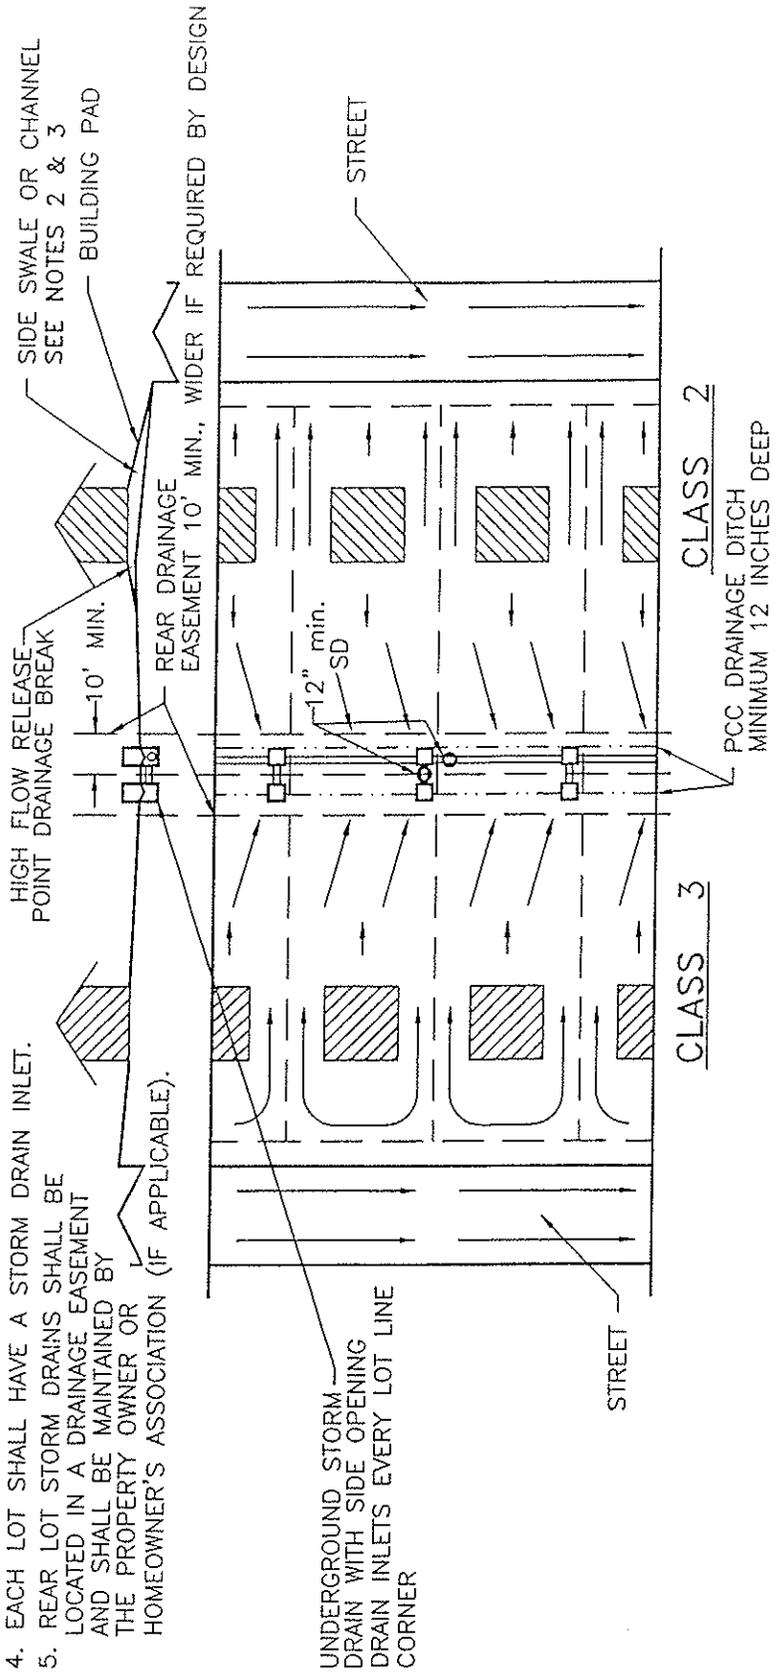

PROVED BY:
Brian J. Fragiola
 BRIAN J. FRAGIOLA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER



TOWN OF LOOMIS
 CLASS 2 & 3 RESIDENTIAL
 LOT GRADING & DRAINAGE
 LOT AREA < 1 ACRE
 DEPARTMENT OF PUBLIC WORKS

REVISED:

SECTION 8

LANDSCAPING & IRRIGATION (LSC)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 8

LANDSCAPING & IRRIGATION

8-1 GENERAL-- All landscaping and irrigation work shall be performed in accordance with these Improvement Standards, approved plans and the manufacturer's recommendations.

8-2 PRESERVATION OF PROPERTY-- The planting and irrigation operations shall be conducted in such a manner that no damage shall result to existing site improvements and plantings. The Contractor shall be responsible for any damage resulting from this operations, and shall repair or replace such damage at his own expense. Vehicles of any kind shall not be allowed to pass over curbs, sidewalks, planting areas, etc., unless proper protection is provided.

8-3 PERSONNEL-- Planting and seeding operations shall be performed by personnel familiar with planting procedures and under the supervision of a certified landscape technician.

8-4 WEATHER-- No planting shall occur during weather conditions which will adversely affect materials or when soil is in a muddy condition.

8-5 IRRIGATION INSTALLATION

A. Backfilling-- Backfill material shall be of native material free from lumps or stones and placed in 6 inch layers thoroughly compacted by mechanical tamping until reaching 92 percent relative compaction outside of paving areas and 95 percent relative compaction within paving areas.

B. Control Wiring

1. Connections between the automatic controllers and the electric control valves shall be made with direct burial copper wire AWG-U.F. 600 volt. Two spare wires of different colors shall be run from the valve furthest from the controller, back to the controller. Pilot wires shall be of a different color for each automatic controller.
2. Common wires shall be white with a different color stripe for each automatic controller. Installations to be made in accordance with the valve manufacturer's recommendations and wire chart. Wire size shall be no less than #14.
3. Wiring shall occupy the same trench as pressure supply or lateral lines. The wiring shall be the same elevation as the supply or lateral lines, being neither above or below these lines.
4. When more than one wire is placed in a trench, the wiring shall be taped together at intervals of 6 feet.
5. Wires installed in conduits shall not be taped together to facilitate replacement of individual wires.

6. An expansion curl should be provided within 3 feet of each wire connection and at least every 100 feet of wire length. Expansion curls shall be formed by wrapping at least five turns of wire around a one-inch diameter pipe, then withdrawing the pipe.
7. Field splices between the automatic controller and electric control valves will not be allowed without the approval of the Town Inspector.
8. There shall be no twinned valves, all RCV's shall be wired to an individual station on the controller.

C. Irrigation Controller -- All controller locations are diagrammatic only. Placement of the controllers will be coordinated with a Town Inspector. All local and applicable codes shall apply in installing the 120 volt electrical service to the controller. The Contractor shall provide the electrical service connections from the power service point to the controller. Adequate coverage and protection of the 24 volt service wire leading from the controller shall be maintained from the bottom of the controller.

D. PVC/Brass Pipe

1. PVC pipe shall be cut with a fine toothed hacksaw or approved cutting tool and any burrs shall be removed. The outside of the pipe and the inside surface of the fittings shall be wiped with a clean cloth and then primed to remove all dirt and moisture prior to applying cement solutions.
2. The cement solution shall be applied to the pipe and fitting socket with a brush having a width approximately one-half the diameter of the pipe. The cement solution shall be applied freely with a light wiping action to spread the cement uniformly over the surfaces. The pipe surface or fitting socket shall not be rubbed with a brush any more than is necessary to spread the cement.

Immediately after the cement has been applied to the surface to be joined, the pipe shall be inserted into the fitting with a twisting motion to the full depth of the fitting socket. Immediately after joining is completed, excess cement shall be thoroughly wiped from the pipe and fitting. The joined members shall be allowed to cure for at least 5 minutes before they are handled. In cold or damp weather, the curing period shall be increased due to slower evaporation of the solvent. An additional fitting or pipe section may be added to the completed joint within 3 minutes if care is exercised in handling so that a strain is not placed on the previous joint.

3. Except as shown on the approved plans, PVC pipe shall be laid in a level trench on compacted or undisturbed earth and solvent-weld pipe shall be placed from side to side in the trench at intervals of approximately 50 feet. Pipe shall be held down between joints with small mounds of earth to prevent movement.
4. Pressure test of mainline shall be made with all RCV's installed and under pressure. After completion of pressure tests on the pipelines, the trench shall be

immediately backfilled, covering the pipe with soft earth to prevent damage from rocks

5. Brass pipe joints shall be threaded couplings, rated at 150 psi. Threaded joints shall be made by placing Teflon tape on the male threads only. Use of thread cement or caulking to make the joints tight is not permitted. All cut ends shall be reamed to full pipe bore before assembly. Brass pipe fittings shall be joined to the pipe in the same manner as specified for pipe joints.
6. All main lines to have a bare copper trace wire installed, running the entire length of the main.
7. All taps on main lines 3 inches or larger shall be made with saddle taps.
8. All piping shall be sleeved under paving.

E. Sprinkler Heads -- Nozzles on stationary sprinklers shall be tightened after installation and sprinklers having an adjustment stem shall be adjusted on a lateral line for proper radius, diameter and gallonage. They shall be set perpendicular to finished grade and shall be installed as indicated on the approved plans and as shown in these Improvement Standard Details.

F. Trenching

1. Excavation shall be open vertical construction sufficiently wide to provide free working space around the work to be installed and to provide ample space for backfilling and compacting. Trenches for pipe shall be cut to required grade-lines, and the trench bottom shall be compacted to provide an accurate grade and uniform bearing for the full length of the line. When two pipes are to be placed in the same trench, 6 inches of separation shall be required between pipes and/or conduits.
2. The excavation required for the installation of conduit, foundations and other appurtenances shall be performed in such a manner as to cause the least possible injury to the streets, sidewalks and other adjacent improvements. All landscape or other improvements disturbed in excavating shall be replaced or reconstructed. The material from the excavation shall be placed in a position that will not cause damage or obstruction to vehicular and pedestrian traffic, nor interfere with surface drainage.
3. The depth of trenches shall provide a minimum cover above the conduit or wiring as follows:
 - a. 12 inches over non-pressure, lateral lines
 - b. 18 inches over pressurized main lines.
 - c. 18 inches over pipe crossing underneath pavement.

G. **Valves** -- Remote control valves shall be adjusted so the most remote sprinkler heads operate at the pressure recommended by the head manufacturer and so a uniform distribution of water is applied by the sprinkler heads to the planting areas for each individual valve system. Each valve assembly shall have its own outlet; multiple assemblies are not allowed. All valves shall be installed as indicated on the approved plans and as shown in these Improvement Standard Details.

H. **Valve Boxes**

1. All remote control valves, gate valves, manual angle or globe valves shall be installed in a plastic valve box as shown in the Construction Standard Details, complete with cover, unless otherwise specified on the approved plans. All plastic valve boxes shall be Brooks, Ametek, Carson, each with locking lids, or approved equal.
2. All valve boxes shall be set 1/4 inch above finish grade in lawn areas and 2 inches above finish grade in ground cover areas. Valve boxes in athletic field areas shall be set 12 inches below grade with a 3M Ball, or approved equal.
3. Valve boxes located near walks, curbs, headerboards or paving shall be installed in such a way as to allow for valve boxes to abut those items with top surface matching planes.
4. All valve boxes shall be blocked for support with brick or concrete block.

I. **Water Service and Meter** -- The water service and meter shall be installed in accordance with PCWA requirements.

8-6 PLANTING INSTALLATION

A. **Soil Preparation and Fine Grading**

1. **Soil Preparation** -- Prior to any planting bed preparation or planting, finish grade all planting areas, fill as needed or remove surplus dirt and float areas to a smooth, uniform grade as indicated on the approved Grading Plans. Slope all planting areas to drain. Roll, scarify, rake and level as necessary to obtain true, even planting surfaces. Finish grades shall be approved by the Town Inspector before planting is started. All planting areas shall be thoroughly wet down and sprinkler emitter coverage and operation confirmed. Allow soils to dry so as to be workable after which thoroughly cultivate to a depth of 12 inches and allow to dry out.
2. **Soil Conditioning** -- Soil amendment and fertilizers shall be spread evenly over all areas as specified below:
 - a. Fertilizer -- Per soils fertility analysis.
 - b. Soil Amendment -- Per soils fertility analysis.

Soil amendments and fertilizers are to be incorporated into the top 12 inches of soil by repeated rotary-hoe cultivation.

3. Fine Grading

- a. Grades not otherwise indicated on the approved plans shall require uniform levels or slopes between points where elevations are given, or between established walks, curbs, paving or other fixed structural elements. Planting areas, including lawns, shall be true to grade within one inch tested in any direction with a 10 foot straightedge. Finish grades shall be smooth, even plane with no abrupt change of surface. Tops and toes of slopes shall be rounded to produce gradual transitions.
- b. Finished grades of all shrubs, annuals and ground cover areas shall be 1 inch below top of adjacent structural elements unless otherwise indicated on the approved plans.

Finished grades of lawn areas shall be 1/2 inch below top of adjacent structural elements. All grades to provide for gravity, surface runoff of water. Low pockets are not allowed.

B. Tree, Shrub and Ground Cover Planting

1. **Locations** -- Tree and shrub locations are to be marked on-site using survey stakes, paint marks or other approved methods. Locations shall be approved by the Town inspector prior to plant holes being dug.
2. **Pit Digging** -- Dig pits circular, 3 times the diameter of the planting can.
3. **Root Balls** -- Plants are to be lifted so that the root ball is supported from the underside. Plants that do not have a satisfactory root system will be rejected. If plants do not have young feeder roots showing at the edge of the container, loosen their roots and cut in several places to encourage new feeder root development along the perimeter of the root ball. Root balls are to be checked for girdling roots around the stems.
4. **Planting plants** -- All plants shall be planted immediately after the containers are cut and containers shall be immediately removed from the site. Ground cover shall be installed at spacings indicated on the approved plans and shall be evenly spaced and staggered in rows. Place each plant in a pit so the root system lies free without doubling and so the roots are planted vertically. Firm the soil around each plant and sprinkle the area immediately to avoid drying out.
5. **Planting trees** -- Place plants in the pits in an upright position and place approved fertilizer tablets. Backfill until the hole is one-half full, thoroughly water, then complete backfilling. Place a 3 inch high berm outside the excavated area, and fill the watering basin with water. Trees shall be planted on a packed mound, 2 inches above grade at the time of planting. The crown on the plant after settlement shall be 1 inch above finish grades for shrubs and 3 inches above

finished grades for trees. Basins are not required if plants are in a lawn area or are watered by an emitter system. Mulch is not to be placed within the basin areas, or within 6 inches of the stems for areas without basins.

6. **Fertilizers & Herbicides** -- Apply fertilizer consisting of a mixture of 16% nitrogen, 6% phosphorous, 8% potassium (16-6-8) at a rate of 5 pounds per 1,000 square feet uniformly over area to receive ground cover. Pre-emergent herbicide shall be applied to all shrub and ground cover areas, including plant basins, prior to any required mulching.
7. **Supporting trees** -- After pruning (only suckers are to be pruned, no pruning on-stem of the tree, up to the primary branches) place stakes along the side of the root ball and two feet into undisturbed soil. Trees are to be tied to the stakes per Improvement Standard Details. No mulch is to be placed within the tree basin, or within 6 inches of the stem if a basin is not required. Specimen trees shall be guyed as specified in Improvement Standard Detail. Specimen trees planted in parks or areas subject to pedestrian traffic shall receive a 24 inch long by 1/2" diameter white PVC pipe on each guy wire for visibility.

C. Hydromulch Seeding

1. **Preparation** -- The slurry preparation shall take place on the site. The slurry preparation shall begin by adding water to the tank when the engine is at half throttle. When the water level has reached the height of the agitator shaft, good recirculation shall be established; the seed shall be added at this time. Fertilizer shall then be added, followed by wood pulp. The wood pulp shall only be added to the mixture after the seed, and, when the tank is at least one-third filled with water.

The engine throttle shall be opened to full speed when the tank is half filled with water. All the wood pulp shall be added by the time the tank is two thirds to three fourths full. Spraying shall commence immediately when the tank is full.

2. **Application** -- Any areas to receive hydromulch shall be sprayed with a uniform, visible coat by using green color wood pulp as a guide. The slurry shall be applied in a sweeping motion, in an arched stream, so as to fall like rain, allowing the wood fibers to build on each other until a good coat is achieved. Application rates shall be based on site conditions and season. Hydromulch shall not be allowed to fall on the ground cover and shrub areas.
3. **Time Limit** -- Any slurry mixture which has not been applied to the slope within 4 hours of mixing will be rejected by the Town Inspector and shall be removed from the project at the Contractor's expense.

D. Seeding

1. **Preparation** -- Installation of all plants and ground cover shall have been completed prior to seeding operations. Just prior to sowing, areas to be seeded shall be made sufficiently loose and friable to receive the seed.

2. **Application** -- Seed shall be sowed evenly using a mechanical spreader at the rate specified on the approved plans. One-half the seed shall be sowed in one direction, and the remaining one-half sowed in a direction 90 degrees to the first during a windless period. Turf seed shall be applied with an implant seeder that implants the seed into the soil. Broadcast seeding is not allowed for turf seed. Apply fertilizer (16-6-8) at a rate of 5 pounds per 1,000 square feet uniformly over seeded areas. Lightly rake surface to cover seed and to mix with fertilizer and then compact with a 200 pound roller. Soil shall be kept moist but not saturated until the seed has germinated.
3. **Protection** -- Protect grass areas with temporary fencing as necessary. Barriers shall be maintained by the Contractor and kept in orderly condition at all times until work has been accepted by the Town. Any damage to turf shall be repaired at the expense of the Contractor.

E. Sod Planting

1. **Application** -- Unroll the sod, fitting each strip tightly to the preceding strip. Do not stretch the sod. Force each strip together as tightly as possible. Stagger the strips of sod to prevent the seams on adjacent rows from matching. Care shall be taken to prevent heel or foot prints in the grade as the sod is being placed.
2. **Rolling** -- As soon as the sod is placed, roll it with a light roller, making certain that no air space is left under the sod. After the first rolling, moisten the sod lightly and then allow the grass to dry off before the second rolling. The second rolling should be at a cross angle to the first rolling.
3. **Maintenance** -- Upon completion of the rolling, apply sufficient water to wet the sod and soil to a depth of 6 inches. Sod shall be kept moist for the next 10 days. The grass is to be mowed to a height of 2 inches at the end of the 10 day period. Care shall be taken to leave no foot prints in the sod.

8-7 IRRIGATION MATERIALS

A. **Backflow Prevention Device** -- The backflow prevention device shall be of a reduced pressure type and shall be in accordance with Improvement Standard Details.

B. Electrical

1. **Control Wire** -- All wiring to be used for connecting the automatic controller to the electric solenoid actuated remote control valve shall be type UF-600V, solid copper, PVC insulation, single conductor, UL approved underground feeder cable. All pilot or "hot" splicing wire at the valves or in the field shall be made as follows: The splice shall be insulated with a 3-M DBR #09053 Splice Kit, or approved equal. Field splices between the controller and valves will not be allowed without prior approval of the Inspector.

2. **Pull Box Covers** -- Pull boxes shall have reinforced concrete covers and shall be inscribed "Irrigation 24 Volt". Covers shall be provided with two-3/8 inch brass hold down bolts with brass washers and nuts. Nuts shall be recessed below the surface of the cover. Pull boxes set in traffic areas shall have steel covers designed to handle vehicle loading.
 3. **Service Unit and Meter Socket** -- The combination service and termination point for metered service shall be Tesco Class 21-000 service pedestal State of California Type 3, or approved equal.
 4. **PVC Conduit** -- All PVC conduit shall be heavy-wall, schedule 40, with factory made bends, couplings and fittings.
- C. Irrigation Controller** -- The irrigation system controller shall be a UL approved micro-processor based, solid state unit capable of fully automatic or manual operation of the system. It shall be housed in an exterior (16 gauge) weatherproof pedestal mounted lodging case. It shall operate on 117 volts AC, 50/60 Hz power input and be capable of operating 24 volt AC electric control valves. In addition, the controller shall be equipped with or shall be capable of the following:
1. Each station shall have the capability of being individually programmed to operate from one minute to nine hours, and from 59 minutes in one minute intervals.
 2. It shall have a a quick stations function which allows for rapid programming of a block of stations with the same watering period.
 3. It shall have three independent programs with four automatic starts per day per program.
 4. Each program shall have its own percentage function which allows the watering length of all stations in the program to be changed from 0% to 300% in 1% increments and at all times be able to display the original watering length of each station.
 5. Each program shall be capable of being set on either a seven day weekly repeat cycle where the active days are displayed all at once or on a skip day basis where the user may select the number of days skipped, from one to thirty, between waterings with the starting day selectable.
 6. The controller shall have a review program function which, with one button, will sequentially bring all its programming information to the displays at a readable rate. The recall display shall be interruptible at any time for changing of the program. Each program shall provide a total duration watering time in hours and minutes.
 7. The controller shall allow for setting in a "rain mode" for up to seven days, after which it will revert to the "automatic mode".

8. Program may be protected by use of an access code.
9. Controller shall be capable of being operated manually at any time without affecting the original program.
10. The controller shall have a rechargeable battery back-up to maintain time and the user's program.
11. The controller shall have the capability of responding to external remote control signals when coupled to a master remote control system.
12. The controller shall have a built-in self test which allows the user to check each of the following:
 - a. LED's for lighting and shorts
 - b. the digital display for lighting and shorts
 - c. each key of the keyboard for integrity and proper function
 - d. all stations capable of being operated manually at any valve.
13. Output power capacity shall be 24 VAC, 1 amp maximum, equivalent to 24VA.
14. When the battery operated controller is used, a PT2 Nicad rechargeable battery pack shall be used.

The controller shall be housed in a pedestal type enclosure installed on a Class A Portland Cement Concrete foundation as recommended by the manufacturer of the controller. Enclosure shall be a weatherproof, 16 gauge zinc coated metal locking case to which 2 keys shall be provided. Enclosure shall be grounded with a minimum 6 foot copper clad ground rod. The enclosure and accessories shall be installed in conformance with the manufacturer's instructions and recommendations. Foundation to be a minimum of 4 inches deep and with sufficient width to prevent tipping.

D. Pipes and Fittings

1. **Mains** -- Irrigation mains shall be 3/4 inch or larger polyvinyl chloride pipe (PVC) Class 315 and shall be manufactured of Type 1, Grade I or II, 2,000 psi design stress compound designated as PVC 1120 or 1220, and shall conform to ASTM designation D1784 for rigid PVC compounds. All main lines of 3 inches or larger shall be ring tite. All plastic fittings shall be molded Schedule 40 fittings manufactured of the same material as the pipe and shall be suitable for either solvent weld or screwed connections. Solvent weld type couplings and fittings shall have a pressure rating equal to or greater than that of the pipe and shall be a type recommended by the pipe manufacturer.
2. **Laterals** -- Laterals shall be 1/2 inch or larger PVC Class 200 and shall be manufactured of Type 1, Grade I or II, 2,000 psi design stress compound designated as PVC 1120 and shall conform to ASTM designation D1784 for rigid PVC compounds.

All plastic fittings shall be molded fittings manufactured of the same material as the pipe and shall be suitable for either solvent weld or screwed connections. Solvent weld type couplings and fittings shall have a pressure rating equal to or greater than that of the pipe and shall be a type recommended by the pipe manufacturer. Brass pipe fittings shall be 150 psi, banded pattern. All nipples shall be of the same material as the pipe.

E. PVC Pipe Cements

1. **Primer** -- For all sizes of PVC pipe and fittings, primer shall be IPS P-70 PVC, Weld On #P-70 Primer, or approved equal.
2. **Cement** -- For all sizes of PVC pipe and fittings, cement shall be IPS 711, Weld On #711 Glue, or approved equal.

- F. Sprinkler Heads** -- All sprinkler heads shall be constructed of plastic or stainless steel and shall be matched precipitation rate (MPR) nozzles equipped with a Seal-A-Matic (SAM) check valve, or approved equal.

All sprinkler heads of a particular type or function in the system shall be of the same manufacturer and shall be marked with the manufacturer's name and identification in such a position that they can be identified without being removed from the system. All tree bubblers shall be placed below grade in perforated pipe with crushed rock and geotex fabric.

- G. Sprinkler Risers** -- All 1/2 inch riser nipples shall be threaded Schedule 80 PVC and swing joints shall be Schedule 80 PVC threaded street ells. All 1 inch riser assemblies shall consist of swing joints rated at 200 psi, 2-Schedule 80 PVC nipples and 1-Schedule 80 nipple.

H. Valves and Valve Boxes

1. **Remote Control Valves** -- All Remote Control Valves (RCV) shall be 24 volts, 3.5 watt maximum, normally closed, spring-loaded and diaphragm actuated. They should have a mechanical self-cleaning internal control system. The RCV shall be slow closing with no adjustments or settings required. A manual flow stem or throttle or close shall be provided. Each RCV will be equipped with a petcock. The solenoid is to be corrosion proof and molded in epoxy resin to form one integral unit. The RCV shall have two inlet tappings (furnished with one plugged) and capable of being installed as either a globe or angle valve. It must have a removable seat and be completely serviceable in the field without removing the valve body from the system.

All RCV are to be isolated from the main line with a PVC Ball Valve and connected to the lateral with a schedule 80 union in the valve box. RCV used in drip irrigation systems shall incorporate an adjustable pressure regulator with a regulating range of 5 to 200 psi. The RCV shall be an electric solenoid type, and shall be the Hydrorain Series 100 or approved equal.

2. **Gate Valves** -- Gate valves shall be bronze body, bronze mounted, double disc, parallel seat with non-rising stem. Gate valves shall have "O" ring seals and have hubs suitable for use with the main distribution pipe furnished for the sprinkler system.
3. **Quick Coupling Valves** -- Quick coupling valves shall be two piece, 1 inch diameter Rain Bird 44RC with a coupler key, single lug-Rain Bird 44K or approved equal.
4. **Valve Boxes** -- Valve boxes shall be plastic with lock snap cover, green, with the word "Irrigation" embossed on the cover. Valve boxes shall be of the Brooks 1100 series, or approved equal. Valve boxes installed below the finish grades shall also include a 3M Marling Ball, or approved equal.

8-8 PLANTING MATERIAL

- A. **Backfill** -- Backfill used in tree and shrub holes shall be a mixture of soil amendment (one-third) and excavated material (two-thirds), thoroughly mixed.
- B. **Fertilizer** -- Fertilizer shall be a commercial inorganic fertilizer in the granular or pellet form. Fertilizer shall be delivered to the site in containers labeled in accordance with the applicable State of California regulations, bearing the warranty of the producer for the grade furnished, and shall be uniform in composition, dry and free-flowing.
 1. **Turf and Planting Areas** -- Pelleted types with analysis of 16-6-8.
 2. **Planting Holes** -- Tablet types with an analysis of 20-10-5, Agriform Blue-Chip Tablets, 21 gram size, or approved equal.
- C. **Herbicide** -- A list of approved products include: Surflan, Ronstat G, Ronstat WP, or approved equal.
- D. **Hydromulch Seed**
 1. **Seed** -- As specified on the approved plans.
 2. **Fertilizer** -- Rate shall be applicable to site and type of seed used.
 3. **Cellulose** -- The mulch shall be a green colored, fibrous, wood cellulose mulch containing no growth or germination inhabiting factors. It shall be manufactured in such a manner that after addition and agitation in slurry tanks with fertilizer, seed, water, and other approved additives, the fibers in the material will become uniformly suspended to form a homogeneous slurry; and, that when hydraulically sprayed on the ground, the material will form a blotter-like ground cover impregnated uniformly with seed and mulch.

After application, this mixture will allow the for the absorption of moisture and allow the rainfall to percolate to the underlying soil. Cellulose shall be certified to indicate that laboratory and field testing of the product has been accomplished and that it meets all of the foregoing requirements. Weight specification of this material from suppliers and for all applications shall refer only to air dry weight of the fiber material. Cellulose rate shall be applicable to site and type of seed used.

4. **Water** -- Water for hydromulching shall be clean, potable and added to the slurry mixture in sufficient amount to spread uniformly the required quantity of hydromulch solids (approximately 3,000 gallons per acre).
 5. **Equipment** -- Hydromulching equipment used for the application of the seed, fertilizer and slurry shall have a built-in agitation system and operating capacity sufficient to agitate, suspend and homogeneously mix a slurry containing up to 40 pounds of fiber plus a combined total of 70 pounds of fertilizer solids and seed for each 100 gallons of water. The slurry distribution lines shall be large enough to prevent stoppage. This discharge line shall be equipped with a set of hydraulic spray nozzles which will provide a continuous non-fluctuating discharge and delivery of the slurry in the prescribed quantities uniformly, without misses, waste or erosion. The slurry tank shall have a minimum capacity of 1,000 gallons and shall be mounted on a traveling unit which may be either self-propelled or drawn. The Town Inspector may authorize equipment with smaller tank capacity provided that the equipment has the necessary agitation system and sufficient pump capacity to spray the slurry in a uniform coat.
- E. **Imported Topsoil** -- Topsoil shall be an imported fertile, friable soil of loamy character containing a normal amount of organic matter. It shall be obtained from well drained, arable land and shall be free from refuse, roots, heavy or stiff clay and stones larger than 1 inch in size. Soil shall, by particle examination, containing the following percentages: Sand--between 45 and 52%; Silt--between 26 and 50%; Clay--between 6 and 26%. Sands shall range from 2 to 0.05 millimeters in diameter; Silt from 0.05 to 0.002 millimeters in diameter; and Clay less than 0.002 millimeters in diameter.
- F. **Mulch** -- Mulch shall be a fibrous, woody bark mixture. A list of approved products includes: Sun-Up Forest Products, "Walk-on-Bark", or approved equal.
- G. **Plant Stock and Ground Cover** - Plants shall be the variety, quantity and size indicated on the approved plans. Quality and size shall conform to the State of California Grading Code of Nursery Stock, No. 1 grade. Nursery grown stock only shall be used and shall be free from insect pests and diseases.

All plants shall comply with Federal and State laws requiring inspection for plant diseases and infestations. Inspection certificates required by law shall accompany each shipment of plants, and certificates shall be delivered to the Town Inspector. All plants shall be true to specified and size indicated, and shall be tagged in accordance with the standard practice recommended by the American Association of

Nurserymen; however, determination of plant species or variety will be made by the Public Works Director and shall be final.

Plants shall be healthy, shapely and well rooted, and roots shall show no evidence of having been root bound, restricted or deformed. Root conditions of plants in containers will be inspected by the Town Inspector and determined by removal of earth from the roots of not less than two plants of each specified or variety from each source. In case the sample plants inspected are found to be defective, the Inspector reserves the right to reject the entire lot or lots of plants represented by the defective samples. All plants rendered unsuitable for planting because of this inspection shall be immediately removed from the site.

Each plant shall be handled and packed in the approved manner for that species or variety and all necessary precautions shall be taken to ensure that the plants will arrive at the site of the work in the proper condition for successful growth without scarred or broken branches. Trucks used for transporting plants shall be equipped with covers to protect plants from wind burn.

Substitutions will not be permitted unless proof is submitted to the Town Inspector that any plant specified is not obtainable. The Inspector will consider use of the nearest equivalent size or variety.

Plants shall have straight trunks with the leader intact, undamaged and uncut. Trees shall be well tapered in the trunk so that they will stand alone without the support of the nursery stake. Branching on the main leader shall be in alternate locations and well spaced apart with no severe crossing of branches. All old abrasions and cuts shall be completely calloused over. All plants shall be measured when their branches are in their normal positions. Height and spread dimensions indicated refer to the main body of the plant and not from branch or root tip to tip. Indicated sizes shown are before pruning. Plants shall be pruned prior to delivery except upon approval of the Town Inspector.

Ground cover shall be rooted plants, grown in flats unless otherwise approved by the Inspector.

- H. Seed** -- Seed mixture shall be 98 percent pure, and noxious weed free, with a minimum of 88 percent Germination. Seed variety or mix shall be as specified on the approved plans. All seed shall be cleaned Grade A "new crop" seed, delivered in the original unopened containers, and shall bear a guaranteed analysis and dealer's label. The dealer may mix the seed provided a guaranteed statement or composition of mixture and percentages of purity and germination of each variety is attached to the sealed container. The seed shall be pre-treated with a pre-emergence fungus preventative in accordance with the manufacturer's specifications. The seed containers shall be stored immediately in a dry, weather and damp proof structure. Any seed which has become wet, moldy or is otherwise damaged in transit or storage will not be acceptable. Supplier shall be approved by the Town Inspector prior to delivery.

- I. **Soil Amendment** -- Soil amendment shall be delivered to the job site bearing the warranty of the producer for the grade furnished and shall be uniform in composition and free flowing. Grade shall be 0 to 1/4 inches with 15% maximum proportion of 1/4 inch particles.

Soil amendment shall be nitrogen stabilized (1-0-0) and shall be Sequia Forest Products' Forest Humas, Mallard Creek Nitro Plus, or approved equal.

J. Tree Stakes and Ties

1. **Tree Stakes** -- Tree stakes shall be straight, close grained hardwood, pointed at one end. Stakes shall be pointed prior to treatment with copper naphthalene which shall penetrate stake surfaces to a minimum depth of 1/4 inch. Tree stakes will consist of 2-two inch diameter by 8 foot long, round stakes.
2. **Tree Ties** -- A list of approved products include: Gro-Strait, or approved equal
3. **Earth Anchors** -- The size of trees to be supported shall determine the necessary holding capacity of these anchors. Anchor holding capacity to be approved by the Public Works Director. A list of approved products include: Landscape Supply Co.'s "Duckbill", or approved equal.

8-9 IRRIGATION TESTING

- A. **Service Lines and Irrigation Main** -- Upon completion of the main line distribution system, lateral lines and installation of the electric control valves, the system shall be flushed and then capped. After notifying the Town Inspector 72 hours in advance, the system will be pressure tested by applying a continuous static water pressure and shall meet the following conditions:

1. Main lines to hold 150 psi for four hours.
2. Lateral lines at line pressure for four hours.

Repair any leaks resulting from the pressure tests. Pressure testing shall continue until no leakage or loss of pressure is shown over the entire prescribed test period. At the conclusion of the pressure tests, the heads shall be installed and tested for operation in accordance with design requirements under normal operating pressures.

- B. **Electrical System** -- Prior to the acceptance of the improvements, the Contractor shall pass the following tests to the electrical system:

1. Continuity of each circuit
2. Grounds in each circuit
3. A megger test on each circuit
4. A functional test in which it is demonstrated that each and every part of the system functions as specified or intended herein.

8-10 MAINTENANCE PERIOD

- A. Preliminary Inspection** -- Upon completion of all irrigation and planting work, the Contractor shall notify in writing the Town that the landscaping is ready for preliminary inspection. The approval of the completed work will establish the beginning of the maintenance period. No partial approvals will be given.
- B. Maintenance Period** -- The maintenance period shall be 120 calendar days from the approval of the constructed improvements. A longer period may be required to establish acceptable stands of thriving plants.
- C. Overall Maintenance Requirements** -- Maintenance shall include all watering, weeding, mowing, fertilizing, cultivation, spraying and pruning necessary to keep the plant material in a healthy, growing condition and to keep the planted areas neat and attractive in appearance throughout the maintenance period. Maintenance shall also include responsibility for maintaining adequate protection for all landscaped areas. Any damaged areas shall be repaired at no additional expense to the Town.

During the maintenance period, should the appearance of any plant indicate weakness and the probability of dying (in the opinion of the Town Inspector) that plant shall be replaced immediately by the Contractor at his own expense. Replacements shall be made in the same manner as specified for the original planting. At the end of the maintenance period, all plant material shall be in a healthy, growing condition and free of physical injury of any kind.

Maintenance includes all items constructed under the approved plans. All items shall be maintained in an optimum working condition. The site shall be kept free of debris, including emptying trash containers, by means of a general clean-up twice a week.

- D. Watering** -- All plants shall be watered not less than twice a week. Each watering shall be of such quantity as to provide optimum growth conditions. The Contractor shall provide the equipment and means for its proper application.
- E. Lawn Maintenance** -- Lawn areas which fail to germinate shall be re-seeded at maximum 10 day intervals until a vigorous, uniform stand of turf is established. Lawn areas shall be kept free of weeds, by hand pulling, or they may be sprayed with an approved selective chemical herbicide before the weeds exceed 2 inches in height.

Lawns shall be mowed for the first time after establishment of a vigorous, uniform stand of turf has reached 3 inches. Lawns shall be trimmed at the edges of curbs, walks, paving and other surface improvements. Clippings and debris shall be removed from the site. Lawn shall be mowed a second time when it again reaches a 3 inch height, except that the second cutting shall be performed no sooner than 10 days after the first. Mowing shall then take place at maximum 1 week intervals until final acceptance.

After the second mowing, apply the second application of fertilizer. Apply fertilizer (16-6-8) at the rate of 5 pounds per 1,000 square feet uniformly over the turf area. Fertilizer is to be applied one more time just prior to final inspection.

F. Plants -- Plants installed shall be properly maintained by regular watering, cultivating, weeding, re-mulching, repair of stakes, pruning, and treatment of insects and pests. Any plants which are vandalized, diseased, dead or in an unhealthy condition shall be replaced by the Contractor at his own expense within two weeks after notification from the Town Inspector. Any lawn or plants damaged by herbicide shall be replaced by the Contractor at his own expense. Maintenance shall also include treatment or replacement due to fungus, diseases, rodents and insects.

G. Weeding and Grading -- All areas to be weeded at intervals of not more than 10 days. Rocks, clods and debris which appears on the surface shall be removed. Heaved, settled or eroded areas shall be restored by excavating, filling, finish grading, rolling and re-seeding as required.

8-11 CLEANING UP -- The Contractor shall at all times keep the premises from accumulations of waste, material or rubbish caused by his employees, or employees of the subcontractors, and at the completion of his work, shall remove all rubbish from and about the site and all tools, scaffolding and/or surplus materials.

8-12 FINAL INSPECTION AND ACCEPTANCE

A. Timing -- Final inspection will be conducted at the end of the maintenance period. Notice requesting the final inspection shall be submitted in writing by the Contractor to the Public Works Director at least 7 days prior to the anticipated date.

B. Review -- Acceptance of the project by the Town will be contingent upon proper maintenance and the establishment of a vigorous, uniform stand of turf, healthy plants, weeded site, repair of any damaged surface improvements, repair of any damaged irrigation components and a thorough cleaning of the site.

Just prior to final inspection, Contractor shall apply fertilizer (16-6-8) to the areas as follows:

15 g.c. plants	1 cup
5 g.c. plants	1/2 cup
1 g.c. plants	1/4 cup
Ground cover	10 pounds per 1,000 square feet
Lawn areas	5 pounds per 1,000 square feet

Fertilizer shall be spread around plant bases and thoroughly watered.

C. Corrective Work

1. Turf -- Any portion of turf which does not show a vigorous, uniform stand shall be replaced and shall make all lawn areas subject to continued maintenance at the Contractor's expense.

2. Plants -- Plants which are missing, vandalized, dead or unhealthy shall be replaced by the Contractor at his expense with the same species and sizes as specified on the approved plans. The Contractor shall make replacements within two weeks after final inspection and maintain the plants for an additional 30 days.

3. Irrigation -- The irrigation system shall be repaired to conform to the requirements of the approved plans and associated specifications.

D. Final Acceptance -- If project improvements, corrective work and maintenance have not been performed as specified to the satisfaction of the Town Inspector, maintenance shall continue at the Contractor's expense until such time as work has been successfully completed. Once work has been performed as specified and to the Town Inspector's satisfaction, the Town will assume maintenance responsibilities following the final inspection.

8-13 GUARANTEE

A. Plants -- All trees, shrubs, ground covers and other plant materials shall be guaranteed to take root, grow and thrive for a period of one year after final acceptance of work. Any trees or other plant materials that die back and lose the form and size specified on the approved plans shall be replaced by the Contractor at his own expense, even though they have taken root and are growing after the die-back.

Within 15 days of written notification by the Town, the Contractor is to remove and replace all guaranteed plant materials which, for any reason, fail to meet the requirements of this guarantee. Replacements shall be made to the same specifications and materials as required on the approved plans and shall carry this same guarantee from the time they are replaced.

B. Irrigation -- The entire sprinkler system shall be unconditionally guaranteed by the Contractor as to material and workmanship, including settling or backfilling areas below grade, for a minimum period of one year following the date of the final acceptance of the work.


If, during the guarantee period, settlement occurs and adjustments in pipes, valves, sprinkler heads, sod or paving is necessary to bring the system, sod or paving to the proper level of the permanent grades, the Contractor shall make the adjustments at his own expense, including the complete restoration of all damaged planting, paving or other improvements of any kind.

Should any operational difficulties in connection with the sprinkler system develop within the specified guarantee period, which, in the opinion of the Town, may be due to inferior material and/or workmanship, said difficulties shall be immediately corrected by the Contractor to the satisfaction of the Town at no additional costs to the Town, including any and all other damage caused by such defects.

LANDSCAPING STANDARD DETAILS

<u>Title</u>	<u>Plate No.</u>
Tree Planting.....	LSC-1
Tree Planting on Slope.....	LSC-2
Groundcover Planting.....	LSC-3
Shrub Planting Detail.....	LSC-4
Shrub Planting Detail.....	LSC-5
Pipe Trenching Detail.....	LSC-6
Pipe Trenching Under Pavement Detail.....	LSC-7
Thrust Block Details.....	LSC-8
Above Grade Emitter.....	LSC-9
Pop-Up Spray Head.....	LSC-10
Gate Valve – 3” & smaller.....	LSC-11
Quick Coupling Valve Detail.....	LSC-12
Tree Bubbler.....	LSC-13
Electric Control Valve and Gate Valve.....	LSC-14
Below Grade Electric Control and Gate Valve.....	LSC-15
Flow Sensor Detail.....	LSC-16
Concrete Walk.....	LSC-17
Asphaltic Concrete Walk.....	LSC-18
A.C. Bike Path.....	LSC-19
Exposed Aggregate Paving.....	LSC-20
Decomposed Granite.....	LSC-21
Collapsible Bollard.....	LSC-22
Bike Path Striping/Bollard Installation.....	LSC-23
Redwood Headerboard.....	LSC-24
Post & Cable.....	LSC-25
Redwood Fence.....	LSC-26
Chain Link Fence Detail One.....	LSC-27
Chain Link Fence Detail Two.....	LSC-27A

15 GAL OR 24" BOX TREE, REMOVE NURSERY STAKES AND LEAVE LOWER BRANCHES.

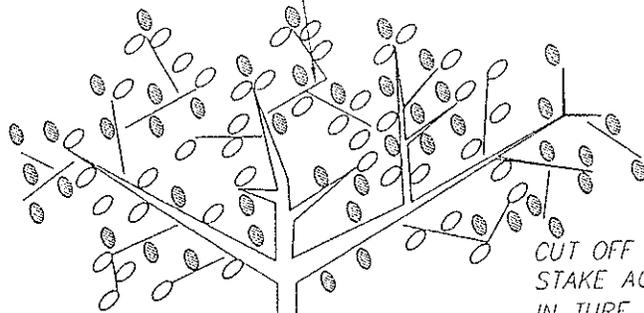

CUT OFF BELOW PRIMARY BRANCHES AND STAKE ACCORDING TO PREVAILING WIND. IF IN TURF AREA LESS THAN 12' IN WIDTH, STAKE TREES PARALLEL TO THE LONG WAY OF THE TURF, NOT CROSS TO THE TURF AREA.

4" WATER BASIN IN PLANTING AREAS ONLY. COVER WITH 2" MULCH OF REDWOOD OR FIR BARK (KEEP 6" AWAY FROM TRUNK). IF BUBBLERS ARE USED, TWO MIN. SET BUBBLERS BELOW GRADE IN PERFORATED PIPE, EVEN IN ROUGH AREAS. SEE SPEC. NOTES.

ARBOR GARD IN LAWN AREAS ONLY.

2-4"x3' RIGID PERFORATED DRAIN PIPE WITH 3/4" DRAIN ROCK AND GREEN P.V.C. SLOTTED DRAIN GRATE IN LAWN AREA ONLY

NO TREE WELL IN TURF AREA

FINISH GRADE

PLANTING DEPTH: TOP OF ROOTBALL 2" ABOVE FINISH GRADE. PLANT NO DEEPER THAN GROWN IN NURSERY

SLOW RELEASE FERTILIZER TABLETS (4), TYP.

CENTER OF HOLE SHALL BE UNDISTURBED SOIL.

BOTH TIES TO BE NEW RUBBER CINCH TYPE

TWO 2" ROUND BY LODGEPOLE STAKES.

ROOTBALL

DO NOT TOUCH ROOTBALL WITH STAKES.

HOLE SIZE: THREE TIMES AS WIDE & 12" DEEPER THAN THE ROOTBALL ON BOTH SIDES.

6'-0"

4'-0"

NOTE:

PREPARED BACKFILL MIX SHALL CONFORM TO SECTION 8-8

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

TREE PLANTING

DEPARTMENT OF PUBLIC WORKS

LSC-1

15 GAL OR 24" BOX TREE, REMOVE NURSERY STAKES AND LEAVE LOWER BRANCHES.

BOTH TIES TO BE NEW RUBBER CINCH TYPE

STAKE ACCORDING TO PREVAILING WIND TWO 2" ROUND BY LODGEPOLE STAKES AND CUT BELOW PRIMARY BRANCHES. IF IN TURF AREA LESS THAN 12' IN WIDTH, STAKE TREES PARALLEL TO THE LONG WAY OF THE TURF, NOT CROSS TO THE TURF AREA.

BUBBLIER TO BE ON UPHILL SIDE OF TREE WITH A MINIMUM OF TWO BUBBLIERS PER TREE. SET BUBBLIERS BELOW GRADE IN PERFORATED PIPE, EVEN IN ROUGE AREAS.

4" WATER BASIN IN PLANTING AREAS ONLY. COVER WITH 2" MULCH OF REDWOOD OR FIR BARK (KEEP 6" AWAY FROM TRUNK). SEE SPEC. NOTES.

ARBOR GARD IN LAWN AREAS ONLY.

PLANTING DEPTH: TOP OF ROOTBALL 2" ABOVE FINISH GRADE. PLANT NO DEEPER THAN GROWN IN NURSERY

BLEND INTO EXISTING SLOPE.

EXISTING SLOPE @ 2:1 MAXIMUM.

DO NOT TOUCH ROOTBALL WITH STAKES.

HOLE SIZE: THREE TIMES AS WIDE & 12" DEEPER THAN THE ROOTBALL ON BOTH SIDES.

TWO 4" ROUND BY 3' PERFORATED DRAIN PIPE WITH 3/4" DRAIN ROCK & GREEN PVC SLOT DRAIN GRATE IN LAWN AREA AND ROUGH AREAS.

SLOW RELEASE FERTILIZER TABLETS (4), TYP.

CENTER OF HOLE SHALL BE UNDISTURBED SOIL.

PREPARED BACKFILL MIX SHALL CONFORM TO SECTION 8-8

6'-0"

4'-0"

APPROVED BY:

Brian J. Fragia

BRIAN J. FRAGIA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

TREE PLANTING ON SLOPE

LSC-2

DEPARTMENT OF PUBLIC WORKS

GROUNDCOVER PLANTS FROM 1 GALLON
CAN, FLATS OR LINERS.

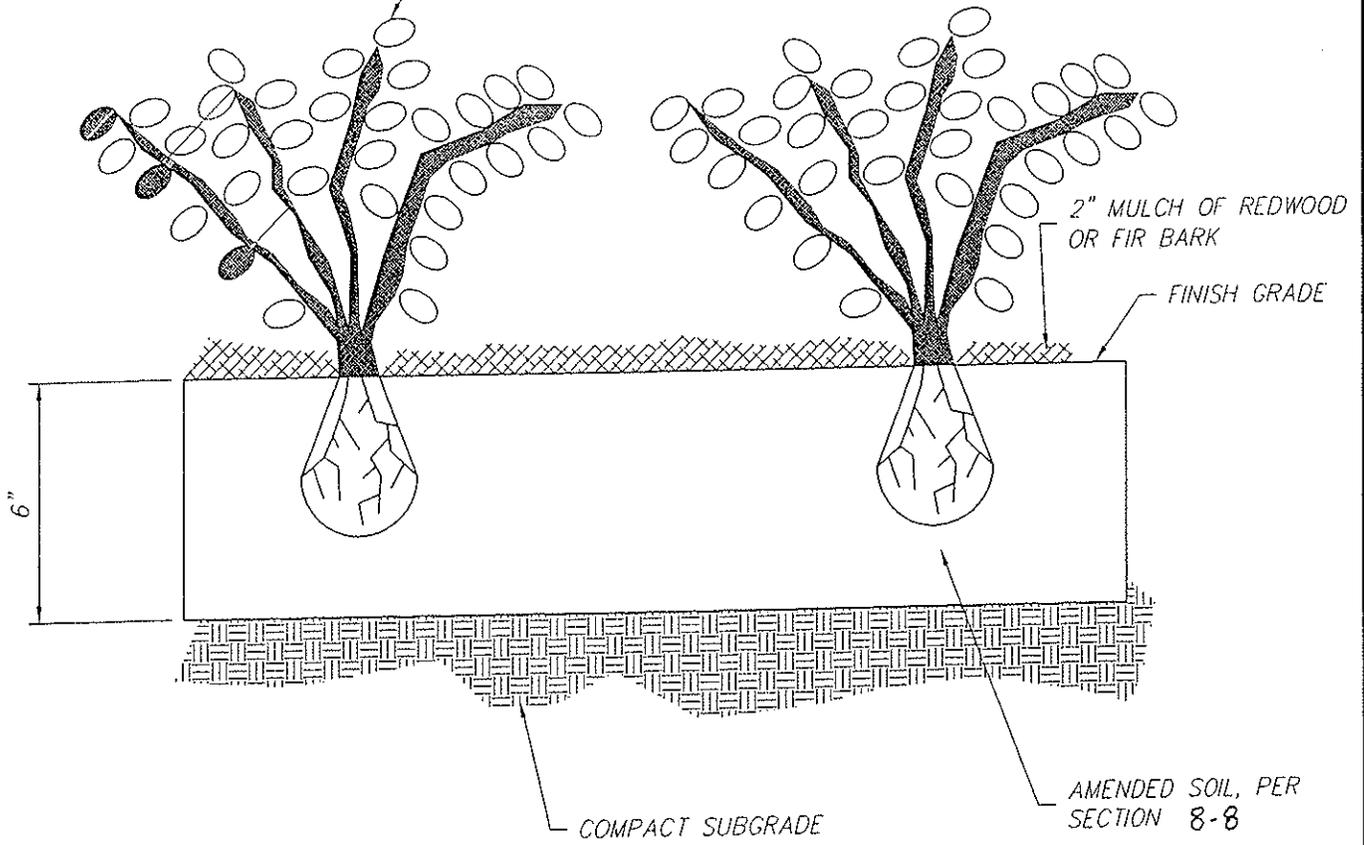

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

GROUNDCOVER PLANTING

DEPARTMENT OF PUBLIC WORKS

LSC-3

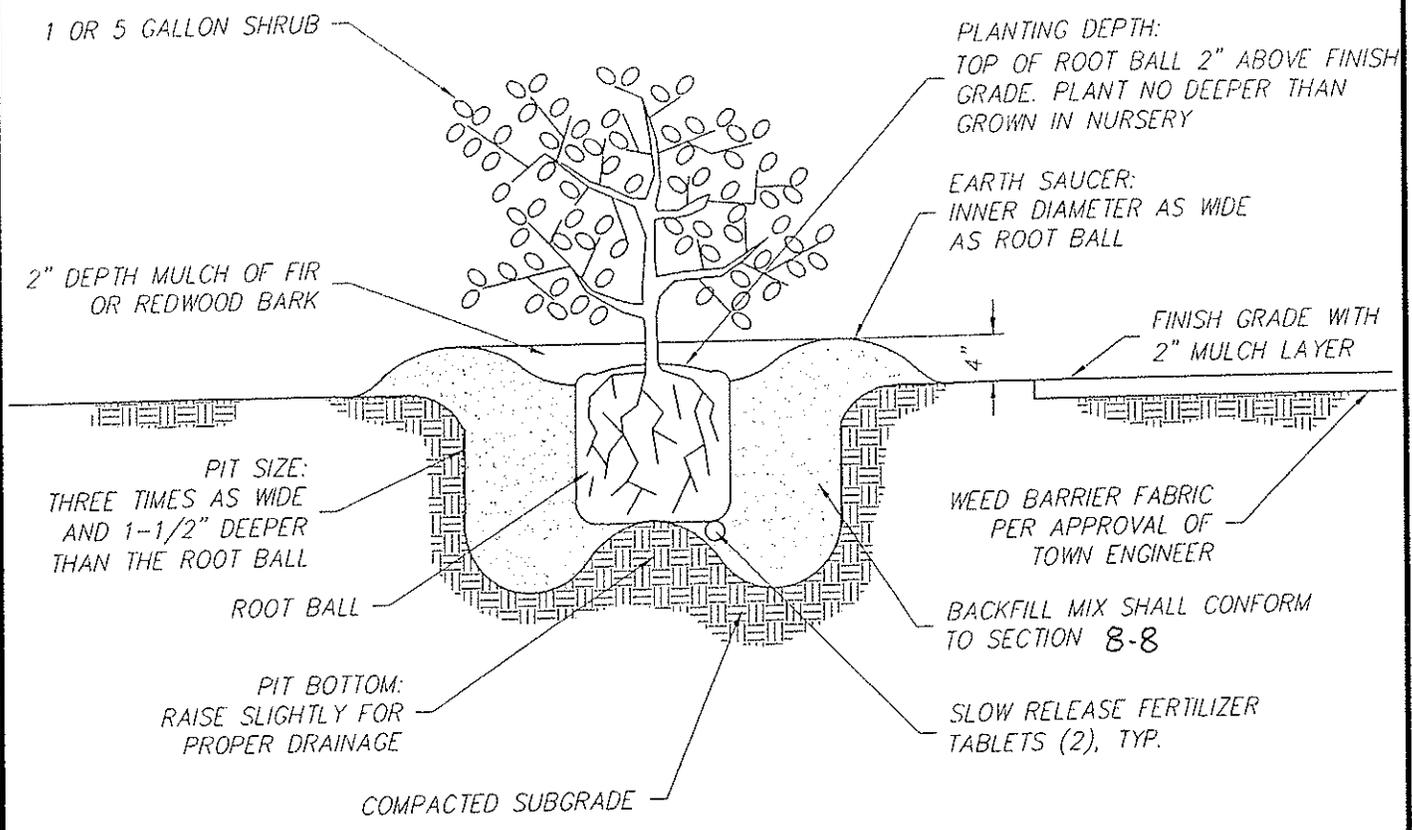

NOTES:

1. PROVIDE CITY WITH PLANTING MIXTURE SPECIFICATIONS
2. PLANTER AREA SHOULD HAVE PRE-EMERGENT HERBICIDE APPLIED BEFORE PLANTING TO PREVENT GERMINATION OF WEED SEEDS
3. WEED BARRIER FABRIC SHALL BE UTILIZED IN ALL PUBLIC MAINTAINED LANDSCAPE AREAS.


APPROVED BY:

 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 SHRUB PLANTING DETAIL
 DEPARTMENT OF PUBLIC WORKS

LSC-4

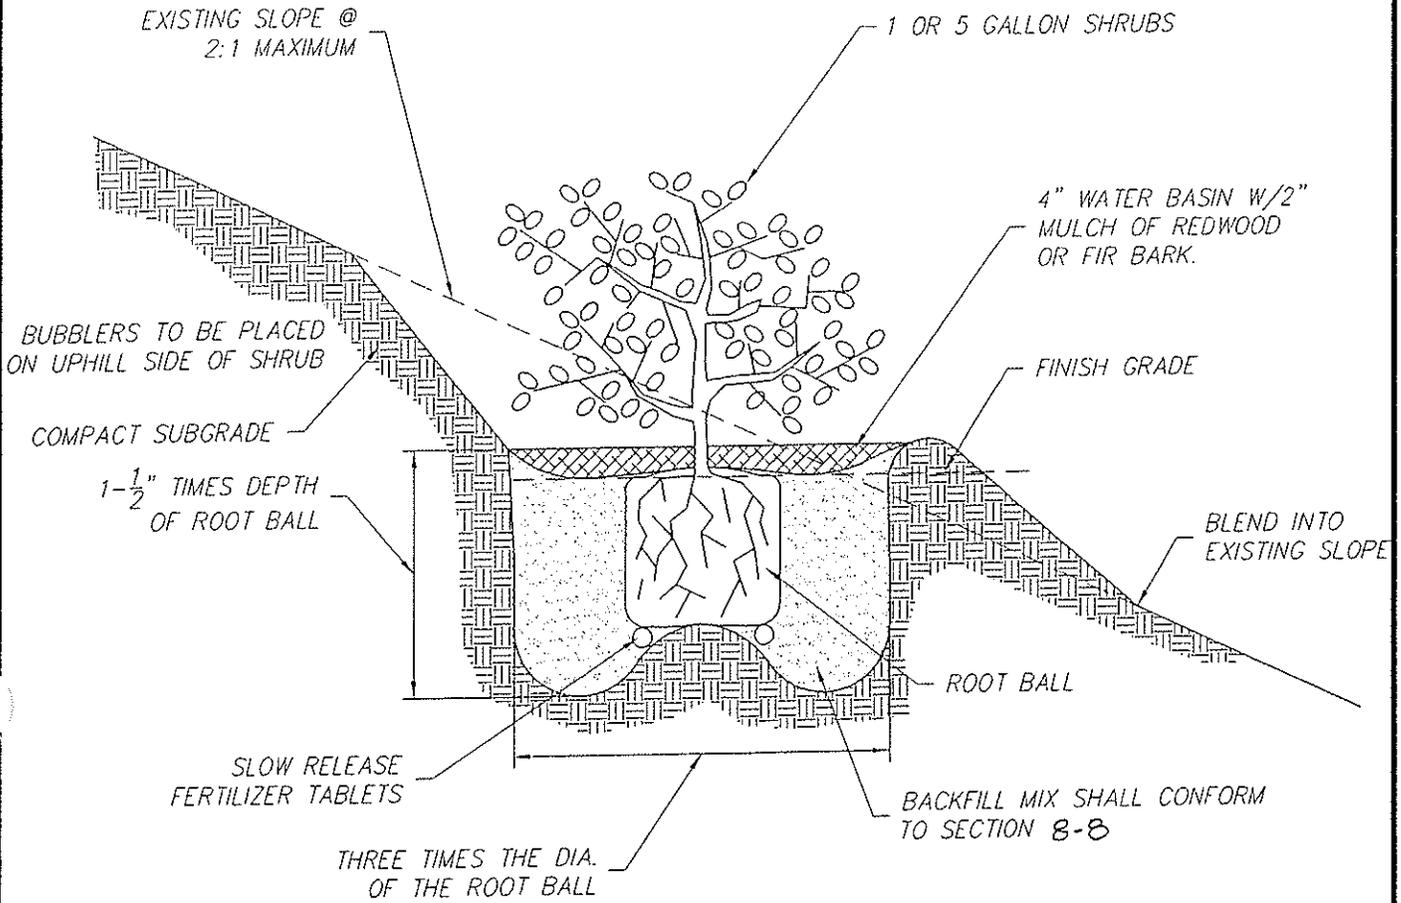

NOTE: PLANTER AREAS SHALL HAVE PRE-EMERGENT HERBICIDE APPLIED BEFORE PLANTING TO PREVENT GERMINATION OF WEED SEEDS

APPROVED BY:

Brian J. Fragiad

BRIAN J. FRAGIAD
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

SHRUB PLANTING ON SLOPE


DEPARTMENT OF PUBLIC WORKS

LSC-5

NON PRESSURE LATERAL

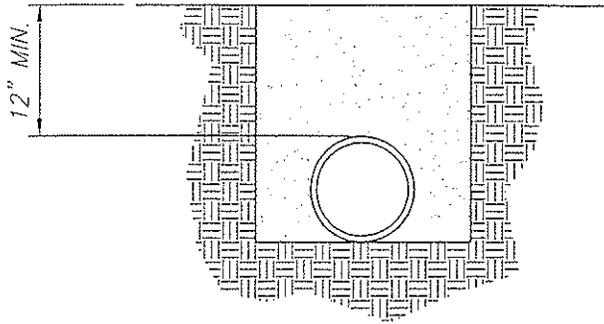

PRESSURE MAIN LINE

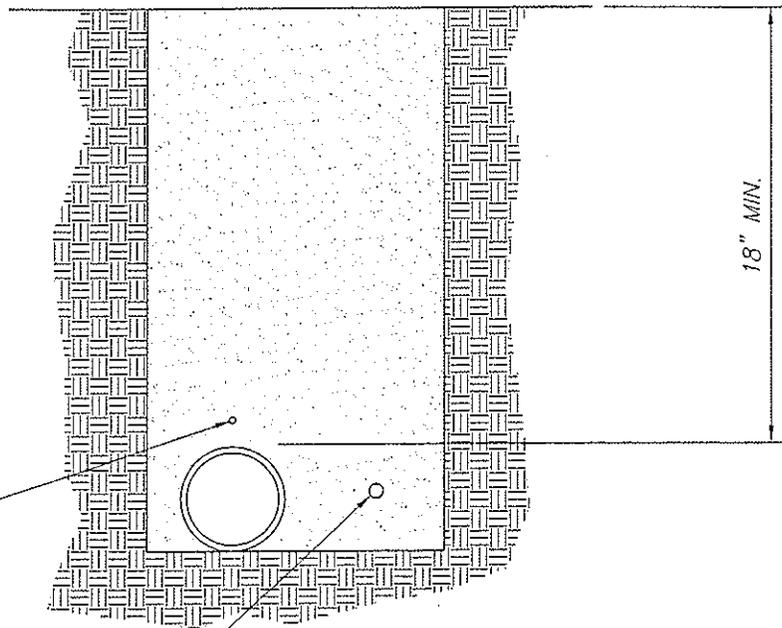


INSTALL #10 BARE COPPER TRACE WIRE IN MAINLINE TRENCH, LEAVE 8" LOOP EXPOSED IN EACH VALVE BOX. SOLDER ANY SPLICES IN TRACE WIRE.

CONTROL WIRE ADJACENT TO PRESSURE MAIN LINE. BUNDLE TAPE AT 10'-0" INTERVAL TO PIPE.

BUNDLE TAPE AT 4'-6" INTERVALS FOR MORE THAN ONE WIRE.

APPROVED BY:


BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

LANDSCAPE PIPE
TRENCHING DETAIL


DEPARTMENT OF PUBLIC WORKS

LSC-6

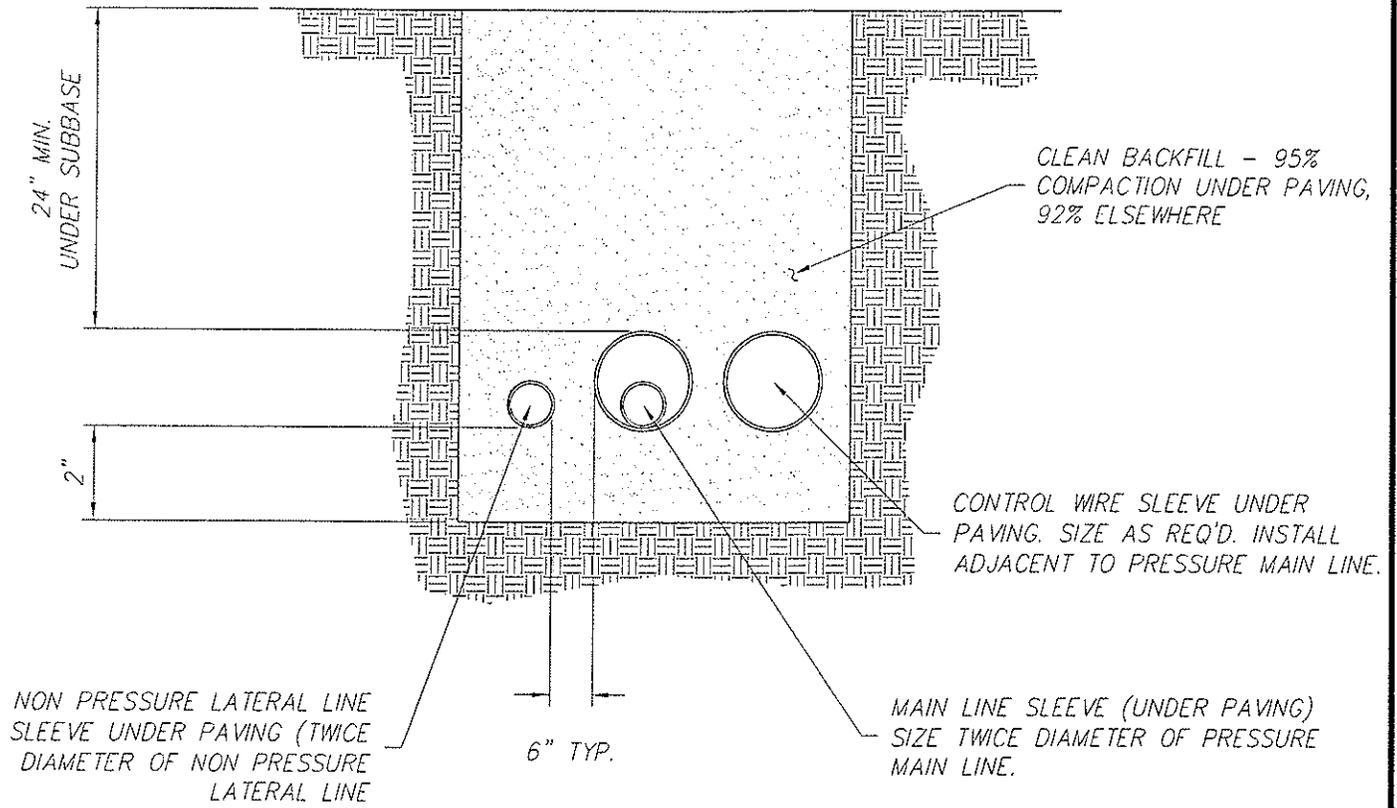

NOTES:


1. ALL SLEEVES TO BE SCH 40 PVC
2. EXTEND ALL SLEEVES 12" BEYOND EDGE OF HARDSCAPING AT BOTH ENDS, CAP ENDS AND FLAG LOCATIONS

APPROVED BY:

 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
**LANDSCAPE
 PIPE TRENCHING
 UNDER PAVEMENT**
 DEPARTMENT OF PUBLIC WORKS

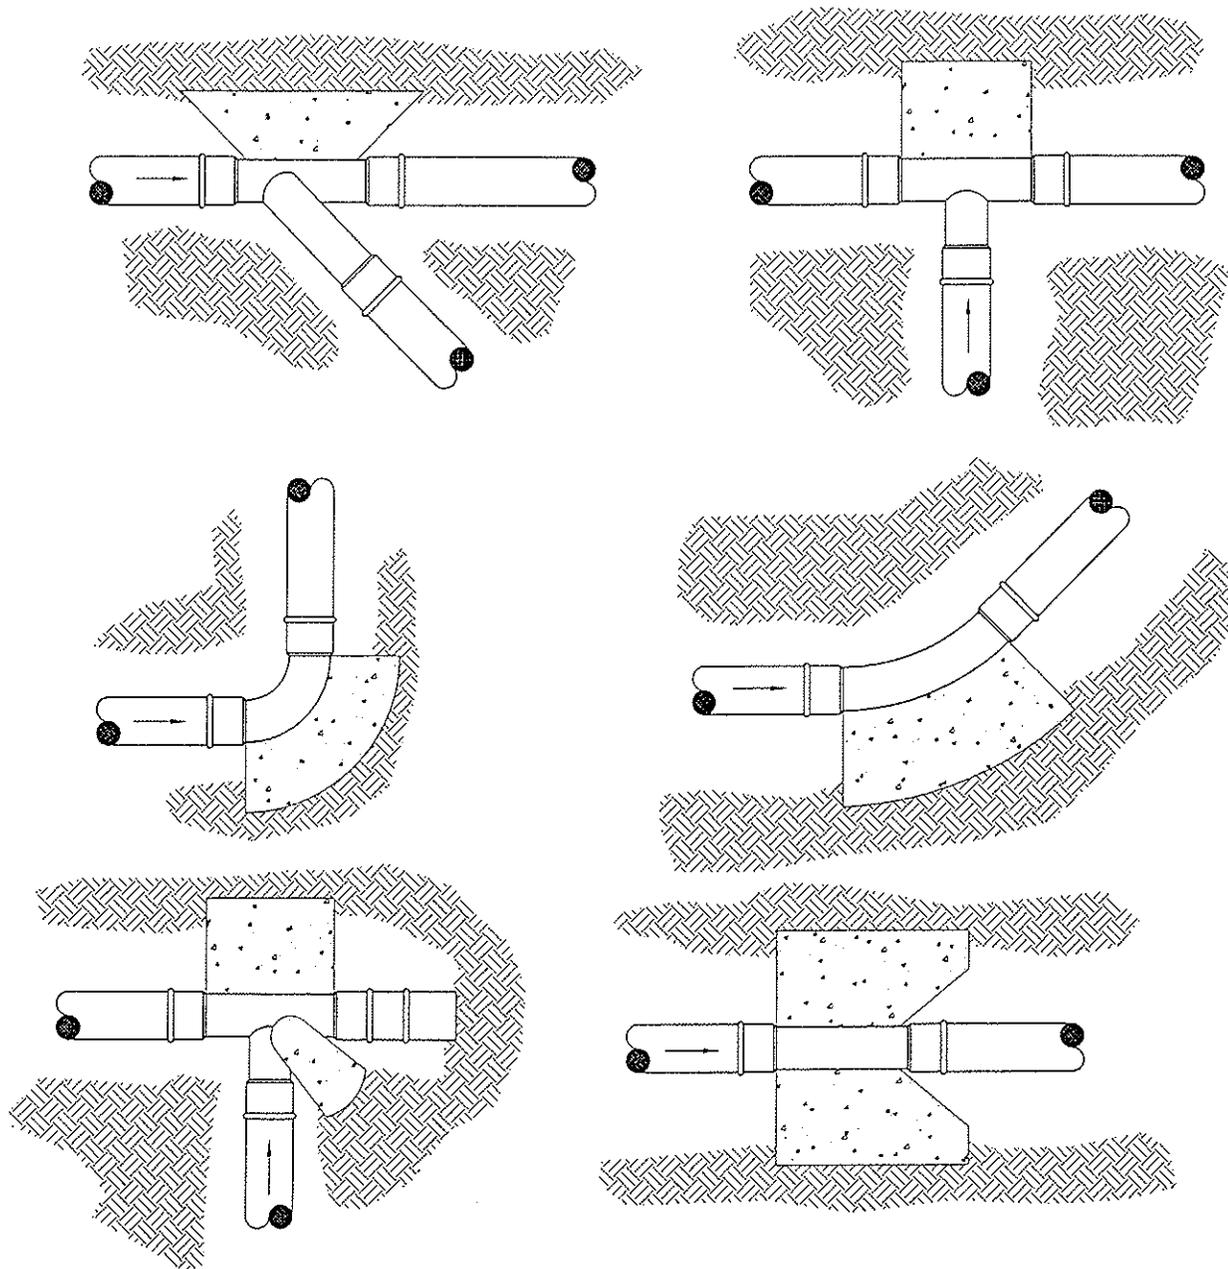LSC-7



NOTES:

1. DO NOT COVER JOINTS WITH CONCRETE.
2. SIZE THE THRUST BLOCKS AS SPECIFIED BY THE PIPE MANUFACTURER.
3. FOR 4" AND GREATER PIPE.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

IRRIGATION
 THRUST BLOCK DETAILS

LSC-8

DEPARTMENT OF PUBLIC WORKS

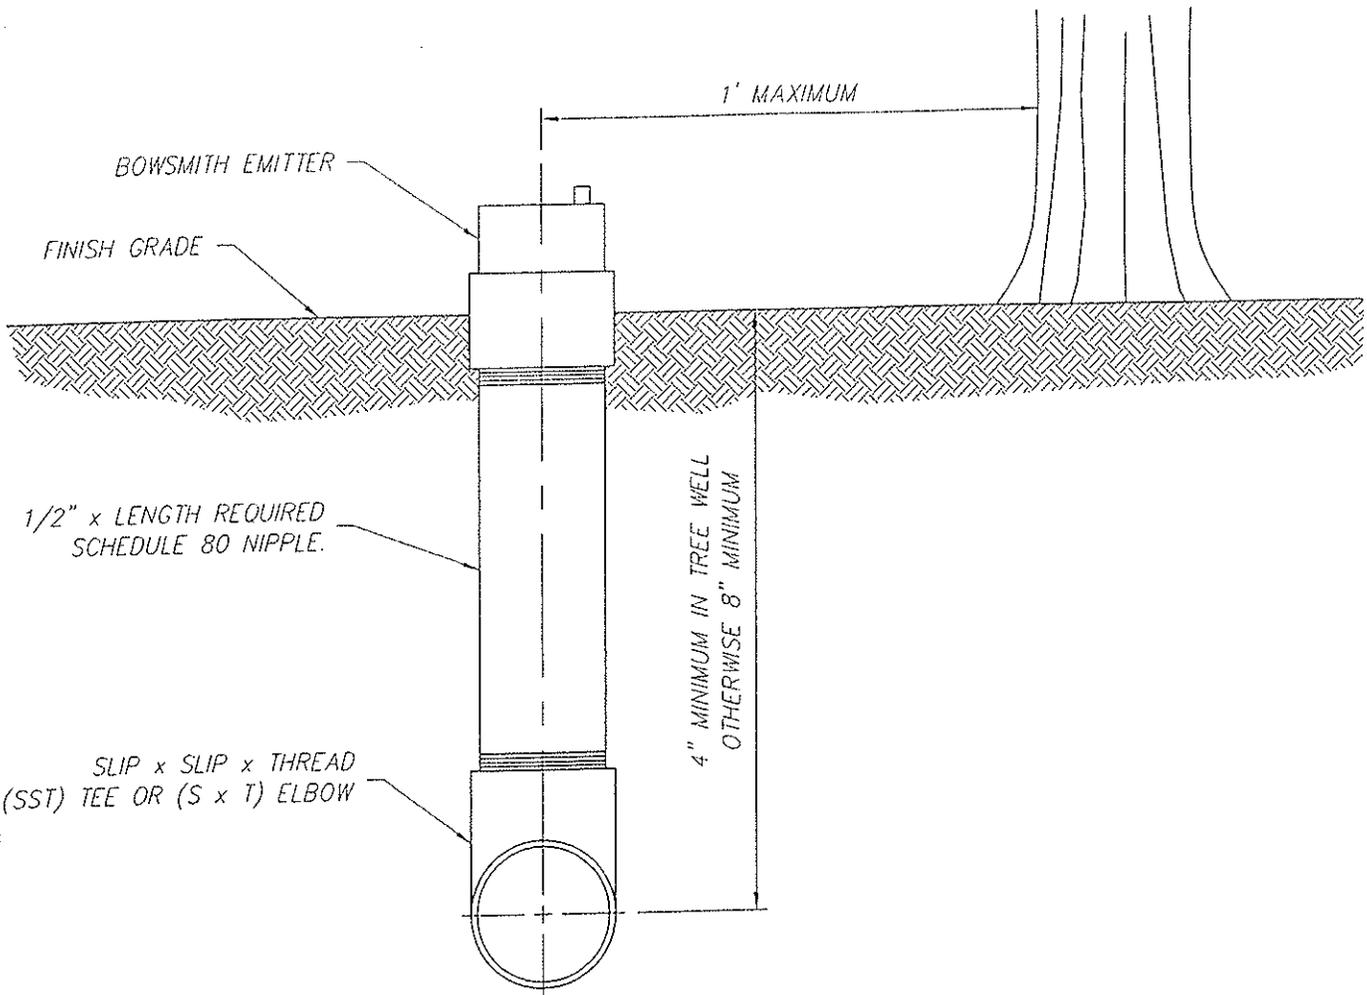

NOTES:

1. LOCATE EMITTER ON UP-HILL SIDE OF THE TREE OR SHRUB.
2. DO NOT TEE STRAIGHT UP OFF LATERAL. TEE HORIZONTAL THEN 90 DEGREES VERTICAL.

APPROVED BY:

Brian J. Fragiolo
 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

ABOVE GRADE EMITTER

DEPARTMENT OF PUBLIC WORKS

LSC-9

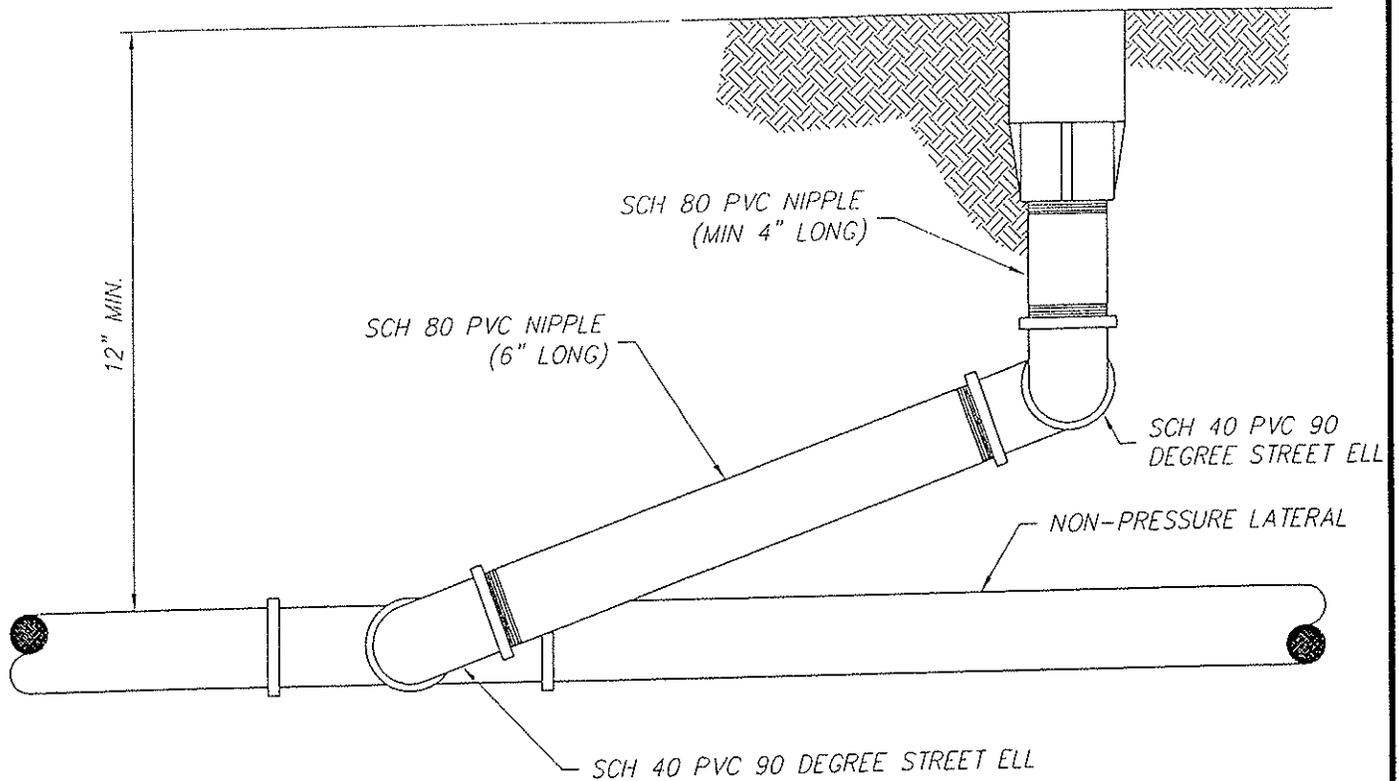

NOTES:

1. LOCATE HEAD 2" FROM WALKS, CURBS, HARDSCAPING, MOW STRIPS, AND HEADER BOARDS.
2. LOCATE STREAM SPRAY/BUBBLIERS 6" FROM ALL STRUCTURES, AND SPRAY HEADS 12" FROM ALL STRUCTURES, BUT 6" FROM ALL STRUCTURES IN GROUND COVER AREAS.
3. USE TEFLON TAPE ON ALL THREADED FITTINGS EXCEPT BETWEEN MARLEX FITTINGS.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

POP-UP SPRAY HEAD

DEPARTMENT OF PUBLIC WORKS

LSC-10

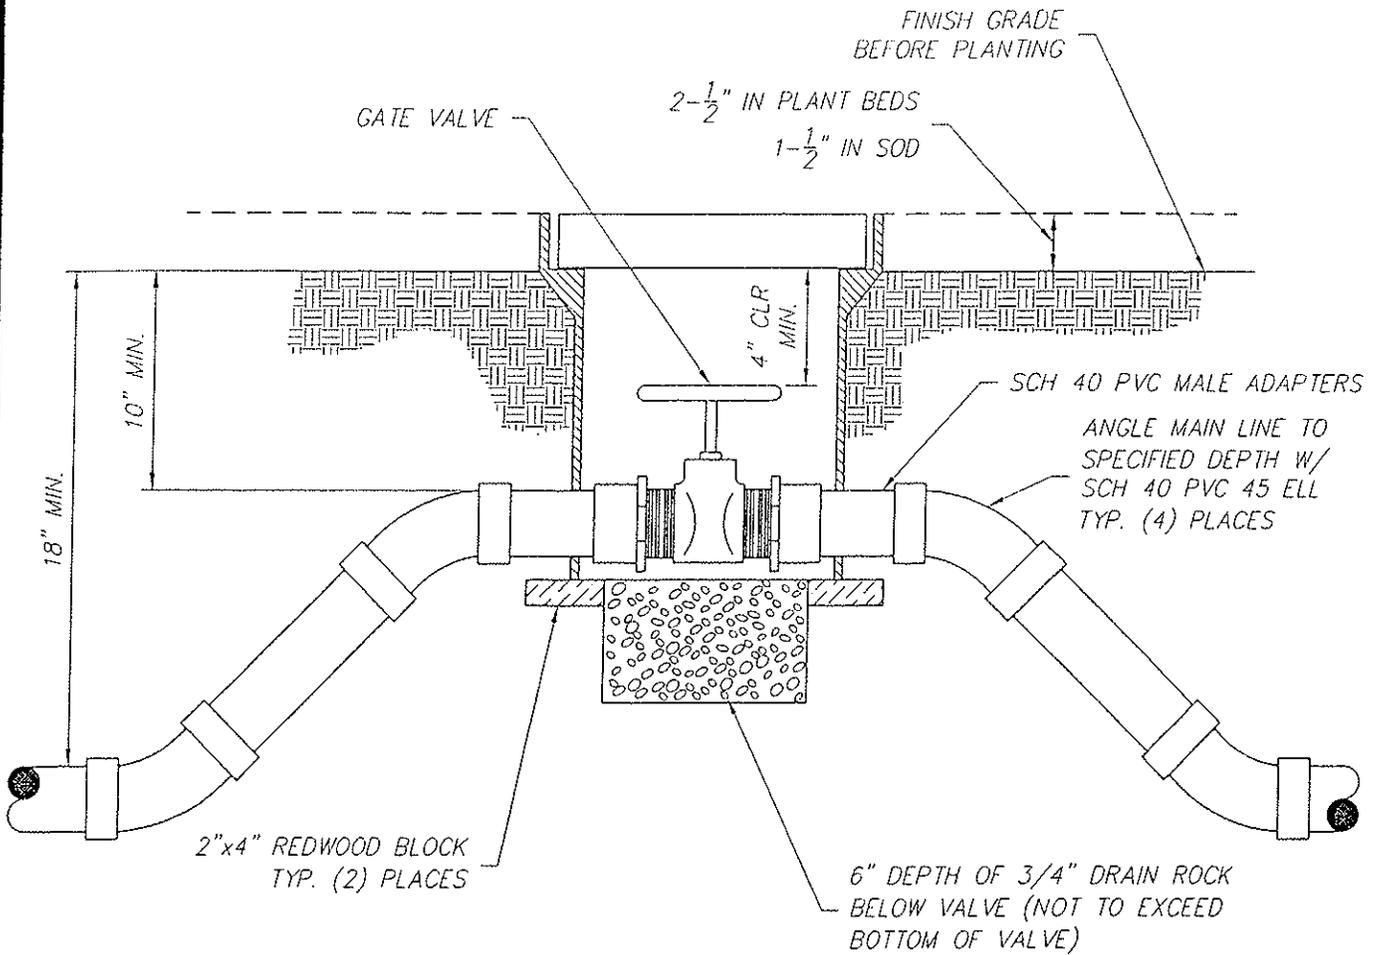

NOTES:

1. PLACE 3/4" DIA. ROCK PRIOR TO INSTALLATION OF VALVE BOX.
2. GATE VALVE AND FITTINGS SHALL BE LINE SIZE UNLESS NOTED OTHERWISE.
3. USE TEFLON TAPE ON ALL THREADED FITTINGS.

APPROVED BY:

Brian J. Fragia
 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

GATE VALE - 3" & SMALLER

DEPARTMENT OF PUBLIC WORKS

LSC-11

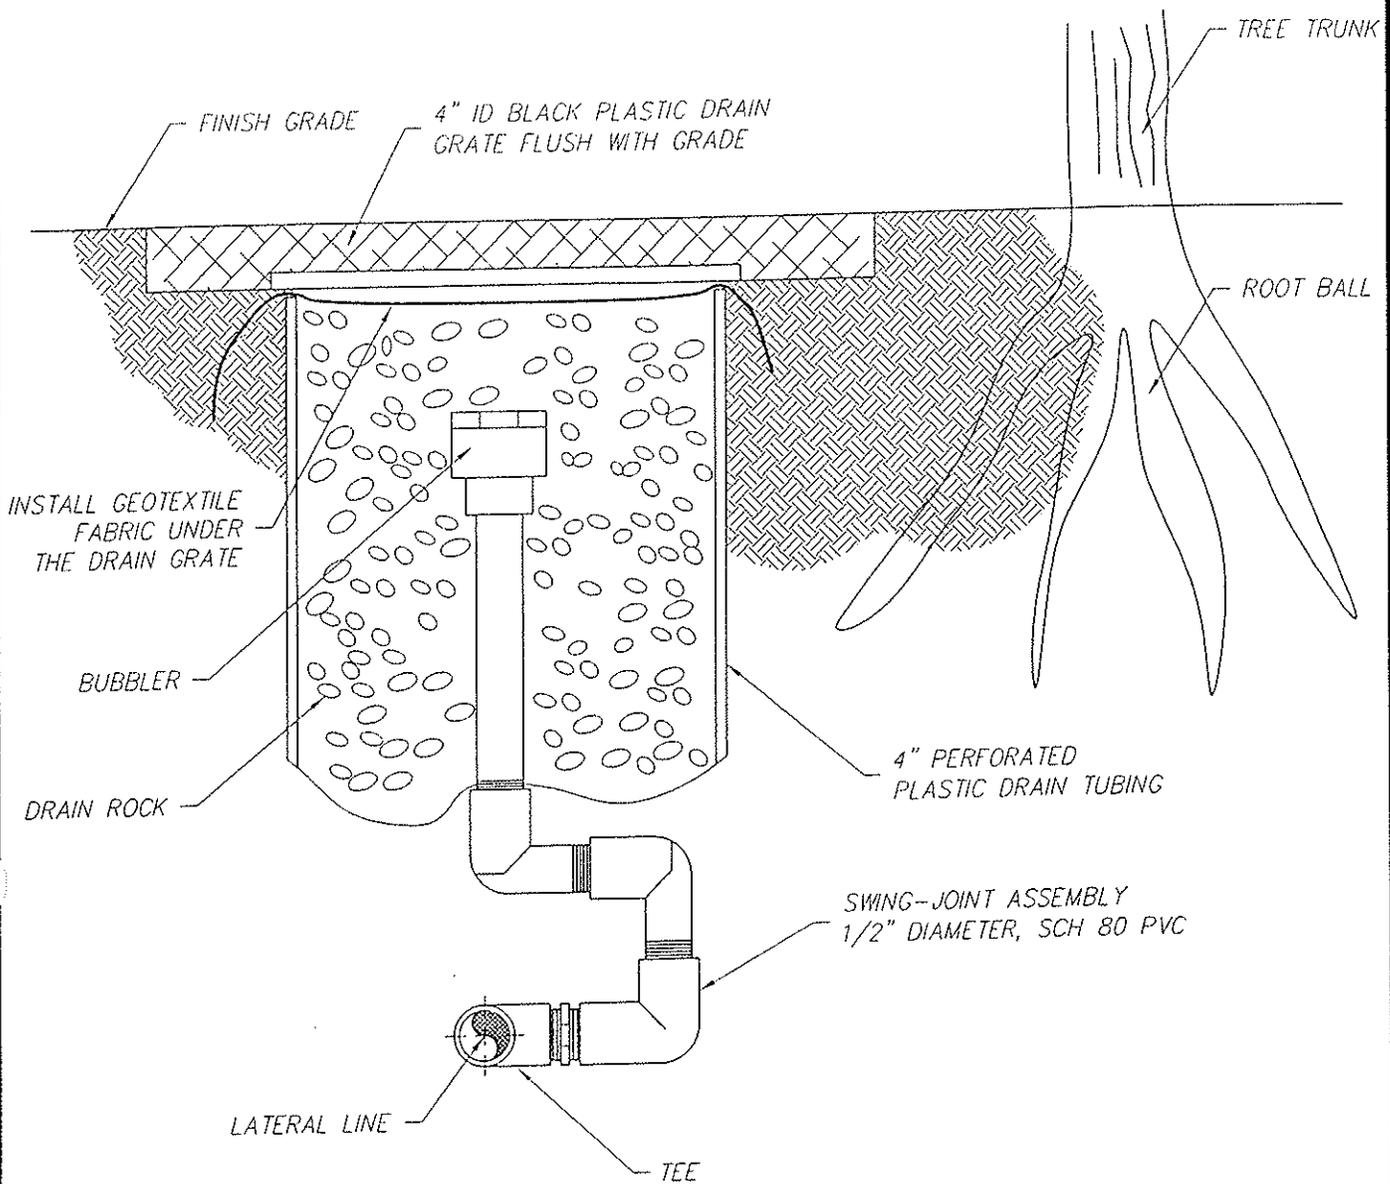

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

TREE BUBBLER


LSC-13

DEPARTMENT OF PUBLIC WORKS

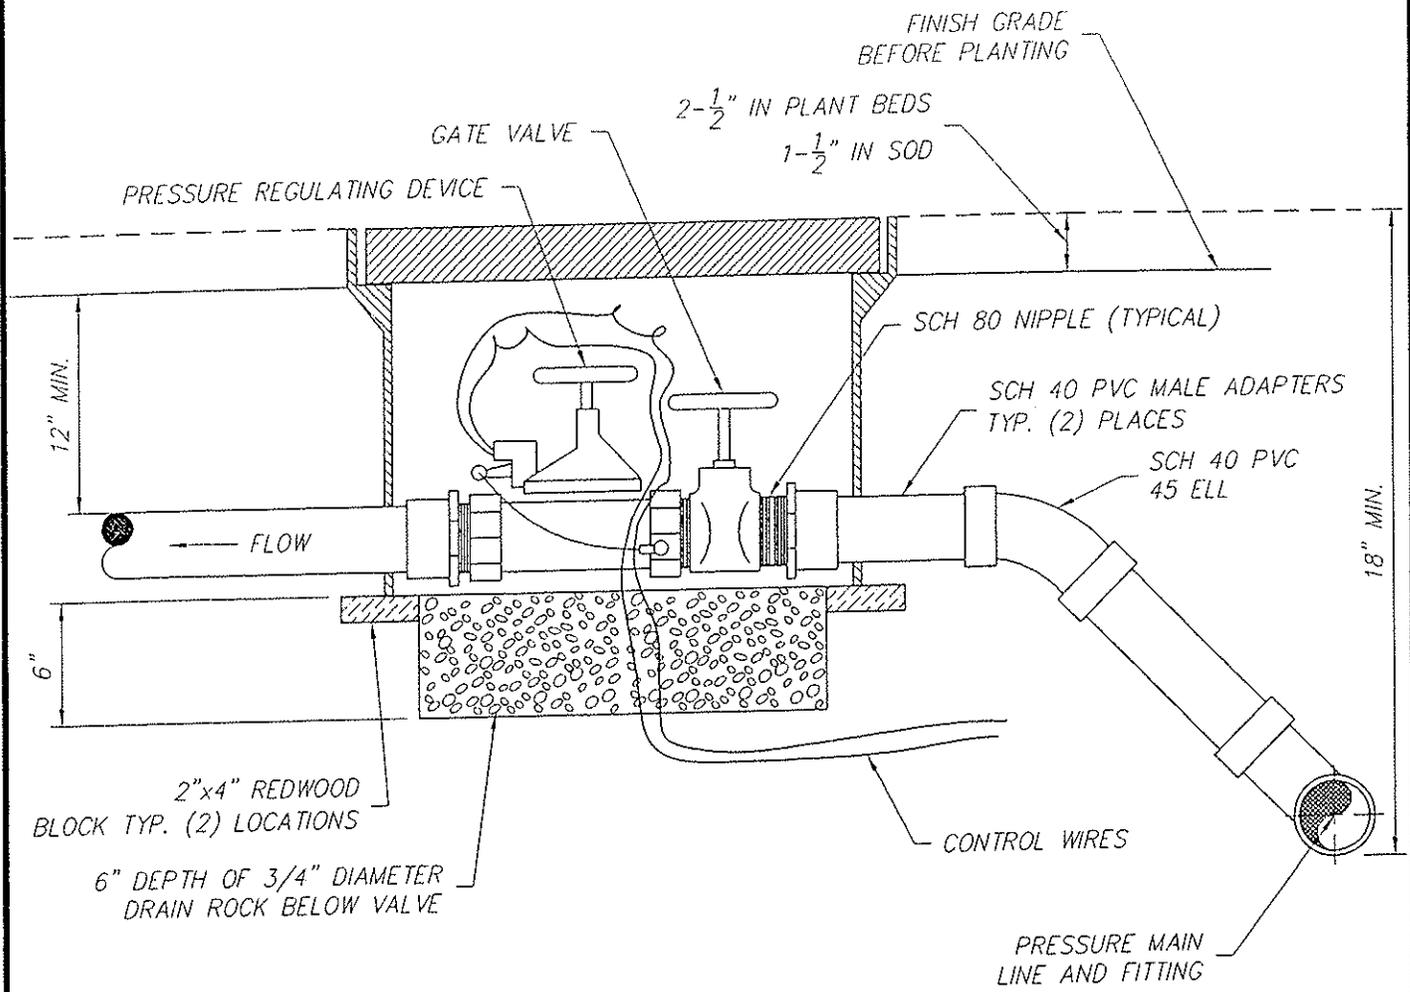

NOTES:


1. INSTALL CONTROL VALVES A MINIMUM OF 12" FROM STRUCTURES OR HARDSCAPING.
2. INSTALL VALVES IN PLANT BEDS WHEREVER POSSIBLE.
3. PLACE VALVE BOX AT RIGHT ANGLES TO STRUCTURES OR HARDSCAPING.
4. INSTALL VALVE BOX SO THAT TOP OF BOX IS FLUSH WITH ADJACENT HARDSCAPING.
5. USE TEFLON TAPE ON ALL MALE THREADS.

APPROVED BY:

 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
 ELECTRIC CONTROL VALVE
 AND GATE VALVE
 DEPARTMENT OF PUBLIC WORKS

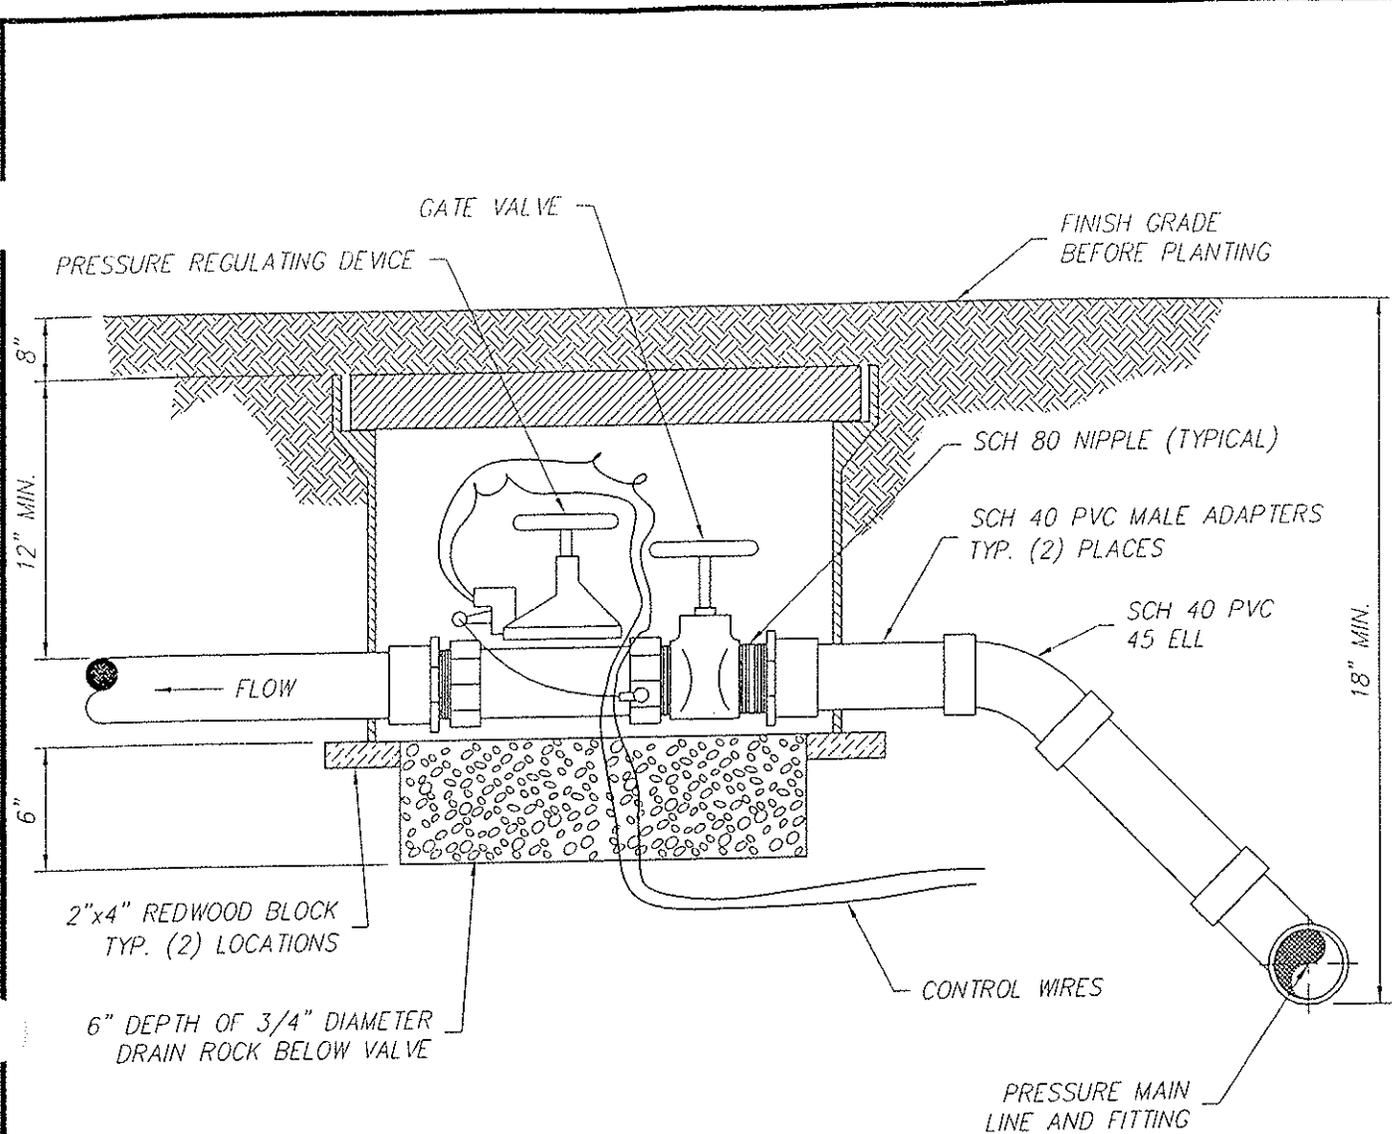LSC-14



NOTES:


1. INSTALL CONTROL VALVES A MINIMUM OF 12" FROM STRUCTURES OR HARDSCAPING.
2. INSTALL VALVES IN PLANT BEDS WHEREVER POSSIBLE.
3. PLACE VALVE BOX AT RIGHT ANGLES TO STRUCTURES OR HARDSCAPING.
4. INSTALL VALVE BOX SO THAT TOP OF BOX IS FLUSH WITH ADJACENT HARDSCAPING.
5. USE TEFLON TAPE ON ALL MALE THREADS.

APPROVED BY:

 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
 BELOW GRADE ELECTRIC
 CONTROL AND GATE VALVE
 DEPARTMENT OF PUBLIC WORKS

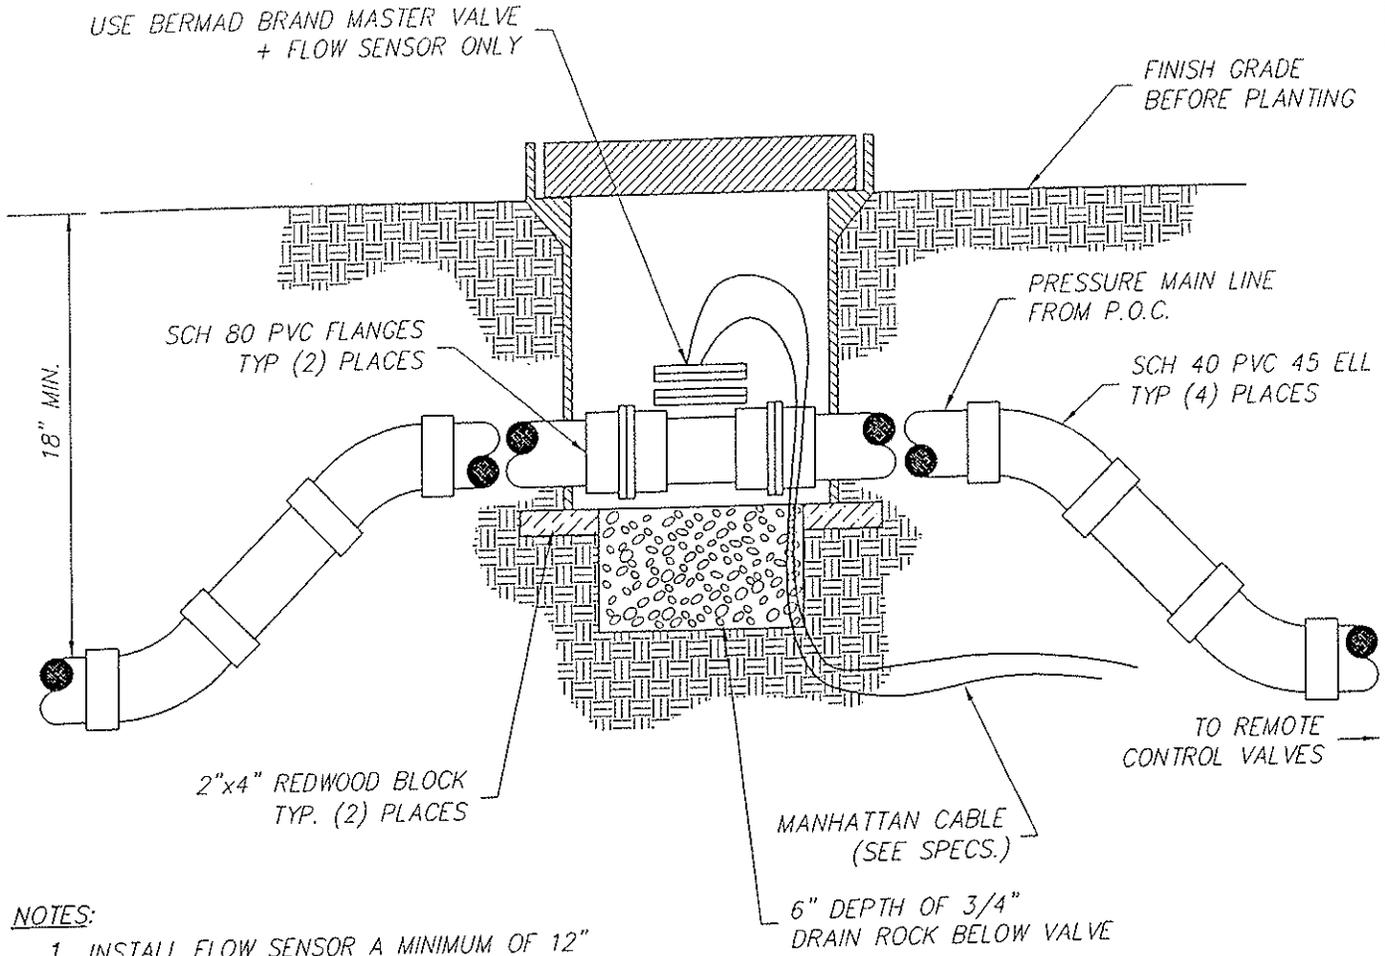LSC-15



NOTES:


1. INSTALL FLOW SENSOR A MINIMUM OF 12" FROM STRUCTURES OR HARDSCAPING
2. INSTALL FLOW SENSOR IN PLANT BEDS WHEREVER POSSIBLE
3. PLACE VALVE BOX AT RIGHT ANGLE TO STRUCTURES OR HARDSCAPING
4. SENSOR CABLE SHALL BE BROUGHT BACK TO CONTROLLER IN 1" GRAY SCH 40 PVC CONDUIT

APPROVED BY:

 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
FLOW SENSOR DETAIL
 DEPARTMENT OF PUBLIC WORKS

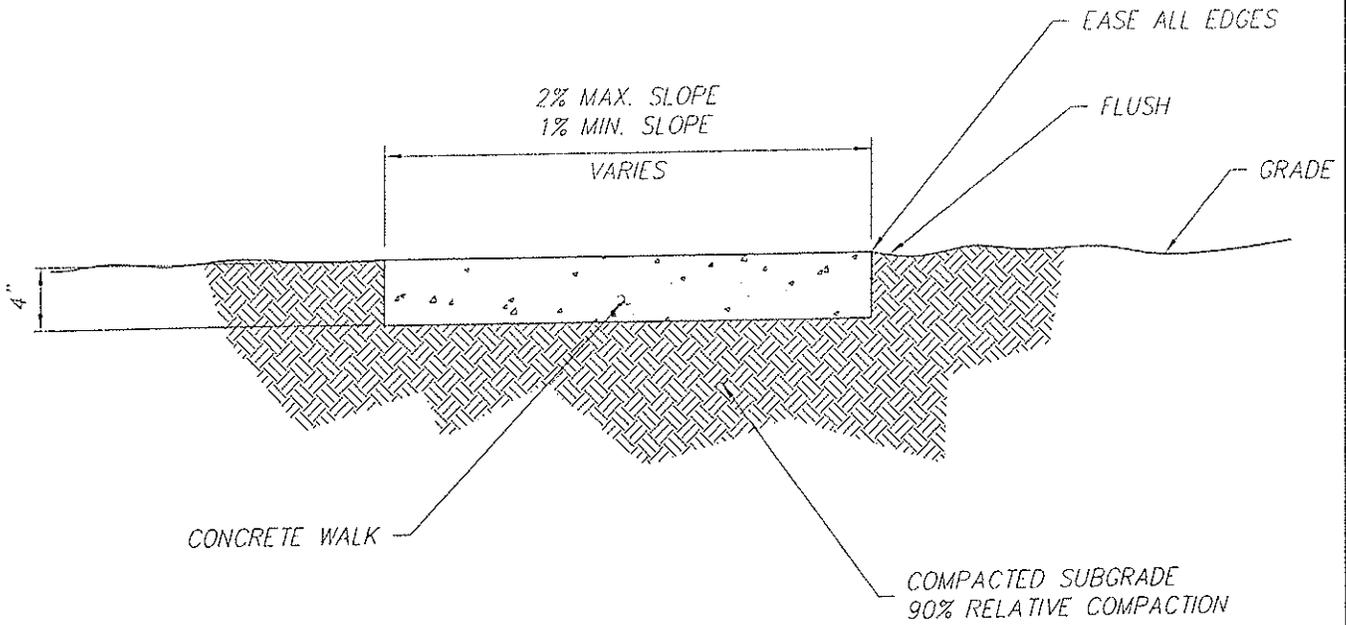LSC-16



NOTES:

1. PROVIDE WEAKENED PLANE JOINTS 1" DEEP AT 10'-0" INTERVALS.
2. PROVIDE EXPANSION JOINT AT 20'-0" INTERVALS WHERE CONCRETE WALK JOINS ANOTHER.
3. CLASS "A" SIX SACK CONCRETE.
4. BROOM FINISHED UNLESS SPECIFIED OTHERWISE.

APPROVED BY:

Brian J. Fragio
BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

CONCRETE WALK

DEPARTMENT OF PUBLIC WORKS

LSC-17

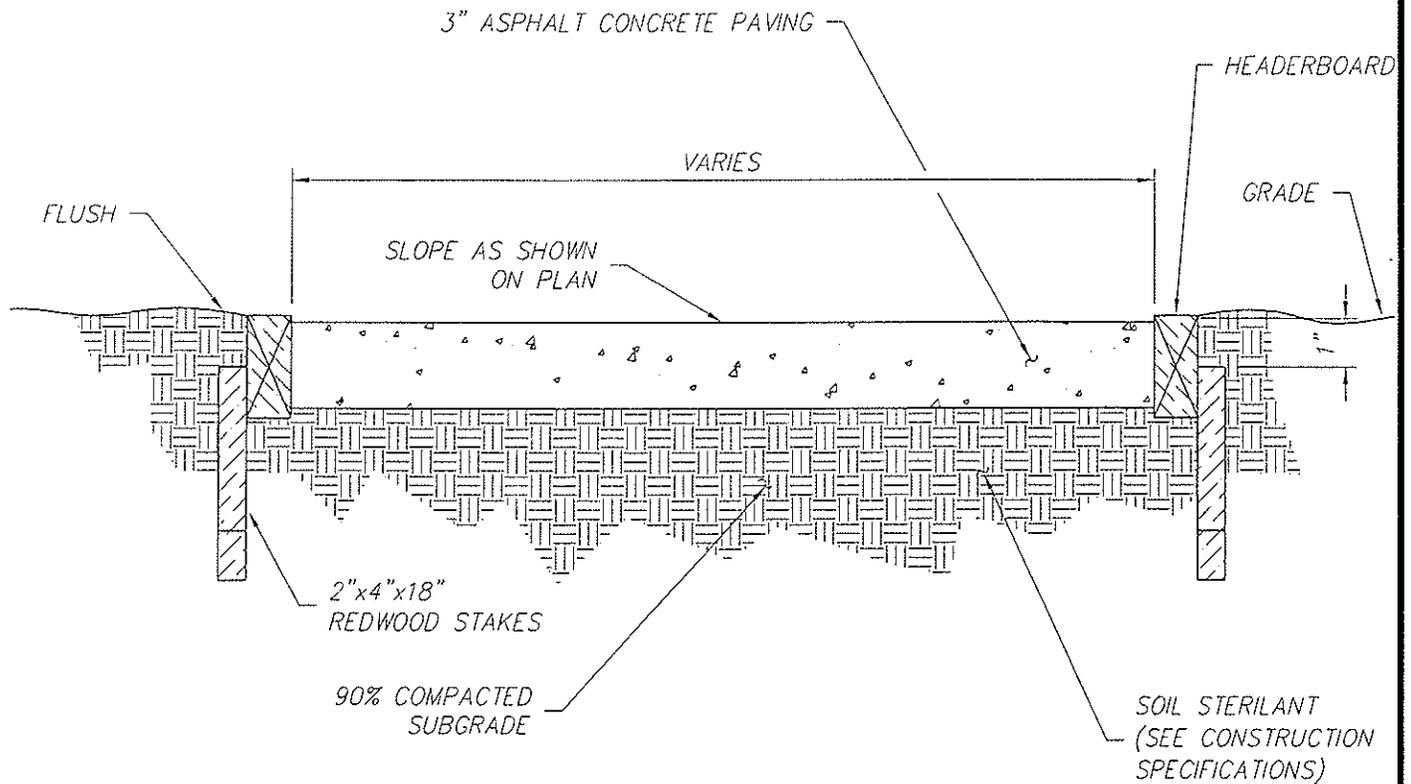

HEADER BOARD SHALL BE:

1. REDWOOD, ROUGH, CONSTRUCTION HEART GRADE, IN ACCORDANCE TO CALIFORNIA REDWOOD ASSOCIATION GRADING RULES.
2. DOUGLAS FIR, ROUGH, CONSTRUCTION GRADE, PRESSURE TREATED FOR UNDERGROUND USE.
3. ALL NAILS SHALL BE GALVANIZED - 16 PENNY.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO,
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS
 PEDESTRIAN
 ASPHALTIC CONCRETE WALK

DEPARTMENT OF PUBLIC WORKS

LSC-18

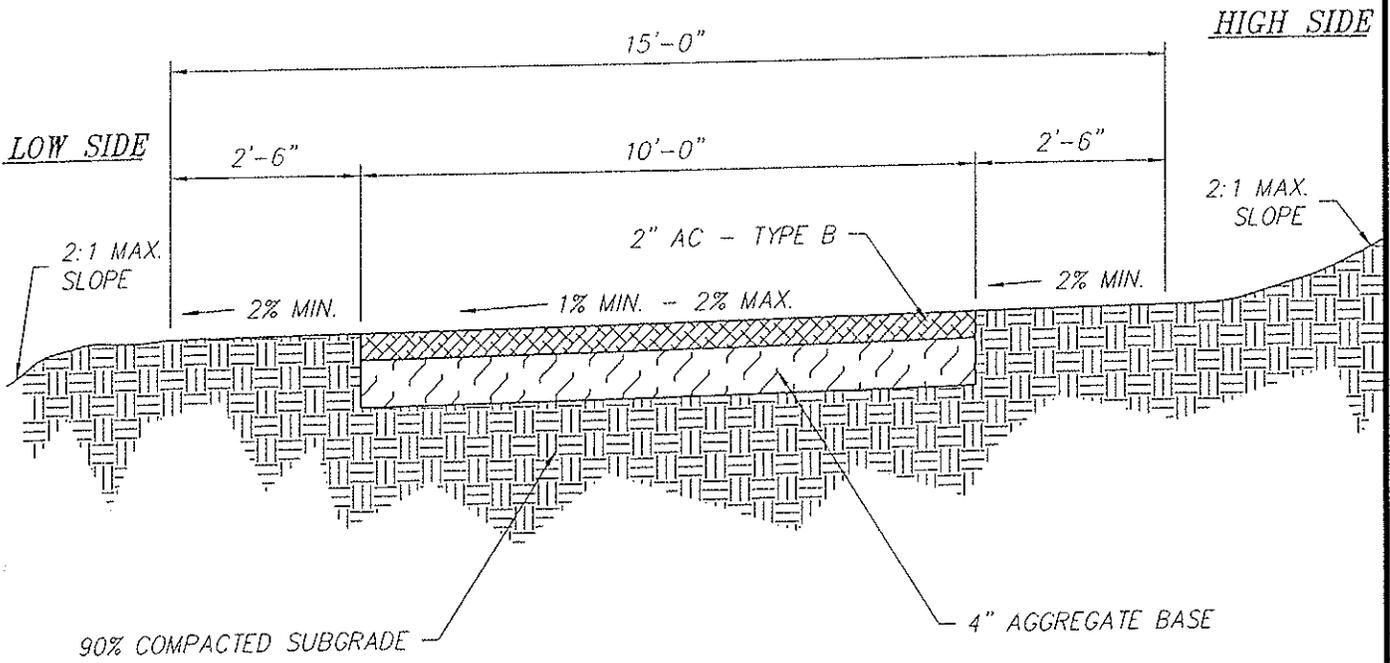

APPROVED BY:

Brian J. Fragia

BRIAN J. FRAGIA
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

A.C. BIKE PATH

DEPARTMENT OF PUBLIC WORKS

LSC-19

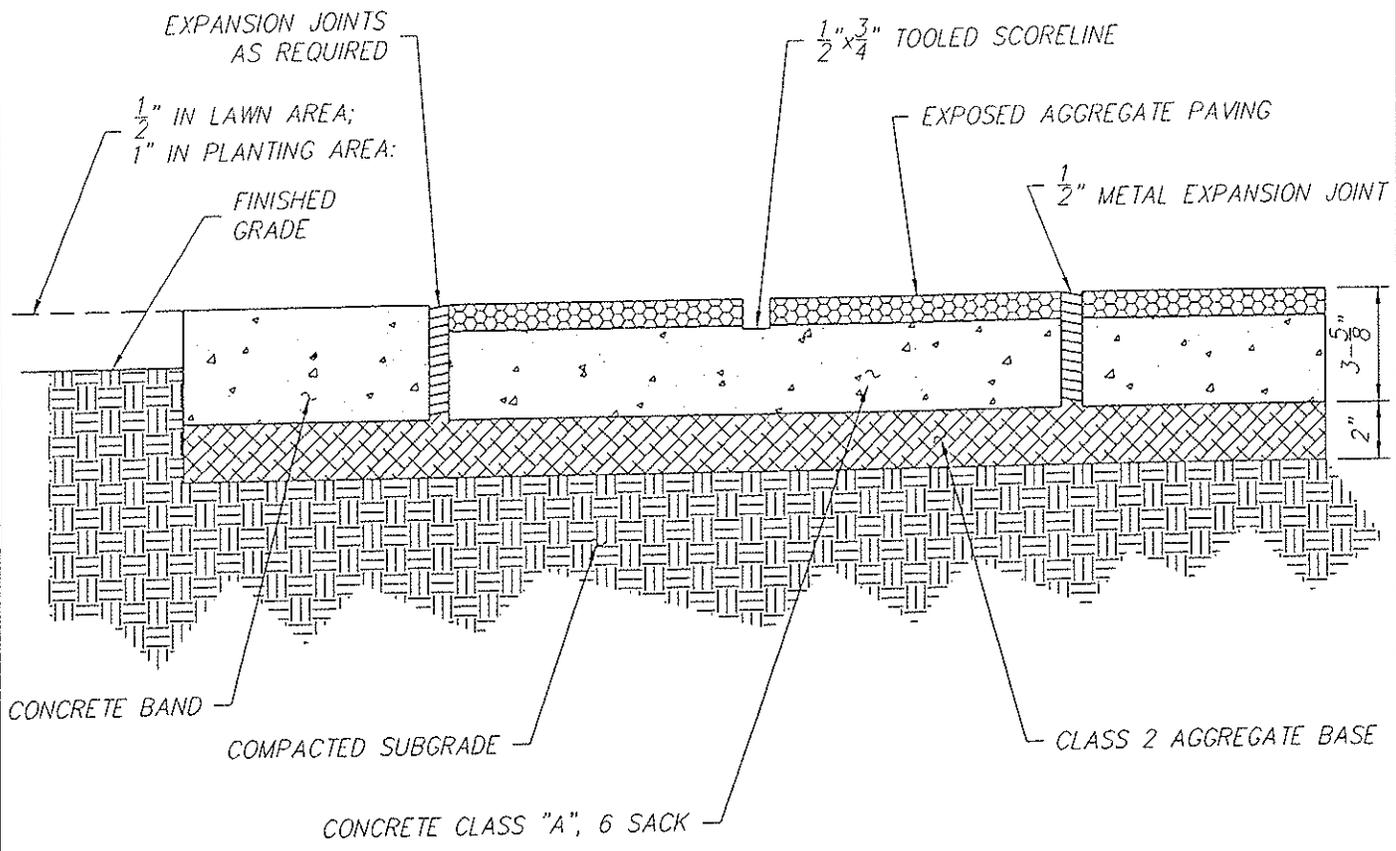

NOTES:

1. REFER TO APPROVED IMPROVEMENT PLANS FOR AGGREGATE SPECS.
2. REFER TO LAYOUT AND CONSTRUCTION PLANS AND APPROPRIATE DETAILS FOR LOCATION OF EXPANSION JOINTS AND SCORELINES.

APPROVED BY:

Brian J. Fragiad
 BRIAN J. FRAGIAD
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER


REVISED:



TOWN OF LOOMIS

EXPOSED AGGREGATE PAVING LSC-20

DEPARTMENT OF PUBLIC WORKS

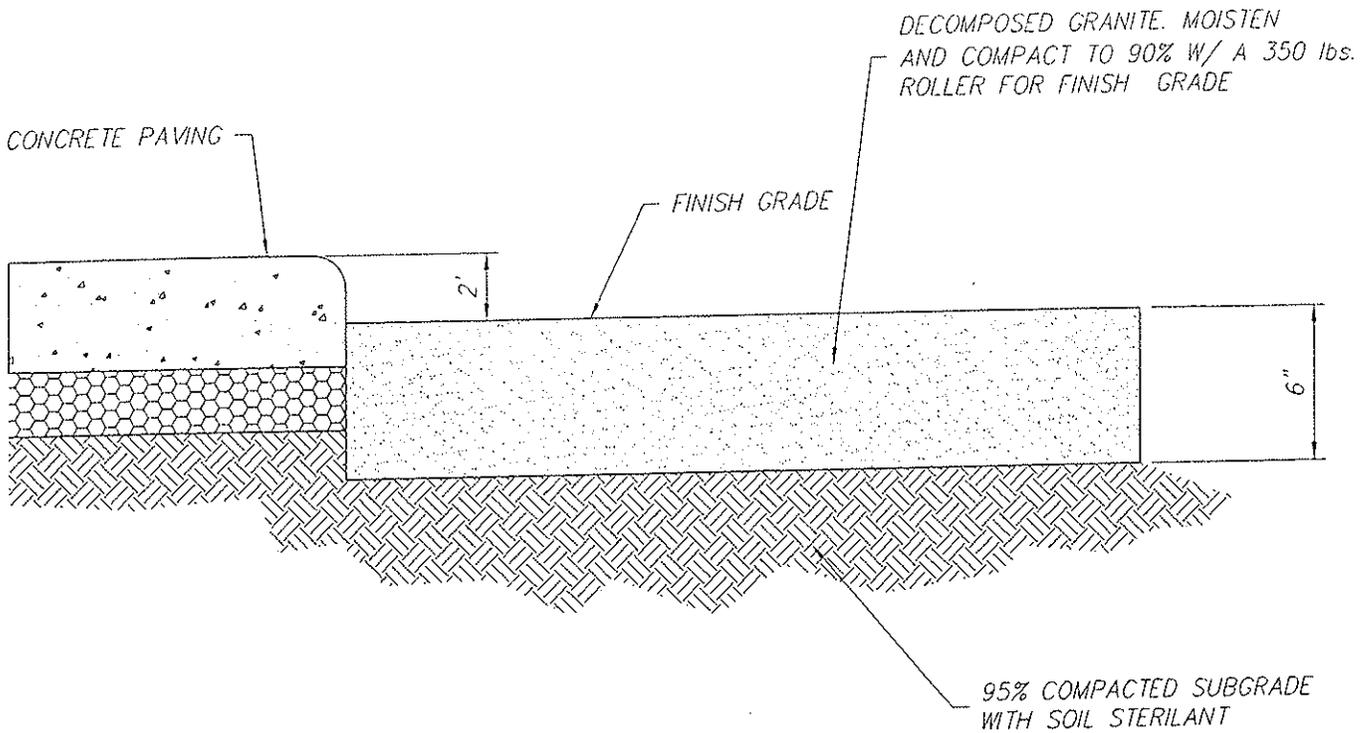

'SECTION'

CONTRACTOR TO SUBMIT SAMPLE OF LIGHT TAN DECOMPOSED GRANITE FOR APPROVAL BY LANDSCAPE ARCHITECT.

APPROVED BY:

Brian J. Fraciao

BRIAN J. FRACIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:





TOWN OF LOOMIS

DECOMPOSED GRANITE



DEPARTMENT OF PUBLIC WORKS

LSC-21

PLAN

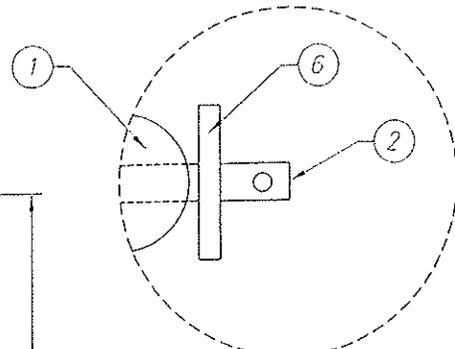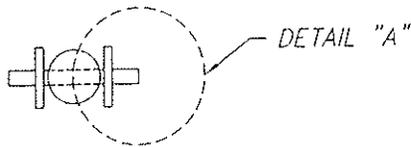

DETAIL "A"

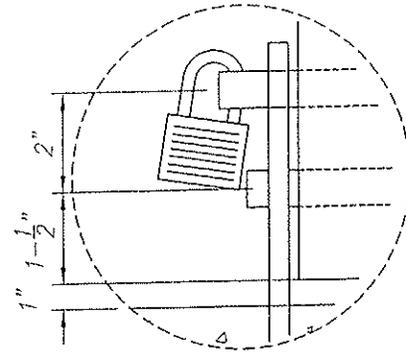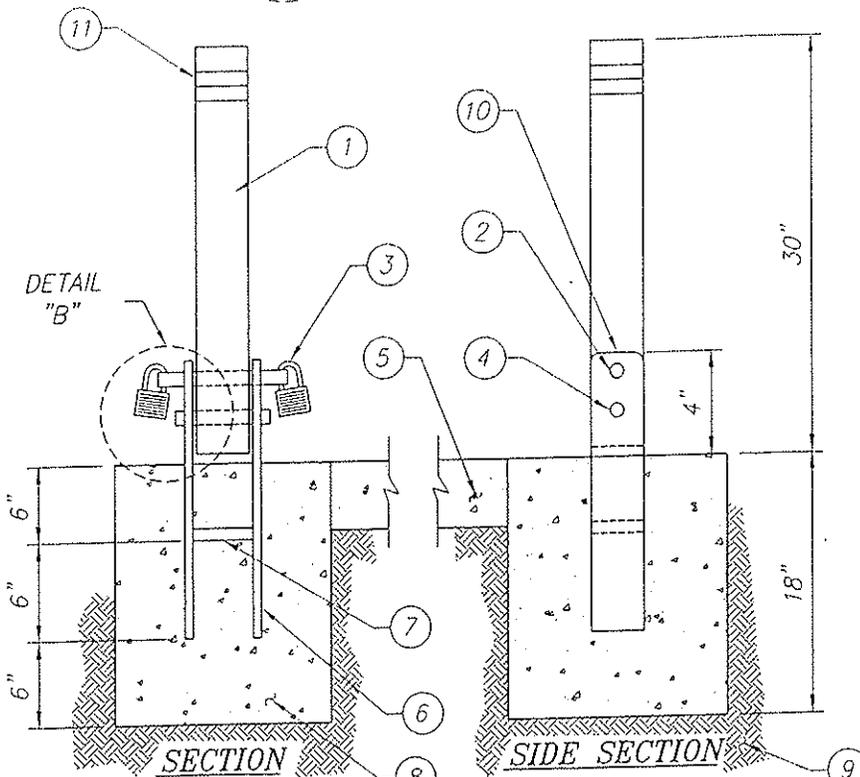

DETAIL "B"


LEGEND:

1. 11 GAUGE, 2 3/4" O.D. ROUND STEEL POST WITH CAPPED TOP & 3/4" HOLES FOR SWIVEL ROD AND 3/4" HOLES FOR LOCKING PIN. EASE ALL EDGES OF STEEL POST.
2. 3/8" DIA x 6" LOCKING PIN WITH 3/8" HOLES 1/4" FROM EACH END OF PIN OR 3/8" DIA x 5" LOCKING PIN WITH WITH FLAT WASHER ON ONE END AND 3/8" HOLE 1/4" FROM END OF PIN.
3. PADLOCKS TO BE PROVIDED BY CONTRACTOR
4. 5/8" DIA STEEL SWIVEL ROD. WELD SWIVEL ROD TO SIDE PLATES - NO WASHERS.
5. CONCRETE PAVING / ASPHALT. HOLD CONCRETE 2" BELOW FINISHED GRADE. BLACK TOP REST.
6. 3/8" x 16" x 4" STEEL BASE PLATE WITH 1" RADIUS CORNERS. EASE ALL EDGES.
7. 3/8" STEEL BRACE. FILET WELD BOTH SIDES TO BASE PLATES.
8. 2" ROUND CONCRETE x 18" DEEP FOOTING.
9. COMPACTED SUBGRADE.
10. 1" RADIUS CORNERS, TYP.
11. 1" RED DIAMOND REFLECTIVE TAPE.

NOTES:

1. ALL PIPE SHALL BE BLACK STEEL PIPE.
2. ALL JOINTS SHALL BE WELDED IN ACCORDANCE W/ CA STATE STANDARD SPECIFICATIONS FOR WELDING STRUCTURAL STEEL.
3. ALL PARTS (EXCEPT PADLOCK) SHALL BE PAINTED W/ 2 COATS OF ZINC CHROMATE PRIMER AND 2 COATS OF EXTERIOR ENAMEL. COLOR: YELLOW PER CITY STANDARD.
4. BOLLARD SHALL BE INSTALLED SUCH THAT WHEN FOLDED IT LAYS FLAT.

APPROVED BY:



BRIAN J. FRAGIO,
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

COLLAPSIBLE BOLLARD


LSC-22

DEPARTMENT OF PUBLIC WORKS

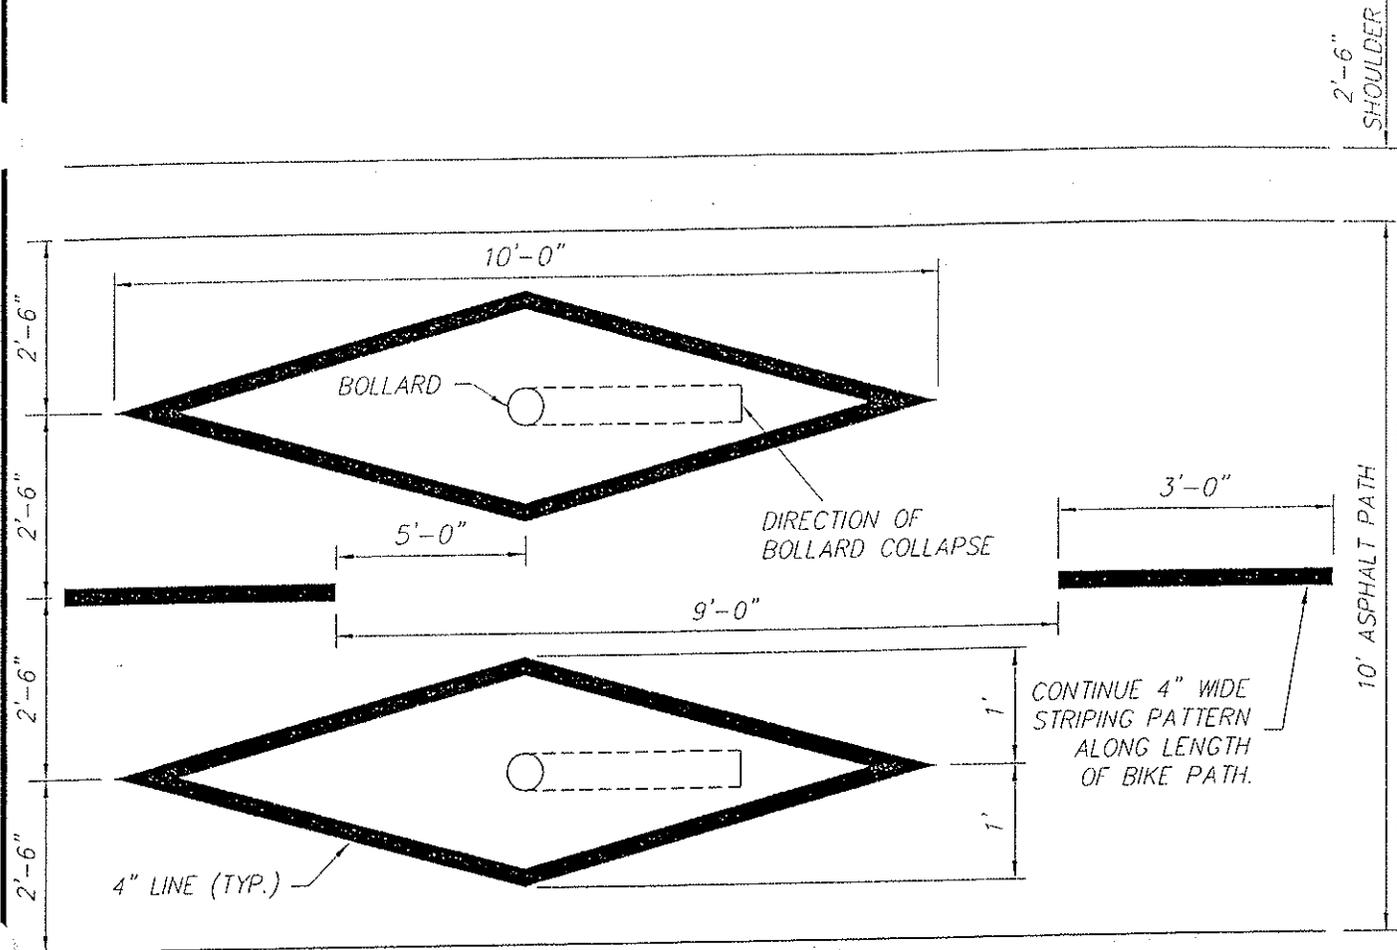

NOTES:

1. STRIPING SHALL CONFORM W/ CAL TRANS HIGHWAY DESIGN MANUAL JULY 1990, SECTIONS 1004.2 AND 1003.115 AND 1003.16 AS WELL AS ALL PERTINENT TOWN OF LOOMIS STANDARDS.
2. STRIPING TO BE YELLOW.



APPROVED BY:

 BRIAN J. FRAGIA
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 BIKE PATH STRIPING/
 BOLLARD INSTALLATION
 DEPARTMENT OF PUBLIC WORKS

LSC-23

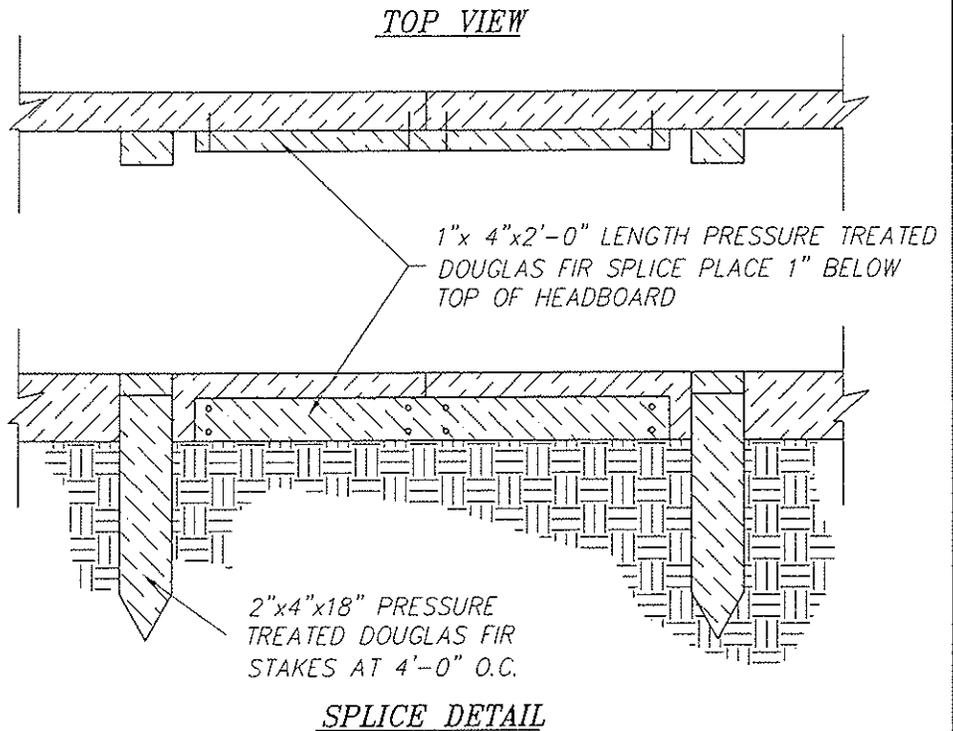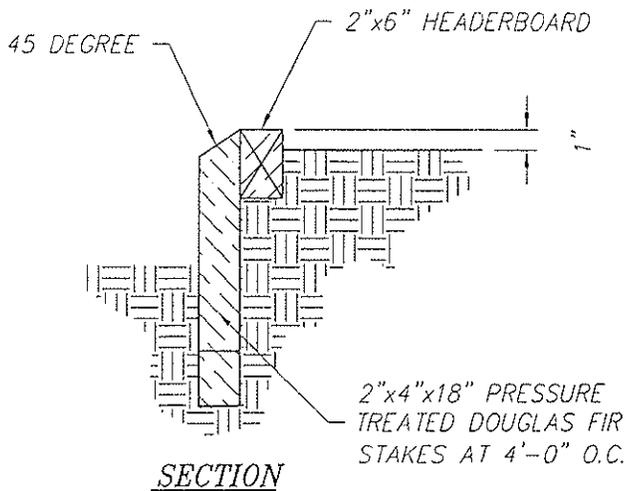2'-6" SHOULDER



NOTES:

1. USE TWO 1"x6" PRESSURE TREATED DOUGLAS FIR ON ALL CURVES (WHERE NECESSARY).
2. INSTALL ALL STAKES AND SPLICES ON PLANTING SIDE OF HEADER BOARD.
3. ALL NAILS SHALL BE GALVANIZED.
4. ALL LUMBER SHALL BE PRESSURE TREATED DOUGLAS FIR, ROUGH CONSTRUCTION HEART GRADE IN ACCORDANCE TO CALIFORNIA STATE SPECIFICATIONS 56-2.02(B).

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

**PRESSURE TREATED
 HEADERBOARD**

DEPARTMENT OF PUBLIC WORKS

LSC-24

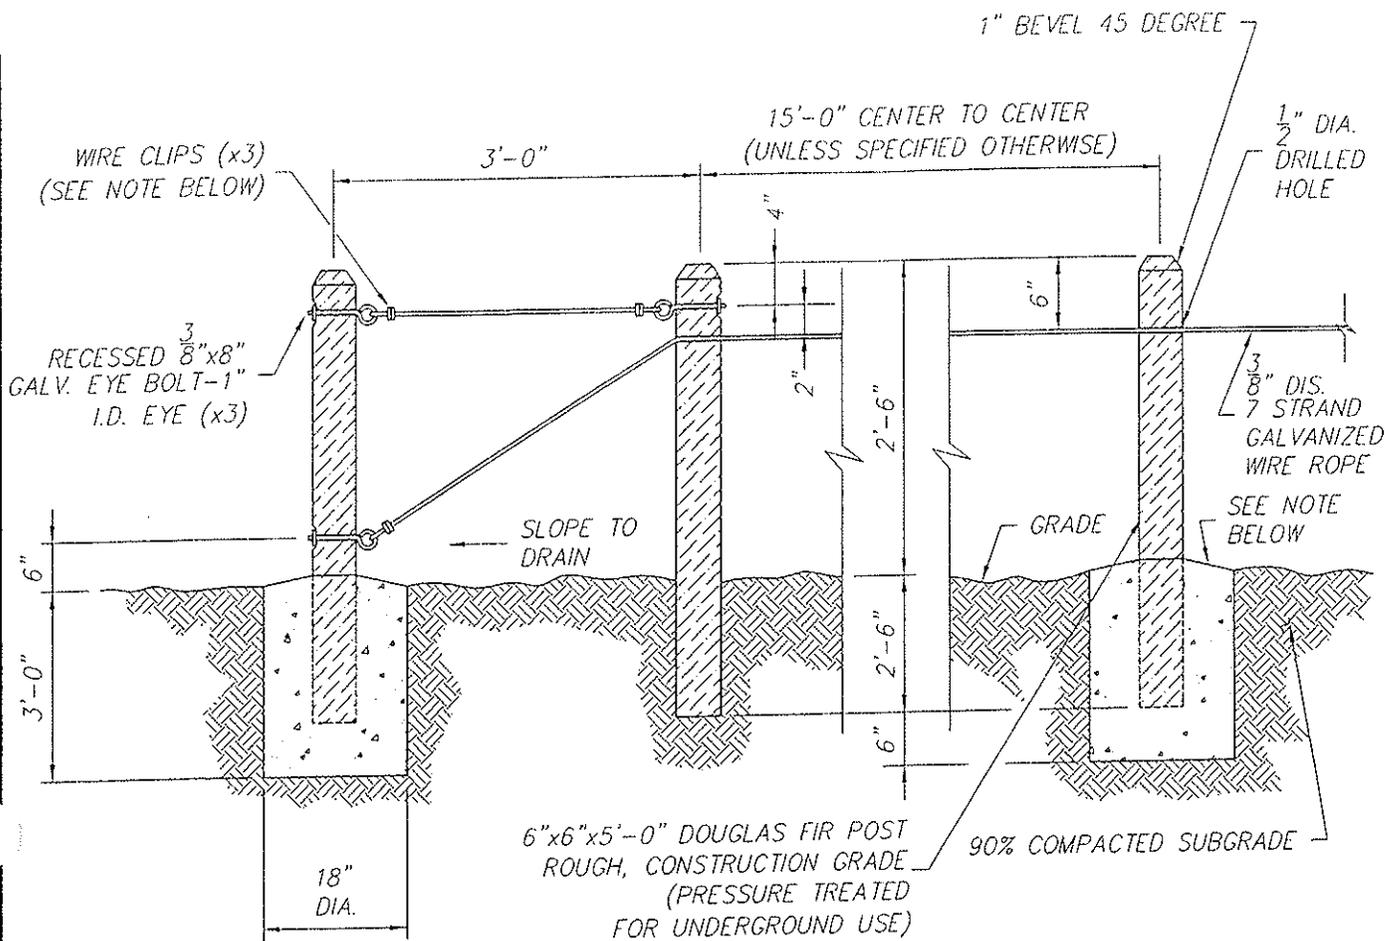

TERMINAL POST ANCHOR DETAIL

LINE POST DETAIL

NOTES:

1. PROVIDE CONCRETE FOOTINGS AT ALL END POSTS, AT ALL BENDS AND AS SPECIFIED ON APPROVED PLANS.
2. USE $\frac{3}{8}$ "x 2" GALVANIZED WIRE ROPE CLIPS FOR CONNECTION AND SPLICES. ALL CLIPS SHALL BE PLACED WITH NUTS FACING DOWNWARD.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

POST & CABLE

DEPARTMENT OF PUBLIC WORKS

LSC-25

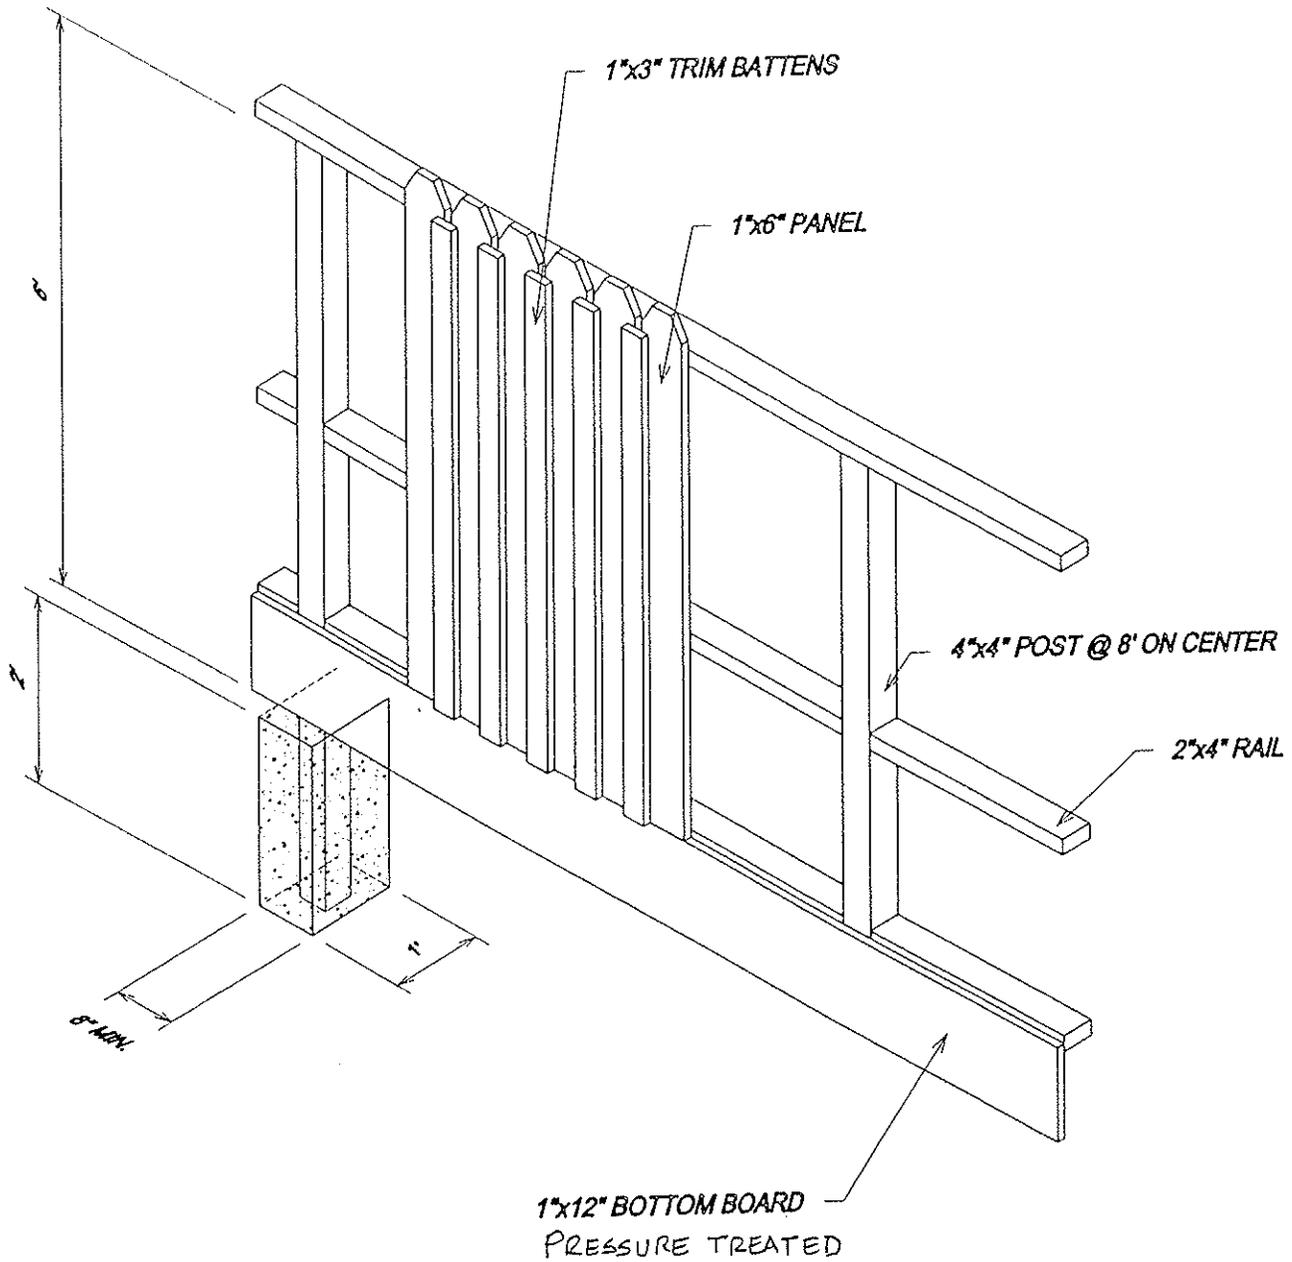

APPROVED BY:

Brian J. Fragiad

BRIAN J. FRAGIAD
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:





TOWN OF LOOMIS

REDWOOD FENCE

DEPARTMENT OF PUBLIC WORKS

LSC-26

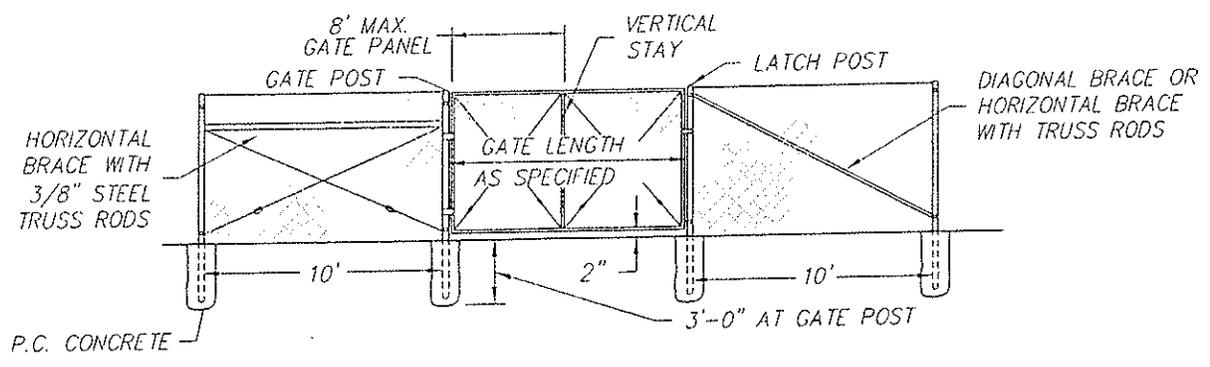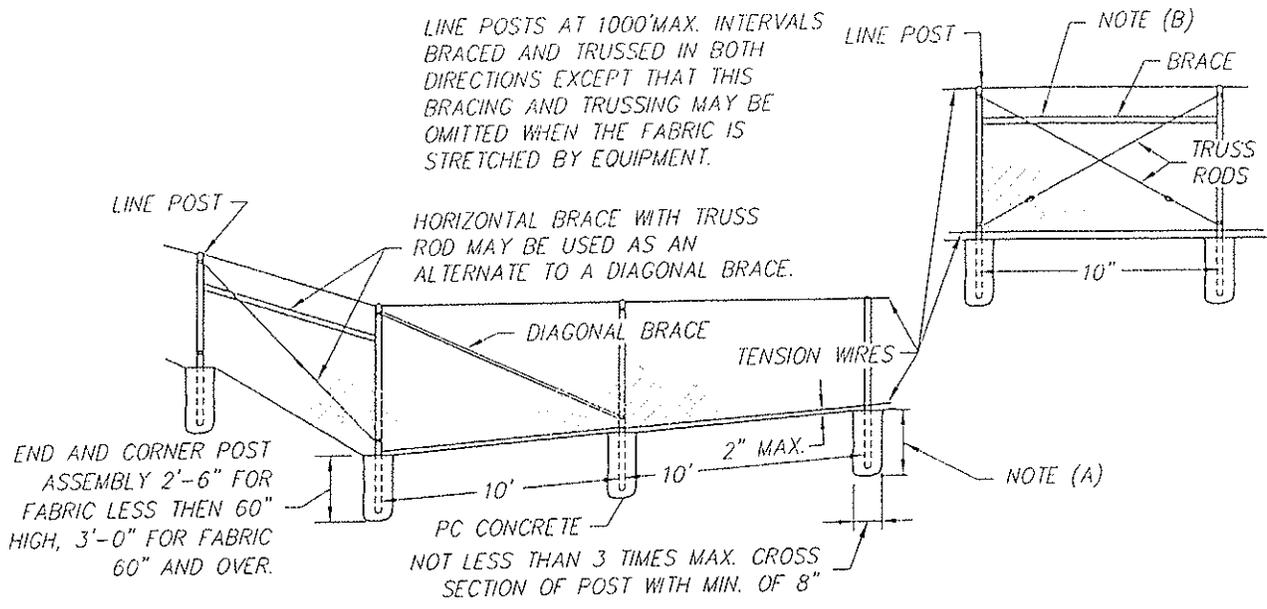


TYPE CL-4=48" FABRIC (11 GAUGE)
 TYPE CL-6=72" FABRIC (9 GAUGE)

NOTES:

- (A) 2'-6" FOR FABRIC LESS THAN 60" HIGH
 3'-0" FOR FABRIC 60" AND OVER
- (B) BRACE TO BE REMOVED AFTER ALL OTHER FENCE CONSTRUCTION IS COMPLETED UNLESS OTHERWISE DIRECTED BY THE ENGINEER.

NOTES:

1. THE ABOVE TABLE SHOWS EXAMPLES OF POST AND BRACE SECTIONS WHICH MAY COMPLY WITH THE SPECIFICATIONS.
2. SECTIONS SHOWN IN THE TABLES MUST ALSO COMPLY WITH THE STRENGTH REQUIREMENTS AND OTHER PROVISIONS OF THE SPECIFICATIONS.
3. OTHER SECTIONS WHICH COMPLY WITH THE STRENGTH REQUIREMENTS AND OTHER PROVISIONS OF THE SPECIFICATIONS MAY BE USED ON APPROVAL OF THE TOWN ENGINEER.
4. OPTIONS EXERCISED SHALL BE UNIFORM ON ANY ONE PROJECT.
5. DIMENSIONS SHOWN ARE NOMINAL.
6. TYPICAL MEMBER DIMENSIONS AND GATE POST TABLES DETAIL (LSC-27A).

APPROVED BY:

 BRIAN J. FRACIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:



TOWN OF LOOMIS
 CHAIN LINK FENCE
 DETAIL ONE
 DEPARTMENT OF PUBLIC WORKS


LSC-27

TYPICAL MEMBER DIMENSIONS

FENCE HEIGHT	LINE POSTS			END, LATCH & CORNER POSTS			BRACES			
	ROUND (I.D.)	H	ROLL FORMED	ROUND (I.D.)	ROLL FORMED		ROUND (I.D.)	H	ROLL FORMED	
					□	□			□	□
LESS THEN 6'	1-1/2"	7/8" x 1-5/8"	1-3/4" x 1-3/4"	2"	3-1/2" x 3-1/2"	2" x 1-3/4"	1-1/4"	1-1/2" x 1-5/16"	5/8" x 1-1/4"	1-3/4" x 1-1/4"
OVER 6'	2"	2-1/4" x 2"	2" x 1-3/4"	2" x 2-1/2"	3-1/2" x 3-1/2"	2" x 1-3/4"	1-1/4"	1-1/2" x 1-5/16"	5/8" x 1-1/4"	1-3/4" x 1-1/4"

GATE POST			
FENCE HEIGHT	GATE WIDTHS	NOMINAL I.D.	WEIGHT PER FOOT
6'-0" AND LESS	UP THRU 6'	2-1/2"	4.95
	OVER 6' THRU 12'	4"	10.79
	OVER 12' THRU 18'	5"	14.62
	OVER 18' TO 24' MAX.	6"	18.97
OVER 6'	UP THRU 6'	3"	7.58
	OVER 6' THRU 12'	5"	14.62
	OVER 12' THRU 18'	6"	18.97
	OVER 18' TO 24' MAX.	8"	28.55

NOTE: ABOVE POST DIMENSIONS AND WEIGHTS ARE MINIMUMS LARGER SIZES MAY BE USED ON APPROVAL OF ENGINEER.

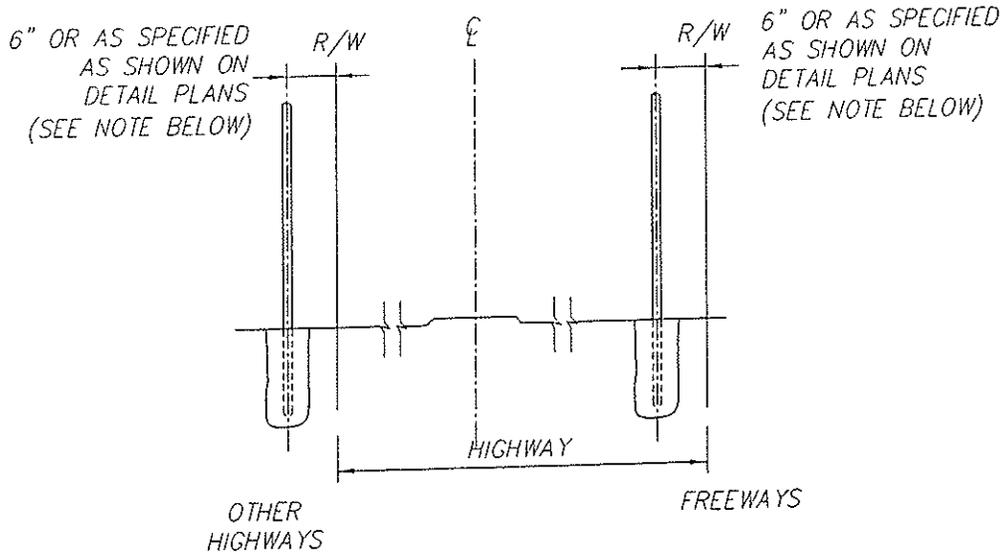

NOTE:
 OFFSET TO BE 2'-0" AT MONUMENT LOCATIONS,
 MEASURED AT RT. ANGLE TO R/W LINES.
 TAPER TO ACHIEVE OFFSET TO BE AT LEAST 20' LONG.

APPROVED BY:

Brian J. Fragio
 BRIAN J. FRAGIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
**CHAIN LINK FENCE
 DETAIL TWO**

DEPARTMENT OF PUBLIC WORKS

LSC-27A

SECTION 9

STREET LIGHTS, SIGNALS, SIGNS, STRIPING & MARKINGS (SL)

CONSTRUCTION
IMPROVEMENT STANDARDS

SECTION 9

STREET LIGHTS (SL)

9-1 **GENERAL** -- All streetlights shall be constructed in accordance with requirements of these improvement standards as recommended by the manufacturer, or as directed by the Utility Agency. The manufacturer's guidelines shall be available at the construction site at all times.

9-2 **STREET LIGHTS REQUIRED** -- Streetlights shall be required for all lots and parcels being developed or constructed upon. In addition, streetlights may be required for lots and parcels containing existing structures which are being improved or altered, depending on the nature and extent of the work.

9-3 **DEVELOPER'S RESPONSIBILITY** -- Existing streetlights, which must be relocated or repositioned, as a result of the construction of new streets or driveways into a development shall be the responsibility of the developer.

9-4 **UTILITY COMPANY AUTHORIZATION** -- A written notice from the serving utility company stating that line clearances and service have been checked and are adequate shall be submitted to the Town Engineer for all developments.

9-5 **GENERAL PLAN DETAILS** -- The plans shall show and identify all street lights to be installed, all existing lights in the immediate vicinity of the project, conduit and conductor runs, service points, trees, and all applicable provisions and details specified in these Standards.

On subdivision plans, the streetlights shall be shown separately. In addition to the above, the following shall be required on the street light portion of subdivision plans even though duplications may be involved.

9-6 **DESIGN STANDARDS** -- Street lighting shall be designed in conformance with these Standards and the "American National Standard Practice for Roadway Lighting" of the American Standards Institute, and as required by the Utility Agency.

9-7 **STREET LIGHT DESIGN DETAILS** -- Design details for streetlights are as follows:

- A. **Intersection** -- Intersections shall have at least one street light. Intersection street light locations and the number required shall conform to Standard Details SL-1 and SL-2.
- B. **Cul-de-sacs** -- All cul-de-sacs exceeding 130 feet in length measured from the street light locations at the intersection to the right-of-way line at the end of the cul-de-sac shall have a street light within the bulb. The location of the street light within the bulb shall be at the end of the cul-de-sac or at the radius neck of the cul-de-sac.

- C. **Pedestrian Lanes** -- Streetlights shall be placed at both ends of pedestrian lanes.
- D. **Spacing** -- Maximum street light spacing measured along the street centerline shall conform to Standard Detail SL-2 except on 84 and 94 foot streets with a 1,000 foot radius horizontal curve or less in which case the maximum spacing is 170 feet. Spacing on all other streets is based on a two side arrangement. The one side spacing arrangement is a system whereby the street light spacing relates to the distance between streetlights all on the same side of the street. The two side arrangement relates to the distance between streetlights taking into consideration the street lights on both sides of the street.
- E. **Street Light Poles** -- All streetlight poles shall be of galvanized steel, aluminum, or concrete except as provided for by Item "F" below. All pole construction and materials shall conform to the Standards outlined below and the Standard Details contained therein. Poles shall be identified on the plans by construction material, luminaries mounting height, pole dimensions, and by length of mast arm.

The Town may approve special or unusual designs if the character of the surrounding neighborhood warrants unusual design. Where special or unusual design street light poles not specified in these Standards are to be used, the developer shall supply to the Town additional poles to be used for future pole replacement. The minimum number of replacement poles to be supplied to the Town shall be 10% of the poles being installed with any fractional percent being rounded to the next whole number.

- F. **Street Lights on Existing Utility Owned Poles** -- Where there are permanent existing (or necessary planned) utility owned poles adjacent to the roadway, the streetlights may be installed upon the utility pole in lieu of the poles required. Should the utility pole option be utilized, the following shall apply:
 - 1. In the Pacific Gas and Electric Company (P.G.& E.) service area, the developer shall arrange to install P.G.& E. owned and maintained street lights on existing utility poles in accordance with P.G.& E. Rate LS1.
 - 2. Spacing of lights shall be varied to meet locations of existing utility poles but shall not exceed the maximum spacing specified in these Standards.
- G. **Luminaires** -- The type of street light and the appropriate wattage shall be specified on the plans. The luminaires shall be high pressure sodium type with internal ballasts.

The light pattern for each luminaire shall be specified on the plans. If required, light shielding shall be provided to prevent glare and/or reflections on to adjacent residential or business buildings. The Contractor shall submit samples of the light shield for approval by the Town Engineer.

- H. **Service** -- All street light systems shall have underground service provided. Service points shall be provided within a utility easement immediately adjacent to or within the right-of-way and shall be open and easily accessible to the street frontage. Types of service are as follows:
1. A direct underground service consists of one or two lights being served from a single service point. The service point may be in the form of a pullbox installed by the developer or a service pedestal provided by the utility district.
 2. Multiple service is three or more lights being served from a single service point installed by the developer. The service point shall be a pullbox. Multiple systems shall have a service can normally located adjacent to the service point between the service point and the light system.
- I. **Pullboxes** -- All pullboxes, including the size, shall be shown and identified on the plans. Pullboxes shall be installed at the locations where more than two conduit runs intersect, where conduit runs are more than 250 feet long, where shown on Standard Details, at critical angle points, behind each light when No. 4 A.W.G. is used, and at such locations ordered by the Town Engineer. Normally a No. 3-1/2 pullbox will be allowed when three conduits or less are involved. For all other situations, a No. 5 or No. 6 pullbox shall be specified.
- J. **Conductors** -- All conductors, including quantity and size, shall be identified on the plans. Unless otherwise specified, conductors shall be single conductor, solid, or stranded copper, sized in accordance with these Standards and the National Electric Code.
1. On a direct underground service, the minimum conductor shall be No. 8 A.W.G.

No conductor shall be larger than No. 4 A.W.G.
 2. On multiple service, the minimum conductor size from the service point to the service shall be No. 8 A.W.G. The size of each conductor from the service point to the luminaires shall be such that the voltage drop along each circuit will not exceed 7% for 2 wire systems and 6% for 3 wire system of the nominal service voltage to the farthest luminaire. The nominal service voltage to be used is a 115 volts. Calculations shall be submitted substantiating the design criteria for every circuit. Calculations shall also be submitted showing the total load in amperes of each circuit at the service can.

Where only one photocell is required in a multiple service system, it shall be connected to the service can with three No. 14 A.W.G.

- K. **Photo Cell** -- A single photo cell receptacle shall be provided on the luminaire nearest to the service point for multiple service containing four or more lights. All other light systems shall have a photocell in each luminaire.
- L. **Conduit** -- All conduit runs, including the size, shall be shown and identified on the plans. The conduit size shall be determined using Standard Detail SL-9 as a guideline with the minimum size being one inch diameter conduit.

For a system designed using the 3 wire principle, only 2 circuits (one set of 3 wires) shall be allowed in any conduit. Further circuits based on 2 wire principle and 3 wire principle shall not be mixed in any conduit. All circuits may, however, be mixed in same conduit form can to first pullbox.

The design may include more than two circuits in a conduit if the conductors for each circuit (2 wire) or set of conductors (3 wire) are identified by conductor insulation, which is a solid color or a basic color with a permanent colored stripe. The identification stripe shall be continuous over the entire length of the conductor.

- M. **Electrical Equipment and Work** -- Control and switching equipment and fusing of all circuits shall meet the requirements of the National Electrical Code, the Basic Electrical Regulations, Title 24, Part 3, of the California Administrative Code, the rules of the National Board of Fire Underwriters, and the Town of Loomis.
- N. **Foundations** -- Foundations for poles, posts, and pedestals shall conform to Section 86 - 2.03 of the State Specifications except as herein modified. Standard bases shall conform to the sizes shown on the drawings or as detailed on the plans. All concrete shall be Class "B".
- O. **Lighting Poles** -- All poles shall be galvanized steel, aluminum, or concrete. The type of standard shall be as shown on the plans or in the Special Provisions.

- 1. **Galvanized Steel Poles**
 - a. Type "A" street lights shall use the "A" series poles as detailed on the drawings.

Galvanizing shall be as provided in Section 75 - 1.05, "Galvanizing", of the State Standard Specifications.

- 2. **Aluminum Poles/Concrete Poles** -- Aluminum and concrete lighting poles will conform to the American Association of State Highway and Transportation Officials (AASHTO) "Standard Specifications for

Structural Supports for Highway Signs, Luminaires, and Traffic Signals”, and these Standards. Poles shall be round in cross section and have continuous tapered shafts and arms of approximately 1/4 inch per foot. A wind velocity of 70 mph and a projected area of three square feet of luminaire will be used for the design of the pole. Hand holes for poles will be reinforced in such a manner as to distribute the load. Hand holes will be provided on the side normal to the luminaire and have tamper-proof hand hole cover. Eight nuts and flat washers will be provided for plumbing the poles. Shop plans for poles will be submitted for approval before any fabrication is begun.

a. Type “A” street light poles shall be equipped with a “2” diameter by 7” long tenon. Arm to pole connections will be a three bolt simplex type with 5/8” H.S. cap screws. Poles with arms shall be provided with a raintight metal cap. Base plates for aluminum poles will be provided with 11-1/2 inch bolt circles. Bolt circles for concrete poles shall be 12-1/2 inches.

3. Special approvals from Community Development and Public Works Departments are required for all streetlights other than type “A”.

P. **Luminaires**

1. Mercury Vapor or High Pressure Sodium Luminaires as specified on the plans:
 - a. Type “A” street light luminaires shall have their ballasts integral to the housing. Glare shields shall not be required. Luminaires shall be as provided in Section 86-6.01, “High Intensity Discharge Luminaires”, of the 1978 State Standard Specifications and Section 86-601B, “High Intensity Discharge Luminaires”, of the 1981 State Standard Specifications.

2. Fluorescent Luminaires
 - a. Type "A" fluorescent luminaires shall have their ballasts integral to the housing. Specifications shall be as specified and approved by the Town Engineer for each project.

Q. Lamps

1. Lamps for mercury vapor and high pressure sodium shall be as follows:
 - a. Each mercury vapor luminaire shall be furnished with a mercury vapor lamp of wattage as shown on the plans. The lamps shall be ANSI Type H39KC - 175/DX for 175 watts, ANSI Type H37KC - 250/DX for 250 watts, and ANSI Type H33GL - 400/DX for 400 watts.
 - b. The lamp shall be operated at a wattage necessary to produce 7,500 lumens with 175 watt lamps, 11,500 lumens with 250 watt lamps, and 21,500 lumens with 400 watt lamps. All lamps shall have a minimum rated average life of 24,000 hours based on 10 hours burning per start.
 - c. Each high-pressure sodium luminaire shall be furnished with a sodium lamp of wattage as shown on the plans. The lamps shall be ANSI S54 for 100 watts, ANSI S55 for 150 watts, and ANSI S50 for 250 watts. The lamps shall be operated at a wattage necessary to produce 9,500 lumens with 100 watt lamps, 16,000 lumens with 150 watt lamps, and 30,000 lumens with 250 watt lamps. All lamps shall have a minimum rated average life of 20,000 hours based on 10 hours burning per start and shall be 55 volts.
2. Fluorescent Lamps
 - a. Each fixture shall be provided with lamps of high luminous efficiency and ability to withstand high current loading, shock, and vibration. Lamps shall be cool white.

R. Ballasts -- All ballasts shall be designed to operate on a nominal primary voltage of 120/240 volts.

1. Mercury vapor ballasts shall be as provided in Section 86-6.10, "Ballasts", of the 1981 State Standard Specifications.
2. High pressure sodium ballasts shall be as provided in Sections 86-6.10, "High-Intensity-Discharge Lamp Ballasts", and Section 86-6.10A, "Regulator Type Ballasts", of the State Standard Specifications.

3. Fluorescent ballasts shall be designed to provide the electrical characteristics recommended by the lamp manufacturer for proper starting and burning of the designated lamp.
- S. Conductors -- Conductors for street lighting shall conform to Sections 86-2.08, "Conductors", 86-2.08A, "Traffic Signal and Multiple Lighting Conductors", and 86-2.08C, "Conductor Identification", of the State Standard Specifications. Contractor shall use color coded wires using a different color for each circuit with continuous color maintained throughout each circuit. Color coding shall be as required by the Town Engineer or as detailed on the plans or in the special provisions.
- T. Wiring -- Wiring for street lighting shall conform to Section 86-2.09, "Wiring", of the State Standard Specifications, except as herein modified. Section 86-2.09E, "Splice Insulation", which provides for use of heat shrinkable insulating tubing, shall not be allowed. Splice insulation -- on 600 volt conductor splices of solid or stranded conductor of =14 A.W.G. to = 6A.W.G., the contractor may use, at his option, an electrical spring connector of three part construction. The three part construction shall consist of a zinc coated free expanding steel spring enclosed in shell, with an outer jacket of polyvinyl chloride. The outer jacket shall have a flared skirt, be flexible, and able to withstand 105 degree centigrade temperature continuously. Each piece must have the spring connector sized in accordance with the manufacturer's recommendations for the number of conductors and gauges being spliced. Wire strip lengths shall also be in accordance with the manufacturer's recommendations. After spring connector has been applied to the connection, the splice shall be coated (by submersion) with a corrosive-resistant, solvent-resistant, sealing/bonding, flexible electrical coating, having at least 100 volt/mil electrical strength. Upon coating of the splice, the flared skirt end shall be positioned in an upright alignment and maintained there until the electrical coating is dry. In addition to the requirements of Section 86-2.09F, "Fused Splice Connectors", of the State Standard Specifications, the standard midget ferrule type fuse shall be further interpreted as being rated at 30 amps at 600 volts. It shall also be constructed to accommodate a 13.32 located in the hand hole section of the pole.
- U. Fuses -- Luminaires with up to 175-watt bulbs shall have 6 amps fuses installed. Luminaires with 250 to 400 watt bulbs shall have 10 amp fuses installed. All fuses shall be the fast blowing type.
- V. Photoelectric Unit -- The photoelectric units shall be supplied by the contractor for installation.
- W. Service -- The service shall conform to the provisions of Section 86 -2.11 of the State Standard Specifications, except as herein modified. The service shall be a three wire A.W.G. = 5 or as shown on the plans and drawings. It shall contain main breakers, auxiliary breakers, test switch, and contractor in accordance with the drawings. The contractor shall provide "American" padlocks for the service cans to unlock with key D233.

The contractor shall supply three # 14 A.W.G. conductors from the service pedestal to the photoelectric unit. The location of service points will be as shown on the plans with the concurrence and approval of the serving utility.

All components within the service box shall be clearly marked with the manufacturer's name and part number with a metallic or permanently marked engraved stencil for future identification. All control and switching equipment and fusing of the circuits shall meet the requirements of the National Electrical Code, the Electrical Safety Orders of the Industrial Accident Commission of the State of California, the rules of the National Board of Fire Underwriters, and Town of Loomis.

- X. **Painting** -- Painting of electrical equipment and materials shall conform to the provisions in Section 59, "Painting", of the State Standard Specifications, with the following additions and modifications:
1. Paint material for electrical installations, unless otherwise specified, shall conform to the provisions in Section 91, "Paint", of the State Standard Specifications.
 2. In lieu of the temperature and seasonal restrictions for painting as provided in Section 59, "Painting", of the State Standard Specifications, paint may be applied to equipment and materials for electrical installations at any time approved by the Town Engineer.
 3. All ferrous surfaced to be painted shall be cleaned as provided in Section 59, "Painting", of the State Standard Specifications prior to applying the vinyl wash primer or prime coat. Blast cleaning of galvanized metal surfaced in good condition, as determined by the Town Engineer, will not be permitted.
 4. Existing equipment to be painted in the field shall be washed with a stiff bristle brush using a solution of water containing 2 tablespoonfuls of heavy duty detergent powder per gallon. After rinsing, all surfaced higher than 8 feet above ground level shall be wire brushed with a coarse, cup shaped, power driven brush to remove all poorly bonded paint, rust scale, corrosion, grease, or dirt. Any dust or residue remaining after wire brushing shall also be removed prior to priming. All surfaced between the ground level and 8 feet in height shall all paint, rust, scale, corrosion, grease, and dirt removed to bare metal.
 5. Immediately after cleaning, all bare metal in corrosive atmospheres, all galvanized surfaces, and all nonferrous metal surfaces shall be coated with PreTreatment, Vinyl Wash Primer, Section 91-2.07 of the State Standard Specifications, followed by two prime coats of Zinc Chromate Primer for metal, Section 91-2.05 of the State Standard Specifications, in non-corrosive atmospheres.

Pre-Treatment, Vinyl Wash Primer may be omitted on bare metal surfaces and the prime coats shall be applied immediately after cleaning.

6. Where standards are to be finished with enamel, the color shall be Light Green Finish Coat (see Section 91-2.17 of the State Standard Specifications); the final prime coat shall be of Zinc Chromate Primer for Metal.
 7. Equipment previously finished as specified shall be given a spot finishing coat on newly primed areas, followed by on finishing coat over the entire surface.
 8. All paint coats may be applied either by hand brushing or by approved spraying machine in the hands of skilled operators. The work shall be done in a neat and workmanlike manner. The Town Engineer reserves the right to require the use of brushes for the application of paint should the work done by the pain spraying machine prove unsatisfactory or objectionable, as determined by the Town Engineer.
- Y. **Cleanup** -- During the progresses of the work, the Contractor shall keep the entire job site in a clean and orderly condition. Spillage resulting from hauling operations along or across existing streets or roads shall be removed immediately by the contractor.
- Z. **Acceptance Test** -- After completion of the installation of the street lights the contractor shall test all streetlights in the presence of the Town Engineer. The contractor shall furnish all material and equipment for such testing. The street light system shall be energized for a period of one hour or 20 minutes per lamp, whichever is greater. The test will identify light distribution patterns; accept ability of the ballasts, fixtures, and lamps for electrical and noise standards; to verify that all connections are electrically and mechanically sufficient; and other purposes as directed by the Town Engineer.
- 9-8 **MASTER PLANNING** -- Master planning is the determination of street light locations between control points. Control points are proposed street light locations at street intersections in accordance with Section 9-7 and existing streetlights. The purpose for master planning is to end up with an overall uniform street light system meeting minimum requirements. On 74 foot, 84 foot, and 94 foot streets, master planning shall apply to only one side of the street. On all other streets, master planning shall apply to both sides of the street. The procedure for master planning is outlined as follows:
- A. Determine the nearest intersections each way from the street light locations required. Determine the location of the streetlights at the intersections in conformance with these design standards.
 - B. Determine the existence of any streetlights situated between the adjacent intersections above.

- C. Determine the distance between the adjacent designed intersection street lights above and/or adjacent to existing street lights, whichever are nearest to the street light locations being determined.
- D. Divide the distance into the most possible equal spaces between lights that can be obtained in conformance with the spacing requirements herein.
- E. Compare the light locations to intersecting property lines, driveways, pedestrian lanes, and utility obstructions as follows:
 - 1. If the location falls close to a property line and the street light location can be adjusted to the property line while staying within the maximum spacing allowed, then the adjustment should be made.
 - 2. Generally, streetlights should be situated at intersecting property lines for residential lots and parcel with minimal frontage (75 feet or less). The light spacing may have to be unbalanced with additional lights being added to attain this and still comply with the maximum spacing allowed.
 - 3. Street light locations shall be adjusted to miss driveways and existing utility obstructions by five feet.
- F. Where utility owned poles with overhead lines are existing, the serving utility company shall be contacted to determine if the streetlights can be installed upon the poles.
- G. Street light locations on 84 foot and 94 foot streets may be adjusted to obtain a more uniform light distribution, should there be existing streetlights on the opposite side of the street.
- H. Street lights, if required, shall be shielded to prevent glare and/or reflection on to adjacent residential or business buildings. The project shall submit samples of the light shield for approval by the Town Engineer.

SIGNS

- 9-9 GENERAL - - Sign shall be constructed/installed in accordance with the approved improvement plans and specifications, these Construction Standards, the Town Specifications, and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the CalTrans Standard Specs.

As a minimum, all signs shall be the standard size as shown in the CalTrans Traffic Manual or CalTrans Sign Specifications, with the exception of type R2, 25 mph, 30 mph, or 35 mph speed limit signs, which may be 24 inches by 30 inches. On collector and arterial streets, the minimum size of type R1 stop signs shall be 36 inches. Type R1 stop signs on other streets shall be 30 inches. Type R1 stop signs installed on bike trails may be either 24 inches or 18 inches as approved by the Engineer.

Fluorescent Yellow Green (FYG) background colored signs shall be installed for all type W54, W54A, W63, W64, W65, W66, W79, and W80 signs.

All Overhead Signs (Signal Mounted) and advance warning G7 Guide signs shall have a 1.25 inch white reflective border around the perimeter of the sign as shown in Code G7-1 of the CalTrans Sign Specifications.

All sign panels, except as otherwise directed in these standards, shall be fabricated using reflective engineering grade sheeting. Message and sheeting shall be on one side of the panel only. No mixing of diamond, high intensity, or engineering grade sheeting on the same panel shall be allowed.

Overhead Signs (Signal Mounted) shall be fabricated using high intensity sheeting. All Fluorescent Yellow Green (FYG) background colored signs shall be fabricated using diamond grade sheeting. All type G7 (street name and advance warning) signs along arterials and collectors shall be high intensity grading.

All existing traffic signs, which are in conflict with the proposed work as shown on the plans, shall be removed by the Contractor and returned to the Town. The Engineer shall make the final decision if a question arises as to what represents said conflict.

OVERHEAD SIGN STRUCTURES (Signal Mounted)

- 9-10 MATERIAL - - G-7 and G-8 street sign lettering shall be white high intensity reflectorized Series D, with eight inch upper case and six inch lower case lettering. When text is too long for a single line, lettering other than Series D, but not smaller than Series B, may be used with the approval of the Engineer.

G-7 and G-8 Signs with one line of text shall be 24 inches tall. Signs with two lines of text shall be 36 inches tall.

All white symbols and arrows on G-8 signs shall be reflectorized.

Internally illuminated Street Name Signs (IISNS) shall not be used unless otherwise directed in writing by the Engineer.

- 9-11 SIGN PANELS & FASTENING HARDWARE - Overhead sign structures shall be attached to signal mast arms per CalTrans Standard Detail ES-7N, or as directed by the Engineer.

A. All street name signs mounted on signal mast arms shall not be the swinging arm type. One end of each street name sign shall be attached to the signal pole in at last two places, and the other end shall be attached to the signal mast arm. Fastener shall pass through both sign panels and stiffening braces, unless otherwise noted.

- B. All signal mast arm mounted signs shall have back stiffening braces attached to the sign panel.

ROADSIDE SIGNS

- 9-12 MATERIAL - G-7 and G-8 Signs with one line of text shall be 18 inches tall. Signs with two lines of text shall be 24 inches tall.
- 9-13 METAL POLE - Metal pole, square tube, shall conform to the standard specifications for cold rolled carbon sheet steel, commercial quality, ASTM A-446 or hot rolled carbon steel sheet, structural quality, ASTM A-570-90 and ASTM A-653-94, structural grade 50. The square end of the post can be pointed for easy penetration and shall be capable of being driven into the ground by the use of an approved driving cap.
 - A. Square tubes shall be installed into a sleeve of same material with two holes showing above finished grade. All holes below grade shall be taped closed. The sleeve shall be embedded in concrete.
 - B. Corner weld steel shall be carefully rolled to size and shall be welded directly in the corner by high frequency resistance welding and externally scarfed to agree with corner radii. Corner weld shall be zinc coated after scarfing operation.

<u>Permissible Dimensions</u>	<u>Squareness Tolerance</u>	<u>Twist In 3' length</u>
1- 3/4" x 1 - 3/4"	Plus or Minus .010"	0.62"
2" x 2"	Plus or Minus .012"	0.62"
2-1/4" x 2- 1/4"	Plus or Minus .014"	0.62"

Note: A square tube may have its side flaring to be 90 degrees to each other by the tolerance listed above.

Permissible variation in the straightness is one-sixteenth of an inch in three feet.

Standard outside corner radius shall be five-thirty seconds of an inch plus or minus one sixty-fourth of an inch.

Welding flash on the inside corner of the welded square tubes shall be controlled to permit a nine sixty-fourths inch radius gauge to be placed in the corner.

Square tubes shall be manufactured from hot dipped galvanized steel with 1.40 ounces of zinc coating, conforming to ASTM A-653, also referred to as G-140.

Square tubes shall be produced utilizing a Polyester TGIC Powder Coating in a white high-glass finish.

Corner weld should be zinc coated after scarfing operation. Interior and exterior walls of the tubing shall be galvanized, or tubing shall be given a triple coated protection by an in-line application of hot-dipped zinc (galvanization) per AASHTO M-120 followed by a chromate conversion coating and a clear organic exterior coating. The inside surface shall be given corrosion protection by double in-line application of a full zinc-base organic coating.

- 9-14 **SIGN PANEL FASTENING HARDWARE** - All signs with a surface area greater than 5 square feet shall have back bracing attached from the post support to the sign panel. Sign panels 16 square feet or larger shall have box framework.
- 9-15 **SIGN PANEL INSTALLATION** - Efforts shall be made to ensure that all signs in the center median or shoulder areas are not installed next to landscaping or other objects which may impair visibility of the sign.

The bottom of roadside signs shall be mounted at a minimum height of seven (7) feet above the grade of the sidewalk (or traveled way if there is no sidewalk), with the following exceptions:

1. The bottom of type R7, W56, and W57 signs shall be mounted at a minimum height of five (5) feet.
2. The bottom of type R10 signs located in the median shall be mounted at a minimum height of (1.5) feet.
3. The bottom of type W81 signs located outside of sidewalk areas shall be mounted at a minimum height of three (3) feet.
4. At intersections in residential areas, the bottom of street name signs shall be mounted at a minimum height of eight (8) feet. If a stop sign is attached to the same post, the street name sign shall be mounted ten (10) feet above the finished grade.

MARKERS AND DELINEATORS

- 9-16 **DESCRIPTION** - Markers and delineators shall be installed in accordance with the approved improvement plans and specifications, these Construction Standards, The State of California Traffic Manual, the State of California Department of Transportation Standard Plans, and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the CalTrans Standard Specs.
- 9-17 **REFLECTORS** - Type K-4 (type Q in the CalTrans Traffic Manual) markers (aka: Superducks) shall be 36 inches tall and have 3 bands of reflective sheeting per Section A73C of the CalTrans Standard Plans.

TRAFFIC STRIPES & PAVEMENT MARKINGS

- 9-18 **DESCRIPTION** - Traffic stripes and pavement markings shall be installed in accordance with the approved improvement plans and specifications, these Construction Standards, The State of California Traffic Manual, the State of California

Department of Transportation Standard Plans, and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the CalTrans Standard Specs.

9-19 **TOLERANCES & APPEARANCES** –The following clarifications or modifications shall be applied when installing traffic stripes and pavement markings:

1. In addition to locations as shown on the plans, bike lane signs and pavement markings shall be installed at no more than one half-mile intervals. The BIKE LANE legend shall be centered in the lane to ensure the legend does not run into the lane striping.
2. Unless otherwise specified on the plans, crosswalks shall be eleven (11) feet wide, measured from the centerline of the strip.
3. Traffic stripes and pavement markings shall not be placed over utility covers including, but not limited to, manhole covers, utility boxes, hand holes, or water valve covers.
4. STOP legend pavement markings and limit lines are required with stop signs. YIELD legend pavement markings are not required with YIELD signs. The yield limit line shall consist of a 12-inch wide white broken line. The broken yield limit line shall be spaced 3 feet solid, 2 foot break, 3 feet solid, 2 foot break (etc.)... until the area is filled.
5. Pavement arrows shall be one of the following types unless otherwise directed by the Engineer: Type II (L, R or B), Type III (L, R, or B), Type IV, Type VI or Bike lane Arrow. Type IV arrows shall only be allowed at approaches controlled by a stop sign.
6. At signalized intersections with left turn lanes longer than 150 feet the Type II, or Type II arrows shall be placed 20 feet behind the limit line, and the arrow in the number 2 left turn lane shall be placed 20 feet behind the limit line. The intent is to have the two arrows line up side by side, even though the limit lines are staggered.
7. All turn lanes shall have a Type II or Type II arrow at the beginning of the turn lane such that the tail of the arrow lines up with the beginning of the Detail 38 striping. All turn lanes 150 feet or longer shall have a minimum of two Type II or Type III arrows.
8. Type IV (L) arrows shall only be allowed at approaches controlled by a stop sign.
9. All traffic lane striping shall be discontinued through any four way public intersection from crosswalk to crosswalk, marked or unmarked. Striping shall be continuous through private intersections unless there is a striped left turn lane and/or traffic signal. For public "T" intersections, the through and bike lane striping shall be continuous for the non-intersections direction, i.e. "across the top of the "T".
10. At locations where bike lane striping is parallel striping used to channelize traffic, right turn acceleration/deceleration lanes and bus turnouts, both strips shall be detail 38. Reflective pavement markers shall be placed along the stripe next to the through lane, the other stripe shall have no pavement markers.

11. Left turn arrows shall not be placed in Two Way Left Turn Lanes unless otherwise directed by the Engineer.

THERMOPLASTIC TRAFFIC STRIPES & PAVEMENT MARKINGS

- 9-20 MATERIAL - The thermoplastic material shall conform to State Specification 8010-19A, Thermoplastic traffic Striping Material, Alkyd Binder, White and Yellow.
- 9-21 APPLICATION - The Contractor shall apply an adhesive primer base coat prior to the application of any thermoplastic material on pavement older than 30 days.

As shown on the plan, the following permanent traffic lane striping shall be thermoplastic and placed as one of the following types: detail 25, 27B, 38, 39, and Detail 39A. Pavement markers are also required for placement of detail 25 and 38.

PAVEMENT MARKERS

- 9-22 DESCRIPTION - Pavement markers shall be installed in accordance with the approved improvement plans and specifications, these Construction Standards, The State of California Traffic Manual, the State of California Department of Transportation Standard Plans, and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the CalTrans Standard Specs.
- 9-23 NON-REFLECTIVE PAVEMENT MARKERS - All nonreflective pavement markers shall be ceramic.
- 9-24 PLACEMENT - As shown on the plans, the following permanent traffic lane striping shall be raised pavement markings, and placed as one of the following types: detail 4, 7, 10, 13, 17, 20, 23, 25, 26, 30, 33, 37C, 38, or Detail 40A. Thermoplastic striping is also required for placement of Detail 25 and 38.

Detail 26 markers shall be placed 6 inches from the face of the median curb.

At all fire hydrant locations, a blue reflective pavement marker shall be installed one foot off paved centerline or median on the hydrant side of the roadway.

All traffic lane striping shall be discontinued through any four way public intersection from crosswalk to crosswalk, marked or unmarked. Striping shall be continuous through private intersections unless there is a striped left turn lane and/or traffic signal. For public "T" intersections, the through and bike lane striping shall be continuous for the non-intersections directions, i.e. "across the top of the T".

At locations where bike lane striping is parallel striping used to channelize traffic, right turn acceleration/ deceleration lanes and bus turnouts, both strips shall be detail 38. Reflective pavement markers shall be placed along the stripe next to the through lane, the other stripe shall have no pavement markers.

SIGNALS, LIGHTING AND ELECTRICAL SYSTEMS

9-25 GENERAL -Signals, lighting electrical systems shall be constructed/installed in accordance with the approved improvement plans and specifications, these Construction Standards, The State of California Standard Plans, and the latest edition of The State of California Department of Transportation Standard Specifications hereinafter referred to as the CalTrans Standard Specs.

9-26 EQUIPMENT LIST AND DRAWINGS - The Town shall provide, as discussed in these Standards, the following traffic signal equipment and materials; Controller Cabinet Assembly, Electrical Service and Emergency Vehicle Preemption.

Upon ten day notice to the Town, the equipment and materials to be provided by the Town will be available for pick-up by the Contractor at the Town's Corporation Yards. The Contractor shall provide all labor and equipment necessary to transport the Town provided equipment and materials to the job site.

9-27 MAINTAINING EXISTING & TEMPORATRY ELECTRICAL SYSTEMS -Roadway closures requiring restrictions of turning movements and/or signal red flash operations shall not be allowed without the written consent of the Town Engineer.

9-28 FOUNDATIONS - Placement (location) of all foundations shall be verified by the Engineer prior to installation.

There shall be a minimum 6-inch high curb around the signal controller/service pad, excluding the sidewalk/roadway side of the pad. The minimum curb height shall increase as necessary to ensure no steeper than a 2:1 slope of the native material around the pad. Masonry blocks may be utilized to achieve the required 2:1 slope. The Contractor shall be responsible for acquiring building permits for retaining walls if the wall is greater than four feet from base of footing to top of wall. Refer to drawing number TS-4 for further details.

Signal pole anchor bolts shall be aligned to ensure a maximum mast arm offset of two(2) degrees from perpendicular to the roadway.

9-29 STANDARD, STEEL PEDESTAL AND POST -- Any 18 standard having a signal head display, 4 sections or larger, shall be installed under the following criteria:

1. Four (4) section display will be side (SV-1-T or SV-2-T) mounted. The 1B standard shall be 13 feet in height. A PVC cap shall be provided as a pole cap. Special mounting instructions as described in these Standards shall apply. (See Section 86-4.06).

Five (5) section display shall be side (SV-1-T or SV-2-T) mounted. The 1B standards shall be 14 feet in height. A PVC cap shall be provided as a pole cap. Special mounting instructions as described in these Standards shall apply. (See Section 86-4-.06).

2. Individuals certified by the pole manufacturer shall perform signal standard welding. The contractor shall give seven (7) days advance notification prior to any welding on existing poles installed in the public right-of-way. The Contractor shall certify that any welding of signal standards will not degrade the integrity of the standards. Upon completion of welding on a signal mast arm, the Contractor shall replace any existing electrical wires in the arm.
3. All future tenons shall be covered with a plastic cap and a pull wire shall be installed to the tenon.

9-30 CONDUIT MATERIAL – All conduits shall be gray PVC, minimum Schedule 40.

9-31 CONDUIT USE -- All conduit shall be two (2) inch or larger.

9-32 CONDUIT INSTALLATION – All trenches in existing streets shall be constructed and shall be per these Standards and as required in this section.

All new conduit placed in the roadway, with the exception of conduit between detector handholds and the first pull box, shall be buried at a depth of 30" below finished grade or 18" below finished subgrade, or which ever is deeper.

Conduit size shall be limited to 3 inches maximum for new installations.

Unless otherwise specified, all signal interconnect shall be installed using 2 inch conduit with 2 foot radius 90 degree sweeps into each number 6 pull box. End bells shall be installed on the pull box end of each 90-degree sweep conduit into all pull boxes.

After conductors have been installed, the ends of conduits terminating in pull boxes and controller cabinets shall be sealed with a duct seal type of sealing compound.

If delay to motorists will not exceed 10 minutes, conduit may be installed as allowed by "Trenching In Pavement Method" as provided in the CalTrans Standard Specifications and these requirements

1. The trench shall be maximum six inches wide and two inches wider than the outside diameter of the conduit to be installed. There shall be one-inch minimum clearance between the conduit and the trench wall. The trench shall be crumbed clean prior to placement of conduit.
2. Aggregate material in concrete shall be pea gravel. Concrete shall be thoroughly consolidated around the conduit filling all voids.

9-33 PULL BOXES – Pull boxes shall not be placed within the area of an access ramp unless directed by the Engineer. Pull boxes should be installed offset 1' from back of curb. The bottoms of pull boxes shall be bedded in 6 inches of clean crushed rock. Grout in the bottom of pull boxes is not required. The pull box rim and lid shall be flush with surrounding surface. In unpaved areas, the pull box rim and lid shall be 1-inch above the finish grade.

Conduit termination in the pull box shall be a minimum of 2" from the sides of the pull box, 2" above the crushed rock, and at least 8" below the bottom of the pull box cover. Conduits shall enter and exit pull box quadrants relative to the direction of the run.

All pull boxes and lids shall be precast reinforced concrete unless otherwise directed by the Engineer.

All pull boxes shall be minimum number 5 unless otherwise specified.

Traffic Signal Interconnect pull boxes shall be a number 6 and shall be located adjacent to street light pull box locations, or as directed by the Engineer. The "Home Run" pull box (typically adjacent to the controller) shall be number 6 unless otherwise specified.

All pull boxes to be abandoned shall have conductors removed from the pull boxes and conduits and the pull box shall be removed. The remaining hole shall be backfilled and compacted with similar material as the surrounding material.

9-34 COVER MARKING - - Strips shall be fastened with ¼ inch stainless steel rivets.

Pull box covers shall read "TRAFFIC SIGNAL", except covers for pull boxes used solely for traffic signal interconnect, which shall read "SIGNAL INTERCONNECT".

9-35 CONDUCTORS - Conductors installation in new conduits shall be limited to 26 percent fill of the conduit maximum. Conductors installed in existing conduits shall be limited to 33 percent fill of the conduit maximum.

All traffic signal conduit and interconnect conduit shall have a green No. 10 pull wire.

9-36 CONDUCTOR IDENTIFICATION - - Additional marking of all conductors and cables shall be made at each termination point or as directed by the Engineer. Conductors for each vehicle and pedestrian phase shall be bundled together and banded with plastic tire-wrap labels in all pull boxes and at the signal controller cabinet.

9-37 MULTIPLE CIRCUIT CONDUCTORS - - Multiple circuit conductors shall not be permitted.

9-38 SIGNAL INTERCONNECT CABLE - - Signal interconnect cable shall consist of twelve (six pairs) number 20, minimum, stranded copper conductors. Each pair shall be wrapped with an aluminum polyester shield and shielded pair. No splicing of the Interconnect cable shall be allowed.

The signal interconnect cable shall not be placed in any conduit runs or pull boxes containing live conductors, unless otherwise directed by the Engineer.

Six (6) feet of slack shall be provided in each pull box. Fifty (50) feet of slack for each signal interconnect cable run shall be provided in the Home Run pull box in front of each signal controller, or the last pull box before the controller.

- 9-39 WIRING - - All wiring shall meet or exceed the current CalTrans Standards and National Electrical Code Standards.
- 9-40 WIRING INSTALLATION - - Ends of spare conductors or conductors terminated in pull boxes shall be taped and water sealed with Scotch Kote or approved equivalent.
- 9-41 CONNECTORS AND TERMINALS - Field conductor wiring shall not be doubled up on any single wire connector. For conductor sizes larger than number 10, connections shall be spliced by the use of "c" shaped compression connectors as shown in the CalTrans Standard Plans.
- 9-42 SPLICING - Grounding conductor splicing shall be water sealed with Scotch Kote Sealant or an approved equivalent. Two applications are required.
- 9-43 SPLICE INSULATION - All splices shall be Method B.
- 9-44 FUSED SPLICE CONNECTORS - Field fuses shall be installed in the hand hole of the standard.

All field wiring connections shall be soldered after crimping the wire connector.

- 9-45 BONDING AND GROUNDING - The second paragraph of Section 86-2.10 of the CalTrans Standard Specifications is amended to read as follows:

Grounding jumper shall be attached by 3/8 inch or larger galvanized bolt in the signal standard or controller pedestal and shall be run to the conduit, ground rod or bonding wire in adjacent pull box. Grounding jumper shall be visible after cap has been placed on foundation. All ground connections shall be watertight.

Grounding electrodes shall be of copper clad steel rod, not less than 5/8 of an inch in diameter x 8 feet in length.

A grounding electrode rod in the Controller Assembly shall be paralleled with the grounding electrode rod in the Service. This connection shall consist of a continuous solid #6 bare conductor. The ground connection shall be on the line side of the electrical entrance terminal block.

A continuous #6 bare copper conductor shall connect the ground bus in the electrical service, the grounding electrode in the service, the grounding electrode in the service, the grounding electrode in the controller, and the ground entrance lug in the controller cabinet.

The equipment-bonding conductor for all standards shall be visible and accessible after completion of work.

- 9-46 SERVICE - The Town shall supply an electrical service consisting of Type II AF, low body configuration, 43 inches high, by 12 inches wide, by 9 inches deep service pedestal. A 50-amp 120/250-volt Hart Lock receptacle shall be installed two inches below spare circuit breakers. A 60-amp 240 volt fuse block will be installed two inches to the left of the inside door latch and one inch below latch and one inch below the test switch. A mercury contactor shall be used for the 120-volt street lighting circuit control. Refer to

drawing number TS-1 for further details. The base shall be reinforced with 3/8-inch aluminum of ¼ inch steel. A 2,000-pound hasp shall be installed in two locations on the circuit breaker door. The meter window will have a metal door cover. The metal shall be anodized aluminum.

The Contractor shall obtain a building permit prior to installation of a new electrical service.

The service pedestal shall be installed a minimum of five (5) feet from the controller cabinet.

There shall be a 1 inch grouted section between the service and the foundation. A ¼ inch weep drain hole shall be installed in this grout section.

9-47 TESTING - The Contractor shall contact the Public Works Inspector at least five (5) business days prior to installation of a tested controller assembly and/or electrical service.

9-48 GROUND -- Before electrical power can be connected, the grounding electrode shall be tested for earth ground resistance. The Town Engineer shall perform this ground resistance testing. The earth ground resistance shall be a maximum of 5 ohms.

9-49 FUNCTIONAL TESTING - A shutdown of the electrical system resulting from damage caused by public traffic or from a power interruption shall not constitute discontinuity of the functional test.

During interconnect cable installation, the Contractor shall in the presence of the Town Engineer, perform a high resistance to ground test, DC resistance test and a dB attenuation loss test. The Contractor shall supply factory specifications prior to the test. The Contractor shall notify the Engineer at least 48 hours prior to interconnect cable installation.

9-50 CONTROLLER CABINET ASSEMBLY - - The Town shall supply the controller cabinet assembly.

The traffic signal controller shall have a 1" bead of clear silicone sealant applied immediately before installation between the foundation and the controller cabinet bottom. The bead shall be centered 2" in from the outer edge of the controller cabinet, around the entire perimeter. All excess silicone on the outer edges shall be cleaned off.

The sealant shall be 35 year rated. There shall be no substitution for the silicone sealant.

The field wire entrance section of the controller shall face the intersection or as directed by the Engineer.

No access to the controller shall be permitted without supervision of the Town Engineer, unless otherwise directed.

9-51 EMERGENCY VEHICLE PREEMPTION EQUIPMENT - - The Town shall supply emergency vehicle preemption equipment, with the exception of the required cabling from the optical detector to the discriminator in the Controller Cabinet Assembly.

Where existing signals are being modified, and said signals are already equipped with emergency vehicle preemption equipment, the Contractor shall perform any necessary remodel and reinstallation of said equipment as required by the plans or as directed by the Town Engineer.

Preemption cables shall be labeled in the following manner;

Phase 2&5	Single gray band
Phase 4&7	Double gray band
Phase 1&6	Triple gray band
Phase 3&8	Quadruple gray band

Labels shall consist of banded colored tape visible at the preemption detector, signal standard hand hole, adjacent pull box and the Controller Cabinet. Cables in the Controller Cabinet shall have tie wrap labels with appropriate phasing descriptions.

9-52 VEHCILE SIGNAL FACES - - All signal faces shall be aluminum. Mountings for MAT and MAS signal sections shall be bronze metal.

9-53 SIGNAL SECTIONS -All signal sections shall be 12-inch mold-cast aluminum.

9-54 LIGHT EMITTING DIODE SIGNAL AND PEDESTRIAN MODULE - All vehicle and pedestrian displays shall be supplied with LED signal lamps that conform to the latest ITE & CalTrans certifications.

9-55 BACKPLATES - All vehicle signal sections shall include aluminum backplates with perforated louvers.

9-56 PROGRAMMED VISIBILITY VEHICLE SIGNAL FACES (PVDISPLAY) - All programming of the optic display shall be done in accordance with the manufacturer and the Town Engineers' specifications.

9-57 FRONT SCREEN - - The front screen shall be plastic.

9-58 PEDESTRIAN SIGNAL FACES - Pedestrian signals shall be aluminum Type "A" with international symbols. Pedestrian head mounts shall be clamshell type with bronze mounting hardware. Mounting shall include one Allen head screw for opening, and all wiring shall be quick connect type (plug in).

9-59 SIGNAL MOUNTING ASSEMBLIES - - Terminal compartments (TV & SV) and mast arm slip fitters (MAS & MAT) shall be bronze.

Signal mast arm mounted four (4) section displays shall be type MAS-4C.

Extra support shall be incorporated whenever the following conditions arise;

1. The use of a SV-3TA or SV-3-TB display.
2. If any display on a side mount is larger than a 3-section 12" display.

The extra support method shall consist of a 1" stand off w/1/4" x 20 threaded hole. The stand-off shall be banded to the signal standard, 3" below the bottom of the top slip fitting of the displays" 1- 1/2 inch riser. A 1/4 inch hole shall be drilled in the center of the 1-1/2 inch riser to match the position of the thread hole on the stand-off. The riser shall be attached to the standoff with a 1/4" x 20 bolt, which shall include a lock washer and flat washer.

All signal display mounting assembly top members shall be watertight. The watertight sealing methods shall be a 1/2" thick layer of clear silicone around the top jointing member of all displays. Additional sealant shall be installed in the same manner on all plugs installed in the top of any signal display. Rubber washers used for water-sealing the top assembly shall not be permitted on any display framework or MAT mounting.

All MAT mounted signal displays shall have only one (1) serrated washer installed between the lock nut and the display.

All MAT and MAS mounts shall be sealed with approved clear silicone around the tenon attachment area, including the through bolt and tenon openings. The sealant shall be 35 year rated. There shall be no substitution for the silicone sealant.

Where vehicle or pedestrian display is to be installed on the side of a signal pole, a terminal compartment only shall be installed on the signal pole at the vehicle display position. All signal display wiring from the signal mast arm shall terminate at this location.

9-60 VEHICLE DETECTORS CONSTRUCTION MATERIALS - The first detector at the limit line shall be inductive loop detector Type "Q". All other vehicle detectors shall be inductive loop detector Type "A". Refer to drawing number TS-5 for further details.

Loop wire shall be Type 1, RHW-USE, neoprene-jacketed, cross-linked polyethylene insulated, #12 stranded copper.

Lead-in cable shall be Type B copper. Tinned copper shall not be permitted.

Vehicle detector hand holes shall be Type "B".

Exclusive right turn loops shall be type "A" loops.

9-61 VEHICLE DETECTORS INSTALLATION DETAILS - The Engineer prior to saw cutting shall verify all loop locations. The contractor shall give 48 hours notice prior to loop verification.

Loop wires shall be labeled in the following manner:

Lane 1-Black	Right turn lane - orange
Lane 2 - Red	
Lane 3 - Blue	

Lane- White
Lane 5 - Yellow

1. Labels shall consist of banded colored tape visible in the pull boxes, where the loop wire is spliced to the detector lead-in cable.
2. Loop detectors shall be clearly marked to reference their location in relation to the limit line and lane. The loop closest to the crosswalk in the left most lane shall be labeled as loop number 1-1. The second loop in the same lane shall be labeled 1-2, and so on. Refer to drawing number TS-5 for further details.
3. The start and end leads of a loop detector shall be clearly marked by a means of plastic tie wrap labels.

Loop Home Run slots be double cut to accommodate the twisted pair (3-turns/foot), or as directed by the Engineer. Sealant for filling slots shall be Hot Melt Rubberized Asphaltic Sealant or equivalent as approved by the Engineer. All excess sealant shall be squeegeed off after application.

During loop installation, the Contractor shall in the presence of the Engineer, perform a high resistance test and an inductive reactance test. The Contractor shall notify the Engineer at least 48 hours prior to loop installation.

All wires for each detector loop shall terminate in the nearest pull box, not the hand hole.

Lead-in cables shall not be spliced between the termination point (the pull box adjacent to loop detectors) and the controller cabinet terminals.

Where the approved plans call for preformed detector loops, the following shall apply:

1. The conduit shall be sealed to prevent the entrance of water and the movement of wires within the conduit.
2. The loop wires from the preformed loop to the adjacent pull box or hand hole shall be twisted together into a pair (at least two turns per foot) and encased in Schedule 40 or Schedule 80 PVC or polypropylene conduit (3/8 inches minimum diameter). The lead-in conduit shall be sealed to prevent the entrance of water at the pull box or hand hole end.
3. The preformed loop and lead-in conduits shall be placed prior to pouring final concrete. The top of the conduit shall be between 2 and 3 inches below top of finished surface. Where the concrete is steel reinforced, the preformed loops may rest on the steel.
4. All detector loop shields shall be grounded in the controller cabinet to the ground bus.

9-62 DETECTOR LOOP CIRCUITRY - Adjacent loops on the same sensor unit channel shall be wound in opposite directions (refer to drawing details). All loops shall be wound in a manner such that any adjacent loop will be wound in the opposite direction. The loop at the limit line, closest to the center median (lane 1), shall be wound in a clockwise direction. The next loop back in the same lane shall be wound in a counter-clockwise direction and so on. The loop detector in lane 2 closest to the limit line, shall be wound in a counter-clockwise direction.

9-63 PEDESTRIAN PUSH BUTTON ASSEMBLIES - Pedestrian push buttons shall be aluminum Type "B" with metal international symbol signs. Push buttons shall meet all Americans with Disabilities Act guidelines and be placed 36 inches above the grade of the closest edge of sidewalk and require a horizontal reach of no more than 18 inches outside the closest edge of sidewalk.

Pedestrian push buttons shall be within five (5) feet from the edge of the access ramp pan.

9-64 HIGH PRESSURE SODIUM LUMINAIRES - Unless otherwise noted, all luminaires shall be 250 watt HPS. Specifications for Luminaires:

1. Medium, cutoff, Type II or III lighting distribution (MSII or MSIII).
2. Multi-voltage ballast (120/208/240/277) with lag-type magnetic regulator.
3. Power door ballast assembly & plug in starter.
4. Photo eye receptacle with shorting cap.
5. Flat glass lens.
6. Polyester fiber gasket breathing seal.
7. Voltage tap connection.

9-65 PHOTOELECTRIC CONTROLS - Photoelectric controls shall be Type II and pole top mounted.

9-66 WIRING - Wiring from the photoelectric cell assembly to the electrical service shall be #14. Wire color for the PEU shall be as follows: black for ungrounded conductor, red for ungrounded switch-leg conductor, and white for grounded conductor.

9-67 REMOVE ELECTRICAL EQUIPMENT - All existing traffic control devices, lighting devices, signs, and equipment to be removed and not reused in the work shall be salvaged, unless otherwise specified or directed by the Town Engineer. Salvageable equipment shall remain the property of the Town. Equipment determined to be unsalvageable by the Town Engineer shall become the property of the Contractor. The Contractor shall deliver salvaged equipment to the Town's Corporation Yard.


Damaged conduits deemed not be reusable shall be removed from existing pull boxes and ends plugged solid with grout. Existing conductors shall be removed from said conduits prior to plugging. Contractor shall dispose of said conductors.

Abandoned conduits deemed reusable shall have the line blown out, existing conductors shall be removed, a number 10 green locate wire shall be installed, and the ends of the conduits shall be sealed.


STREET LIGHTING STANDARD DETAILS

<u>Title</u>	<u>Plate No.</u>
Intersection Lighting	SL-1
Street Light Locations at Major Arterials and Major Industrial	SL-2
Typical Service & Wiring Schedule.....	TS-1
Typical Pole and Equipment Schedule.....	TS-2
Typical Conductor Schedule	TS-3
Typical Controller/Service Cabinet Pad Detail	TS-4
Typical Loop Detector Layout.....	TS-5



INTERSECTION WITH 2-LANE STREET

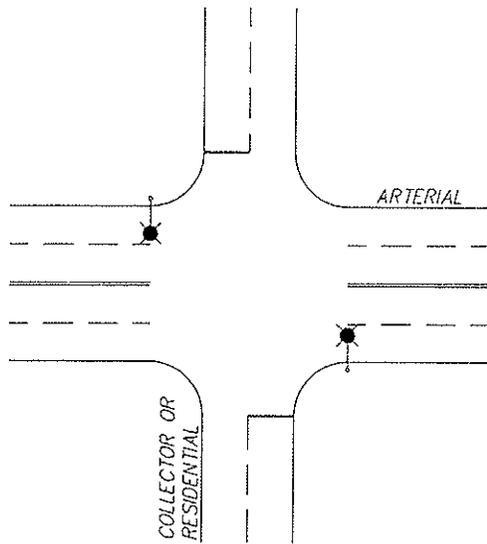


INTERSECTION WITH 4-LANE STREET

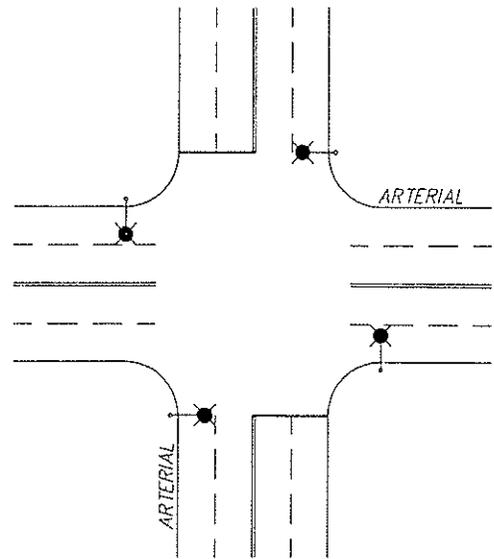

TEE INTERSECTIONS

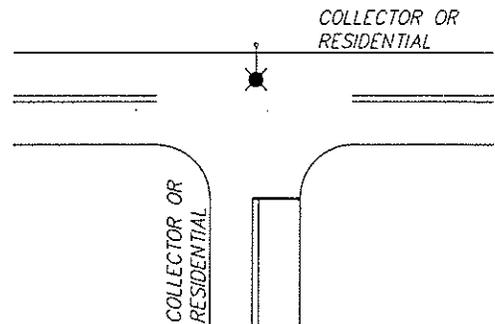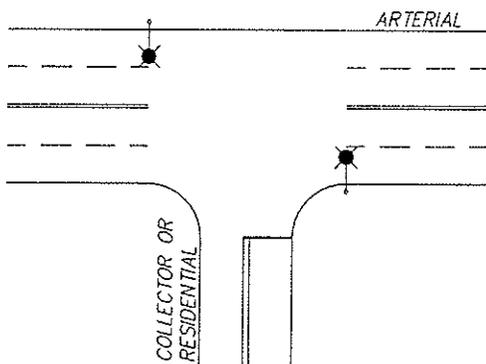

APPROVED BY:



BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:





TOWN OF LOOMIS

INTERSECTION
LIGHTING

DEPARTMENT OF PUBLIC WORKS

SL-1

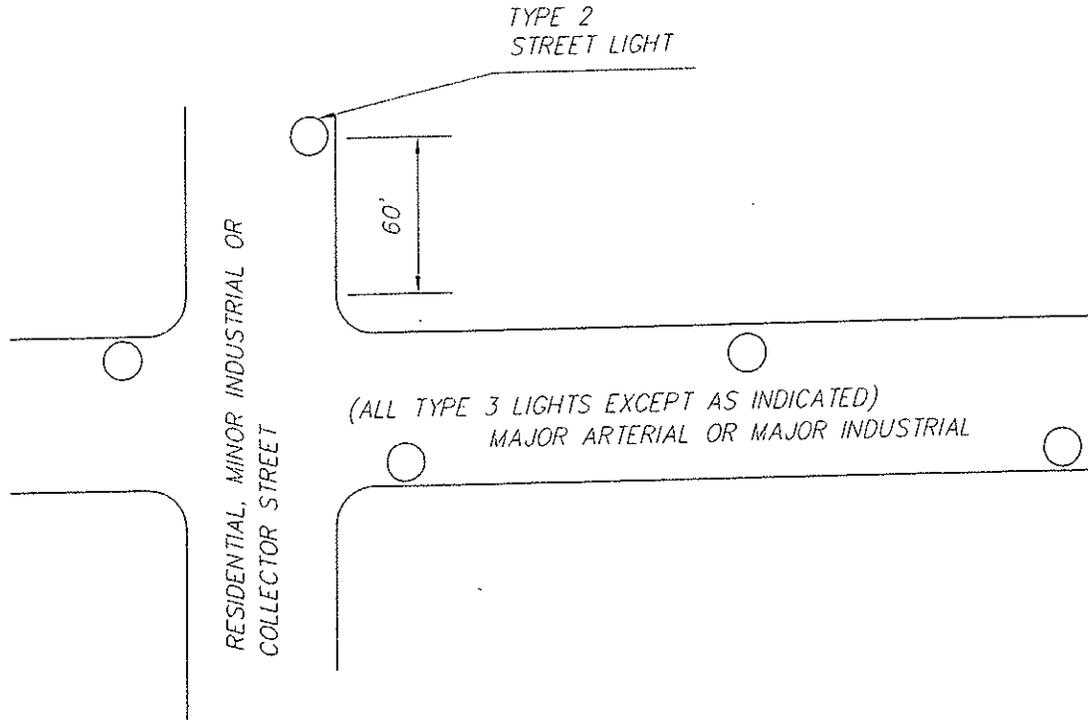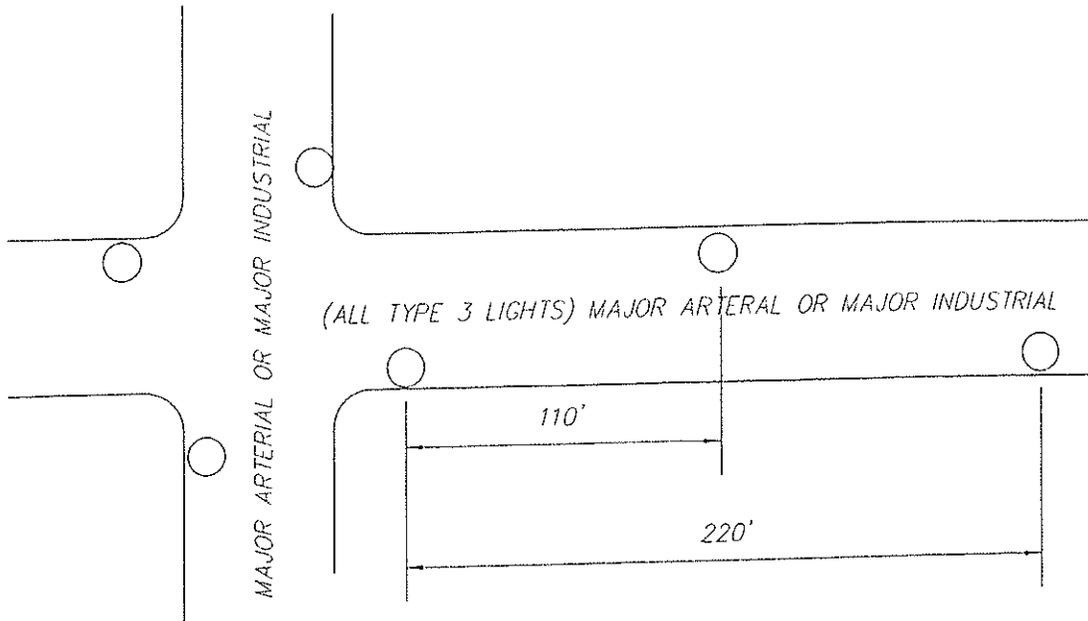

NOTES: ANY MODIFICATIONS REQUIRE APPROVAL OF TOWN ENGINEER.

APPROVED BY:

Brian J. Fragiaco

BRIAN J. FRAGIACO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS
STREET LIGHT LOCATIONS AT
MAJOR ARTERIALS
& MAJOR INDUSTRIAL

DEPARTMENT OF PUBLIC WORKS

SL-2

SERVICE ENCLOSURE WIRING DIAGRAM
 METERED PER UTILITY REQUIREMENTS

METER SOCKET
 WIRED FOR
 120/240 DR
 208/240V
 SINGLE PHASE

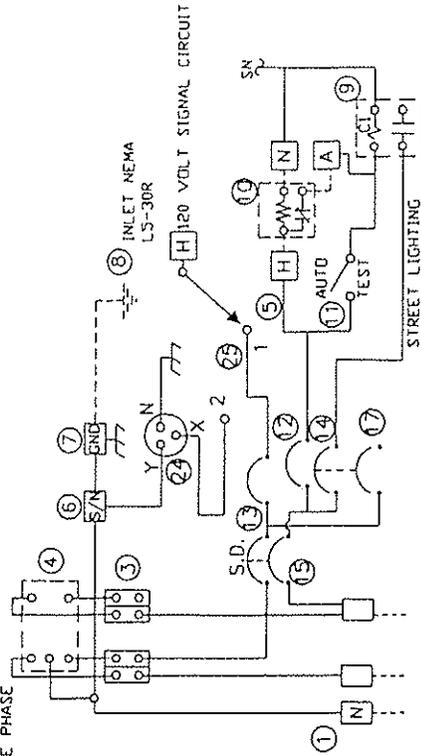

1 PH, 3V
 120/208 VOLT
 ROSEVILLE ELECTRIC
 DEPT. SERVICE

**TYPE III-AF SERVICE
 EQUIPMENT SCHEDULE**

COMPONENT	NAME PLATE DESCRIPTION
①	NEUTRAL LUG
②	LANDING LUG
③	TEST BYPASS FACILITIES
④	METER SOCKET AND SUPPORT
⑤	TERMINAL BLOCKS
⑥	SOLID NEUTRAL BUS
⑦	GROUND BUS
⑧	GROUND ROD
⑨	35A MERCURY CONTACTOR
⑩	PHOTO ELECTRIC UNIT
⑪	15 AMP SWITCH SPST
⑫	15A, 120V, 1P, CKT. BKR.
⑬	50A, 120V, 1P, CKT. BKR.
⑭	20A, 240V, 1P, CKT. BKR.
⑮	100A, 240V, 2P, CKT. BKR.
⑯	20A, 120V, 1P, CKT. BKR.
⑰	50A, 120V, FLANGED RECEPTACLE
⑱	55A, 120V, 1P
	TRANSFER SWITCH
	LIGHTING TEST SWITCH
	LIGHTING CONTROL
	SIGNALS
	STREET LIGHTS (TRAF. SIG.)
	SERVICE DISCONNECT
	SPARE

APPROVED BY:

 BRIAN J. FRAGLIO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER
 REVISED:




TOWN OF LOOMIS
 TYPICAL SERVICE AND
 WIRING SCHEDULE
 DEPARTMENT OF PUBLIC WORKS

TS-1

SERVICE ENCLOSURE WIRING DIAGRAM

METERED PER UTILITY REQUIREMENTS

METER SOCKET
WIRED FOR
120/240 OR
208/240V
SINGLE PHASE

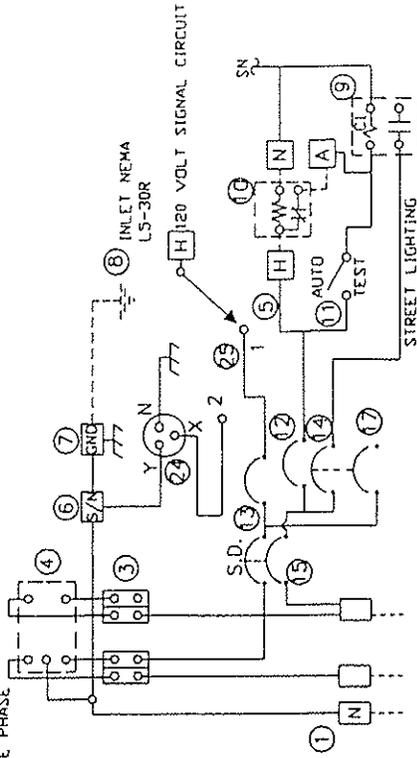

1 PH, 3V
120/208 VOLT
ROSEVILLE ELECTRIC
DEPT. SERVICE

TYPE III-AF SERVICE EQUIPMENT SCHEDULE	
COMPONENT	NAME PLATE DESCRIPTION
1	NEUTRAL LUG
2	LANDING LUG
3	TEST BYPASS FACILITIES
4	METER SOCKET AND SUPPORT
5	TERMINAL BLOCKS
6	SOLID NEUTRAL BUS
7	GROUND BUS
8	GROUND ROD
9	35A MERCURY CONTACTOR
10	PHOTO ELECTRIC UNIT
11	15 AMP SWITCH SPST
12	15A,120V,1P,CKT.BKR.
13	50A,120V,1P,CKT.BKR.
14	20A,240V,1P,CKT.BKR.
15	100A,240V,2P,CKT.BKR.
17	20A,120V,1P,CKT.BKR.
24	50A,120V,FLANGED RECEPTACLE
25	55A,120V,1P

APPROVED BY:

Brian J. Fragio

BRIAN J. FRAGIO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

TYPICAL SERVICE AND
WIRING SCHEDULE

DEPARTMENT OF PUBLIC WORKS

TS-1

POLE & EQUIPMENT SCHEDULE

NO.	STANDARD		VEHICLE SIGNAL MOUNTING		PEDESTRIAN SIGNAL MOUNTING	PPB Ø	HPS LUMINAIRE WATTAGE	NOTES	
	TYPE	SIG. MA (FEET)	LUM. MA (FEET)	MAST ARM					POLE
(A)	26-4-70	40'	15'	MAS MAS	SV-1-T	SP-2-CS	2 8	250	MOUNT G7 SIGN (Taylor Road) & R73-3 ON SMA. INSTALL OPTICOM DETECTOR EVC ON SMA.
(B)	1-B				TV-2-T	SP-2-CS			
(C)	18-3-70	30'		MAS		SP-1-CS			MOUNT G7 SIGN (King Road) & R34 ON SMA. INSTALL OPTICOM DETECTOR EVB ON SMA.
(D)	1-B				TV-2-T				MOUNT R96, R96A ON 1-B POLE.
(E)	18-3-70	25'		MAS	SV-1-T	SP-1-CS			MOUNT G7 SIGN (Taylor Road) & R34-2 ON SMA. INSTALL OPTICOM DETECTOR EVA ON SMA. MOUNT R96, R96A ON SIGNAL POLE.
(F)	1-B				TV-1-T		2		
(G)	TYPE 15		15'					250	INSTALL PEU ATOP THIS POLE.

APPROVED BY:

 BRIAN J. FRAGIAO
 DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

TYPICAL POLE AND
 EQUIPMENT SCHEDULE

DEPARTMENT OF PUBLIC WORKS

TS-2

CONDUCTOR SCHEDULE													
AWG	CIRCUIT	1	2	3	4	5	6	7	8	9	10	11	
No. 14	ø1	3	3	3	3	3		3	3	6			
	ø2						6	6	3	9			
	ø3		3	3	3	3		6		12			
	ø4		3	3	9	9		12		12			
	ø5					3	3	6		6			
	ø6	6	6	6	6	9		9		9			
	ø7												
	ø8												
	ø2 PED						2	2	2	4			
	ø4 PED				2	2		4		4			
	ø6 PED	2	2	2	4	4		4		4			
	ø8 PED												
	ø2 PPB							1	1	2			
	ø4 PPB					1	1	2		2			
	ø6 PPB		1	1	2	2		2		2			
	ø8 PPB												
	SPARES		6	12	12	15	21	6	33	6	42		
	P.E.U.										2		
TOTAL No.14		17	30	30	44	57	18	57	15	116			
No.12	PPB COMMON		1	1	1	1	1	2	1	2			
No.10	LUMINAIRE	2	2	2	2	2	2			2			
No. 8	SIGNAL COMMON	1	1	1	1	1	1	2	1	2			
No.10	PULL WIRE	1	1	1	1	1	1	1	1	1			
DLC	ø1 DETECTORS					4		4		4			
	ø2 DETECTORS								12	12			
	ø3 DETECTORS			7	7	7		7		7			
	ø4 DETECTORS							9		9			
	ø5 DETECTORS								4	4			
	ø6 DETECTORS					11		11		11			
	ø7 DETECTORS												
	ø8 DETECTORS												
TOTAL DLC			7	7	22		31	16	47				
OPTICOM CABLES	EVA						1	1		1			
	EVB				1	1		1		1			
	EVC	1	1	1	1	1		1		1			
	EVD									1			
	TOTAL CABLES	1	1	1	2	2	1	3		4			
TOTAL CONDUCTORS													
CONDUCTOR SIZES		3"2.5"4"1.5"(2)4"3"2.5"											
PERCENT FILL													

APPROVED BY:

BRIAN J. FRAGIAO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:




TOWN OF LOOMIS

TYPICAL CONDUCTOR
SCHEDULE

DEPARTMENT OF PUBLIC WORKS

TS-3

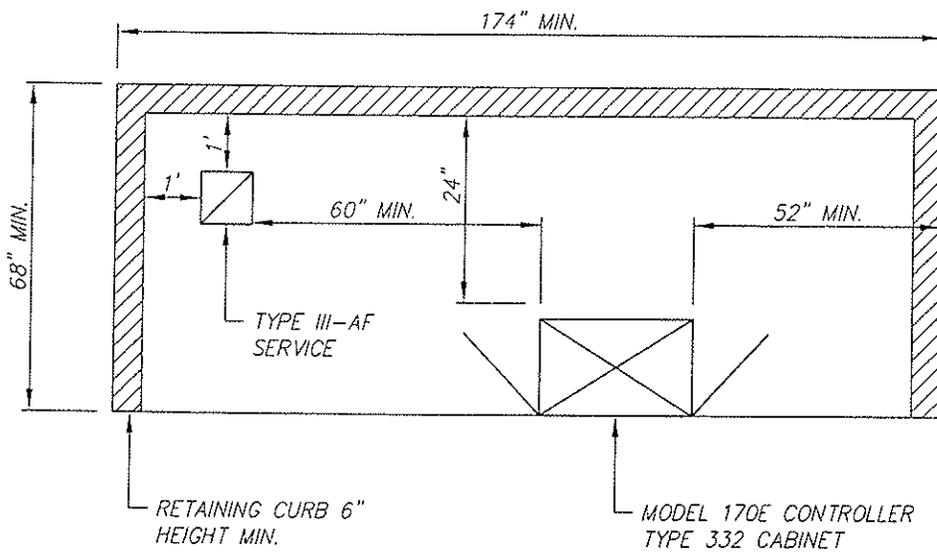

ROADWAY/SIDEWALK SIDE

APPROVED BY:

Brian J. Fragiaco


BRIAN J. FRAGIACO
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS
TYPICAL CONTROLLER /
SERVICE CABINET
PAD DETAIL
DEPARTMENT OF PUBLIC WORKS

TS-4

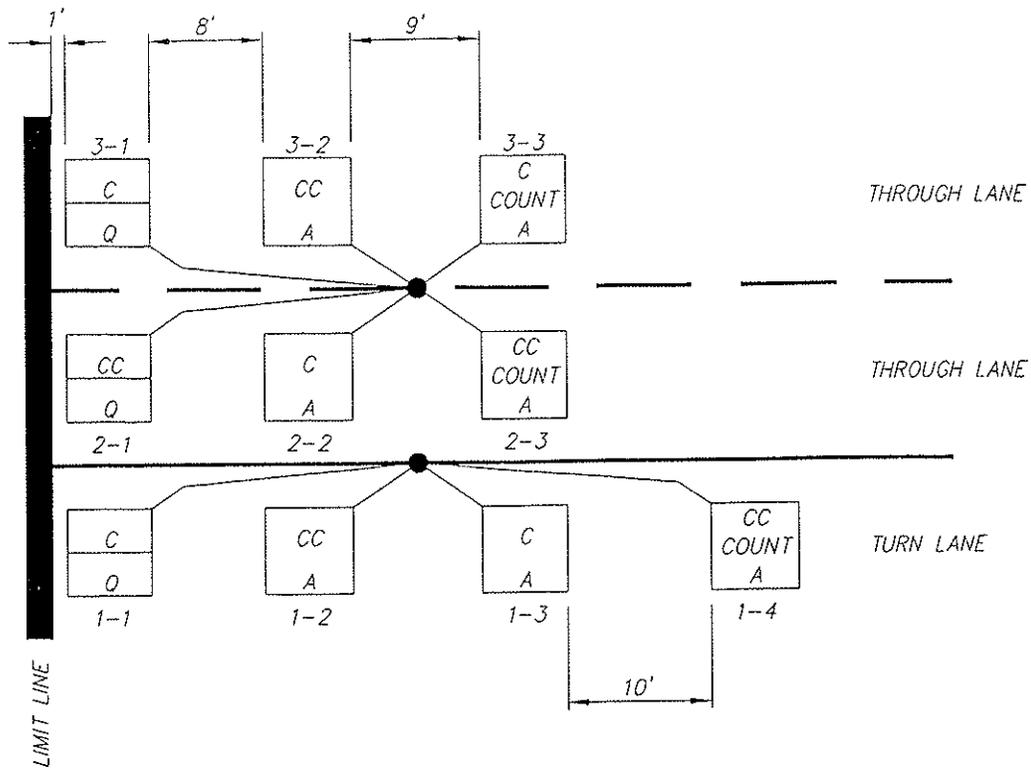

LOOP DETECTOR ASSIGNMENTS

	LT (1)	LT (2)	THRU (1)	THRU (2)	THRU (3)
CALL	111U 315U 5J1U 7J5U	111L 315L 5J1L 7J5L	214U 418U 6J4U 8J8U	212U 416U 6J2U 8J6U	214U 418U 6J4U 8J8U
COUNT	119U 319L 5J9U 7J9L (SEE NOTE 3)		213U 417U 6J3U 8J7U		212L 416L 6J2L 8J6L
ADVANCE				213L 417L 6J3L 8J7L	


LEGEND:

- A = TYPE "A" LOOP
- Q = TYPE "Q" LOOP
- C = CLOCKWISE WOUND LOOP
- CC = COUNTER CLOCKWISE WOUND LOOP
- 1-1 = LANE #, LOOP #
- COUNT = COUNT LOOP

NOTES:

1. CENTER LOOPS IN EFFECTIVE AREA.
2. HANDHOLES TO BE PLACED BETWEEN PRESENCE & COUNT LOOPS IN THE THROUGH LANES.
3. SEPERATE DLC'S SHALL BE REQUIRED FOR EACH LOOP, AND A PERMANENT LABEL SHALL BE REQUIRED TO DESIGNATE THEIR LOCATION.

APPROVED BY:



BRIAN J. FRAGIAD
DIRECTOR OF PUBLIC WORKS/TOWN ENGINEER

REVISED:



TOWN OF LOOMIS

TYPICAL LOOP
DETECTOR LAYOUT

DEPARTMENT OF PUBLIC WORKS

TS-5