

CONSTRUCTION PLANS FOR THE ELLA BROOKE ESTATES

AN ADDITION TO THE CITY OF LUCAS
COLLIN COUNTY, TEXAS
3 SINGLE FAMILY LOTS, 8.823 ACRES

CONTACT INFORMATION:


City of Lucas - (972) 771-6228
Engineer -
Development Services Director - Joe Hilbourn

Lovejoy ISD - (469) 742-8017
Dennis Womack

Grayson-Collin Electric - (903) 482-7183
Michael Lauer

TXU Energy - (214) 812-4600
Brian Neitzel

Co-Serve - (940) 321-7862
Lance Ehler

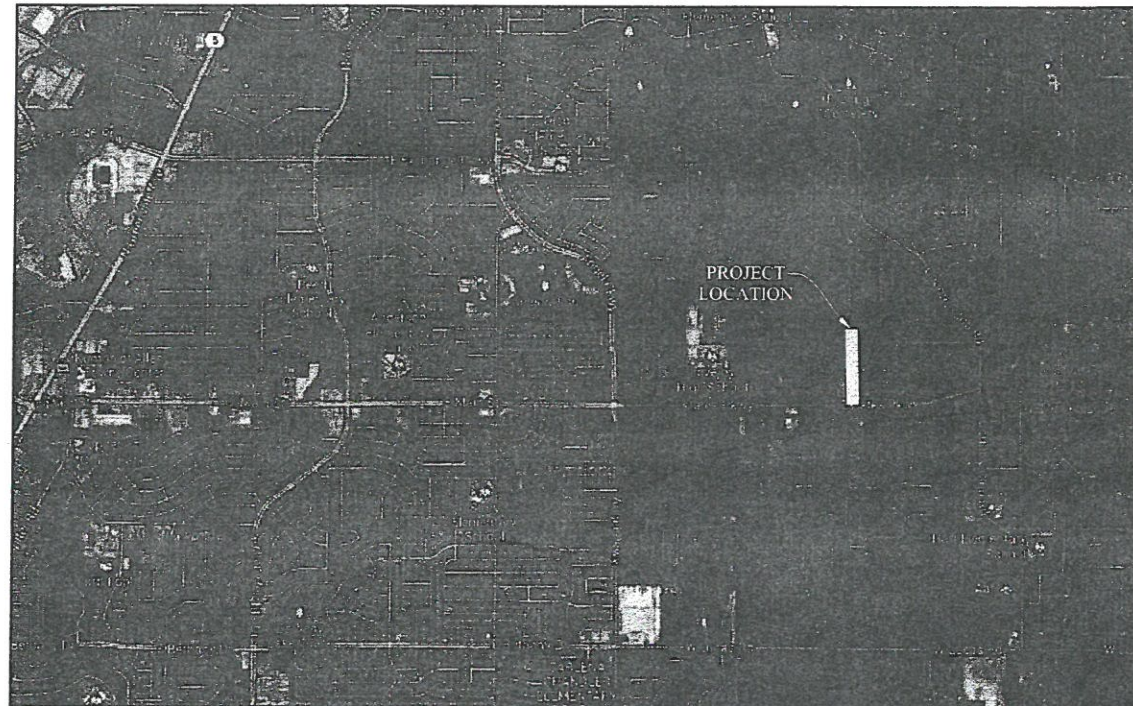

VICINITY MAP
NOT TO SCALE



SHEET INDEX

1. COVER SHEET
2. PRELIMINARY PLAT
3. PRELIMINARY PLAT - DEDICATION
4. GENERAL NOTES & PAVING SECTIONS
5. PAVING PLAN & PROFILE - KENZIE LANE 0+00 TO END
6. DRAINAGE AREA MAP & CULVERT 'A' PROFILE
7. WATER PLAN
8. WATER DETAILS
9. EROSION CONTROL PLAN
10. EROSION CONTROL & PAVING DETAILS
11. TREE SURVEY

APPROVED
CITY OF LUCAS
CITY ENGINEER *SA Fh* DATE 9-12-13

ELLA BROOKE ESTATES
CITY OF LUCAS, COLLIN COUNTY, TEXAS

ENGINEERINGCONCEPTS
& DESIGN, L.P.

24-Jul-2013

FOR CONSTRUCTION

CAUTION! EXISTING UTILITIES
CONTRACTOR SHOULD CALL 1-800-DIG-TESS PRIOR TO BEGINNING ANY CONSTRUCTION ACTIVITIES FOR EXISTING UTILITY LOCATIONS. EXISTING UTILITIES AND UNDERGROUND FACILITIES INDICATED ON THESE PLANS HAVE BEEN LOCATED FROM REFERENCE INFORMATION. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY BOTH HORIZONTALLY AND VERTICALLY THE LOCATION OF ALL EXISTING UTILITIES AND UNDERGROUND FACILITIES PRIOR TO CONSTRUCTION AND TO TAKE NECESSARY PRECAUTIONS IN ORDER TO PROTECT ALL FACILITIES ENCOUNTERED. THE CONTRACTOR SHALL PRESERVE AND PROTECT ALL EXISTING UTILITIES FROM DAMAGE DURING CONSTRUCTION.

SITE BENCHMARK:
An 'X' cut in top of curb at the southwest corner of the intersection of Stonegate Drive and Forest Grove Road. ELEV.=580.44

OWNER/DEVELOPER
SCOTT ALLEN ROGERS & MARIFRANCES KELLY ROGERS
1800 MONACO DRIVE
ALLEN, TX 75002-2691

ENGINEERINGCONCEPTS
& DESIGN, L.P.
ENGINEERING / PROJECT MANAGEMENT /
CONSTRUCTION SERVICES FIRM REG # F-001145
201 WINDCO CIR, SUITE 200 WYLIE, TEXAS 75098
972-941-8400 FAX: 972-941-8401 WWW.ECDLP.COM

REVISIONS:	
DATE:	24-Jul-2013
PROJECT NO.:	8360
DWG FILE NAME:	Z:\PROJECTS\08160 Ella Brooke Estates\dwg\8360 Coversheet.dwg

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF CONSTRUCTION.
THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY TODD D. WINTERS, P.E. 87085

OWNER'S CERTIFICATE & DEDICATION

STATE OF TEXAS
COUNTY OF COLLIN

WHEREAS, Scott Allen Rogers and Marifrances Kelly Rogers BEING the owners of a 8.823 acre tract of land situated in the City of Lucas, Collin County, Texas, and being part of the James Grayum Survey, Abstract No. 354, and being all of that certain 8.834 acre tract of land described in deed to Scott Allen Rogers and Marifrances Kelly Rogers, as recorded in Instrument 20130325000392770, Deed Records, Collin County, Texas, said 8.823 acre tract being more particularly described by metes and bounds as follows:

BEGINNING at a 5/8-inch iron rod with cap stamped "RPLS 3963" set for the southwest corner of said 8.834 acre tract and the southeast corner of a 10.00 acre tract of land described in deed to L. Wayne Benton and Sharon Benton, as recorded in Volume 4923, Page 816 of said Deed Records;

THENCE North 01 degrees 27 minutes 43 seconds West, with the common boundary line of said 8.834 acre tract, said 10.00 acre tract and on 11.945 acre tract of land described in deed to L. Wayne Benton, as recorded in County Clerks Document No. 96-0010101 of said Deed Records, a distance of 1595.06 feet to a 1/2-inch iron rod found for the northwest corner of said 8.834 acre tract and the northeast corner of said 11.945 acre tract, said corner being in the southerly boundary line of Lot 7, Kingswood Estates, an addition to the City of Lucas, as recorded in Cabinet F, Page 240, Plat Records, Collin County, Texas;

North 89 degrees 11 minutes 17 seconds East, with the common boundary line of said 8.834 acre tract and said Lot 7, a distance of 235.00 feet to a 5/8-inch iron rod with cap stamped "RPLS 3963" set for the northeast corner of said 8.834 acre tract and the northwest corner of Lot 6, Glenbrook Estates, an addition to the City of Lucas, as recorded in Cabinet E, Page 87 of said Plat Records from which a 1/2-inch iron rod bears North 71 degrees 35 minutes 12 seconds West, a distance of 0.69 feet;

THENCE South 01 degrees 53 minutes 52 East, with the common boundary line of said 8.834 acre tract and Lots 1-6 of said Glenbrook Estates, a distance of 1594.02 feet to a 1-inch double flat iron found for the southeast corner of said 8.834 acre tract, said corner being in the north right-of-way line of Farm to Market Road 2170 (Estates Parkway);

THENCE South 88 degrees 54 minutes 15 West, with the common boundary line of said 8.834 acre tract and said Estates Parkway, a distance of 247.12 feet to the POINT OF BEGINNING AND CONTAINING 384,434 square feet or 8.823 acres of land.

OW THEREFORE KNOW ALL MEN BY THESE PRESENTS:

THAT, Scott Allen Rogers and Marifrances Kelly Rogers, do hereby adopt this plat designating the herein described property as ELLA BROOKE ESTATES, an addition to the City of Lucas, Texas, and do hereby dedicate to the public use forever, the streets and alleys shown thereon. The streets and alleys are dedicated for street purposes. The Easements and public use areas, as shown, are dedicated, for the public use forever, for the purposes indicated on this plat. No buildings, fences, trees, shrubs or other improvements or growths shall be constructed or placed upon, over or across the Easements as shown. In addition, Utility Easements may also be used for the mutual use and accommodation of all public utilities desiring to use or using the same unless the easement limits the use to particular utilities, said use by public utilities being subordinate to the Public's and City of Lucas's use thereof. The City of Lucas and public utility entities shall have the right to remove and keep removed all or parts of any buildings, fences, trees, shrubs or other improvements or growths which may in any way endanger or interfere with the systems in said Easements. The City of Lucas and public utility entities shall at all times have the full right of Ingress and Egress to or from their respective easements for the purpose of constructing, reconstructing, inspecting, patrolling, maintaining, and adding to or removing all or parts of their respective systems without the necessity at any time procuring the permission from anyone.

This plat approved subject to all platting ordinances, rules, regulations and resolution of the City of Lucas, Texas.

BY: Scott Allen Rogers Marifrances Kelly Rogers

STATE OF TEXAS
COUNTY OF COLLIN

Before me, the undersigned authority, a Notary Public in and for the State of Texas, on this day personally appeared Scott Allen Rogers and Marifrances Kelly Rogers, known to me to be the persons whose names are subscribed to the foregoing instrument and acknowledged to me that he executed the same for the purposes and considerations therein expressed.

Given under my hand and seal of office, this ____ day of _____, 2013.

Notary Public in and for the State of Texas
My Commission Expires: _____

On-Site Sewage Facilities (OSSF) Notes:

- All lots must utilize alternative type On-Site Sewage Facilities.
- All lots must maintain state-mandated setback of all On-Site Sewage Facility components from any/all easements and drainage areas, water distribution lines, sharp breaks and/or creeks/rivers/ponds, etc. (Per State regulations).
- No portion of Lots 1-3 are located within the 100-year flood plain:
 - Any OSSF that is located within the 100-year flood plain is subject to special planning requirements.
 - All electrical/mechanical appurtenances located within the 100-year flood plain must be elevated at least 1' above base flood elevation.
 - A certificate of elevation establishing base flood elevation and proving that the finished floor will be at least 2' above base flood elevation must accompany any permit application for a structure that is proposed to be located within the curvilinear line of the 100-year flood plain.
- Tree removal and/or grading for OSSF may be required on individual lots.
- Individual site evaluations and OSSF design plans (meeting all State and County requirements) must be submitted to and approved by Collin County for each lot prior to construction of any OSSF system.

CITY APPROVAL CERTIFICATE

This plat is hereby approved by the Planning and Zoning Commission of the City of Lucas, Texas.

Chairman, Planning and Zoning Commission _____ Date _____

ATTEST:

Signature _____ Date _____

Name _____ Date _____

The The Director of Public Works of the City of Lucas, Texas hereby certifies that to the best of his/her knowledge or belief, this subdivision plat conforms to all requirements of the Code of Ordinances and with engineering construction standards and processes adopted by the City of Lucas, Texas as to which his/her approval is required.

Director of Public Works _____ Date _____

The Director of Planning and Community Development of the City of Lucas, Texas hereby certifies that to the best of his/her knowledge or belief, this subdivision plat conforms to all requirements of the Code of Ordinances, or as may have been amended or modified, as allowed, by the Planning and Zoning Commission as to which his/her approval is required.

Director of Planning and Community Development _____ Date _____


SURVEYOR'S CERTIFICATION

KNOW ALL MEN BY THESE PRESENTS:

That I, Robert C. Myers, hereby certify, that I prepared this plat was made from an actual on the ground survey of the land as described and that the corner monuments shown thereon were properly placed under my personal supervision in accordance with the Platting Rules and Regulations of the City of Lucas Planning and Zoning Commission

Preliminary, this document shall not be recorded for any purpose.

ROBERT C. MYERS
REGISTERED PROFESSIONAL LAND SURVEYOR
STATE OF TEXAS NO. 3963



STATE OF TEXAS
COUNTY OF COLLIN

Before me, the undersigned authority, a Notary Public in and for the State of Texas, on this day personally appeared Robert C. Myers, known to me to be the person whose name is subscribed to the foregoing instrument and acknowledged to me that he executed the same for the purpose and considerations therein expressed.

Given under my hand and seal of office, this ____ day of _____, 2013.

Notary Public in and for the State of Texas
My Commission Expires: 02/14/2015

HEALTH DEPARTMENT CERTIFICATION:

I hereby certify that the on-site sewage facilities described on this plat conform to the applicable OSSF laws of the State of Texas, that site evaluations have been submitted representing the site conditions in the area in which on-site sewage facilities are planned to be used.

Registered Sanitarian or Designated Representative
Collin County Development Services

"Preliminary Plat - For Inspection Purposes Only."

LAND SURVEYOR
R.C. MYERS SURVEYING, LLC
3400 OXFORD DRIVE
ROWLETT, TX 75088
(214) 532-0636
FAX (972) 412-4875
EMAIL: rcmsurveying@gmail.com
Job No. 226

OWNER/DEVELOPER
SCOTT ALLEN ROGERS & MARIFRANCES KELLY ROGERS
1800 MONACO DR
ALLEN, TX 75002-2691

PRELIMINARY PLAT
ELLA BROOKE ESTATES
LOTS 1-3, BLOCK A
3 RESIDENTIAL LOTS
BEING 8.823 ACRES
SITUATED IN THE
JAMES GRAYUM SURVEY, ABSTRACT NO. 354
CITY OF LUCAS, COLLIN COUNTY, TEXAS

ENGINEERING CONCEPTS & DESIGN, L.P.
ENGINEERING/PROJECT MANAGEMENT/CONSTRUCTION SERVICES
TEXAS FIRM REG. NO. 001145
201 WINDCO CIRCLE, SUITE 200, WYLLIE, TEXAS 76098
(972) 941-8400 FAX (972) 941-8401

DATE: JULY 24, 2013

SHEET 2 OF 2

GENERAL NOTES:

- All work and materials shall conform to the City of LUCAS Engineering Design Manual and the "Standard Specifications for Public Works Construction" published by the North Central Texas Council of Governments (NCTCOG), latest edition. In the event of conflict, duplication, or variance, the City Engineer shall have the final decision on all construction materials, methods, and procedures.
- Prior to construction, the contractor shall familiarize himself with the contract documents and specifications, the plans including all notes and any other applicable standards or specifications relevant to the proper completion of the work specified. Failure on the part of the contractor to familiarize himself with all standards or specifications pertaining to this work shall in no way relieve the contractor of responsibility for performing the work in accordance with all such applicable standards and specifications.
- Contractor shall have in his possession, prior to construction, all necessary permits, licenses, etc. Contractor shall have at least one set of approved engineering plans and specifications on site at all times.
- Any item of work called for by the plans and/or specification and not included, as a bid item shall be subsidiary to the construction of the various bid items.
- Construction inspection will be performed by representatives of the owner, engineer, city, geotechnical engineer, and reviewing authorities and agencies. Unrestricted access shall be provided to them at all times. Contractor is responsible for scheduling required inspections as required by contract documents.
- Any item requiring inspection by the City, must be performed between the hours of 8am-5pm Monday thru Friday.
- The contractor and all subcontractors must confine their activities to the work area. Any damage resulting from construction activities, shall be the contractor's responsibility.
- It will be the responsibility of each contractor to protect all existing public and private utilities throughout the construction of this project. Contractor shall contact the appropriate utility companies for line locations prior to commencement of construction and shall assume full liability to those companies for any damages caused to their facilities. Location of utilities are taken from the City of LUCAS and Utility Company records. Contractor shall field verify to determine exact location of utilities.
- Trench safety design will be the responsibility of the contractor. The contractor shall abide by all applicable federal, state, and local laws governing excavation. Trench side slopes shall meet OSHA standards. Benching, shoring, and bracing shall be required when side slope standards are not met. A pull box, meeting OSHA standards will be acceptable. The contractor shall submit detailed plans to the City Engineer for review showing how OSHA Standards for excavation shall be met prior to the start of any utility construction. The plans shall be sealed by an Engineer registered by the State of Texas.
- Contractor shall stockpile salvaged materials for inspection. All items not salvaged by the owner shall be removed from the site at the contractor's expense. The owner will transport salvaged materials away from the site at the owner's expense. Salvage, stockpile, and removal of materials shall be considered subsidiary to the various bid items and shall not be paid for directly unless such items are specifically included in the bid items.
- The contractor shall be responsible for providing and maintaining all necessary warning and safety work, material, and operations needed to provide for the health and safety of the public until all work has been completed, including maintenance bond periods, and to be accepted by the City of LUCAS in writing.
- All construction and materials testing unless otherwise indicated, shall be performed by an Engineering Testing Laboratory employed by the Contractor. The testing laboratory shall be approved by the City of LUCAS. The testing laboratory shall make tests necessary to insure that construction is in accordance with the approved plans and specifications. Re-testing required due to construction not being performed in accordance with the plans and specifications shall be at the expense of the contractor. The testing laboratory shall submit testing reports to the City Engineer and Design Engineer.
- Any additional excavated material shall be placed as directed by the Owner.
- All fill areas to be density and moisture controlled. Fill should be compacted to 95% of standard proctor density at a minimum of 2% above optimum moisture content.
- *The contractor shall contact NIMWD Engineering at (972) 442-5405 at least 48 hours prior to performing any work in the vicinity of the NIMWD facilities.

CLEARING AND GRADING NOTES:

- All grading shall conform to the City of LUCAS standards.
- Site Preparation: All surface vegetation and the foreign materials such as roots, grass, etc., shall be stripped to a minimum depth of 4 inches and removed. All cleared and grubbed materials shall be removed off-site in accordance with local, state, and federal regulations.
- Scarifying Area to be Filled: In areas where fills are desired, the stripped surface shall be scarified to a depth of at least 6 inches for uniform compaction. The scarified surface shall be such that it is free from lumps and uneven surfaces.
- Compacting Area to be Filled: After clearing and scarifying the area to be filled, the soils shall be brought to a moisture content of -2% to +4% of the optimum moisture value and compacted, in 6 inch maximum lifts, mechanically to at least 95% of Standard Proctor maximum dry density (ASTM D 698). R.O.W. areas to be filled shall be brought to moisture content of 0% to +4% of the optimum moisture value and compacted, in 6 inch maximum lifts, mechanically to at least 95% of Standard Proctor maximum dry density (ASTM D 698).
- Fill Material: On-site soil and/or rock could be used as random fill provided such material is free from vegetation and other deleterious substances. No fill material shall contain rocks or lumps having a diameter of 8 inches or greater.
- Depth and Mixing of Fill Layers: The fill materials shall be placed in level, uniform layers. Each layer shall be thoroughly blade mixed during spreading to insure uniform compaction. These materials shall be placed in loose lifts with density and moisture content shall conform to that specified herein.
- Compaction of Fill Layer: Compaction equipment shall be capable of compacting all fill soils to the specified density. Compaction of all fill shall be accomplished with the material at the specified moisture content. Each fill layer shall be compacted uniformly with sufficient effort to achieve the specified degree of compaction.
- Amount of Compaction: After each fill layer has been placed, mixed, and spread evenly, it shall be thoroughly compacted to a minimum 95% of the Standard Proctor density (ASTM D 698).
- Moisture Content: All fill material shall be compacted at the appropriate moisture content as defined for the particular soil type. Each layer shall be brought to a moisture content of -2% to +4% of the optimum moisture value as determined by ASTM D 698. The compaction moisture content of limestone or other rock-like materials is not considered crucial, provided the proper degree of compaction is attained. R.O.W. areas to be filled shall be brought to moisture content of 0% to +4% of the optimum moisture value and compacted, in 6 inch maximum lifts, mechanically to at least 95% of Standard Proctor maximum dry density (ASTM D 698).
- Slope Control: In areas where cut of fill slopes exceed 3 feet in depth/height, a slope ratio of one (vertical) to 4 (horizontal) shall not be exceeded. Compaction operations of fill slopes shall be continued until the slopes are stable.
- Field Density: Field density tests of fill and/or backfill shall be controlled by an Engineering Testing Laboratory. Density tests shall be taken in the compacted material below the disturbed surface. When these tests indicate that the density or any layer of fill is below the required density, the particular soil or rock layer shall be reworked until the proper density and/or moisture content is achieved. Re-testing of reworked areas shall be at contractor's expense.
- Tolerance for Rough Grading: Streets shall be rough graded within 0.2' of plan grades prior to utility construction. Utility contractor shall return street to within 0.2' of plan grade prior to street paving.
- Supervision: Supervision by the Soils Engineer shall be of such continuity during the grading operations that he can adequately describe the work done and evaluate that work in comparison with the specifications. Actual supervision shall be the Contractor's Supervisor.
- Reports: The Testing Laboratory shall send 1 copy of each test, inspection, or evaluation report to the Public Works Department, Owner, and Design Engineer.
- All excess earth shall be used on-site or taken to an area designated by the Engineer at the Contractor's expense.

PAVING NOTES:

- Concrete street pavement shall be NCTCOG Class "C", 3,600 PSI compressive strength. Air content shall be 3%-5%. Pavement thickness and reinforcing steel shall be as indicated on construction plans and conforming with current City of LUCAS Standards.
- The subgrade shall be treated 7 inches deep, minimum, with lime slurry. Lime slurry shall be Type B Grade 1 and applied in accordance with the City Standard Specifications. Lime shall be applied at a rate of 7.0% of the dry weight soil and have a P.I. of less than 15. Compaction of the lime stabilized subgrade shall be to 95% Standard Proctor density. Stabilization shall extend 2' ft. beyond back of curb (refer to typical paving section).
- All dimensions are to edge of pavement unless otherwise noted. Elevations are edge of pavement unless otherwise noted.
- Water meters and/or services shown to be in conflict with proposed paving or drainage facilities are to be relocated by the Contractor, subject to review by the Public Works Department, prior to commencement of construction of paving and drainage.
- Power and telephone poles shown to be in conflict with proposed sidewalk paving to be relocated by appropriate utility prior to paving.
- It will be the responsibility of the paving contractor to protect all public utilities of this project. All manholes, valve boxes, fire hydrants, etc., must be adjusted to proper line and grade by the paving contractor prior to and after the placing of permanent paving.
- Expansion or construction joints should be placed at 600 feet maximum spacing or the final pour of the construction day. Transverse construction joints shall be placed on 20 feet maximum spacing. Refer to City of LUCAS Standard Details.
- Construction joints shall be formed by sawing. Joint depth shall be equal to one-fourth (1/4) of slab thickness. Sawing of joints shall begin as soon as the concrete has hardened sufficiently to permit sawing without excessive raveling. All joints should be completed before uncontrolled shrinkage cracking occurs. Joints should be continuous across the slab and extend completely through the edge of pavement. All joint openings to be cleaned and sealed with hot poured rubber joint sealing compound prior to opening to traffic.
- Any excess earth shall be taken to an area, to be designated by the Engineer at the contractor's expense.
- Back fill shall be placed along all pavement edges. Back fill material shall be free of earthwork debris such as muck, rock, refuse, stumps, concrete, asphalt, or other unsuitable materials and shall consist of soil suitable for sodding.
- Topsoil to stripped and placed on parkways and yards on lots.
- City will water test streets upon completion. Any standing water must be remedied before acceptance.

WATER SYSTEM IMPROVEMENTS NOTES:


- All work and materials shall be in accordance with City of LUCAS standard specifications.
- Fire Hydrants shall be Mueller or approved equal, 3-way breakaway type, no less than 5 1/2 inches in size and shall conform to the provisions of the latest AWWA Standard C502, and shall have a bury depth of five feet. Valves shall be placed on all fire hydrant leads and shall be F x M.J. Fire hydrants shall be located so that breakaway point is no less than 2-inches and no greater than 6-inches above the grade surface and a minimum of 2-feet and a maximum of 5-feet below the edge of pavement line, based on the location of the sidewalk. The fire hydrant shall not be in the sidewalk and shall be installed so the stamer connection will face the street, or as directed by the fire department. A Blue Stimsonite, Fire-Life reflector (or approved equal) shall be placed in the center of the drive lane on the side of the fire hydrant.
- Fire hydrant Bonnets shall be painted according to the capacity of the main to which it is attached. See chart below. The remainder of the hydrant above ground shall be painted aluminum.
- 8" Waterline - Blue
- Valves 12" and under to be Gate Valves meeting requirements of AWWA C500 or AWWA C509 (NCTCOG Item 2.13.1) with non-raising stems. Contractor shall also mark curb with "V" at location of valve.
- Water Mains - All water mains, fittings, and valves shall meet AWWA specifications. All water lines to be C900 DR-18 (NCTCOG Item 2.12.2). Minimum cover over water mains shall be 8' dia. and under, 3.5-feet, 8' dia., 4-feet, 12' dia., 4.5 feet-5 feet. DR-18 water mains to be tested at 150 psi for a continuous period of four (4) hours. Leakage rate shall not exceed 25 gallons per inch of normal diameter per mile of pipe over test period. Contractor shall flush and sterilize lines and prove lines to be free of conforma organisms by obtaining samples for laboratory tests for contamination. The Contractor shall flush and sterilize until samples for test are free from contamination. Jetting of backfill will not be permitted.
- All water services shall be 1" copper. Meter boxes shall comply with current City of LUCAS Standards and Specifications.
- Contractor shall use a 1" piece of blue plastic flagging to the water service and shall leave a minimum of 36" of flagging exposed after backfill. Contractor shall also mark curb with "W" at location of water service.
- Contractor shall furnish a maintenance bond to the City of LUCAS to run for two years from the date of acceptance.
- The source of water supply for this addition will be from the City of LUCAS.
- Valve boxes shall be furnished and set on each gate valve. After the final clean-up and alignment has been completed, the Contractor (utility) shall pour a concrete block 6" x 18" x 18" around all valves box tops so the finished grade is level with the finished parkway.
- Water lines shall be pressure tested and disinfected in accordance with AWWA C601.
- Water valves deeper than 4' shall have extensions in accordance with City of LUCAS Details.
- All embedment to be class B+ or better as detailed in the NCTCOG Construction Standards.

Texas Commission on Environmental Quality
Chapter 290 - Public Drinking Water
Subchapter D - Rules And Regulations For Public Water Systems
§290.44. Water Distribution.

- Location of waterlines
 - Where the nine-foot separation distance cannot be achieved, the following criteria shall apply.
 - New waterline installation - parallel lines.
 - Where a new potable waterline parallels an existing, non-pressure or pressure rated wastewater main or lateral and the licensed professional engineer licensed in the State of Texas is able to determine that the existing wastewater main or lateral is not leaking, the new potable waterline shall be located at least two feet above the existing wastewater main or lateral, measured vertically, and at least four feet away, measured horizontally, from the existing wastewater main or lateral. Every effort shall be exerted not to disturb the bedding and backfill of the existing wastewater main or lateral.
 - Where a new potable waterline parallels an existing pressure rated wastewater main or lateral and it cannot be determined by the licensed professional engineer if the existing line is leaking, the existing wastewater main or lateral shall be replaced with at least 150 psi pressure rated pipe. The new potable waterline shall be located at least two feet above the new wastewater line, measured vertically, and at least four feet away, measured horizontally, from the wastewater main or lateral.
 - New waterline installation - crossing lines.
 - Where a new potable waterline crosses an existing, non-pressure rated wastewater main or lateral, one segment of the waterline pipe shall be centered over the wastewater main or lateral such that the joints of the waterline pipe are equidistant and at least nine feet horizontally from the centerline of the wastewater main or lateral. The potable waterline shall be at least two feet above the wastewater main or lateral. Whenever possible, the crossing shall be centered between the joints of the wastewater main or lateral. If the existing wastewater main or lateral is disturbed or shows signs of leaking, it shall be replaced for at least nine feet in both directions (18 feet total) with at least 150 psi pressure rated pipe.
 - Where a new potable waterline crosses an existing, pressure rated wastewater main or lateral, one segment of the waterline pipe shall be centered over the wastewater main or lateral such that the joints of the waterline pipe are equidistant and at least nine feet horizontally from the centerline of the wastewater main or lateral. The potable waterline shall be at least six inches above the wastewater main or lateral. Whenever possible, the crossing shall be centered between the joints of the wastewater main or lateral. If the existing wastewater main or lateral shows signs of leaking, it shall be replaced for at least nine feet in both directions (18 feet total) with at least 150 psi pressure rated pipe.
 - Where a new potable waterline crosses a new, non-pressure rated wastewater main or lateral and the standard pipe segment length of the wastewater main or lateral is at least 18 feet, one segment of the waterline pipe shall be centered over the wastewater main or lateral such that the joints of the waterline pipe are equidistant and at least nine feet horizontally from the centerline of the wastewater main or lateral. The potable waterline shall be at least two feet above the wastewater main or lateral. Whenever possible, the crossing shall be centered between the joints of the wastewater main or lateral. The wastewater pipe shall have a minimum pipe stiffness of 115 psi at 5.0% deflection. The wastewater main or lateral shall be embedded in cement stabilized sand (see clause (v) of this subparagraph) for the total length of one pipe segment plus 12 inches beyond the joint on each end.
 - Where a new potable waterline crosses a new, non-pressure rated wastewater main or lateral and a standard length of the wastewater pipe is less than 18 feet in length, the potable water pipe segment shall be centered over the wastewater line. The materials and method of installation shall conform with one of the following options.
 - Within nine feet horizontally of either side of the waterline, the wastewater pipe and joints shall be constructed with pipe material having a minimum pressure rating of at least 150 psi. An absolute minimum vertical separation distance of two feet shall be provided. The wastewater main or lateral shall be located below the waterline.
 - All sections of wastewater main or lateral within nine feet horizontally of the waterline shall be encased in an 18-foot (or longer) section of pipe. Flexible encasing pipe shall have a minimum pipe stiffness of 115 psi at 5.0% deflection. The encasing pipe shall be centered on the waterline and shall be at least two nominal pipe diameters larger than the wastewater main or lateral. The space around the carrier pipe shall be supported at five-foot (or less) intervals with spacers or be filled to the springline with washed sand. Each end of the casing shall be sealed with watertight non-shrink cement grout or a manufactured watertight seal. An absolute minimum separation distance of six inches between the encasement pipe and the waterline shall be provided. The waterline line shall be located below the waterline.
 - When a new waterline crosses under a wastewater main or lateral, the waterline shall be encased as described for wastewater mains or laterals in subclause (i) of this clause or constructed of ductile iron or steel pipe with mechanical or welded joints as appropriate. An absolute minimum separation distance of one foot between the waterline and the wastewater main or lateral shall be provided. Both the waterline and wastewater main or lateral must pass a pressure and leakage test as specified in AWWA C600 standards.
 - Where a new potable waterline crosses a new, pressure rated wastewater main or lateral, one segment of the waterline pipe shall be centered over the wastewater line such that the joints of the waterline pipe are equidistant and at least nine feet horizontally from the center line of the wastewater main or lateral. The potable waterline shall be at least six inches above the wastewater main or lateral. Whenever possible, the crossing shall be centered between the joints of the wastewater main or lateral. The wastewater pipe shall have a minimum pressure rating of at least 150 psi. The wastewater main or lateral shall be embedded in cement stabilized sand (see clause (v) of this subparagraph) for the total length of one pipe segment plus 12 inches beyond the joint on each end.
 - Where cement stabilized sand bedding is required, the cement stabilized sand shall have a minimum of 10% cement per cubic yard of cement stabilized sand mixture, based on loose dry weight volume (at least 2.5 bags of cement per cubic yard of mixture). The cement stabilized sand bedding shall be a minimum of six inches above and four inches below the wastewater main or lateral. The use of brown coloring in cement stabilized sand for wastewater main or lateral bedding is recommended for the identification of pressure rated wastewater mains during future construction.

NOTE:

All backfill for utilities and pavement including lime stabilized subgrade to be +2% or higher of optimum moisture.

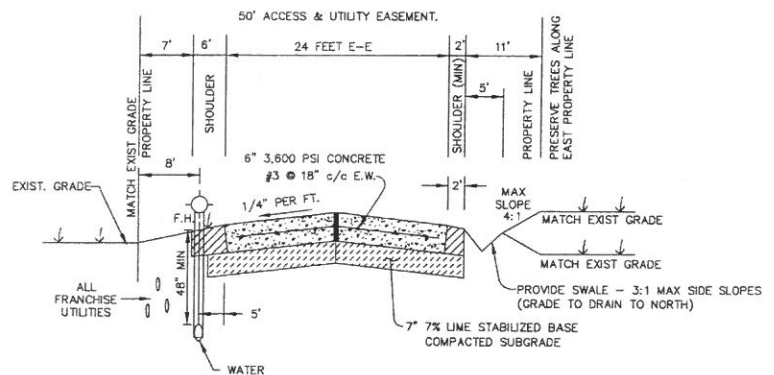

TYPICAL PAVING SECTION
(24 E-E CONCRETE STREET)
(LOOKING NORTH)

SITE BENCHMARK:
An 'X' cut in top of curb at the southwest corner of the intersection of Stonegate Drive and Forest Grove Road. ELEV.=580.44



ENGINEERING / PROJECT MANAGEMENT /
CONSTRUCTION SERVICES - FIRM REG. #F-001145
201 WINDCO CIR, STE 200, WYLLIE, TX 75098
972-941-8400 FAX: 972-941-8401 WWW.ECDLP.COM

REVISIONS:	
DRAWN: DENNY	DATE: 16-Jul-13
CHECKED: TW	DATE: 24-Jul-13
PROJECT NO: 08360	
DWG FILE NAME: 8360 GEN NOTES SECT.DWG	




THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF CONSTRUCTION. THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY TODD D. WINTTERS, P.E. 87085



GENERAL NOTES AND ROAD SECTION
ELLA BROOKE ESTATES

CITY OF LUCAS, COLLIN COUNTY, TEXAS

SHEET
4
OF
11

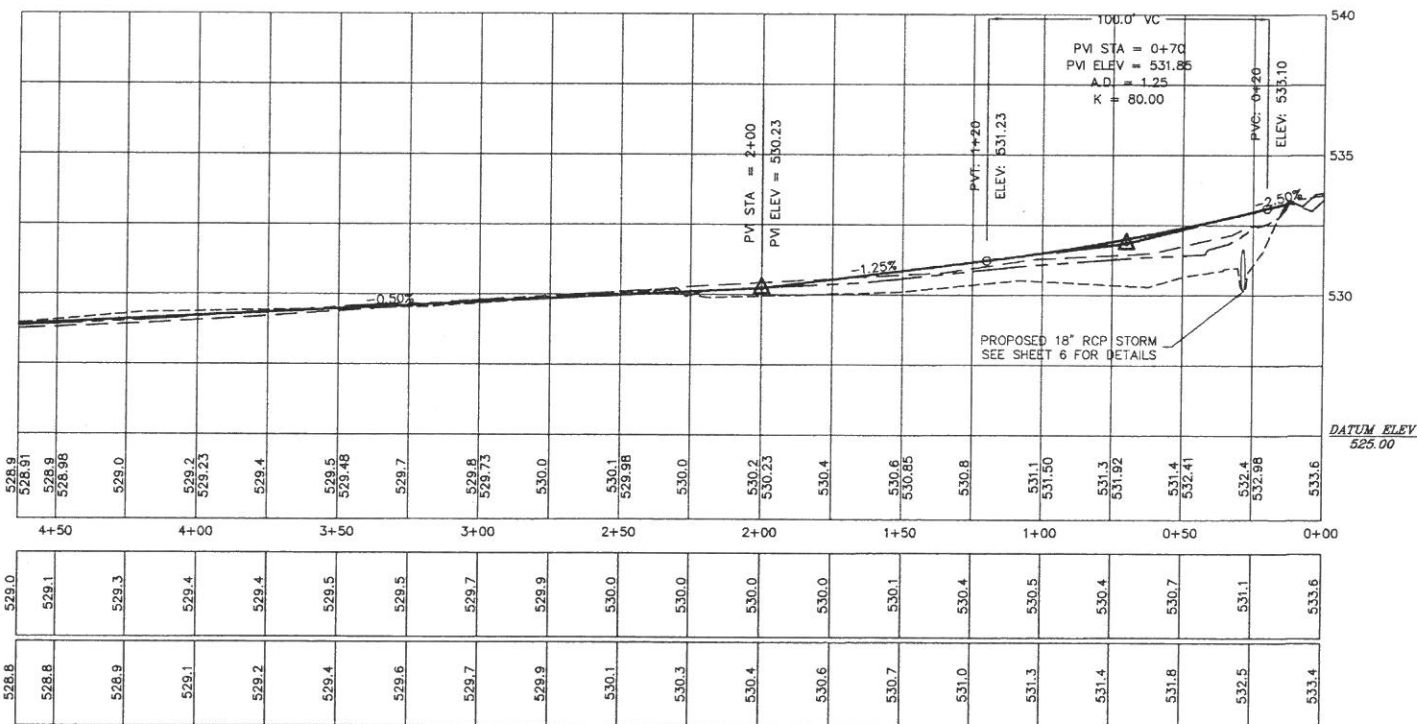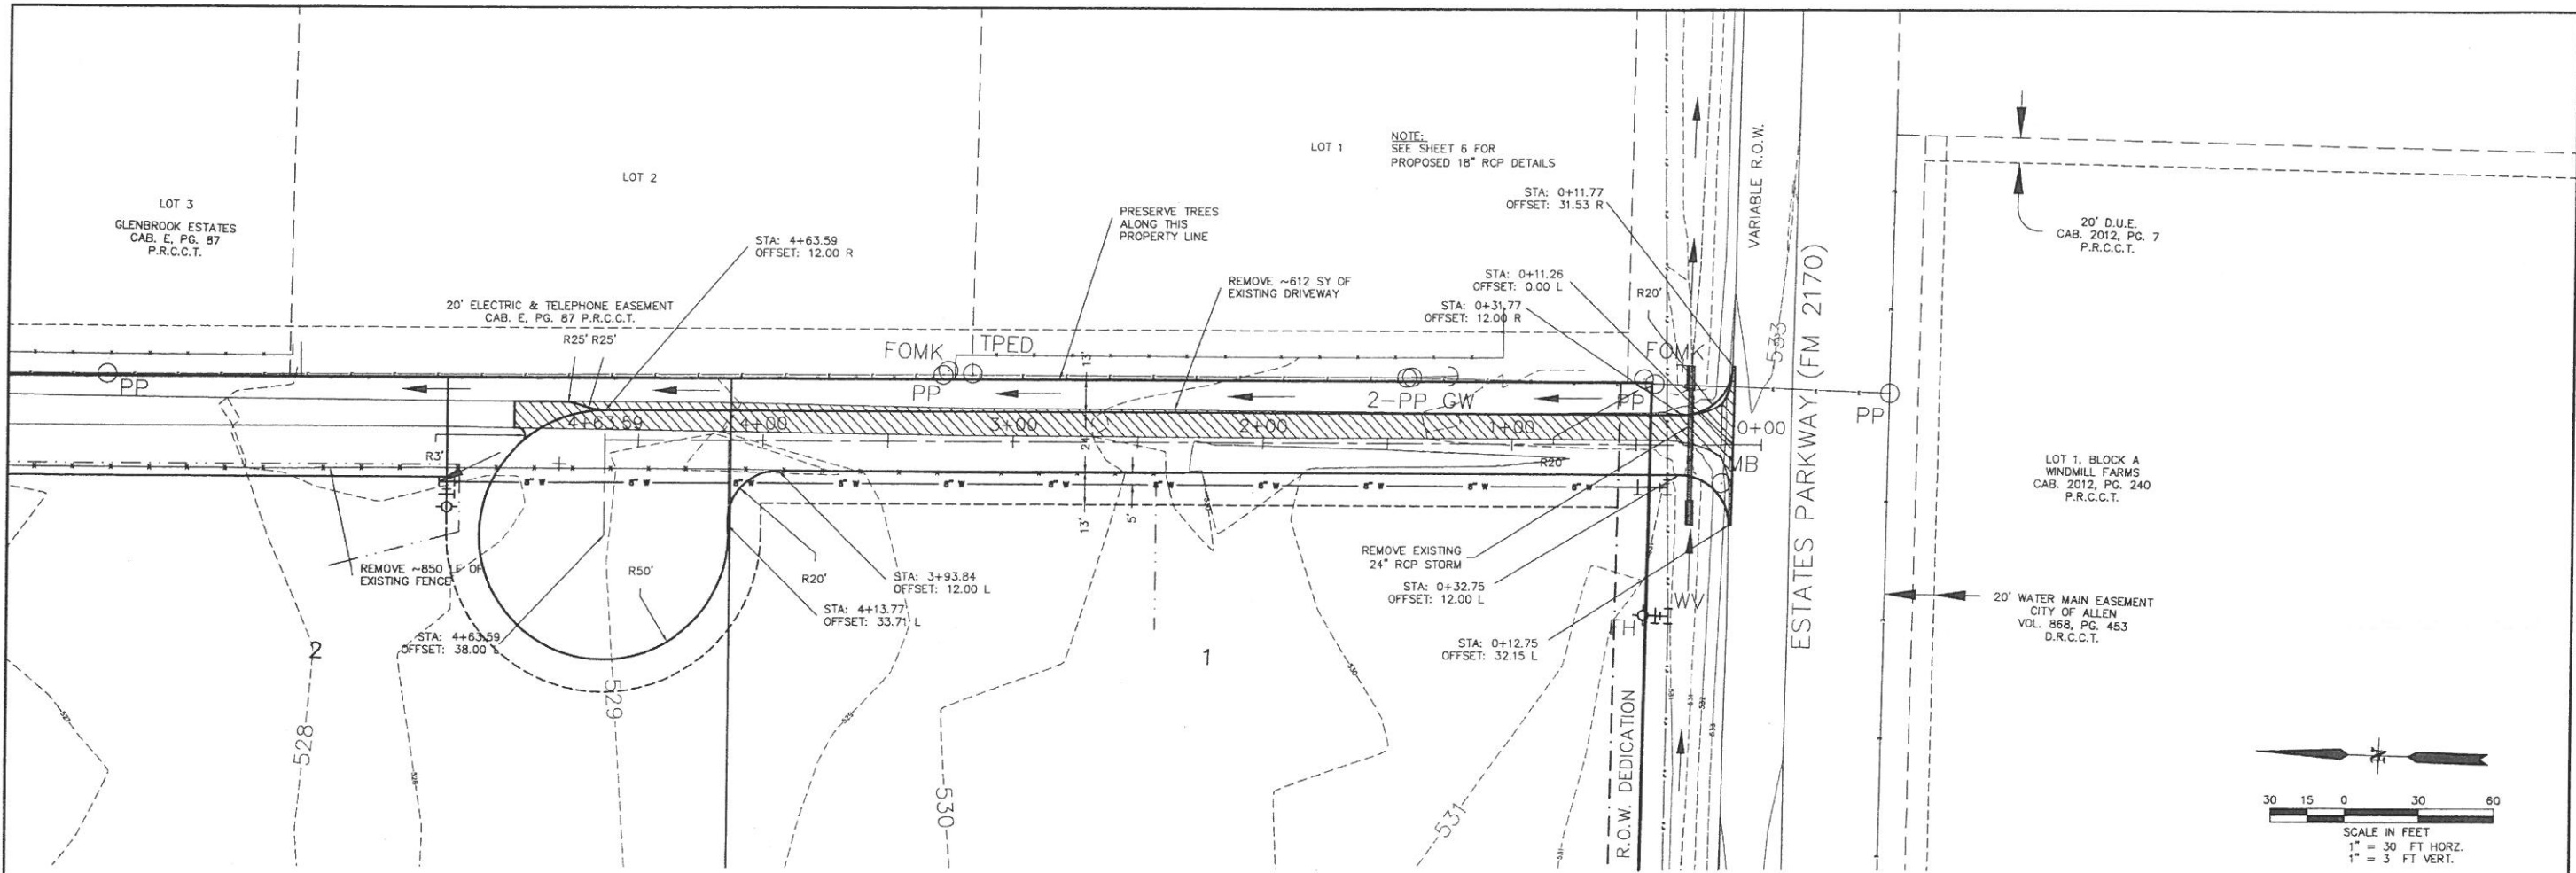

SITE BENCHMARK:
An 'X' cut in top of curb at the southwest corner of the intersection of Stonegate Drive and Forest Grove Road. ELEV.=580.44

ENGINEERINGCONCEPTS
& DESIGN, L.P.

ENGINEERING / PROJECT MANAGEMENT /
CONSTRUCTION SERVICES - FIRM REG. #F-001145
201 WINDCO CIR, STE 200, WYLIE, TX 75098
972-941-8400 FAX: 972-941-8401 WWW.ECDLP.COM


REVISIONS:

DRAWN: DENNY	DATE: 17-Jul-13
CHECKED: TW	DATE: 24-Jul-13
PROJECT NO: 08360	
DWG FILE NAME: 8360 PAVING.DWG	

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF CONSTRUCTION. THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY TODD D. WINTTERS, P.E. 87085


**KENZIE LANE 0+00 TO END
ELLA BROOKE ESTATES
PAVING - PLAN & PROFILE**

SHEET
5
OF
11

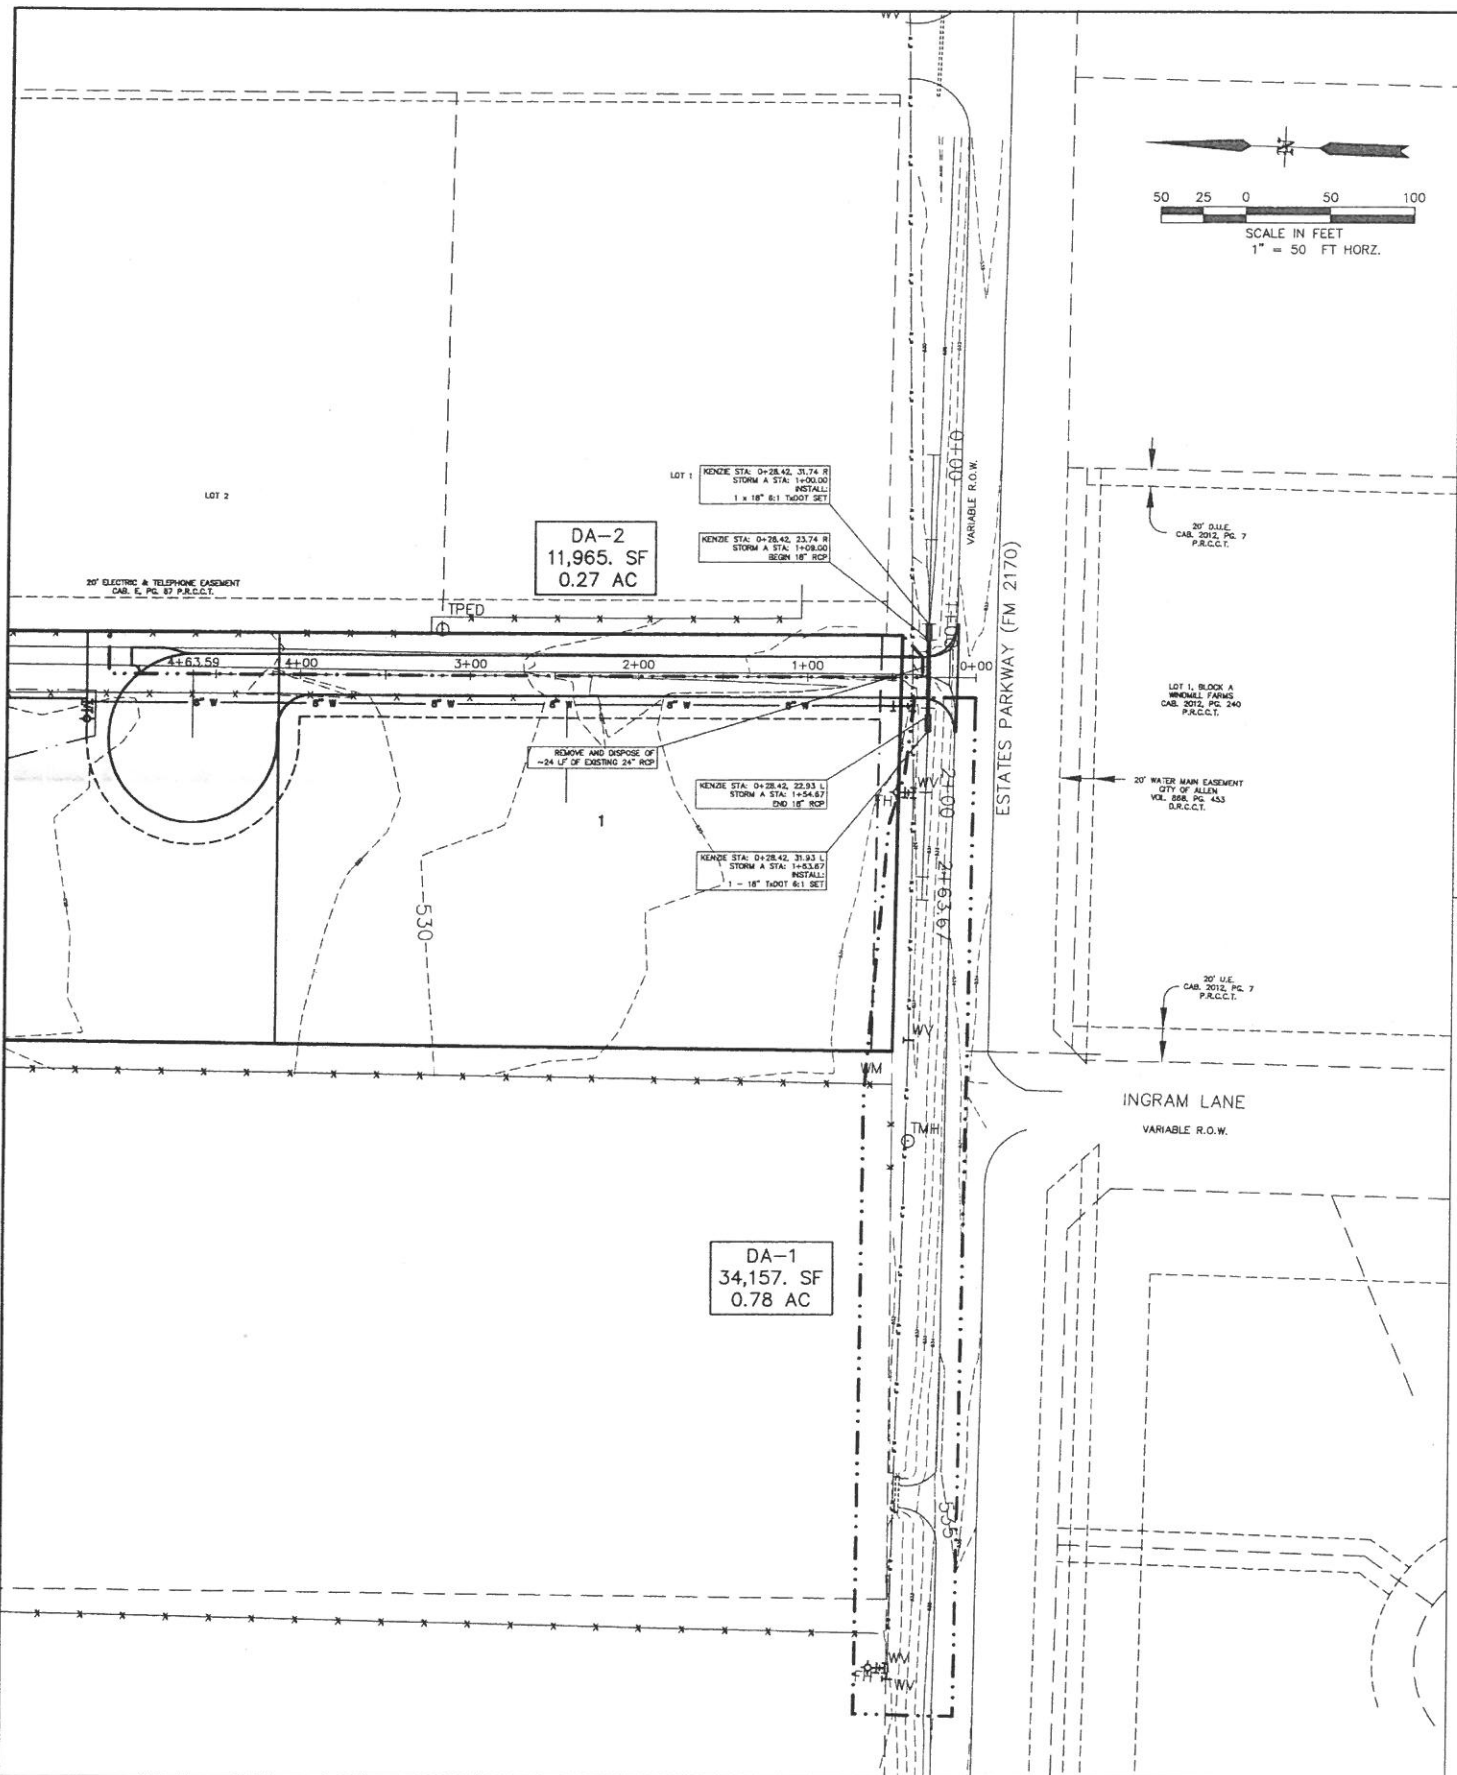

Drainage Area Table for Ella Brooke Estates

Area #	Area (Ft ²)	Area (Acres)	T _c (min)	C	I ₁₀₀ (In/hr)	Q ₁₀₀ (cfs)	RCP Size for		Main Line			
							Main Line	n (0.009=PVC) (0.013=RCP)	Slope (%)	Q _{exp} (Ft ³ /sec)	V _{act} (Ft/sec)	(S _r)
1	34,157.00	0.78	15	0.55	9.60	4.12	18	0.013	0.50%	7.45	4.21	0.000000
2	11,965.00	0.27	15	0.55	9.60	1.42	18	0.013	0.50%	0.89	0.89	0.000000

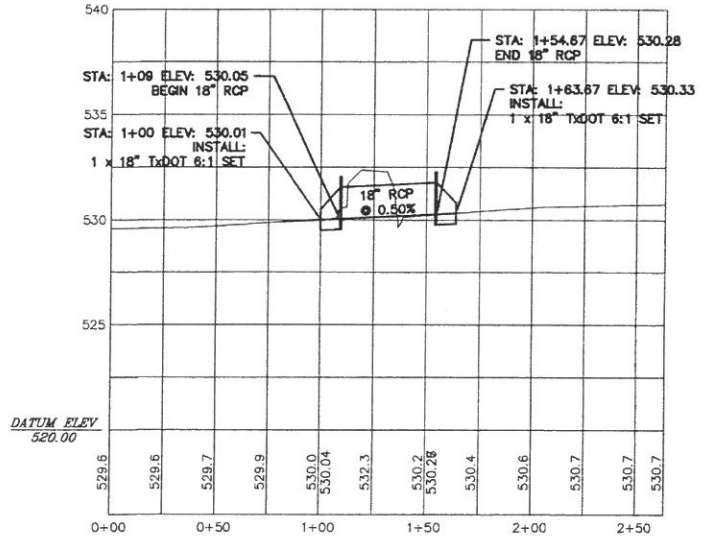

SITE BENCHMARK:
An 'X' cut in top of curb at the southwest corner of the intersection of Stonegate Drive and Forest Grove Road. ELEV.=580.44



ENGINEERING / PROJECT MANAGEMENT / CONSTRUCTION SERVICES - FIRM REG. #F-001145
201 WINDCO CIR, STE 200, WYLIE, TX 75098
972-941-8400 FAX: 972-941-8401 WWW.ECDLP.COM



REVISIONS	
DRAWN: DENNY	DATE: 17-Jul-13
CHECKED: TW	DATE: 24-Jul-13
PROJECT NO.: 08360	
DWG FILE NAME: 8360 DRAINAGE AREA MAP DWG	

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF CONSTRUCTION. THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY TODD D. WINTTERS, P.E. 87085



**DRAINAGE AREA MAP
ELLA BROOKE ESTATES**

CITY OF LUCAS, COLLIN COUNTY, TEXAS

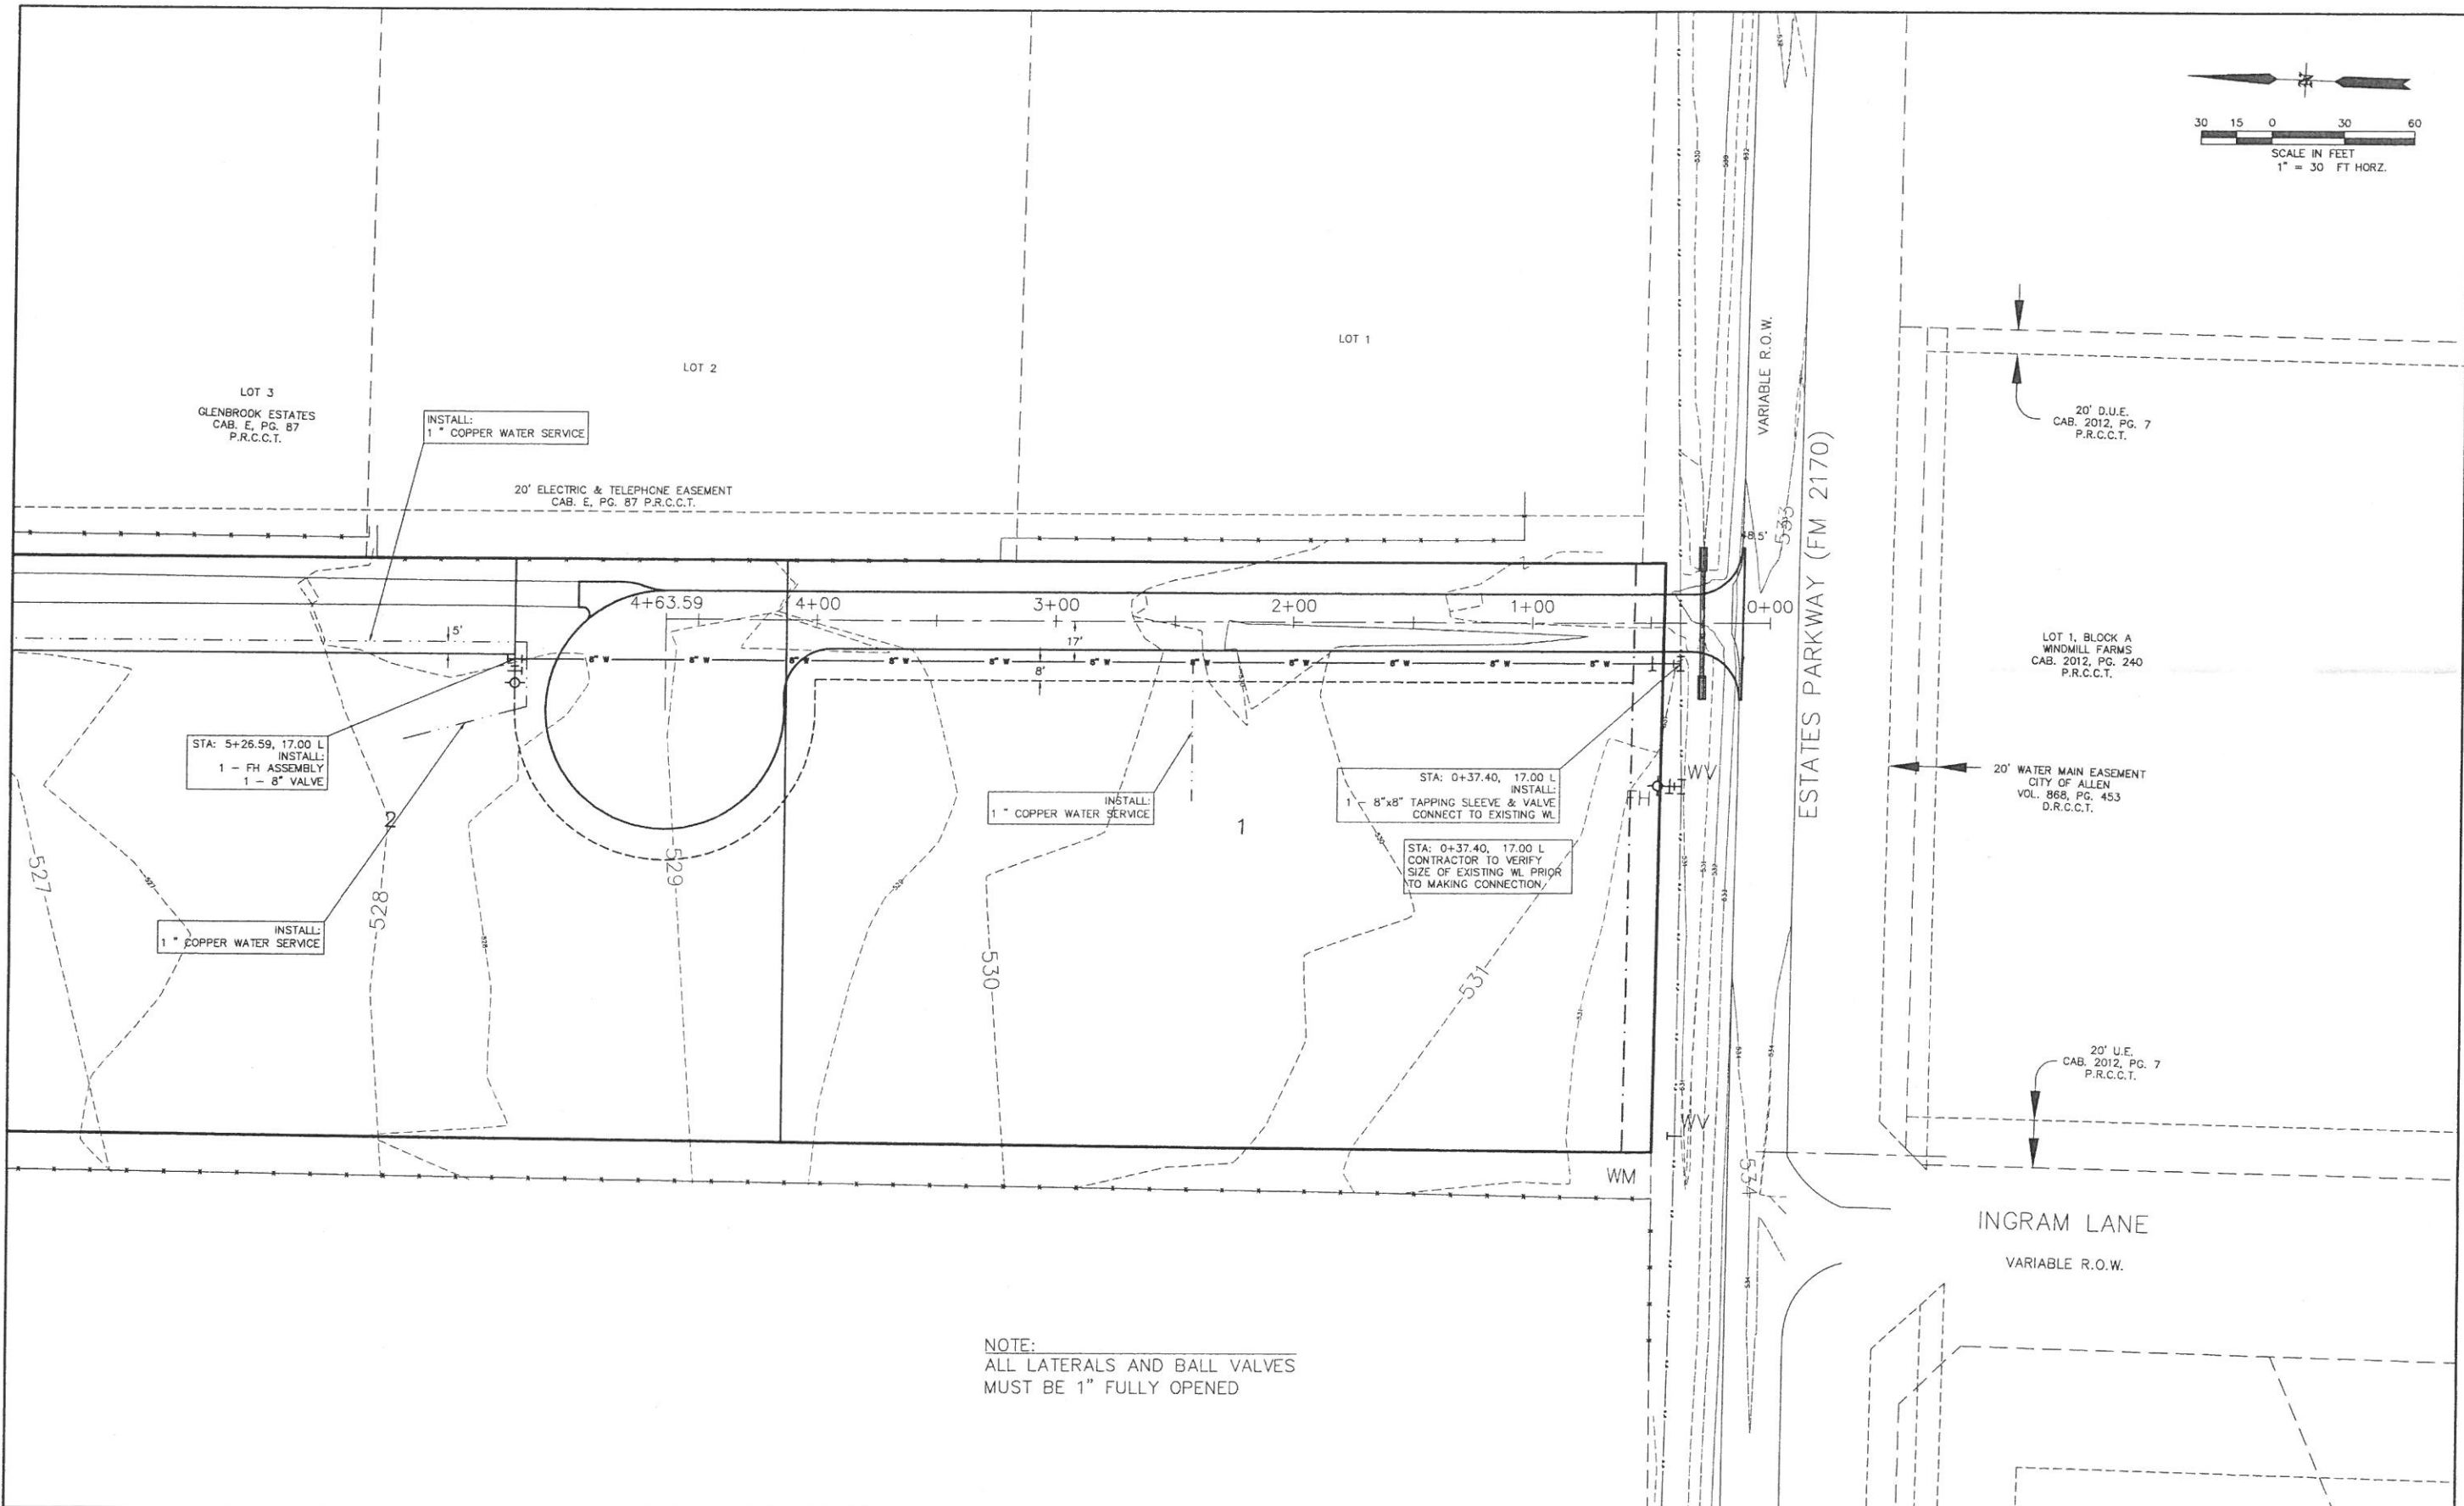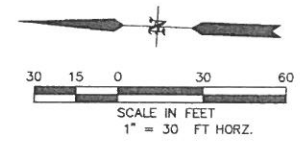

NOTE:
ALL LATERALS AND BALL VALVES
MUST BE 1" FULLY OPENED

SITE BENCHMARK:
An 'X' cut in top of curb at the southwest corner of
the intersection of Stonegate Drive and Forest Grove
Road. ELEV.=580.44

ENGINEERINGCONCEPTS
& DESIGN, L.P.

ENGINEERING / PROJECT MANAGEMENT /
CONSTRUCTION SERVICES - FIRM REG. #F-001145
201 WINDCO CIR, STE 200, WYLIE, TX 75098
972-941-8400 FAX: 972-941-8401 WWW.ECDLP.COM


REVISIONS:	
DRAWN: DENNY	DATE: 24-Jul-13
CHECKED: TW	DATE: 24-Jul-13
PROJECT NO.: 08360	
DWG FILE NAME: 8360 WATER.DWG	

THIS DOCUMENT IS RELEASED FOR
THE PURPOSE OF CONSTRUCTION.
THE SEAL APPEARING ON THIS
DOCUMENT WAS AUTHORIZED BY
TODD D. WINTTERS, P.E. 87085


WATER PLAN
ELLA BROOKE ESTATES

CITY OF LUCAS, COLLIN COUNTY, TEXAS

SHEET
7
OF
11



PLAN OF PLUG THRUST BLOCK
N.T.S.



PLAN OF TEE THRUST BLOCK
N.T.S.

REFER TO STD. DWG. No. 4040 FOR GENERAL NOTES.

LD (IN.)	T (IN.)	Δ = 11.25°	Δ = 22.50°	E (FT.)
4.68	0.4	1.5	1.9	8.9
10.12	0.5	1.5	1.2	
16.18	0.8	1.5	1.8	
20	0.7	1.5	1.8	
24	0.8	1.5	1.9	2.1
30	2.8	1.5	1.9	2.4
36	4.5	1.5	2.3	3.3
42	5.0	1.8	2.8	3.8
48	5.5	2.0	3.0	4.3
54	6.0	2.3	3.4	4.8
60	6.5	2.5	3.8	5.3
66	6.8	2.8	4.1	5.7
72	7.5	3.0	4.5	6.3
78	7.5	3.3	4.9	6.7
84	8.0	3.5	5.3	7.2
90	8.5	3.8	5.6	7.7
96	9.0	4.0	6.0	8.2

LD (IN.)	T (IN.)	Δ = 11.25°	Δ = 22.50°	E (FT.)
4.68	0.4	1.0	1.0	0.1
10.12	0.6	2.2	1.5	0.1
16.18	0.8	3.5	2.0	0.2
20	0.9	4.2	2.3	0.3
24	1.1	4.9	2.6	0.4
30	1.4	5.6	3.0	0.4
36	1.7	6.3	3.4	0.5
42	2.0	7.0	3.8	0.5
48	2.2	7.8	4.2	0.6
54	2.5	8.5	4.6	0.6
60	2.8	9.2	5.0	0.7
66	3.1	10.0	5.4	0.7
72	3.4	10.7	5.8	0.8
78	3.7	11.5	6.2	0.8
84	4.0	12.2	6.6	0.9
90	4.3	13.0	7.0	0.9
96	4.6	13.7	7.4	1.0


LD (IN.)	T (IN.)	Δ = 11.25°	Δ = 22.50°	E (FT.)
4.68	0.4	1.0	1.0	0.1
10.12	0.6	2.2	1.5	0.1
16.18	0.8	3.5	2.0	0.2
20	0.9	4.2	2.3	0.3
24	1.1	4.9	2.6	0.4
30	1.4	5.6	3.0	0.4
36	1.7	6.3	3.4	0.5
42	2.0	7.0	3.8	0.5
48	2.2	7.8	4.2	0.6
54	2.5	8.5	4.6	0.6
60	2.8	9.2	5.0	0.7
66	3.1	10.0	5.4	0.7
72	3.4	10.7	5.8	0.8
78	3.7	11.5	6.2	0.8
84	4.0	12.2	6.6	0.9
90	4.3	13.0	7.0	0.9
96	4.6	13.7	7.4	1.0

TABLES OF DIMENSIONS AND QUANTITIES

LD (IN.)	T (IN.)	Δ = 30°	Δ = 45°	E (FT.)
4.68	1.0	2.6	2.0	1.5
10.12	1.5	4.0	3.0	2.0
16.18	2.2	5.2	4.0	2.8
20	2.4	5.8	4.5	3.0
24	2.9	6.4	5.0	3.3
30	3.4	7.0	5.5	3.6
36	3.8	7.6	6.0	3.9
42	4.2	8.2	6.5	4.2
48	4.6	8.8	7.0	4.5
54	5.0	9.4	7.5	4.8
60	5.4	10.0	8.0	5.1
66	5.8	10.6	8.5	5.4
72	6.2	11.2	9.0	5.7
78	6.6	11.8	9.5	6.0
84	7.0	12.4	10.0	6.3
90	7.4	13.0	10.5	6.6
96	7.8	13.6	11.0	6.9

LD (IN.)	T (IN.)	Δ = 67.50°	Δ = 90°	E (FT.)
4.68	2.1	3.6	3.0	2.0
10.12	3.1	5.2	4.5	3.0
16.18	4.1	6.8	6.0	4.0
20	4.2	7.4	6.5	4.2
24	4.3	8.0	7.0	4.4
30	4.4	8.6	7.5	4.6
36	4.5	9.2	8.0	4.8
42	4.6	9.8	8.5	5.0
48	4.7	10.4	9.0	5.2
54	4.8	11.0	9.5	5.4
60	4.9	11.6	10.0	5.6
66	5.0	12.2	10.5	5.8
72	5.1	12.8	11.0	6.0
78	5.2	13.4	11.5	6.2
84	5.3	14.0	12.0	6.4
90	5.4	14.6	12.5	6.6
96	5.5	15.2	13.0	6.8

TABLES OF DIMENSIONS AND QUANTITIES

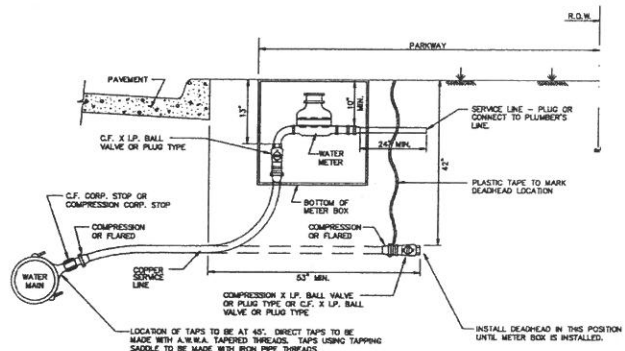


WATER SERVICE INSTALLATION
3/4" OR 1" LINE

INSTALL DEADHEAD IN THIS POSITION UNLESS METEER BOX IS INSTALLED.

LOCATION OF TAPS TO BE AT 45° DIRECT TAPS TO BE MADE WITH A WELDED TAPPED SADDLE. TAPS USING TAPPING SADDLE TO BE MADE WITH COPPER THREADS.


NOTE: LOCATION OF METER BOX WITHIN PARKWAY SHALL BE SPECIFIED BY OWNER. IF THE LOCATION INTERFERES WITH SIDEWALK, METER BOX SHALL BE PLACED IN THE CENTER OF SIDEWALK.

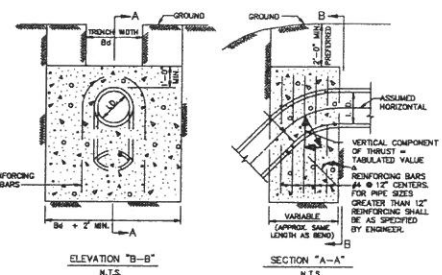


VERTICAL THRUST BLOCK AT PIPE BEND
N.T.S.

LD (IN.)	T (IN.)	Δ = 11.25°	Δ = 22.50°	Δ = 30°	Δ = 45°	Δ = 67.50°	Δ = 90°	E (FT.)
4.68	1.0	2.6	2.0	1.5	3.8	1.8	4.8	2.5
10.12	1.5	4.0	3.0	2.2	5.2	2.8	6.6	3.3
16.18	2.2	5.2	4.0	3.2	6.6	3.8	8.0	4.1
20	2.4	5.8	4.5	3.6	7.2	4.2	8.8	4.5
24	2.9	6.4	5.0	4.0	7.8	4.6	9.6	4.9
30	3.4	7.0	5.5	4.4	8.4	5.0	10.4	5.3
36	3.8	7.6	6.0	4.8	9.0	5.4	11.2	5.7
42	4.2	8.2	6.5	5.2	9.6	5.8	12.0	6.1
48	4.6	8.8	7.0	5.6	10.2	6.2	12.8	6.5
54	5.0	9.4	7.5	6.0	10.8	6.6	13.6	6.9
60	5.4	10.0	8.0	6.4	11.4	7.0	14.4	7.3
66	5.8	10.6	8.5	6.8	12.0	7.4	15.2	7.7
72	6.2	11.2	9.0	7.2	12.6	7.8	16.0	8.1
78	6.6	11.8	9.5	7.6	13.2	8.2	16.8	8.5
84	7.0	12.4	10.0	8.0	13.8	8.6	17.6	8.9
90	7.4	13.0	10.5	8.4	14.4	9.0	18.4	9.3
96	7.8	13.6	11.0	8.8	15.0	9.4	19.2	9.7

VERTICAL THRUST BLOCK AT PIPE BEND
N.T.S.



SECTION X-X
N.T.S.

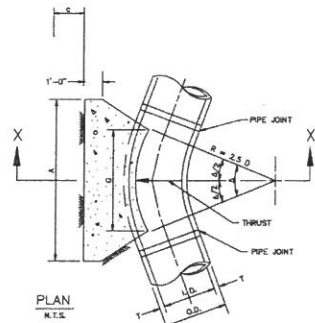


PLAN
N.T.S.

REFER TO STD. DWG. No. 4040 FOR GENERAL NOTES.


GENERAL NOTES FOR ALL THRUST BLOCKS:

- CONCRETE FOR BLOCKING SHALL BE CLASS "B".
- ALL CALCULATIONS ARE BASED ON INTERNAL PRESSURE OF 200 PSI FOR DUCTILE IRON, P.V.C., AND 150 PSI FOR CONCRETE PIPE.
- VOLUMES OF THRUST BLOCKS ARE NET VOLUMES OF CONCRETE TO BE FURNISHED. THE CORRESPONDING WEIGHT OF THE CONCRETE (CLASS "B") IS EQUAL TO OR GREATER THAN THE VERTICAL COMPONENT OF THE THRUST ON THE VERTICAL BEND.
- WALL THICKNESS (T) ASSUMED HERE FOR ESTIMATING PURPOSES ONLY.
- POUR CONCRETE FOR BLOCK AGAINST UNDISTURBED EARTH.
- DIMENSIONS MAY BE VARIED AS REQUIRED BY FIELD CONDITIONS WHERE AND AS DIRECTED BY THE ENGINEER. THE VOLUME OF CONCRETE BLOCKING SHALL NOT BE LESS THAN SHOWN HERE.
- THE SOIL BEARING PRESSURES ARE BASED ON 1000 LBS./S.F. IN SOIL AND 2000 LBS./S.F. IN ROCK.
- USE POLYETHYLENE WRAP OR EQUAL BETWEEN CONCRETE AND BEND, TEE, OR PLUG TO PREVENT THE CONCRETE FROM STICKING TO IT.
- CONCRETE SHALL NOT EXTEND BEYOND JOINTS.

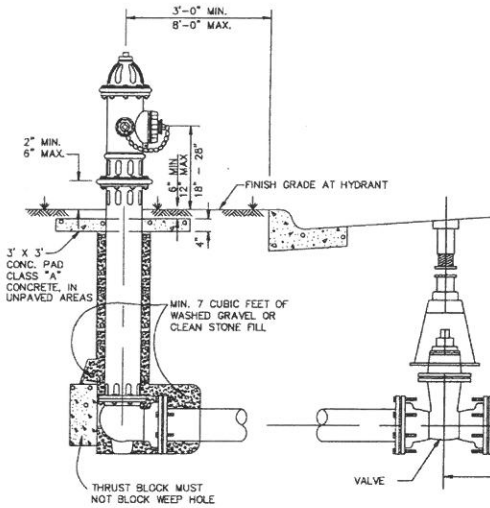

FIRE HYDRANT INSTALLATION
N.T.S.

NOTE: IN UNPAVED AREAS, INSTALL 2' x 2' x 6" CONCRETE VALVE PAD FLUSH WITH THE TOP OF VALVE BOX. REINFORCE WITH #3 BARS ON 6" CENTERS BOTH WAYS.

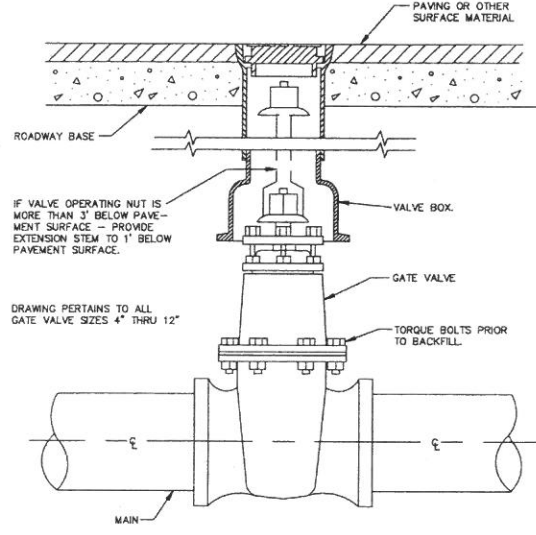

GATE VALVE BOX AND EXTENSION STEM
N.T.S.

- GRANULAR MATERIAL (SAND) COMPACTED TO 95% STANDARD PROCTOR DENSITY.
- SELECT MATERIAL FREE OF ROCKS, CLUMPS OR DEBRIS LARGER THAN 6" IN GREATEST DIMENSION. COMPACT TO 90% STANDARD PROCTOR DENSITY. UNDER STRUCTURES, ROADWAYS AND PAVEMENT, EXCLUDE MATERIAL WITH LL >50 COMPACT TO 90% STANDARD PROCTOR DENSITY. GRANULAR MATERIAL MUST BE WELL GRADED.

SIZE OF PIPE IN INCHES DIA.	KIND OF PIPE	EXTERNAL DIA. (B) IN INCHES	TRENCH WIDTH (W) IN INCHES
6"	PVC SEWER PIPE	6.28	24
8"	PVC SEWER PIPE	8.16	24
10"	PVC SEWER PIPE	10.2	26

WATER EMBEDMENT
CLASS "B+"
(per NCTCOG Standards)

ENGINEERINGCONCEPTS
& DESIGN, L.P.
ENGINEERING / PROJECT MANAGEMENT /
CONSTRUCTION SERVICES - FIRM REG. #F-001145
201 WINDCO CIR, STE 200, WYLLIE, TX 75098
972-941-8400 FAX: 972-941-8401 WWW.ECDLP.COM


REVISIONS:

DRAWN: DENNY DATE: 24-Jul-13
CHECKED: TW DATE: 24-Jul-13
PROJECT NO: 08360
DWG FILENAME: 8360 DETAILS.DWG

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF CONSTRUCTION. THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY TODD D. WINTTERS, P.E. 87085




WATER DETAILS
ELLA BROOKE ESTATES
CITY OF LUCAS, COLLIN COUNTY, TEXAS

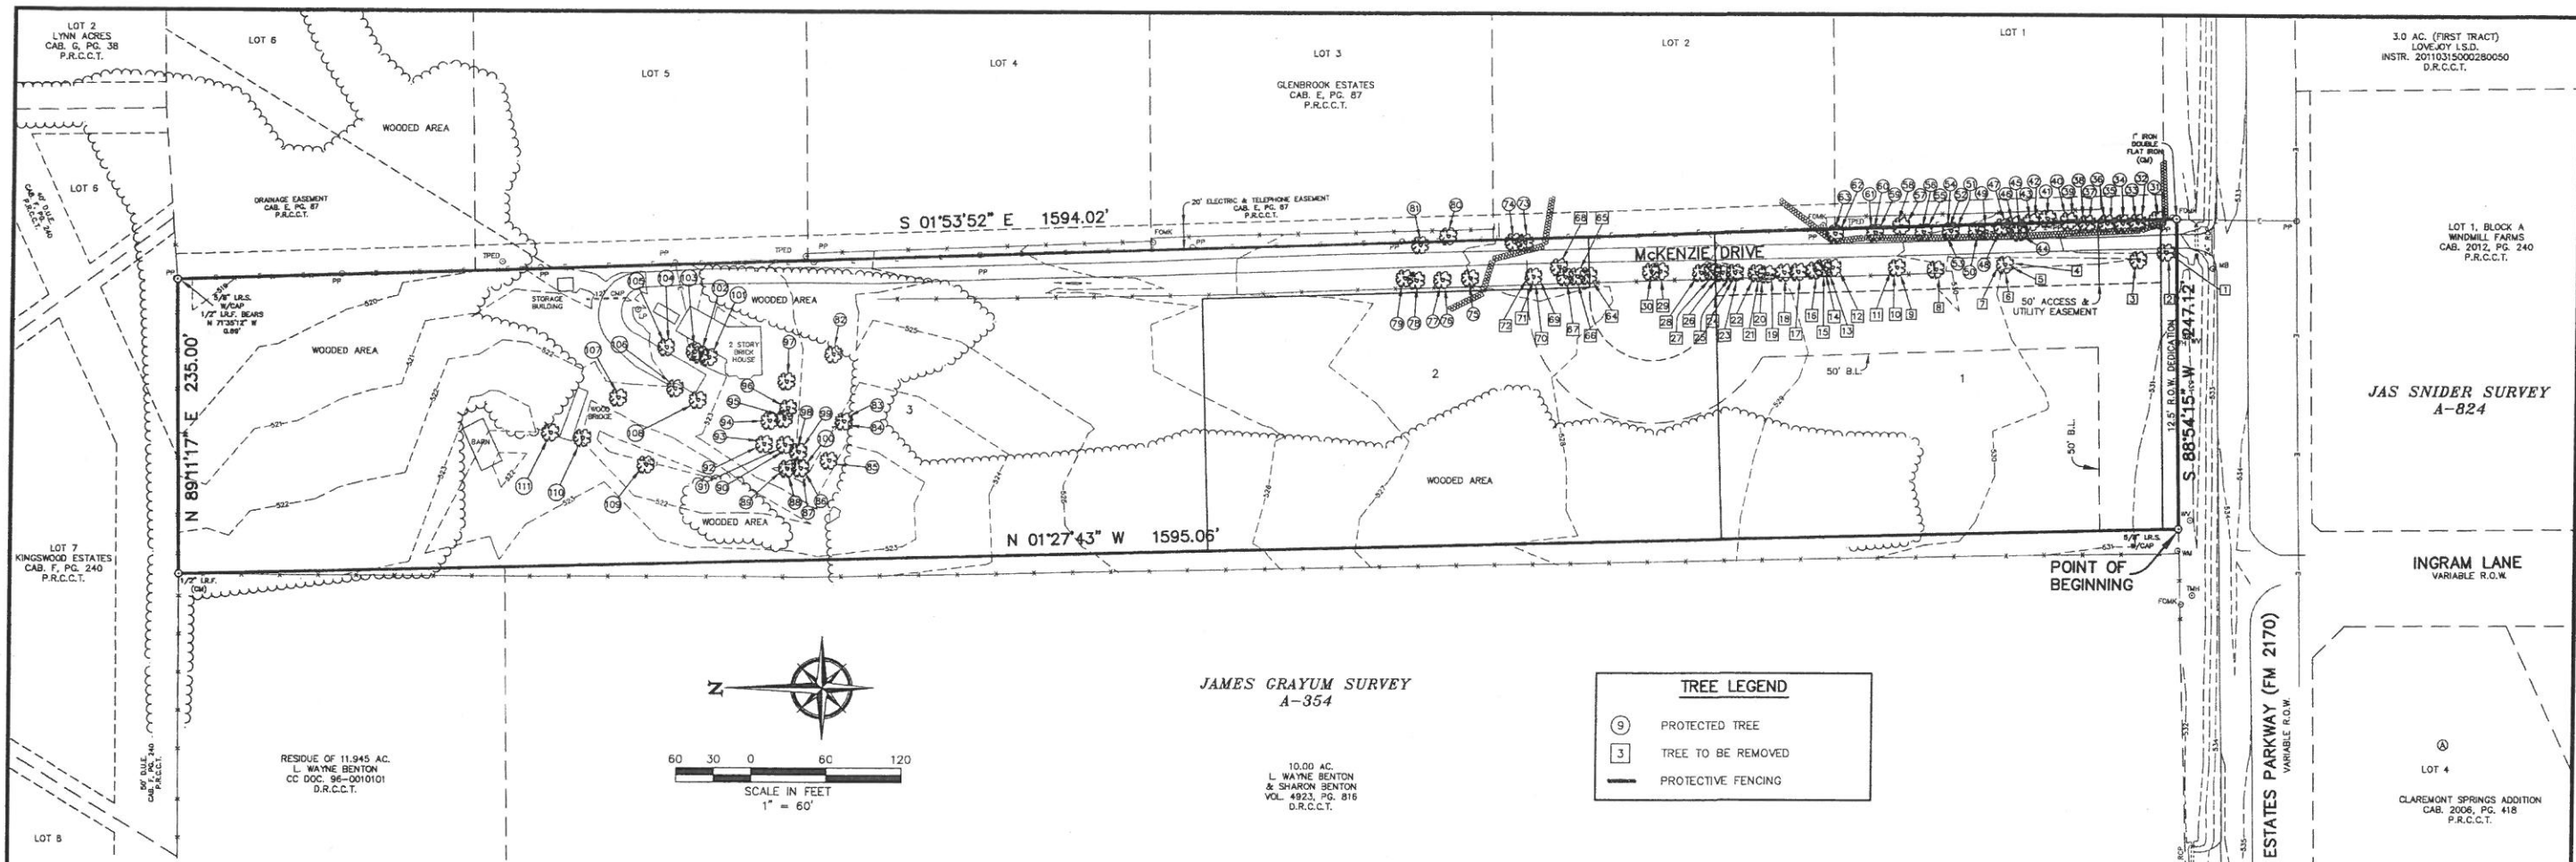

LEGEND

5/8" I.R.S. W/CAP	5/8" IRON ROD SET WITH YELLOW CAP STAMPED "RPLS 3963"
I.R.F.	IRON ROD FOUND
D.U.E.	DRAINAGE & UTILITY EASEMENT
U.E.	UTILITY EASEMENT
D.E.	DRAINAGE EASEMENT
B.L.	BUILDING SETBACK LINE
(CM)	CONTROLLING MONUMENT
D.R.C.C.T.	DEEDS RECORDS COLLIN COUNTY TEXAS
P.R.C.C.T.	PLAT RECORDS COLLIN COUNTY TEXAS




TREE LEGEND

⊙	PROTECTED TREE
⊠	TREE TO BE REMOVED
—	PROTECTIVE FENCING

TREE CHART

No.	Protect / Remove	Species	Size	No.	Protect / Remove	Species	Size	No.	Protect / Remove	Species	Size
1	Remove	Hackberry	12"	38	Protect	Hackberry	6"	75	Protect	Hackberry	8"
2	Remove	Hackberry	11"	39	Protect	Hackberry	14"	76	Protect	Bois D'Arc	6"
3	Remove	Bois D'Arc	16"	40	Protect	Hackberry	8"	77	Protect	Hackberry	8"
4	Remove	Hackberry	8"	41	Protect	Hackberry	6"	78	Protect	Hackberry	14"
5	Remove	Hackberry	12"	42	Protect	Hackberry	6"	79	Protect	Hackberry	8"
6	Remove	Hackberry	8"	43	Protect	Elm	14"	80	Protect	Hackberry	15"
7	Remove	Hackberry	12"	44	Protect	Hackberry	6"	81	Protect	Hackberry	24"
8	Remove	Hackberry	10"	45	Protect	Hackberry	6"	82	Protect	Hackberry	14"
9	Remove	Hackberry	8"	46	Protect	Hackberry	6"	83	Protect	Oak	8"
10	Remove	Hackberry	8"	47	Protect	Hackberry	10"	84	Protect	Oak	7"
11	Remove	Hackberry	10"	48	Protect	Hackberry	8"	85	Protect	Elm	7"
12	Remove	Hackberry	8"	49	Protect	Hackberry	6"	86	Protect	Elm	21"
13	Remove	Hackberry	8"	50	Protect	Hackberry	6"	87	Protect	Elm	35"
14	Remove	Hackberry	9"	51	Protect	Hackberry	6"	88	Protect	Elm	15"
15	Remove	Hackberry	9"	52	Protect	Hackberry	6"	89	Protect	Elm	17"
16	Remove	Elm	8"	53	Protect	Hackberry	8"	90	Protect	Elm	15"
17	Remove	Elm	6"	54	Protect	Hackberry	6"	91	Protect	Elm	15"
18	Remove	Elm	14"	55	Protect	Hackberry	10"	92	Protect	Elm	21"
19	Remove	Elm	8"	56	Protect	Hackberry	10"	93	Protect	Elm	18"
20	Remove	Hackberry	8"	57	Protect	Hackberry	8"	94	Protect	Elm	50"
21	Remove	Elm	6"	58	Protect	Hackberry	6"	95	Protect	Elm	64"
22	Remove	Hackberry	8"	59	Protect	Hackberry	8"	96	Protect	Elm	6"
23	Remove	Elm	10"	60	Protect	Hackberry	10"	97	Protect	Hackberry	40"
24	Remove	Elm	6"	61	Protect	Hackberry	10"	98	Protect	Elm	22"
25	Remove	Elm	6"	62	Protect	Hackberry	12"	99	Protect	Elm	33"
26	Remove	Elm	5"	63	Protect	Hackberry	6"	100	Protect	Elm	19"
27	Remove	Elm	6"	64	Remove	Elm	8"	101	Protect	Hackberry	14"
28	Remove	Elm	6"	65	Remove	Hackberry	8"	102	Protect	Hackberry	8"
29	Remove	Hackberry	6"	66	Remove	Hackberry	8"	103	Protect	Hackberry	20"
30	Remove	Elm	32"	67	Remove	Elm	6"	104	Protect	Hackberry	12"
31	Protect	Hackberry	6"	68	Remove	Hackberry	6"	105	Protect	Hackberry	10"
32	Protect	Hackberry	6"	69	Remove	Hackberry	12"	106	Protect	Hackberry	10"
33	Protect	Hackberry	8"	70	Remove	Bois D'Arc	10"	107	Protect	Hackberry	36"
34	Protect	Hackberry	14"	71	Remove	Hackberry	18"	108	Protect	Hackberry	10"
35	Protect	Hackberry	8"	72	Remove	Bois D'Arc	10"	109	Protect	Bois D'Arc	38"
36	Protect	Hackberry	12"	73	Protect	Bois D'Arc	10"	110	Protect	Bois D'Arc	24"
37	Protect	Hackberry	8"	74	Protect	Bois D'Arc	10"	111	Protect	Bois D'Arc	36"

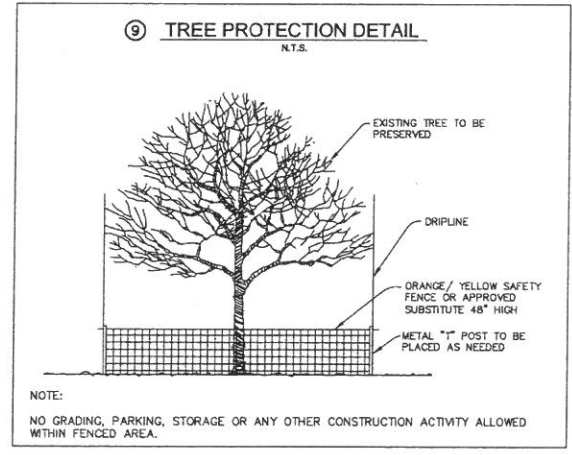

The following activities are prohibited within the limits of the primary root zone of any protected tree subject to the requirements of City Ordinance A - Section 41-115.

- Material Storage.** No materials intended for use in construction or waste materials shall be placed within the limits of the primary root zone of any protected tree.
- Equipment cleaning/ liquid disposal.** No cleaning or other liquids shall be deposited or allowed to flow overland within the limits of the primary root zone of a protected tree. This includes, but is not limited to, paint, oil, solvents, asphalt, concrete, mortar or similar materials.
- Tree attachments.** No signs, wires or other attachments, other than those of a protective nature, shall be attached to any protected tree.
- Construction equipment / vehicular traffic.** Unless otherwise approved by the Landscape Administrator, no vehicular and / or construction equipment traffic or parking shall take place within the limits of the primary root zone of any protected tree other than on existing street pavement. This restriction does not apply to single incident access within the primary root zone for purposes of clearing underbrush, establishing the building pad and associated lot grading, vehicular traffic necessary for routine utility maintenance, emergency restoration of utility service, or routine mowing operations. No heavy equipment, including but not limited to trucks, tractors, trailers, bulldozers, and bobcat tractors, shall be allowed inside the drip-line of any protected tree on any construction site without the specific approval of the Landscape Administrator.
- Grade changes.** Unless specifically allowed by this Section, no grade changes shall be allowed within the limits of the primary root zone of any protected tree unless the Landscape Administrator and/or the City Engineer approves adequate construction methods.
- Impervious paving near non-exempt trees.** Unless a health, safety and welfare issue arises due to access and circulation requirements, no paving with asphalt, concrete or other impervious materials may be placed within seventy-five percent (75%) of the limits of the primary root zone of a protected tree except as otherwise allowed in this Section.

NOTES:

- By graphical plotting, the parcel described hereon does not lie within a Special Flood Hazard Area, as delineated on the Collin County, Texas and Incorporated Areas, Flood Insurance Rate Map, Map Number 4805SC0405, dated June 02, 2009, as published by the Federal Emergency Management Agency.
- Bearings are based on Texas State Plane Coordinates. Projection: State Plane NAD83 Texas North Central Zone 4202, Lambert Conformal Conic, Feet (TX83-NCF).

OWNER/DEVELOPER
SCOTT ALLEN ROGERS & MARIFRANCES KELLY ROGERS
1800 MONACO DR
ALLEN, TX 75002-2691

TREE SURVEY & PRESERVATION PLAN
ELLA BROOKE ESTATES
LOTS 1-3, BLOCK A
3 RESIDENTIAL LOTS
BEING 8.823 ACRES
SITUATED IN THE
JAMES GRAYUM SURVEY, ABSTRACT NO. 354
CITY OF LUCAS, COLLIN COUNTY, TEXAS

ENGINEERING CONCEPTS & DESIGN, L.P.
ENGINEERING/PROJECT MANAGEMENT/CONSTRUCTION SERVICES
TEXAS STATE REG. NO. 001148
201 WINDCO CIRCLE, SUITE 250, WYLER, TEXAS 75098
(972) 941-8400 FAX (972) 941-8401

