GENERAL NOTES FOR ALL ELECTRICAL WORK

- The location of all conduits, junction boxes, ground boxes, and electrical services is diagrammatic and may be shifted to accommodate field conditions.
- 2. Provide new and unused materials. Ensure that all materials and installations comply with the applicable articles of the National Electrical Code (NEC), TxDOT standards and specifications, National Electrical Manufacturers Association (NEMA), and are listed by Underwriters Laboratories (UL) or a Nationally Recognized Testing Lab (NRTL). NRTLs such as Canadian Standard Association (CSA), Intertek Testing Services NA Inc., or FM Approvals LLC can be considered equivalent to UL. Where reference is made to NEMA listed devices, International Electrotechnical Commission (IEC) listed devices will not be considered an acceptable equal to a NEMA listed device. Acceptable devices may have both a NEMA and IEC listing. Faulty fabrication or poor workmanship in any material, equipment, or installation is justification for rejection. Replace or reinstall rejected material or equipment at no additional cost to the Department.
- 3. Miscellaneous nuts, bolts and hardware, except for high strength bolts, may be stainless steel when plans specify galvanized, provided the bolt size is $\frac{1}{2}$ in. or less in diameter.
- 4. Provide the following test equipment as required by the Engineer to confirm compliance with the contract and the NEC: voltmeter, ammeter, megohm meter (1000 volt DC), ground resistance tester, torque wrenches, and torque screwdrivers. Ensure all equipment has been properly calibrated within the last year. Provide calibration certification to the Engineer upon request. Operate test equipment during inspection as requested by the Engineer.
- 5. Install grounding as shown on the plans and in accordance with the NEC. Ensure all metallic conduits; metal poles; luminaires; and metal enclosures are bonded to the equipment grounding conductor. Provide stranded bare copper or green insulated grounding conductors. Ground rods, connectors, and bonding jumpers are subsidiary to the various bid items.
- 6. When required by the Engineer, notify the Department in writing of materials from the Material Producers List (MPL) intended for use on each project. Prequalified materials are listed on the MPL on TxDOT's website under "Roadway Illumination and Electrical Supplies." No substitutions will be allowed for materials on this list.

CONDUIT

A. MATERIALS

- 1. Provide conduit, junction boxes, fittings, and hardware as per TxDOT Departmental Material Specification (DMS) 11030 "Conduit" and Item 618 "Conduit" of TxDOT's "Standard Specifications For Construction And Maintenance Of Highways, Streets, And Bridges," latest edition. Provide conduits listed under Item 618 on the MPL under "Roadway Illumination and Electrical Supplies. Provide conduit types according to the descriptive code or as shown on the plans. Do not substitute other types of conduits for those shown. Provide liquidtight flexible metal conduit (LFMC) when flexible conduit is called for on galvanized steel rigid metallic conduit (RMC) systems. Provide liquidtight flexible nonmetallic conduit (LFNC) when flexible conduit is called for on polyvinyl chloride (PVC) systems.
- 2. Provide galvanized steel RMC for all exposed conduits, unless otherwise shown on the plans. Properly bond all metal conduits.
- Unless otherwise shown on the plans, provide junction boxes with a minimum size as shown in the following table, which applies to the greatest number of conductors entering the box through one conduit with no more than four conduits per box. When a mixture of conductor sizes is present, count the conductors as if all are of the larger size. For situations not applicable to the table, size junction boxes in accordance with NEC.

AWG	3 CONDUCTORS	5 CONDUCTORS	7 CONDUCTORS
#1	10" x 10" x 4"	12" x 12" x 4"	16" x 16" x 4"
#2	8" × 8" × 4"	10" x 10" x 4"	12" x 12" x 4"
#4	8" × 8" × 4"	10" x 10" x 4"	10" x 10" x 4"
#6	8" × 8" × 4"	8" × 8" × 4"	10" x 10" x 4"
#8	8" × 8" × 4"	8" × 8" × 4"	8" × 8" × 4"

- 4. Junction boxes with an internal volume of less than 100 cu. in. and supported by entering raceways must have threaded entries or hubs identified for the intended purpose and supported by connection of two or more rigid metal conduits. Secure conduit within 3 ft. of the enclosure or within 18 in. of the enclosure if all conduit entries are on the same side. Mechanically secure all junction boxes with an internal volume greater than 100 cu. inches.
- Provide hot dipped galvanized cast iron or sand cast aluminum outlet boxes for junction boxes containing only 10 AWG or 12 AWG conductors. Do not use die cast aluminum boxes. Size outlet boxes according to the NEC.
- 6. Do not use intermediate metal conduit (IMC) or electrical metallic tubing (EMT) unless specifically required by the plan sheets. When EMT is called for, provide junction boxes made from galvanized steel sheeting, listed and approved for outdoor use, unless otherwise noted on the plans. Size all galvanized steel junction boxes in accordance with the NEC. Provide junction boxes for IMC conduit systems that meet the same requirements for junction boxes used with RMC systems.
- 7. Provide PVC junction boxes intended for outdoor use on PVC conduit systems, unless otherwise noted on the plans.

- 8. Provide PVC elbows in PVC conduit systems, unless otherwise shown on the plans. Use only a flat, high tensile strength polyester fiber pull tape for pulling conductors through the PVC conduit system. When galvanized steel RMC elbows are specifically called for in the plans and any portion of the RMC elbow is buried less than 18 in., ground the RMC elbow by means of a grounding bushing on a rigid metal extension. Grounding of the rigid metal elbow is not required if the entire RMC elbow is encased in a minimum of 2 in. of concrete. PVC extensions are allowed on these concrete encased rigid metal elbows. RMC or PVC elbows are subsidiary to various bid items.
- 9. When required, provide High-Density Polyethylene (HDPE) conduit with factory installed internal conductors according to Item 622 "Duct Cable." At the Contractor's request and with approval by the Engineer, substitute HDPE conduit with no conductors for bored schedule 40 or schedule 80 PVC conduit bid under Item 618. Ensure bored HDPE substituted for PVC is schedule 40 and of the same size PVC called for in the plans. Ensure the substituted HDPE meets the requirements of Item 622, except that the conduit is supplied without factory-installed conductors. Make the transition of the HDPE conduit to PVC (or RMC elbow when required) at the bore pit. Provide conduit of the size and schedule as shown on the plans. Do not extend substituted conduit into ground boxes or foundations. Provide PVC or galvanized steel RMC elbows as called for at all ground boxes and foundations.
- 10. Use two-hole straps when supporting 2 in. and larger conduits. On electrical service poles, properly sized stainless steel or hot dipped galvanized one-hole standoff straps are allowed on the service riser conduit.
- B. CONSTRUCTION METHODS
- 1. Provide and install expansion joint conduit fittings on all structure-mounted conduits at the structure's expansion joints to allow for movement of the conduit. In addition, provide and install expansion joint fittings on all continuous runs of galvanized steel RMC conduit externally exposed on structures such as bridges at maximum intervals of 150 ft. When requested by the project Engineer, supply manufacturer's specification sheet for expansion joint conduit fittings. Repair or replace expansion joint fittings that do not allow for movement at no additional cost to the Department. Provide the method of determining the amount of expansion to the Engineer upon request. Do not use LFMC or LFNC as a substitute for the required expansion conduit fittings.
- 2. Space all conduit supports at maximum intervals of 5 ft. Install conduit spacers when attaching metal conduit to surface of concrete structures. See "Conduit Mounting Options" on ED(2). Install conduit support within 3 ft. of all enclosures and conduit terminations.
- 3. Do not attach conduit supports directly to pre-stressed concrete beams except as shown specifically in the plans or as approved by the Engineer.
- 4. Unless otherwise shown on the plans, jack or bore conduit placed beneath existing roadways, driveways, sidewalks, or after the base or surfacing operation has begun. Backfill and compact the bore pits below the conduit per Item 476 "Jacking, Boring, or Tunneling Pipe or Box" prior to installing conduit or duct cable to prevent bending of the connections.
- 5. When placing conduit in the sub-grade of new roadways, backfill all trenches with excavated material unless otherwise noted on the plans. When placing conduit in the sub-base of new roadways, backfill all trenches with cement-stabilized base as per requirements of Items 110 "Excavation", 400 "Excavation and Backfill for Structures", 401 "Flowable Backfill", 402 "Trench Excavation Protection", and 403 "Temporary Special Shoring."
- 6. Provide and place warning tape approximately 10 in. above all trenched conduit as per Item 618.
- 7. During construction, temporarily cap or plug open ends of all conduit and raceways immediately after installation to prevent entry of dirt, debris and animals. Temporary caps constructed of durable duct tape are allowed. Tightly fix the tape to the conduit opening. Clean out the conduit and prove it clear in accordance with Item 618 prior to installing any conductors.
- 8. Ensure conduit entry into the top of any enclosure is waterproof by installing conduit sealing hubs or using boxes with threaded bosses. This includes surface mounted safety switches, meter cans, service enclosures, auxiliary enclosures and junction boxes. Grounding bushings on water tight sealing hubs are not required.
- 9. Fit the ends of all PVC conduit terminations with bushings or bell end fittings. Provide and install a grounding type bushing on all metal conduit terminations.
- 10. Install a bonding jumper from each grounding bushing to the nearest ground rod, grounding lug, or equipment grounding conductor. Ensure all bonding jumpers are the same size as the equipment grounding conductor. Bonding of conduit used as a casing under roadways for duct cable is not required, if the duct extends the full length through the casing.
- 11. At all electrical services, install a 6 AWG solid copper grounding electrode conductor.
- 12. Place conduits entering ground boxes so that the conduit openings are between 3 in. and 6 in. from the bottom of the box. See the ground box detail on sheet ED(4).
- 13. Seal ends of all conduits with duct seal, expandable foam, or by other methods approved by the Engineer. Seal conduit immediately after completion of conductor installation and pull tests. Do not use duct tape as a permanent conduit sealant. Do not use silicone caulk as a conduit sealant.
- 14. File smooth the cut ends of all mounting strut and conduit. Before installing, paint the field cut ends of all mounting strut and RMC (threaded or non-threaded) with zinc rich paint (94% or more zinc content) to alleviate overspray. Use zinc rich paint to touch up galvanized material as allowed under Item 445 "Galvanizing," Do not paint non-galvanized material with a zinc rich paint as an alternative for materials required to be galvanized.



ELECTRICAL DETAILS CONDUITS & NOTES

Operation: Division Standard

ED(1) - 14

			-				
:	ed1-14.dgn	DN:		CK:	DW:		CK:
TxDOT	October 2014	CONT	SECT	JOB		н	SHWAY
	REVISIONS	1392	01	044		FM	1378
		DIST		COUNTY			SHEET NO.
		18		COLLIN			252

ELECTRICAL CONDUCTORS

- A. MATERIAL INFORMATION
- 1. Provide Type XHHW insulated conductors in accordance with Departmental Material Specification (DMS)11040 "Conductors" and Item 620 "Electrical Conductors." Provide conductors as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies" Item 620. Color code insulated conductors in conformance with the NEC. Identify grounded (neutral) conductors with white insulation. Identify grounding conductors (ground wires) with green insulation or bare conductors. Identify ungrounded (hot) conductors with any color insulation except green, white, or gray. Keep color scheme consistent throughout the wiring system. Identify conductors 6 American Wire Gauge (AWG) and smaller by continuous color jacket. Identify electrical conductors 4 AWG and larger by continuous color jacket or by colored tape. When identifying conductors with colored tape, mark at least 6 in. of the conductor's insulation with half laps of tape.
- 2. Provide a solid copper 6 AWG grounding electrode conductor to bond the electrical service equipment to the concrete encased grounding electrode or the ground rod at the service location. Connect the grounding electrode conductor to the ground rod with a UL listed connector in accordance with DMS 11040. Connect the grounding electrode conductor to the concrete encased grounding electrode as shown in the plans.
- 3. Where two or more circuits are present in one conduit or enclosure, permanently identify the conductors of each branch circuit by attaching a non-metallic tag around both circuit conductors at each accessible location. Provide tags with two straps, large enough to indicate circuit number, letter, or other identification as shown in the plans. Print circuit identification on the tag with a permanent marker.
- 4. Use listed compression or screw type pressure connectors, terminal blocks, or split bolt connectors for splicing as specified in DMS 11040. Use hot melt adhesive tape to fill the gap and seal the ends of heat shrink tubing. Provide UL listed gel-filled insulating splice covers. Splicing materials, insulating materials, breakaway disconnects, splice covers, and fuse holders are subsidiary to various bid items.
- B. CONSTRUCTION METHODS
- 1. Use only a flat, high tensile strength polyester fiber pull tape for pulling conductors through the conduit system. After installing conductors in conduit, perform conductor pull test. If a conductor cannot be freely pulled, make any needed alterations or repairs at no additional cost to the department. Perform insulation resistance tests in accordance with Item 620. Coordinate with the Engineer to witness the tests.
- Leave 2 ft. minimum, 3 ft. maximum length for each conductor up to the splice in ground boxes. Leave 3 ft. minimum, 4 ft. maximum length of conductor in ground boxes when pulled through with no splice. Leave 1 ft. minimum, 1.5 ft. maximum length of conductor at enclosures, weatherheads and pole bases.
- 3. Make splices only in junction boxes, ground boxes, pole bases, or electrical enclosures and use only listed compression or screw type pressure connectors, terminal blocks, or split bolt connectors. Insulate splices with heavy wall heat shrink tubing or gel-filled insulating splice covers to provide a watertight splice. Overlap conductor insulation with heat shrink tubing a minimum of 2 in. past both sides of the splice. Where heat shrink tubing may not shrink sufficiently to provide a watertight seal around the individual conductors, prior to heating the tubing, increase the diameter of the conductor insulation using hot melt adhesive tape to provide a watertight seal between the individual conductors and the heat shrink tubing. Ensure the tape extends past the heat shrink tubing. Use hot melt adhesive tape to fill the gap and seal the ends of heat shrink tubing. Heat shrink tubing that appears to have been burned, or overheated, is considered defective and must be replaced.
- Size and install gel-filled insulating splice covers according to manufacturer's specifications when used in place of heat shrink tubing.
- 5. Wire nuts with factory applied waterproof sealant may be used for 8 AWG or smaller conductors in above ground junction boxes, but not in pole bases or ground boxes. Install wire nuts in an upright position to prevent the accumulation of water.
- 6. Support conductors in illumination poles with a J-hook at the top of the pole.
- 7. When terminating conductors, remove the insulation and jacketing material without nicking the individual strands of the conductor. Conductors with nicked individual conductor strands or removed strands will be considered damaged.
- 8. Replace conductors and cables that are damaged beyond repair or that fail an insulation resistance test at no additional cost to the department.
- Do not repair damaged conductors with duct tape, electrical tape, or wire nuts. Use only approved splicing methods.
- 10. Do not terminate more than one conductor under a single connector, unless the connector is rated for multiple conductors. Do not exceed the pressure connector's listing for maximum number and size of conductors allowed.
- 11. Install breakaway connectors on conductors bid under Item 620 whenever those conductors pass through a breakaway support device. Follow manufacturer's instructions when terminating conductors to breakaway connectors. Properly torque threaded connections. Proper terminations are critical to the safe operation of breakaway devices. Trim waterproofing boots on breakaway connectors to fit snugly around the conductor to ensure waterproof connection. Only one conductor may enter a single opening in a boot. Provide waterproof boots with the correct number of openings. Leave unused openings factory sealed. Use prequalified breakaway connectors as shown on the MPL.

12. Provide and install a separate stranded equipment grounding conductor (EGC) in all conduits that contain circuit wiring of 50 volts or more. Unless shown elsewhere, size the EGC to be the same size as the largest current carrying conductor contained in the conduit. Ensure all EGCs are bonded together at every accessible location. For traffic signal installations, provide a minimum size 8 AWG EGC. The EGC is paid for under Item 620.

C. TEMPORARY WIRING


- Install temporary conductors and electrical equipment in accordance with the NEC article "Temporary Installations" and Department standard sheets.
- 2. Provide a ground fault circuit interrupter (GFCI) for power outlets for portable electrical equipment, power tools, ice machines, ice storage bins and refrigerators located outdoors at grade. GFCI may be any one of the following: molded cord and plug set, receptacle, or circuit breaker type.
- Use listed wire nuts with factory applied sealant for temporary wiring where approved.
- 4. Enclose conductor splices within a listed enclosure or ground box, or ensure the splices are more than 10 ft. above grade vertically and more than 5 ft. horizontally from any metal structure. Where installing temporary conductors in areas subject to vehicle traffic or mobile construction equipment, ensure the vertical clearance to ground is at least 18 ft. when measured at the lowest point. Ground messenger wires that support power conductors in conformance with the NEC.
- Protect and when necessary repair any existing electrical conduits uncovered during the construction process in a timely manner and in conformance with the NEC.


GROUND RODS & GROUNDING ELECTRODES

- A. MATERIAL INFORMATION
- Provide and install a grounding electrode at electrical services. Provide ground rods according to DMS 11040 and the plans. Larger diameter or longer length rods may be called for in some specific locations, see the individual plans sheets. Concrete encased grounding electrodes may be called for in specific locations including electrical service, see individual plan sheets.


B. CONSTRUCTION METHODS

- 1. Furnish auxiliary ground rods for lightning protection and install in soil, concrete, or both, as called for in the plans. For ground rods installed in concrete, ensure the connection of the conductor to the ground rod is readily accessible for inspection or repairs. For ground rods installed in soil, ensure that the upper end is between 2 to 4 in. below finished grade.
- 2. Do not place ground rods in the same drilled hole as a timber pole.
- Install ground rods so the imprinted part number is at the upper end of the rod.
- 4. Remove all non-conductive coatings such as concrete splatter from the rod at the clamp location.
- Route all conductors as short and straight as possible for connection to lightning protection ground rods. When a bend is required, ensure a minimum radius bend of four inches for these conductors.
- 6. Unless otherwise called for in the plans, protect grounding electrode conductors with non-metallic conduit. When protecting grounding electrode conductors with metal conduit, provide and install a grounding type bushing and properly sized bonding jumper on each end of the metal conduit.
- 7. Written authorization is required before installing a ground rod in a horizontal trench for rocky soil or a solid rock bottom.

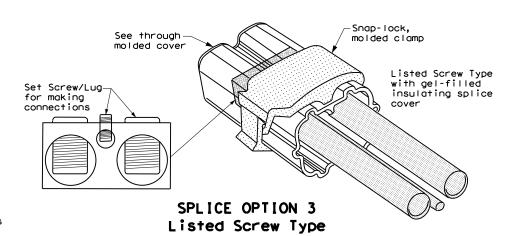


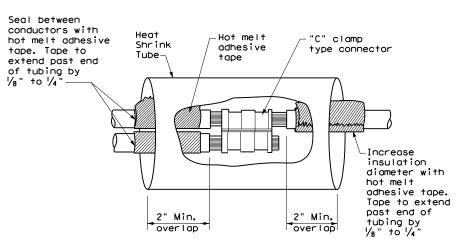


SPLICE OPTION 1 Compression Type

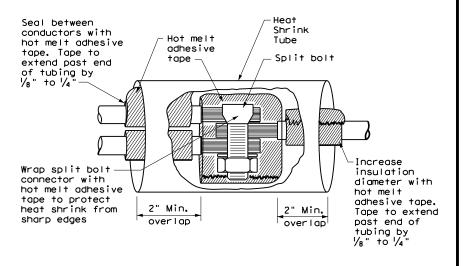

SPLICE OPTION 2 Split Bolt Type



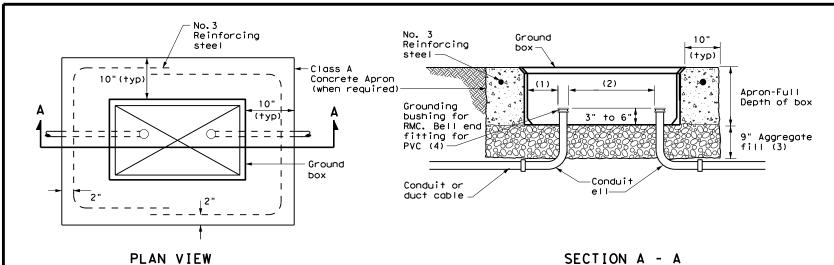


APRON FOR GROUND BOX

- (1) Uniformly space ends of conduits within the ground box. Position ends of conduits so that ground box walls do not interfere with the installation of grounding bushings or bell end fittings.
- (2) Maintain sufficient space between conduits to allow for proper installation of bushing.
- (3) Place aggregate under the box, not in the box. Aggregate should not encroach on the interior volume of the box.
- (4) Install a grounding bushing on the upper end of all RMC terminating in a ground box. Ground RMC elbows when any part of the elbow is less than 18 in. below the bottom of the ground box. Install a PVC bushing or bell end fitting on the upper end of all PVC conduits terminating in a ground box.

GROU	ND BOX DIMENSIONS
TYPE	OUTSIDE DIMENSIONS (INCHES) (Width x Length X Depth)
Α	12 X 23 X 11
В	12 X 23 X 22
С	16 X 29 X 11
D	16 X 29 X 22
E	12 X 23 X 17

	GROL	JND BO	ох со	VER D	IMENS	IONS		
TYPE			DIMEN	SIONS	(INCH	ES)		
ITPE	Н	I	J	К	L	М	N	Р
A, B & E	23 1/4	23	13 3/4	13 ½	9 %	5 1/8	1 3/8	2
C & D	30 ½	30 1/4	17 ½	17 1/4	13 1/4	6 3/4	1 3/8	2

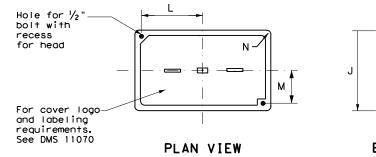

END SIDE

GROUND BOX COVER

GROUND BOXES

- A. MATERIALS
- Provide polymer concrete ground boxes measuring 16x30x24 in. (WxLxD) or smaller in accordance with Departmental Material Specification (DMS) 11070 "Ground Boxes" and Item 624 "Ground Boxes."
- 2. Provide Type A, B, C, D, and E ground boxes as shown in the plans, and as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies," Item 624.
- 3. Ensure ground box cover is correctly labeled in accordance with DMS 11070.
- 4. Provide larger ground boxes in accordance with Item 624 and as shown in the plans.
- B. CONSTRUCTION METHODS
- Remove all gravel and dirt from conduit. Cap all conduits prior to placing aggregate and setting ground box. Provide Grade 3 or 4 coarse aggregate as shown on Table 2 of Item 302 "Aggregates for Surface Treatments." Ensure aggregate bed is in place and at least 9 inches deep, prior to setting the ground box. Install ground box on top of aggregate.
- 2. Cast ground box aprons in place. Reinforcing steel may be field bent. Ensure the depth of concrete for the apron extends from finished grade to the top of the aggregate bed under the box. Ground box aprons, including concrete and reinforcing steel, are subsidiary to ground boxes when called for by descriptive code.
- 3. Keep bolt holes in the box clear of dirt. Bolt covers down when not working in ground boxes.
- 4. Install all conduits and ells in a neat and workmanlike manner. Uniformly space conduits so grounding bushings and bell end fittings can easily be installed.
- 5. Temporarily seal all conduits in the ground box until conductors are installed.
- 6. Permanently seal conduits immediately after the completion of conductor installation and pull tests. Permanently seal the ends of all conduits with duct seal, expandable foam, or other method as approved. Do not use duct tape as a permanent conduit sealant. Do not use silicone caulk as a sealant.
- 7. When a ground rod is present in a ground box, bond all equipment grounding conductors together and to the ground rod with listed connectors.
- 8. When a type B or D ground box is stacked to meet volume requirements, it is allowable to cut an appropriately sized hole for conduit entry in the side wall at least 18 inches below grade.
- 9. If an existing ground box in the contract has a metal cover, bond the cover to the equipment grounding conductor with a 3 ft. long stranded bonding jumper the same size as the grounding conductor. The bonding jumper is subsidiary to various bid items. Verify existing ground boxes with metal covers are shown on the plans, with notes fully describing the work required.
- 10. If other ground boxes with metal covers are within the project limits but are not part of the contract, the Engineer may direct the Contractor to bond the metal covers, identifying the specific boxes in writing. This work will be paid for separately.
- 11. Bond metal ground box covers to the grounding conductor with a tank ground type lug.



Traffic Operations Division Standard

ELECTRICAL DETAILS GROUND BOXES

ED(4)-14

FILE:	ed4-14.dgn	DN: Tx	DOT	CK: TXDOT DW: TXDO		TxDOT	ck: TxDOT
©TxD0T	October 2014	CONT	SECT	JOB		HIG	GHWAY
	REVISIONS	1392	01	044		FM	1378
		DIST		COUNTY			SHEET NO.
		18		COLLIN			254

ELECTRICAL SERVICES NOTES

- 1. Provide new materials. Ensure installation and materials comply with the applicable provisions of the National Electrical Code (NEC) and National Electrical Manufacturers Association (NEMA) standards. Ensure material is Underwriters Laboratories (UL) listed. Provide and install electrical service conduits, conductors, disconnects, contactors, circuit breaker panels, and branch circuit breakers as shown on the Electrical Service Data chart in the plans. Faulty fabrication or poor workmanship in material, equipment, or installation is justification for rejection. Where manufacturers provide warranties and guarantees as a customary trade practice, furnish these to the State.
- Provide electrical services in accordance with Electrical Details standard sheets, Departmental Material Specification (DMS) 11080 "Electrical Services, "DMS 11081 "Electrical Services-Type A," DMS 11082 "Electrical Services-Type C," DMS 11083 "Electrical Services-Type D," DMS 11084 "Electrical Services-Type T," DMS 11085 "Electrical Services-Pedestal (PS)", and Item 628 "Electrical Services" of the Standard Specifications. Provide electrical service types A, C, and D, as listed on the Material Producers List (MPL) on the Department web site under Illumination and Electrical Supplies," Item 628. Provide other service types as
- Provide all work, materials, services, and any incidentals needed to install a complete electrical service as specified in the plans.
- 4.Coordinate with the Engineer and the utility provider for metering and compliance with utility requirements. Primary line extensions, connection charges, meter charges, and other charges by the utility company to provide power to the location are paid for in accordance with Item 628. Get approval for the costs associated with these charges prior to engaging the utility company to do the work. Consult with the utility provider to determine costs and requirements, and coordinate the work as approved.
- 5. The enclosure manufacturer will provide Master Lock Type 2 with brass tumblers keyed #2195 for all custom electrical enclosures. Installing Contractor is to provide Master Lock #2195 Type 2 with brass tumblers for "off the shelf" enclosures. Master Lock #2195 keys and locks become property of the State. Unless otherwise approved, do not energize electrical service equipment until
- 6. Enclosures with external disconnects that de-energize all equipment inside the enclosure do not need a dead front trim. Protect incoming line terminations from incidental contact as required by the NEC.
- 7. When galvanized is specified for nuts, screws, bolts or miscellaneous hardware, stainless steel may be used.
- 8. Provide wiring and electrical components rated for 75°C. Provide red. black. and white colored XHHW service entrance conductors of minimum size 6 American Wire Gauge (AWG). Identify size 6 AWG conductors by continuous color jacket. Identify electrical conductors sized 4 AWG and larger by continuous color jacket or by colored tape. Mark at least 6 inches of the conductor's insulation with half laps of colored tape, when identifying conductors. Ensure each service entrance conductor exits through a separately bushed non-metallic opening in the weatherhead. The lengths of the conductors outside the weatherhead are to be 12 inches minimum, 18 inches maximum, or as required by utility.
- 9. All electrical service conduit and conductors attached to the electrical service including the riser or the elbow below ground are subsidiary to the electrical service. For an underground utility feed, all service conduit and conductors after the elbow, including service conduit and conductors for the utility pole riser when furnished by the Contractor, will be paid for separately
- 10.Provide rigid metal conduit (RMC) for all conduits on service, except for the 1/2 in. PVC conduit containing the electrical service grounding electrode conductor. Size the service entrance conduit as shown in the plans. Ensure conduit for branch circuit entry to enclosure is the same size as that shown on the layout sheets for branch circuit conduit. Extend all rigid metal conduits minimum of 6 inches underground and then couple to the type and schedule of the conduit shown on the layout for that particular branch circuit. Install a grounding bushing on the RMC where it terminates in the service enclosure.
- .Use of liquidtight flexible metal conduit (LFMC) is allowed between the meter and service enclosure when they are mounted 90 to 180 degrees to each other. Size the LFMC the same size as service entrance conduit. LFMC must not exceed 3 feet in length. Strap LFMC within 1 foot of each end. LFMC less than 12 inches in length need not be strapped. Each end of LFMC must have a grounding bushing or be terminated with a grounding fitting. The LFMC must contain a grounded (neutral) conductor. Ensure any bend in LFMC never exceeds 180 degrees. A pull test is required on all installed conductors, with at least six inches of free conductor movement demonstrated to the satisfaction of the Engineer.
- 12.Ensure all mounting hardware and installation details of services conform to utility company specifications.
- 13.For all electrical service enclosures listed under Item 628 on the MPL, the UL 508 enclosure manufacturers will prepare and submit a schematic drawing unique to each service. Before shipment to the job site, place the applicable laminated schematic drawings and the laminated plan sheet showing the electrical service data chart used to build the enclosure in the enclosure's data pocket. The installing contractor will copy and laminate the actual project plan sheets detailing all equipment and branch circuits supplied by that service. The laminated plan sheets are to be placed in the service enclosure's document pocket. Reduce 11 in, x 17 in, plan sheets to sheets, the installing contractor is to redline plan sheets before laminating.
- 4.When providing an "Off The Shelf" Type D or Type T service, provide laminated plan sheets detailing equipment and branch circuits supplied by that service. Reduce 11 in. x 17 in. plan sheets to 8 $\frac{1}{2}$ in. x 11 in before laminating. Deliver these drawings before completion of the work to the Engineer, instead of placing in enclosure that has no door pocket.
- 15.Do not install conduit in the back wall of a service enclosure where it would penetrate the equipment mounting panel inside the enclosure. Provide grounding bushings on all metal conduits, and terminate bonding jumpers to grounding bus. rounding bushings are not required when the end of the metal conduit is fitted with a conduit sealing hub or threaded boss, such as a meter base hub.

SERVICE ASSEMBLY ENCLOSURE

- 1. Provide threaded hub for all conduit entries into the top of enclosure.
- 2. Type galvanized steel (GS) enclosures may be used for Type C panelboards and for Type D and T services that do not use an enclosure mounted photocell or lighting contactor. Provide GS enclosures in accordance with DMS 11080, 11082, 11083, and 11084.
- 3. Provide aluminum (AL) and stainless steel (SS) enclosures for Types A, C, and D in accordance with DMS 11080, 11081, 11082, 11083, and 11084. Do not paint stainless steel.
- 4. Provide pedestal service (PS) enclosures in accordance with ED(9) and DMS 11080 and 11085. Do not provide GS pedestal services. If GS is shown in the PS descriptive code, provide an AL enclosure.

MAIN DISCONNECT & BRANCH CIRCUIT BREAKERS


- 1. Field drill flange-mounted remote operator handle if needed, to ensure handle is lockable in both the "On" and "Off" positions.
- 2. When the utility company provides a transformer larger than 50 KVA. verify that the available fault current is less than the circuit breaker's ampere interrupting capacity (AIC) rating and provide documentation from the electric utility provider to the Engineer.


PHOTOELECTRIC CONTROL

1. Provide photocell as listed on the MPL. Move, adjust, or shield the photocell from stray or ambient night time light to ensure proper operation. Mount photocell facing north when practical. Mount top of pole photocells as shown on Top Mounted Photocell Detail.

	* ELECTRICAL SERVICE DATA											
Elec. Service ID	Plan Sheet Number		Service Conduit **Size	Service Conductors No./Size	Safety Switch Amps	Main Ckt. Bkr. Pole/Amps	Two-Pole Contractor Amps	Panelbd/ Loadcenter Amp Rating	Branch Circuit ID	Branch Ckt. Bkr. Pole/Amps	Branch Circuit Amps	KVA Load
SB 183	289	ELC SRV TY A 240/480 100(SS)AL(E)SF(U)	2"	3/#2	100	2P/100	100	N/A	Lighting NB	2P/40	26	28.1
									Lighting SB	2P/40	25	
									Underpass	1P/20	15	
NB Access	30	ELC SRV TY D 120/240 060(NS)SS(E)TS(O)	1 1/4"	3/#6	N/A	2P/60		100	Sig. Controller	1P/30	23	5.3
							30		Luminaires	2P/20	9	
									CCTV	1P/20	3	
2nd & Main	58	ELC SRV TY T 120/240 000 (NS) GS (N) SP (O)	1 1/4"	3/#6	N/A	N/A	N/A	70	Flashing Beacon 1	1P/20	4	1.0
									Flashing Beacon 2	1P/20	4	

- * Example only, not for construction. All new electrical services must have electrical service data chart specific to that service as shown in the plans.
- ** Verify service conduit size with utility. Size may change due to utility meter requirements. Ensure conduit size meets the National Electrical Code.

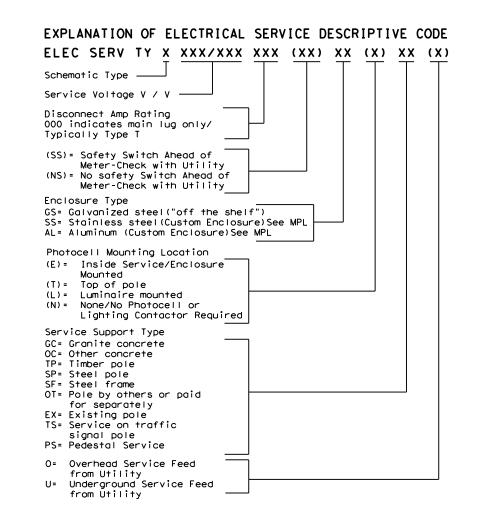

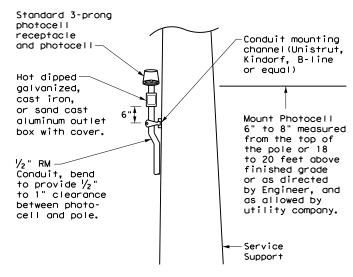

TOP MOUNTED PHOTOCELL

Install conduit strap maximum 3 feet from box. 5 foot maximum spacing between straps supporting conduit.




Texas Department of Transportation

Operation


ED(5) - 14

FILE:	ed5-14.dgn	DN:	Txl	DOT	ck: T	xDOT	DW:	TxDOT	ck: TxDOT
C TxDOT	October 2014	CON	Т	SECT		JOB		н	I GHWAY
	REVISIONS		1392 01		044			FM 1378	
		DIS	т		С	OUNTY			SHEET NO.
		18			С	OLLIN			255

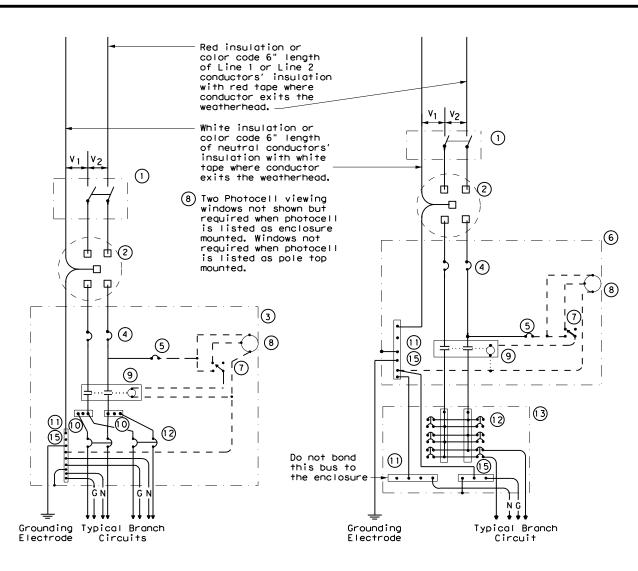

SCHEMATIC TYPE A THREE WIRE


SCHEMATIC TYPE C THREE WIRE

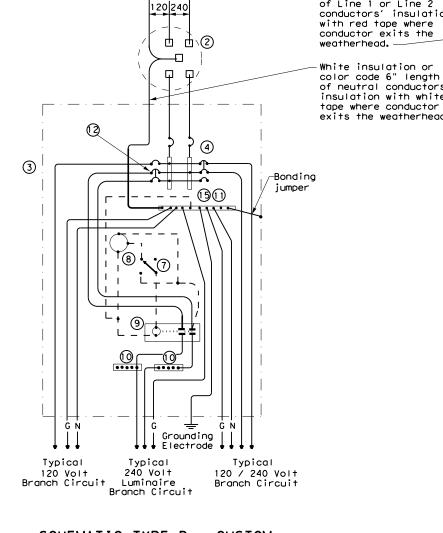

SCHEMATIC TYPE D - CUSTOM 120/240 VOLTS - THREE WIRE

	WIRING LEGEND
	Power Wiring
	Control Wiring
—N—	Neutral Conductor
— c—	Equipment grounding conductor-always required

	SCHEMATIC LEGEND
1	Safety Switch (when required)
2	Meter (when required-verify with electric utility provider)
3	Service Assembly Enclosure
4	Main Disconnect Breaker (See Electrical Service Data)
5	Circuit Breaker, 15 Amp (Control Circuit)
6	Auxiliary Enclosure
7	Control Station ("H-O-A" Switch)
8	Photo Electric Control (enclosure- mounted shown)
9	Lighting Contactor
10	Power Distribution Terminal Blocks
11	Neutral Bus
12	Branch Circuit Breaker (See Electrical Service Data)
13	Separate Circuit Breaker Panelboard
14	Load Center
15	Ground Bus

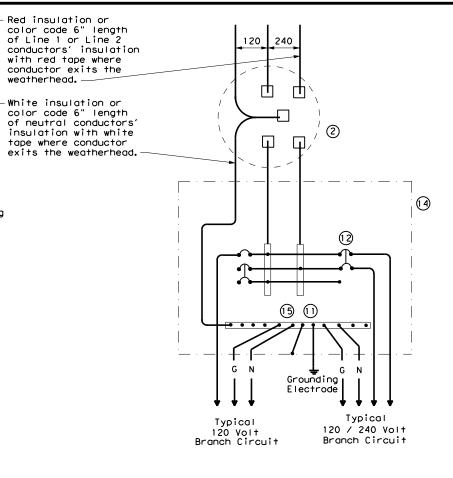

SCHEMATIC TYPE T

120/240 VOLTS - THREE WIRE

Galvanized steel-"Buy Off The Shelf" only. When required install photocell top of the pole or on luminaire only, no lighting contractor will be installed.



Traffic Operations Division Standard


ELECTRICAL DETAILS SERVICE ENCLOSURE AND NOTES

ED(6)-14

E:	ed6-14.dgn	DN: T>	DOT	ck: TxDOT	DW:	TxDOT	ck: TxDOT		
TxDOT	October 2014	CONT SECT		JOB		HIGHWAY		HIGHWAY	
	REVISIONS	1392	01	044		FM 1378			
		DIST		COUNTY			SHEET NO.		
		D392		COLLIN			256		

TRAFFIC SIGNAL NOTES

- 1. Do not pass luminaire conductors through the signal controller cabinet.
- Include an equipment grounding conductor in all conduits throughout the electrical system. Bond all exposed metal parts to the grounding conductor.
- 3. Provide roadway luminaires, when required, in accordance with the material and construction sections of Item 610, "Roadway Illumination Assemblies," except for performance testing of luminaires. Test installed roadway luminaires for proper operation as a part of the associated traffic signal system test.
- 4. If internally illuminated street name signs are approved for use, ground the fixture to the pole with a 12 AWG green XHHW conductor.
- Bond anchor bolts to rebar cage in two locations using #3 bars or 6 AWG stranded copper conductors. Use Listed mechanical connectors rated for embedment in concrete. See TXDOT standard TS-FD for further details.
- 6. Drill and tap signal poles for ½ in. X 13 UNC tank ground fitting. Provide and install tank ground fitting 4 in. to 6 in. directly below electrical service enclosure. Provide properly sized hole through the bottom of the enclosure for the service grounding electrode conductor. Connect the electrical service grounding electrode conductor to the tank ground fitting. Ensure electrical service grounding electrode conductor is as short and straight as possible from the enclosure to the tank ground fitting. See Inset A detail for further information. Size service entrance conduit and branch circuit conduit as shown in the plans.
- 7. Mount electrical service enclosure and meter to signal pole with stainless steel bands. Ensure bands are a minimum width of ¾ in. Secure enclosures to bands using two-bolt brackets. Install brackets near top and bottom of each enclosure. Install properly sized stainless steel washers on each bolt in the enclosure. Band or drill and tap properly sized stand-off straps to signal pole for attaching conduit.
- 8. Conduct pull tests and insulation resistance tests on all illumination and power conductors as required in Item 620 "Electrical Conductors" and ED(3). To prevent electronics damage, do not conduct insulation resistance tests on traffic signal cables after termination.
- Lock all enclosures and bolt down all ground box covers before applying power to the signal installation.
- 10. Terminate conduits entering the top of enclosures with a conduit-sealing hub or threaded boss such as meter hub. Install a grounding bushing on all metal conduits not connected to conduit-sealing hub or threaded boss. Bond the grounding bushing to the ground bus with a bonding jumper. Seal all conduits entering enclosures with duct seal or expanding foam. Do not use silicone to seal conduit ends.
- For all conduits, ensure the burial depth is a minimum of 18". Ensure the minimum burial depth for conduit placed under a roadway is 24".

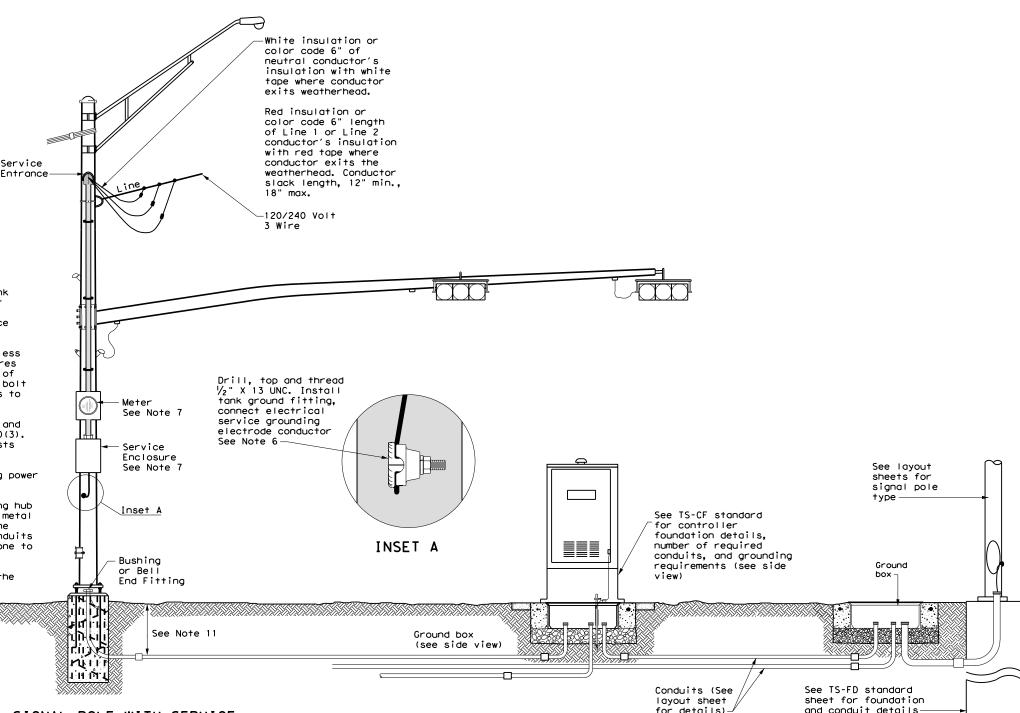

SIGNAL POLE WITH SERVICE

Type T electrical service mounted on signal pole shown as an example. See electrical details, layout sheets, and electrical service data chart for additional details.

SIGNAL CONTROLLER FRONT VIEW

SIGNAL POLE

Texas Department of Transportation

Division Standard

Traffic Operation:

ELECTRICAL DETAILS
TYPICAL TRAFFIC SIGNAL
SYSTEM DETAILS


ED(8) - 14


SIGNAL CONTROLLER
SIDE VIEW

See TS-CF standard for conduit and grounding requirements. See layout sheets for ground box locations and any additional conduits that are required.

PEDESTAL SERVICE NOTES


- 1. Manufacture pedestal electrical services in accordance with Departmental Material Specifications (DMS)11080 "Electrical Services", 11085 "Electrical Services-Pedestal (PS)" and Item 628 "Electrical Services. "Provide pedestal electrical services as listed on the Material Producers list (MPL) on the Department's web site under "Roadway Illumination and Electrical Supplies," Item 628. Ensure all mounting hardware and installation details of services meet utility company specifications. Contact the local utility company for approval of pedestal details prior to installing the electrical pedestal service. Submit any changes required by the utility company prior to manufacturing the pedestal enclosure.
- 2. When a meter socket is required, provide a socket with a minimum 100 amp rating that complies with local utility requirements.
- 3. Provide Class A or C concrete for pedestal service foundations in accordance with Item 420, "Concrete Substructures," except that concrete will not be paid for directly but is considered subsidiary to Item 628.
- 4. Provide #4 reinforcing steel for foundations in accordance with Item 440, "Reinforcement for Concrete."
- 5. Install $\frac{1}{2}$ in. X 2 $\frac{1}{16}$ in. minimum length concrete single expansion type anchors for mounting pedestal enclosure to foundation. Anchor location to match mounting holes in each corner of enclosure. Secure each of the four corners of the pedestal enclosure to the anchors in the foundation with a $\frac{1}{2}$ in, galvanized or stainless steel machine thread bolt, a properly sized locknut and a flat washer.
- 6. Finish top of concrete foundation in a neat and workmanlike manner. If leveling washers are used, ensure no more than $\frac{1}{16}$ in, gap at any corner. Do not exceed a maximum dip or rise in the foundation of $\frac{1}{16}$ in, per foot. When properly installed, ensure the top of the service enclosure is level front to back and side to side within $\frac{1}{16}$ in. Repair rocking or movement of the service enclosure at no additional cost to the department.
- 7. Do not use liquidtight flexible metal conduit (LFMC) on pedestal type services.
- 8. Ensure all elbows in the foundation are sized as per utility provider's conduit requirements for underground conduit and feeders. PVC extensions may be installed provided the ends of the rigid metal conduits are more than 2 in, below the top of the concrete foundation. Where extension conduits are metal, grounding bushings must be installed with a bonding jumper properly terminated.

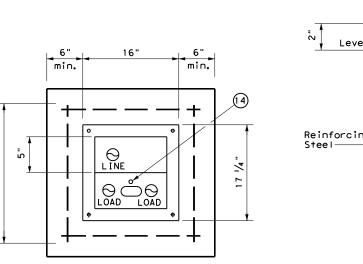




SECTION A-A

ANCHOR BOLT DETAIL

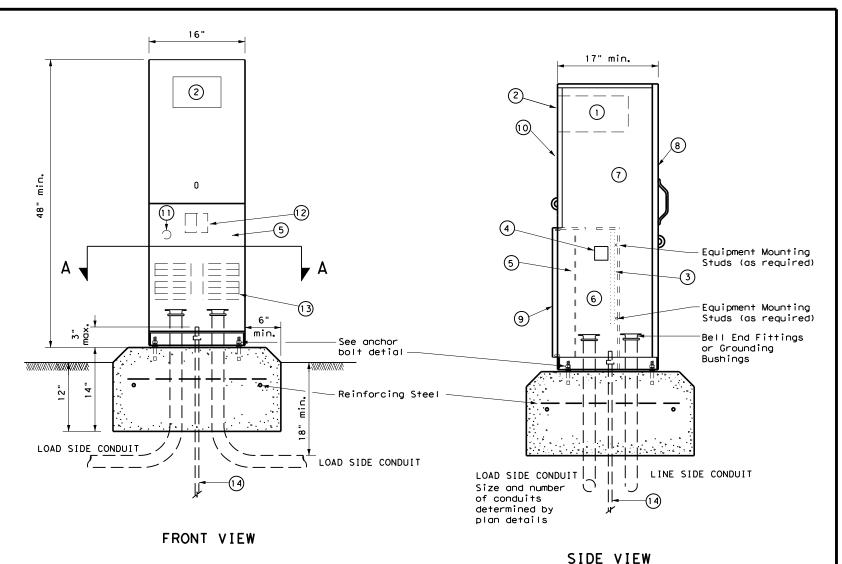

TYPE C shown, TYPE A similar except that TYPE A shall have individual circuit breakers (CB) mounted on an equipment mounting panel. CB Handles shall protrude through hinged deadfront trim.

	LEGEND						
1	Meter Socket, (when required)						
2	Meter Socket Window, (when required)						
3	Equipment Mounting Panel						
4	Photo Electric Control Window, (When required)						
5	Hinged Deadfront Trim						
6	Load Side Conduit Trim						
7	Line Side Conduit Area						
8	Utility Access Door, with handle						
9	Pedestal Door						
10	Hinged Meter Access						
11	Control Station (H-O-A Switch)						
12	Main Disconnect						
13	Branch Circuit Breakers						
14	Copper Clad Ground Rod - 5/8" X 10'						




Traffic Operations Division Standard

ELECTRICAL DETAILS
ELECTRICAL SERVICE SUPPORT
PEDESTAL SERVICE TYPE PS

ED(9)-14

E:	ed9-14.dgn	DN: Tx	TxDOT CK: TxDOT DW: TxDOT		TxDOT	ck: TxDOT		
TxDOT	October 2014	CONT	SECT JOB		HIG	HIGHWAY		
	REVISIONS	1392	01	044 FM		FM	1378	
		DIST		COUNTY			SHEET NO.	
		18	COLLIN			258		

······

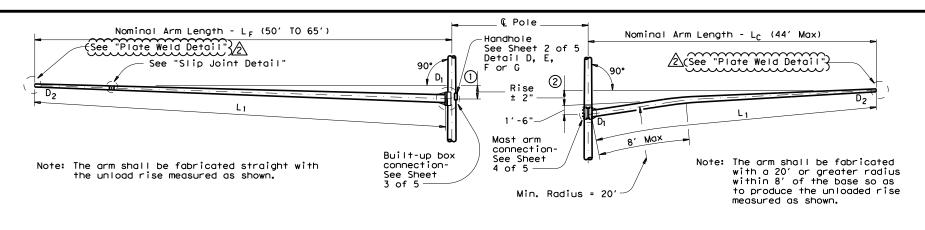

FIXED MOUNT TRAFFIC SIGNAL ARM CLAMP-ON TRAFFIC SIGNAL ARM (IF REQUIRED) 2 See Sheet 4 of 5 for Arm Rise ①See Sheet 3 of 5 for Arm Rise and Clamp-on Arm Details Luminaire Arm -See Sheet "Lum-A' See Sheet 2 of 5 -Detail A ILSN Arm Connection - See Sheet 4 of 5 Shee 2 of ILSN Arm Connection - See Sheet 4 of 5 Nom Arm Lath ę (8') Nominal Arm Length - La Nominal Arm Length - LF Detail B or C Traffic Signal Arm See Above Detail Bracket Bracket Bracket Assembly -Assembly Assembly-Assembly-El Paso St El Paso St $\overline{\mathbf{m}}$ ◬ *∕*6\ <u></u>6\ Traffic Signal <u>6</u> Arm See Above -0"Max Detail Weather Head (Supplied 4 by others) ⇗ }<u>-</u> |**∑** -0.Min-8 (See Sheet "LMA(2)-12(DAL)") Crown of Road Crown of Road Foundation See Sheet 3 of 5 Foundation $\bigcirc 18'-0$ " w/o clamp-on arm Lc 18'-9" w/ clamp-on arm Lc See Sheet 3 of 5

STRUCTURE ASSEMBLY

PLATE WELD DETAIL

GENERAL NOTES:

Design conforms to 1994 AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals and Interim Specifications thereto. Design Wind Speed can be either 100 mph or 80 mph plus a 1.3 gust factor. If clamp-on traffic signal is required, designs are based on an arm included angle of 90 degrees or more. Angles of less than approximately 75 degrees will require a special design.

Poles are designed to support one 8'-0" luminaire arm, two 9'-0" internally lighted street name (ILSN) signs and two traffic signal arms with limited length combinations.

Each arm with its related attachment is shown below

Arm	Equivalent DL (5)	WL EPA (5)6
8' Luminaire Arm	Luminaire 60 lbs	1.6 sq ft
9' ILSN Arm	Sign 85 lbs	11.5 sq ft
50' to 65' Fixed Mount Arm	Signal Loads 310 lbs	52 sq ft
Up to 44' Clamp-on Arm	Signal Loads 180 lbs	32.4 sq ft

- (5) Equivalent dead load plus horizontal wind load applied at the end of arm except ILSN arm, which applied 4.5' from the centerline of the pole.
- © Effective projected area (actual area times drag coefficient) for the application of horizontal wind load.

Except as noted in Sheet 1 thru 5 of 5, other details not covered shall refer to

Standard Sheet "LUM-A" for luminaire arm and connection details, "SNS" for

internally lighted street name sign details, and "TS-FD" for anchor bolt
and foundation details.

Fabrication shall be in accordance with Item 686, "Traffic Signal Pole Assemblies (Steel)" and with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. Material, fabrication tolerances, and shipping practices shall also meet the requirements of this sheet and Item 686, "Traffic Signal Pole Assemblies (Steel)".


Unless otherwise noted, all parts shall be galvanized in accordance with Item 445, "Galvanizing" after fabrication.

Deviations from the details and dimensions shown herein require submission of shop drawings in accordance with the Item 441, "Steel Structures". Alternate designs are not acceptable.

Installation of damping plate for the long mast arm is not recommended.


Provision of the bracket assembly used to support the traffic signal heads shall be under the direction of the Engineer for approval.

Design also conforms to NCHRP Report 412 for fatigue resistance except that there are no stiffeners at the base plate. TxDOT is conducting tests to determine if stiffeners at the base plate will or will not result in optimal performance; depending upon the results of the tests, poles may need a retrofit to ensure optimal fatigue performance.

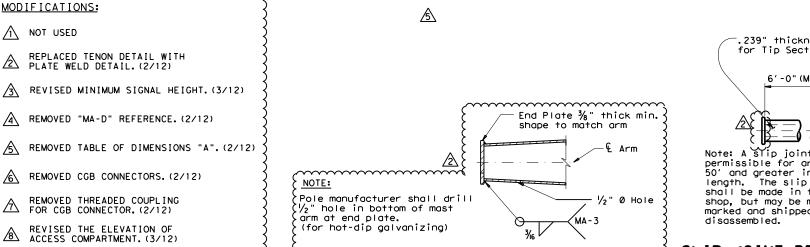

ELEVATION

(Showing fixed mount arm)

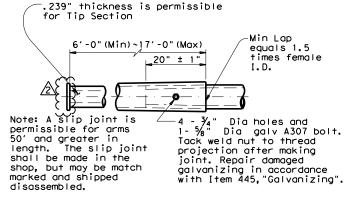

ELEVATION

(Showing clamp-on arm)


SLIP JOINT DETAIL (FIXED MOUNT ARM)



SUPPORT STRUCTURES
LONG MAST ARM ASSEMBLY
(50 TO 65 FT)
(80 AND 100 MPH WIND ZONE)
LMA(1)-12(DAL)

Sheet 1 of 5

ℂTxDOT July 2000	DN: JK		CK: GRB	DW:	FDN	CK: CAL
REVISIONS	CONT	SECT	JOB		HI:	CHWAY
-12	1392	01	044		FM	1378
	DIST		COUNTY			SHEET NO.
	DAL		COLLIN			259

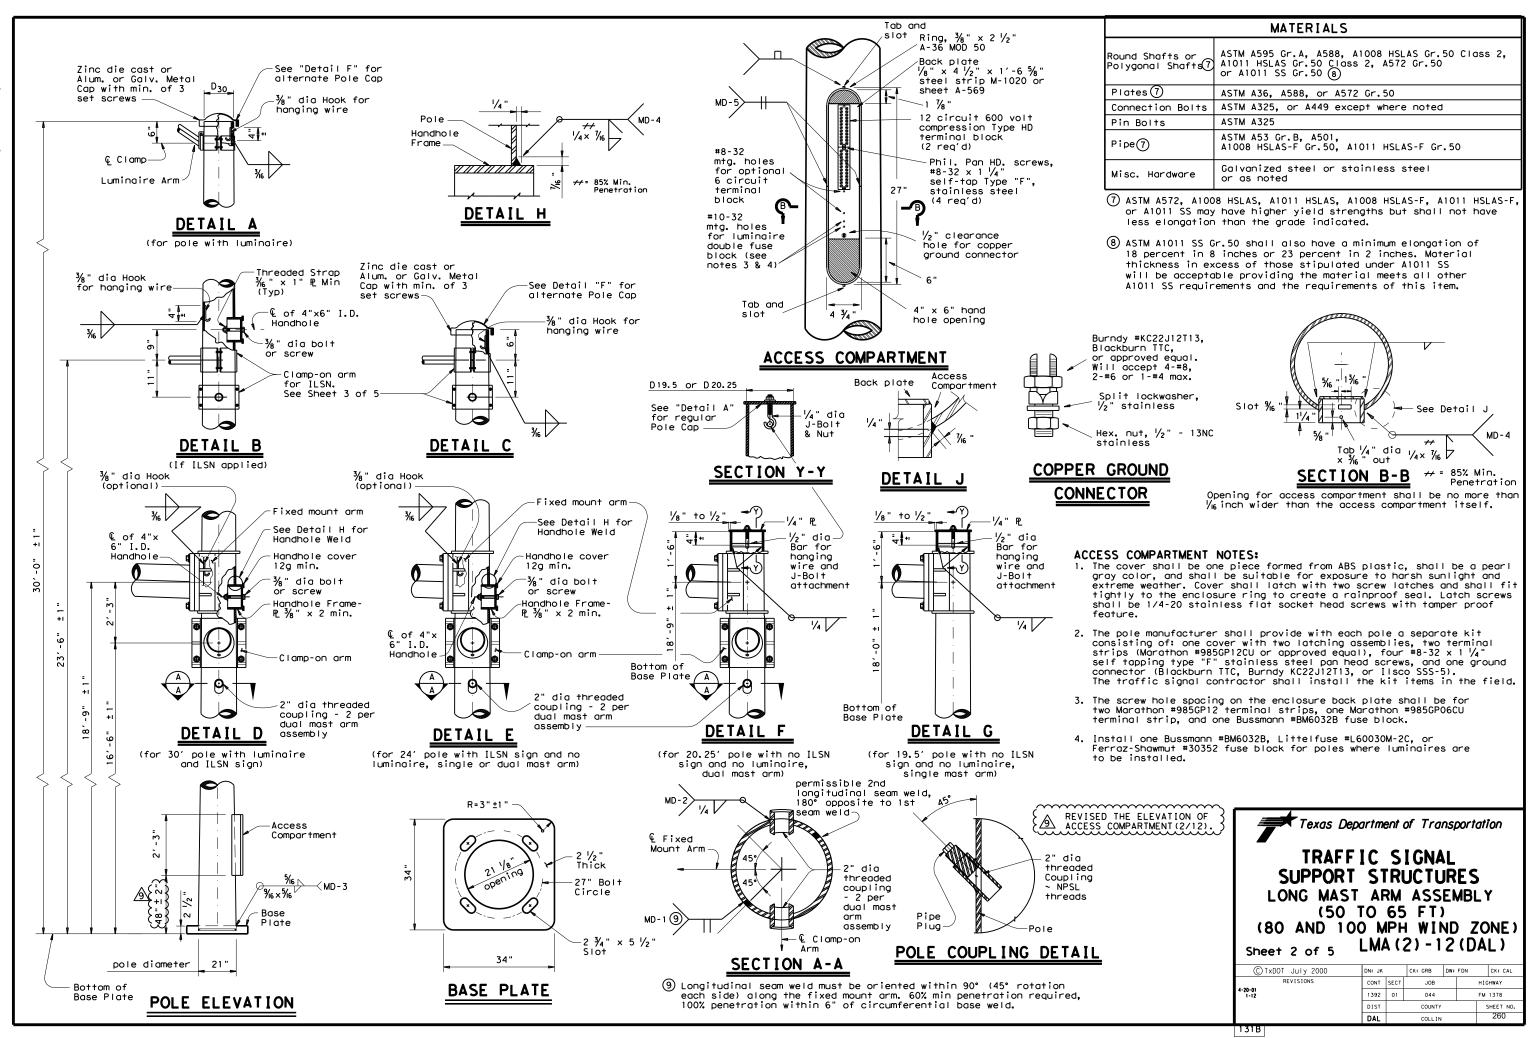

2, -5

7,4

Weld other side to Side Gusset Plate

2 optional drainage holes ¾4" Dia inside box

Stiffener

Arm Mounting Plate

2 ½" Dia hole in PLŪ

Pole Mounting Plate

4. Mast Arm

Weld other side to

or wire access

Side Gusset Plate

11 Deburr holes and offset

as shown for drainage

28"

2'-5"

-0-

~0

SECTION D-D

~ 2" PI

0

0

-Mast Arm

ىي

Arm Stiffener

 σ

0

0

 $1 \frac{1}{2}$ " Dia Connection Bolts -

REINFORCING STIFFENER

4" Min


Provide Detail shown in SECTION F-F or equivalent

100% complete joint


penetration weld. . from both sides.

Only 4" length at tip of Arm Stiffener requires a complete joint penetration weld. Smooth weld radius to connect Stiffener. Only a fillet weld is required for the remaining weld length.

DETAIL "K"



SECTION F-F



TEMPLATE DETAIL

2'-4" %" Plate

ARM STIFFENER

(Cut to match arm inclination and taper)

¾"

edge of adjacent 4" dia hole BUILT-UP BOX CONNECTION

SECTION C-C

Mounting

Plate

Stiffener

Radius Slot

≺турј


· E Pole

3" Min. clear distance from the

2- $\frac{3}{4}$ " dia optional drainage holes.

(both sides)\

hole in Pole(11)

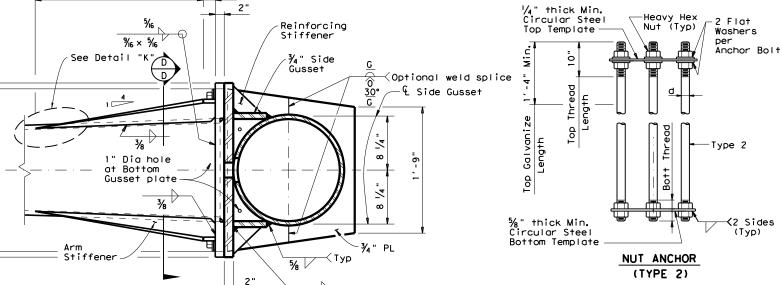

100%

penetration

Top Gusset Plate

€ Box

· £ 4" × 6" I.D.

required if

arm applied

Handhole

ILSN or

luminaire

/2

o

%" dia Hook ∽

(optional)

& Reinf

Side Gusset

Bottom Gusset

Plate

Plate

Stiffener

ANCHOR BOLT ASSEMBLY

					FOUND	ATION	DESIG	N TAE	BLE				
FDN	DRILLED	REINFORCING DRILLED SHAFT LENGTH-ft				ANCHOR BOLT DESIGN (14)				FOUNDATION DESIGN 15			
TYPE	SHAFT DIA	VERT BARS	SPIRAL & PITCH	N	blows/f		ANCHOR BOLT DIA	Fy (ksi)	BOL T CIR	ANCHOR TYPE	MOMENT	SHEAR	
10.	40.0			10	15	40			DIA	2	K-ft		50' to 65'
48-A	48"	20 #9	#4 at 6"	21.9	19.5	14.7	2 1/2 "	55	27"	2	490	10	Mast arm assembly.

SEE SHEET "TS-FD" FOR ADDITIONAL DETAILS.

- (4) Anchor bolt design develops the foundation capacity given under Foundation Design Laods.
- (5) Foundation Design Loads are the allowable moments and shears at
- $\widehat{\text{(b)}}$ Field Penetrometer readings at a depth of approximately 3 to 5 feet may be used to adjust shaft lengths.
- If rock is encountered, the Drilled Shaft shall extend a minimum of two diameters into solid rock.
- B Decimal lengths in Design Table are to allow interpolation for other penetrometer values. Round to nearest foot for entry into Summary Table.

Fixed		ROU	ND POLE	S (13)		
Mount Arm L f	D _B	D ₁₉ , 5 D ₂₀ , 25	D ₂₄	D 30	12 ^{thk}	Foundation Type
ft.	in.	in.	in.	in.	in.	3
50', 55' 60', 65'	21.0	18.2	17.6	16.8	.3125	48-A

Fixed	ROUND ARMS (13)									
Mount Arm Lf	Lı	Dı	D ₂	(12)thk	D'aa					
ft.	ft.	in.	in.	in.	Rise					
50	49	18.5	11.7	.3125	3' - 3"					
55	54	18.5	11.0	.3125	3' - 7"					
60	59	18.5	10.3	.3125	3'-11"					
65	64	18.5	9.6	.3125	4' - 4"					

= Pole Base O.D.

D_{19.5} = Pole Base 0.D. with no Luminaire and no ILSN (single mast arm)
D_{20.25} = Pole Top 0.D. with no Luminaire and no ILSN (dual mast arm)

= Pole Top O.D. with ILSN

w/out Luminaire
= Pole Top O.D. with Luminaire

= Arm Base O.D. = Arm End O.D.

Shaft LengthFixed Arm Length

- (12) Thickness shown is minimum, thicker materials may be used.
- (13) Shaft profile 16-sided or 18-sided is considered to be equivalent to round section.

GENERAL NOTES:

Built-up Box Connection: For the welded arm-to-pole connection as a build-up box configuration illustrated here is an example only, fabricators are required to submit a shop drawing of box connection for approval. The drawing shall specify the details of each box element, welds of arm-to-pole connection, arm-to-plate socket connection, and arm rise connection, driff-to-prote socker connection, and driff rise creation. Specify the proper location of drain holes along the pole. 2 $\frac{1}{2}$ " dia hole in the pole mounting plate and 4" dia hole in the pole need to be aligned for wiring access or drainage. Arm stiffeners cut to match arm inclination and taper shall also be included.

The deviation from flat for either arm or pole mounting plate shall not exceed $\frac{1}{2}$ in., which is measured along the center of mounting plate to a radial distance of 13.5 in. The deformed-from-flat connection between arm and pole mounting plates shall not be allowed if the center of both mounting plates cannot contact directly.

Fixed mount details are used for single mast arm assemblies and for the first arm on dual mast arm assemblies.

	ANCHOR BOLT & TEMPLATE SIZE									
Bolt Dia in.	Length ‡	Top Thread	Bottom Thread	Bolt Circle	R2	Rı				
2 ½"	5′-2"	10"	6 ½"	27"	16"	11"				

*Min dimension given, longer bolts are acceptable.




TRAFFIC SIGNAL SUPPORT STRUCTURES LONG MAST ARM ASSEMBLY (50 TO 65 FT) (80 AND 100 MPH WIND ZONE)

Sheet 3 of 5

LMA(3)-12

© TxDOT July 2000	DN: JK		CK: GRB	DW:	FDN CK: CAL	
REVISIONS 4-20-01	CONT	SECT	JOB		HIGHWAY	
1-12	1392	01	044		FM 1378	
	DIST	COUNTY SHEET		SHEET NO.		
	DAI	COLLIN 261		261		

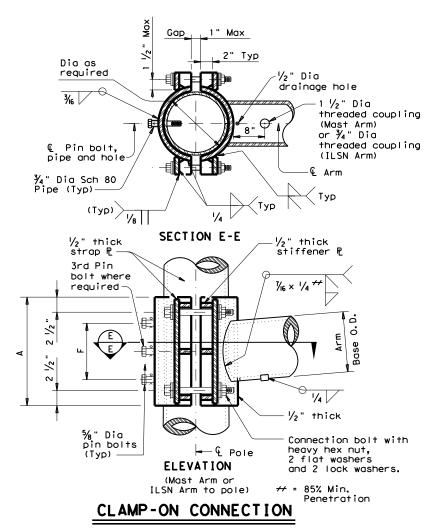


	80 MPH WIND												
Clamp-on		ROUND	ARMS			P(DLYGONAL	ARMS					
Arm LC	L ₁	D ₁	D 2	thk (12)	Rise	L,	Dı	D ₂	thk (12)	Rise			
ft.	ft.	in.	in.	in.	Rise	ft.	in.	in.	in.	Rise			
20	19.1	6.5	3.8	.179	1′-9"	19.1	7.0	3.5	.179	1′-8"			
24	23.1	7.5	4.3	.179	1′-10"	23.1	7.5	3.5	.179	1′-9"			
28	27.1	8.0	4.2	.179	1′-11"	27.1	8.0	3.5	.179	1′-10"			
32	31.0	9.0	4.7	.179	2′-1"	31.0	9.0	3.5	.179	2'-0"			
36	35.0	9.5	4.6	.179	2′-4"	35.0	10.0	3.5	.179	2'-1"			
40	39.0	9.5	4.1	.239	2′-8"	39.0	9.5	3.5	.239	2'-3"			
44	43.0	10.0	4.1	.239	2'-11"	43.0	10.0	3.5	.239	2′-6"			
				1	OO MPH I	W I NID							

				1	00 MPH V	VIND				
Clamp-on ROUND ARMS								POLYGON	NAL ARMS	
Arm LC	Lı	D 1	D 2	thk (12)	Rise	L,	Dη	D ₂	thk (12)	Rise
ft.	ft.	in.	in.	in.	Rise	ft.	in.	in.	in.	Rise
20	19.1	8.0	5.3	.179	1′-8"	19.1	8.0	3.5	.179	1′-7"
24	23.1	9.0	5.8	.179	1′-9"	23.1	9.0	3.5	.179	1′-8"
28	27.1	9.5	5.7	.179	1′-10"	27.1	10.0	3.5	.179	1′-9"
32	31.0	9.5	5.2	.239	1'-11"	31.0	9.5	3.5	.239	1′-10"
36	35.0	10.0	5.1	.239	2′-0"	35.0	10.0	3.5	.239	1'-11"
40	39.0	10.5	5.1	.239	2′-3"	39.0	11.0	3.5	.239	2'-1"
44	43.0	11.0	5.1	.239	2′-8"	43.0	11.5	4.0	.239	2'-3"

(2) Thickness shown is minimum, thicker materials may be used.

	CLAMP	-ON	ARM	CONNECTIO	ON
ILSN Arr	n Size		F	4 Conn. Bolts	%" Dia. Pin Bo∣ts
Sch 40 pipe Dia	Thick	A	r	Dia	No.
in.	in.	in.	in.	in.	ea
3	.216	10	4	3/4	2
Mast Ari	Mast Arm Size		F	4 Conn. Bolts	5% " Dia. Pin Bo∣ts
Base Dia	Thick			Dia	No.
in.	in.	in.	in.	in.	ea
6.5	.179	12	6	1	2
7.5	.179	14	8	1	2
8.0	.179	14	8	1	2
9.0	.179	16	10	1	2
9.5	.179	18	12	1 1/4	3
9.5	.239	18	12	1 1/4	3
10.0	.239	18	12	1 1/4	3
10.5	. 239	18	12	1 1/4	3
11.0	.239	18	12	1 1/4	3
11.5	.239	18	12	1 1/4	3




D1 = Arm Base O.D.

D2 = Arm End O.D. L1 = Shaft Length LC = Clamp-on Arm Length

ARM COUPLING DETAIL

Coupling




ILSN ARM COUPLING DETAIL

Note: A slip joint is permissible for arms 40' and greater in length. The slip joint shall be made in the shop, but may be match marked and shipped disassembled. Note: A slip joint is 4 - 3/4" Dia holes and 1- 5/8" Dia galv A307 bolt. Tack weld nut to thread projection after making joint. Repair damaged galvanizing in accordance with Item 445, "Galvanizing".

SLIP JOINT DETAIL (CLAMP-ON ARM)

Stainless steel bands (or Cables) and cast bracket as in "Astro-Brac", "Sky Bracket" or "Easy Bracket" with 1 ½" Dia Threaded Coupling.

BRACKET ASSEMBLY



ARM WELD DETAIL

(9) Longitudinal Seam Weld must be oriented within the lower 90° of the signal arm.
60% Min penetration
100% penetration within 6" of circumferential base welds.

GENERAL NOTES:

Clamp-on details are used for the second arm on dual mast arm assemblies or ILSN arm support. For a clamp-on mast arm, a maximum 1 $\frac{1}{2}$ " wide vertical slotted hole may be cut in the front clamp plate to facilitate drainage during galvanizing. The slot shall be centered behind the arm and shall be no longer than the arm diameter minus 1". For an ILSN arm, a 1 $\frac{1}{2}$ " diameter hole shall be cut in the front clamp plate for wire access. A matched hole shall be field drilled through the pole to provide wire access after arm is oriented. Deburr both holes.

Where duplicate parts occur on a detail, welds shown for part shall apply to all similar parts on the detail

Pin bolts are required to prevent rotation of clamp-on arms under design wind forces. Pin bolts shall be ASTM A325 with threads excluded from the shear plane. Pin bolt and $\frac{7}{4}$ " diameter pipe shall have $\frac{7}{4}$ " diameter holes for a $\frac{7}{8}$ " diameter galvanized cotter pin. Back clamp plate shall be furnished with a $\frac{7}{4}$ " diameter hole for each pin bolt. An $\frac{7}{6}$ " diameter hole for each pin bolt be field drilled through the pole after arm orientations have been approved by the Engineer.

REPLACED TENON DETAIL WITH PLATE WELD DETAIL (2/12).



TRAFFIC SIGNAL
SUPPORT STRUCTURES
LONG MAST ARM ASSEMBLY
(50 TO 65 FT)
(80 AND 100 MPH WIND ZONE)

Sheet 4 of 5 LMA (4) -12 (DAL)

© TxDOT November 2000	DN: JK		CK: GRB	DW:	FDN	CK: CAL
REVISIONS	CONT	SECT	JOB		HI	GHWAY
-12	1392	01	044		FM 1378	
	DIST		COUNTY			SHEET NO.
	DAL		COLLIN			262

131[

			Shippin	g Parts List			
				ed: enlarged ha		e cap, fixed arm con	nection
Nomi			ith Luminaire	24' Poles		19,50' (Sind	gle Mast Arm)
Arm			e plus: one (or	See note al		20, 25' (Dua	
Leng	th		ttached) small	one small l		Poles with no Lumine	
			omp-on simplex			See note	
				Most Arm		300 11010	
Lf f	t.	Designation	Quantity	Designation	Quantity	Designation	Quantity
50		50L	•	50\$		50	
55		55L		55\$		55	
60		60L		60\$		60	
65		65L	1	65\$		65	
		•	Dual	Most Arm	1	•	•
Lf	Lc						
ft.	ft.	Designation	Quantity	Designation	Quantity	Designation	Quantity
50	20	5020L		5020S		5020	
	24	5024L		5024S		5024	
	28	5028L		5028S		5028	
	32	5032L		5032S		5032	
	36	5036L		5036S		5036	
	40	5040L		5040S		5040	
	44	5044L		50445		5044	
55	20	5520L		5520S		5520	
	24	5524L		5524S		5524	
	28	5528L		55285		5528	
	32	5532L		5532S		5532	
	36	5536L		5536S		5536	
	40	5540L		5540S		5540	
	44	5544L		5544\$		5544	
60	20	6020L		6020S		6020	
	24	6024L		60245		6024	
	28	6028L		60285		6028	
	32	6032L		60325		6032	
	36	6036L		6036S		6036	
	40	6040L		6040S		6040	
	44	6044L		60445		6044	
65	20	6520L		6520S		6520	
	24	6524L		6524S		6524	
	28	6528L		6528\$		6528	
	32	6532L		6532\$		6532	
	36	6536L		6536S		6536	
	40	6540L		6540S		6540	
	44	6544L		6544\$		6544	

_	_	_	_	
Foundat	inn	Summory	Toble	4 4

Location Ident.	Avg. N Blow/ft.	No. Each	Drill Shaft *** Length (feet) 48-A
P1	10	1	22
Total Drill S	haft Length		22

Notes

- ** Foundations may be listed separately or grouped according to similarity of location and type. Quantities are for the Contractor's information only.
- *** Decimal lengths in Design Table are to allow interpolation for other penetrometer values. Round to nearest foot for entry into Summary Table.

		Shi	ipping Parts List
Traffic S	Signal Arms (Fixe	ed Mount) (1 per	pole)
Ship eact	n arm with listed	d equipment atta	iched
Nominal	Type IV Arm	(4 Signals)	
Arm	A Procket A	ccombline	
Length	A Brocket A	13361101163	
ft.	Designation	Quantity	
50	501V		
55	55111		
3			
65	65 I V	1	

Luminaire A	rms	(1 p	er 30' pole)
Nominal Arm	Length		Quantity
8' Arm			1
ILSN Arm	(Max. 2 per clamps, bo	-	e) Ship with and washers
	rm Length		Quantity

9' Arm

Traffic	Type I Arm (1 Sianal)	Type II Arm (2	2 Signals)	Type III Arm	(3 Signals)	
Nominal Arm Length	SI Bracket Asse	mhly and	2 Bracket Assen 1clamp w/bolts	mhlies and	3 Bracket Asset	mblies and }	
ft.	Designation	Quantity	Designation	Quantity	Designation	Quantity	
20	201-80						
24	241-80		2411-80				
28	281-80		2811-80				
32			3211-80		32111-80		
36			3611-80		36111-80		
40					40111-80		
44					44111-80		
Traffic Signal Arms (100 MPH Clamp-On Mount) (1 per pole) Ship each arm with listed equipment attached Type I Arm (1 Signal) Type II Arm (2 Signals) Type III Arm (3 Signals)							
Nominal Arm	1 Bracket Asse 1clamp w/bolts	mbly and sand washers	2 Bracket Assemblies and 1clamp w/bolts and washers		3 Bracket Asser 1clamp w/bolts	mblies and } and washers	

Nominal Arm	1 Bracket Asse	mbly and and washers	2 Bracket Asser 1clamp w/bolts	nblies and and washers	3 Brocket Assem	
ft,	Designation	Quantity	Designation	Quantity	Designation	Quantity
20	201-100				_	
24	241-100		2411-100			
28	281-100		2811-100			
32			3211-100		32111-100	
36			3611-100		36111-100	
40					40111-100	
44					44111-100	

Anchor Bo	olt Assemblies	(1 per pole)
Anchor	Anchor	
Bolt	Bolt	
Diameter	Length	Quantity
2 1/2 "	5' - 3"	1

Each anchor bolt assembly consists of the following: Top and bottom templates, 4 anchor bolts, 8 nuts, 8 flat washers and 4 nut anchor devices (type 2) per Standard Drawing "TS-FD".

Templates may be removed for shipment.

Abbreviations

Lf= Fixed Arm Length Lc= Clamp-on Arm

c= Clamp-on Arm Length (44' Max.)


M REPLACED CGB CONNECTOR WITH BRACKET ASSEMBLY(2/12).



LONG MAST
ARM ASSEMBLY
PARTS LIST
LMA(5)-12(DAL)

Sheet	5	of	5
-------	---	----	---

			_							
(C) T	xDOT	November	2000	DN: JK		CK: GRB	DW:	FDN		CK: CAL
01	RE	EVISIONS		CONT	SECT	JOB			HIG	HWAY
12				1392	01	044		F	М	1378
				DIST	COUNTY SHEET			HEET NO.		
				DAL		COLLIN				263

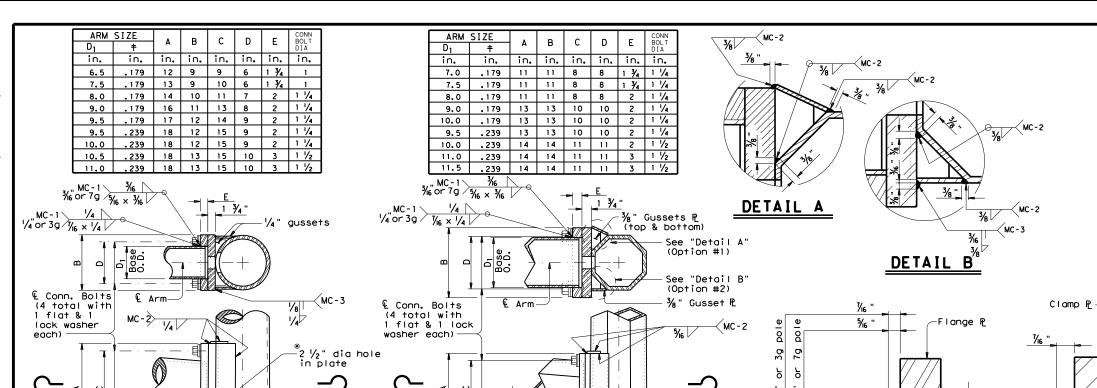

€ Pole

ARM SIZE

in.

.179

.179

- 179

. 239

. 239

14

18

Dı

in.

7.5

8.0

9.0

10.0

9.5

10.0

Dia as

required

€ Pin bolt,

¾" dia Sch 80 Pipe

where

pipe & hole

3rd bolt

required

... 22

/2

FIXED MOUNT DETAIL 2

10

Gap = 2T max.

-Grade 50 PL-

- € Pole

CLAMP-ON DETAIL 2

18 10

10 1/8 4

18 10 1 6

⁹4" dia hole

Deburr holes and

for drainage

offset as shown

in pole

€ Pole

12 6

14 8

16 10

18 12

18 | 12

18 12

in.

6.5

8.0

9.0

9.5

10.0

Dia as

€ Pin bolt,

¾" Dia Sch 80 Pipe (Typ)—

pipe and hole-

_∾ 3rd Pin

required

.179

. 179

.179

.179

.179

.239

. 239

(Typ) /₈ ||

bolt where

%" Dia pin bolts

(Typ)

½" thick strap ₧—

72

required-

FIXED MOUNT DETAIL 1

in. ea.

4

4

4

4

2" Typ

No. Dia No. Dia

4 1 1/4 3 1/8

4 1 1/4 3 1/8

4 | 1 1/4 | 3 | 5/4

Тур

-½" thick stiffener P

1/4

CLAMP-ON DETAIL 1

in. ea. in.

1 2 %

1 2 %

1/2" Dia

drainage hole

threaded

coupling

1/4

heavy hex nut,

2 flat washers

Connection bolt with

and 2 lock washers.

-Min. 85%

Penetration

~2 ½" dia hole in pole & plate

Deburr holes and

offset as shown for drainage

CONN. BOLTS PIN BOLTS

No. Dia No. Dia

_½" dia _drainage hole

1 ½" Dia

threaded

coupling

Min. 85%

1/4

Penetration

in, in, ea, in, ea, in,

6 3/4 4 3/4 2 3/8

8 | 3/4 | 4 | 3/4 | 2 | 3/8

4

FIXED MOUNT ARM CLAMP-ON ARM

ARM	SIZE		F	CONN.	BOLTS	PIN	BOLTS
D ₁	+	Α	-	No.	Dia	No.	Dia
in,	in.	in.	in.	ea.	in.	ea.	in.
6.5	.179	12	6	4	1	2	5%
7.5	.179	14	8	4	1	2	5/8
8.0	.179	14	8	4	1	2	%
9.0	.179	16	10	4	1	2	%
9.5	.179	18	12	6	1	3	%
9.5	. 239	18	12	6	1	3	%
10.0	. 239	18	12	6	1	3	%

ARM BASE WELD DETAILS

ARM	SIZE		F	CONN.	BOLTS	PIN	BOLTS
D ₁	+	A	-	No.	Dia	No.	Dia
in,	in.	in.	in.	ea.	in.	ea.	in.
6.5	.179	12	6	4	1	2	5%
7.5	.179	14	8	4	1	2	5%
8.0	.179	14	8	4	1	2	5%
9.0	.179	16	10	4	1	2	5%
9.5	.179	18	12	6	1	3	5%
9.5	. 239	18	12	6	1	3	5%
						_	E/

MATERIALS ASTM A595 Gr.A, A588, A1008 HSLAS Gr.50 Class 2, A1011 HSLAS Gr.50 Class 2, A572 Gr.50 or A1011 SS Gr.50 ② Round Shafts or Polygonal Shafts① Plates ① ASTM A36, A588, or A572 Gr.50 ASTM A325 or A449, except where noted Connection Bolts ASTM A325 Pin Bolts ASTM A53 Gr.B, A501, A1008 HSLAS-F Gr.50, A1011 HSLAS-F Gr.50 Pipe(1) Galvanized steel or stainless steel Misc. Hardware

or as noted

- ① ASTM A572, A1008 HSLAS, A1011 HSLAS, A1008 HSLAS-F, A1011 HSLAS-F or A1011 SS may have higher yield strengths but shall not have less elongation than the grade indicated.
- ② ASTM A1011 SS Gr.50 material shall also have a minimum elongation of 18 percent in 8 inches or 23 percent in 2 inches. Material thickness in excess of those stipulated under A1011 SS will be acceptable providing the material meets all other A1011 SS requirements and the requirements of this item.

except 'Clamp-on Detail 3"

Min. 85%

Penetration

GENERAL NOTES:

Clamp-on details are used for the second arm on dual mast arm assemblies. A Maximum 1 $\frac{1}{2}$ " wide vertical slotted hole shall be cut in the front clamp plate to facilitate drainage during The slot shall be centered behind the arm and shall be no longer than the arm diameter minus 1'


Fixed mount details are used for single mast arm assemblies and for the first arm on dual mast arm assemblies.

Where duplicate parts occur on a detail, welds shown for one part shall apply to all similar parts on the detail.

Pin bolts are required to prevent rotation of clamp-on arms under design wind forces.

NOTE:


Pin bolts shall be A325 with threads excluded from the shear plane. Pin bolt and $\frac{7}{4}$ " dia pipe shall have $\frac{7}{6}$ 6" dia holes for a $\frac{7}{6}$ 8" dia galvanized cotter pin. Back clamp plate shall be furnished with a $\frac{7}{4}$ " dia hole for each pin bolt. An $\frac{1}{6}$ 6" dia hole for each pin bolt shall be field drilled through the pole after arm orientations have been approved by the Engineer.

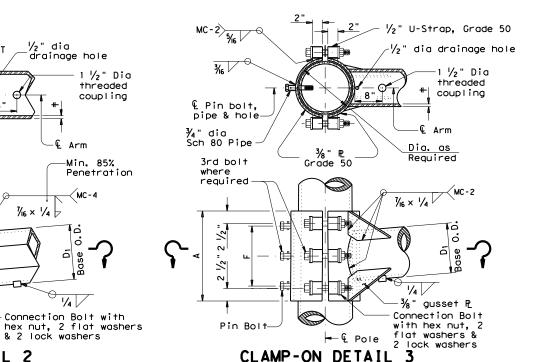

Texas Department of Transportation Traffic Operations Division STANDARD ASSEMBLY FOR TRAFFIC SIGNAL SUPPORT STRUCTURES MAST ARM CONNECTIONS

© TxDOT August 1995 CK: JSY DW: MMF CONT SECT JOB 1392 01 044 FM 1378 DIST 264

MA-C-12

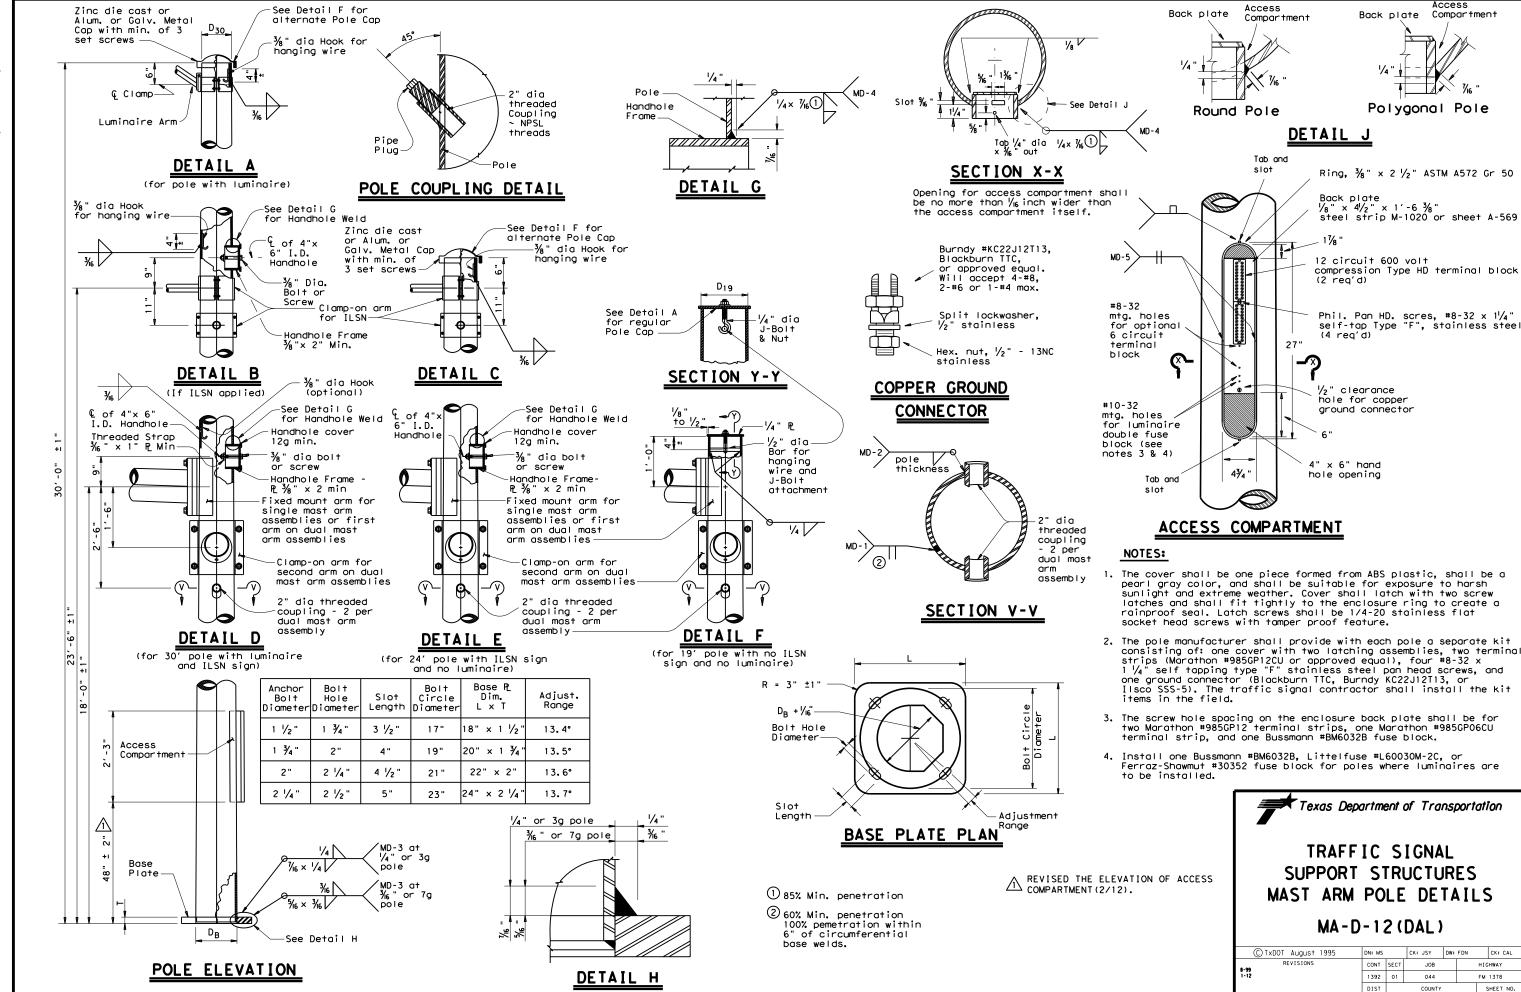


CK: CAL

265

DAL

Backplate

(See note 6)

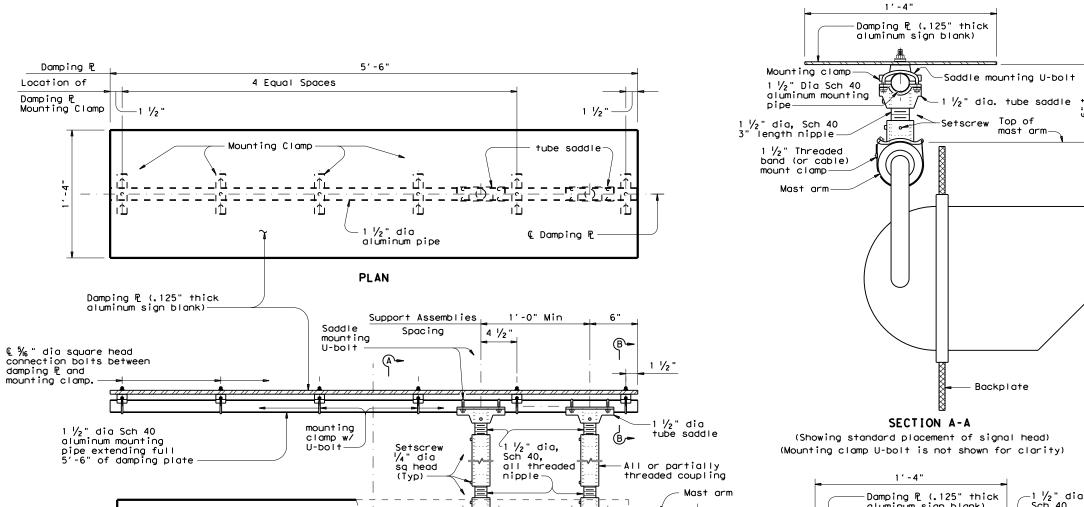

🖵 🖟 Damping 🏲 and signal head assembly

(A)-

ELEVATION


DAMPING PLATE MOUNTING DETAILS

(Showing alternate placement of signal head)

(Showing standard placement of signal head) (Mounting clamp U-bolt is not shown for clarity)

1/2" Threaded

mount clamp

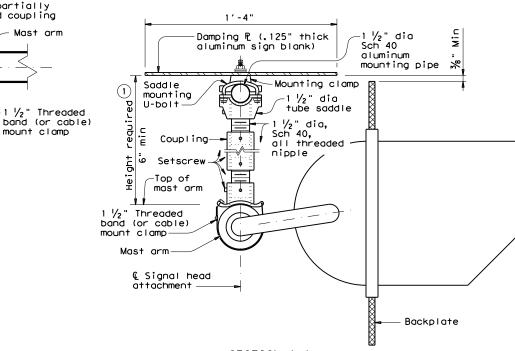

mast arm


SECTION A-A

(Showing alternate placement of signal head) (Mounting clamp U-bolt is not shown for clarity)

$\ensuremath{\bigcirc}$ Recommended supporting assemblies to achieve required height for horizontal section heads							
Height required	One nipple each length	Two nipples One coupling each length					
6"-6 3/4"	3"	-	-				
7"-8 ½"	4"	-	-				
9"-10 ½"	6"	-	-				
11"-15 1/2"	-	4"	5"				
16"-24"	-	6"	10"				

GENERAL NOTES:

- 1. In accordance with the findings of TxDOT sponsored research, the installation of a damping plate in accordance with the details shown here at the end of signal mast arms of SMA and DMA standard structures reduces excessive harmonic vertical vibration, and thus fatigue damage. Any deviation from these details may reduce the effectiveness of this damping device.
- Aluminum sign blank for damping plate will conform to Departmental Material Specifications DMS-7110. Materials for mast arm mounting clamp and tube saddle will be aluminum castings or aluminum alloys as in accordance with manufacturers' stipulations. Mounting pipe, pipe nipple and coupling will be aluminum alloy 6061-T6 or 6063-T6. Damping plate mounting clamp and u-bolt assemblies will conform to Standard sheet SMD(GEN). U-bolts for saddle mounting will have a minimum yield strength of 36 ksi.
- 3. Damping plate will be mounted horizontally.
 Position centerline of damping plate to align with
 centerline of mast arm or horizontal signal head assembly. Vertical clearance between signal head (with or without backing plate) and bottom of damping plate will be maintained as shown. The attachments shown here are examples only, other supporting details which meet both alignment and vertical clearance requirements are also acceptable.
- 4. Unless stipulated by the manufacturers, all steel parts will be galvanized finish in accordance with Standard Specification Item 445, "Galvanizing".
- 5. Contractor will verify applicable field dimensions before the installation.
- 6. Backplates are optional for traffic signals. When backplates are used, Backplates will have a 2-inch fluorescent yellow AASHTO Type B_{FL} or C_{FL} retroreflective border conforming to TxDOT DMS-8300 "Sign Face Materials." See Sheet TS-BP-20 for backplate details.



SECTION B-B


(Showing damping plate attachment)



MAST ARM DAMPING PLATE DETAILS

MA-DPD-20

FILE:ma-dpd-20.dgn	DN: Tx	DOT	ck: TxDOT	DW:	TxDOT	ck: TxDOT
© TxDOT January 2012	CONT	SECT	JOB		HIC	GHWAY
REVISIONS 6-20	1392	01	044		FM	1378
0-20	DIST		COUNTY			SHEET NO.
	18		COLLIN			266

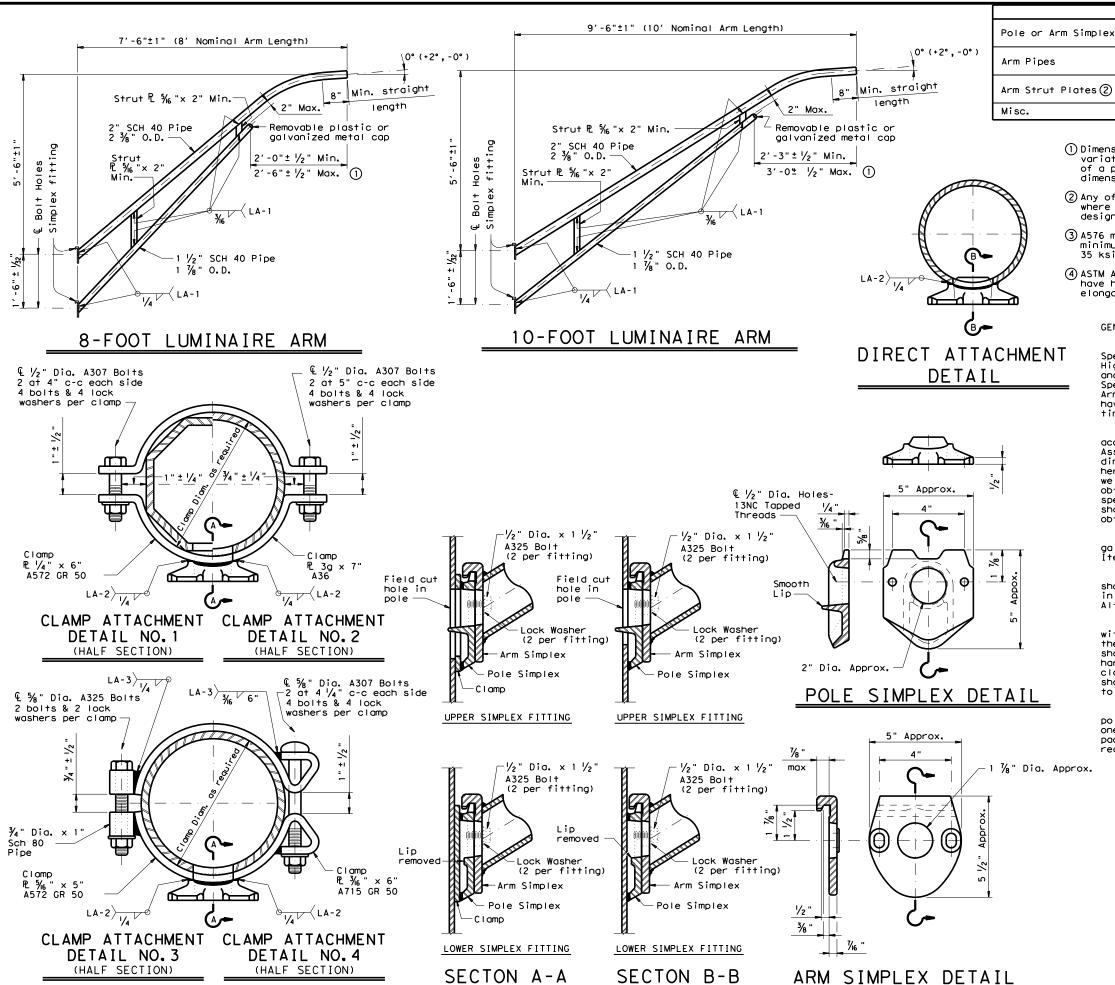

MATERIALS ASTM A27 Gr. 65-35 or A148 Gr. 80-50, A576 Gr. 1021 ③, or A36 (Arm only) ASTM A53 Gr.B, A501, A1008 HSLAS-F Gr.50 (4), or A1011 HSLAS-F Gr.50 (4) ASTM A36, A572 Gr.50 ④, or A588 ASTM designations as noted

- (1) Dimensional limits are given to show acceptable variation in design. All of a Fabricator's production of a particular arm length shall have the same dimensions within specified tolerances.
- 2) Any of the materials listed for plates may be used where the drawings do not specify a particular ASTM designation.
- (3) A576 must be suitable for forging and also meet minimum tensile strength of 65 ksi, minimum yield of 35 ksi, and elongation in 2 inches of 22 percent.
- 4 ASTM A572, A1008 HSLAS-F, and A1011 HSLAS-F may have higher yield strengths but shall not have less elongation than the grade indicated.

GENERAL NOTES:

Design conforms to 1994 AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals and Interim Revisions thereto. Design Wind Speed equals 90 mph plus a 1.3 gust factor. Arms are designed to support a 60 lb. luminaire having an effective projected area (actual area times drag coefficient) of 1.6 sq. ft.

Materials and fabrication shall be in accordance with Item 686, "Traffic Signal Pole Assemblies (Steel)" and with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. In the absense of specified Fabricaton tolerances, dimensions shall be within the tolerances generally obtainable in normal fabrication practice.

Unless otherwise noted, all parts shall be galvanized after fabrication in accordance with Item 445, "Galvanizina".

Deviation from the details and dimensions shown herein require submission of shop drawings in accordance with Item 441, "Steel Structures". Alternate designs are not acceptable.

Each pole simplex fitting shall be supplied with 2 ASTM A325 bolts and 2 lock washers of the size specified. The bolts and lock washers shall be secured to the pole with the other hardware items called for in the plans. When clamp attachment is specified, the Fabricator shall ship the clamp assembly securely attached to the pole at the location shown on the plans.

If clamp assemblies are ordered without poles, the Fabricator shall ship one upper and one lower clamp assembly together in a single package, including all nuts and washers required for the clamps and simplex fittings.



ARM DETAILS LUM-A-12

© TxDOT August 1995	DN: LEH	1	CK: JSY	DW:	LTT	CK: TEB
i-96 REVISIONS	CONT	SECT	JOB		HIC	HWAY
-99 -12	1392	01	044		FM	1378
	DIST		COUNTY			SHEET NO.
	18		COLLIN			267

EXAMPLE:

Type 1

R=d

1 ½" Min

Circular Steel Bottom Template

HOOKED ANCHOR

(TYPE 1)

ANCHOR BOLT ASSEMBLY

(8)Orient anchor bolts orthogonal with the fixed arm direction to

ensure that two bolts are in tension under dead load.

(Omit bottom template for FDN 24-A)

 $\frac{1}{4}$ " thk. min.

Circular Steel

Top Template

1. For 80mph design wind speed, foundation 30-A can support up to a 32' arm with another arm up to 28'

2. For 100mph design wind speed, foundation 36-A can support a single 36' mast arm.

2 Flat Washers

per Anchor Bolt


Type 2

NUT ANCHOR (TYPE 2)

Thickness =


<2 Sides</p>

-Heavy Hex Nut (Typ)

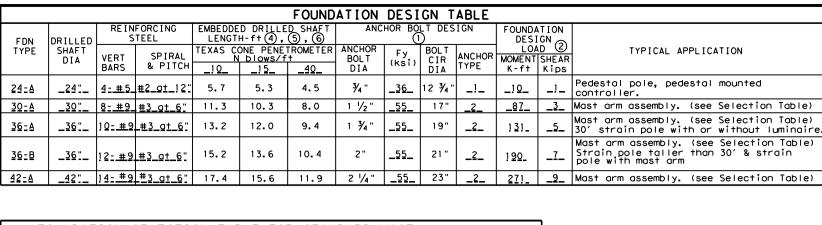

	FOUNDATION SELE ARM PLUS IL	CTION TABL SN SUPPORT	E FOR STAND ASSEMBLIES	ARD MAST (ft)	
		FDN 30-A	FDN 36-A	FDN 36-B	FDN 42-A
-	MAX SINGLE ARM LENGTH	32′	48′		
80 MPH DESIGN WIND SPEED		24′ X 24′			
	MAXIMUM DOUBLE ARM LENGTH COMBINATIONS	28' X 28'			
		32' X 28'	32′ X 32′		
			36′ X 36′		
ຂີ			40′ X 36′		
			44′ X 28′	44′ X 36′	
<u> </u>	MAX SINGLE ARM LENGTH		36′	44′	
20			24' X 24'		
100 MPH DESIGN WIND SPEED			28′ X 28′		
	MAXIMUM DOUBLE ARM LENGTH COMBINATIONS		32′ X 24′	32' X 32'	
	LENGTH COMBINATIONS			36′ X 36′	
		-		40′ ×24′	40' X 36'
					44' 70'

Span Wires



Use average N value over the top third of the


embedded shaft.


NOTES:


- Anchor bolt design develops the foundation capacity given under Foundation Design Loads.
- ② Foundation Design Loads are the allowable moments and shears at the base of the structure.
- 3 Foundations may be listed separately or grouped according to similarity location and type. Quantities are for the Contractor's information only
- (4) Field Penetrometer readings at a depth of approximately 3 to 5 feet may be used to adjust shaft lengths.
- (5) If rock is encountered, the Drilled Shaft shall extend a minimum of two

ANCHOR BOLT & TEMPLATE SIZES									
BOLT DIA IN.	7 BOLT LENGTH	TOP THREAD	BOTTOM THREAD	BOLT CIRCLE	R2	Rı			
¾ "	1'-6"	3"	_	12 3/4"	7 1/8"	5 % "			
1 1/2 "	3′-4"	6"	4"	17"	10"	7"			
1 3/4"	3'-10"	7"	4 1/2 "	19"	11 1/4"	7 3/4"			
2"	4'-3"	8"	5"	21"	12 ½"	8 1/2"			
2 1/4"	4'-9"	9"	5 ½"	23"	13 3/4"	9 1/4"			

7 Min dimensions given, longer bolts are acceptable.

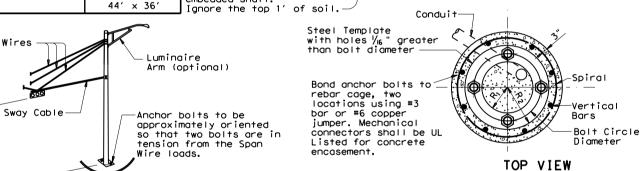

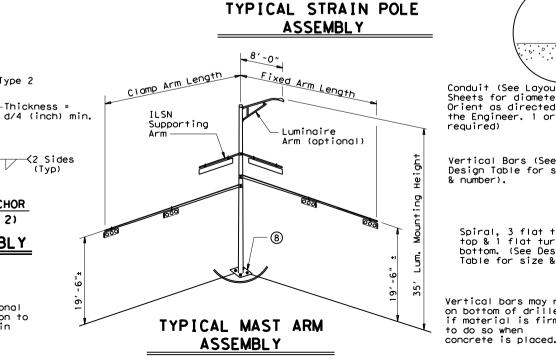

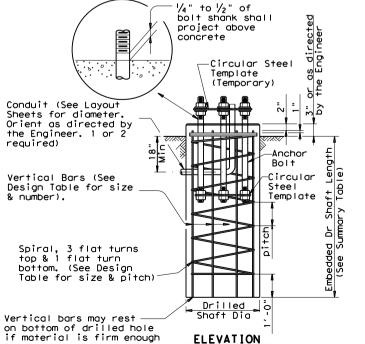

ELEVATION

FOUNDATION DETAILS

Threads for anchor bolts and nuts shall be rolled or cut threads of 8UN series up to 2" in diameter or UNC series for all sizes. Bolts and nuts shall have Class 2A and 2B fit tolerances.

Anchor bolts that are larger than 1" in diameter shall conform to "alloy steel" or "medium-strength mild steel" per Item 449, "Anchor Bolts". Anchor bolts that are 1" in diameter or less shall conform to ASTM A36. Galvanize a minimum of the top end thread length plus 6" for all anchor bolts unless otherwise noted. Exposed washers and exposed nuts shall be galvanized. All galvanizing shall be in accordance with Item 445, "Galvanizing".

Templates and embedded nuts need not be galvanized. Lubricate and tighten anchor bolts when erecting the structure in accordance with Item 449, "Anchor Bolts".



TRAFFIC SIGNAL POLE FOUNDATION

TS-FD-12

	© TxDOT August 1995	DN: MS		CK: JSY	DW:	MAO/MMF	CK: JSY/TEB
5-96	5-96 REVISIONS		SECT	JOB		-	HIGHWAY
5-96 11-99 1-12		1392	01	044		F١	1 1 3 7 8
		DIST		COUNTY			SHEET NO.
		DAL		COLLI	N		268

diameters into solid rock.

(6) Decimal lengths in Design Table are to allow interpolation for other penetrometer values. Round to nearest foot for entry into Summary Table.

> TOTAL DRILLED SHAFT LENGTHS *SUBSIDIARY TO ITEM 685
> **SUBSIDIARY TO ITEM 687

GENERAL NOTES:

Design conforms to 1994 AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals and interim revisions thereto.

Reinforcing steel shall conform to Item 440, "Reinforcing Steel".

24

FOUNDATION SUMMARY TABLE

NO.

TYPE EA

DRILLED SHAFT LENGTH 6

(FEET)

24-A 30-A 36-A 36-B 42-A

AVG. FDN

BLOW

/ft.

10

24-A

10 24-A

10 24-A

LOCATION

DENTIFICATION

FM 1378

FM 3826


ΡЗ

*P7

Concrete shall be Class "C".


Galvanized nuts shall be tapped after galvanizing.


RADAR DETECTION ZONE LOCATIONS

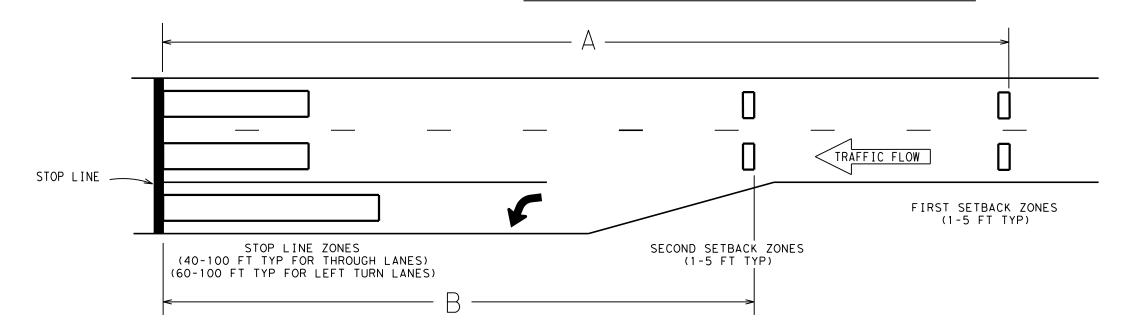


APPROACH SPEED LIMIT (MPH)	DISTANCE A (FT)	DISTANCE B (FT)	MINIMUM RANGE OF DETECTION (LF)
45	360	245	400
50	405	300	440
55	445	325	490
60	485	355	530
65	525	380	575
70	565	410	620

RADAR DETECTION INSTALLATION DETAILS

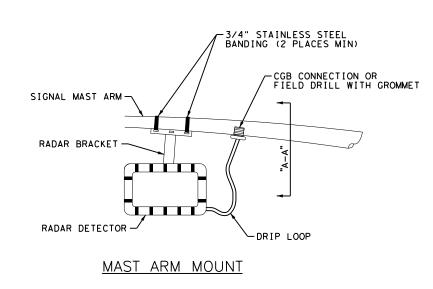

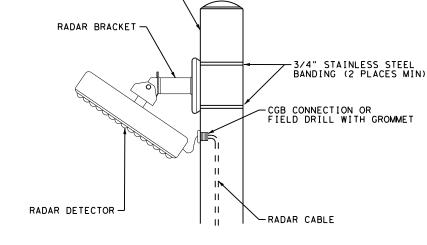

POLE MOUNT

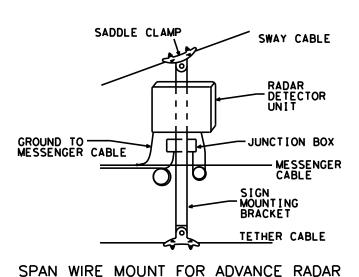

NOTES:

SIGNAL MAST ARM POLE

CGB CONNECTION OR FIELD DRILL WITH GROMMET

-3/4" STAINLESS STEEL BANDING (2 PLACES MIN)

SECTION "A-A"

SIGNAL MAST ARM-

RADAR DETECTOR -


- 1. THE RADAR SENSOR MOUNTING BRACKET MUST BE ADJUSTABLE TO TILT UP, DOWN, LEFT, RIGHT, AND TO ROTATE.
- 2. THE RADAR DETECTOR UNITS SHOWN ARE NOT INTENDED TO REPRESENT ANY SPECIFIC BRAND OR PRODUCT, AND ALTERNATE MOUNTING METHODS MAY BE SUBMITTED FOR APPROVAL.





RADAR VEHICLE
DETECTION SYSTEM
RVDS-18 (DAL)

CK: - TRF - Aus.	DW: - EF	CK:	DN: - EF	y 2018	© TxDOT Ma
HIGHWAY NO.	T NO.	AID PROJEC	FED.RD. DIV.NO.	REVISIONS	
FM 1378	SHEET)	SEE TITLE SHEET		6	
SHEET NO.	ГҮ	COUN.	DISTRICT	STATE	
000	LIN	COL	18	TEXAS	
269		JOB	SECTION	CONTROL	
	4	04	01	1392	

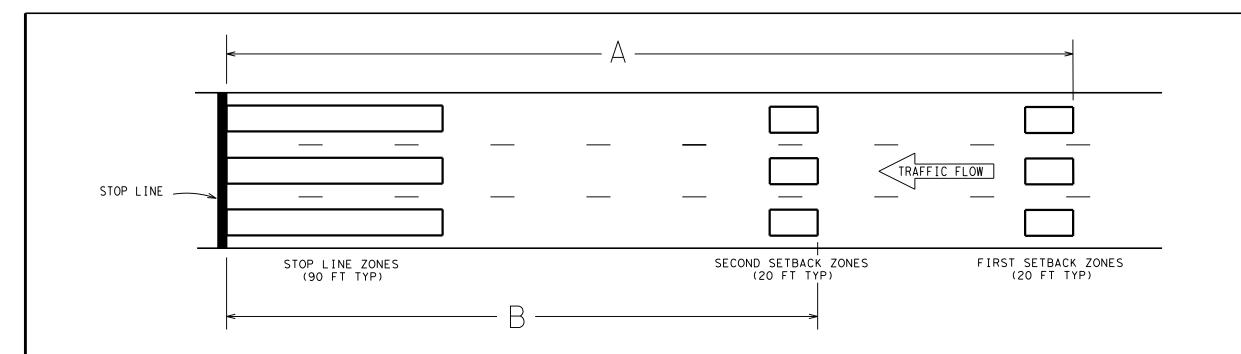

APPROACH	DISTANCE 2	1	CAMERA HEIGHT (FT)									
SPEED LIMIT	BETWEEN CAMERA AND	DISTANCE '	24	28	32	36	40	24	28	32	36	40
(MPH)	I STOP LINE I ACTA		DISTANCE B (FT)					EXTENSION ON 2ND DET. ZONE (SEC.)				
60	80	470	280	295	305	310	315	0.0	0.0	0.0	0.5	0.5
00	150	470	270	285	295	300	310	0.0	0.0	0.0	0.0	0.5
55	80	430	255	265	275	280	285	0.0	0.0	0.0	0.5	0.5
55	150	430	245	255	265	275	280	0.0	0.0	0.0	0.0	0.5
F.0	80	390	235	245	250	255	260	0.0	0.0	0.5	0.5	0.5
50	150	390	220	230	240	245	250	0.0	0.0	0.0	0.0	0.5
45	80	350	210	215	220	225	230	0.0	0.0	0.5	0.5	0.5
45	150	350	190	200	210	215	220	0.0	0.0	0.0	0.0	0.5

- 1. Distances shown are based on a 20' detection zone and a 1.0 second passage time setting.
- 2. Distance between the camera and the stop line, as measured parallel to the direction of travel.

DALLAS DISTRICT STANDARD




VIDEO DETECTION ZONE PLACEMENT VDZ-04 (DAL)

CK: - TRF - Aus.	DW: - BES	ck: - CDB	DN: - THW	ptember 2004	© 1xD01 Se
HIGHWAY NO.	T NO.	FEDERAL AID PROJECT NO.		FED.RD. DIV.NO.	REVISIONS
FM 1378	SHEET)	TITLE S	(SEE	6	
SHEET NO.	ГҮ	COUN.	DISTRICT	STATE	
	LIN	COL	18	TEXAS	
27()		JOB	SECTION	CONTROL	
_, _	4	04	01	1392	

NOTES:

- 1. INSTALL $1\frac{1}{2}$ " ALL THREAD NIPPLE WITH BONDING BUSHINGS ON BOTH ENDS AND 6 EA OF $\frac{1}{2}$ " X $1\frac{1}{2}$ " 13 UNC MOUNTING BOLTS BETWEEN THE TWO CABINETS (SIGNAL AND BBU).
- 2. INSTALL 2 " FITTING FOR EVP CABLES/WIRES AND 4 EA OF $\frac{1}{2}$ " X $\frac{1}{2}$ " 13 UNC MOUNTING BOLTS BETWEEN THE TWO CABINETS (SIGNAL AND EVP).
- 3. USE SILICON SEALANT TO SEAL BETWEEN THE CABINETS OF THE CONTROLLER, EVP AND BBU UNIT.
- 4. THE ABOVE WORK PERFORMED AND MATERIALS FURNISHED WILL NOT BE PAID FOR DIRECTLY, BUT WILL BE SUBSIDIARY TO PERTINENT ITEMS.

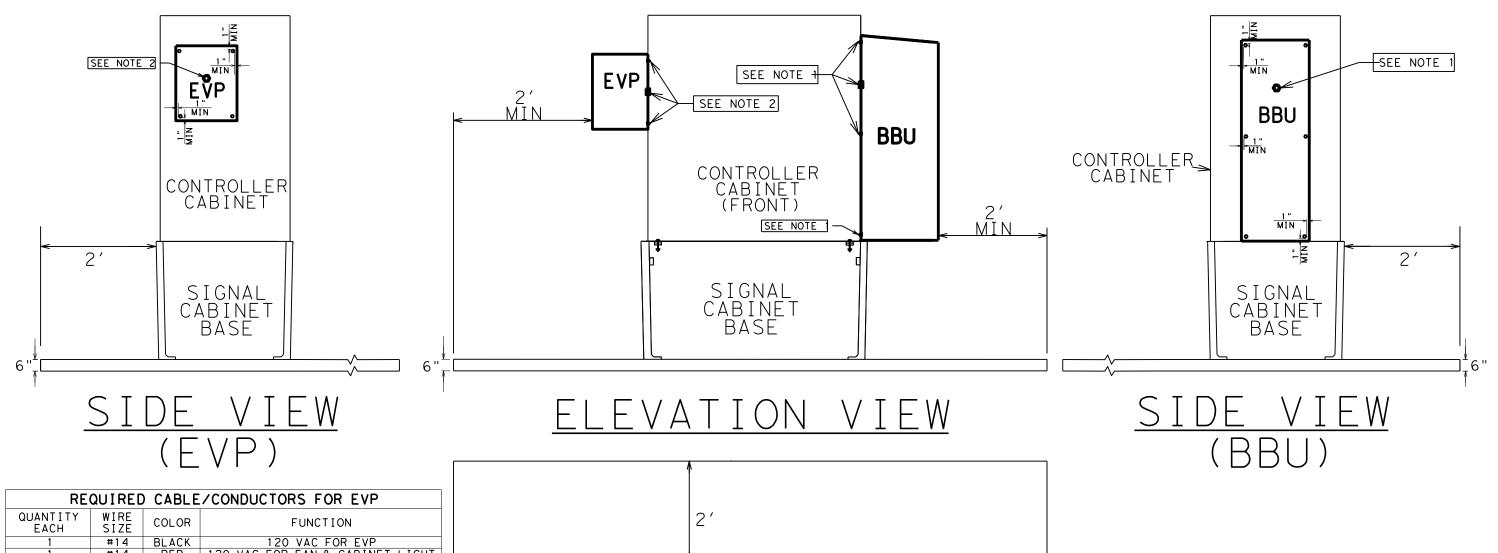


REQUIRED CABLE/CONDUCTORS FOR EVP										
QUANTITY EACH	WIRE SIZE	COLOR	FUNCTION							
1	#14	BLACK	120 VAC FOR EVP							
1	#14	RED	120 VAC FOR FAN & CABINET LIGHT							
1	#14	WHITE	AC NEUTRAL							
1	#14	GREEN	CHASIS GROUND							
1	#18	GRAY	LOGIC GROUND							
4	#18	BLUE	PREEMPT COMMANDS							
4	-	-	CABLE FROM DETECTOR UNIT							

	REQUIRED CONDUCTORS FOR BBU								
QUANTITY EACH	WIRE SIZE	COLOR	FUNCTION						
1	-	BLACK	120 VAC FROM SERVICE						
1	-	WHITE	AC NEUTRAL FROM SERVICE						
1	#6	BLACK	120 VAC TO CONTROLLER						
1	#6	WHITE	AC NEUTRAL TO CONTROLLER						
1	#6	GREEN	GROUND						

LEGEND:

EVP-EMERGENCY VEHICLE PREEMPTION CABINET. BBU-BATTERY BACKUP UNIT.

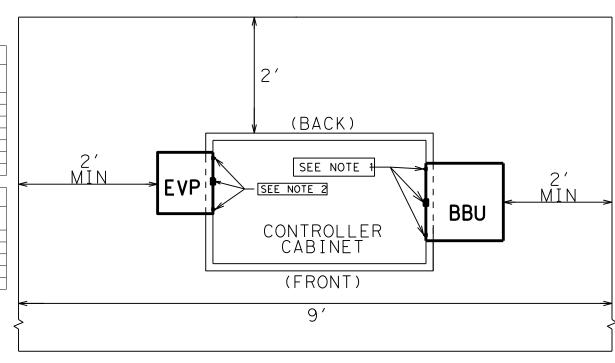


<u>Plan view</u>



INSTALLATION OF BBU/EVP EXTERNAL SIDE MOUNT CABINET INSTALLATION DETAILS DALLAS DISTRICT STANDARD

N.T.S.		SHEET	1 OF 3
FED.RD. DIV.NO.	FEDERA	HIGHWAY NO.	
6	(SEE	FM 1378	
STATE	DISTRICT	COUNTY	SHEET NO.
TEXAS	DAL	COLLIN	
CONTROL	SECTION	JOB	2711
1392	01	044	_ ' '

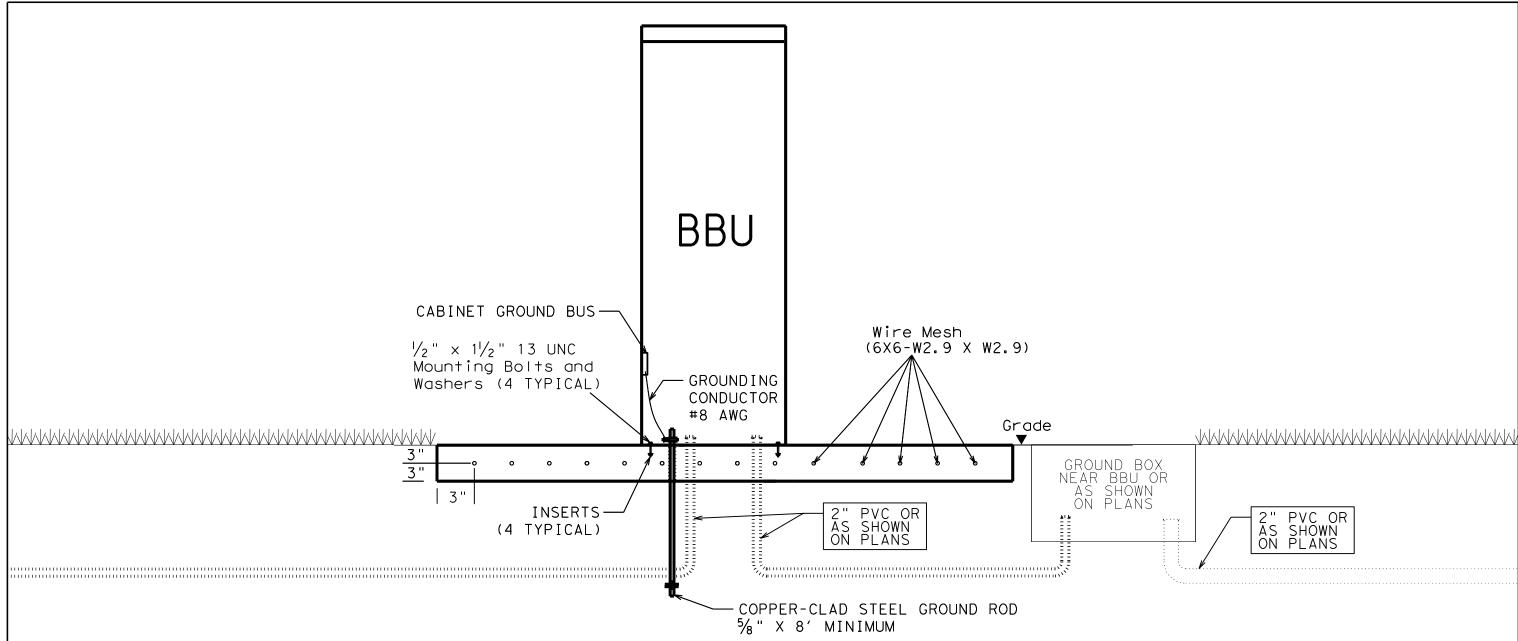


NOTES:

- 1. INSTALL A 5' X 5' CONCRETE PAD AT THE LOCATION DIRECTED BY THE ENGINEER. THE PAD MAY BE CAST-IN-PLACE OR PRE-CAST AS APPROVED BY THE ENGINEER.
- 2. PROVIDE WELDED WIRE MESH 6X6-W2.9 X W2.9 FOR REINFORCEMENT. PROVIDE JOINTS AND SPLICES IN THE MESH WITH A MINIMUM 6-INCH OVERLAP. PROVIDE A MINIMUM 3 INCH COVER BETWEEN WIRE MESH AND EDGE OF CONCRETE PAD.
- 3. PROVIDE CLASS B CONCRETE MINIMUM FOR THE CONCRETE PAD IN ACCORDANCE WITH ITEM 421. CONSTRUCT THE CONCRETE PAD IN ACCORDANCE WITH ITEM 531, EXCEPT FOR PAYMENT.
- 4. INSTALL THE BACK OF BBU CABINET 10" FROM THE EDGE OF CONCRETE PAD AND CENTER THE CABINET ON THE PAD FROM SIDE TO SIDE.
- 5. SUPPLY FOUR 1/2" X 11/2" 13 UNC STAINLESS STEEL INSERTS FOR ATTACHMENT OF THE BBU CABINET TO THE CONCRETE PAD.
 INSERTS MUST WITHSTAND A MINIMUM TORQUE OF 50 FT-LB AND A MINIMUM STRAIGHT PULL OUT STRENGTH OF 750 LBS.
- 6. BOND A #8 AWG COPPER GROUND WIRE AND AN 8 FT GROUND ROD TO THE REINFORCING MESH WITH A SUITABLE UL LISTED CLAMP. AND TERMINATE THE GROUND WIRE TO THE CABINET GROUNDING BUS.
- 7. INSTALL A PVC SLEEVE TO PREVENT THE GROUND ROD FROM DIRECT EMBEDMENT IN THE CONCRETE PAD.
- 8. THE ABOVE WORK PERFORMED AND MATERIALS FURNISHED WILL NOT BE PAID FOR DIRECTLY, BUT WILL BE SUBSIDIARY TO PERTINENT ITEMS.

Texas Department of Transportation © 2012

INSTALLATION OF BBU/EVP STAND ALONE BBU CABINET (GROUND MOUNT) DALLAS DISTRICT STANDARD

2 OF 3	SHEET		N.T.S.
HIGHWAY NO.	L AID PROJECT NO.	FEDERA	FED.RD. DIV.NO.
FM 1378	TITLE SHEET)	(SEE	6
SHEET NO.	COUNTY	DISTRICT	STATE
	COLLIN	18	TEXAS
272	JOB	SECTION	CONTROL
- 	044	01	1392

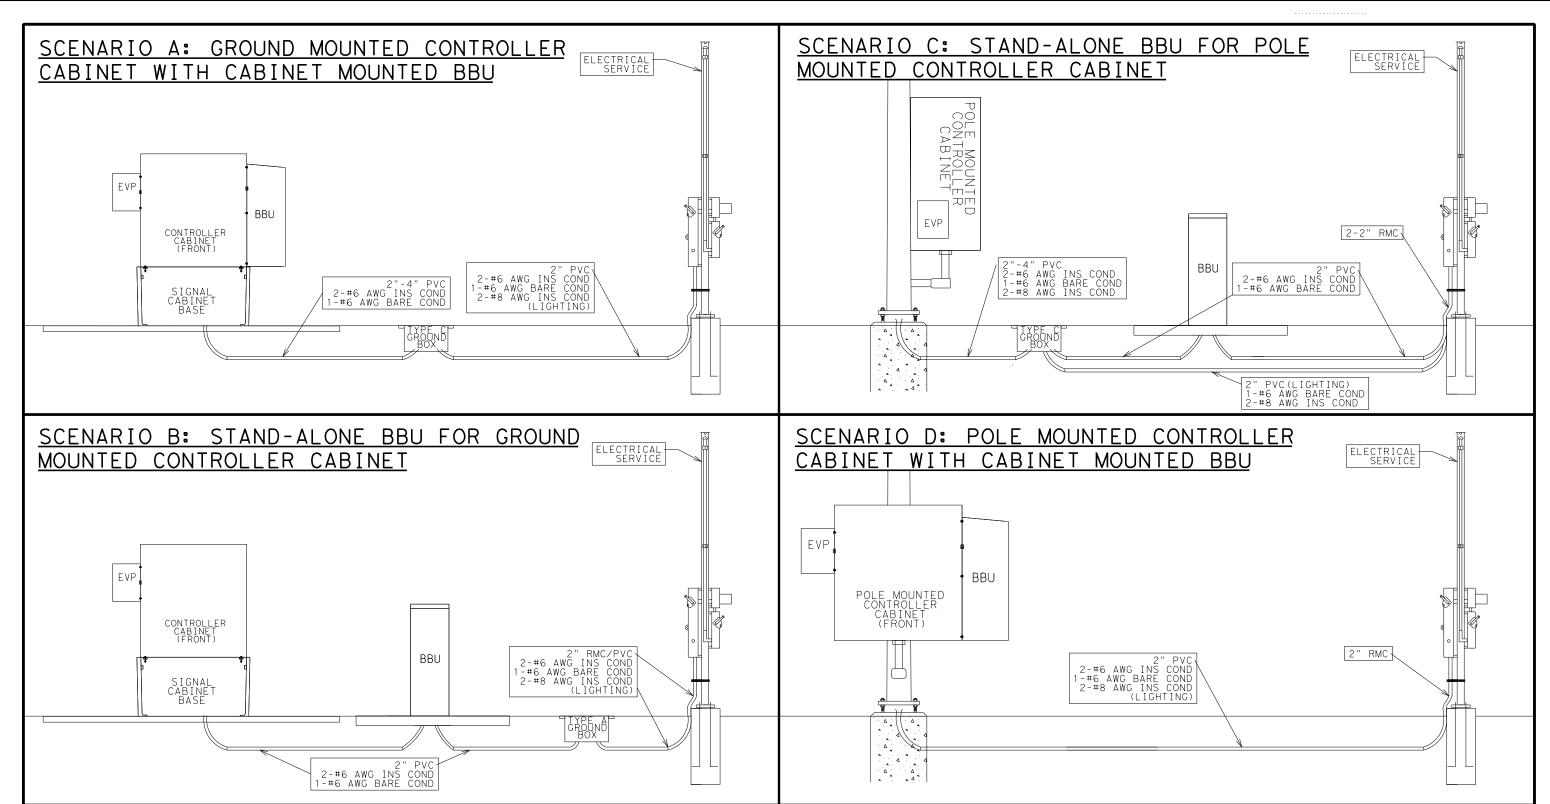


NOTE:

ABOVE SCENARIOS ARE TYPICAL BBU/EVP INSTALLATIONS USED IN THE DALLAS DISTRICT. SEE TRAFFIC SIGNAL DESIGN PLANS FOR GROUND BOX, CONDUIT AND CONDUCTOR QUANTITIES AND SIZES SPECIFIC TO EACH INTERSECTION.



INSTALLATION OF BBU/EVP INSTALLATION SCENARIOS DALLAS DISTRICT STANDARD

N.T.S.		SHEET	3 OF 3
FED.RD. DIV.NO.	FEDERA	L AID PROJECT NO.	HIGHWAY NO.
6	(SEE	TITLE SHEET)	FM 1378
STATE	DISTRICT	COUNTY	SHEET NO.
TEXAS	18	COLLIN	
CONTROL	SECTION	JOB	273
1392	0.1	044	_, _









PEDESTRIAN PUSHBUTTON SIGN DETAILS



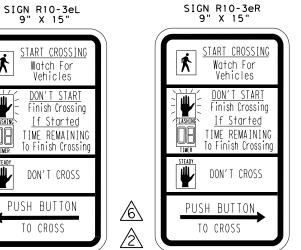

COUNTDOWN PEDESTRIAN PUSHBUTTON

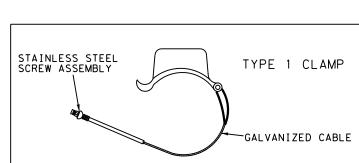



NOTE: EITHER TYPE 1 CLAMPS OR CLAM SHELL MOUNTING HARDWARE MAY BE USED AS APPROVED BY THE ENGINEER. FOR CLAM SHELLS, USE ICC P/N 4805 OR McCAIN QUICKMOUNT OR APPROVED EQUAL.

ALTERNATIVE MOUNTING METHOD /1\ revised 12-92

ALTERNATIVE PEDESTRIAN SIGNAL /2\ HEAD AND SIGNING revised 10-08


PEDESTRIAN PUSH 3 BUTTON POLE revised 01-11

PEDESTRIAN PUSH BUTTON POLE 4 GROUNDING DETAILS revised 09-15

APS UNIT ADDED "SYMBOLS ONLY" PEDESTRIAN SIGNAL HEAD REMOVED MOUNTING HARDWARE NOTES MOUNTING HEIGHT REVISED revised 06-17

APS SIUN NEVIZ revised 11-20 APS SIGN REVISED






PEDESTRIAN SIGNAL HEAD MOUNTING

FOR ONE PEDESTRIAN SIGNAL HEAD


152A

TYPE 1 CLAMP


PEDESTRIAN SIGNAL HEAD MOUNTING FOR TWO PEDESTRIAN SIGNAL HEADS 143C

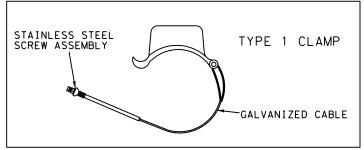


PEDESTRIAN PUSH BUTTON POLE GROUNDING DETAILS

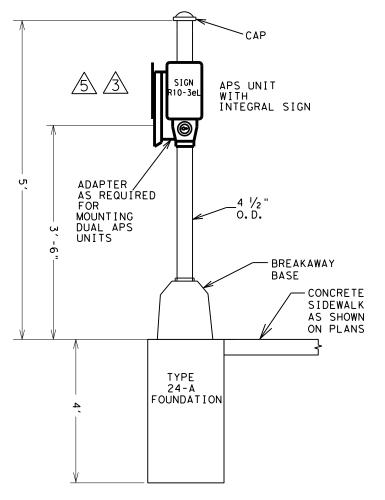

PEDESTRIAN PUSH BUTTON POLE

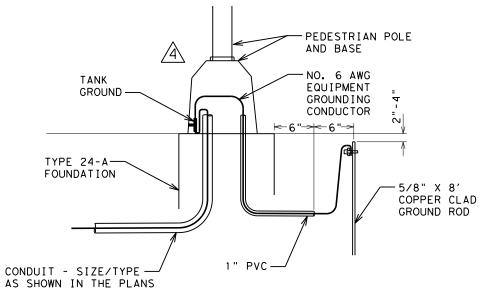

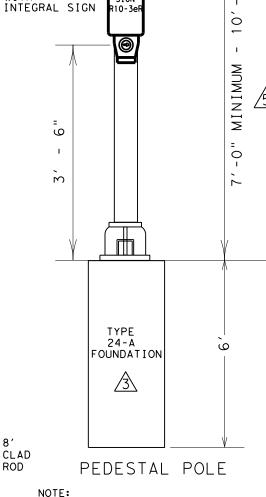

MAXIMUM

0

NOTE:

APS UNIT

THE POLES ON THIS DRAWING ARE SHOWN AS AN EXAMPLE ONLY. POLES OF SIMILAR DESIGN FOR ANY CROSS SECTION WHICH MEET THE SPECIFICATIONS AND REQUIREMENTS SHOWN ON THESE DRAWINGS AND ARE APPROVED BY THE ENGINEER WILL BE DEEMED ACCEPTABLE.

PEDESTRIAN SIGNAL HEAD DETAILS (DAL)


		(C) T>	(DOT 20	20	
DALL	AS	DIST	RICT S	TAND	ARD
FED. RD. DIV. NO.		PRO	JECT NO.		SHEET NO.
6	(274			
STATE		STATE DIST.	co	UNTY	
TEXA	S	18	COL	LIN	
CONT		SECT.	JOB	H [GHW	AY NO.
1392		01	044	FM	1378


NOTES:


/5\ 1. ALL PEDESTRIAN SIGNAL HEADS SHALL BE INSTALLED ON THE AWAY-FROM-TRAFFIC SIDE OF THE PEDESTAL OR MAST ARM POLE.


2. ALL WIRING FOR PEDESTRIAN SIGNALS SHALL BE TOTALLY ENCLOSED WITHIN THE SIGNAL MOUNTING HARDWARE.

3. ALL PEDESTRIAN SIGNAL HEADS AND PUSH BUTTON SIGNS SHALL DISPLAY THE SYMBOLIZED MESSAGES SHOWN ABOVE.










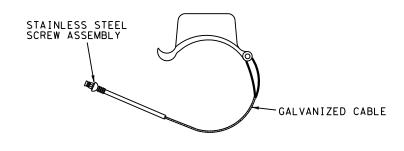



TYPE 1 AND 2 CLAMPS









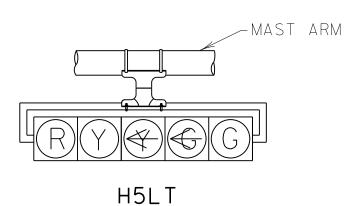



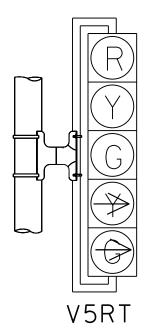



TYPE 2 CLAMP KIT


SHALL BE INSTALLED WHEN ROTATION ABOUT THE HORIZONTAL AND VERTICAL AXES ARE NEEDED.

NOTES:

- 1. VEHICLE SIGNAL HEADS SHALL BE MOUNTED WITH TYPE 1 CLAMP AND APPROPRIATE TUBING.
- 2. ALL POLE MOUNTED VEHICLE HEADS SHALL BE INSTALLED ON THE AWAY-FROM-TRAFFIC SIDE OF THE PEDESTAL OR MAST ARM POLE.
- 3. THE SIGNAL HEADS SHOWN ARE NOT MEANT TO REFLECT ALL POSSIBLE SIGNAL HEADS, BUT ARE REPRESENTATIVE OF SIGNAL HEADS COMMONLY IN USE. SEE THE TRAFFIC SIGNAL LAYOUT FOR REQUIRED SIGNAL HEADS, AND THE NUMBER AND ORIENTATION OF LOUVERS.

TRAFFIC SIGNAL HEAD DETAILS (DAL)

DALLA	_		XDOT 2		DARD	
FED. RD. DIV. NO.	FE	DERAL A	AID PROJECT	NO.	SHEET NO.	
6	(S	EE TI	TLE SHEE	T)	275	
STATE		TATE DIST.	,	COUNTY		
TEXAS DALLAS COLLIN						
CONT.		SECT.	JOB	H [GHWAY	NO.	
1392		01	044	FN 1.	378	

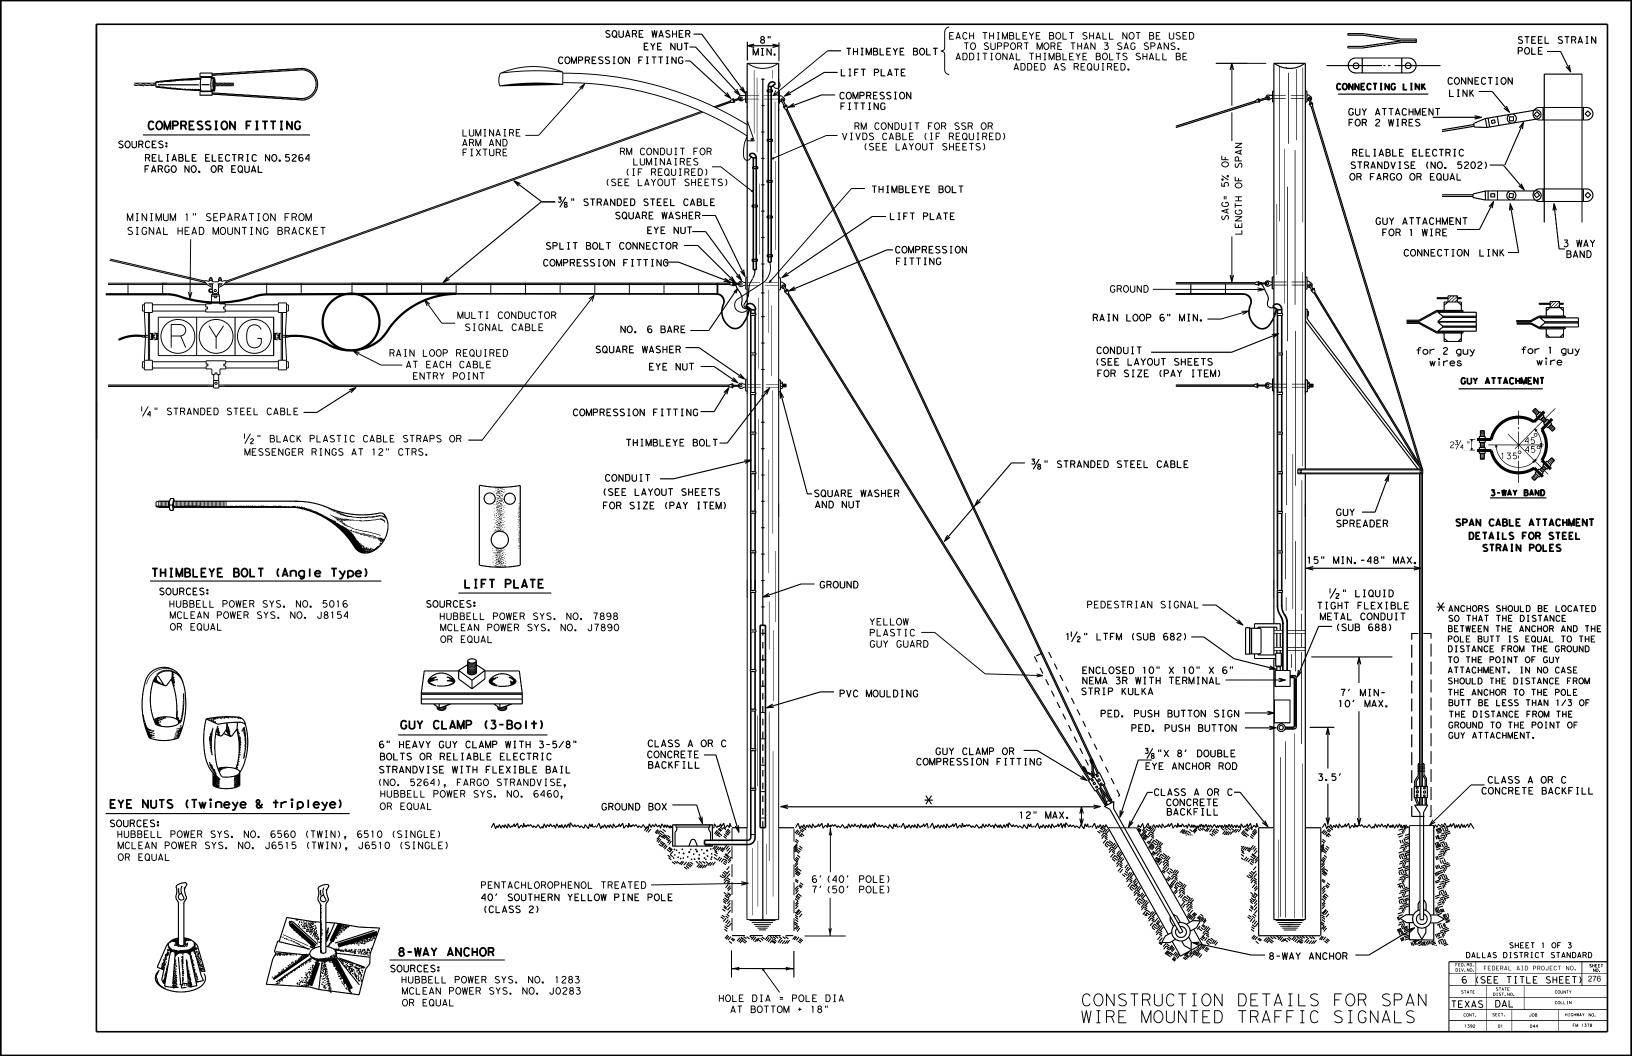

TETHER ASSY


BOTTOM TETHERED, SPAN WIRE SIGNAL HEAD HARDWARE ASSEMBLY (BACKPLATE NOT SHOWN)


ITEM	DESCRIPTION	QTY
1	SPAN WIRE CLAMP, IRON, W/ U-BOLTS	1
2	SPAN WIRE ADAPTER, ALUM W/ STAINLESS BUSHING	1
3	TEE HORIZONTAL SLIP, DIE CAST ALUM	2
4	SCREW, SET SQ HD, 1/4"-20 X 1/2", STAINLESS	6
5	TUBE, 1½" X LENGTH, ALUM	2
6	TUBE CAP, 11/2", PLASTIC	4
7	SCREW, SET SQ HD, 56"-18 X 58", STAINLESS	8
8	CGB, ¾ " .5565, ZINC 1	1
9	CAST ARM, FOR HORIZONTAL MOUNTED SIGNAL, ALUM	2
10	GASKET, TRI-BOLT, 1/16 " X 70 DURO NEOPRENE	2
11	WASHER, SLOTTED, ZINC 2	2
12	WASHER, LOCK SPLIT, 1/4", STAINLESS	6
13	BOLT, HEX HD, $\frac{1}{4}$ "-20 X $\frac{1}{2}$ ", GRADE 5, STAINLESS	6
14	NIPPLE, ALLTHREAD, 11/2" NPS X 2.13", ALUM	1
15	SCREW, SET SQ HD, 1/4"-20 X 1/8", STAINLESS	1
16	BODY, 11/2", HANGER, ALUM	1
17	BOLT, HEX HD, 5/6 "-18 X 11/2", STAINLESS	1
18	PLATE, TETHER, 1-HOLE, ALUM	1
19	WASHER, FENDER, 56", STAINLESS	1
20	WASHER, SPLIT LOCK, 1/6", STAINLESS	1
21	NUT, HEX HD, 1/6 "-18, STAINLESS	1
22	CAP. EN-3/4. BLUE (FOR CGB)	1






"EGGCRATE" VISOR PEDESTRIAN SIGNAL WITH ONE-PIECE REFLECTOR

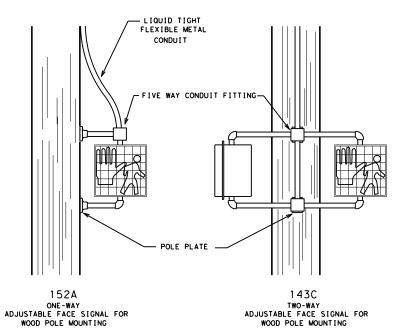



PEDESTRIAN PUSHBUTTON SIGN DETAILS



H5LT


TYPICAL SPAN WIRE HORIZONTAL MOUNT INSTALLATION




TYPICAL SPAN WIRE


HORIZONTAL MOUNT

H4LT




Н3 TYPICAL SPAN WIRE HORIZONTAL MOUNT INSTALLATION




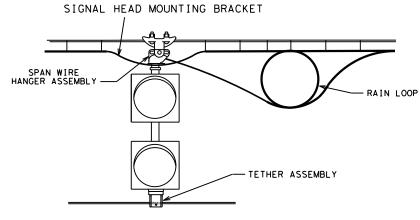

TYPICAL ONE-WAY FLASHING BEACON INSTALLATION

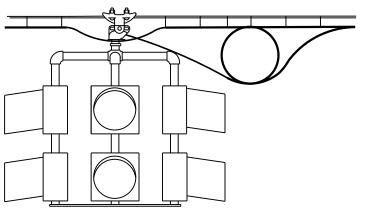

TYPICAL FOUR-WAY FLASHING BEACON INSTALLATION



SPAN WIRE FLASHING BEACON SIGNAL HEAD HANGER ASSEMBLY

SPAN WIRE FLASHING BEACON SIGNAL HEAD HANGER ASSEMBLY

	STONAL HEAD HANGEN ASSEMBLE	
ITEM	DESCRIPTION	QTY
1	SPAN WIRE CLAMP, IRON, W/ U-BOLTS	1
2	WIRE OUTLET BODY, 3/4", ALUM	1
3	SET SCREW, SQUARE HD, CUP POINT, 1/4"-20X5/8", TYPE 304 STAINLESS	1
4	LOCKRING, SERRATED, 380 DIE CAST ALUM	1
5	GASKET, 70 DURO NEOPRENE	1
6	NIPPLE, HEX, 1-1/2" NPS, ALUM	1
7	KIT, SIGNAL CLOSURE	1
8	GROMMET, 1-1/2", W/ DIAPHRAGM	1


SHEET 2 OF 3 DALLAS DISTRICT STANDARD


FED.RD. FEDERAL AID PROJECT NO. SHEET NO. 6 (SEE TITLE SHEET) 277 TEXAS DAL COLLIN

CONT. SECT. JOB HIGHWAY NO.


1392 01 044 FM 1378

CONSTRUCTION DETAILS FOR SPAN WIRE MOUNTED TRAFFIC SIGNALS

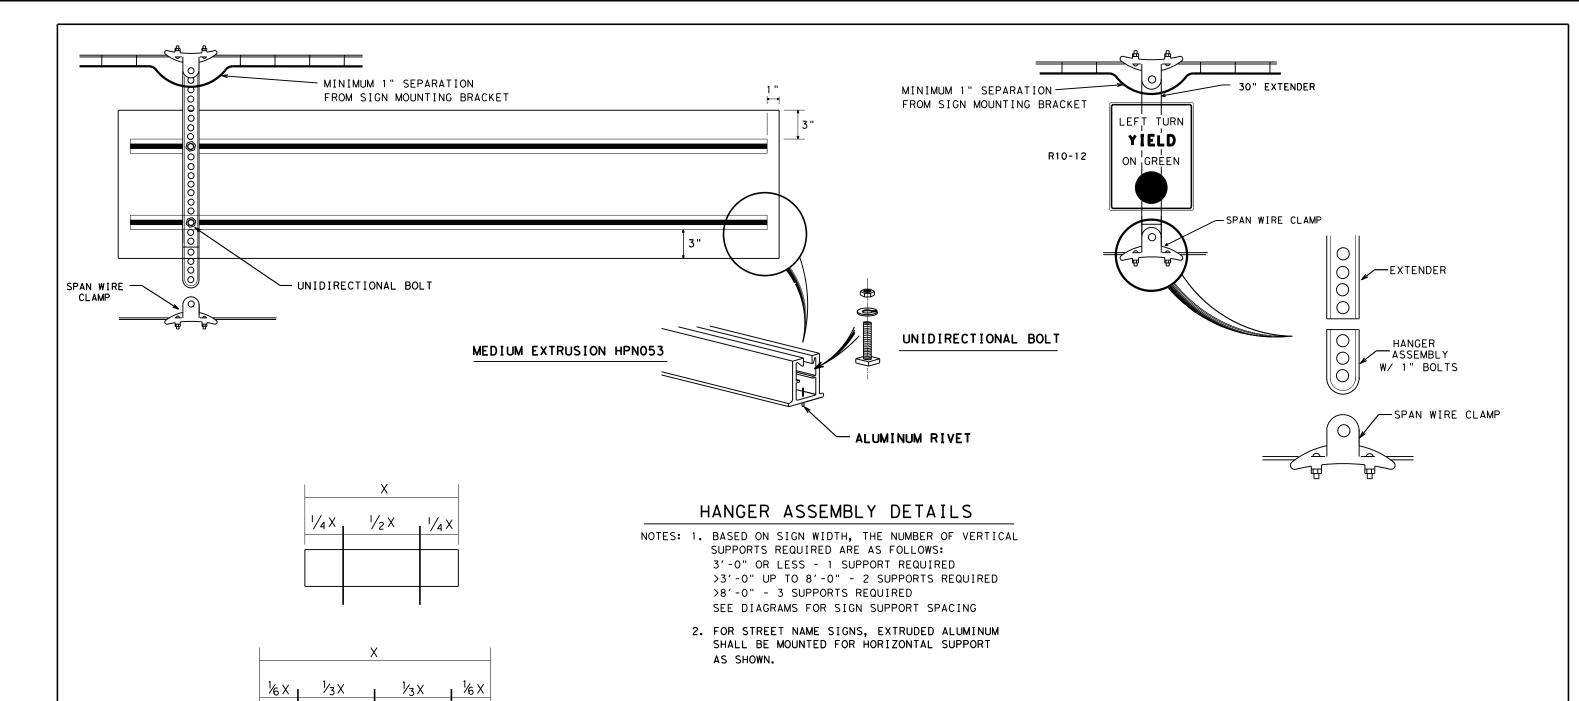

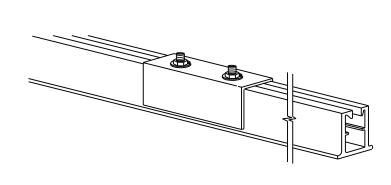

5" ALUMINUM COUPLING
6061-T6




ALUMINUM RIVET


NOTE: ALUMINUM RIVETS SHALL BE USED TO ATTACH
THE SIGN TO THE EXTRUDED ALUMINUM. SPACINGS
OF RIVETS SHALL BE 6" O.C.

SHEET 3 OF 3
DALLAS DISTRICT STANDARD


FED. RD. DIV. NO.	F	FEDERAL AID PROJECT NO. SHEET NO.							
6	(S	EΕ	TI.	TLE	SH	EET)	278		
STATE		STATE DIST. NO.		COUNTY					
TEXA	١S	DAL		COLLIN					
CONT	ONT, SECT.		JOI	JOB H[GHWAY		NO.			
1392		01		044		FM	1378		

CONSTRUCTION DETAILS FOR SPAN WIRE MOUNTED TRAFFIC SIGNALS

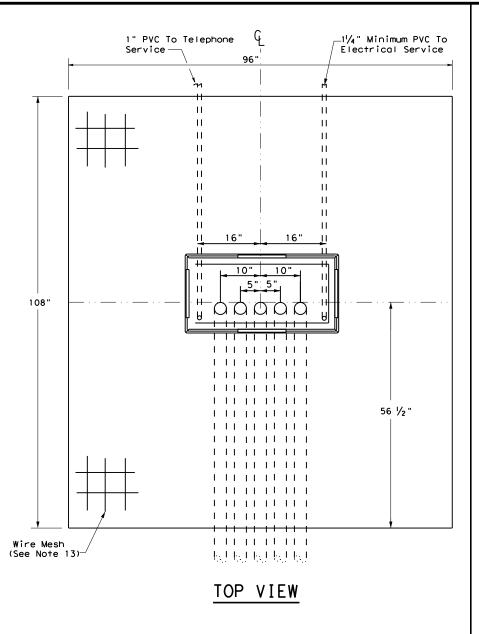

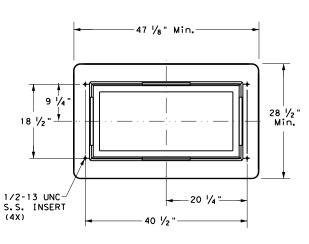

CABINET BASE

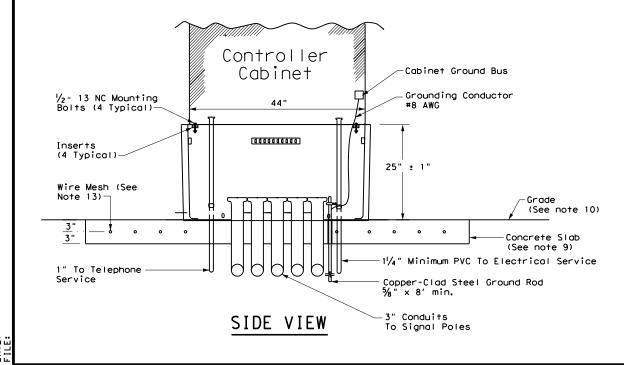

TRAFFIC SIGNAL CONTROLLER BASE:

- Provide a traffic signal controller base (cabinet base) manufactured of polymer concrete material consisting
 of calcareous and siliceous stone; glass fibers and thermoset polyester resin. The polymer concrete cabinet
 base must be reinforced on the inside of the cabinet base with fiberglass matting. Provide one of the
 following bases: Armorcast Part # A6001848X24, Quazite Model # PG3048Z709, or other as approved by TxDOT
 Traffic Safety Division.
- 2. The polymer concrete material must have a minimum compressive strength of 10,300 pounds per square inch (psi), minimum flexural strength of 3600 psi, and minimum shear strength of 3600 psi.
- The polymer concrete cabinet base must conform to the dimensions shown and must accommodate a standard TxDOT basemount cabinet.
- 4. Supply the cabinet base with four 1#2"-13 UNC stainless steel inserts for attachment of the cabinet to the base. Inserts must withstand a minimum torque of 50 ft-lb and a minimum straight pull out strength of 750 lbs.
- 5. Provide the cabinet base with 4 cable racks mounted one on each side of the base 2" to 7 " from the top edge of the base. Unless approved otherwise, cable racks must be 1-1/2 x 9#16x 3#16inch steel channel with eight T-slots spaced at 1-1/2 inches. The cable racks must easily accommodate the insertion of tie wraps to attach field wiring to the racks to serve as strain relief. Secure cable racks to the base using 1#2"-13 UNC stainless steel screws and inserts.
- 6. The cabinet base, when secured to the concrete slab with controller cabinet attached, must withstand a minimum wind load of 125 mph or a 850 lb force applied at 49" above the bottom of the base without causing the base or cabinet to come out of their anchored position or cause any permanent deformation. The manufacturer must supply certification by an independent testing laboratory or sealed by a Texas Licensed Professional Engineer. Provide the cabinet base with hardware for attachment to a concrete slab.
- The traffic signal base must be permanently marked either by impress or by permanent ink with the manufacturer's model number and name or logo.
- 8. Seal the base to the concrete with a silicone caulk bead and fastened to the slab per manufacturer's instructions.

CONCRETE SLAB:

- 9. Traffic signal controller pad must be a portland cement concrete slab poured in place, must conform to the dimensions shown, and must be level.
- 10. Grade earthwork such that it is flush with the concrete pad on all four sides, unless otherwise shown on the plans. Subsidiary to ITEM 680, four inch rip rap may be used in lieu of earthwork. Slopes shall gradually contour to match plans.
- 11. Bond a #8 AWG copper ground wire and an 8 ft ground rod bonded to the reinforcing mesh by a suitable UL Listed clamp and terminated to the cabinet grounding bus for the purpose of providing a local ground for the electrical grounding conductor. The electrical grounding conductor specified in Item 680-3.A.4 is required and must be terminated to the cabinet ground bus.
- 12. Install a PVC sleeve to prevent the ground rod from direct embedment in the slab.
- 13. Provide welded wire mesh 6X6-W2.9 X W2.9 for reinforcement. Provide joints and splices in the mesh with a minimum 6-inch overlap. Center the mesh between top and bottom and provide a minimum 3 inch cover on the edges.
- 14. Provide Class B concrete minimum for the slab in accordance with Item 421. Construct the slab in accordance with Item 531.

CONDUITS:

- 5. Stub up and run 3-inch conduits through the slab to the various traffic signal poles and ground boxes as shown on the layouts. Install the number of conduits as shown on layouts plus two additional 3 inch conduits for future use. Terminate the conduits with a bushing between 2 and 4-inches above the slab.
- 16. Extend conduits for future use at least 18-inches from the edge of the slab, terminate underground with a coupling, and cap and seal so that the seal can be removed without damaging the coupling. This must also apply to unused telephone conduit.
- 17. Stub up two separate conduits through the slab from the electrical and telephone services. Run the conduit for the electrical feed directly to the electrical service enclosure. Run the conduit for the telephone line directly to the telephone service, usually located on the same pole as the electrical service. Telephone must not under any circumstance share a conduit with any other function.
- 18. Terminate electric and telephone conduits above the slab with a coupling. After the base is installed, extend the conduits above the top of the base and secure to the base using a steel one-hole strap or similar suitable substitute.

CONTROLLER CABINET:

- 19. Anchor the controller cabinet to the base using four stainless steel 1/2-13 NC bolts.
- 20. The silicone caulk bead specified in Item 680.3.B must be RTV 133.

PAYMENT:

21. Bid TS-CF as subsidiary to Item 680.



Traffic Safety Division Standard

TRAFFIC SIGNAL
CONTROLLER CABINET
BASE AND PAD
TS-CF-21

FILE: ts-cf-21.dgn	DN:		CK:	DW:	CK:
© TxDOT October 2000	CONT	SECT	JOB		HIGHWAY
12-04 REVISIONS	1392	01	044		FM 1378
2-21	DIST		COUNTY		SHEET NO.
	10		COLLIN		279

132

			SHIPP	ING PARTS LIST - P	OLES AND L	UMINAIRE	ARMS			
Nominal	Shoe Bo	ise		T-Bas	e			CSB/SSCB I	Mounted	
Mounting Ht.	Designation		Quantity	Designation		Quantity		Designation		Quantity
(f†)	Pole A1 A2	Luminaire	addititiy	Pole A1 A2	Luminaire	addining	Pole	A1 A2	Luminaire	dudililiy
20	(Type SA 20 S - 4)	(150W EQ) LED		(Type SA 20 T - 4)	(150W EQ) LED					
	(Type SA 20 S - 4 - 4)	(150W EQ) LED		(Type SA 20 T - 4 - 4)	(150W EQ) LED					
30	(Type SA 30 S - 4)	(250W EQ) LED		(Type SA 30 T - 4)	(250W EQ) LED		(Type SP 28	S - 4)	(250W EQ) LED	
	(Type SA 30 S - 4 - 4)	(250W EQ) LED		(Type SA 30 T - 4 - 4)	(250W EQ) LED		(Type SP 28	S - 4 - 4)	(250W EQ) LED	
	(Type SA 30 S - 8)	(250W EQ) LED		(Type SA 30 T - 8)	(250W EQ) LED		(Type SP 28	S - 8)	(250W EQ) LED	
	(Type SA 30 S - 8 - 8)	(250W EQ) LED		(Type SA 30 T - 8 - 8)	(250W EQ) LED		(Type SP 28	S - 8 - 8)	(250W EQ) LED	
40	(Type SA 40 S - 4)	(250W EQ) LED		(Type SA 40 T - 4)	(250W EQ) LED		(Type SP 38	S - 4)	(250W EQ) LED	
	(Type SA 40 S - 4 - 4)	(250W EQ) LED		(Type SA 40 T - 4 - 4)	(250W EQ) LED		(Type SP 38	S - 4 - 4)	(250W EQ) LED	
	(Type SA 40 S - 8)	(250W EQ) LED		(Type SA 40 T - 8)	(250W EQ) LED	1	(Type SP 38	S - 8)	(250W EQ) LED	l
	(Type SA 40 S - 8 - 8)	(250W EQ) LED		(Type SA 40 T - 8 - 8)	(250W EQ) LED		(Type SP 38	S - 8 - 8)	(250W EQ) LED	l
	(Type SA 40 S - 10)	(250W EQ) LED		(Type SA 40 T - 10)	(250W EQ) LED		(Type SP 38	S - 10)	(250W EQ) LED	<u> </u>
	(Type SA 40 S - 10 - 10)	(250W EQ) LED		(Type SA 40 T - 10 - 10)	(250W EQ) LED		(Type SP 38	S - 10 - 10)	(250W EQ) LED	
	(Type SA 40 S - 12)	(250W EQ) LED		(Type SA 40 T - 12)	(250W EQ) LED		(Type SP 38	S - 12)	(250W EQ) LED	l
	(Type SA 40 S - 12 - 12)	(250W EQ) LED		(Type SA 40 T - 12 - 12)	(250W EQ) LED		(Type SP 38	S - 12 - 12)		
50	(Type SA 50 S - 4)	(400W EQ) LED		(Type SA 50 T - 4)	(400W EQ) LED		(Type SP 48	S - 4)	(400W EQ) LED	
	(Type SA 50 S - 4 - 4)	(400W EQ) LED		(Type SA 50 T - 4 - 4)	(400W EQ) LED		(Type SP 48	S - 4 - 4)	(400W EQ) LED	<u> </u>
	(Type SA 50 S - 8)	(400W EQ) LED		(Type SA 50 T - 8)	(400W EQ) LED		(Type SP 48	S - 8)	(400W EQ) LED	
·	(Type SA 50 S - 8 - 8)	(400W EQ) LED	·	(Type SA 50 T - 8 - 8)	(400W EQ) LED	-	(Type SP 48	(S - 8 - 8)	(400W EQ) LED	
·	(Type SA 50 S - 10)	(400W EQ) LED	·	(Type SA 50 T - 10)	(400W EQ) LED		(Type SP 48		(400W EQ) LED	
·	(Type SA 50 S - 10 - 10)	(400W EQ) LED	·	(Type SA 50 T - 10 - 10)	(400W EQ) LED	-			(400W EQ) LED	
	(Type SA 50 S - 12)	(400W EQ) LED		(Type SA 50 T - 12)	(400W EQ) LED		(Type SP 48		(400W EQ) LED	
	(Type SA 50 S - 12 - 12)	(400W EQ) LED		(Type SA 50 T - 12 - 12)	(400W EQ) LED		(Type SP 48	S - 12 - 12)	(400W EQ) LED	

		ОТН	IFR						
Designation Quantity									
Pole	Pole A1 A2 Luminaire								
	<u> </u>		20						
				_					
				_					
				-					
				-					
				-					
				_					
				-					
				+					
				+					
				+					

GENERAL NOTES:

- 1. All work, materials and services not shown on the plans which may be necessary for complete and proper construction shall be performed, furnished and installed by the Contractor. Faulty fabrication or poor workmanship in any material, equipment or installation will be considered justification for rejection. Where manufacturers provide warranties or guarantees as a customary trade practice, furnish to the Department such warranties or guarantees.
- 2. The location of poles and fixtures are diagrammatic only and may be shifted by the Engineer to accommodate local conditions. Install or remove poles and luminaires located near overhead electrical lines using established industry and utility safety practices and in accordance with laws governing such work. Consult with the appropriate utility company prior to beginning such work.
- 3. Standard Steel Pole Designs. Steel poles fabricated in accordance with the details and dimensions shown herein, shall be considered standard designs. Submission of shop drawings and design calculations for standard designs is not required.
- 4. Optional Steel Pole Designs. Multi-sided steel poles may be allowed as optional designs, if steel poles are permitted or required, pending approval by the Department as outlined below.
 - a. Shop Drawings. Optional designs require submission of shop drawings and design calculations bearing the seal of an engineer licensed in the State of Texas, in accordance with Item 441, "Steel Structures." The Department may elect to pre-approve some shop drawings for optionally designed poles. Submission of shop drawings and design calculations is not required for structures fabricated in accordance with the details of shop drawings on the pre-approved list maintained by the TxDOT Traffic Operations Division. Any deviation from the pre-approved shop drawings will require submission of shop drawings of the complete assembly and design calculations as described above.
- dssembly did design Catalitations as desir local above.

 b. Structural Support Design for Luminaires. Lighting support structures shall be designed for a 25 year design life in accordance with the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto. All poles shall be designed for 110 mph 3-second gust wind speeds. The Gust Factor, G, and Wind Importance Factor, Ir, shall be applied as per the AASHTO Specifications assuming a 25-year design life. The design wind pressure for hurricane wind velocities greater than 100 mph shall not be less than the design wind pressure using 100 mph with the non-hurricane Wind Importance Factor, Ir, value. For transformer base poles, fabricator shall include transformer base and connecting hardware in design calculations and shop drawing submittals. All transformer bases shall have been structurally tested to resist the theoretical plastic moment capacity of the pole. Certification of the plastic moment load test and FHWA breakaway requirement test of the model of base being furnished shall be submitted with the shop drawings. Shop drawings shall show breakaway base model number, and manufacturer's name and logo. Manufacturer's shop drawings shall include the ASTM designations for all materials to be used.
- c. Most Arm Attachments. All poles and attachments shall be structurally designed to support two 12-foot mast arms and luminaires. Poles shall be supplied with mast arm combinations as shown in the plans. All
- mast arms shall be designed for a 60-pound luminaire having an effective projected area of 1.6 square feet. d. Anchor Bolt Assembly. Anchor bolt assemblies for optionally designed poles shall be the same as those shown herein.
- 5. Aluminum Pole Designs. Aluminum pole designs may be allowed, if aluminum poles are permitted or required, pending approval by the Department as outlined below.
 - a. Meet all of the requirements stated above for optional steel pole designs and the following:
 1. Aluminum poles shall be fabricated in accordance with "Structural Welding Code-Aluminum" AWS D1.2.

anti-seize compound, Never-Seez Compound, Permatex 133K or equal.

- Aluminum pole designs shall use the same anchor bolt assembly and be subject to the same geometric restraints and other requirements for steel poles specified herein.
 Aluminum poles shall be equipped with vibration mitigation devices, as approved by the engineer.
- Pole components shall be constructed using the following material: Shaft: ASTM B221 or B241 Alloy 6063-T6, ASTM B209 Alloy 5086-H34, ASTM B221 Alloy 6005-T5.

 Base Flange: ASTM B26 Alloy 356.0-T6 or ASTM B108 Alloy 356.0-T6 (Yield strength test required).


 Mast Arm Fitting: ASTM B209 Alloy 6061-T6 or ASTM B221 Alloy 6005-T5.

 Mast Arms: ASTM B241 Alloy 6061-T6 or AIloy 6063-T6.

 Pole Cap: ASTM B209 Alloy 5086-H32 or ASTM B108 or B26 Alloy 356.0-T6.

 Bolts: Stainless Steel AISI 300 series. Bolts threading into aluminum threads shall be treated with
- 6. Special Designs. Poles with architectural treatments shall meet the requirements shown elsewhere in the plans.
- 7. Luminaire Mounting Height. Actual luminaire mounting height shall be the nominal mounting height given on RIP(2) for all pole-arm combinations except for poles with 4 ft. luminaire arms, which shall be 3^7 -0" lower than the nominal height, unless otherwise shown or directed.

EXPLANATION OF ROADWAY ILLUMINATION ASSEMBLY DESIGNATIONS

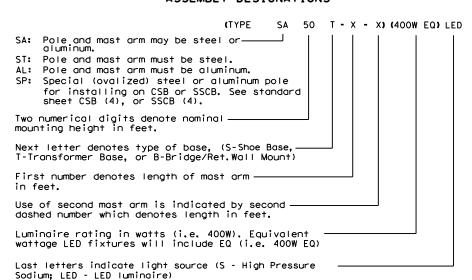





ROADWAY ILLUMINATION POLES

RIP(1) - 19

FILE: rip-19.dgn	DN:		CK:	DW:		CK:
© TxDOT January 2007	CONT	SECT	JOB		HIG	HWAY
REVISIONS	1392	01	044		FM 1378	
7-17 12-19	DIST		COUNTY		5	SHEET NO.
12 13	DAL	COLLIN			280	

SHOE BASE POLE

SHOE BASE POLE											
Luminaire Mounting Height (Nominal)(ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)						
20.00	7.00	4.90	15.00	0.1196	7.1						
30.00	7.50	4.00	25.00	0.1196	13.2						
31.00-39.00	8.00	4.36-3.24	26.00-34.00	0.1196	20.7						
40.00	8.50	3.60	35.00	0.1196	20.7						
50.00	10.50	4.20	45.00	0.1196	30.3						

See Pole Top Detail. 1 Simplex Arm Connection 60% of CP-3 Pole Thickness See Transformer Base Baseplate Detail, Sheet 4 of 4 See Transformer Base Details. Sheet 4 of 4 See Transformer Base Anchor Bolt Assembly Detail,

TRANSFORMER BASE POLE

TRANSFORMER BASE POLE						
Luminaire Mounting Height (Nominal)(ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)	
20.00	7.00	5.11	13.50	0.1196	7.1	
30.00	7.50	4.21	23.50	0.1196	13.2	
31.00-39.00	8.00	4.57-3.45	24.50-32.50	0.1196	20.7	
40.00	8.50	3.81	33.50	0.1196	20.7	
50.00	10.00	3.91	43.50	0.1196	30.3	

Rise ① Simplex Arm Connection Seam Weld Ę located 45° from mast arm axis 60% of Thickness See Handhole Detail, Sheet 3 of 4 Max. 6′ -0" 7′ -6" 0val Sect See Concrete Traffic Barrier Base Baseplate Detail. Sheet 4 of 4 See Concrete Traffic Barrier Base Anchor Bolt Assembly Detail, Sheet 4 of 4

See Pole

Top Detail,

CONCRETE TRAFFIC BARRIER BASE POLE

CONCRETE TRAFFIC BARRIER BASE POLE (CSB/SSCB)							
Luminaire Mounting	Base② Diameter			Length Thickness		Design Moment (K-ft)	
Height	/in)	(in)	(fŤ)	(in)	About & of Rail	Perp. to Rail	
28.00	9.00	5.78	23.00	0.1196	10.3	13.2	
28.00 38.00 48.00	9.00	4.38	33.00	0.1196	16.6	20.8	
48.00	10.50	4.48	43.00	0.1345	25.1	30.5	

GENERAL NOTES:

- 1. Designs conform to AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto. Design 3-Second Gust Wind Speed equals 110 mph with a 1.14 gust factor. A wind importance factor of 0.80 is applied to adjust the wind speed to a 25 year recurrence interval. Design moments listed in tables assume base of pole is 25' above natural ground level.
- Structures are designed to support two 12' luminaire mast arms and luminaires. Mast arms are designed to support a 60-pound luminaire having an effective projected area of 1.6 square feet.
- 3. Fabrication shall be in accordance with the Specifications and with the details, dimensions, and weld procedures shown herein. Do not submit shop drawings for roadway illumination pole assemblies fabricated in accordance with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. Materials, fabrication tolerances, and shipping practices shall meet the requirements of these sheets and the Specifications. In the absence of specified fabrication tolerances, dimensions shall be within the tolerances generally obtainable in normal fabrication practice.

- For mounting heights between values shown in the tables, use base diameter and thickness values for the larger height.
- Unless otherwise noted, all steel parts shall be galvanized in accordance with Item 445, "Galvanizing."
- 6. Steel poles shall be fabricated in accordance with Item 441, "Steel Structures." Longitudinal seam welds for pole sections shall have 60% minimum penetration. All welding shall be in accordance with AWS D1.1, Structural Welding Code-Steel.
- 7. Two-section poles joined by circumferential welds will not be permitted, unless otherwise shown on the plans. Poles may be fabricated in two sections and field-assembled by the lap-joint method. The two sections shall telescope together with a lap length of not less than 1-1/2 times the shaft diameter at the lap joint.
- Alternate material equal to or better than material specified may be substituted with the approval of the Engineer.
- Lubricate and tighten anchor bolts, when erecting shoe base poles and concrete traffic barrier base poles, in accordance with Item 449, "Anchor Bolts."

- 10. All poles, except Transformer Base Poles, shall have hand holes with reinforcing frames and covers. For ground mounted shoe base poles, hand holes shall be placed 90 degrees to mast arm unless otherwise noted on the plans. For poles mounted on a concrete traffic barrier with one luminaire arm, hand holes shall be located 180 degrees from luminaire arm. For poles mounted on a concrete traffic barrier with two luminaire arms, all hand holes shall be on the same side of the barrier. For poles mounted on a bridge lighting bracket or a retaining wall lighting bracket, hand hole shall be on traffic side of the pole, at a height that will clear the barrier.
- 11. The finished pole shall have a smooth, uniform finish free of pits, blisters, or other defects. Scratched, chipped, and other damaged galvanized areas on poles and mast arms shall be repaired in accordance with Item 445, "Galvanizing."
- 12. Pole length is based on a 5'-6" luminaire arm rise. 4 ft. luminaire arms have a 2'-6" rise. A pole with 4 ft. luminaire arms will have an actual mounting height 3'-0" less than the nominal mounting height. Increasing the pole length to meet the nominal mounting height is allowed, but unnecessary unless otherwise directed by the engineer.
- 13. Erect transformer base poles in accordance with sheet RID(1).

MATERIAL DATA						
COMPONENT	ASTM DESIGNATION	MIN. YIELD (ksi)				
Pole Shaft (0.14"/ft. Taper)	A572 Gr 50, A595 Gr A, A1011 HSLAS Gr 50 Cl 2 ③, or A1008 HSLAS Gr 50 Cl 2	50				
Base Plate and Handhole Frame	A572 Gr.50, or A36	36				
T-Base Connecting Bolts	F3125 Gr A325	92				
Anchor Bolts	F1554 Gr 55, A193-B7 or A321	55 105				
Anchor Bolt Templates	A36	36				
Heavy Hex (H.H.) Nuts	A194 Gr 2H, or A563 Gr DH					
Flat Washers	F436					

NOTES:

- 1)2'-6" rise for 4 ft. luminaire arms.
- ② Before ovalized as shown on Concrete Traffic Barrier Base Baseplate details, Sheet 4 of 4.
- ③A1011 SS Gr 50 may be used instead of HSLAS, provided the material meets the elongation requirements for HSLAS.

POLE ASSEMBLY FABRICATION TOLERANCES TABLE DIMENSION TOLERANCE Shaft length +1" I.D. of outside piece of slip fitting pieces 0.D. of inside piece of slip fitting pieces +1/32", -1/8"

of slip fitting pieces O.D. of inside piece of slip fitting pieces Shaft diameter: other +3/16" Out of "round" 1/4" Straightness of shaft ±1/4" in 10 ft Twist in multi-sided shaft 4° in 50 ft Perpendicular to baseplate 1/8" in 24" ±1/4" Pole centered on baseplate Location of Attachments ±1/4" ±1/16" Bolt hole spacing

SHEET 2 OF 4

Traffic Safety Division Standard



ROADWAY
ILLUMINATION
POLES

RIP(2)-19


file: rip-19.dgn	DN:		CK:	DW:		CK:
© TxDOT January 2007	CONT	SECT	JOB		HIG	HWAY
REVISIONS	1392	01	044		FM	1378
7-17 12-19	DIST		COUNTY		9	SHEET NO.
12 13	DΔI		COLLII	J		281

rances generally obtainable in normal fabrication accordance with Item 449, "Anchor Bolts." 13. Erect tice.

LUMINAIRE ARM

LUMINAIRE ARM DIMENSIONS							
Nominal Arm Length	Arm Length	Rise					
4′-0"	3′-6"	2′-6"					
6′-0"	5′-6"	5′-6"					
8′-0"	7′-6"	5′-6"					
10'-0"	9′-6"	5′-6"					
12'-0"	11′-6"	5′-6"					

ARM ASSEMBLY FABRICATION TOLERANCES TABLE						
DIMENSION	TOLERANCE					
Arm Length	±1"					
Arm Rise	±1"					
Deviation from flat	1/8" in 12"					
Spacing between holes	±1/32"					

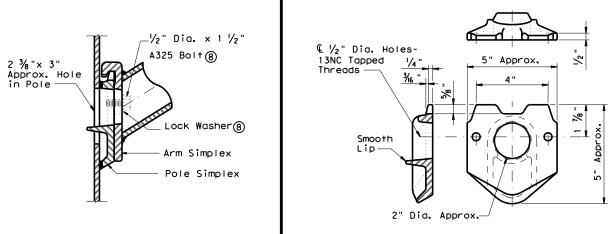

UPPER SIMPLEX FITTING POLE SIMPLEX DETAIL 9

(Gusset not shown for clarity)

LOWER SIMPLEX FITTING

(Gusset not shown for clarity)

SECTION B-B

SIDE

POLE TOP

Lip

LA-3


Тур

1/2" Dia. x 1 1/2"

-Lock Washer®

A325 Bolt(8)

Arm Simplex Pole Simplex

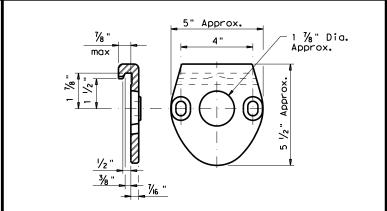

ARM SIMPLEX DETAIL 9


1/8" Min Gusset Plate

1/8" Min Gusset Plate

ELEVATION

SECTION C-C


SIMPLEX ATTACHMENT DETAIL

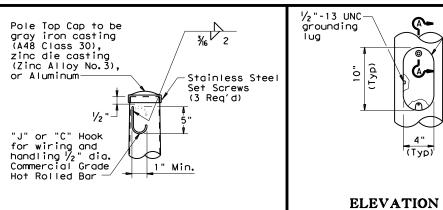

 $\sqrt{2}$ LA-3

Тур

Gusset Plate

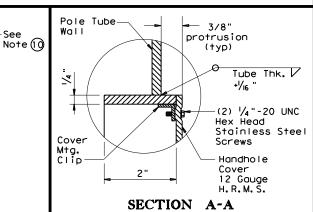

SHEET 3 OF 4

Texas Department of Transportation

ROADWAY ILLUMINATION **POLES**

Traffic Safety Division Standard

RIP(3) - 19

	- +	•		4	
FILE: rip-19.dgn	DN:		CK:	DW:	CK:
© TxDOT January 2007	CONT	SECT	JOB		H]GHWAY
REVISIONS	1392	01	044		FM 1378
7-17 12-19	DIST		COUNTY		SHEET NO.
12 13	DAL		COLLIN	1	282

HANDHOLE

NOTES:

where the drawings do not specify a particular ASTM designation.

(5) A576 must be suitable for forging and also meet minimum tensile strength of 65 ksi, minimum yield of 35 ksi, and elongation in 2 inches of 22 percent. (6) A572, A1008 HSLAS-F, and A1011 HSLAS-F materials may have higher yield strengths but shall not have less elongation than the grade indicated.

(4) Any of the materials listed for plates may be used


(7) Dimensional limits are given to show acceptable variation in design. All of a Fabricator's production of a particular arm length shall have the same dimensions within specified tolerances.

8 Each pole simplex fitting shall be supplied with 2 bolts and 2 lock washers of the size specified. The bolts and lock washers shall be secured to the pole with the other hardware items called for in the plans.

 Proposed deviations in arm simplex dimensions or materials must be submitted to the Department for approval.


(10) A welded handhole frame is permissible. Maximum of two (2) CJP weld splices is allowed.

MATERIALS ASTM A27 Gr 65-35 or Gr 70-36, A148 Gr 80-50, A576 Gr 1021 (\$\), or A36 Pole or Arm Simplex ASTM A53 Gr A or B,A500 Gr B, A501, A 1008 HSLAS-F Gr 50 6, or A1011 HSLAS-F Gr 50 6 Arm Pipes Arm Struts and Gusset Plates ④ ASTM A36, A572 Gr 50 6, or A588 Misc. ASTM designations as noted




SHOE BASE BASEPLATE

SHOE BASE BASEPLATE TABLE								
MOUNTING HEIGHTS (nominal)	BOLT CIRCLE	SQUARE	THICK	BOLT HOLE DIAMETER				
20' - 39'	13"	13"	1 1/4"	1 1/4"				
40′	15"	15"	1 1/4"	1 1/2"				
50′	15"	15"	1 ½"	1 1/2"				

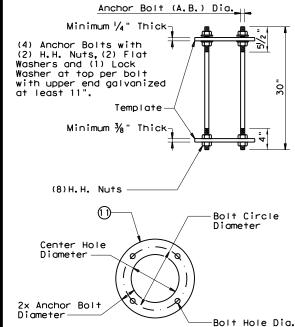


SHOE BASE ANCHOR BOLT ASSEMBLY

SHOE BA	SE A	NCHOR E	OLT ASSEM	BLY TABLE
MOUNTING HEIGHTS (nominal)	A.B. Dia.	BOLT CIRCLE DIAMETER	CTR. HOLE DIAMETER	BOLT HOLE DIAMETER
20'-39'	1 "	13"	11"	1 1/16 "
40′-50′	1 1/4"	15"	12 ½"	1 % "

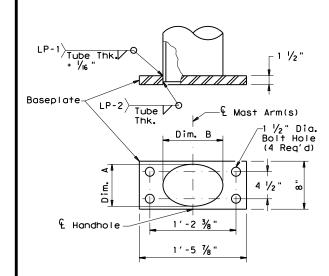


CONCRETE TRAFFIC BARRIER BASE BASEPLATE

CONCRETE TRAFFIC BARRIER BASE BASEPLATE TABLE							
MOUNTING HEIGHTS (nominal)	POLE DIA.	DIM. A	DIM. B				
28' - 38'	9"	7"± 1/4"	10"± 1/4"				
48′	10 ½"	7"± 1/4"	13"± 1/4"				

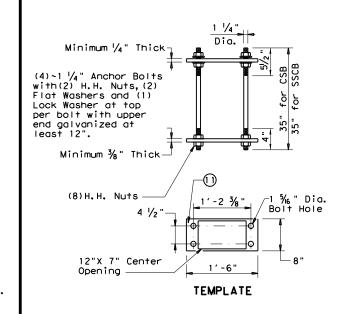


CONCRETE TRAFFIC BARRIER BASE ANCHOR BOLT ASSEMBLY

TRANSFORMER BASE ANCHOR BOLT ASSEMBLY TABL								
MOUNTING HEIGHTS (nominal)	A.B. Dia.	BOLT CIRCLE DIAMETER	CTR. HOLE DIAMETER	BOLT HOLE DIAMETER				
20' - 39'	1 "	14"	12"	1 1/16 "				
40' - 50'	1 1/4"	17 1/4"	14 ¾"	1 1/6 "				

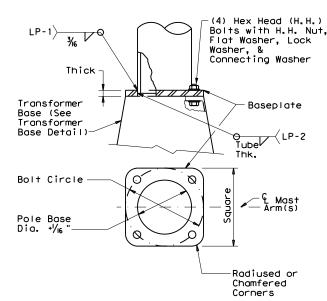


TRANSFORMER BASE BASEPLATE


TRANSFORMER BASE BASEPLATE TABLE									
MOUNTING HEIGHTS (noming)	BOLT CIRCLE	SQUARE	THICK	CONNECTING BOLT DIA.	BOLT HOLE DIAMETER	TRANSFOMER BASE TYPE			
20' - 39'	13"	13"	1 1/4"	1 "	1 1/4"	A			
40′	15"	15"	1 1/4"	1 1/4"	1 1/2"	В			
50′	15"	15"	1 1/2"	1 1/4"	1 ½"	В			

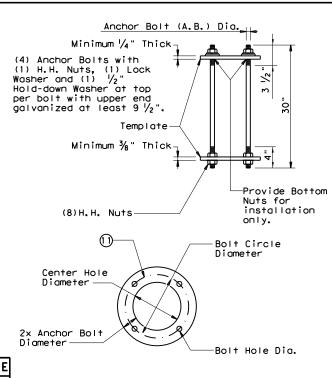


TRANSFORMER BASE ANCHOR BOLT ASSEMBLY

TRANSFORMER BASE TABLE TOP B.C. TYPE 13" 14" 15" 17 1/4










TOP PLAN



BOTTOM PLAN

thereto, and shall have been tested by FHWA-approved methods. All bases shall have been structurally tested to resist 150% of the design moment. 3. Transformer bases shall be cast from aluminum, ASTM B108 or B26 Alloy 356.0-T6, or other material approved by the Engineer. Four Hex Head (H.H.) bolts with four H.H. nuts, four lock washers, four flat washers, and connecting and hold-down washers as recommended by the manufacturer, galvanized to ASTM A153 Class C or D, or B695 Class 50, shall be provided with

1. For mounting heights between those shown in the table, use the values in the table for

2. All breakaway bases shall meet the breakaway

Specifications for Structural Supports for


6th Edition (2013) and Interim Revisions

Highway Signs, Luminaires and Traffic Signals,

requirements of the AASHTO Standard

GENERAL NOTES:

the larger mounting height.



each transformer base for connecting the pole.

Bolts shall be ASTM A325 or approved equal.


Nuts shall be ASTM A563 grade DH galvanized.

5. Doors for transformer bases shall be made of plastic, fiberglass or other non-metallic material approved by the Engineer and shall be attached with stainless steel screws or bolts. Transformer bases shall be cleaned by grit blast cleaning after heat treatment. Certification by the manufacturer of heat treatment shall be furnished with transformer bases. The certification shall show the metal alloy and temper and that the base meets those requirements, chemical and physical. The certification shall also show the material ASTM specification. Transformer bases shall be cast with a removable tab bar for material testing. Some bars may have been removed by the manufacturer for testing.

NOTES:

- (1) Anchor Bolt Templates do not need to be aalvanized.
- 🔞 Pole diameter before ovalized.

ANCHOR BOLT FABRICATION TOLERANCES TABLE DIMENSION TOLERANCE Length ± 1/2' Threaded length ± 1/2" Galvanized length (if required) - 1/4"



ELEVATION

TRANSFORMER BASE **DETAILS**



ILLUMINATION **POLES**

SHEET 4 OF 4

Traffic Safety Division Standard

RIP(4)-19

FILE: rip-19.dgn	DN:		CK:	DW:	CK:
© TxDOT January 2007	CONT	SECT	JOB		HIGHWAY
REVISIONS	1392	01	044		FM 1378
7-17 12-19	DIST		COUNTY	•	SHEET NO.
12 19	DAL		COLLI	1	283

Γ	Arm		ROUND	POLES				POL Y G	ONAL POLI	ES		
	Length	D _B	D19	D ₂₄	D 30	1) thk	D _B	D19	D ₂₄	D 30	1) thk	Foundation Type
	ft.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.]
Г	20	10.5	7.8	7.1	6.3	.179	11.5	8,5	7.7	6.8	.179	30-A
Г	24	11.0	8.3	7.6	6.8	.179	12.0	9.0	8.2	7.3	.179	30-A
Г	28	11.5	8.8	8.1	7.3	.179	12.5	9.5	8.7	7.8	.179	30-A
Г	32	12.5	9.8	9.1	8.3	.179	12.0	9.0	8.2	7.3	.239	30-A
	36	12.0	9.3	8.6	7.8	. 239	12.5	9.5	8.7	7.8	.239	36-A
Г	40	12.0	9.3	8.6	7.8	.239	13.5	10.5	9.7	8.8	.239	36-A
Г	44	12.5	9.8	9.1	8.3	.239	14.0	11.0	10.2	9.3	.239	36-A
	48	13.0	10.3	9.6	8.8	.239	15.0	12.0	11.2	10.3	.239	36-A


Arm		ROUND	ARMS				POLYG	ONAL ARM	S	
Length	Lı	D,	D ₂	1) thk	Rise	L,	D,	② D ₂	1) thk	Rise
ft.	ft.	in.	in.	in.	11150	ft.	in.	in.	in.	RISE
20	19.1	6.5	3.8	.179	1'-9"	19.1	7.0	3.5	.179	1′-8"
24	23.1	7.5	4.3	.179	1'-10"	23.1	7.5	3.5	.179	1′-9"
28	27.1	8.0	4.2	.179	1'-11"	27.1	8.0	3.5	.179	1'-10"
32	31.0	9.0	4.7	.179	2'-1"	31.0	9.0	3.5	.179	2′-0"
36	35.0	9.5	4.6	.179	2'-4"	35.0	10.0	3.5	.179	2'-1"
40	39.0	9.5	4.1	.239	2′-8"	39.0	9.5	3.5	.239	2'-3"
44	43.0	10.0	4.1	.239	2'-11"	43.0	10.0	3.5	.239	2′-6"
48	47.0	10.5	4.1	.239	3′-4"	47.0	11.0	3.5	.239	2′-9"

D_B = Pole Base O.D.
D₁₉ = Pole Top O.D. with no Luminaire and no ILSN
D₂₄ = Pole Top O.D. with ILSN w/out Luminaire

D₂ = Arm End O.D. L₁ = Shaft Length L = Nominal Arm Length

D₃₀ = Pole Top O.D. with Lumingire D₁ = Arm Base O.D.

- 1) Thickness shown are minimums, thicker materials may be used.
- \bigcirc D₂ may be increased by up to 1" for polygonal arms.

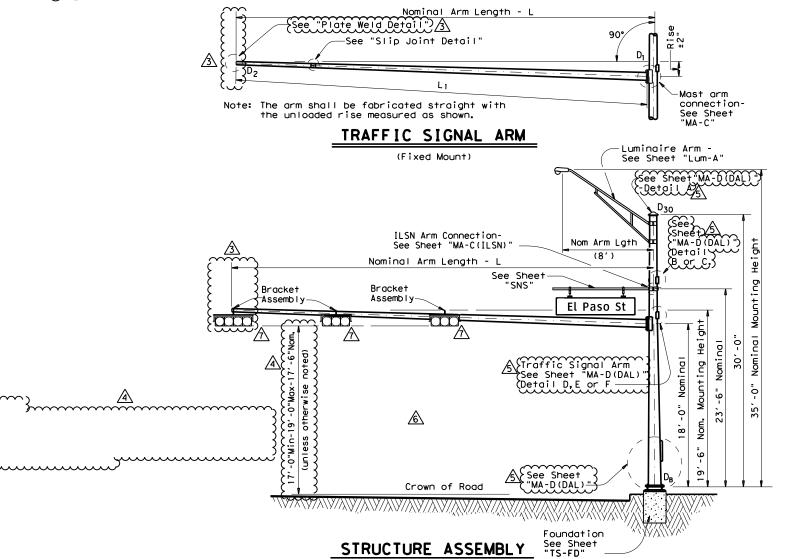

SHIPPING PARTS LIST

Ship each pole with the following attached: enlarged hand hole, pole cap, fixed-arm connection bolts and washers and any additional hardware listed in the table.

	30' Poles Wi	th Luminaire	24' Poles W	ith ILSN	19' Poles With No		
Nominal Arm Length	(or two if I	re plus: One LSN attached) ole, clamp-on	Above hardware plus one small hand hole		See note above		
f†	Designation	Quantity	Designation	Quantity	Designation	Quantity	
20	20L-80		205-80		20-80		
24	24L-80		245-80		24-80		
28	28L-80	1	285-80		28-80		
32	32L-80		325-80		32-80		
36	36L-80		365-80		36-80		
40	40L-80	1	405-80		40-80		
44	44L-80		445-80		44-80		
48	48L-80		485-80		48-80		

Traffic Signal Arms (1 per Pole)

Ship each arm with the listed equipment attached Type III Arm (2 Signals) Type III Arm (3 Signals)

	Type I Arm (1 Signal)	Type II Arm	(2 Signals)	Type III Arm (3 Signals)
Nominal Arm Length	1 Bracket	Assembly	2 Bracket A	Assemblies	3 Bracket	Assemblies }
f†	Designation	Quantity	Designation	Quantity	Designation	Quantity
20	201-80					
24	241-80		24∐-80			
28	281-80		28∐-80	1		
32			32∐-80		32111-80	
36			36∐-80		361111-80	
40			<u>/2</u> (40H-80)		401111-80	1
44			(44∏-80)		44111-80	
48					48111-80	

Luminaire Arms (1 per 30' pole)

Nominal Arm Length	Quantity
8' Arm	2

ILSN Arm (Max. 2 per pole) Ship with clamps, bolts and washers

Nor	minal Arm Length	Quantity
7′	Arm	
ý	Arm	

Anchor Bolt Assemblies (1 per pole)

Anchor Bolt Diameter	Anchor Bolt Length	Quantity
)	
1 1/2 "	3, -4	1
1 3/4"	3′-10"	1

Each anchor bolt assembly consists of the following: Top and Bottom templates, 4 anchor bolts, 8 nuts, 8 flat washers, and 4 nut anchor devices (Type 2) per Standard Drawing "TS-FD".

Templates may be removed for shipment.

MODIFICATIONS:

REPLACED CGB CONNECTOR WITH BRACKET ASSEMBLY. (2/12)

ADDITIONAL OPTION. (3/12)

REPLACED TENON DETAIL WITH PLATE WELD DETAIL. (2/12)

REVISED MINIMUM SIGNAL HEIGHT. (3/12)

REPLACED "MA-D" WITH "MA-D(DAL)". (2/12)

REMOVED TABLE OF DIMENSIONS "A". (2/12)

REMOVED CGB CONNECTORS. (2/12)


SHEET 1 OF 2

Texas Department of Transportation TRAFFIC SIGNAL


SUPPORT STRUCTURES SINGLE MAST ARM ASSEMBLY (80 MPH WIND ZONE)

SMA-80(1)-12(DAL)

© TxDOT August 1995	DN: MS		CK: JSY	DW:	MMF	CK: JSY
REVISIONS	CONT	SECT	JOB		H I GHWAY	
5-96 11-99	1392	01	044		FM 1378	
1-12	DIST		COUNTY			SHEET NO.
	DAL		COLLIN			284

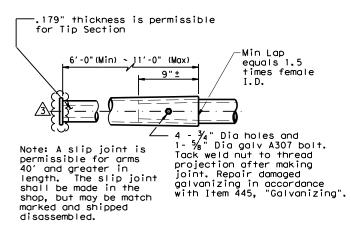


SLIP JOINT DETAIL



Stainless steel bands (or Cables) and cast bracket as in "Astro-Brac", "Sky Bracket" or "Easy Bracket" with 1 $\frac{1}{2}$ " Dia Threaded Coupling.

BRACKET ASSEMBLY

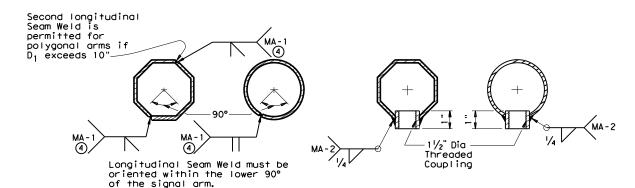

ARM WELD DETAIL

4 60% Min. penetration 100% pemetration within 6" of circumferential base welds.

ARM COUPLING DETAILS

REPLACED TENON DETAIL WITH PLATE WELD DETAIL (2/12).

REPLACED "MA-D" WITH "MA-D(DAL)"(2/12).

VIBRATION WARNING

Mast Arms of SMA and DMA structures and clamp-on Arms of LMA structures of approximately 40 ft or longer are subject to harmonic vertical vibrations in light wind conditions due to the aeroelastic characteristics of a few of the myriads of possible combinations of the following: signal numbers, weights and positions; existence/solidity of backplates; presence of additional attachments to the arm, such as signs and cameras; arm-wind orientation; and arm-pole stiffness.

Such vibrations may cause fatigue damage to the structure and may lead to galloping in moderate wind conditions which may further damage the structure and alarm the public. Tests have indicated that when wind is blowing toward the back side of signal heads having un-vented backplates attached the probability of unacceptable harmonic vibration and/or galloping is rather high.

If backplates are not required for improved visibility they should not be applied to the signal heads or, if they must be applied, they should be vented as a first and inexpensive measure to mitigate vibrations.

The traffic signal mast arms shall be visually inspected in 5 to 20 mph wind conditions after installation of signal heads and any attachments, including any required backpates. If vertical movements with a total excursion (maximum upward excursion to maximum downward excursion) of more than approximately 8" are observed at the arm tip, a damping plate shall be fitted to the arm. See "Damping Plate Mounting Details" on standard sheet, MA-DPD-10.

This visual inspection shall be repeated after each modification of the structure that could affect its aeroelastic response. Excessive vibrations shall not be allowed to continue for more than two days.

GENERAL NOTES:

Design conforms to 1994 AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals and Interim Specifications thereto. Design Wind Speed equals 80 mph plus a 1.3 gust factor.

Poles are designed to support one 8′-0" luminaire arm, one 9′-0" internally lighted street name sign and one traffic signal arm with a length as tabulated. The specified luminaire load applied at the end of the luminaire arm equals 60 lbs vertical dead load plus the horizontal wind load on an effective projected area of 1.6 sq ft. The specified internally lighted street name sign load applied 4.5 ft from the centerline of the pole equals 85 lbs vertical dead load plus horizontal wind load on an effective projected area of 11.5 sq ft. The specified signal load applied at the end of the traffic signal arm equals 180 lbs vertical dead load plus the horizontal wind load on an effective projected area of 32.4 sq ft (actual area times drag coefficient).

See Standard Sheet "MA-D(DAL)" for pole details, "MA-C" for traffic (signal arm connection details, "MA-C (ILSN) righted (street name sign arm connection details, "LUM-A" for luminaire arm and connection details, "SNS" for internally lighted street name sign details, and "TS-FD" for anchor bolt and foundation details. (See "MA-C" for material specifications.

Fabrication shall be in accordance with Item 686, "Traffic Signal Pole Assemblies (Steel)" and with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. Materials, fabrication tolerances, and shipping practices shall meet the requirements of this sheet and Item 686, "Traffic Signal Pole Assemblies (Steel)".

Unless otherwise noted, all parts shall be galvanized in accordance with Item 445, "Galvanizing", after fabrication.

Deviation from the details and dimensions shown herein require submission of shop drawings in accordance with Item 441, "Steel Structures". Alternate designs are not accordable

SHEET 2 OF 2



SUPPORT STRUCTURES
SINGLE MAST ARM ASSEMBLY

(80 MPH WIND ZONE)
SMA-80(2)-12(DAL)

© TxDOT August 1995	DN: MS		CK: JSY	DW:	MMF	CK: JSY
REVISIONS 5-96	CONT	SECT	JOB		HIO	HWAY
1-12	1392	01	044		FM	1378
	DIST		COUNTY			SHEET NO.
	DΔI		COLL IN			285

1 2 2 B |

REQUIREMENTS FOR INDEPENDENT MOUNTED ROUTE SIGNS

SHEETING REQUIREMENTS							
USAGE	COLOR	SIGN FACE MATERIAL					
BACKGROUND	WHITE	TYPE A SHEETING					
BACKGROUND	ALL OTHERS	TYPE B OR C SHEETING					
LEGEND & BORDERS	WHITE	TYPE A SHEETING					
LEGEND & BORDERS	BLACK	ACRYLIC NON-REFLECTIVE FILM					
LEGEND & BORDERS	ALL OTHERS	TYPE B or C SHEETING					








TYPICAL EXAMPLES

REQUIREMENTS FOR BLUE, BROWN & GREEN D AND I SERIES GUIDE SIGNS

SHEETING REQUIREMENTS							
USAGE	COLOR	SIGN FACE MATERIAL					
BACKGROUND	ALL	TYPE B OR C SHEETING					
LEGEND & BORDERS	WHITE	TYPE D SHEETING					
LEGEND, SYMBOLS & BORDERS	ALL OTHERS	TYPE B OR C SHEETING					













TYPICAL EXAMPLES

GENERAL NOTES

- 1. Signs to be furnished shall be as detailed elsewhere in the plans and/or as shown on sign tabulation sheet. Standard sign designs and arrow dimensions can be found in the "Standard Highway Sign Designs for Texas" (SHSD).
- 2. White legend shall use the Clearview Alphabet. The following Clearview fonts shall be used to replace the existing white Federal Highway Administration (FHWA) Standard Highway Alphabets, when not specified in the SHSD, or in the

В	CV-1W
С	CV-2W
D	CV-3W
E	CV-4W
Emod	CV-5WR
F	CV-6W

- 3. Route sign legend (ie. IH, US, SH and FM shields) shall use the Federal Highway Administration (FHWA) Standard Highway Alphabets B, C, D, E, Emod
- 4. Lateral spacing between letters and numerals shall conform with the SHSD, and any approved changes thereto. Lateral spacing of legend shall provide a balanced appearance when spacing is not shown.
- 5. Independent mounted route sign with white or colored legend and borders shall be applied by screening process with transparent color ink, transparent colored overlay film to white background sheeting or cut-out white sheeting to colored background sheeting, or combination thereof. White legend, symbols and borders on all other signs shall be cut-out white sheeting applied to colored background sheeting.
- 6. Information regarding borders and radii for signs is found in the "Standard Highway Sign Designs for Texas". Dimensions shown and described for borders and corner radii on parent sign are nominal. Borders may vary in width as much as 1/2 inch. Corner radii above 3 inches may vary in width as much as 1 inch. Borders and corner radii within a parent sign must be of matching widths. The sign area outside the corner radius should be trimmed or rounded.
- 7. Sign substrate shall be any material that meets the Departmental Material Specification requirements of DMS-7110 or approved alternative.
- 8. Mounting details of roadside signs are shown in the "SMD series" Standard Plan Sheets.

DEPARTMENTAL MATERIAL SPEC	IFICATIONS
ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

ALUMINUM SIGN	BLANKS THICKNESS
Square Feet	Minimum Thickness
Less than 7.5	0.080
7.5 to 15	0.100
Greater than 15	0.125

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website.

http://www.txdot.gov/



Traffic Operations Division Standard

TYPICAL SIGN REQUIREMENTS


TSR(3)-13

FILE:	tsr3-13.agn	DN: I	XDOT	CK: IXDOI	DW:	LXDC) I C	C: 1	XDOT
© TxD0T	October 2003	CONT	SECT	JOB			HIGHW	ΑY	
		1392	01	044, ET	.C	FM	137	8,1	ETC
12-03 7-13		DIST		COUNTY			SHE	EΤ	NO.
9-08		DAL		COLLI	N		2	286	

REQUIREMENTS FOR RED BACKGROUND REGULATORY SIGNS (STOP- YIELD- DO NOT ENTER AND

(STOP, YIELD, DO NOT ENTER AND WRONG WAY SIGNS)









REQUIREMENTS FOR FOUR SPECIFIC SIGNS ONLY

SHEETING REQUIREMENTS					
USAGE	COLOR	SIGN FACE MATERIAL			
BACKGROUND	RED	TYPE B OR C SHEETING			
BACKGROUND	WHITE	TYPE B OR C SHEETING			
LEGEND & BORDERS	WHITE	TYPE B OR C SHEETING			
LEGEND	RED	TYPE B OR C SHEETING			

REQUIREMENTS FOR WARNING SIGNS





TYPICAL EXAMPLES

SHEETING REQUIREMENTS					
USAGE	COLOR	SIGN FACE MATERIAL			
BACKGROUND	FLOURESCENT YELLOW	TYPE B _{FL} OR C _{FL} SHEETING			
LEGEND & BORDERS	BLACK	ACRYLIC NON-REFLECTIVE FILM			
LEGEND & SYMBOLS	ALL OTHER	TYPE B OR C SHEETING			

REQUIREMENTS FOR WHITE BACKGROUND REGULATORY SIGNS

(EXCLUDING STOP, YIELD, DO NOT ENTER AND WRONG WAY SIGNS)





TYPICAL EXAMPLES

SHEETING REQUIREMENTS						
USAGE	COLOR	SIGN FACE MATERIAL				
BACKGROUND	WHITE	TYPE A SHEETING				
BACKGROUND	ALL OTHERS	TYPE B OR C SHEETING				
LEGEND, BORDERS AND SYMBOLS	BLACK ACRYLIC NON-REFLECTIVE I					
LEGEND, BORDERS AND SYMBOLS	ALL OTHER	TYPE B OR C SHEETING				

REQUIREMENTS FOR SCHOOL SIGNS





TYPICAL EXAMPLES

SHEETING REQUIREMENTS						
USAGE	COLOR	SIGN FACE MATERIAL				
BACKGROUND	WHITE	TYPE A SHEETING				
BACKGROUND	FLOURESCENT YELLOW GREEN	TYPE B _{FL} OR C _{FL} SHEETING				
LEGEND, BORDERS AND SYMBOLS BLACK		ACRYLIC NON-REFLECTIVE FILM				
SYMBOLS	RED	TYPE B OR C SHEETING				

GENERAL NOTES

- Signs to be furnished shall be as detailed elsewhere in the plans and/or as shown on sign tabulation sheet. Standard sign designs and arrow dimensions can be found in the "Standard Highway Sign Designs for Texas" (SHSD).
- 2. Sign legend shall use the Federal Highway Administration (FHWA) Standard Highway Alphabets (B, C, D, E, Emod or F).
- Lateral spacing between letters and numerals shall conform with the SHSD, and any approved changes thereto. Lateral spacing of legend shall provide a balanced appearance when spacing is not shown.
- 4. Black legend and borders shall be applied by screening process or cut-out acrylic non-reflective black film to background sheeting, or combination thereof.
- 5. White legend and borders shall be applied by screening process with transparent colored ink, transparent colored overlay film to white background sheeting or cut-out white sheeting to colored background sheeting, or combination thereof.
- Colored legend shall be applied by screening process with transparent colored ink, transparent colored overlay film or colored sheeting to background sheeting, or combination thereof.
- 7. Sign substrate shall be any material that meets the Departmental Material Specification requirements of DMS-7110 or approved alternative.
- 8. Mounting details for roadside mounted signs are shown in the "SMD series" Standard Plan Sheets.

ALUMINUM SIGN	BLANKS THICKNESS
Square Feet	Minimum Thickness
Less than 7.5	0.080
7.5 to 15	0.100
Greater than 15	0.125

DEPARTMENTAL MATERIAL SPEC	CIFICATIONS
ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website.

http://www.txdot.gov/



Traffic Operations Division Standard

TYPICAL SIGN REQUIREMENTS

TSR(4)-13

LE:	tsr4-13.dgn	DN: T	(DOT	ck: TxDOT	DW:	TxDOT	ck: TxDOT	
)TxDOT	October 2003	CONT	SECT	JOB		HIG	GHWAY	
		1392	01	044,ETC FM		FM 13	1378,ETC	
2-03 7-1: 9-08	3	DIST		COUNTY			SHEET NO.	
		DAL		COLLI	N		287	



Type A

TYPE

A-2

A-3

B-I

B-2

B-3


CODE

E-3

E-4

ARROW DETAILS

for Large Ground-Mounted and Overhead Guide Signs



LETTER SIZE

10.67" U/L and 10" Caps

13.33" U/L and 12" Caps

16" & 20" U/L

10.67" U/L and 10" Caps

13.33" U/L and 12" Caps

16" & 20" U/L

USED ON SIGN NO.

E5-laT

E5-lbT




USE

Single

Lane

Multiple

Lane Exits



E-3

Texas" manual.

can be found at the following website.


Arrow dimensions are shown in the

The Standard Highway Sign Designs for Texas (SHSD)


http://www.txdot.gov/

"Standard Highway Sign Designs for

NOTE




Down Arrow



INTERSTATE ROUTE MARKERS

Α	С	D	Е
36	21	15	11/2
48	28	20	13/4



"Y" NO. OF EQUAL SPACES 6" Holes


SIGN BLANK PUNCHING DETAILS FOR ATTACHMENTS WHEN SPECIFIED

TO BE TYPE A ALUMINUM SIGNS

(FOR MOUNTING TO GUIDE SIGN FACE)

U.S. ROUTE MARKERS

Sign Size	"Y"
24×24	2
30×24	3
36×36	3
45×36	4
48×48	4
60×48	5



STATE ROUTE MARKERS


No.of Digits	W	Х
4	24	4
4	36	5
4	48	6
3	24	3
3	36	4
3	48	5

MOUNTING DETAILS OF ATTACHMENTS TO GUIDE SIGN FACE ("EXIT ONLY" AND "LEFT EXIT" PANELS, ROUTE MARKERS AND OTHER ATTACHMENTS)

background Attachment sheeting sign sheeting Attachment sheeting must be cut at panel joints

DIRECT APPLIED ATTACHMENT

- 1. Sheeting for legend, symbols, and borders must be cut at panel joints.
- 2. Direct applied attachment signs will be subsidiary to "Aluminum Signs" or "Fiberglass Signs".

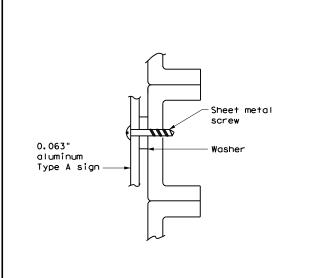



1/4" nut and bolt 0.063" Lock washer aluminum Type A sign Washer




NOTE:

Furnish Type A aluminum sign attachments only when specified in the plans. These signs will be paid for under "Aluminum Signs".

ARROW DETAILS

for Destination Signs (Type D)

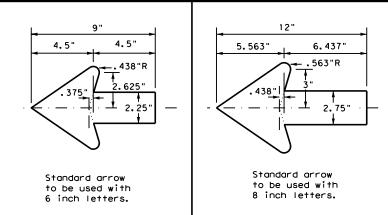



TYPICAL SIGN REQUIREMENTS

TSR(5)-13

ILE:	tsr5-13.dgn	DN: I	KDO1	ck: [xD0]	DW:	TxD0	CK:	1×001
C) TxDOT	October 2003	CONT	SECT	JOB			HIGHWA	Y
	REVISIONS	1392	01	044, ET	C	FM	1378	,ETC
2-03 7- 9-08	13	DIST		COUNTY				T NO.
3-00		DAL		COLLI	N		28	88

SIGN SUPPORT DESCRIPTIVE CODES (Descriptive Codes correspond to project estimate and quantities sheets)

SM RD SGN ASSM TY XXXXX(X)XX(X-XXXX)

Post Type

FRP = Fiberglass Reinforced Plastic Pipe (see SMD(FRP)) TWT = Thin-Walled Tubing (see SMD(TWT))

10BWG = 10 BWG Tubing (see SMD(SLIP-1) to (SLIP-3)) S80 = Schedule 80 Pipe (see SMD(SLIP-1) to (SLIP-3))

Number of Posts (1 or 2)

Anchor Type

UA = Universal Anchor - Concreted (see SMD(FRP) and (TWT)) UB = Universal Anchor - Bolted down (see SMD(FRP) and (TWT))

WS = Wedge Anchor Steel - (see SMD(TWT))

No more than 2 sign

posts should be located

within a 7 ft. circle.

- WP = Wedge Anchor Plastic (see SMD(TWT))
- SA = Slipbase Concreted (see SMD(SLIP-1) to (SLIP-3))
- SB = Slipbase Bolted Down (see SMD(SLIP-1) to (SLIP-3))

Sign Mounting Designation


P = Prefab. "Plain" (see SMD(SLIP-1) to (SLIP-3), (TWT), (FRP)) T = Prefab, "T" (see SMD(SLIP-1) to (SLIP-3), (TWT)) U = Prefab. "U" (see SMD(SLIP-1) to (SLIP-3))

IF REQUIRED 1EXT or 2EXT = Number of Extensions (see SMD(SLIP-1) to (SLIP-3), (TWT))

BM = Extruded Wind Beam (see SMD(SLIP-1) to (SLIP-3)) WC = 1.12 #/ft Wing Channel (see SMD(SLIP-1) to (SLIP-3))

EXAL = Extruded Aluminum Sign Panels (see SMD(SLIP-3))

REQUIRED CLEARANCE FOR BREAKAWAY SUPPORT



To avoid vehicle undercarriage snagging, any substantial remains of a breakaway support, when it is broken away, should not project more than 4 inches above a 60-inch chord (i.e., typical space between wheel paths).


> 7 ft. diameter

circle

Not Acceptable

Not Acceptable

PAVED SHOULDERS



LESS THAN 6 FT. WIDE

When the shoulder is 6 ft. or less in width. the sign must be placed at least 12 ft. from the edge of the travel lane.

HIGHWAY 6 ft min INTERSECTION AHEAD Greater than 6 ft 7.5 ft max Travel 7.0 ft min > Lane Paved Shou I der

SIGN LOCATION

GREATER THAN 6 FT. WIDE

When the shoulder is greater than 6 ft in width, the sign must be placed at least 6 ft, from the edge of the shoulder.

When this sign is needed at the end of a two-lane, two way roadway, the right edge of the sign should be in line with the centerline of the roadway. Place as close to ROW as practical.

Paved

Shou I der


T-INTERSECTION

12 ft min

← 6 ft min ·

7.5 ft max


7.0 ft min *



Edge of Travel Lane

Travel

Lane



- * Signs shall be mounted using the following condition that results in the greatest sign elevation:
- (1) a minimum of 7 to a maximum of 7.5 feet above the edge of the travel lane or (2) a minimum of 7 to a maximum of 7.5 feet above the
- grade at the base of the support when sign is installed on the backslope.

The maximum values may be increased when directed by

See the Traffic Operations Division website for detailed drawings of sign clamps, Triangular Slipbase System components and Wedge Anchor System components.


The website address is: http://www.txdot.gov/publications/traffic.htm

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS GENERAL NOTES & DETAILS


SMD (GEN) - 08

© TxDOT July 2002	DN: TXD	ОТ	CK: TXDOT	DW:	TXDOT	CK:	TXDOT
-08 REVISIONS	CONT	SECT	JOB			HIGHWAY	
	1392	01	044, ET	С	FM	1378,	ETC
	DIST		COUNTY			SHEET	. NO.
	DAL		COLLI	N		28	9

BEHIND BARRIER



BEHIND GUARDRAIL




 $\hbox{\tt **Sign clearance based on distance required for proper guard rail or concrete barrier performance.}$

RESTRICTED RIGHT-OF-WAY

TYPICAL SIGN ATTACHMENT DETAIL

diameter

circle




diameter

circle / Not Acceptable

Bolts used to mount sign panels to the clamp are 5/16-18 UNC galvanized square head with nut, nylon washer, flat washer and lock washer. The bolt length is 1 inch for aluminum.

When two sign clamps are used to mount signs back-to-back, use a 5/16-18 UNC galvanized hex head per ASTM A307 with nut and helical-spring lock washer. The approximate bolt lengths for various post sizes and sign clamp types are given in the table at right. The bolt length may need to be adjusted depending upon field conditions.

Sign clamps may be either the specific size clamp




diameter

circle


Acceptable


	Approximate Bolt Length					
Pipe Diameter	Specific Clamp	Universal Clamp				
2" nominal	3"	3 or 3 1/2"				
2 1/2" nominal	3 or 3 1/2"	3 1/2 or 4"				
3" nominal	3 1/2 or 4"	4 1/2"				

SIGNS WITH PLAQUES

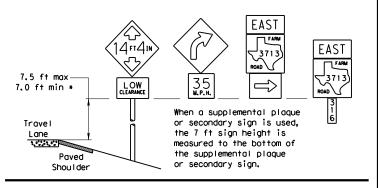


CURB & GUTTER OR RAISED ISLAND

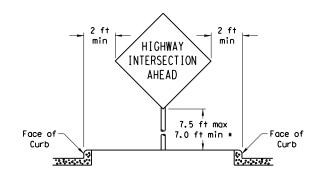




In situations where a lateral restriction prevents the minimum horizontal clearance from the edge of the travel lane, signs should be placed as far from the travel

*** Post may be shorter if protected by guardrail or if Engineer determines the





factors.

lane as practical.


post could not be hit due to extreme



Texas Department of Transportation Traffic Operations Division


The use kind is sion of


TRIANGULAR SLIPBASE INSTALLATION GENERAL REQUIREMENTS

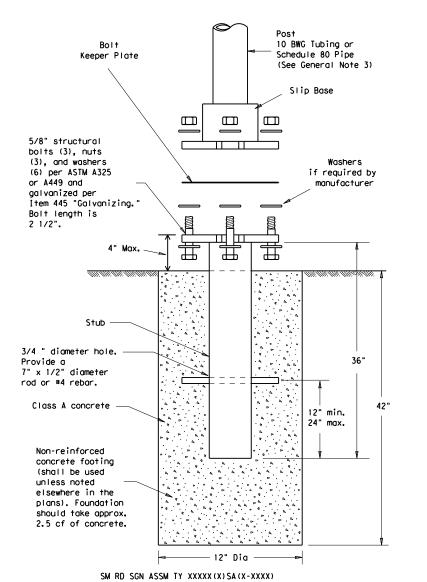

NOTE


The devices shall be installed per manufacturers' recommendations. Installation procedures shall be provided to the Engineer by Contractor.

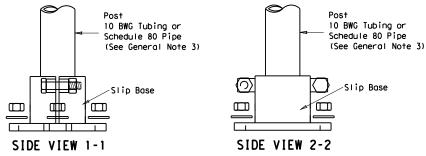



DETAIL A

CONCRETE ANCHOR



SM RD SGN ASSM TY XXXXX(X)SB(X-XXXX)

bolt threads on the upper end. Heavy hex nut per ASTM A563, and stud bolt shall have a minimum of 50 and 75 KSI, respectively. Nuts, bolts and washers shall be ing." Adhesive type anchors shall III epoxy per DMS-6100, "Epoxies and Adhesives." Adhesive anchors cure time per the manufacturer's extend at least flush with top of when installed in 4000 psi normalweight concrete with a 5 1/2" minimum embedment, shall have a of 3900 and 3100 psi, respectively.

Concrete anchor consists of 5/8' diameter stud bolt with UNC series hardened washer per ASTM F436. The yield and ultimate tensile strength galvanized per Item 445, "Galvanizhave stud bolts installed with Type may be loaded after adequate epoxy recommendations. Top of bolt shall the nut when installed. The anchor. minimum allowable tension and shear

GENERAL NOTES:

- 1. Slip base shall be permanently marked to indicate manufacturer. Method, design, and location of marking are subject to approval of the TxDOT Traffic Standards Engineer.
- Material used as post with this system shall conform to the following specifications:

10 BWG Tubing (2.875" outside diameter)

0.134" nominal wall thickness

Seamless or electric-resistance welded steel tubing or pipe

Steel shall be HSLAS Gr 55 per ASTM A1011 or ASTM A1008

Other steels may be used if they meet the following:

55,000 PSI minimum yield strength

70,000 PSI minimum tensile strength

20% minimum elongation in 2"

Wall thickness (uncoated) shall be within the range of 0.122" to 0.138"

Outside diameter (uncoated) shall be within the range of 2.867" to 2.883" Galvanization per ASTM A123 or ASTM A653 G210. For precoated steel tubing (ASTM A653), recoat tube outside diameter weld seam by metallizing with zinc wire per ASTM B833.

Schedule 80 Pipe (2.875" outside diameter)

0.276" nominal wall thickness

Steel tubing per ASTM A500 Gr C

Other seamless or electric-resistance welded steel tubing or pipe with equivalent

outside diameter and wall thickness may be used if they meet the following:

46,000 PSI minimum yield strength 62,000 PSI minimum tensile strength

21% minimum elongation in 2"

Wall thickness (uncoated) shall be within the range of 0.248" to 0.304" Outside diameter (uncoated) shall be within the range of 2.855" to 2.895"

Galvanization per ASTM A123

3. See the Traffic Operations Division website for detailed drawings of sign clamps and Texas Universal Triangular Slipbase System components. The website address is:

http://www.txdot.gov/publications/traffic.htm

4. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.

ASSEMBLY PROCEDURE

10-2010

Foundation

- 1. Prepare 12-inch diameter by 42-inch deep hole. If solid rock is encountered, the depth of the foundation may be reduced such that it is embedded a minimum of 18 inches into the solid rock.
- 2. The Engineer may permit batches of concrete less than 2 cubic yards to be mixed with a portable. motor-driven concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Concrete shall be Class A.
- 3. Push the pipe end of the slip base stub into the center of the concrete. Rotate the stub back and forth while pushing it down into the concrete to assure good contact between the concrete and stub. Continue to work the stub into the concrete until it is between 2 to 4 inches above the ground.
- 4. Plumb the stub. Allow a minimum of 4 days to set, unless otherwise directed by the Engineer.
- 5. The triangular slipbase system is multidirectional and is designed to release when struck from any direction.

- 1. Cut support so that the bottom of the sign will be 7 to 7.5 feet above the edge of the travelway (i.e., edge of the closest lame) when slip plate is below the edge of pavement or 7 to 7.5 feet above slip plate when the slip plate is above the edge of the travelway. The cut shall be plumb and
- 2. Attach sign to support using connections shown. When multiple signs are installed on the same support, ensure the minimum clearance between each sign is maintained. See SMD(SLIP-2) for clearances based on sign types.





SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD (SL IP-1) -08 (DAL)


© TxDOT July 2002	DN: TX	тоот	CK: TXDOT	DW: TX	тоот	CK: TXDOT
9-08 REVISIONS	CONT	SECT	JOB		ніс	HWAY
12-10 (DISTRICT)	1392	01	044, ET	C F	M 13	78,ETC
ADDED CLAMP BASE DETAIL FOR SLIP	DIST		COUNTY			SHEET NO.
BASE INSTALLATION	DAI		COLLI	N		290





0.25 H

W(max)=8FT

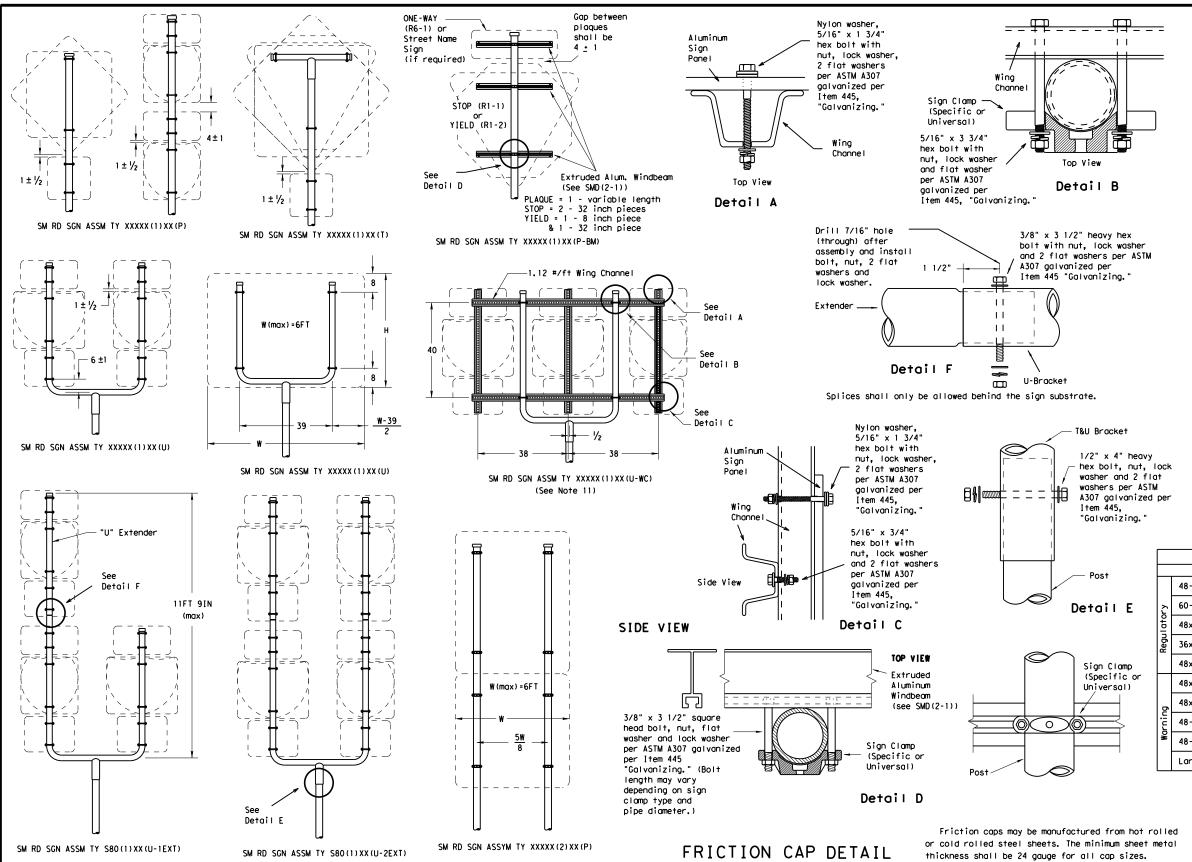

±.05"

Skirt

Variation

Depth

Rolled Crimp to

engage pipe 0.D.

Pipe O.D.

-.025"<u>+</u>.010"

Pipe O.D.

+. 025" +. 010"

All dimensions are in english

unless detailed otherwise.


SM RD SGN ASSM TY XXXXX(1)XX(T)

(* - See Note 12)

GENERAL NOTES:

1.	SIGN SUPPORT	# OF POSTS	MAX. SIGN AREA
	10 BWG	1	16 SF
	10 BWG	2	32 SF
	Sch 80	1	32 SF
	Sch 80	2	64 SF

- The Engineer may require that a Schedule 80 post be used in place of a 10 BWG where a sign height is abnormally high due to a fill slope.
- 3. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
- Aluminum sign blanks shall conform to Departmental Material Specifications DMS-7110 and shall have the following minimum thicknesses: 0.080 for signs less than 7.5 sq. ft., 0.100 for signs 7.5 to 15 sq. ft., and 0.125 for signs greater than 15 sq. ft.
- 5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table on this sheet.
- 6. For horizontal rectangular signs fabricated from flat aluminum, T-brackets are used for signs 24 inches or less in height. U-brackets are used for signs of
- greater height.
 7. When two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
- Wing channel shall meet ASTM A 1011 SS Gr 50 and be galvanized per ASTM A 123.
- 9. Excess pipe, wing channel, or windbeam shall be cut off so that it does not extend beyond the sign panel (i.e., excess support shall not be visible when the sian is viewed from the front,) Repair galvanized coating at cut support ends per Item 445, "Galvanizing."
- 10. Additional route markers may be added vertically, provided the total sign area does not exceed the maximum allowable amount per Note 1.
- 11. Additional sign clamp required on the "T-bracket" post for 24 inch height signs. Place the clamp 3 inches above bottom of sign when possible.
- 12. Post open ends shall be fitted with Friction Caps.
- 13. Sign blanks shall be the sizes and shapes shown on the plans.

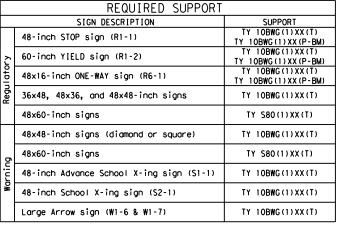




SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-2)-08


© Tx	DOT July 2002	DN: TXD	тот	CK: TXDOT	DW:	TXDOT		CK: TXDOT
9-08	REVISIONS	CONT	SECT	JOB			HIGH	IWAY
		1392	01	044, ET	C	FM	137	'8,ETC
		DIST		COUNTY			SH	HEET NO.
		DAL		COLLI	N			291

The rim edges shall be reasonably straight and smooth. Caps shall be sized and formed in such a manner as to produce a drive-on friction fit and have no tendency to rock when seated on the pipe. The depth shall be sufficient to give positive protection against entrance of rainwater. They shall be free of sharp creases or indentations and show no evidence of metal fracture.


Caps shall have an electrodeposited coating of zinc in accordance with the requirements of ASTM B633 Class FE/ZN 8.

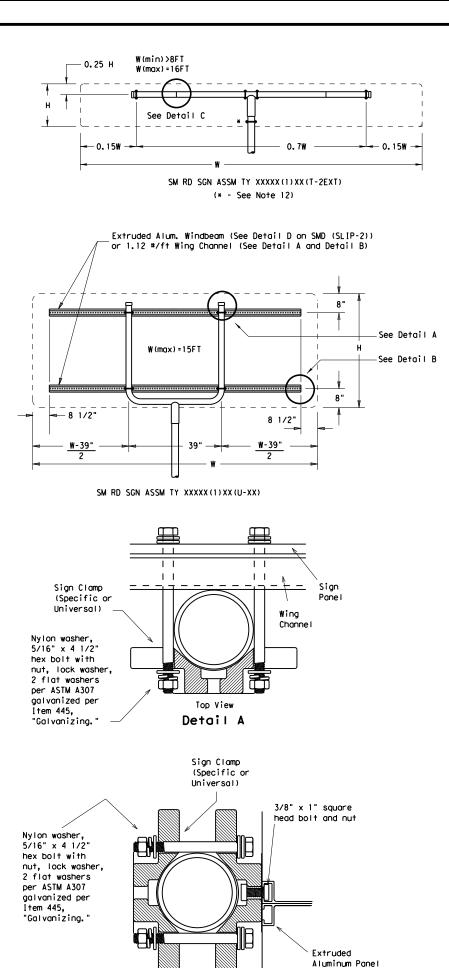

EXTRUDED ALUMINUM SIGN WITH T BRACKET



Detail B

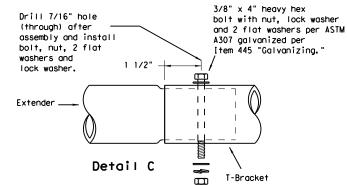

Splices shall only be allowed behind the sign substrate.

Sign

Clamps

(Specific or

Universal)

3/8" x 4 1/2"


square head bolt, nut, flat washer and lock washer per


ASTM A307 galvanized


per Item 445.

"Galvanizina.


Detail E

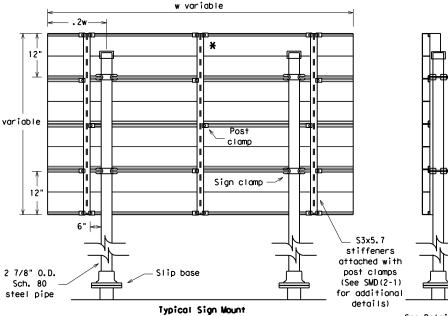




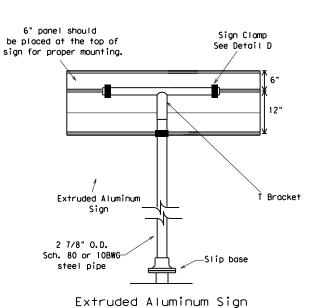

With T Bracket





Use Extruded Alum. Windbeam as stiffeners See SMD (2-1) for additional details See Detail E for clamp installation

GENERAL NOTES:

1.	SIGN SUPPORT	# OF POSTS	MAX. SIGN AREA
	10 BWG	1	16 SF
	10 BWG	2	32 SF
	Sch 80	1	32 SF
	Sch 80	2	64 SF

- The Engineer may require that a Schedule 80 post be used in place of a 10 BWG where a sign height is abnormally high due to a fill slope.
- 3. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
- Aluminum sign blanks shall conform to Departmental Material Specifications DMS-7110 and shall have the following minimum thicknesses: 0.080 for signs less than 7.5 sq. ft., 0.100 for signs 7.5 to 15 sq. ft., and 0.125 for signs greater than 15 sq. ft.
- 5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table on this sheet.

 6. For horizontal rectangular signs fabricated from flat
- aluminum, T-brackets are used for signs 24 inches or less in height. U-brackets are used for signs of
- greater height.
 7. When two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
- Wing channel shall meet ASTM A 1011 SS Gr 50 and be galvanized per ASTM A 123.
- 9. Excess pipe, wing channel, or windbeam shall be cut off so that it does not extend beyond the sign panel (i.e., excess support shall not be visible when the sign is viewed from the front.) Repair galvanized coating at cut support ends per Item 445, "Galvanizing."
- 10. Sign blanks shall be the sizes and shapes shown on
- 11. Additional sign clamp required on the "T-bracket" post for 24 inch high signs. Place the clamp 3 inches above bottom of sign when possible.
- 12. Post open ends shall be fitted with Friction Caps.

	REQUIRED SUPPORT	
	SIGN DESCRIPTION	SUPPORT
	48-inch STOP sign (R1-1)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
,	60-inch YIELD sign (R1-2)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	48x16-inch ONE-WAY sign (R6-1)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
•	36x48, 48x36, and 48x48-inch signs	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
	48x48-inch signs (diamond or square)	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
	48-inch Advance School X-ing sign (S1-1)	TY 10BWG(1)XX(T)
!	48-inch School X-ing sign (S2-1)	TY 10BWG(1)XX(T)
	Large Arrow sign (W1-6 & W1-7)	TY 10BWG(1)XX(T)



SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-3)-08

© TxDOT July 2002	DN: TXD	ОТ	CK: TXDOT	DW:	TXDOT	CK: TXDOT
9-08 REVISIONS	CONT	SECT	JOB			HIGHWAY
	1 392	01	044, ET	C	FM	1378,ETC
	DIST		COUNTY			SHEET NO.
	DAL		COLLI	N		292


XX M. P. H.

Standard Double Yellow Stripes


Curve Safety Sequence

Applicable Mi	nimum Measur	es		carve surery sequence
Advisory Speed 55 mph or higher	Advisory	Advisory	111:4	ve signing, delineation and pavement markings sted in order from minimum to maximum level of treatment as needed)
+	+	+	1	Advance warning (36" x 36") and advisory mph (18" x 18")
+	+	+	2	Chevron alignment signs if advisory speed is 15 mph or greater than posted speed
	+	+	3	Edge lines
			3a	Pavement width 24' or greater 6" solid white edge line
			3b	Pavement width 20' - 24' 4" solid white edge line
			3с	Pavement width 20' or less no edge line
		Supplementa	l Me	osures
		#	4	Add shoulders and edge line (see #3a)
		#	5	Yellow high intensity flourescent chevron alignment signs - add
				reflective sheeting to sign support from bottom edge of sign
#	#	#	6	Large advance warning (48" x 48") and advisory mph (30" x 30")
#	#	#	7	Arrow sign (48" x 24")
		#	8	Large arrow sign with diagonals (96" x 36")
		#	9	Add flashers to advance warning signs
#	#	#	10	Surface treatment to improve friction
			* *	The W1-1R or L sign shall only be used when the advisory speed is
				30 mph or less

Typical Curve Treatment with Intersection

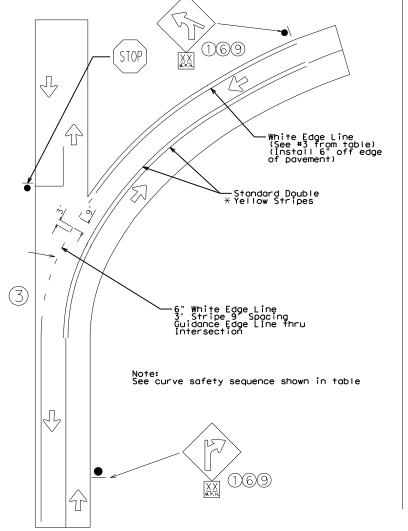

Typical Reverse Curve Edge Line Treatment

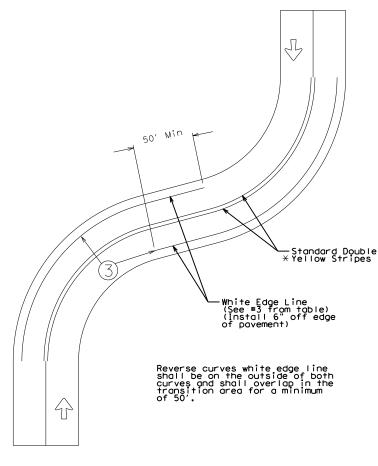

* Standard Double Yellow Stripes shall be dropped through a non-signalized intersection within the city limit. Outside the city limit, the Standard Double Yellow Strip shall be carried through all non-signalized intersections.

+ = required

= optional

Applications 4 - 10 are additional supplemental applications which may be added as directed by the Area Engineer.

Point of

curvature

Note:
"B" - Chevron Spacing
referenced from D&OM(3)-15B

Notes:

- 1. Two methods will be used to determine the appropriate advisory speed for curves, the GPS Method(existing curves) and the Design Method (new curves).
- 2. Notify the Traffic Engineering Section for all requests on advisory speeds for existing curves.


OCT-2014 Texas Department of Transportation UPDATED NOTES ©2013 JAN-2016

NOTE ADDED TWO-LANE HIGHWAY CURVE SIGNING & MARKINGS SEPT-2016 NOTE ADDED FOR STRIPING IN CURVE DALLAS DISTRICT STANDARD

	ı
MAR-2017	
REMOVED	
REFERENCE	L
TO DELINEATORS	
MAY-2019	ŀ
MODIFIED	
SIGN SIZE	r

SCALE:	NTS			SH	EET	1	OF	1
DESIGN/CK	FED.RD. DIV.NO.	FEDER	AL AID PROJECT NO.			HIGH NO		
CHECK	6	SEE	TITLE SHEET		FM	137	8,E	TC.
BLS	STATE	DISTRICT	COUNTY			SHE NO		
FRC	TEXAS	DALLAS	VARIOUS			_	_	
CHECK	CONTROL	SECTION	JOB			26	1:3	
ΔRO	1392	0.1	044. ETC.			_ `		

20A

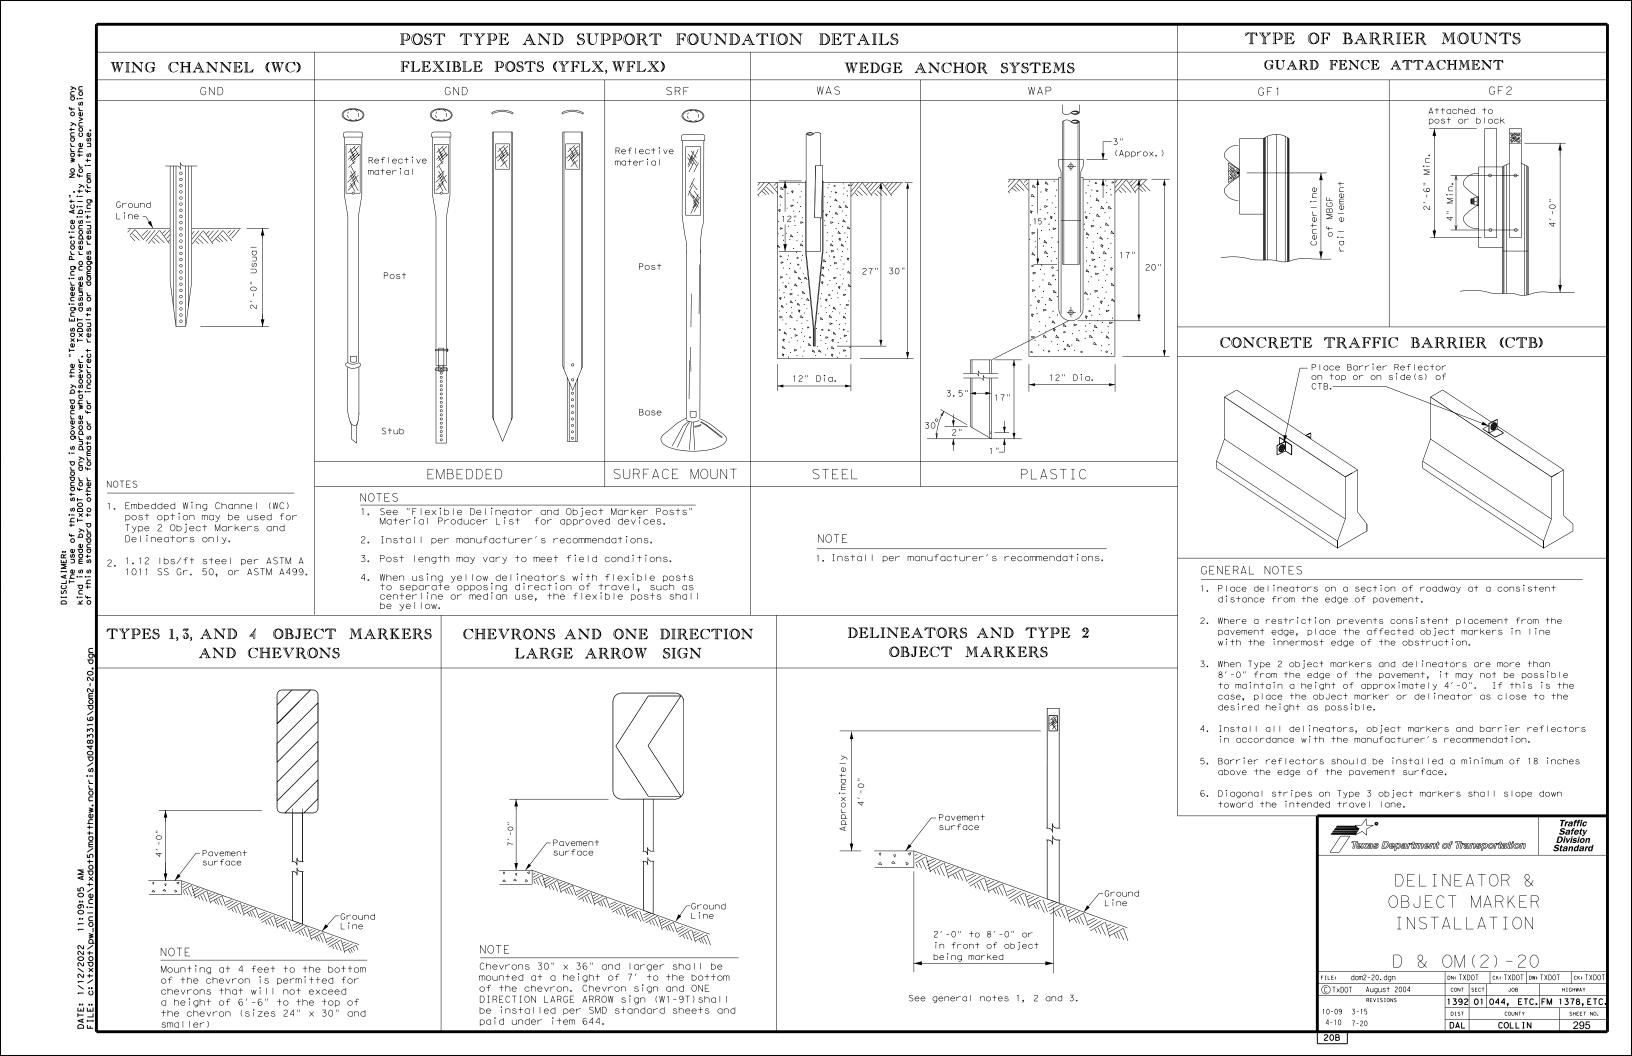


MINIMUM WARNING DEVICES AT CURVES WITH ADVISORY SPEEDS


Amount by which Advisory Speed	Curve Advisory Speed				
is less than Posted Speed	Turn (30 MPH or less)	Curve (35 MPH or more)			
5 MPH & 10 MPH	• RPMs	• RPMs			
15 MPH & 20 MPH	 RPMs and One Direction Large Arrow sign 	 RPMs and Chevrons; or RPMs and One Direction Large Arrow sign where geometric conditions or roadside obstacles prevent the installation of chevrons. 			
25 MPH & more	RPMs and Chevrons; or RPMs and One Direction Large Arrow sign where geometric conditions or roadside obstacles prevent the installation of	• RPMs and Chevrons			

SUGGESTED SPACING FOR DELINEATORS ON HORIZONTAL CURVES

chevrons

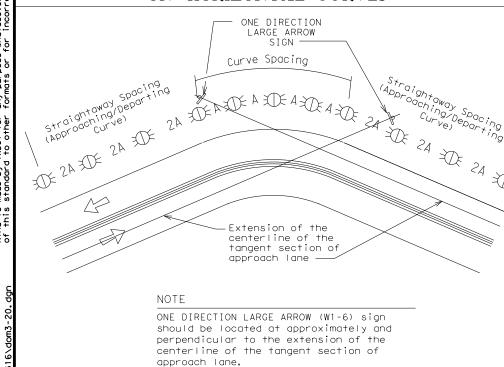

SUGGESTED SPACING FOR CHEVRONS ON HORIZONTAL CURVES

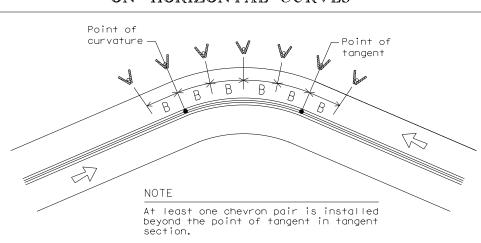

DELINEATOR AND CHEVRON SPACING

WHEN DEGREE OF CURVE OR RADIUS IS KNOWN

			FEET	
Degree of Curve	Radius of Curve	Spacing in Curve	Spacing in Straightaway	Chevron Spacing in Curve
		А	2A	В
1	5730	225	450	
2	2865	160	320	
3	1910	130	260	200
4	1433	110	220	160
5	1146	100	200	160
6	955	90	180	160
7	819	85	170	160
8	716	75	150	160
9	637	75	150	120
10	573	70	140	120
11	521	65	130	120
12	478	60	120	120
13	441	60	120	120
1 4	409	55	110	80
15	382	55	110	80
16	358	55	110	80
19	302	50	100	80
23	249	40	80	80
29	198	35	70	40
38	151	30	60	40
57	101	20	40	40

Curve delineator approach and departure spacing should include 3 delineators spaced at 2A. This spacing should be used during design preparation or when the degree of curve is known.

DELINEATOR AND CHEVRON SPACING

WHEN DEGREE OF CURVE OR RADIUS IS NOT KNOWN

Advisory Speed (MPH)	Spacing in Curve	Spacing in Straightaway	Chevron Spacing in Curve
	Α	2×A	В
65	130	260	200
60	110	220	160
55	100	200	160
50	85	170	160
45	75	150	120
40	70	140	120
35	60	120	120
30	55	110	80
25	50	100	80
20	40	80	80
15	35	70	40

If the degree of curve is not known, delineator spacing may be determined based on the Advisory Speed of the curve. Use the delineator curve spacing for each Advisory Speed (MPH).

DELINEATOR AND OBJECT MARKER APPLICATION AND SPACING

CONDITION	REQUIRED TREATMENT	MINIMUM SPACING
Frwy./Exp. Tangent	RPMs	See PM-series and FPM-series standard sheets
Frwy./Exp. Curve	Single delineators on right side	See delineator spacing table
	Single delineators on at least one	100 feet on ramp tangents
Frwy/Exp.Ramp	side of ramp (should be on outside of curves) (see Detail 3 on D&OM(4))	Use delineator spacing table for ramp curves ("straightway spacing" does not apply to ramp curves)
Acceleration/Deceleration Lane	Double delineators (see Detail 3 on D&OM(4))	100 feet (See Detail 3 on D & OM (4)
Truck Escape Ramp	Single red delineators on both sides	50 feet
Bridge Rail (steel or concrete)and Metal Beam Guard Fence	Bi-Directional Delineators when undivided with one lane each direction Single Delineators when multiple lanes each direction	Equal spacing (100'max) but not less than 3 delineators
Concrete Traffic Barrier (CTB) or Steel Traffic Barrier	Barrier reflectors matching the color of the edge line	Equal spacing 100' max
Cable Barrier	Reflectors matching the color of the edge line	Every 5th cable barrier post (up to 100'max)
Guard Rail Terminus/Impact Head	Divided highway - Object marker on approach end Undivided 2-lane highways - Object marker on approach and departure end	Requires reflective sheeting provide by manufacturer per D & OM (VIA) or a Type 3 Object Marker (OM-3) in front of the terminal end See D & OM (5) and D & OM (6)
Bridges with no Approach Rail	Type 3 Object Marker (OM-3) at end of rail and 3 single delineators approaching rail	See D & OM(5)
Reduced Width Approaches to Bridge Rail	Type 2 and Type 3 Object Markers (OM-3) and 3 single delineators approaching bridge	Requires reflective sheeting provided by manufacturer per D & OM (VIA) or a Type 3 Object Marker (OM-3) in front of the terminal end
		See D & OM (5)
Culverts without MBGF	Type 2 Object Markers	See Detail 2 on D & OM(4)
Crossovers	Double yellow delineators and RPMs	See Detail 1 on D & OM (4)
Pavement Narrowing (lane merge) on	Single delineators adjacent to affected lane for full	100 feet

- Unless indicated otherwise, the delineator or barrier reflector color shall conform to the color of the pavement edge line on the side of the road where the delineators or barrier reflectors are placed.
- 2. Barrier reflectors may be used to replace required delineators.
- 3. Single red delineators may be mounted on the back side of delineator posts for wrong way driver applications

	LEGEND
$\stackrel{\sim}{\mathbb{R}}$	Bi-directional Delineator
\mathbb{R}	Delineator
-	Sign





DELINEATOR &
OBJECT MARKER
PLACEMENT DETAILS

D & OM(3)-20

FILE: dom3-20.dgn	DN: TX[TOC	ck: TXDOT	DW: TXDO	T	ck: TXDO
© TxDOT August 2004	CONT	SECT	JOB		HIG	HWAY
REVISIONS	1392	01	044, E1	C. FM	13	78,ETC
3-15 8-15	DIST		COUNTY		9	HEET NO.
8-15 7-20	DAL		COLLI	N		296

20C

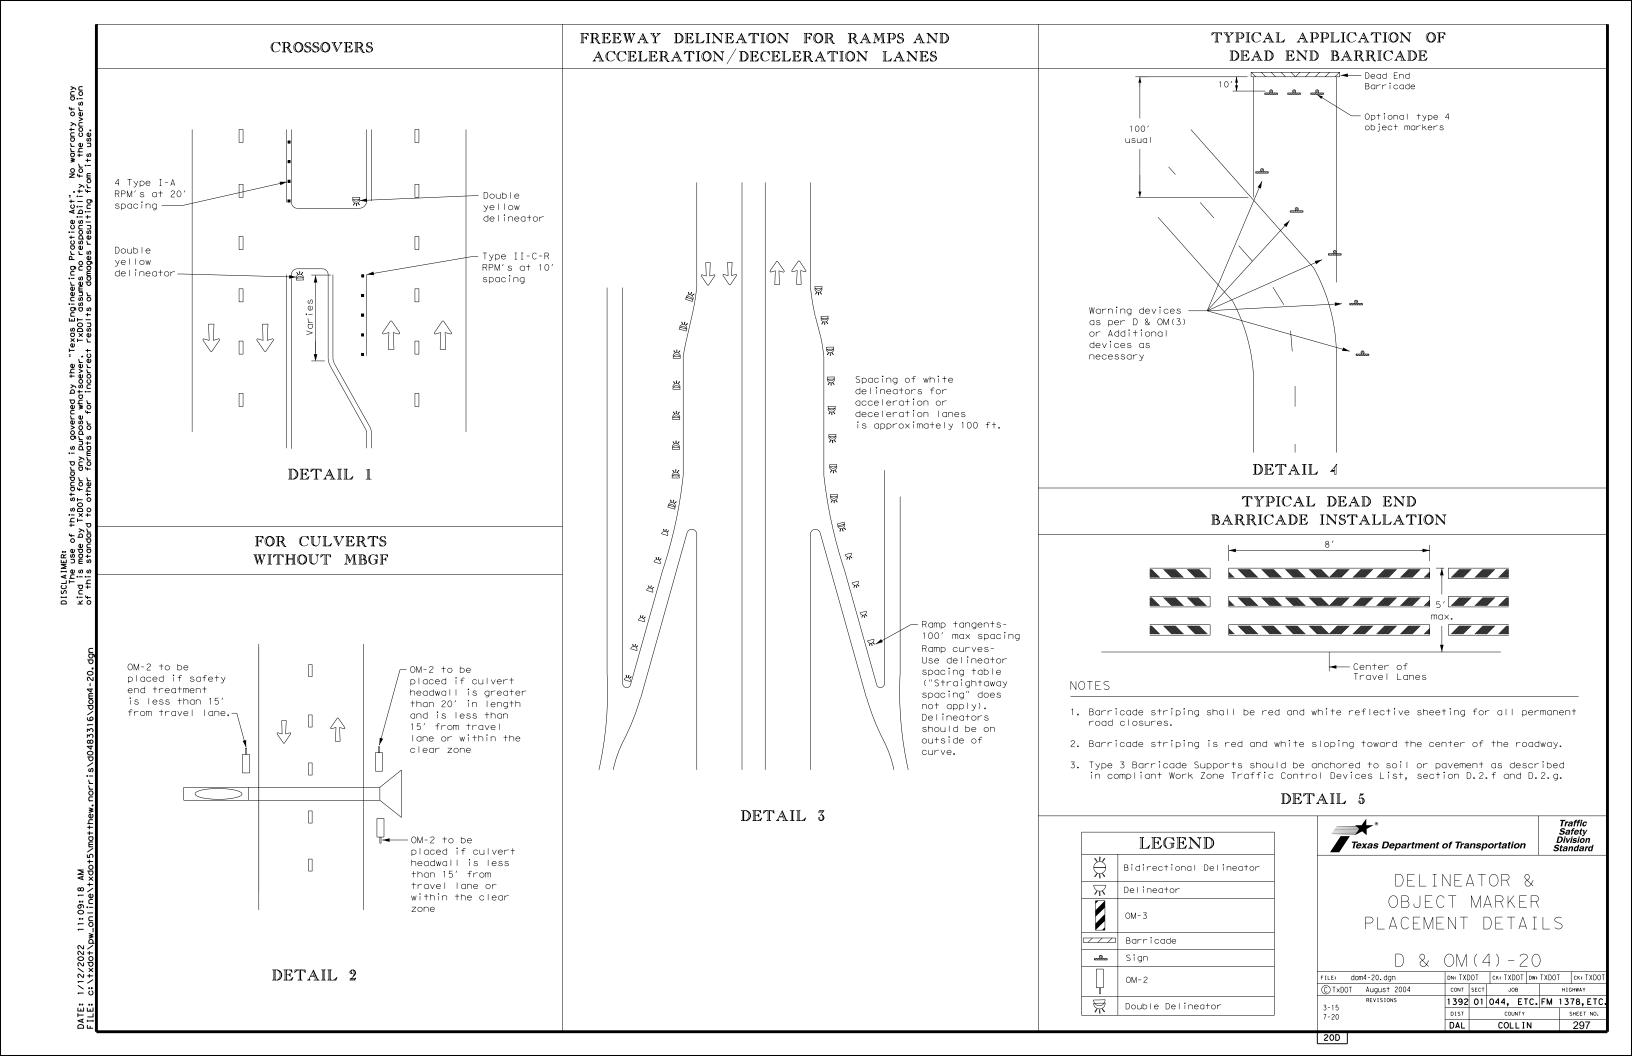

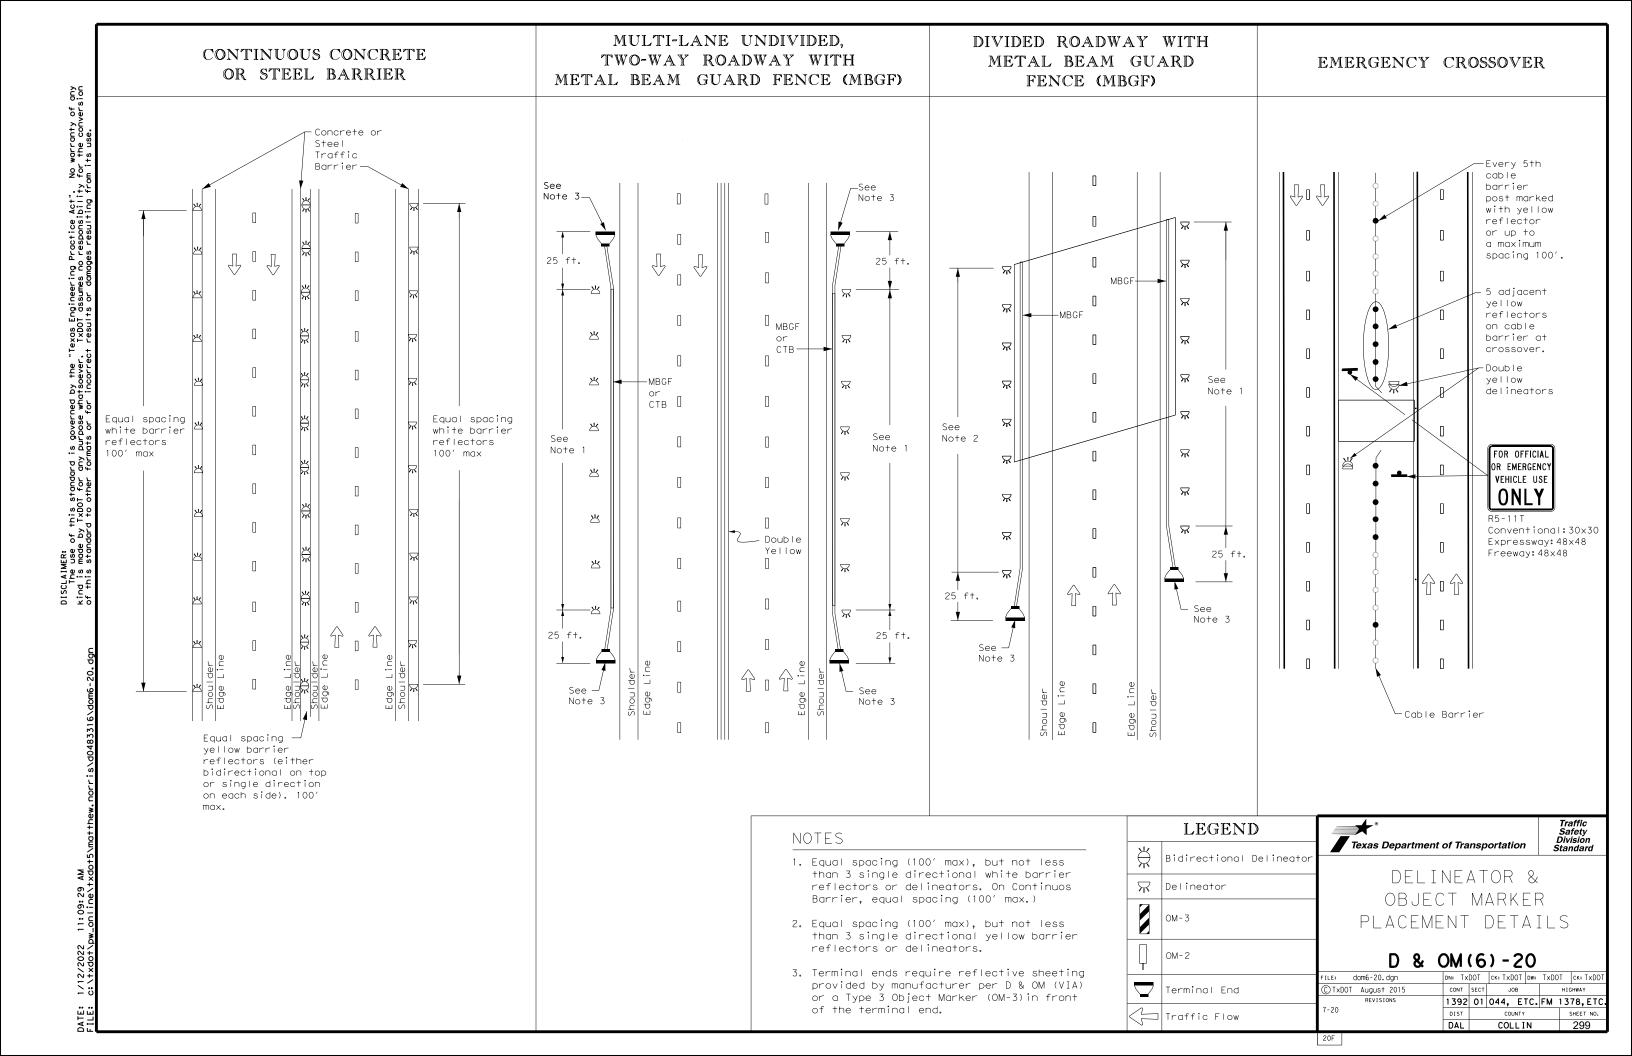

Shou I der

4" Solid

Edge Line-


4" Solid

4" Solid White


Edge Line-

White Edge Line-


Yellow

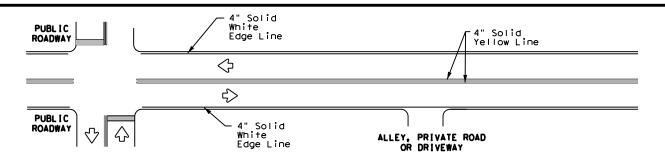

TYPICAL TWO-LANE. TWO-WAY PAVEMENT MARKINGS THROUGH INTERSECTIONS

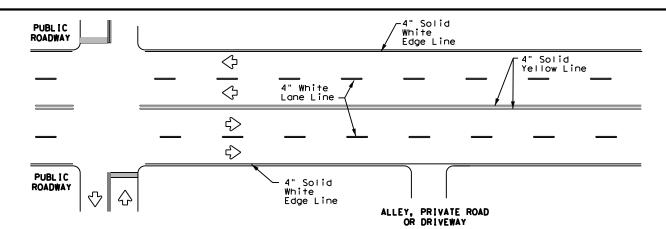

TYPICAL MULTI-LANE, TWO-WAY PAVEMENT MARKINGS THROUGH INTERSECTIONS

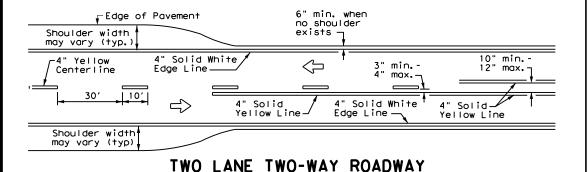

WITH OR WITHOUT SHOULDERS

-6" min.

_6" min.

10′

3" min.-4" usual

(12" max. for

traveled way

10′

 \Rightarrow

 $\overline{}$

 \Rightarrow

-Edge of Pavement

EDGE LINE AND LANE LINES

ONE-WAY ROADWAY

WITH OR WITHOUT SHOULDERS

-Edge of Pavement

wnite F

Lane Line

4" Solid Yellow Line-

4" Solid White


CENTERLINE AND LANE LINES

FOUR LANE TWO-WAY ROADWAY


WITH OR WITHOUT SHOULDERS

──4" White

 \Rightarrow



YIELD LINES

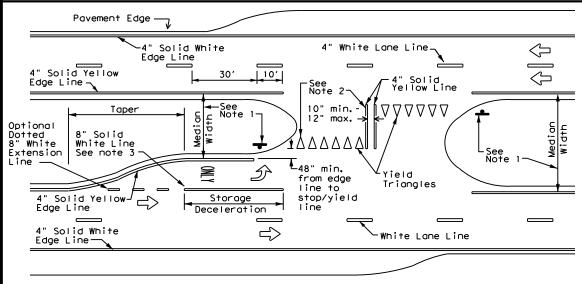

FOUR LANE DIVIDED ROADWAY CROSSOVERS

NOTES


- 1. Where divided highways are separated by median widths at the median opening itself of 30 feet or more, median openings shall be signed as two separate intersections. Each median opening has two width measurements, with one measurement for each approach. The narrow median width will be the controlling width to determine if signs are required. Yield signs are the typical intersection control. Stop signs are optional as determined by the Engineer.
- 2. Install median striping (double yellow centerlines and stop bars/yield triangles) when a 50' or greater median centerline can be placed. Stop bars shall only be used with stop signs. Yield traingles shall only be used with yield signs.
- 3. Length of turn bays, including taper, deceleration, and storage lengths shall be as shown on the plans or as directed by the Engineer.

GENERAL NOTES

- 1. Edgeline striping shall be as shown in the plans or as directed by the Engineer. The edgeline should not be placed less less than 6 inches from the edge of pavement. This distance may vary due to pavement raveling or other conditions. Edgelines are not required in curb and gutter sections of roadways.
- 2. The traveled way includes only that portion of the roadway used for vehicular travel. It does not include the parking lanes, sidewalks, berms and shoulders. The traveled ways shall be measured from the inside of edgeline to the inside of edgeline of a two lane roadway.


MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

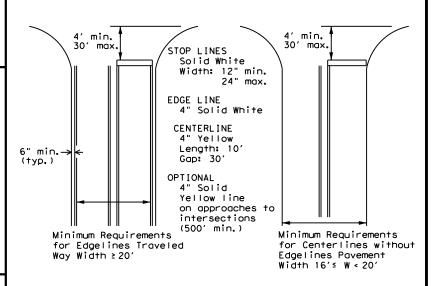


GUIDE FOR PLACEMENT OF STOP LINES. EDGE LINE & CENTERLINE


Based on Traveled Way and Pavement Widths for Undivided Highways




CIXDOT November 1978 1392 01 044, ETC. FM 1378, ETC 8-95 3-03 REVISION 5-00 2-12 8-00 6-20 COLLIN

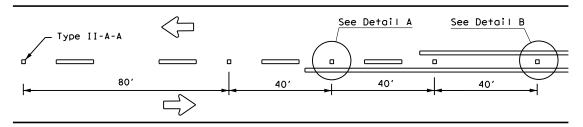

CENTERLINE FOR ALL TWO LANE ROADWAYS

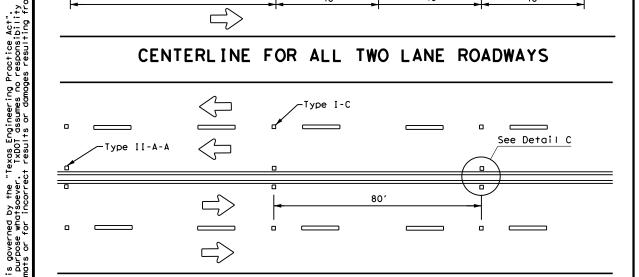


CENTERLINE & LANE LINES FOR FOUR LANE TWO-WAY HIGHWAYS

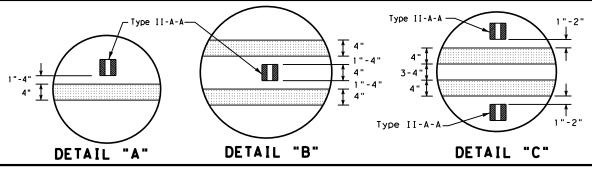

Centerline \ Symmetrical around centerline Continuous two-way left turn lane Type II-A-A 401 80' Type I-C

CENTERLINE AND LANE LINES FOR TWO-WAY LEFT TURN LANE

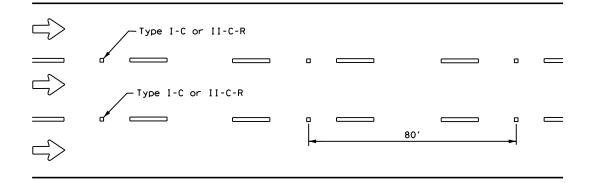

LANE LINES FOR ONE-WAY ROADWAY (NON-FREEWAY FACILITIES)

Raised pavement markers Type II-C-R shall have clear face toward normal traffic and red face toward wrong-way traffic.

CENTER OR EDGE LINE | 12"<u>+</u> 1" 10' BROKEN LANE LINE REFLECTORIZED PROFILE PATTERN DETAIL USING REFLECTIVE PROFILE PAVEMENT MARKINGS 18"<u>+</u> 1" -300 to 500 mil in height 12"<u>+</u> 1" 51/2" ± 1/2" 31/4 "± 3/4 "\$ A quick field check for the thickness 2 to 3"--2 to 3"-of base line and profile marking is approximately equal to a stack of 5 quarters to a maximum height of 7 quarters. OPTIONAL 6" EDGE 4" EDGE LINE. LINE, CENTER LINE CENTER LINE NOTE OR LANE LINE OR LÂNE LINE


Profile markings shall not be placed on roadways with a posted speed limit of 45 MPH or less.

GENERAL NOTES


- All raised pavement markers placed in broken lines shall be placed in line with and midway between
- On concrete pavements the raised pavement markers should be placed to one side of the longitudinal


MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.



Type I (Top View)





RAISED PAVEMENT MARKERS



Traffic Safety Division Standard

POSITION GUIDANCE USING RAISED MARKERS RELECTORIZED PROFILE **MARKINGS** PM(2) - 20

LE: pm2-20,dgn	DN:	CK: DW:		CK:			
)TxDOT April 1977	CONT	SECT	JOB			HIGHWAY	
-92 2-10 REVISIONS	1392	01	044, E	TC.	FM :	1378,ETC.	
-00 2-12	DIST		COUNTY			SHEET NO.	
-00 6-20	DAL		COLLI	N		301	

No warranty of any for the conversion


Pavement

RIGHT LANE ENDS

Edge

MINOR

TWO-WAY

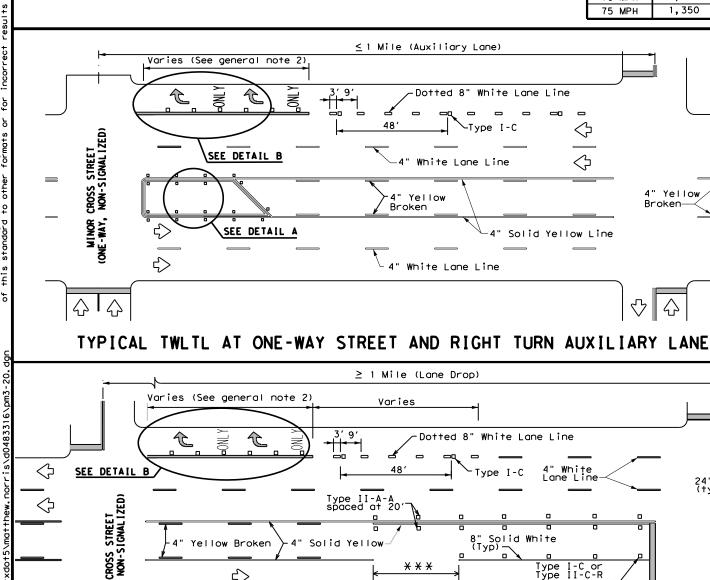

➪

<>

imes imes imes Typically equal to $imes_2$ the length of storage lane

TYPICAL TWLTL AT TWO-WAY CROSS STREET AND RIGHT TURN LANE DROP

MINOR TWO-WAY,

4" Dotted White

D/2

LANE REDUCTION

″W9-2⊺L

-Lane-Reduction

Arrow_

D/4

Extension Line-

D/4

LANE ENDS MERGE LEFT

Paved Shoulder

(Optional)

300'-500'

NOTES

Posted

Speed

30 MPH

35 MPH

40 MPH

45 MPH

50 MPH

55 MPH

60 MPH

65 MPH

70 MPH

75 MPH

D (f+)

460

565

670

885

990

1,100

1,200

1,250

1,350

4" Yellow

♡ 0

Type I-C or Type II-C-R

spaced at 20

L=WS²

60


L=WS

Wņite (†yp.")-

 \Diamond

STREET

- 1. Lane reduction pavement markings are used where the number of through lanes is reduced because of narrowing of the roadway or because of a section of on-street parking in what would otherwise be a through lane. For Texas Super 2 Passing Lanes, see TS2(PL) standard sheets.
- 2. On divided highways, an additional W9-1R "RIGHT LANE ENDS" sign may be installed in the median aligned with the W9-1R sign on the right side of the highway.
- 3. Lane reduction arrows are required for speeds of 45 mph or greater. An optional third lane reduction arrow may be added based on engineering judgement. If used, the optional third lane reduction arrow should be centered between the first and last lane reduction arrows.
- For lane reductions on Freeways and Expressways, signing shall conform to the TxDOT Freeway Signing Handbook.

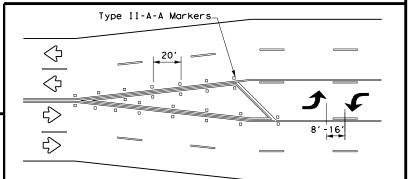

A two-way left-turn (TWLT) lane-use arrow pavement marking should be used at or just downstream from the beginning of a two-way left-turn lane within a corridor. Repeating the marking after each intersection or dedicated turn bay is not required unless stated elsewhere in the plans.


TYPICAL TRANSITION FOR TWLTL AND DIVIDED HIGHWAY

GENERAL NOTES


- 1. Lane use word and arrow markings shall be used where through lanes approaching an intersection become mandatory turn lanes. Lane use word and arrow markings should be used in auxiliary lanes of substantial length. Lane use arrow markings or word and arrow markings may be used in other lanes and turn bays for emphasis. Details for words and arrows are as shown in the Standard Highway Sign Designs for Texas.
- 2. When lane-use words and arrow markings are used, two sets of arrows should be used if the length of the bay is greater than 180 feet. When a single lane use arrow or word and arrow marking is used for a short turn lane, it should be located at or near the upstream end of the full-width turn lane.
- Use raised pavement marker Type I-C with undivided highways, flush medians and two way left turn lanes. Use raised pavement marker Type II-C-R with divided highways and raised medians.
- 4. Length of turn bays, including taper, deceleration, and storage lengths shall be as shown on the plans or as directed by the Engineer.

MATERIAL SPECIFICATIONS				
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200			
EPOXY AND ADHESIVES	DMS-6100			
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130			
TRAFFIC PAINT	DMS-8200			
HOT APPLIED THERMOPLASTIC	DMS-8220			
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240			

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

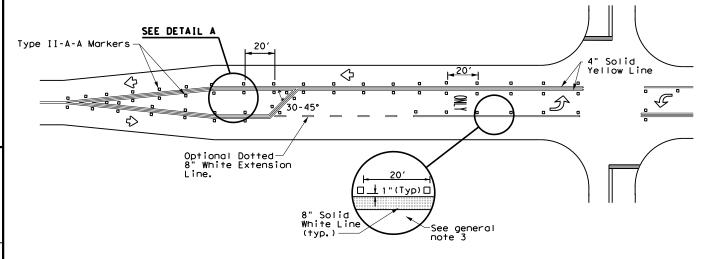

TYPICAL TWO-LANE HIGHWAY INTERSECTION WITH LEFT TURN BAYS

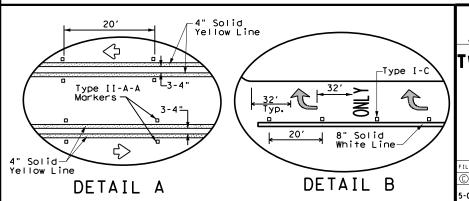




'WO-WAY LEFT TURN LANES. RURAL LEFT TURN BAYS.

Traffic Safety Division Standard


AND LANE REDUCTION PAVEMENT MARKINGS PM(3) - 20

FILE:	pm3-20.dgn	DN:		CK:	DW:		С	к:
① TxI	OOT April 1998	CONT	SECT	JOB			HIGH	WAY
5-00	2-10 REVISIONS	1392	01	044, E	TC.	FM	1378	в, ЕТС.
8-00	2-12	DIST		COUNT	Y		SHI	EET NO.
3-03	6-20	DAL		COLL	ΙN		3	302

22C

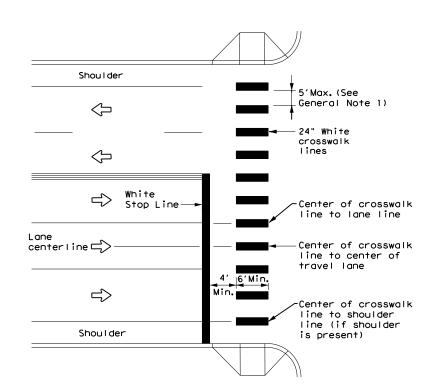

HIGH-VISIBILITY LONGITUDINAL CROSSWALK AT CONTROLLED APPROACH

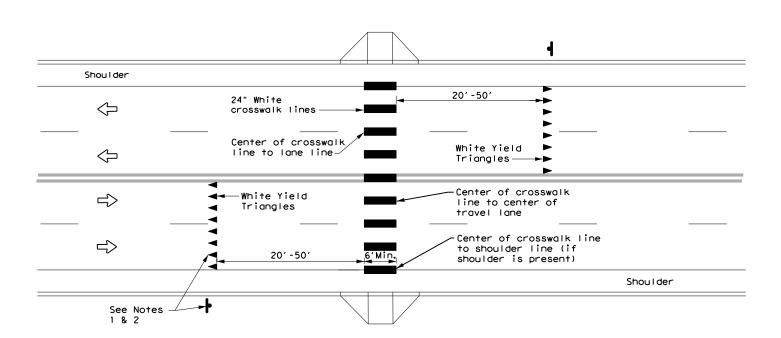

UNSIGNALIZED MID BLOCK HIGH-VISIBILITY LONGITUDINAL CROSSWALK

GENERAL NOTES

- Longitudinal crosswalk lines should not be placed in the wheel path of vehicles. Center the crosswalk lines on travel lanes, lane lines, and shoulder lines (if present).
- A minimum 6" clear distance shall be provided to the curb face. If the last crosswalk line falls into this distance it must be omitted.
- 3. For divided roadways, adjustments in spacing of the crosswalk lines should be made in the median so that the crosswalk lines are maintained in their proper location across the travel portion of the roadway.
- 4. At skewed crosswalks, the crosswalk lines are to remain parallel to the lane lines.
- 5. Each crosswalk shall be a minimum of 6' wide.
- 6. The High-Visibility Longitudinal Crosswalk is the preferred crosswalk pattern on State Highways. Other crosswalk patterns as shown in the "Texas Manual on Uniform Traffic Control Devices" may be used. All crosswalk designs and dimension shall comply with the "Texas Manual on Uniform Traffic Control Devices."
- 7. Final placement of Stop Bar/Yield Triangles and Crosswalk shall be approved by the Engineer in the field.

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

NOTES

- Use yield triangles with "Yield Here to Pedestrians" signs at unsignalized mid block crosswalks.
- Use stop bars with "Stop Here on Red" signs at mid block crosswalks controlled by traffic signals or pedestrian hybrid beacons.



Traffic Safety Division Standard

CROSSWALK PAVEMENT MARKINGS

PM(4) - 20

.E: pm4-20, dgn	DN:		CK:	D)W:		CH	:
TxDOT June 2020	CONT	SECT	JC	В			HIGHW	YAY
REVISIONS	1392	01	044,	ET	C.F	М	1378	B, ETC.
	DIST		COL	JNTY			SHE	ET NO.
	DAL		COL	LIN	١		3	03

2. PROJECT SITE MAPS:

- * Project Location Map: See Title Sheet and Project Layout Sheets.
- * Drainage Patterns: See Exterior Drainage Area Map Sheet.
- * Slopes Anticipated After Major Gradings or Areas of Soil Disturbance: See typical Sections Sheets
- * Location of Erosion and Sediment Controls: See SW3P Site Map Sheets
- * Surface Waters and Discharge Locations: See Culvert Layouts Sheets
- * Project Specific Location(s) (PSL): To be determined by the project Construction Personnel. Location(s) shown on SW3P Site Map (If PSL location(s) is within one mile of project) and information located in project SW3P Binder (Reference Item *IO below).

3. PROJECT DESCRIPTION:

CONSTRUCT INTERESCTION IMPROVEMENTS (SIDEWALK & TURN LANES)

4. MAJOR SOIL DISTURBING ACTIVITIES:

Construction of Intersection improvements consisting of paving, grading, final surface preparation, revegetation, Drainage, Signing and Traffic Signal Construction, and final surface preparation and vegetation.

5. EXISTING CONDITION OF SOIL & VEGETATIVE COVER AND % OF EXISTING VEGETATIVE COVER:

Gentle sloping to sloping, 100% materials were light to dark brown clay with aggregate fragments and fill sand at the top layers. The project area consists mostly of short grasses and shrubs, wih a few small trees throughout. A portion of the site has been developed with streets and houses. The estimated existing vegetative cover is 60%.

6. TOTAL PROJECT AREA: 17.80 Acres

7. TOTAL AREA TO BE DISTURBED: 16.90 Acres

8. WEIGHTED RUNOFF COEFFICIENT

BEFORE CONSTRUCTION: 0.45 AFTER CONSTRUCTION:

9. NAME OF RECEIVING WATERS:

White Rock Creek East Tributary No: I, which flows to Lake Lavon (Segment 0821, no water quality impairments).

10. PROJECT SW3P Binder:

A. For projects disturbing one to five acres, TxDOT will maintain a SW3P Binder at the project field office (If there is not a project field office, should be kept at the Area Office) which contains the following: Index Sheet, TCEQ Signature Authority, TxDOT's and Contractor's Small Construction Site Notice, SW3P Inspector Qualification Statements, EPIC Sheet, SW3P Sheet, Site Location Maps, Inspection and Maintenance Reports (Form 2118), Construction Stage Gate Checklist(s) (CSGC). Stored Material Lists specifying associated control measures and the Appendix which contains the TPDES Construction General Permit, TxDOT and Contractor MS4 Operator Notification(s) and the Construction PSL Permits per all applicable requirements.

B. For projects disturbing 5 acres or more, TxDOT will follow the actions listed in (IO.A.) above with the addition of the following: TxDOT and Contractor Notice Of Intent (N.O.I.) and Fee Payment Form, TxDOT and Contractor Large Construction Site Notice (to be used instead of Small Site Notice), and TPDES Permit Coverage Notice.

C. For projects disturbing less than one acre, actions described in (IO.A.) and (IO.B.) above are not required. Acreage is calculated by adding Total Area To Be Disturbed Acres on project (See *7 above) and the PSL(s) acreage located within one mile of project.

B. EROSION AND SEDIMENT CONTROLS

1. <u>SOIL STABILIZATION PRACTICES</u> : (Select	T = Temporary or P = Permanent, as applicable
	<pre>P PRESERVATION OF NATURAL RESOURCES</pre>
MULCHING (Hay or Straw)	FLEXIBLE CHANNEL LINER
BUFFER ZONES	RIGID CHANNEL LINER
PLANTING	—— SOIL RETENTION BLANKET
SEEDING	<pre>_P</pre>
P_ SODDING	<u> </u>

OTHER:

2. <u>STRUCTURAL PRACTICES</u>: (Select T = Temporary or P = Permanent, as applicable)

T SILT FENCES

EROSION CONTROL COMPOST BERMS (Low Velocity)

ROCK FILTER DAMS

____ DIVERSION, INTERCEPTOR, OR PERIMETER DIKES ____ DIVERSION, INTERCEPTOR, OR PERIMETER SWALES

____ DIVERSION DIKE AND SWALE COMBINATIONS

____ PIPE SLOPE DRAINS

PAVED FLUMES

____ TIMBER MATTING AT CONSTRUCTION EXIT

____ CHANNEL LINERS SEDIMENT TRAPS

SEDIMENT BASINS

STORM INLET SEDIMENT TRAP

STONE OUTLET STRUCTURES

P CURBS AND GUTTERS

P STORM SEWERS

____ VELOCITY CONTROL DEVICES

____ OTHER:

NOTE: TOP OF BMP'S SHOULD NOT BE HIGHER THAN ROADWAY ELEVATION AS NOT TO FLOOD ROADWAY UNLESS PRIOR APPROVAL FROM ENGINEER IS OBTAINED.

3. STORM WATER MANAGEMENT:

- A. Storm water drainage will be provided by ditches, inlets, and storm water systems which carry drainage within the R.O.W. to the lows within the roadway and project site which drains to natural facilities.
- B. Concrete washout, portable sanitary units and other chemicals shall not be stored within 50 feet upgradient of a stormwater drainage feature without implementation of appropriate pollution prevention and control devices.
- 4. STORM WATER MANAGEMENT ACTIVITIES: (Sequence of Construction See Phases 1-2)

See construction progress schedule and durations of relevant soil disturbance and stabilization activities.

I. PLACE ADVANCED WARNING AND TEMPORARY TRAFFIC CONTROL SIGNS AND TCP DEVICES. 2. PLACE EROSION, SEDIMENT AND POLLUTION PREVENTION/CONTROL DEVICES AS APPROPRIATE TO PROTECT STORMWATER DISCHARGE QUALITY AT PROXIMAL STORMWATER DRAINAGE FEATURES AND TO PREVENT SEDIMENTATION OF ADJACENT ACTIVE ROADWAYS. 3. STABILIZE SOIL WITH TEMPORARY SEEDING OR PERMANENT SODDING AS OULINED IN SW3P.

4. FINAL CLEAN UP AND REMOVAL OF EROSION AND SEDIMENT CONTROL DEVICES.

Sedimentation basins are not feasible on this project due to limited room within the TxDOT ROW. Alternate BMPs have been included in the SW3P Site Plan to provide equivalent sedimentation control.

5. NON-STORM WATER DISCHARGES:

Filter non-storm water discharges, or hold in retention basins, before being allowed to mix with storm water. These discharges consist of, but not limited to, non-polluted ground water, spring water, foundation or footing drain water, water used for dust control or pavement washing and vehicle washwater containing no detergents.

C. OTHER REQUIREMENTS & PRACTICES

1. MAINTENANCE:

Maintain all erosion and sediment controls in good working order. Perform any necessary cleaning/repairs/replacements at the earliest possible date prior to next rain event, but no later than 7 calendar days, Ensure the surrounding ground has dried sufficiently to prevent damage from equipment, "Too Wet" is the only reason for not adhering to timeframes described. When construction activities permanently or temporarily cease and are not expected to resume for 14 or more days on a disturbed portion of the site, stabilization measures must be initiated immediately.

2. INSPECTION:

A TxDOT Inspector will perform a regularly scheduled SW3P inspection every 7 calendar days. An Inspection and Maintenance Report, signed by the TxDOT Inspector and the Contractor, will be filed for each inspection. Revise/clean/repair/replace each BMP control device in accordance with the current Field Inspection and Maintenance Report (Form 2/18) and Item I (Maintenance) above.

3. WASTE MATERIALS:

On a daily basis, or as may be directed, collect all waste materials, trash and debris from the construction site and deposit into a metal dumpster having a secure cover and which meets all state and local city solid waste management requirements. Empty the dumpster as required by regulation, or as may be directed, at a local approved landfill site. Do not bury construction waste on the construction project site.

4. HAZARDOUS WASTE & SPILL REPORTING:

As a minimum, any products in the following categories are considered to be hazardous: Paints, Acids, Solvents, Fuels, Asphalt Products, Chemical Additives for Soil Stabilization, and Concrete Curing Compounds or Additives. When storing hazardous material on the project site, or at a Project Specific Location, take all practicable precaution to prevent and/or contain any spillage of these materials. In the event of a spill, contact the spill coordinator immediately.

Use a licensed sanitary waste management contractor to collect all sanitary waste from portable units as may be required by local regulation, or as directed.

6. CONSTRUCTION VEHICLE TRACKING:

On a regular basis, or as may be directed, dampen haul roads for dust control and construct construction entrances/exits. Provide for a motorized broom or vacuum type sweeper to be available on a daily basis, or as may be directed, to remove sediment from payed roadways on project, abutting and traversing the project site.

7. MANAGEMENT PRACTICES:

- A. Construct disposal areas, stockpiles, haul roads and PSL's in a manner that will minimize and control the amount of sediment that may enter receiving waters. Do not locate disposal areas in any wetland, waterbody or streambed.
- B. Locate construction staging areas, vehicle maintenance and PSL's areas in a manner to minimize the runoff of pollutants.
- C. When working in or near a wetland, install and maintain operating soil erosion and sediment controls at all times during construction and isolate the work from the wetland.
- D. Clear all waterways as soon as practicable of temporary embankment, temporary bridges, matting, falsework, piling, debris or other obstructions placed during construction operations that are not a part of the finished work.
- E. Procedures and/or practices should be taken to control dust.
- F. Sediment to be removed from roadways daily or when work begins after weather events if construction activities have ceased due to weather event.

Texas Department of Transportation **PRELIMINARY** © 2022 DALLAS DISTRICT ENVIRONMENTAL FOR REVIEW ONLY Not intended for construction, bidding or

STORM WATER POLLUTION PREVENTION PLAN (SW3P)

TEMPLATE REVISION DATE: 02/07/18

	I LIVII LAIL	INE VISIO	V DATE - 02/01/10		
DESIGN SM	FED.RD. DIV.NO.	FEDER	FEDERAL AID PROJECT NO. HIGHWA		
GRAPHICS	6	SEE	TITLE SHEET	FM 1378	
SM	STATE	DISTRICT	COUNTY	SHEET NO.	
CHECK	TEXAS	DAL	DALLAS		
CHECK	CONTROL	SECTION	JOB	304	
	1392	01	044. etc.		

, P.E. Signature of Registrant & Date

permit purposes.

Engineer: [BRAHIM]. EL SAAD

P.E. No.: 142049

Date: 1/14/2022

STORMWATER POLLUTION PREVENTION PLAN-CLEAN WATER ACT SECTION 402 TPDES TXR 150000: Stormwater Discharge Permit or Construction General Perrmit required for projects with 1 or more acres disturbed soil. Projects with any disturbed soil must protect for erosion and sedimentation in accordance with Item 506. List adjacent MS 4 Operator(s) that receive discharges from this project. They need to be notified prior to construction activities. (Note: Leave blank only if no adjacent MS 4 Operator(s) are affected.) 1. City of Lucas Phase II MS 4- Contact Stanton Foerster. ☐ No Action Required Action Number: 1. Prevent stormwater pollution by controlling erosion and sedimentation in accordance with TPDES Permit TXR 150000. 2. Comply with the SW3P and revise when necessary to control pollution or required by the Engineer. 3. Post Construction Site Notice (CSN) with SW3P information on or near the following permit(s): ☐ No Permit Required

the site, accessible to the public and TCEQ, EPA or other inspectors. 4. When Contractor project specific locations (PSL's) increase disturbed soil area to 5 acres or more, submit NOI to TCEQ and the Engineer. II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS CLEAN WATER ACT SECTIONS 401 AND 404 USACE Permit required for filling, dredging, excavating or other work in any water bodies, rivers, creeks, streams, wetlands or wet areas. No equipment is allowed in any sream channel below the ordinary High Water Mark except on approved temporary stream crossings or drill pads. The Contractor must adhere to all of the terms and conditions associated with X Nationwide Permit 14 - PCN not Required (less than 1/10th acre waters or Nationwide Permit 14 - PCN Required (1/10 to <1/2 acre, 1/3 in tidal waters) ☐ Individual 404 Permit Required Other Nationwide Permit Required: NWP# 3(a) Required Actions: List Waters of the US Permit applies to, location in project and check Best Management Practices planned to control erosion, sedimentation and post-project TSS. REFER TO EPIC SHEET 2 OF 2 FOR SECTION II - FOR CONTINUATION OF SECTIONS 401 AND 404 The elevation of the ordinary high water marks of any areas requiring work to be performed in the waters of the US requiring the use of a nationwide permit can be found on the Bridge Layouts. Best Management Practices for applicable 401 General Conditions: (Note: If CORP Permit not required, do not check boxes.) Post-Construction TSS Erosion Sedimentation X Temporary Vegetation x Silt Fence Vegetative Filter Strips ☐ Blankets/Matting Rock Berm Retention/Irrigation Systems ☐ Mulch ☐ Triangular Filter Dike Extended Detention Basin Sand Bag Berm Sodding Constructed Wetlands ☐ Interceptor Swale Straw Bale Dike ₩et Basin

☐ Brush Berms

Sediment Basins

Erosion Control Compost

Stone Outlet Sediment Traps Sand Filter Systems

Grassy Swales

X Required Action

III. CULTURAL RESOURCES Refer to TxDOT Standard Specifications in the event historical issues or archeological artifacts are found during construction. Upon discovery of archeological artifacts (bones, burnt rock, flint, pottery, etc.) cease work in the immediate area and contact the Engineer immediately. No Action Required IV. VEGETATION RESOURCES Preserve native vegetation to the extent practical. Contractor must adhere to Construction Specification Requirements Specs 162 164, 192, 193, 506, 730, 751 & 752 in order to comply with requirements for invasive species, beneficial landscaping and tree/brush removal commitments. No Action Required Action Number: V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRDS TREATY ACT. ☐ No Action Required Texas garter snake and slender glass lizard - Terrestrial Reptile BMPs: a) Apply hydromulching and/or hydroseeding in areas for soil stabilization and/or revegetation of disturbed areas where feasible. If hydromulching and/or hydroseeding are not feasible due to site conditions, utilize erosion control blankets or mats that contain no netting or contain loosely woven, natural fiber netting is preferred. Plastic netting should be avoided to the extent practicable, b) For open trenches and excavation pits, install escape ramps at an angle of less than 45 degrees (1:1) in areas left uncovered. Visually inspect excavation areas for trapped wildlife prior to backfilling. c) Inform contractors that if reptiles are found on project site, allow species to safely leave the project area. d) Avoid or minimize disturbing or removing downed trees, rotting stumps, and leaf litter where feasible. e) Contractors will be advised of potential occurrence in the project area, and to avoid harming the species if encountered. REFER TO EPIC SHEET 2 OF 2 FOR SECTION II - FOR CONTINUATION OF SECTIONS \boldsymbol{V} Special Note: The Migratory Bird Act of 1918 states that it is unlawful to kill, capture, collect, possess, buy, sell, trade or transport any migratory bird, nest, young, feather or egg in part or in whole, without a federal permit issued in accordance within the Act's policies and regulations. The contractor would remove all old migratory bird nests from any structure or trees where work would be done from October 1 to February 15. In addition, the contractor would be prepared to prevent migratory birds from building nest(s) between February 15 to October 1. In the event that migratory birds are encountered on-site during project construction, efforts to avoid adverse impacts on protected birds, active nests, eggs and/or young would be observed. LIST OF ABBREVIATIONS BMP: Best Management Practice Construction General Permit Erosion Control Compost DSHS: Texas Department of State Health Services Mulch Filter Berm and Socks FHWA: Federal Highway Administration Memorandum of Agreement ☐ Mulch Filter Berm and Socks ☐ Mulch Filter Berm and Socks ☐ Compost Filter Berm and Socks Memorandum of Understanding MS4: Municipal Separate Stormwater Sewer System TPWD: Texas Parks and Wildlife Department \square Compost Filter Berm and Socks \square Compost Filter Berm and Socks X Vegetation Lined Ditches MBTA: Migratory Bird Treaty Act

NOT: Notice of Termination

Nationwide Permit

NOI: Notice of Intent

VI. HAZARDOUS MATERIALS OR CONTAMINATION ISSUES

Required Action

Required Action

X Required Action

SPCC: Spill Prevention Control and Countermeasure

Starm Water Pollution Prevention Plan

TPDES: Texas Pollutant Discharge Elimination System

Texas Commission on Environmental Quality

Pre-Construction Notification

TxDOT: Texas Department of Transportation

T&E: Threatened and Endangered Species

USACE: U.S. Army Corp of Engineers

USFWS: U.S. Fish and Wildlife Service

Project Specific Location

PCN:

Comply with the Hazard Communication Act (the Act) for personnel who will be working with hazardous materials by conducting safety meetings prior to beginning construction and making workers aware of potential hazards in the workplace. Ensure that all workers are provided with personal protective equipment appropriate for any hazardous materials used. Obtain and keep on-site Material Safety Data Sheets (MSDS) for all hazardous products used on the project, which may include, but are not limited to the following categories: Paints, acids, solvents, asphalt products, chemical additives, fuels and concrete curing compounds or additives. Provide protected storage, off bare ground and covered, for products which may be hazardous. Maintain product labelling as required by the Act. Maintain an adequate supply of on-site spill response materials, as indicated in the MSDS. In the event of a spill, take actions to mitigate the spill as indicated in the MSDS, in accordance with safe work practices, and contact the District Spill Coordinator immediately. The Contractor shall be responsible for the proper containment and cleanup

Contact the Engineer if any of the following are detected:

- Dead or distressed vegetation (not identified as normal)
- Trash piles, drums, canisters, barrels, etc.
- Undesirable smells or odors
- * Evidence of leaching or seepage of substances

Does the project involve any bridge class structure rehabilitation(s) or replacement(s) (bridge class structures not including box culverts)?

Yes

If "No", then no further action is required.

If "Yes", then TxDOT is responsible for completing asbestos assessment/inspection.

Are the results of the asbestos inspection positive (is asbestos present)?

If "Yes", then TxDOT must retain a DSHS licensed asbestos consultant to assist with the notification, develop abatement/mitigation procedures, and perform management activities as necessary. The notification form to DSHS must be postmarked at least 15 working days prior to scheduled demolition.

If "No", then TxDOT is still required to notifiy DSHS 15 working days prior to any

In either case, the Contractor is responsible for providing the date(s) for abatement activities and/or demolition with careful coordination between the Engineer and asbestos consultant in order to minimize construction delays and subsequent claims.

Any other evidence indicating possible hazardous materials or contamination discovered on site. Hazardous Materials or Contamination Issues Specific to this Project:

x No Action Required

Required Action

Action Number:

VII. OTHER ENVIRONMENTAL ISSUES

(includes regional issues such as Edwards Aquifer District, etc.)

X No Action Required

Required Action

Action Number:

GENERAL NOTE:

Any change orders and/or deviations from the final design must be reported to the Engineer prior to commencement of construction activities, as additional environmental clearance may be required.

©2020 ## Texas Department of Transportation Dallas District

ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS (EPIC) SHEET 1 OF 2

FEDERAL AID PROJECT NO. SEE TITLE SHEET FM 1378 DISTRICT Collin CONTROL SECTION 305 044, ETC. 1392

LAST REVISION: 1/15/15

8878

☐ Diversion Dike

Erosion Control Compost

DISCLAIMER:

The use of this standard is governed by the "Texas Engineering Practice Act".

No warranty of any kind is made by TxDOT for any purpose whatsoever.

IxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damge resulting from its use.

II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS CLEAN WATER ACT SECTIONS 401 AND 404 - CONTINUATION FROM PAGE1.

1. Unnamed Tributary to Lake Lavon- Desc: Sta. 24+50 2. Unnamed Tributary to Lake Lavon- Desc: Sta. 30+05 3. Unnamed Tributary to Lake Lavon -Desc: Sta. 103+00 V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRD TREATY ACT. - CONTINUATION FROM PAGE 1.

2.Eastern spotted skunk - Contractors will be advised of potential occurrence in the project area, to avoid harming the species if encountered, and avoid unnecessary impacts to dens.

3. Western Burrowing Owl Bird BMPs: In addition to complying with the Migratory Bird Treaty Act perform the following BMPs: a) Prior to construction, perform daytime surveys for nests including under bridges and in culverts to determine if they are active before removal. Nests that are active should not be disturbed. b) Do not disturb, destroy, or remove active nests, including ground nesting birds, during the nesting season. c) Avoid the removal unoccupied, inactive nests, as practicable. d) Prevent the establishment of active nests during the nesting season on TxDOT owned and operated facilities and structures proposed for replacement or repair. e) Do not collect, capture, relocate, or transport birds, eggs, young, or active nests without a permit.

4. Woodhouse's toad - Contractors will be advised of potential occurrence in the project area, and to avoid harming the species if encountered.

NA...

GENERAL NOTE:

Any change orders and/or deviations from the final design must be reported to the Engineer prior to commencement of construction activities, as additional environmental clearance may be required.

©2020 Texas Department of Transportation Dallas District

ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS

(EPIC) SHEET 2 OF 2 FED. RD. DIV. NO. FEDERAL AID PROJECT NO. HIGHWAY NO. SEE TITLE SHEET 6 FM 1378 STATE DISTRICT COUNTY TEXAS DALLAS Collin SHEET NO. CONTROL SECTION JOB


044, ETC.

306

LAST REVISION: 1/15/15

1392

01

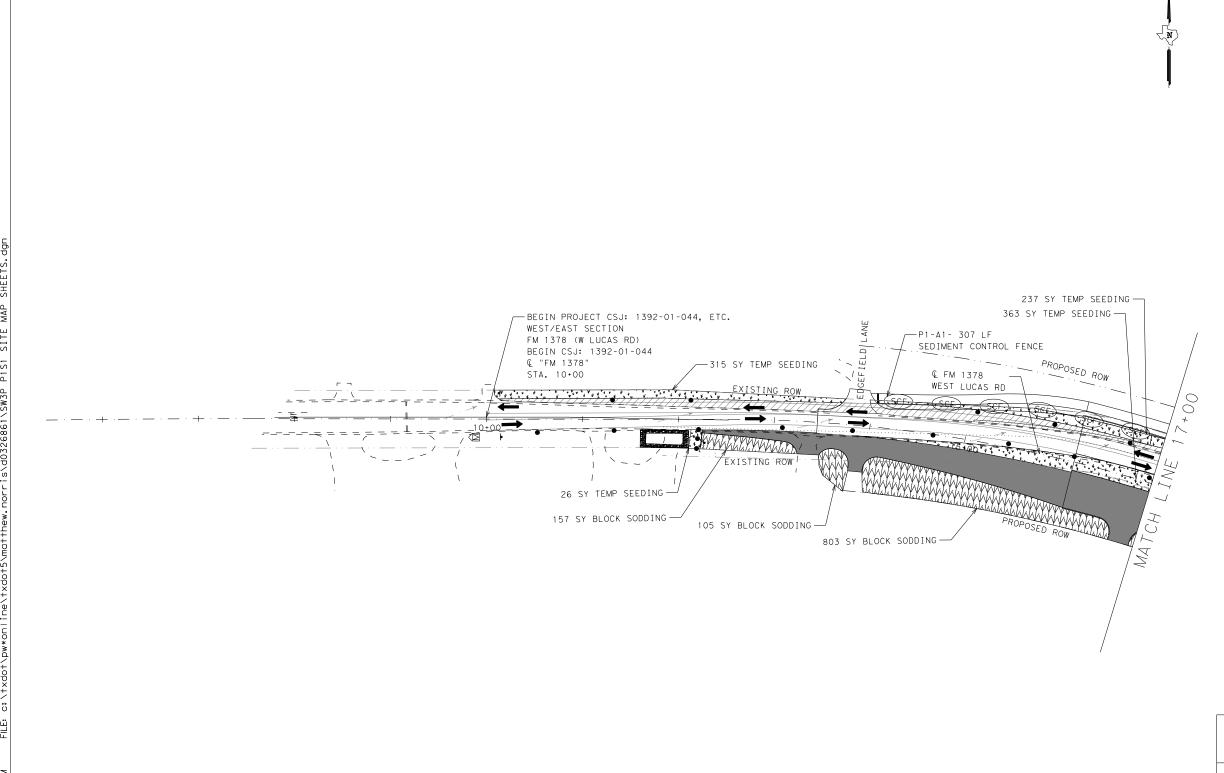

LEGEND

→ DIRECTION OF FLOW

-SCF- SEDIMENT CONTROL FENCE

-ECL- EROSION CONTROL LOG

-(RFD2)- ROCK FILTER DAM (TY II)

-AREF- AMPHIBIAN AND REPTILE EXCLUSION FENCE

CONSTRUCTION EXIT

TEMPORARY SEEDING

PERMANENT BLOCK SODDING

PERMANENT CONSTRUCTION PREVIOUS PHASE

PERMANENT CONSTRUCTION THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED PREVIOUS PHASE

CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION CONTROL DEVICES FROM PREVIOUS PHASE(S) THROUGHOUT DURATION OF PROJECT.

BMP'S SHALL BE INSTALLED NO SOONER THAN TWO WEEKS PRIOR TO SOIL DISTURBANCE IN THEIR CONTROL AREA.

SEE DAILY WORK REPORTS FOR INITIAL STABILIZATION TIMEFRAMES.

PRELIMINARY

FOR REVIEW ONLY Not intended for construction, bidding or permit purposes.

Engineer: IBRAHIM I. EL SAAD

P.E. No.: 142049 Date: 1/14/2022



© 2022

Texas Department of Transportation

FM 1378

AT FM 3286


SW3P SITE MAP PHASE 1 STAGE 1


SCALE	1 " = 100	,		SHEET 01 OF 04
DESIGN PR	FED.RD. DIV.NO.	FEDERAL	AID PROJECT NO.	HIGHWAY NO.
GRAPHICS	6	SEE T	ITLE SHEET	FM 1378,ETC.
PR	STATE	DISTRICT	COUNTY	SHEET NO.
CHECK	TEXAS	DAL	COLLIN	
CHECK	CONTROL	SECTION	JOB	307
	1392	0.1	044. FTC.	


DATE DISTURBED	DATE STABILIZED

BMP INSTALL/ REMOVE DATES

BMP #	INSTALL DATE	REMOVE DATE	BMP #	INSTALL DATE	REMOVE DATE
P1-A1					

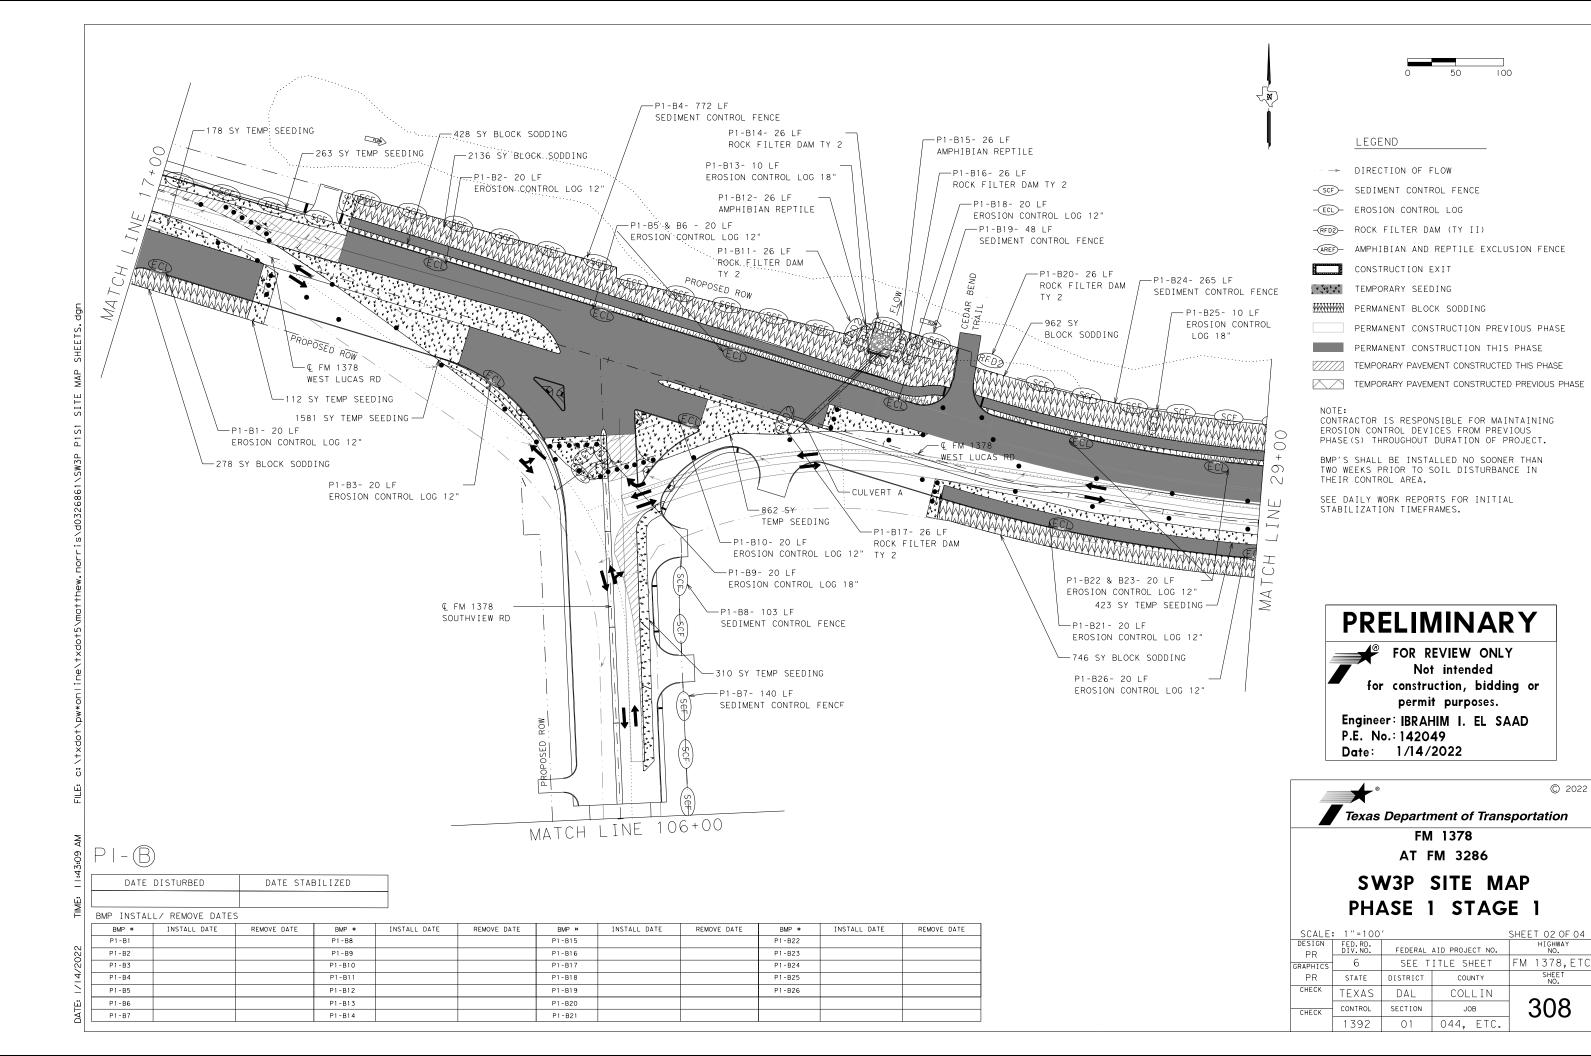

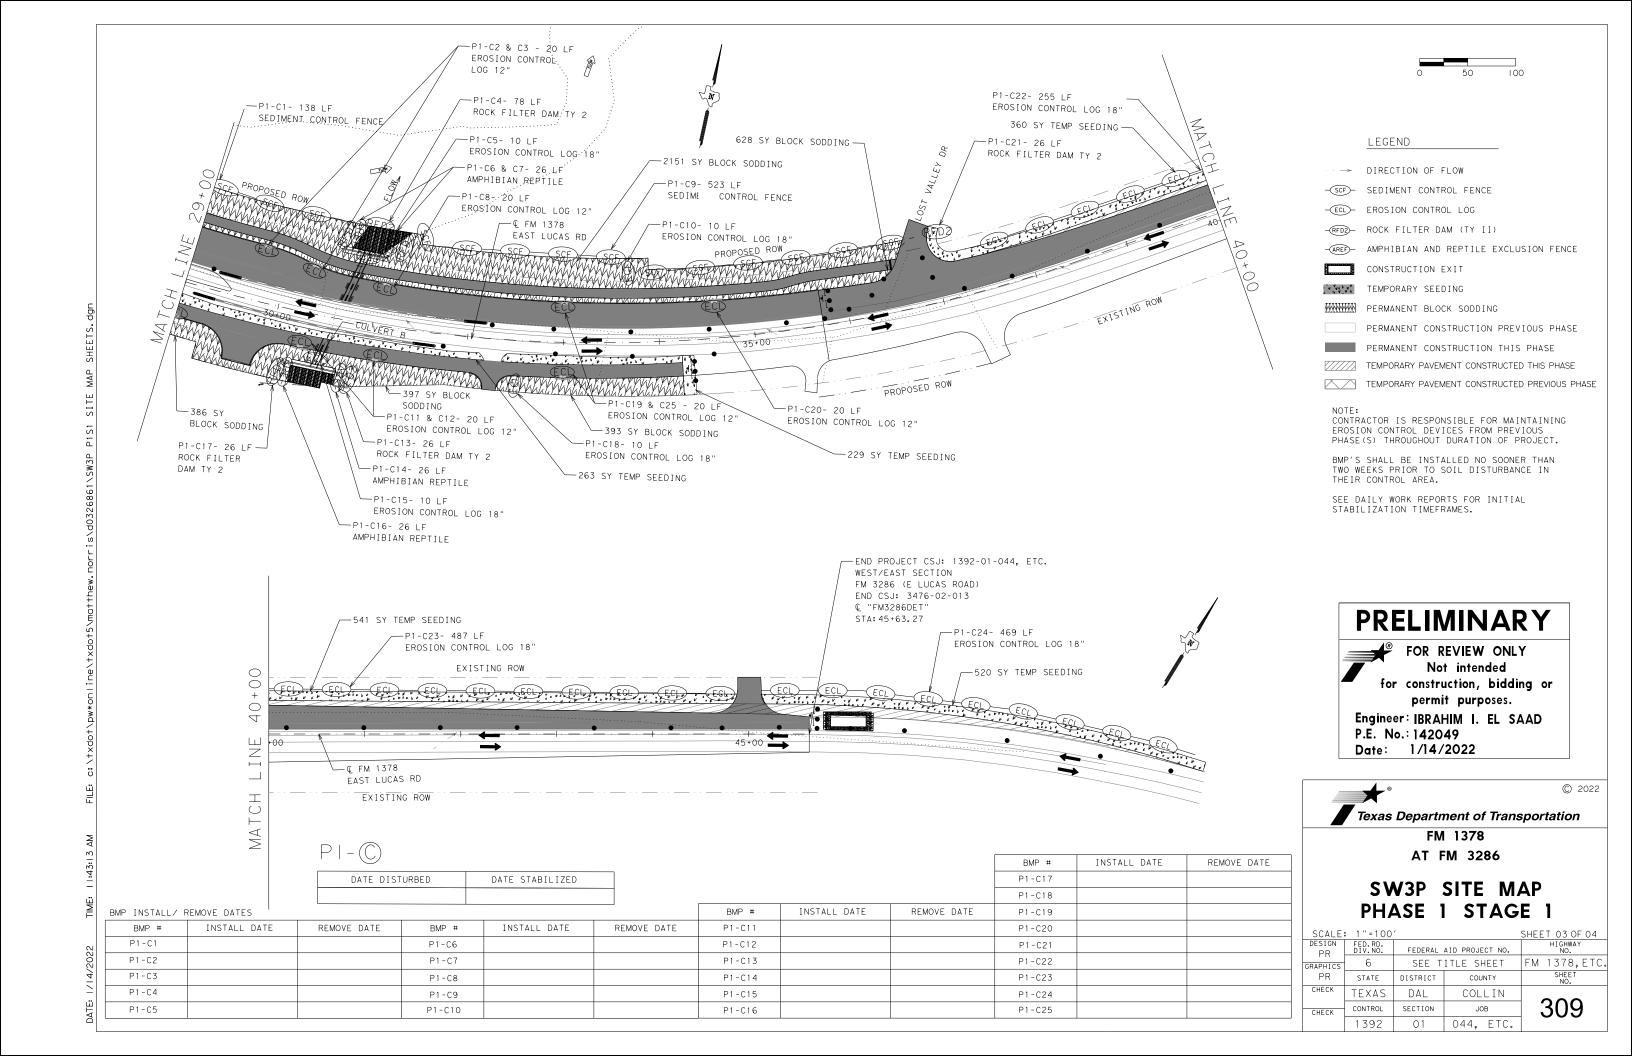

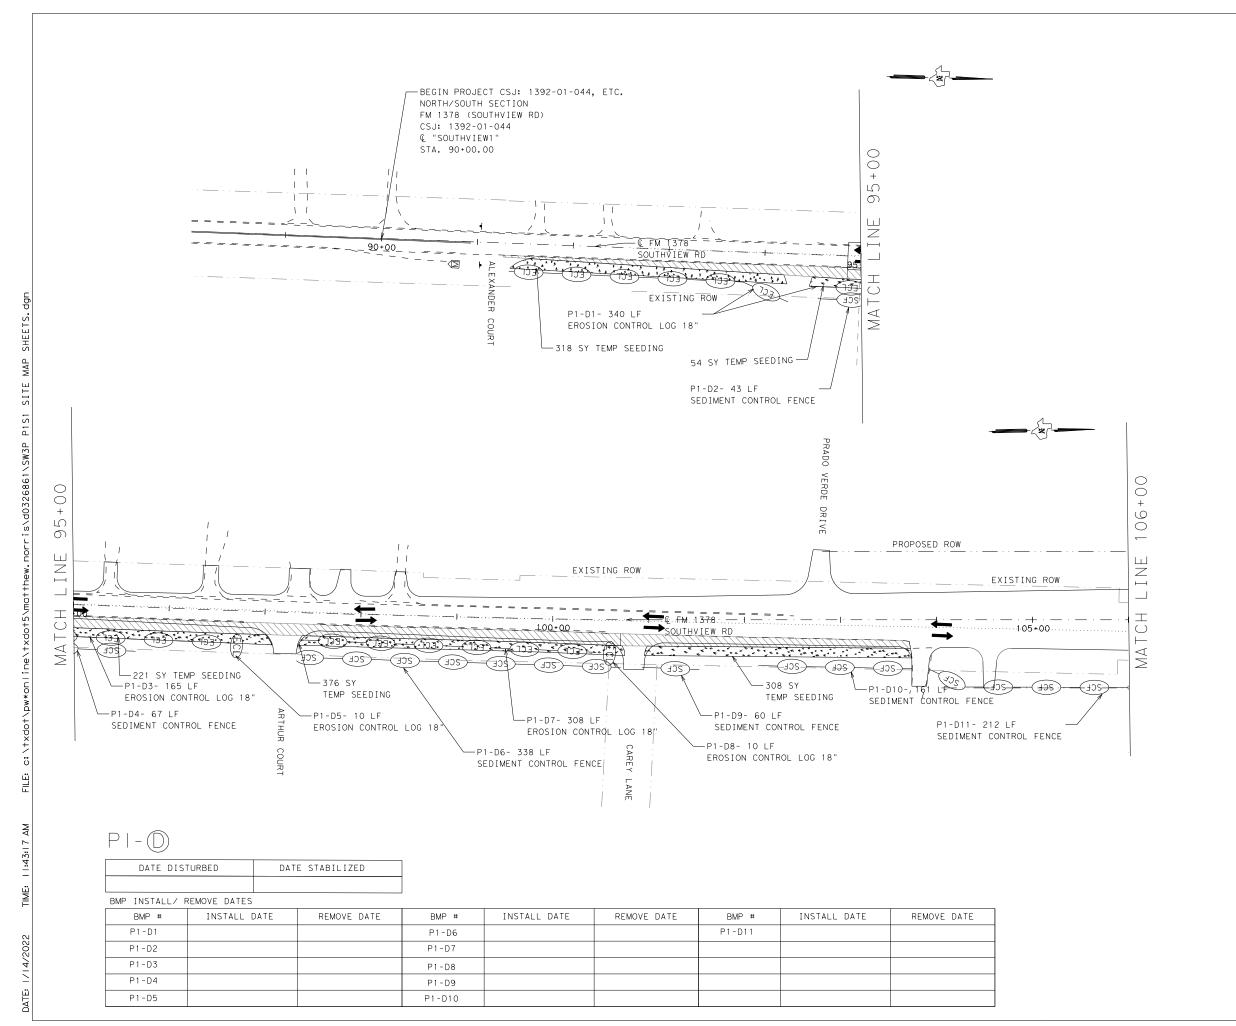



→ DIRECTION OF FLOW

-SCF- SEDIMENT CONTROL FENCE

-ECL- EROSION CONTROL LOG

ROCK FILTER DAM (TY II)

AMPHIBIAN AND REPTILE EXCLUSION FENCE

CONSTRUCTION EXIT

TEMPORARY SEEDING

PERMANENT BLOCK SODDING

PERMANENT CONSTRUCTION PREVIOUS PHASE

PERMANENT CONSTRUCTION THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED PREVIOUS PHASE

CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION CONTROL DEVICES FROM PREVIOUS PHASE(S) THROUGHOUT DURATION OF PROJECT.

BMP'S SHALL BE INSTALLED NO SOONER THAN TWO WEEKS PRIOR TO SOIL DISTURBANCE IN THEIR CONTROL AREA.

SEE DAILY WORK REPORTS FOR INITIAL STABILIZATION TIMEFRAMES.

PRELIMINARY

FOR REVIEW ONLY Not intended for construction, bidding or

permit purposes.

Engineer: IBRAHIM I. EL SAAD P.E. No.: 142049

Date: 1/14/2022




© 2022

Texas Department of Transportation

FM 1378 AT FM 3286

SW3P SITE MAP PHASE 1 STAGE 1

SCALE	1 " = 100	,		SHEET 04 OF 04
DESIGN PR	FED.RD. DIV.NO.	FEDERAL	AID PROJECT NO.	HIGHWAY NO.
GRAPHICS	- 6	SEE T	ITLE SHEET	FM 1378, ETC.
PR	STATE	DISTRICT	COUNTY	SHEET NO.
CHECK	TEXAS	DAL	COLLIN	0.40
CHECK	CONTROL	SECTION	JOB	310
	1392	01	044, ETC.	

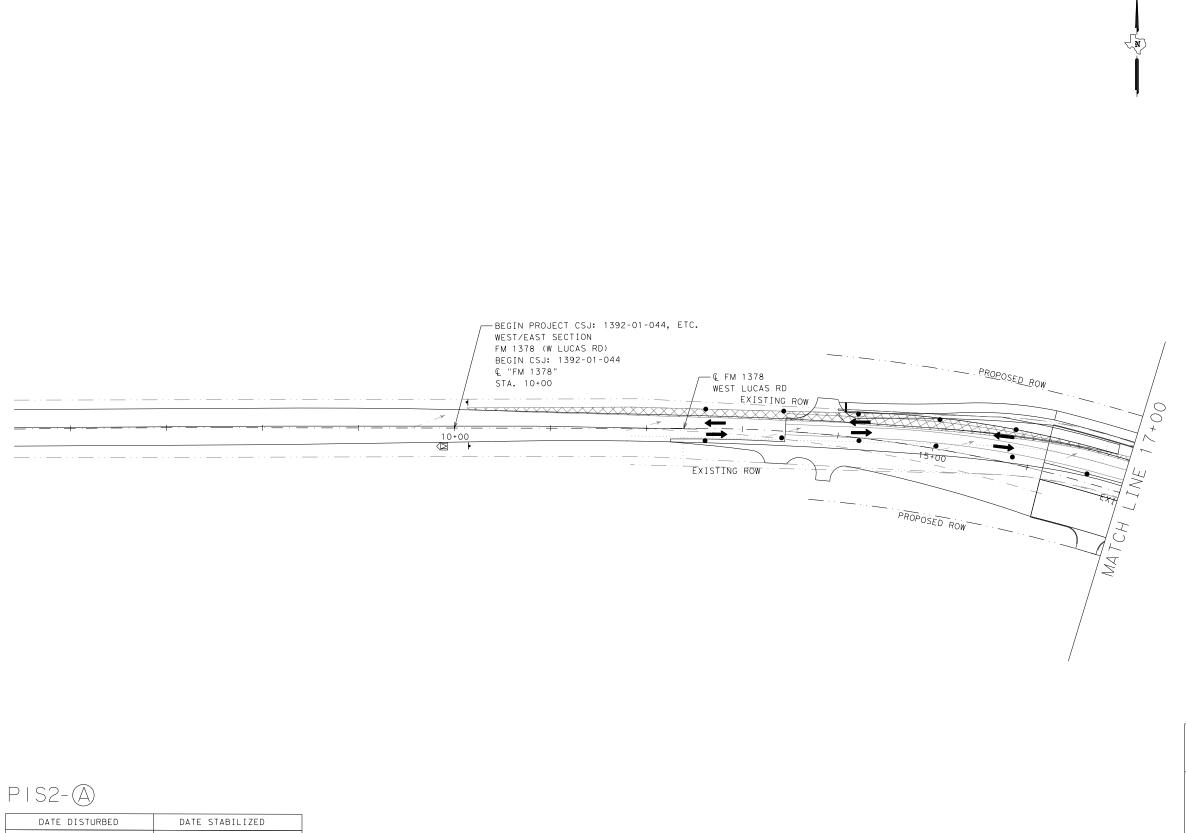

→ DIRECTION OF FLOW

LEGEND

-SCF- SEDIMENT CONTROL FENCE

-ECL- EROSION CONTROL LOG

-RFD2- ROCK FILTER DAM (TY II)

-AREF- AMPHIBIAN AND REPTILE EXCLUSION FENCE

CONSTRUCTION EXIT

TEMPORARY SEEDING

PERMANENT BLOCK SODDING

PERMANENT CONSTRUCTION PREVIOUS PHASE

PERMANENT CONSTRUCTION THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED PREVIOUS PHASE

CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION CONTROL DEVICES FROM PREVIOUS PHASE(S) THROUGHOUT DURATION OF PROJECT.

BMP'S SHALL BE INSTALLED NO SOONER THAN TWO WEEKS PRIOR TO SOIL DISTURBANCE IN THEIR CONTROL AREA.

SEE DAILY WORK REPORTS FOR INITIAL STABILIZATION TIMEFRAMES.

PRELIMINARY

FOR REVIEW ONLY

Not intended for construction, bidding or permit purposes.

Engineer: IBRAHIM I. EL SAAD

P.E. No.: 142049 Date: 1/14/2022



© 2022

Texas Department of Transportation

FM 1378

AT FM 3286

SW3P SITE MAP PHASE 1 STAGE 2

SCALE	1 " = 100	,		SHEET 01 OF 04
DESIGN PR	FED.RD. DIV.NO.	FEDERAL	AID PROJECT NO.	HIGHWAY NO.
GRAPHICS	- 6	SEE T	ITLE SHEET	FM 1378,ETC.
PR	STATE	DISTRICT	COUNTY	SHEET NO.
CHECK	TEXAS	DAL	COLLIN	0.4.4
CHECK	CONTROL	SECTION	JOB	311
	1392	01	044, ETC.	


P1S2 SITE MAP SHEETS.dgn

c:\txdot\pw*online\txdot5\matthew.norris\d0326861\SW3P

DATE DISTURBED	DATE STABILIZED

BMP INSTALL/ REMOVE DATES

BMP #	INSTALL DATE	REMOVE DATE	BMP #	INSTALL DATE	REMOVE DATE

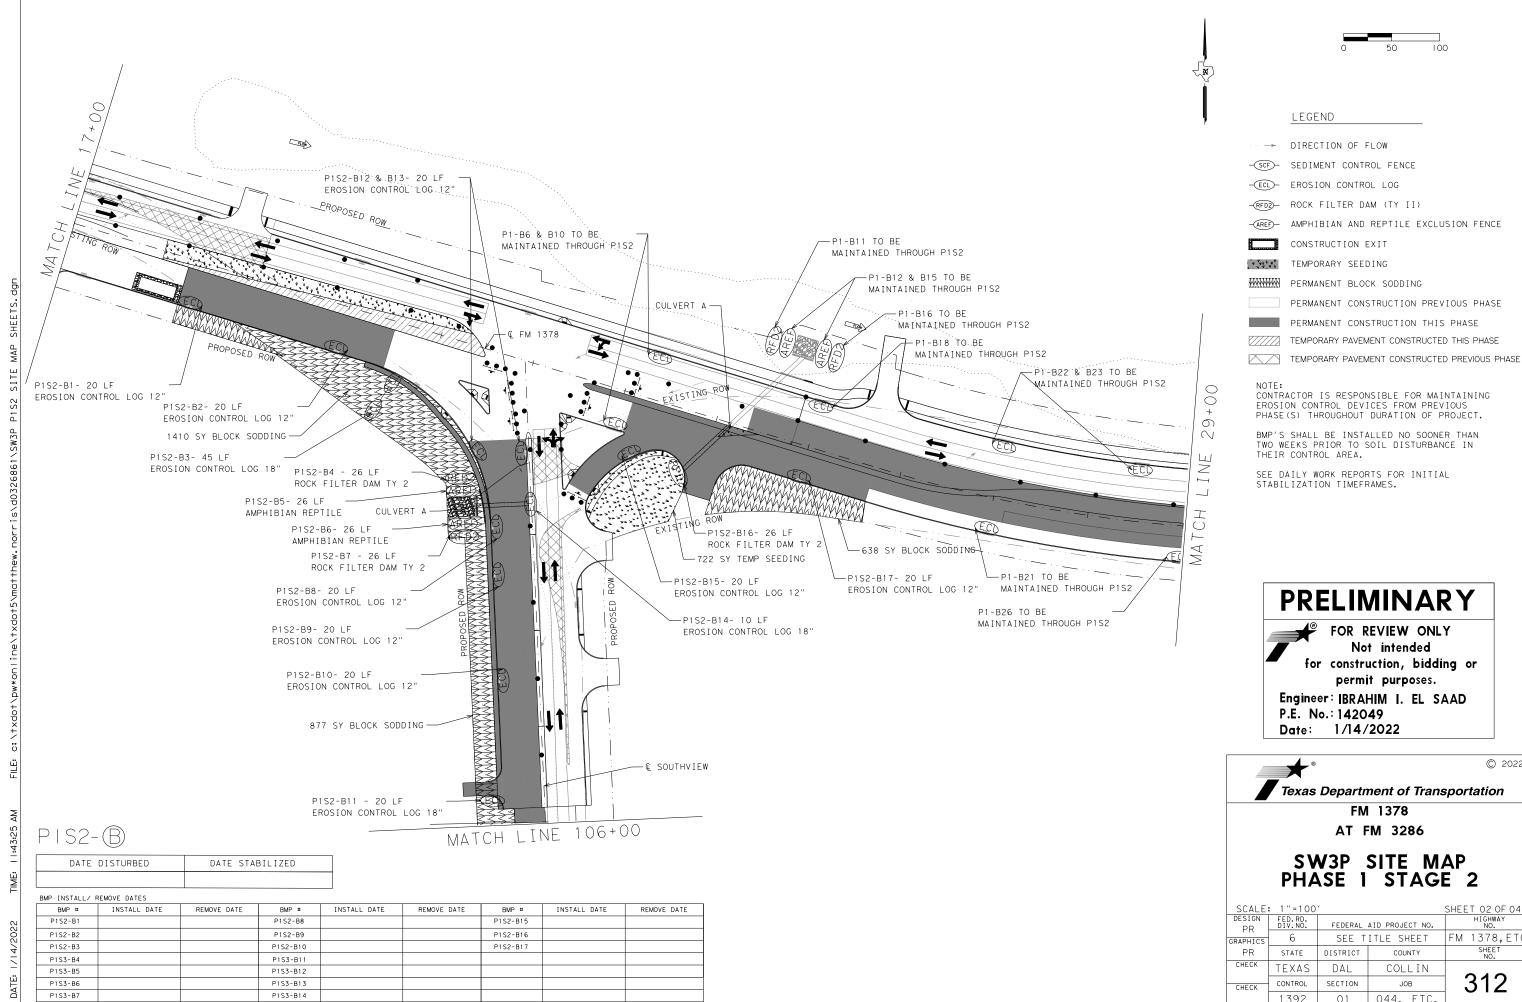

-SCF- SEDIMENT CONTROL FENCE

-ECL- EROSION CONTROL LOG

-RFD2- ROCK FILTER DAM (TY II)

AMPHIBIAN AND REPTILE EXCLUSION FENCE

CONSTRUCTION EXIT

TEMPORARY SEEDING

PERMANENT BLOCK SODDING

PERMANENT CONSTRUCTION PREVIOUS PHASE

PERMANENT CONSTRUCTION THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED THIS PHASE

CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION CONTROL DEVICES FROM PREVIOUS PHASE(S) THROUGHOUT DURATION OF PROJECT.

BMP'S SHALL BE INSTALLED NO SOONER THAN TWO WEEKS PRIOR TO SOIL DISTURBANCE IN THEIR CONTROL AREA.

SEE DAILY WORK REPORTS FOR INITIAL STABILIZATION TIMEFRAMES.

PRELIMINARY

FOR REVIEW ONLY Not intended for construction, bidding or permit purposes.

Engineer: IBRAHIM I. EL SAAD

Date: 1/14/2022


© 2022


Texas Department of Transportation


FM 1378 AT FM 3286

SW3P SITE MAP PHASE 1 STAGE 2

SCALE:	1 " = 100	,		SHEET 02 OF 04
DESIGN PR	FED.RD. DIV.NO.	FEDERAL	AID PROJECT NO.	HIGHWAY NO.
GRAPHICS	6	SEE T	ITLE SHEET	FM 1378,ETC.
PR	STATE	DISTRICT	COUNTY	SHEET NO.
CHECK	TEXAS	DAL	COLLIN	0.40
CHECK	CONTROL	SECTION	JOB	312
	1392	01	044, ETC.	

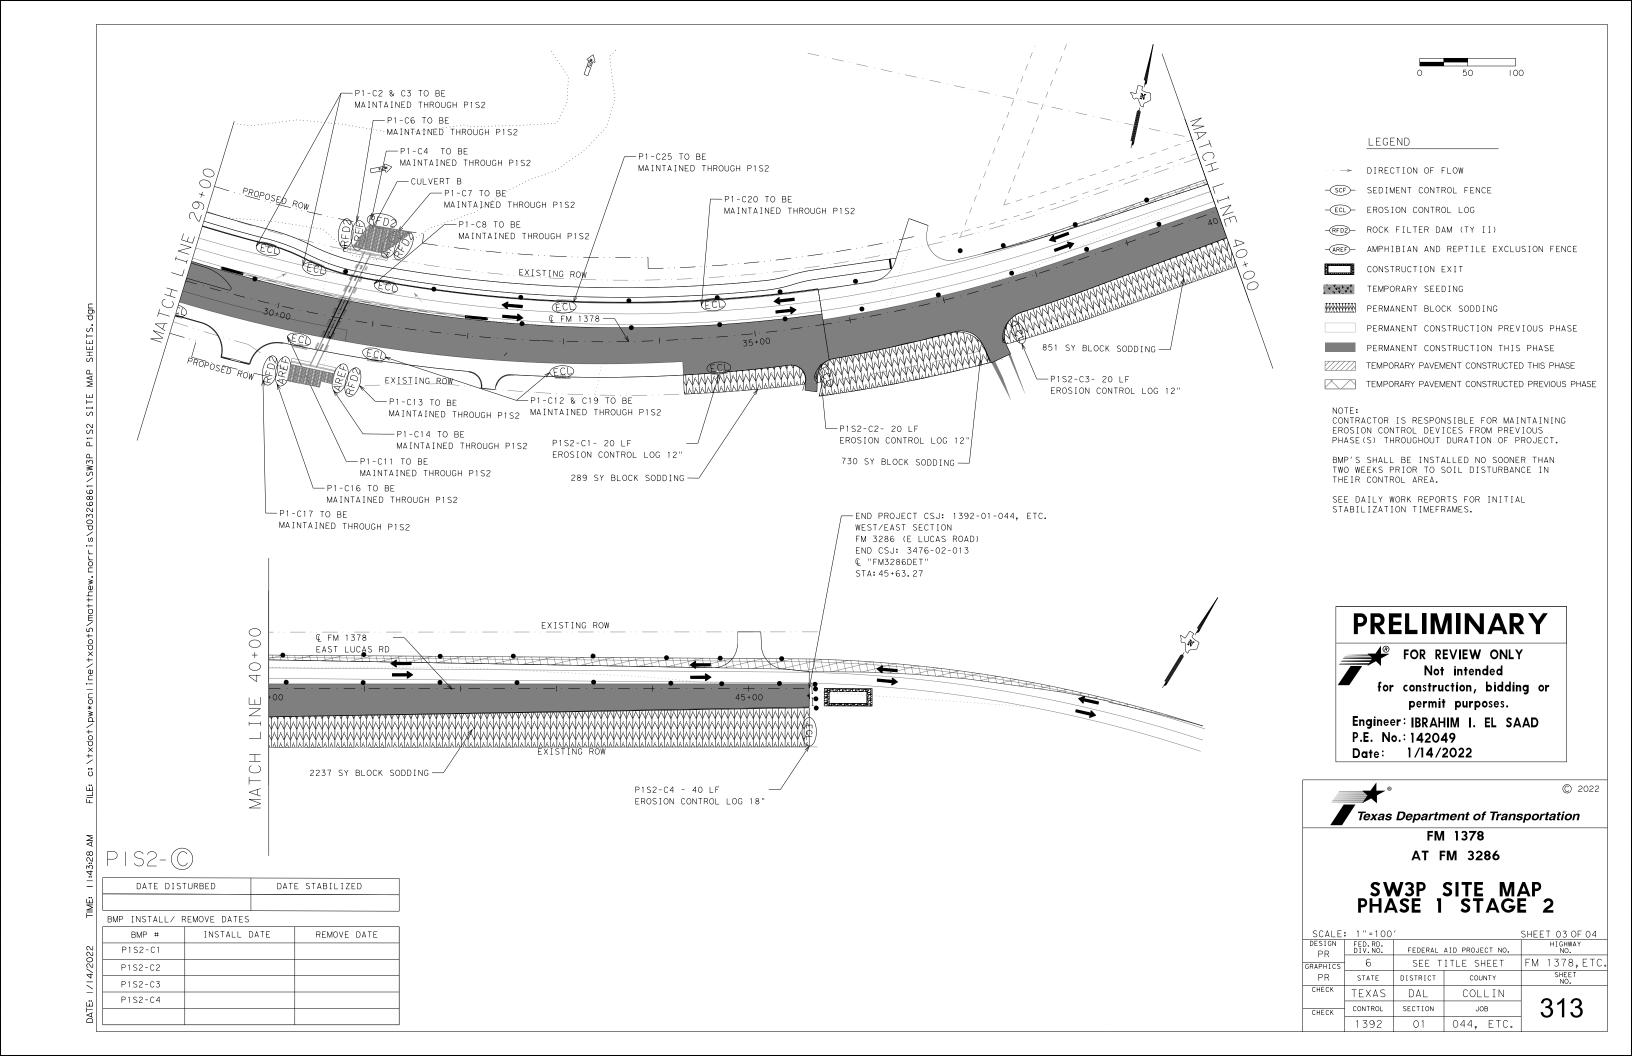

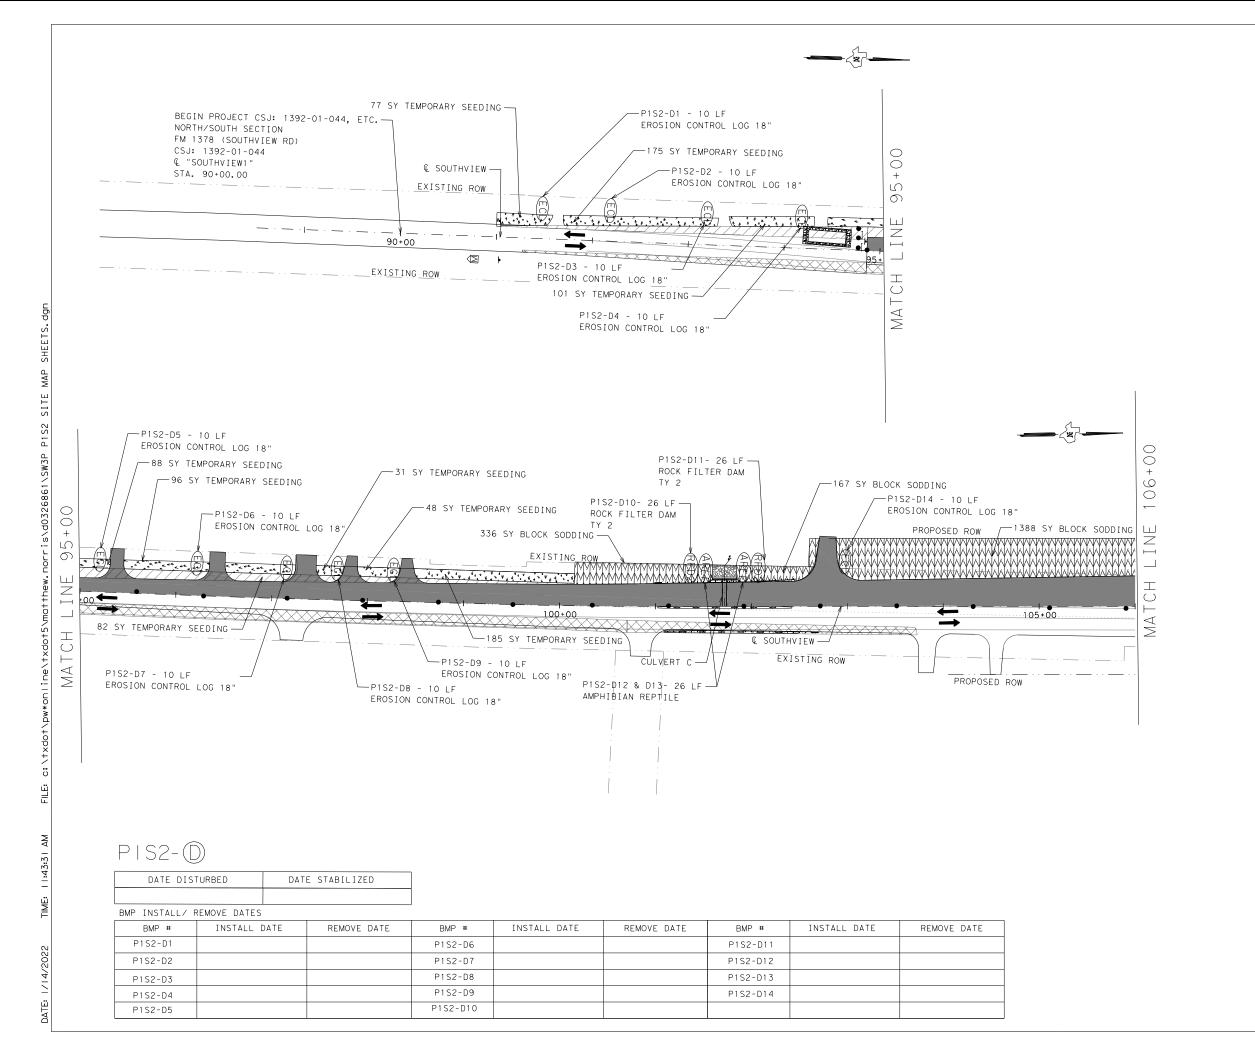



LEGEND

→ DIRECTION OF FLOW

-SCF- SEDIMENT CONTROL FENCE

-ECL- EROSION CONTROL LOG

ROCK FILTER DAM (TY II)

AMPHIBIAN AND REPTILE EXCLUSION FENCE

CONSTRUCTION EXIT

TEMPORARY SEEDING

PERMANENT BLOCK SODDING

PERMANENT CONSTRUCTION PREVIOUS PHASE

PERMANENT CONSTRUCTION THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED PREVIOUS PHASE

CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION CONTROL DEVICES FROM PREVIOUS PHASE(S) THROUGHOUT DURATION OF PROJECT.

BMP'S SHALL BE INSTALLED NO SOONER THAN TWO WEEKS PRIOR TO SOIL DISTURBANCE IN THEIR CONTROL AREA.

SEE DAILY WORK REPORTS FOR INITIAL STABILIZATION TIMEFRAMES.

PRELIMINARY

FOR REVIEW ONLY

Not intended for construction, bidding or permit purposes.

Engineer: IBRAHIM I. EL SAAD

P.E. No.: 142049 Date: 1/14/2022


© 2022

Texas Department of Transportation

FM 1378 AT FM 3286

SW3P SITE MAP PHASE 1 STAGE 2

SCALE	: 1 " = 1 00	,		SHEET 04 OF 04
DESIGN PR	FED. RD. DIV. NO.	FEDERAL	AID PROJECT NO.	HIGHWAY NO.
GRAPHICS	6	SEE T	ITLE SHEET	FM 1378, ETC.
PR	STATE	DISTRICT	COUNTY	SHEET NO.
CHECK	TEXAS	DAL	COLLIN	
CHECK	CONTROL	SECTION	JOB	314
	1392	01	044, ETC.	

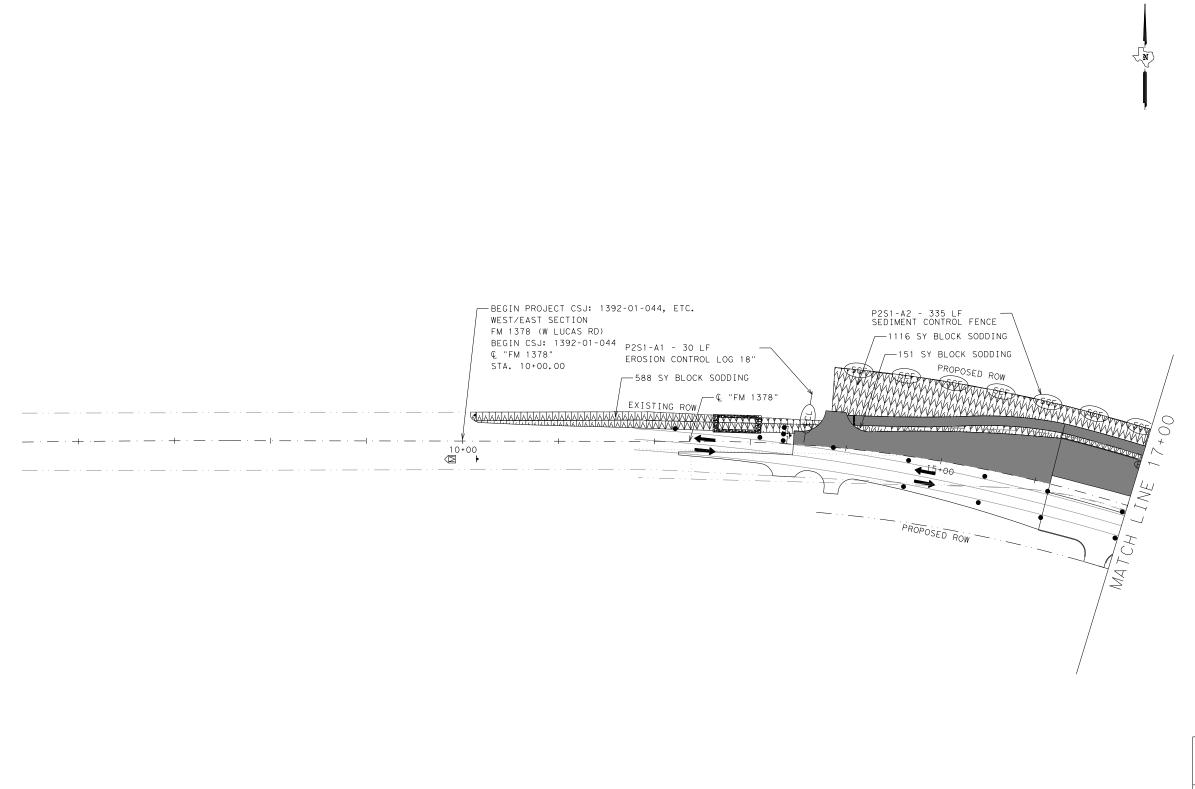

LEGEND

→ DIRECTION OF FLOW

-SCF- SEDIMENT CONTROL FENCE

-ECL- EROSION CONTROL LOG

-RFD2- ROCK FILTER DAM (TY II)

-AREF- AMPHIBIAN AND REPTILE EXCLUSION FENCE

CONSTRUCTION EXIT

TEMPORARY SEEDING

PERMANENT BLOCK SODDING PERMANENT CONSTRUCTION PREVIOUS PHASE

PERMANENT CONSTRUCTION THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED THIS PHASE

TEMPORARY PAVEMENT CONSTRUCTED PREVIOUS PHASE

CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION CONTROL DEVICES FROM PREVIOUS PHASE(S) THROUGHOUT DURATION OF PROJECT.

BMP'S SHALL BE INSTALLED NO SOONER THAN TWO WEEKS PRIOR TO SOIL DISTURBANCE IN THEIR CONTROL AREA.

SEE DAILY WORK REPORTS FOR INITIAL STABILIZATION TIMEFRAMES.

PRELIMINARY

FOR REVIEW ONLY Not intended for construction, bidding or

permit purposes. Engineer: IBRAHIM I. EL SAAD

P.E. No.: 142049 Date: 1/14/2022

© 2022

Texas Department of Transportation

FM 1378 AT FM 3286

SW3P SITE MAP PHASE 2 STAGE 1


SCALE:	: 1"=100	,		SHEET 01 OF 04
ESIGN RI/MN	FED. RD. DIV. NO.		AID PROJECT NO.	HIGHWAY NO.
RAPHICS	6	SEE T	ITLE SHEET	FM 1378, ETC.
RI/MN	STATE	DISTRICT	COUNTY	SHEET NO.
CHECK SM/MN	TEXAS	DAL	COLLIN	0.4 =
CHECK	CONTROL	SECTION	JOB	315
	1392	01	044, ETC.	


P2SI-(A)


DATE DISTURBED	DATE STABILIZED


BMP INSTALL/ REMOVE DATES

BMP #	INSTALL DATE	REMOVE DATE	BMP #	INSTALL DATE	REMOVE DATE
P2S1-A1					
P2S1-A2					
					-

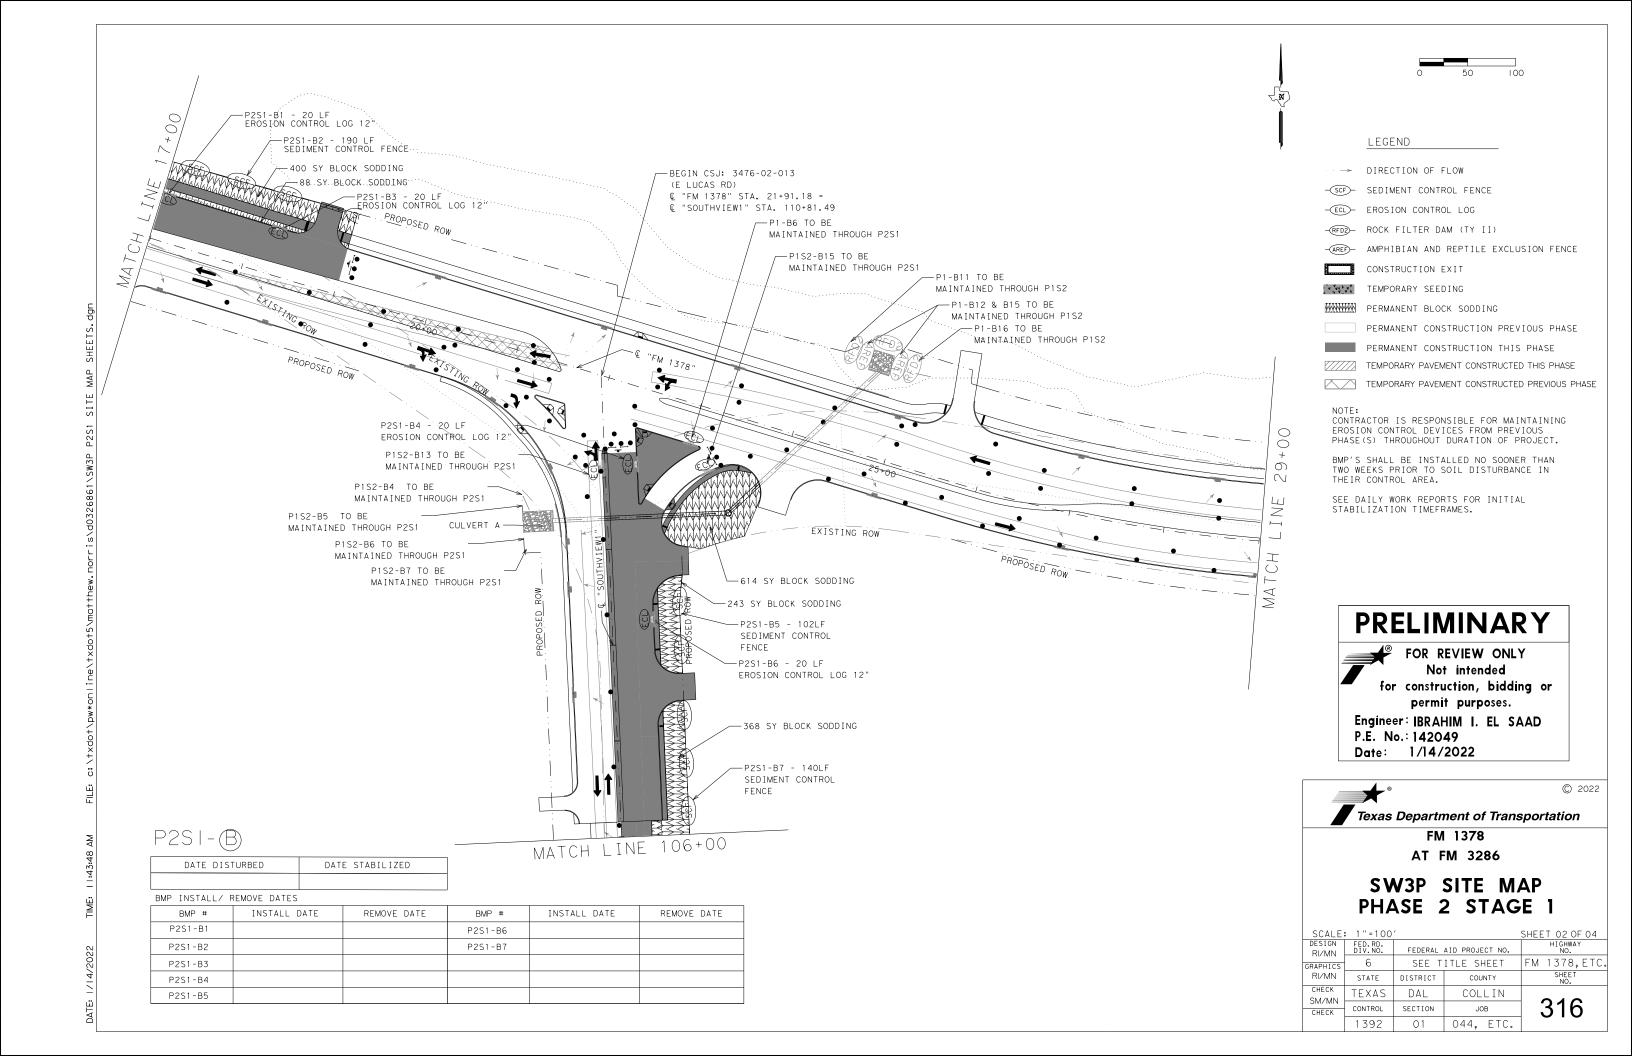

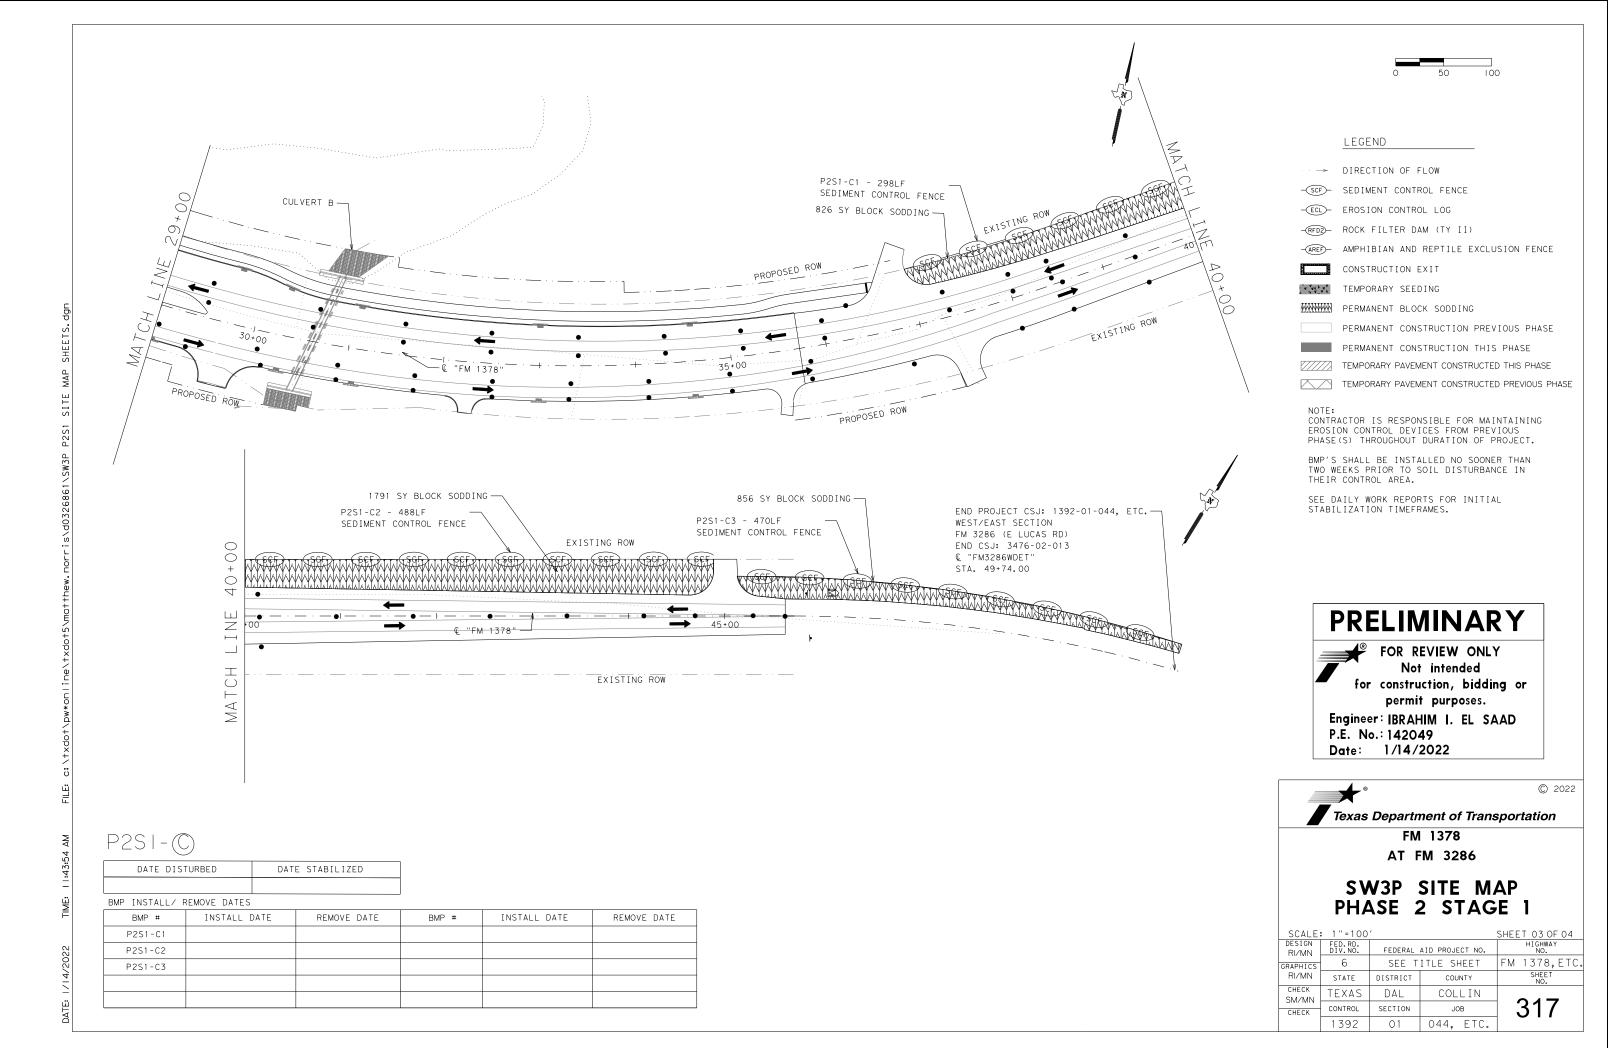

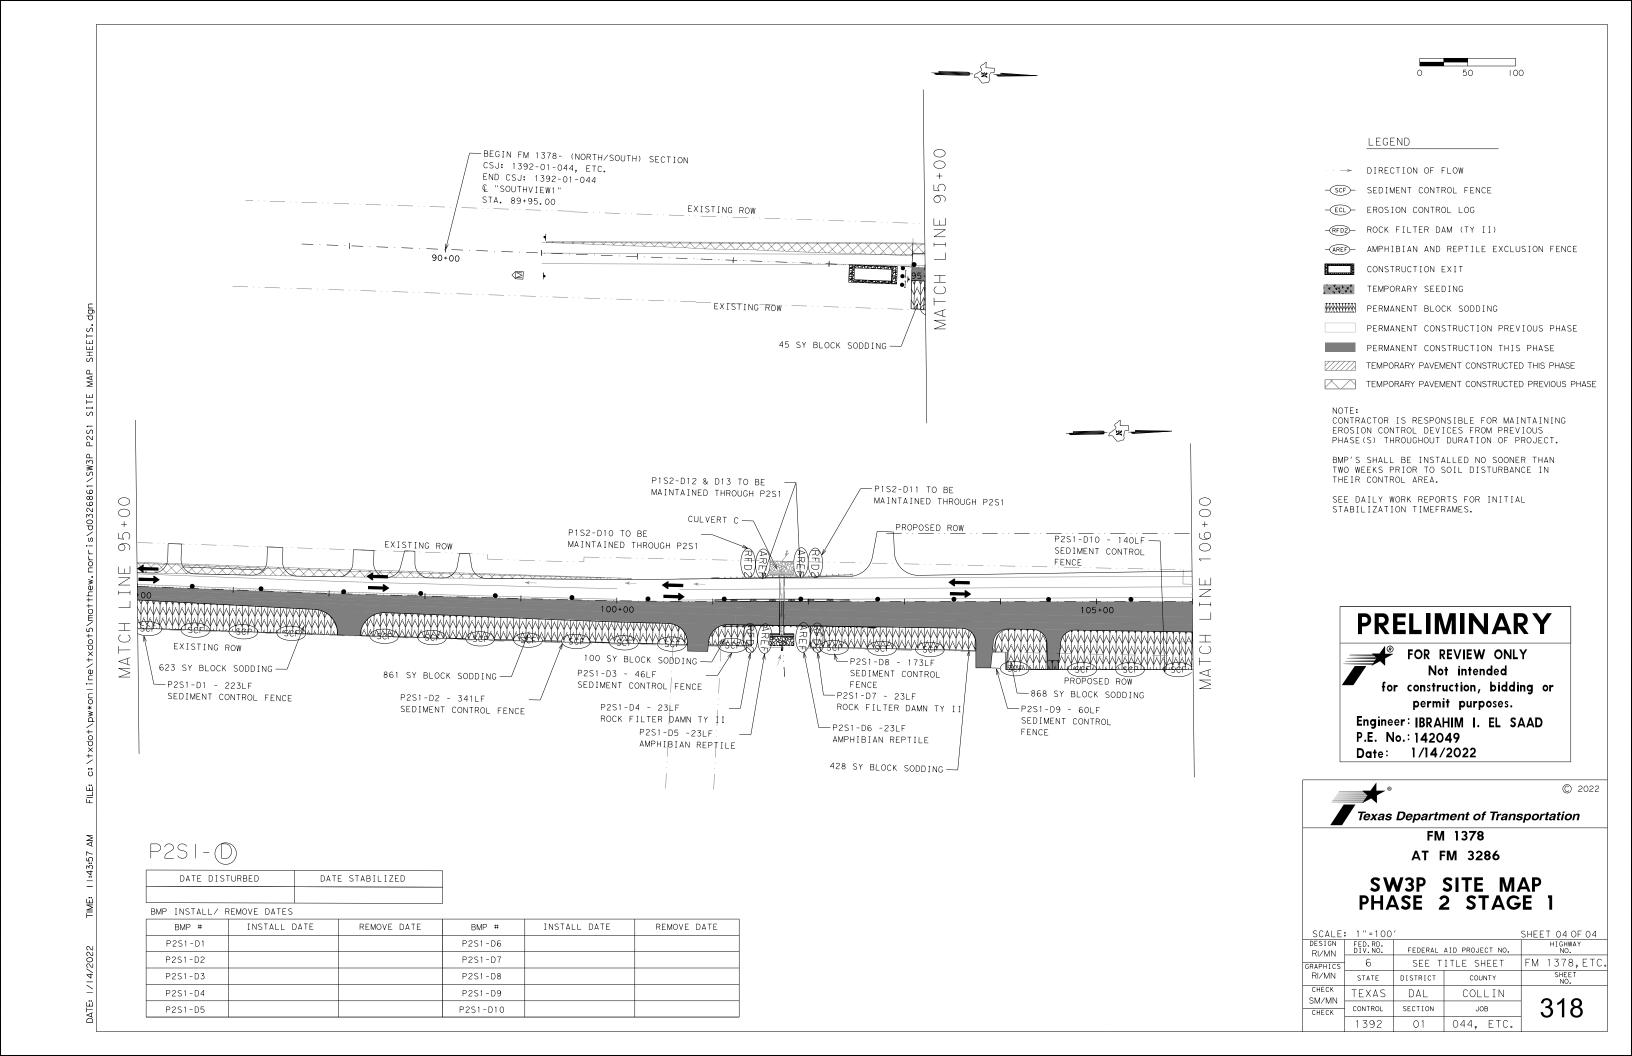

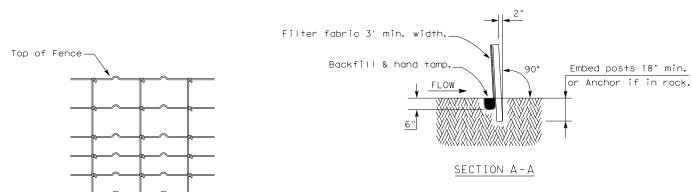

HINGE JOINT KNOT WOVEN MESH (OPTION) DETAIL

Galvanized hinge joint knot woven mesh (12.5 GA.SWG Min.) requires a minimum of five horizontal wires spaced at a maximum of 12 inches apart and all vertical wires spaced at a maximum of 12 inches apart.

SEDIMENT CONTROL FENCE USAGE GUIDELINES

A sediment control fence may be constructed near the downstream perimeter of a disturbed area along a contour to intercept sediment from overland runoff. A 2 year storm frequency may be used to calculate the flow rate to be filtered.


Sediment control fence should be sized to filter a maximum flow through rate of 100 ${\sf GPM/FT}^2$. Sediment control fence is not recommended to control erosion from a drainage area larger than 2 acres.

LEGEND

Sediment Control Fence

GENERAL NOTES

- Vertical tracking is required on projects where soil distributing activities have occurred unless otherwise approved.
- 2. Perform vertical tracking on slopes to temporarily stabilize soil.
- 3. Provide equipment with a track undercarriage capable of producing linear soil impressions measuring a minimum of 12" in length by 2" to 4" in width by 1/2" to 2" in depth.
- 4. Do not exceed 12" between track impressions.
- 5. Install continous linear track impressions where the minimum 12" length impressions are perpendicular to the slope or direction of water flow.

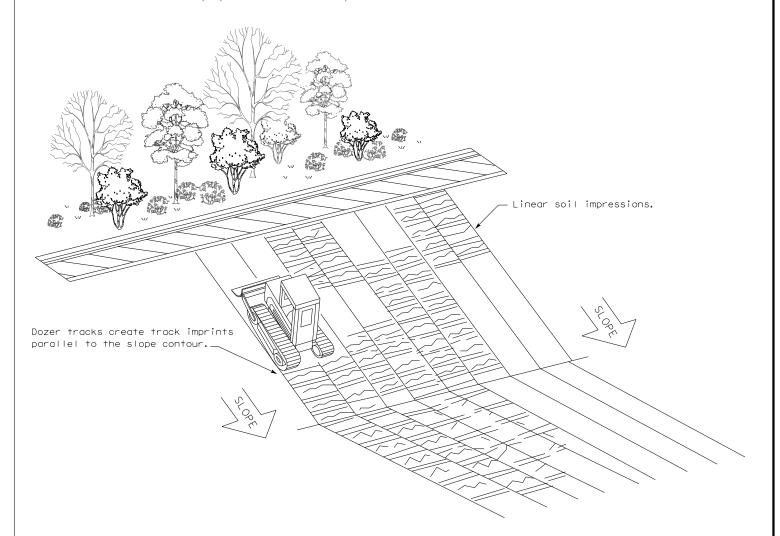

VERTICAL TRACKING



Design Division Standard

TEMPORARY EROSION,
SEDIMENT AND WATER
POLLUTION CONTROL MEASURES

FENCE & VERTICAL TRACKING

EC(1)-16

FILE: ec116	DN: TxD	OT	ck: KM	DW:	۷P	DN/CK: LS
C TxDOT: JULY 2016	CONT	SECT	JOB			HIGHWAY
REVISIONS	1392	01	044, E	ГC.	FM	1378,ETC.
	DIST	COUNTY			SHEET NO.	
	DAL		COLLI	N		319

7E2022

ያ ያ


made sults


warranty of any kind hats or for incorrect

Engineering Practice Act". No of this standard to other form

the "Texas I


this standard is governed by es no responsibility for the

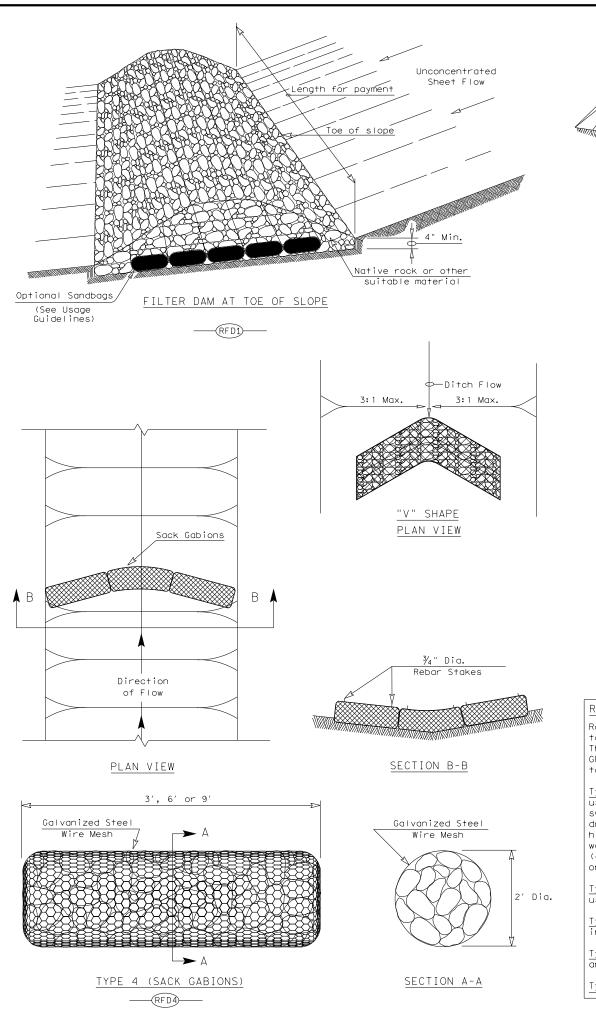


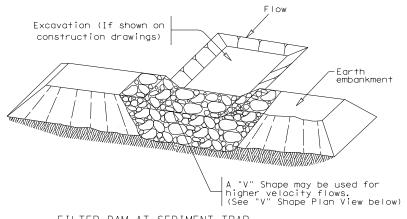

FILTER DAM AT SEDIMENT TRAP



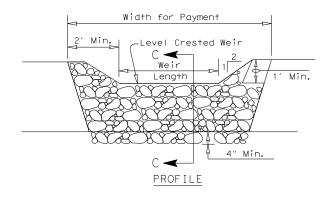

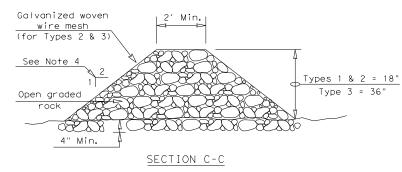

ROCK FILTER DAM USAGE GUIDELINES


Rock Filter Dams should be constructed downstream from disturbed areas to intercept sediment from overland runoff and/or concentrated flow. The dams should be sized to filter a maximum flow through rate of 60 GPM/FT² of cross sectional area. A 2 year storm frequency may be used to calculate the flow rate.

swale outlets. This type of dam is recommended to control erosion from a drainage area of 5 acres or less. Type 1 may not be used in concentrated high velocity flows (approximently 8 Ft/Sec or more) in which aggregate wash out may occur. Sandbags may be used at the embedded foundation (4" deep min.) for better filtering efficiency of low flows if called for on the plans or directed by the Engineer.

Type 2 (18" high with wire mesh) (3" to 6" aggregate): Type 2 may be used in ditches and at dike or swale outlets.

Type 3 (36" high with wire mesh) (4" to 8" aggregate): Type 3 may be used in stream flow and should be secured to the stream bed.


Type 5: Provide rock filter dams as shown on plans.

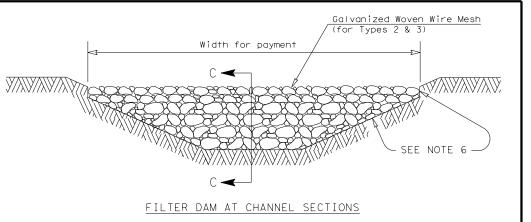

1. If shown on the plans or directed by the Engineer, filter dams should be placed near the toe of slopes where erosion is anticipated, upstream and/or downstream at drainage structures, and in roadway ditches and channels to collect sediment.

- 2. Materials (aggregate, wire mesh, sandbags, etc.) shall be as indicated by the specification for "Rock Filter Dams for Erosion and Sedimentation
- 3. The rock filter dam dimensions shall be as indicated on the SW3P plans.
- 4. Side slopes should be 2:1 or flatter. Dams within the safety zone shall have sideslopes of 6:1 or flatter.
- 5. Maintain a minimum of 1' between top of rock filter dam weir and top of embankment for filter dams at sediment traps.
- 6. Filter dams should be embedded a minimum of 4" into existing ground.
- 7. The sediment trap for ponding of sediment laden runoff shall be of the dimensions shown on the plans.
- 8. Rock filter dam types 2 & 3 shall be secured with 20 gauge galvanized woven wire mesh with 1" diameter hexagonal openings. The aggregate shall be placed on the mesh to the height & slopes specified. The mesh shall be folded at the upstream side over the aggregate and tightly secured to itself on the downstream side using wire ties or hog rings. For in stream use, the mesh should be secured or staked to the stream bed prior to aggregate placement.
- 9. Sack Gabions should be staked down with $\frac{3}{4}$ " dia. rebar stakes, and have a double-twisted hexagonal weave with a nominal mesh opening of 2 $\frac{1}{2}$ " x 3 $\frac{1}{4}$ "
- 10. Flow outlet should be onto a stabilized area (vegetation, rock, etc.).
- 11. The guidelines shown hereon are suggestions only and may be modified by








Type 4 Rock Filter Dam —

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES


ROCK FILTER DAMS

EC(2) - 16

FILE: ec216	DN: TxD	OT	ck: KM	DW:	۷P	DN/CK: LS
C TxDOT: JULY 2016	CONT	SECT	JOB			H]GHWAY
REVISIONS	1392	01	044, E	TC.	FM :	1378, ETC.
	DIST	COUNTY			SHEET NO.	
	DAL		COLLI	N		320

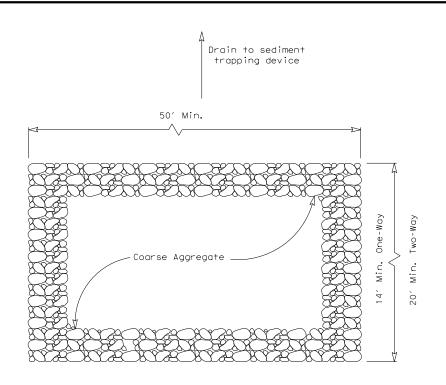

PLAN VIEW

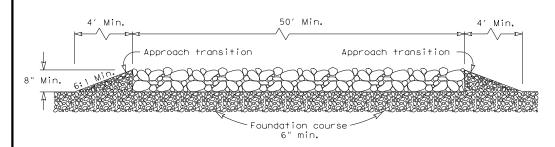


ELEVATION VIEW

CONSTRUCTION EXIT (TYPE 1)


ROCK CONSTRUCTION (LONG TERM)

GENERAL NOTES (TYPE 1)

- 1. The length of the type 1 construction exit shall be as indicated on the plans, but not less than 50'.
- 2. The coarse aggregate should be open graded with a size of 4" to 8".
- 3. The approach transitions should be no steeper than 6:1 and constructed as directed by the Engineer.
- 4. The construction exit foundation course shall be flexible base, bituminous concrete, portland cement concrete or other materialas approved by the Engineer.
- 5. The construction exit shall be graded to allow drainage to a sediment trappina device.
- 6. The guidelines shown hereon are suggestions only and may be modified by the Engineer.
- 7. Construct exits with a width of at least 14 ft. for one-way and 20 ft. for two-way traffic for the full width of the exit, or as directed by the engineer.

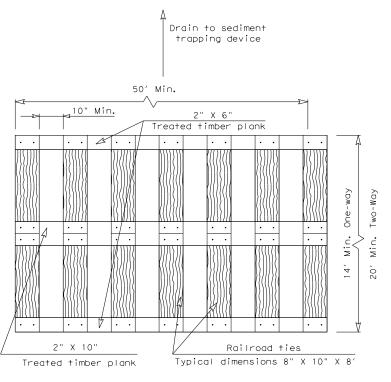

PLAN VIEW

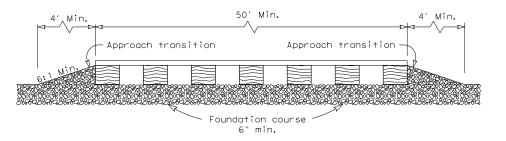


ELEVATION VIEW

CONSTRUCTION EXIT (TYPE 2)

TIMBER CONSTRUCTION (LONG TERM)


GENERAL NOTES (TYPE 2)

- 1. The length of the type 2 construction exit shall be as indicated on the plans, but not less than 50'.
- The treated timber planks shall be attached to the railroad ties with $\frac{1}{2}$ "x 6" min. lag bolts. Other fasteners may be used as approved by the Engineer.
- The treated timber planks shall be #2 grade min., and should be free from large and loose knots.
- 4. The approach transitions shall be no steeper than 6:1 and constructed as directed by the Engineer.
- 5. The construction exit foundation course shall be flexible base, bituminous concrete, portland cement concrete or other material as approved by the Engineer.
- 6. The construction exit should be graded to allow drainage to a sediment trapping device.
- The guidelines shown hereon are suggestions only and may be modified by the Engineer.
- 8. Construct exits with a width of at least 14 ft. for one-way and 20 ft. for two-way traffic for the full width of the exit, or as directed by the

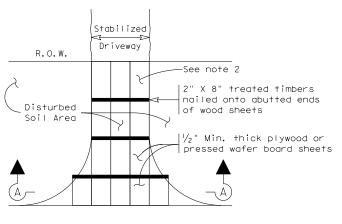

Paved Roadway

PLAN VIEW

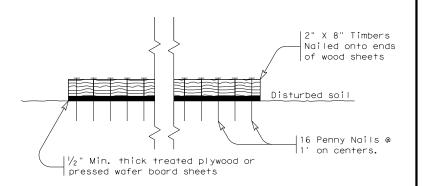


SECTION A-A

CONSTRUCTION EXIT (TYPE 3) SHORT TERM

GENERAL NOTES (TYPE 3)

- 1. The length of the type 3 construction exit shall be as shown on the plans, or as directed by the Engineer.
- 2. The type 3 construction exit may be constructed from open graded crushed stone with a size of two to four inches spread a min. of 4" thick to the limits shown on the plans.
- 3. The treated timber planks shall be #2 grade min., and should be free from large and loose knots.
- 4. The guidelines shown hereon are suggestions only and may be modified by the Engineer.



TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES CONSTRUCTION EXITS

EC(3) - 16

ILE: ec316	DN: Tx[<u>T00</u>	ck: KM	DW:	VP	DN/CK: LS
C)TxDOT: JULY 2016	CONT	SECT	JOB			H]GHWAY
REVISIONS	1392	01	044, E	TC.	FM 1	378, ETC.
	DIST		COUNTY			SHEET NO.
	DAL		COLLI	N		321

1/12/2022 DATE: FILE:

FLOW ADDITIONAL UPSTREAM STAKES FOR HEAVY TEMP. EROSION FLOW RUNOFF EVENTS CONTROL LOG SECURE END ADDITIONAL UPSTREAM -STAKES FOR HEAVY OF LOG TO STAKE AS RUNOFF EVENTS DISTURBED AREA DIRECTED SECURE END BACK OF CURB OF LOG TO -LIP OF GUTTER STAKE LOG ON DOWNHILL STAKE AS SIDE AT THE CENTER, DIRECTED AT EACH END, AND AT STAKE ON DOWNHILL SIDE OF ADDITIONAL POINTS AS TEMP. EROSION LOG AT 8' (ON CENTER) MAX. NEEDED TO SECURE LOG CONTROL LOG AS NEEDED TO SECURE LOG, (4' MAX. SPACING), OR AS DIRECTED BY THE OR AS DIRECTED BY ENGINEER. THE ENGINEER. PLAN VIEW PLAN VIEW

R.O.W.

STAKE LOG ON DOWNHILL

SIDE AT THE CENTER,

AT EACH END, AND AT

AS DIRECTED BY THE

ENGINEER.

ADDITIONAL POINTS AS


NEEDED TO SECURE LOG

(4' MAX. SPACING), OR


ADDITIONAL UPSTREAM


STAKES FOR HEAVY

RUNOFF EVENTS

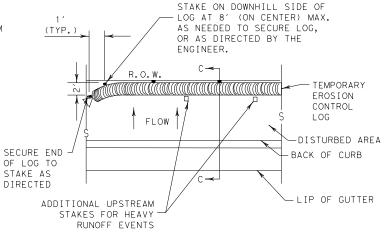

PLAN VIEW

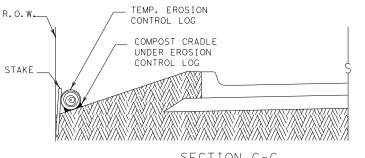

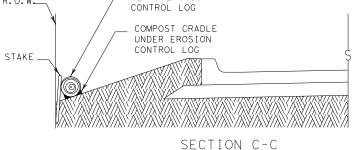

EROSION CONTROL LOG AT EDGE OF RIGHT-OF-WAY



EROSION CONTROL LOG AT BACK OF CURB

-TEMP. EROSION

COMPOST CRADIT

UNDER EROSION

CONTROL LOG

CONTROL LOG

SECTION A-A EROSION CONTROL LOG DAM

MIN



LEGEND

CL-D -EROSION CONTROL LOG DAM


TEMP. EROSION-

CONTROL LOG

COMPOST CRADLE UNDER EROSION

CONTROL LOG

- →(CL-BOC) — EROSION CONTROL LOG AT BACK OF CURB
- EROSION CONTROL LOG AT EDGE OF RIGHT-OF-WAY
- EROSION CONTROL LOGS ON SLOPES STAKE AND TRENCHING ANCHORING -(CL-SST
- EROSION CONTROL LOGS ON SLOPES STAKE AND LASHING ANCHORING -(CL-SSL
- CL-DI - EROSION CONTROL LOG AT DROP INLET
- (CL-CI EROSION CONTROL LOG AT CURB INLET
- [CL-GI] - EROSION CONTROL LOG AT CURB & GRATE INLET



SECTION B-B

CL-BOO

REBAR STAKE DETAIL

SEDIMENT BASIN & TRAP USAGE GUIDELINES

An erosion control log sediment trap may be used to filter sediment out of runoff draining from an unstabilized area.

The drainage area for a sediment trap should not exceed Log Traps: 5 acres. The trap capacity should be 1800 CF/Acre (0.5" over the drainage area).

Control logs should be placed in the following locations:


- 1. Within drainage ditches spaced as needed or min. 500' on center
- 2. Immediately preceding ditch inlets or drain inlets
- 3. Just before the drainage enters a water course
- 4. Just before the drainage leaves the right of way
- 5. Just before the drainage leaves the construction limits where drainage flows away from the project.

The logs should be cleaned when the sediment has accumulated to a depth of 1/2 the log diameter.

Cleaning and removal of accumulated sediment deposits is incidental and will not be paid for separately.

GENERAL NOTES:

- 1. EROSION CONTROL LOGS SHALL BE INSTALLED IN ACCORDANCE WITH MANFACTURER'S RECOMMENDATIONS, OR AS DIRECTED BY THE ENGINEER.
- 2. LENGTHS OF EROSION CONTROL LOGS SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND AS REQUIRED FOR THE PURPOSE INTENDED.
- 3. UNLESS OTHERWISE DIRECTED, USE BIODEGRADABLE OR PHOTODEGRADABLE CONTAINMENT MESH ONLY WHERE LOG WILL REMAIN IN PLACE AS PART OF A VEGETATIVE SYSTEM. FOR TEMPORARY INSTALLATIONS, USE RECYCLABLE CONTAINMENT MESH.
- FILL LOGS WITH SUFFICIENT FILTER MATERIAL TO ACHIEVE THE MINIMUM COMPACTED DIAMETER SPECIFIED IN THE PLANS WITHOUT EXCESSIVE DEFORMATION.
- STAKES SHALL BE 2" X 2" WOOD OR #3 REBAR, 2'-4' LONG, EMBEDDED SUCH THAT 2" PROTRUDES ABOVE LOG, OR AS DIRECTED BY THE ENGINEER.
- 6. DO NOT PLACE STAKES THROUGH CONTAINMENT MESH.
- 7. COMPOST CRADLE MATERIAL IS INCIDENTAL & WILL NOT BE PAID FOR SEPARATELY.
- SANDBAGS USED AS ANCHORS SHALL BE PLACED ON TOP OF LOGS & SHALL BE OF SUFFICIENT SIZE TO HOLD LOGS IN PLACE.
- TURN THE ENDS OF EACH ROW OF LOGS UPSLOPE TO PREVENT RUNOFF FROM FLOWING AROUND THE
- 10. FOR HEAVY RUNOFF EVENTS, ADDITIONAL UPSTREAM STAKES MAY BE NECESSARY TO KEEP LOG FROM FOLDING IN ON ITSELF.



DIAMETER MEASUREMENTS OF EROSION CONTROL LOGS SPECIFIED IN PLANS

SHEET 1 OF 3



Design Division Standard

TEMPORARY EROSION. SEDIMENT AND WATER POLLUTION CONTROL MEASURES

EROSION CONTROL LOG

EC(9) - 16

FILE: ec916	DN: TxD	OT	ck: KM	DW:	LS/PT	ck: LS
© TxDOT: JULY 2016	CONT	SECT	JOB			HIGHWAY
REVISIONS	1392	01	044, E	TC.	FM :	1378,ETC.
	DIST	COUNTY		SHEET NO.		
	DΔI		COLL	N		322


SECURE END > OF LOG TO STAKE AS DIRECTED

TEMP. EROSION

FLOW

CONTROL LOG



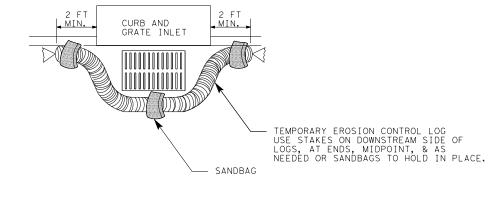

OVERLAP ENDS TIGHTLY 24" MINIMUM

--- FLOW

EROSION CONTROL LOG AT DROP INLET

-STAKE OR USE SANDBAGS ON DOWNHILL SIDE OF LOG AS NEEDED TO HOLD IN PLACE (TYPICAL)

COMPLETELY SURROUND
DRAINAGE ACCESS TO
AREA DRAIN INLETS WITH
EROSION CONTROL LOG



CURB

TEMP. EROSION CONTROL LOG

SANDBAG



EROSION CONTROL LOG AT CURB INLET

-2 SAND BAGS




NOTE: EROSION CONTROL LOGS USED AT CURB INLETS SHOULD ONLY BE USED IF THEY WILL NOT IMPEDE TRAFFIC OR FLOOD THE ROADWAY OR WHEN THE STORM SEWER SYSTEM IS NOT FULLY FUNCTIONAL.

6" CURB-

2 SAND BAGS -

TEMP. EROSION CONTROL LOG




- USE STAKES ON DOWNSTREAM SIDE OF LOGS, AT ENDS, MIDPOINT, & AS NEEDED OR SANDBAGS TO HOLD IN PLACE.

SANDBAG DETAIL

SHEET 3 OF 3

-CURB INLET _INLET EXTENSION




TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES


EROSION CONTROL LOG


EC(9) - 16

			_			
ILE: ec916	DN: TxD	OT	ck: KM	DW:	LS/PT	ck: LS
C) TxDOT: JULY 2016	CONT	SECT	JOB			HIGHWAY
REVISIONS	1392	01	044, [ETC.	FM 1	378, ETC.
	DIST	COUNTY		SHEET NO.		
	DAL		COLL	IN		323

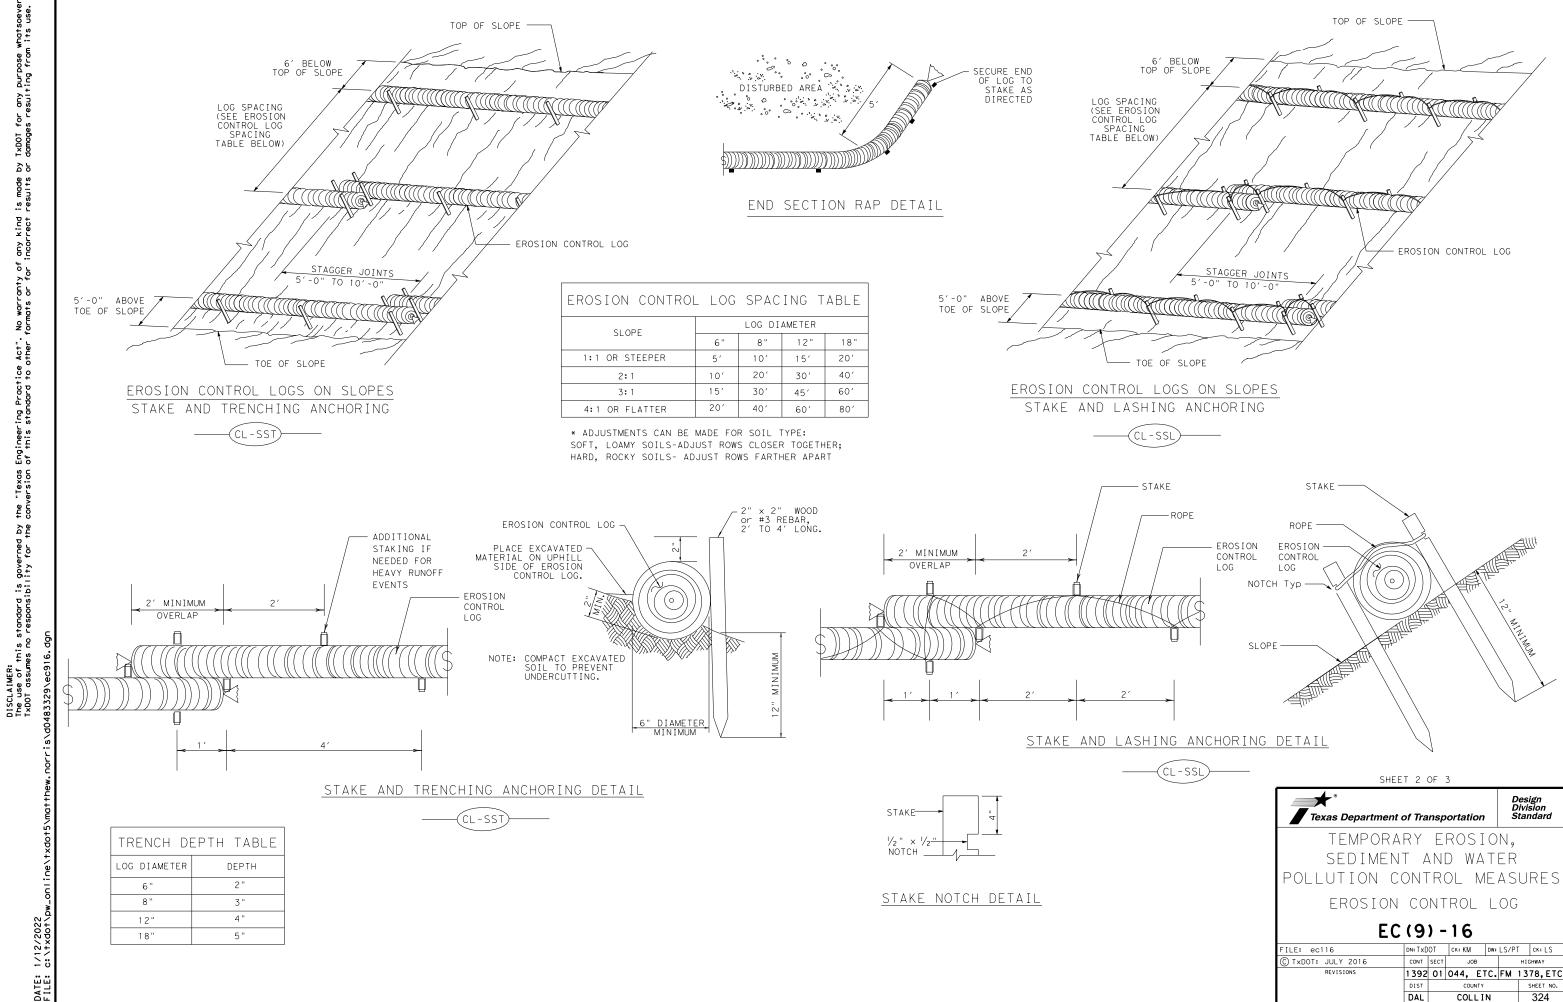





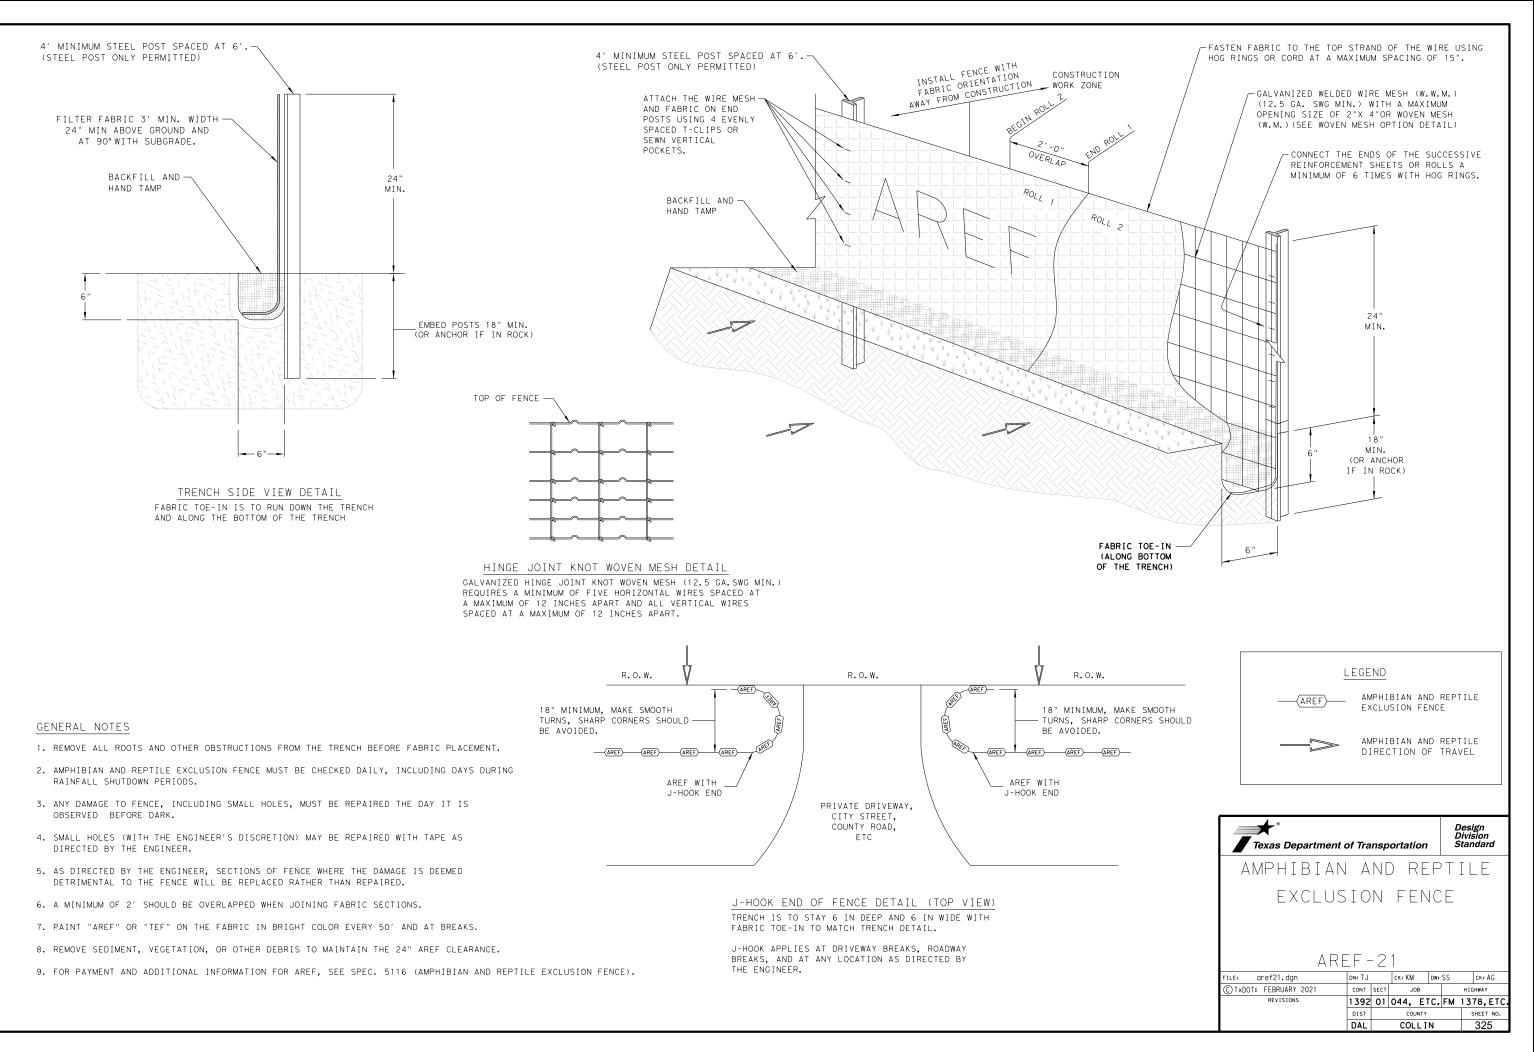

SURFACE PREPARATION ITEM 160* TOPSOIL SY / ITEM 161* COMPOST MANUF. TOPSOIL (BOS) (4") SY

SURFACE PREPARATION

Prepare planting area surface BEFORE placing Topsoil, Compost, Fertilizer, Seed and/or Sod.

Once project area has been completed to final lines, grade and compaction, remove objectionable materials from planting area surface and cultivate existing surface to a depth of 4 inches, unless otherwise specified or directed.

Refer to Items 160 and 161 of TxDOT 2014 Standard Specifications* for specifications, dimensions, volumes, and measurements that have been modified or not shown in plans. Materials and construction shall meet all specifications.

- TOPSOIL NOTES:

 1. When Topsoil is specified under Item 160, use suitable material salvaged from the project ROW in accordance with Item 160 specifications, and/or secure additional good material from approved sources.

 2. Topsoil shall include only the top 6 inches of its native surface, and be easily cultivated, fertile, erosion-resistant
- obtained from sites outside of the ROW must come from approved sources and have a pH between 5.5 and 8.5 su. 4. Place Topsoil on pre-cultivated surface, spread to a uniform loose cover at thickness specified, and shape per plans.
 Water and roll the finished surface with a light roller or other suitable equipment per Item 160.3; do not over-compact.

COMPOST NOTES:

- When Compost Manufactured Topsoil (4") is specified under Item 161, use compost meeting all requirements of Item 161.2 and Table 1. Provide quality control (QC) documentation and obtain Engineer approval prior to compost delivery.
 Contractor shall provide tickets/invoices that document material type, quantity and placement for all compost delivered.
 Additional topsoil may be required to be imported to achieve the compost/topsoil mix ratio. Topsoil must meet Item 160
- specifications.

APPLICATION OF COMPOST MANUFACTURED TOPSOIL (4")

AFTER Surface Preparation, uniformly spread a 1-inch layer of compost on-grade with 3 inches topsoil over pre-cultivated planting area. (25% compost and 75% topsoil = 1" compost and 3" topsoil.)

Then mix compost and topsoil together by cultivating the compost into the topsoil (by till or disk) to a 4-inch (4") depth Roll the finished surface with a light corrugated drum; do not over-compact.

FERTILIZER ITEM 166* FERTILIZER AC

ANALYSIS FOR FERTILIZER APPLICATION RATE

Unless otherwise stated in the plans. Contractor shall perform at least one soil analysis on each project before fertilization, and submit results to Engineer with recommended fertilizer rates based on soil analysis. Engineer may direct sample location(s). Soil analysis may be waived if both compost and sod are used on entire project

FERTILIZER NOTES:

- 1. Refer to Item 166 of TxDOT 2014 Standard Specifications* for specifications, dimensions, volumes, and measurements that have been modified or not shown in plans. Materials and construction shall meet all specifications.

 2. Apply fertilizer BEFORE seeding, or AFTER placing sod.

 3. Use fertilizer containing nitrogen (N), phosphoric acid (P) and potash (K) nutrients, unless otherwise specified. At
- least 50% of the Nitrogen component shall be a slow-release sulfur-coated urea as described in Item 166.3. Do not apply more than 60 lbs Nitrogen per acre without Engineer concurrence.
- 4. Deliver fertilizer in bags, clearly labeled to show contents, unless otherwise specified or approved prior to delivery. When non-bagged, loose fertilizer is approved, provide documentation for each load of material delivered, to validate authenticity of the material.

 5. Apply fertilizer uniformly, as a dry, granular material, essentially dust-free, and do not mix with water for application as a surry.
- application as a slurry.
- 6. When both temporary and permanent seeding are specified for the same area, apply half of the required fertilizer before the temporary seeding operation and the other half before the permanent seeding operation.

SEEDING FOR EROSION CONTROL ITEM 164* DRILL SEEDING AC

RECOMMENDED PERMANENT RURAL SEED MIX PLANTING SEASON ITEM 164 - DRILL SEEDING (PERM) (RURAL) (CLAY) ITEM 164 - DRILL SEEDING (PERM) (URBAN) (CLAY) ITEM 164 - DRILL SEEDING (TEMP) (WARM OR COOL) Pure Live Seed Rate** Pure Live Seed Rate** Pure Live Seed Rate** Green Sprangletop (Leptochloa dubia) Sideoats Grama (El Reno) (Bouteloua curtipendula) Buffalograss (Texoka) (Buchloe dactyloides) Green Sprangletop (Van Horn) Sideoats Grama (Haskell) - 1.0 lbs/AC - 1.0 lbs/AC - 0.3 lbs/AC - 3.6 lbs/AC Foxtail Millet (Setaria italica) - 34 lbs/AC WARM SEASON - 1.6 lbs/AC - 2.4 lbs/AC Texas Grama (Atascosa) Hairy Grama (Chaparral) - 1.0 |bs/AC - 0.4 |bs/AC Mar.15th, April, May, June, July, August, Sept. 15th Bermudagrass (Cynodon dactylon) Shortspike Windmillgrass (Welder) Little Bluestem (OK Select) Purple Prairie Clover (Cuero) Engelmann Doisy (Eldorado) Illinois Bundleflower - 0.2 lbs/AC - 0.8 lbs/AC - 0.6 lbs/AC - 1.3 lbs/AC Awnless Bushsunflower (Plateau) - 0.2 lbs/AC Pure Live Seed Rate* COOL SEASON Tall Fescue (Festuca arundinaceae) - 4.5 lbs/AC - 5.6 lbs/AC Western Wheatgrass (Agropyron smithii) Sept 16th, Oct, lbs/AC Nov. Dec. Jan.

SEEDING NOTES:

- 1. When seeding is specified under Item 164, refer to TxDOT 2014 Standard Specifications* for specifications, dimensions volumes, and measurements that have been modified or not shown. Materials and construction shall meet specifications.

 2. Conduct seeding upon completion of each applicable construction stage (dependent upon planting season requirements),
- Conduct seeding upon completion of each applicable construction stage (dependent upon planting season requirements), without compensation for additional move-ins.
 Place seed AFTER preparing planting area surface. Refer to Surface Preparation detail this sheet, as well as Topsoil Item 160 and Compost Manufactured Topsoil Item 161 when specified. Apply fertilizer per Item 166 BEFORE seeding, per specifications and this sheet, to help drill the fertilizer into the soil.
 When temporary grasses are well-established and more than 2 inches tall, mow planting area before seeding permanent grasses; mowing for this purpose will be subsidiary. When vegetation is not already well-established, cultivate planting area to a depth as described in Item 164.3, before temporary seeding and before permanent seeding.
 Seed material must be appropriate to the location, soil type and season. Use the seed mix species and pure live seed rates designated in Tables 1-4 of the TxDOT 2014 Standard Specifications* for Item 164, unless otherwise specified.
 All seed shall meet labeling, delivery, analysis, and testing requirements described in Item 164.2.1. Deliver seed in

- 6. All seed shall meet labeling, delivery, analysis, and testing requirements described in Item 164.2.1. Deliver seed in labeled, unopened bags or containers to Engineer prior to planting.
 7. Uniformly plant seed over the designated planting area, along the contour of slopes, and drill seed to a depth as described in Item 164.3.4.
- 8. Hydroseeding may be allowed, when specified or Engineer concurs.
 9. Implement and continue Vegetative Watering per the schedule, rate and volume specified under Item 168.

TXDOT REFERENCE MATERIALS:

Feb. Mar 14th

- * "STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MAINTENANCE OF HIGHWAYS, STREETS, AND BRIDGES" 2014
- "A GUIDANCE TO ROADSIDE VEGETATION ESTABLISHMENT" 2004
 ONLINE TRAINING COURSE: MNT415 REVEGETATION DURING CONSTRUCTION
- DALLAS DISTRICT "VEGETATION ESTABLISHMENT GUIDELINES"

SODDING FOR EROSION CONTROL ITEM 162* BLOCK SOD (BERMUDA) SY

BLOCK OR BOLL SOD	COMMON NAME	BOTANICAL NAME
BLOCK ON NOLL 30D	Common Bermuda Grass	Cynodon dactylon

- SODDING NOTES:

 1. Refer to Item 162 of TxDOT 2014 Standard Specifications* for specifications, dimensions, volumes, and measurements that have been modified or not shown in plans. Materials and construction shall meet all specifications.

 2. Place sod between the average date of the last freeze in the Spring and 6 weeks before the average date of the first freeze in the Fall, per the Texas Almanac for the project area.

 3. Place sod only AFTER soil surface preparation is complete as detailed in this sheet. Dry soil may require pre-watering.

 4. Place all sod (blocks or rolls) within 24 hours of delivery to the site, and keep moist from the time it is dug up until it is planted. Sod with dried roots will not be accepted.

 5. Place sod with joints alternating on each row to prevent all joints from lining up, and place blocks firmly against adjacent blocks. Roll, tamp and trim sod per Item 162.3.

 6. Place fertilizer promptly AFTER sodding aperation is complete in each area.

- 6.Place fertilizer promptly AFTER sodding operation is complete in each area.
 7. Water sod immediately following placement, and continue Vegetative Watering per Item 168.

VEGETATIVE WATERING FOR ESTABLISHING SEED AND SOD ITEM 168* VEGETATIVE WATERING MG

WATERING SCHEDULE SEASON (Usual Months) TIME SCHEDULE TOTAL WATER ESTIMATE Vegetative watering for seed shall begin on the day after rainfall described below and continue for 60 consecutive working days; SPRING & FALL 420.000 gallons/acre 7,000 gallons/acre (March, April, May, October) per working day (60 working days) regetative watering for sod shall begin SLIMMER 720,000 gallons/acre (60 working days) the day the sod is placed and continue for (June, July, August, September) per working day a minimum of 15 consecutive working days. Vegetative watering for seed and/or sod WINTER 1.000 aallons/acre 15.000 aallons/acre shall begin on the day after placement for (November through February) per working day (15 working days) 15 consecutive working days

Notes: Rate and frequency may be adjusted, with the approval of the Engineer, to meet site conditions (especially with sod). For informational purposes only: 1,000 gallons equals 1 MG

VEGETATIVE WATERING NOTES:

- 1. Refer to Item 168 of TxDOT 2014 Standard Specifications* for specifications, dimensions, volumes, and measurements that have been modified or not shown in plans. Materials and construction shall meet all specifications.

 2. Use clean water free of industrial waste and other substances harmful to vegetation growth, per Item 168.2.

 3. Use Vegetative Watering to keep the seed bed moist during germination; not to provide initial watering. After drill seeding, postpone watering operations until site receives at least 1/2-inch of natural rainfall in a single day. Delay watering operations for warm season grasses until soil temperature exceeds 70 degrees F.
- 4. For sod, water immediately.
 5. All water distribution equipment shall be furnished and operated to provide water at a uniform and controllable rate.

- 5. All water distribution equipment shall be furnished and operated to provide water at a uniform and controllable rate. Use a metering device on all watering equipment.
 6. Evenly distribute water over entire area designated for seeding and/or sodding, using even spray patterns that do not disturb seed bed and/or dislodge seed from seed bed.
 7. Do not water between the hours of 12:00 p.m. and 6:00 p.m. when daytime temperatures exceed 95 degrees F.
 8. After initial establishment period, continue intermittent watering of newly established seed or sod at a rate of approximately 1-inch water/week, during summer months until end of contract.
 9. If 1/4-inch or more of rainfall occurs on site on any given working day, no vegetative watering will be needed on that working day. (Note: 1/4-inch rain equals 7,000 gallons of water per acre.)
 10. Should the Contractor fail to apply the specified amount of water within the time allowed, any seed or sod in poor condition shall be replaced, fertilized, and watered at Contractor's expense.

PERMANENT URBAN SEED MIX TEMPORARY DRILL SEED MIX

Red Winter Wheat (Triticum aestivum) - 34 Cereal Rye - 34 lbs/AC

**Note: The amount of Pure Live Seed (PLS) in one pound of bulk seed is based on three factors: % Purity, % Germination, and % Dormant.

Use the following formula to calculate PLS in bulk seed: PLS = % Purity X (% Germination + % Dormant) Ensure that the specified amount of pure live seed is placed.

ROADSIDE MOWING ITEM 730* PROJECT MAINTENANCE AC MOWING NOTES:

- 1. During project construction, once seed is established, use mowing to promote permanent grasses by mowing any remaining temporary grasses.

 2. Also mow established turf and ROW grasses in designated areas of
- project limits as specified or directed by Engineer.

 3. Remove litter and debris prior to mowing.

 4. Do not mow on wet ground when soil rutting can occur.

- 5. Hand-trim around obstructions and stormwater control devices as needed.

 6. Maintain paved surfaces free of tracked soils and clipped vegetation.

SEQUENCE OF WORK:


- CULTIVATE SURFACE SOIL.
- PREPARE / PLACE TOPSOIL, OR
- PREPARE / PLACE COMPOST MANUFACTURED TOPSOIL.
- APPLY FERTILIZER AND THEN PLACE SEEDING, OR
- PLACE SOD AND THEN APPLY FERTILIZER.
- CONDUCT VEGETATIVE WATERING.
- CONDUCT ROADSIDE MOWING, AS DIRECTED.



VEGETATION ESTABLISHMENT SHEET (DALLAS DISTRICT)

TEMPLATE REVISION DATE: 02/21/19

	DESIGN CPB	FED.RD. DIV.NO.	FEDER	AL AID PROJECT NO.	HIGHWAY NO.	
П	GRAPHICS	6	(See	Title Sheet)	FM 1378,ETC.	
П	XXX	STATE	DISTRICT	COUNTY	SHEET NO.	
	CHECK	TEXAS	DALLAS	COLLIN	000	
	CHECK	CONTROL	SECTION	JOB	326	
J	XXX	1392	01	044,ETC.	020	

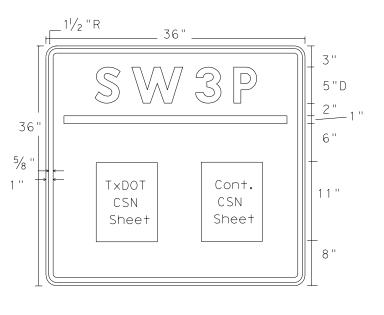

SW3P SIGN

TxDOT & Contractor
Construction Site Note
(CSN)

Sign Dimensions

36" X 36"

Letters - White

Numbers - White Border - White

Background - Blue

BEGIN

ROAD WORK NEXT X MILES

NAME

ADDRESS

STATE CONTRACTOR

GENERAL NOTES:

- 1. The alphabets and lateral spacing between letters and numerals shall conform with the "Texas Manual on Uniform Traffic Control Devices for Streets and Highways", (TMUTCD) latest edition, and the "Compliant Work Zone Traffic Control Devices List". Lateral spacing of text shall provide a balanced appearance. All materials shall conform to Department Specifications.
- 2. Legend and border may be applied by reverse screening process with transparent colored ink, cut-out white reflective sheeting applied to colored background or combination thereof. Background shall be reflective sheeting Type C.
- 3. CSN Sheets will be laminated and attached to the sign with an adhesive. Ensure sheets remain dry.(See Figure 1).
- 4. SW3P Signs should be placed just inside the ROW line at the project limits at a readable height. It may be placed perpendicular or parallel to ROW line. If the sign cannot be placed outside the clear zone, it will be mounted per TMUTCD requirements.
- 5. Final location of the signs will be as approved by the Engineer.

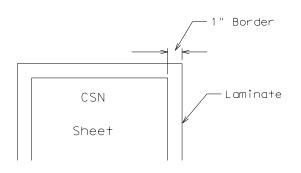


Figure 1



COLOR USAGE REFLECTIVE SHEETING OR OTHER MATERIAL

BLUE BACKGROUND TYPE C (FLUORESCENT PRISMATIC)
WHITE LEGEND & BORDERS VINYL NON-REFLECTIVE DECAL SHEETING

Texas Department of Transportation
DALLAS DISTRICT STANDARD

SW3P SIGN SHEET

FILE:		DN: <u>IxDOI</u>	CK:	DW:		CK:	
© TxD0T	2016	DISTRICT FEDERAL AID PROJECT					SHEET
REVISION DATE:		18	SEE	327			
		COUNTY		CONTROL	SECT	JOB	HIGHWAY
10-16-	10-16-15		MIIN	1392	01	044 ETC	EM 1378 ETC

