



# FIVE RUSTON HOMES SANITARY AND STORM SEWER EXHIBIT

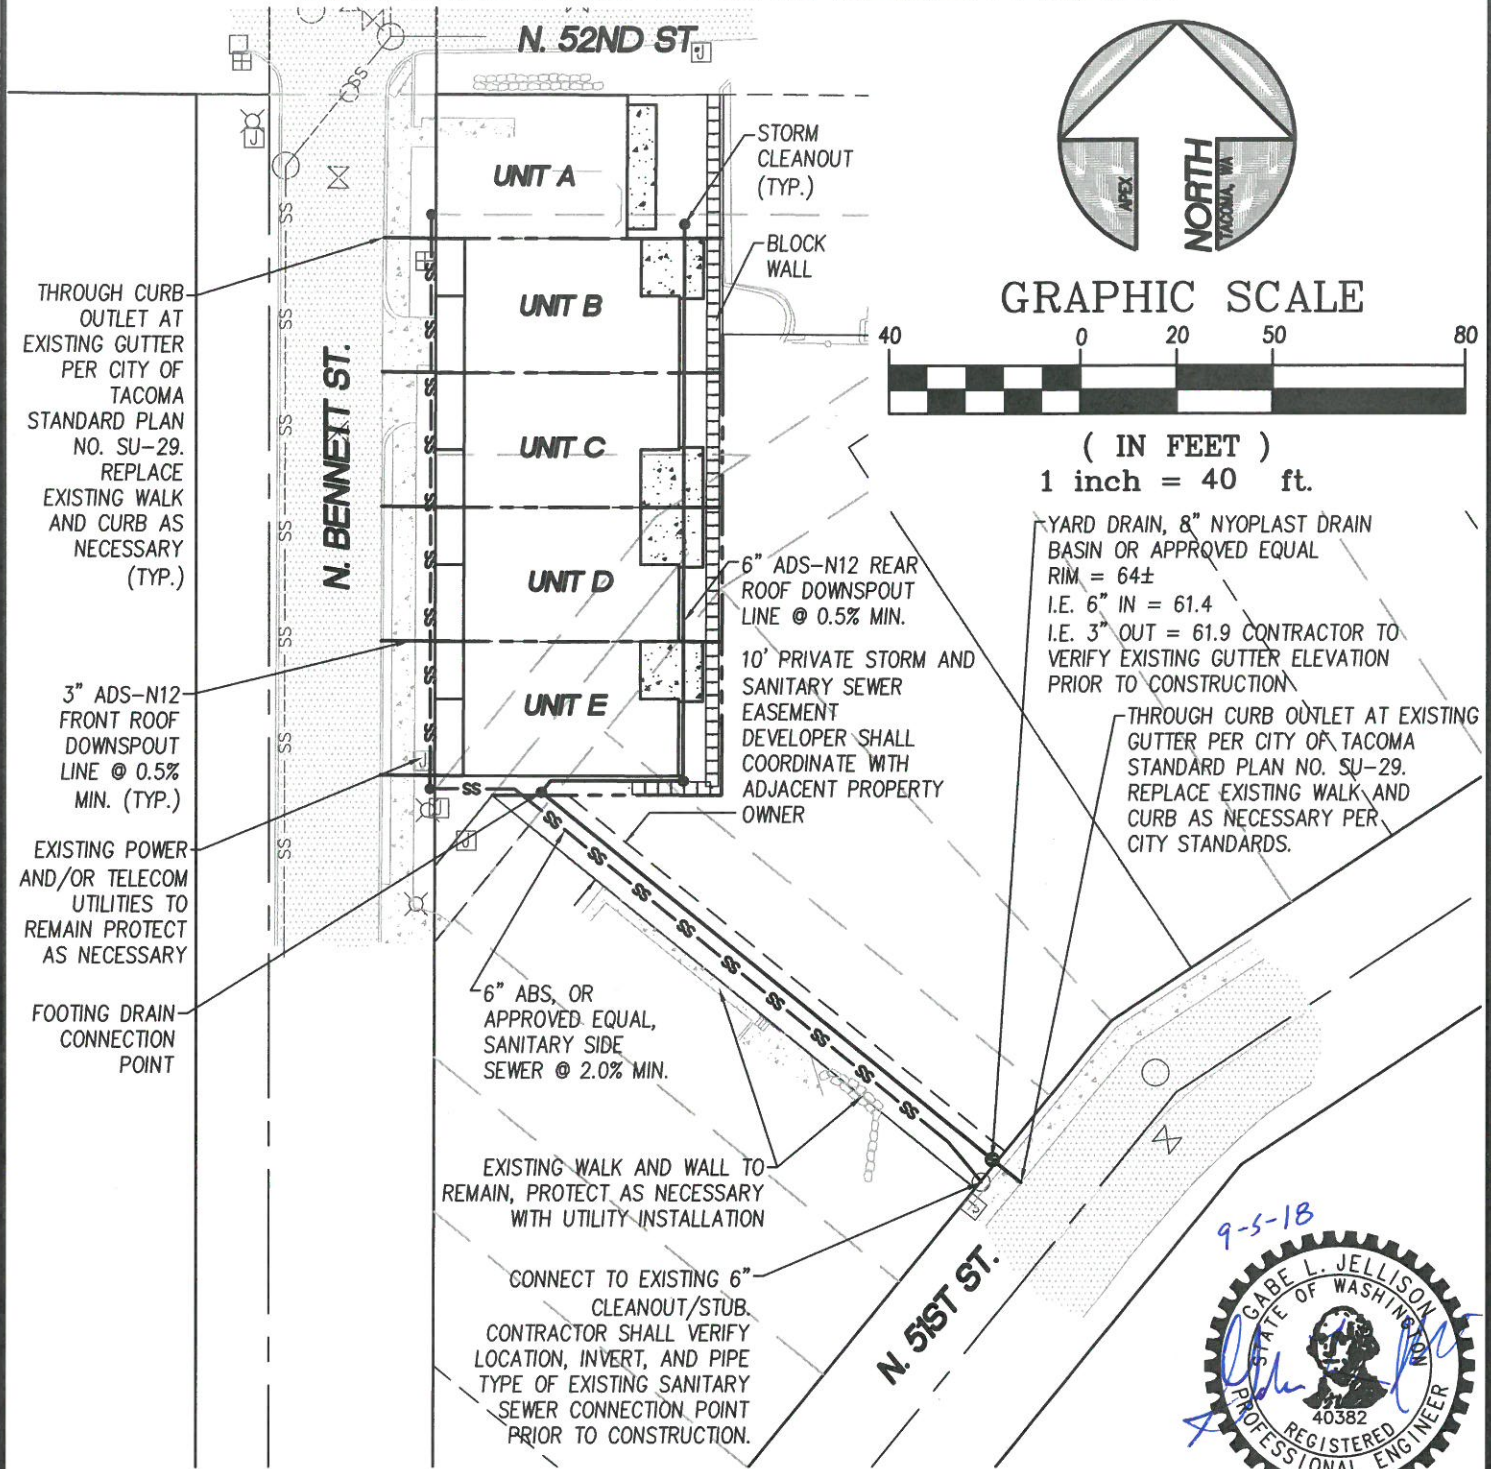

**NOTES:**

1. INFILTRATION SYSTEMS ARE NOT FEASIBLE ONSITE. THERE IS NOT ADEQUATE ROOM IN THE REAR YARDS TO MAINTAIN THE REQUIRED 10 FOOT SETBACK FROM THE STRUCTURES OR THE 5 FOOT SETBACK FROM THE PROPERTY LINE. ADDITIONALLY, STORMWATER SHOULD NOT BE DIRECTED TOWARDS THE PROPOSED WALL ALONG THE EASTERN PROPERTY LINE. REFER TO THE GEOTECHNICAL LETTER BY REX HUMPHREY, LEG, DATED AUGUST 10, 2018, FOR ADDITIONAL INFORMATION AND RECOMMENDATIONS.
2. CONTRACTOR SHALL COORDINATE EXACT ROOF DOWNSPOUT LOCATIONS WITH BUILDING PERMIT.
3. FRONT ROOF DOWNSPOUTS SHALL DISCHARGE TO THE GUTTER OF N. BENNETT STREET AND REAR ROOF DOWNSPOUTS AND FOOTING DRAINS SHALL BE TIGHTLINED TO THE GUTTER OF N. 51ST STREET.

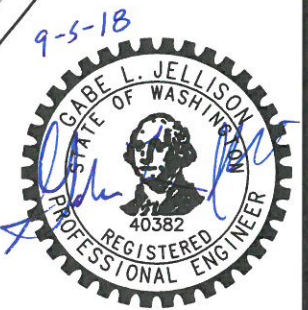

# Apex

## Engineering PLLC

2601 South 35th, Suite 200  
Tacoma, Washington 98409-7479  
(253) 473-4494 FAX: (253) 473-0599  
© APEX ENGINEERING PLLC 2018