


NOTE: WHERE SPACING EXCEEDS 10' 0" INSTALL 1 1/2" X 6'-1" STD. GALV. PIPE LINE POSTS WITH GALV. EYE TYPE CAPS FOR TOP RAIL AND 12" LONG LIGHT WT. METAL INSERTS AT EQUAL INTERVALS OF 10' 0" OR LESS.

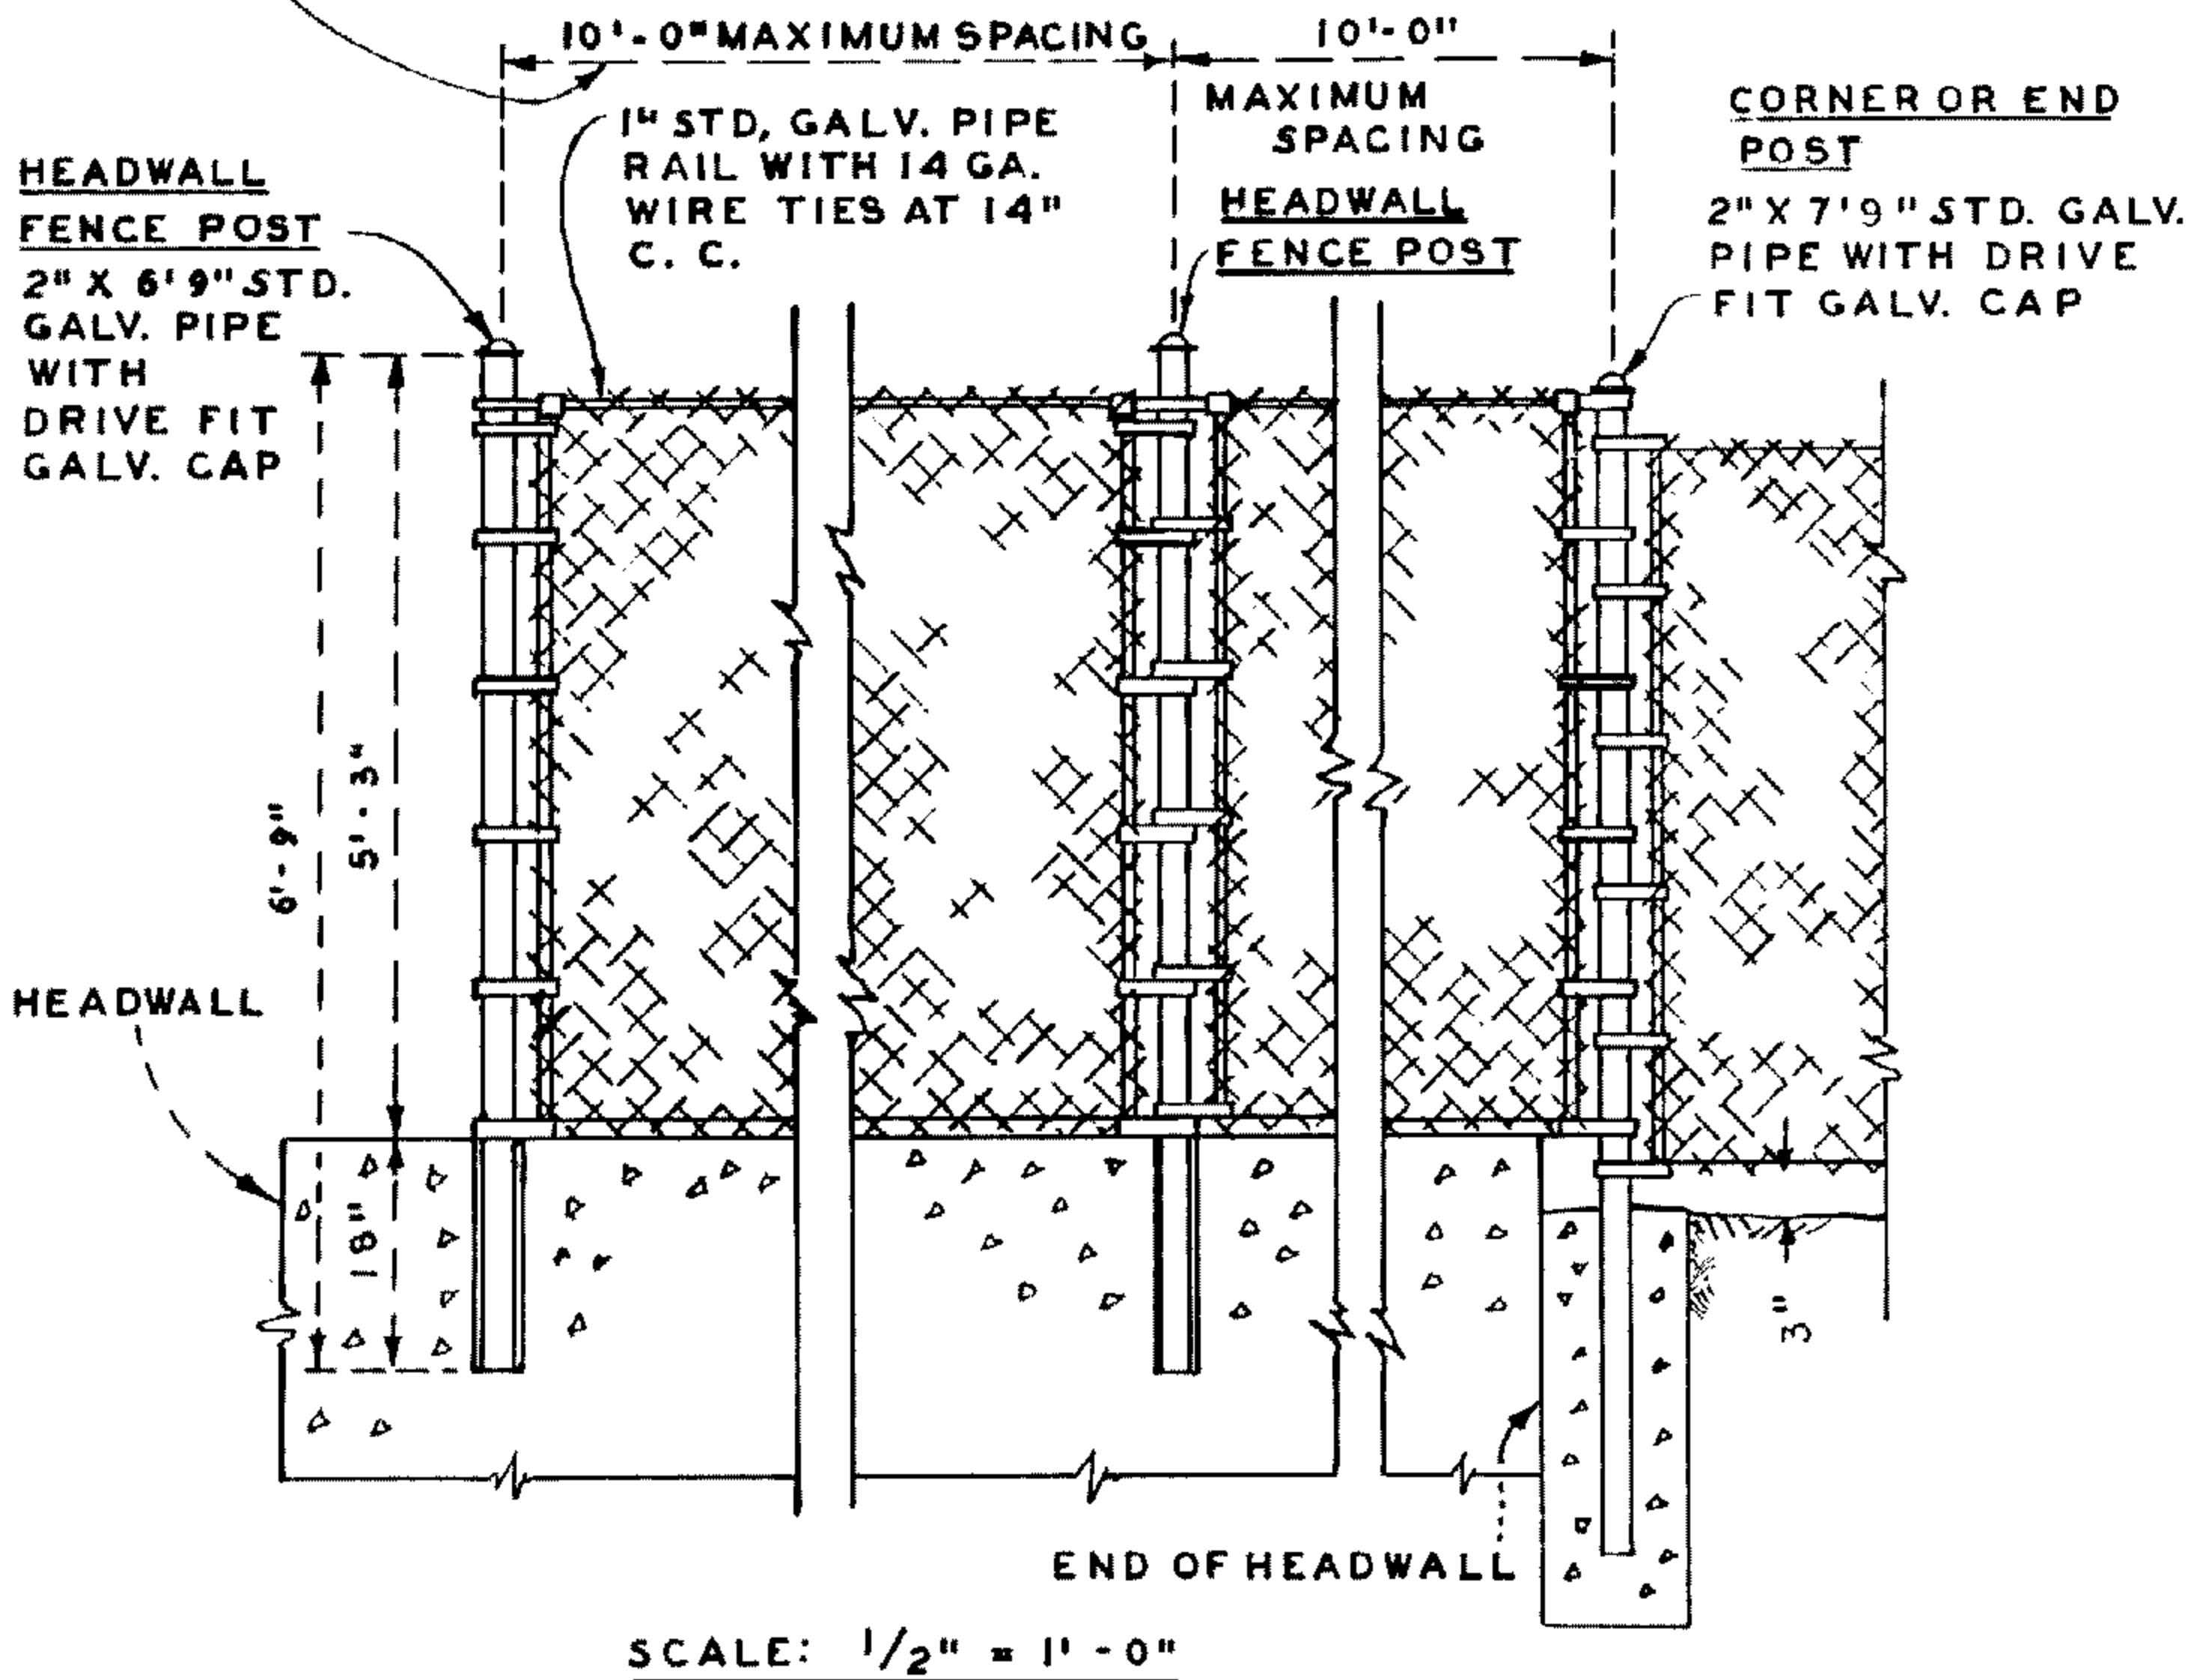

1. ALL METAL PARTS OF ALL TYPE FENCES AND GATES, INCLUDING FENCE FABRICS, SHALL BE NEW GALVANIZED MATERIAL.
2. LIGHT WEIGHT METAL INSERTS SHALL BE SHEET METAL TUBES WITH I.D. 3/4" GREATER THAN O.D. OF PIPE USED. POSTS SHALL BE GROUTED INTO INSERTS USING NEAT GROUT OF 1 PART OF CEMENT & 2 PARTS OF WATER. POST MAY BE SET IN SULPHUR IN LIEU OF GROUT IF APPROVED BY ENGINEER.
3. FOR DETAILS NOT SHOWN SEE DRAWING NO. 310.

DATE OF REVISIONS	NATURE OF	CITY OF SANTA ANA IMPROVEMENT STANDARD		STD NO
		CHAIN LINK HEADWALL FENCE		312
		APPROVED: 10.10.10. <i>Volcano</i> CITY ENGINEER	DATE 10-23-63	