



NOTES:

1. CONNECTION AND PIPE TO BE BACKFILLED PER CLASS SPECIFIED.
2. IN LIEU OF AN INTERNAL CYLINDER, AN HDPE WATERTIGHT REPAIR COUPLER CAN BE USED.
3. INTERNAL CYLINDER ADAPTER IS NOT RECOMMENDED FOR DOWNSTREAM CONNECTIONS.

DOUBLE WIDE MARMAC
COUPLER TO BE WRAPPED
AROUND CONNECTION



SECTION A-A

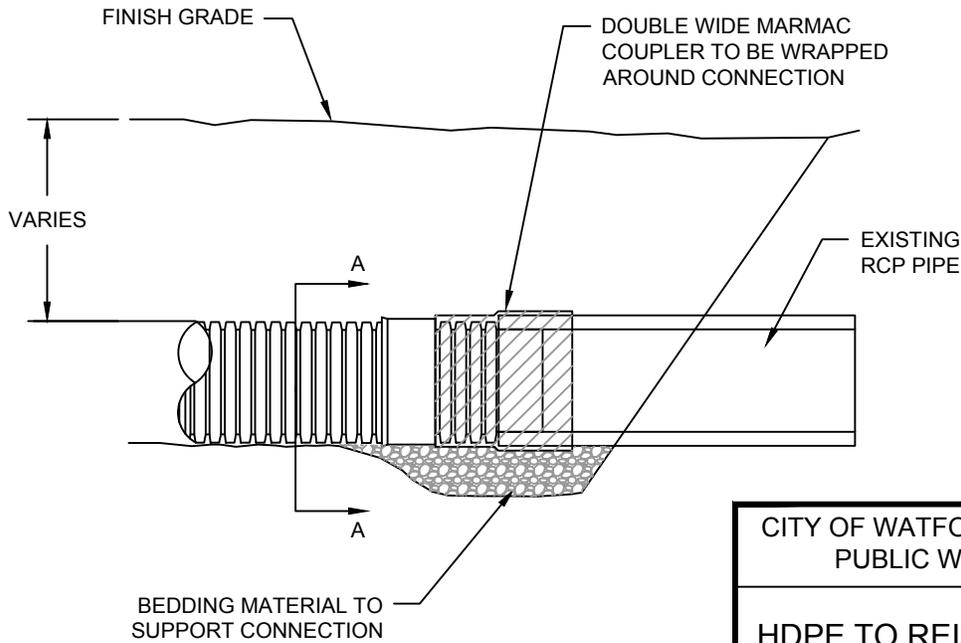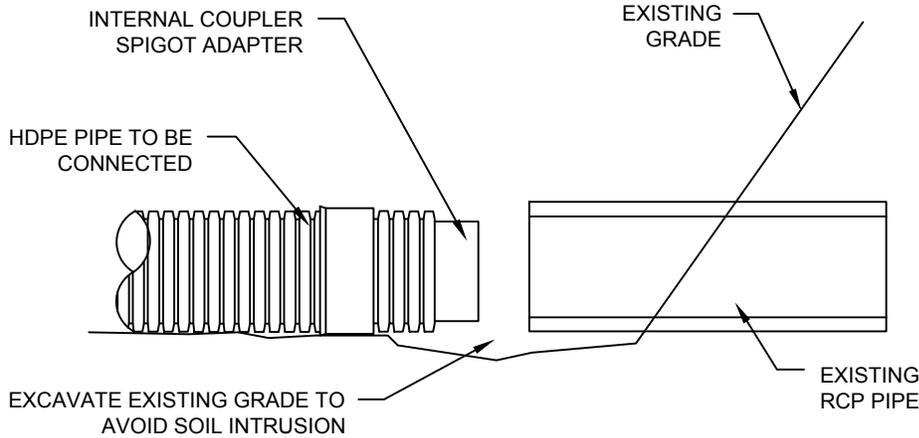

CITY OF WATFORD CITY, NORTH DAKOTA
PUBLIC WORKS DEPARTMENT

HDPE TO REINFORCED CONCRETE
PIPE CONNECTION DETAIL

APPROVED FOR PUBLICATION

DWG. NO.

802-2

City Engineer

Date