

VICINITY MAP


TOPOGRAPHIC SURVEY
PORTIONS OF LOT 7 & LOT 8
BLOCK 34
EASTERN ADDITION
CITY OF ALBUQUERQUE
BERNALILLO COUNTY, NEW MEXICO
NOVEMBER 2016

SCALE 1"=80'
0 20 40



AVENIDA CESAR CHAVEZ SE

PROJECT BENCHMARK
1+25.541 ELEV. = 5094.10

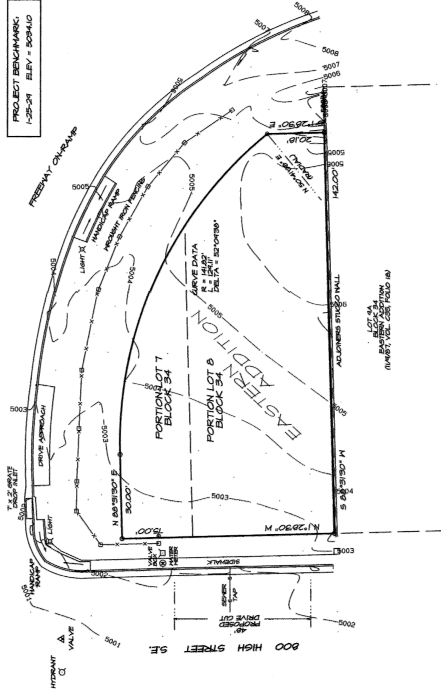

LEGAL DESCRIPTION


BEING PORTIONS OF LOT NUMBERED 68, 69, 70 AND LOT NUMBERED EIGHT, (8) IN BLOCK NUMBERED THIRTY-FOUR (34) OF THE EASTERN ADDITION TO THE CITY OF ALBUQUERQUE, NEW MEXICO, AS THE SAME IS SHOWN AND DESIGNATED ON THE MAP OF SAID ADDITION FILED IN THE OFFICE OF THE PROBATE CLERK AND COUNTY CLERK OF BERNALILLO COUNTY, NEW MEXICO ON MAY 29, 1962, IN BOOK C-1, PAGE 171.

CERTIFICATION

I, MICHAEL T. SHOOK, A REGISTERED PROFESSIONAL SURVEYOR IN THE STATE OF NEW MEXICO, DO HEREBY CERTIFY THAT THIS TOPOGRAPHIC SURVEY IS TRUE AND CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF. THE FIELD WORK AND CALCULATIONS WERE DONE BY ME AND MY ASSISTANT, DIRECT SUPERVISION.

Michael T. Shook
MICHAEL T. SHOOK INELS No. 8240

8/01/16
DATE



ADVANTAGE
SURVEYING
249-1212 OFFICE
249-6833 FAX

LEE GAMESKY ARCHITECTS P.C.

2412 NILES ROAD SE
ALBUQUERQUE, NM 87102
505.263.1000 FAX 505.263.1000
www.lee-gamesky.com

STAR LIMO

Albuquerque, New Mexico

Project No. 11-00000000

Client LEE GAMESKY, AIA

Date 11 November 2016

SURVEY

Sheet No. 02


V-101

LEGEND

	ASPHALT PAVING
	CONCRETE SUB. (SEE GENERAL NOTES) KEYED NOTES.
	COMPACTED AGGREGATE BASE COURSE AND GRAVEL
	SLOPE / DIRECTION OF DRAINAGE
	CRUSHED GRAVEL LANDSCAPE
	LANDSCAPE PLANTING. SEE SHEET C-101



ZONE LOCATION MAP | -14-7

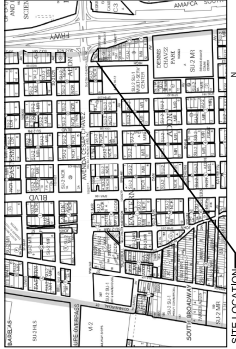
$$z \in \mathbb{C}$$

ZONING
THE PROJECT SITE IS ZONED SLL2 / NCR

ZONING
THE PROJECT SITE IS ZONED SLL2 / NCR

GENERAL NOTES


- A. AT NEW ASPHALT PAVING AREAS: MAXIMUM GRADES NOT TO EXCEED 8% IN PARKING AREAS.
- B. THERE ARE NO EXISTING BUILDINGS ON SITE.

[illegible]


AVENIDA CESAR CHAVEZ SE
ROW VARIES

CESAR
ROW VARIES

CESAR
ROW VARIES

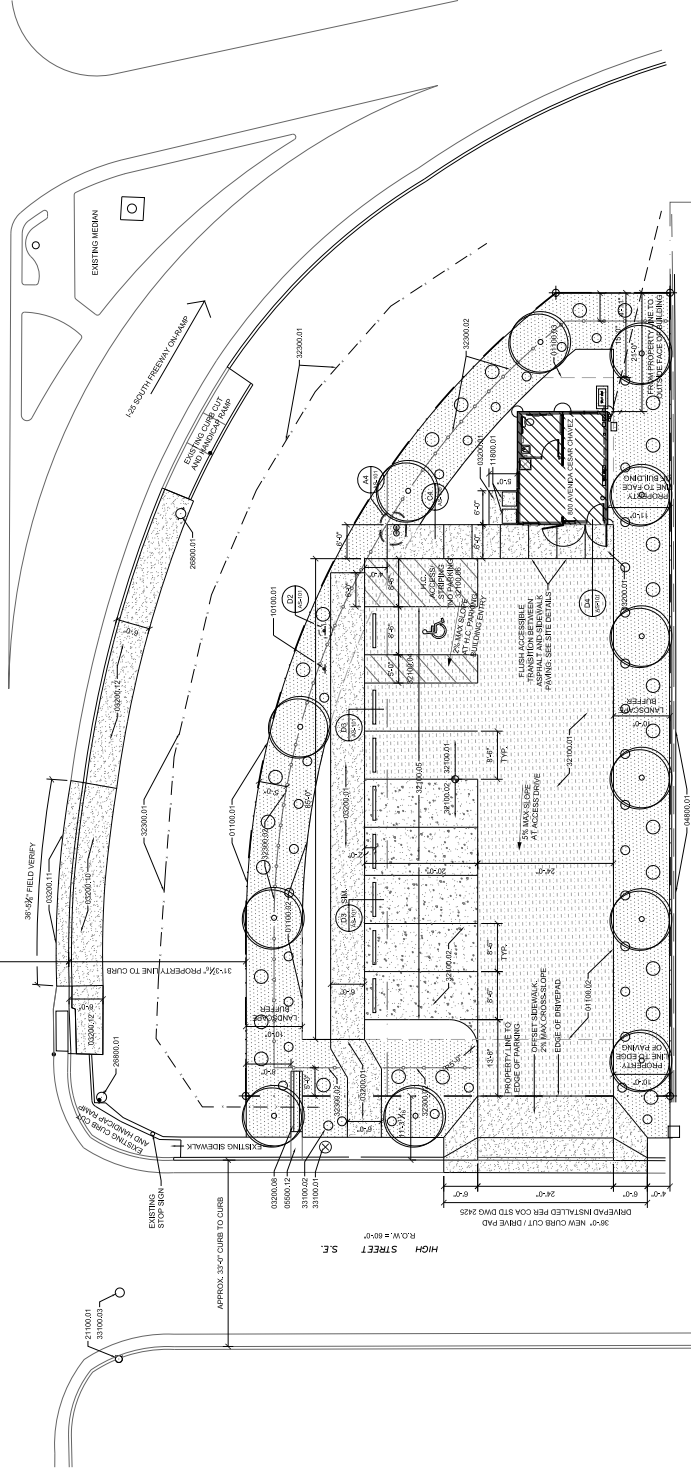[illegible]

A1 TRAFFIC CIRCULATION LAYOUT PLAN
1" = 10'-0"



STABI IMC

QUALITY ASSURED

Abuquerque, New Mexico

PROJECT ARCHITECT:
LEE GAMESLKY, AIA

LEE GAVRIELSON, AKA


By:	Sheet:	Of:
File:	TCL	

- BUILDING IS 320 SF
- SINGLE STORY
- NOT FIRE SPRINKLED
- TOP OF BUILDING STRUCTURE IS AT 9'-0" A.F.F.

GENERAL NOTES


- A. ALL FIRE DETECTORS NOT REQUIRED AS THERE IS NO DUCTWORK.
- B. SEE SHEET A-01 FOR EGRESS HARDWARE ON DOORS.

AVENIDA CESAR CHAVEZ SE

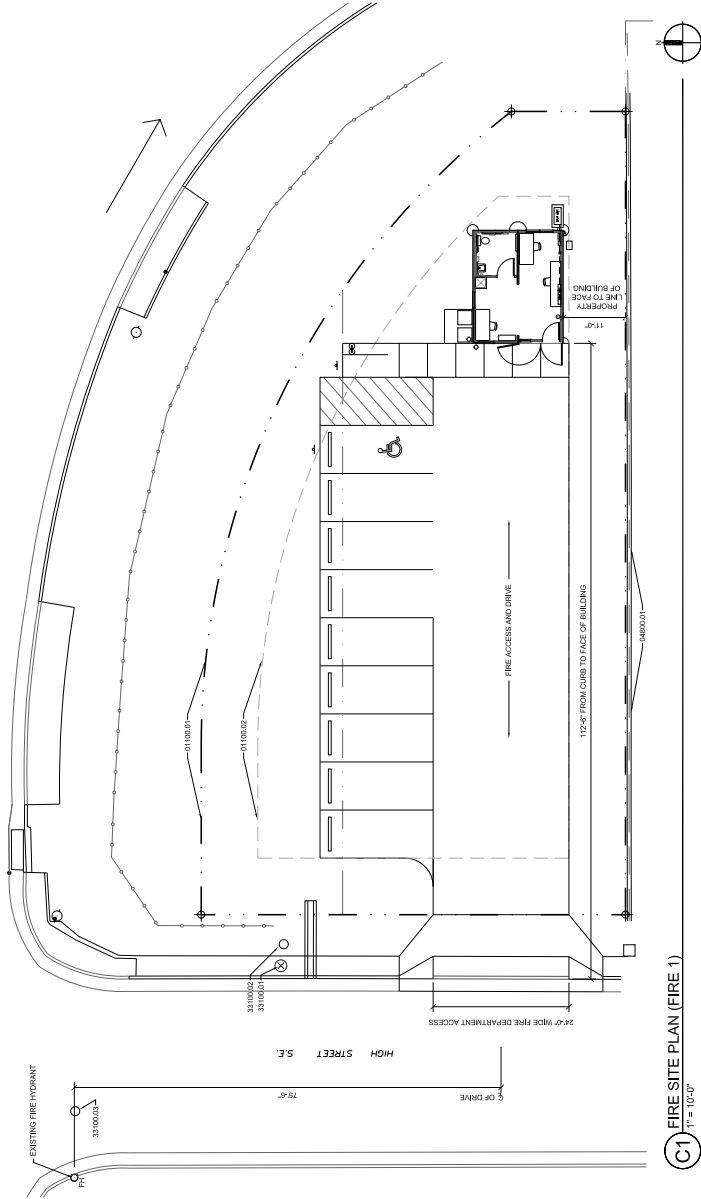

C1 FIRE SITE PLAN (FIRE 1)

1" = 10'-0"

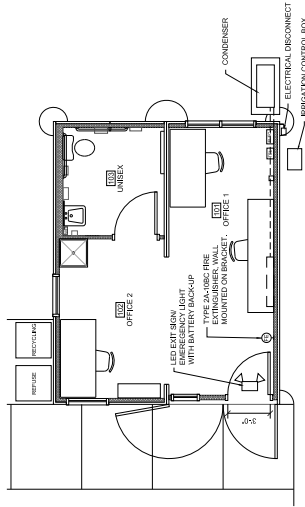

A1 FIRE FLOOR PLAN (FIRE 2)

1/4" = 1'-0"



A2 FIRE HYDRANT LOCATIONS

N.T.S.


CODE DATA

ADDRESS: 800 AVENIDA CESAR CHAVEZ SE
CONSTRUCTION TYPE: TYPE VB, NOT FIRE SPRINKLED
OCCUPANT LOAD: 4 OCCUPANTS
BUILDING AREA: 320 GROSS SQUARE FEET

LEGEND

KEYED NOTES

- 01100.01 LINE INDICATES LOCATION OF PROPERTY LINE (SEE SURVEY).
- 01100.02 LINE INDICATES LOCATION OF FIRE DEPARTMENT ACCESS.
- 0400.01 EXISTING 6" HIGH SOLID SITE WALL.
- 31100.01 EXISTING WATER METER TO REMAIN.
- 31100.02 EXISTING WATER METER TO REMAIN.
- 31100.03 EXISTING WATER VALVE TO REMAIN.



STAR LIMO

Illustrations: Alex H. Lim
Project #: 24-001-00
Date: 11 November 2024
LEE GAMELSKY, AIA

FIRE SITE PLAN AND FIRE FLOOR PLAN

Rev: _____ Date: _____
Fire: _____



- BUILDING IS 320 SF
- SINGLE STORY
- NOT FIRE SPRINKLED
- TOP OF BUILDING STRUCTURE IS AT 9'-0" A.F.F.

GENERAL NOTES

- A. ALL ELECTRICAL DETECTORS NOT REQUIRED AS THERE IS NO DUCTWORK.
- B. SEE SHEET A-01 FOR EGRESS HARDWARE ON DOORS.

CODE DATA

ADDRESS: 600 AVENUE CESAR CHAVEZ SE
CONSTRUCTION TYPE: TYPE VB, NOT FIRE SPRINKLED
OCCUPANT LOAD: 4 OCCUPANTS
BUILDING AREA: 320 GROSS SQUARE FEET

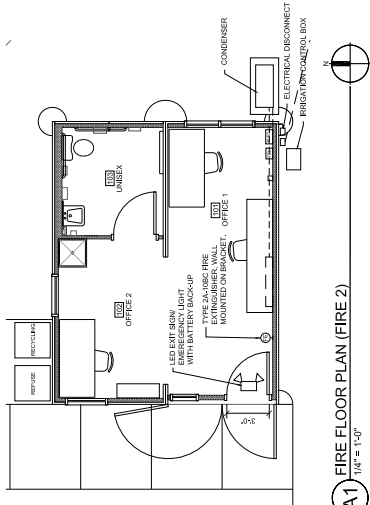

STAR LIMO


Address: New Mexico
City: Albuquerque
State: NM
Zip: 87102
Phone: (505) 261-1234
Fax: (505) 261-1235
Email: lee@lee-gamelsky.com
Website: www.lee-gamelsky.com

FIRE FLOOR PLAN


Rev:	Sheet:
1	2

GENERAL NOTES

- ALL INTERIOR FLOOR PLAN DIMENSIONS ARE TO FACE OF STUD, UNLESS NOTED OTHERWISE.
- HATCHED WALLS (---) INDICATE NEW CONSTRUCTION, WALLS AND WALL FINISHES.
- PROVIDE BLOODING / BACKING BEHIND ALL WALL MOUNTED EQUIPMENT.
- COORDINATE ALL NEW DOOR AND WINDOW OPENING DIMENSIONS WITH THE ARCHITECT. PROVIDE FINISHES AND FINISH SCHEDULE NOTES.
- FOR INFORMATION ONLY, THE CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS TO INSTALL ELECTRICAL, SWITCHES, DEVICES, AND EQUIPMENT LOCATIONS WITH OWNERS REPRESENTATIVE.
- SEE SHEET A-207 FOR BUILDING ELEVATIONS, FINISH AND EQUIPMENT

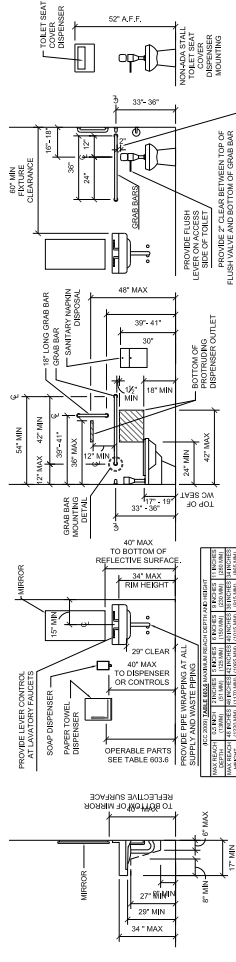


D4 TYPICAL GRAB BAR MOUNTING DETAIL
3" = 1'-0"

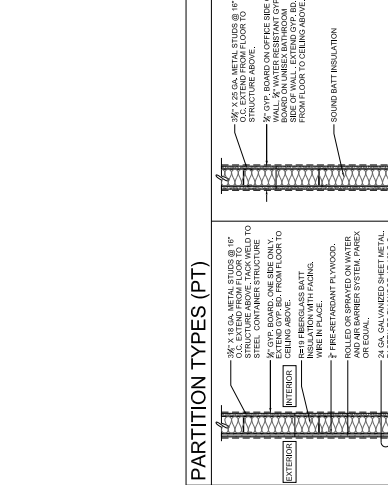

KEYED NOTES


032001.00 2'-0" @ CONCRETE FOOTING.
032001.01 3'-0" @ CONCRETE FOOTING.
051001.01 PAIR OF 3" X 1/4" STEEL ANGLES CONTINUOUSLY WELDED AT HEAD OF CONTAINER STRUCTURE CUT OPENING.
051001.02 PROVIDE STEEL CHANNEL WELDED CONTINUOUSLY FROM FLOOR TO HEADER ALONG EDGE OF WALL AT CUT OPENING IN CONTAINER.
051001.03 PROVIDE STEEL CHANNEL WELDED CONTINUOUSLY FROM FLOOR TO STRUCTURE, GRIND SMOOTH ALL EDGES.
064001.01 3.567" H. GAL. METAL THICK. TACK WELD TO CONTAINER WALL.
065001.02 INSTALL WITH OUTSIDE FACE 3" FROM INSIDE FACE OF CONTAINER WALL.
065001.03 3/16" X 5/8" WIDE DRAIN WELD FROM INSIDE FACE OF ROOF BEAM

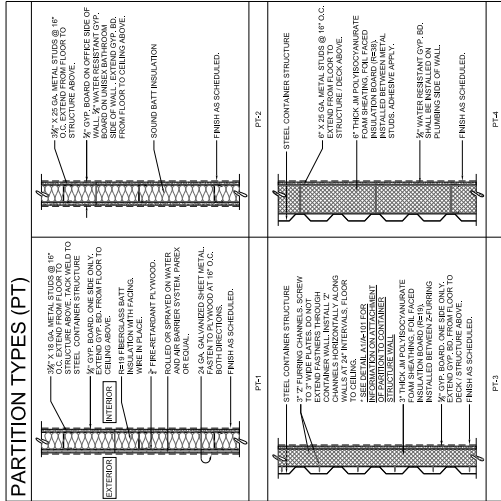

FOUNDATION PLAN DETAIL



PARTITION SCHEDULE



A2 TYPICAL DOOR HEAD/JAMB SIM. DETAIL



A. CONTRACTOR IS RESPONSIBLE FOR ALL STATE AND LOCAL PERMITS AND SUBMITTAL REQUIREMENTS. THIS INCLUDES BUT IS NOT LIMITED TO STRUCTURAL, ELECTRICAL, MECHANICAL AND UTILITY HOOK-UPS. CONTRACTOR IS RESPONSIBLE FOR FOLLOWING GUIDELINES SET FORTH IN THE 2009 IBC, ANSI H117-1:2009 AND LOCAL CODES FOR BERNALILLO COUNTY.

B. ELECTRICAL WIRING METHODS AND MATERIALS SHALL MEET THE PROVISIONS OF THE 2009 NATIONAL ELECTRICAL CODE, THE 2009 NEW MEXICO ELECTRICAL CODE AND OTHER APPLICABLE CODES AND STANDARDS.

C. PLUMBING SHALL MEET ALL PROVISIONS OF THE 2009 NATIONAL PLUMBING CODE, THE 2009 NEW MEXICO PLUMBING CODE, THE 2009 NEW MEXICO MECHANICAL CODE, THE 2009 NEW MEXICO MECHANICAL CODE AND OTHER APPLICABLE CODES AND STANDARDS.

23400.02 DAKIN MINI SPLIT OUTDOOR UNIT, MODEL NO. RXS24VJ.U, SEE MECH./ELEC. DRAWINGS

23400.03 DAKIN MINI SPLIT INDOOR UNIT, MODEL NO. FTXS24VJ.U, LOCATE INDOOR MINI SPLIT UNIT ON WALL WITH BOTTOM OF UNIT AT 7'-0" A.F.F MIN. SEE MECH./ELEC. DRAWINGS.

20200.02 ELECTRICAL DISCONNECT BOX (FOR MECH. UNIT).

 EXTERIOR WALL MOUNT LIGHT FIXTURE.
 2 X 7 RECESSED LED TROFFER, DIMENSION: 25.58" X 25.58" X 3.34", 3500K COOL TEMP. MANUFACTURED BY ECOLIGHT.
 MODEL: E7-TR022380.

 EMERGENCY LIGHT

 ELECTRICAL PANEL

 SINGLE SWITCH

 LED LIGHT (EMERGENCY LIGHT WITH BATTERY BACKUP, ECOLIGHT SKU: E7-TR022380 OR EQUAL)

ITEM	DESCRIPTION	MANUFACTURER (OR EQUAL)	FITTINGS	ROUGH SCHEDULE CUT HW	TDW	Y	REMARKS
MB-1	COMPOSITE LAUNDRY TUB	MUSTER 20 X 30	FAUCET INCLUSIVE	1/2"	1/2"	1"	FURNISH WITH ALL FITTINGS FOR A COMPLETE OPERATIONAL SYSTEM.
WC-1	FLOOR MOUNTED ELONGATED FLUSH-ASSET WATER CLOSET (ADA)	MAGNIA CONCEALED ASSEMBLY HEBET	COMPLETE ASSEMBLY	1/2"	1/2"	2"	2" EPA WATER SENSE TOILET.
LV-1	ADA WALL MOUNTED WITH MANUAL LEVERS LAUNDRATORY / PBK03 WASHING FAUCET SUPPORT	AMERICAN STANDARD MODEL B221 LAUNDRATORY / PBK03 WASHING FAUCET SUPPORT	KOEN MODEL B221	1/2"	1/2"	2"	ADA COMPLIANT WALL MOUNTED LAUNDRATORY WITH MANUAL LEVERS. CONCEALED ADA SUPPORT. WALL HANG CARRIERS: TOMBALOGA

TYPE	QTY	WATTS/TOTAL
110 OUTLETS	7	180 / 1260
220 OUTLETS	1	360
GFIC OUTLETS	1	180
LED TROFFERS	4	38 / 152
EMERGENCY EXIT	1	0.8
EXT. EMERGENCY LIGHT	1	2.8
MINI-SPLIT INDOOR	1	2,210
WATER HEATER	1	4,100
EXHAUST FAN	1	640
TOTAL WATTS /AMPS		8905.6

Section 1: Project Information

Albuquerque, New Mexico
4b
8%

Flood Area
320

Building Use: Active Typing
Office space (Office) - Nonresidential


percentage F&B, Design: 4% worse than code.

[illegible]

1. All joints and penetrations are caulked, gasketed or covered with a moisture vapor-permeable wrapping material installed in accordance with the manufacturer's installation instructions.
2. Windows, doors, and skylights certified as meeting leakage requirements.
3. Component R-values & U-factors labeled as certified.
4. No roof insulation is installed on a suspended ceiling with removable ceiling panels.


Project Title: Star Limo
 Project Location: Star Limo
 Project File Name: P:\Comet Projects\STAR LIMO\DRAWINGS\CONSTRUCTION DOCUMENT DRAWINGS\Star Limo Envelope
 Report Date: 11/14/18
 Page 1 of 2

Project Title: Star Lino
Data filename: P:\Current Projects\STAR LINO\DRAWINGS\CONSTRUCTION DOCUMENT DRAWINGS\Star Lino Envelope certificate.ccd
Report date: 11/14/18
Page 2 of 2



PANEL NUMBER	MAIN:	200 A	1 PH 3 W	60HZ
	VOLTAGE:	240 V		
	NEUTRAL:	100 % OF MAIN BUS RATING		
	INTERTRIPPING:	10 KAIC		

CKT #	LOAD DESCRIPTION	LOADS (VA)			LOADS (VA)			BKR	LOAD DESCRIPTION	CKT #
		AMP	P	H	AMP	P	H			
1	OUTDOOR LIGHTS	360			20	1	20		OFFICE RECEPTACLES 1	2
3	INDOOR OFFICE LIGHTS	360			20	1	20		OFFICE RECEPTACLES 2	4
5	INDOOR UNLESS LIGHT	120			20	1	20		INBOX GFCI RECEPTACLE	6
7	EMERGENCY EXIT LIGHT	120			20	1	20		INDOOR MINI SPLIT UNIT	8
9					20	1	20		INDOOR MINI SPLIT UNIT	10
11					20	2	20		OUTDOOR MINI SPLIT UNIT	12
13					20	2	20		OUTDOOR MINI SPLIT UNIT	14
15					20	2	20		ON DEMAND WATER HEATER	16
17	ELECTRIC BASEBOARD HEATER	220			20	2	20		ON DEMAND WATER HEATER	18
19	ELECTRIC BASEBOARD HEATER				20	20	20		EXHAUST FAN	20

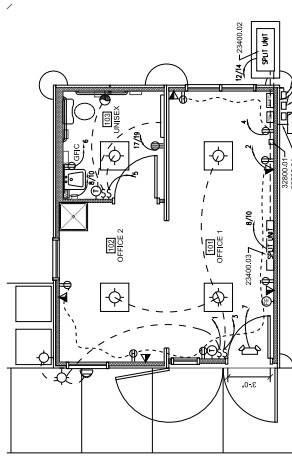

A. CONTRACTOR IS RESPONSIBLE FOR ALL STATE AND LOCAL PERMITS AND SUBMITTAL REQUIREMENTS. THIS INCLUDES BUT IS NOT LIMITED TO STRUCTURAL, ELECTRICAL, MECHANICAL AND UTILITY HOOK-UPS. CONTRACTOR IS RESPONSIBLE FOR FOLLOWING GUIDELINES SET FORTH IN THE 2009 IBC, ANSI H117-12000 AND LOCAL CODES FOR BERNALILLO COUNTY.

B. ELECTRICAL WIRING METHODS AND MATERIALS SHALL MEET THE PROVISIONS OF THE 2009 NATIONAL ELECTRICAL CODE AND THE 2009 NEW MEXICO ELECTRICAL CODE AND OTHER APPLICABLE CODES AND STANDARDS.

C. PLUMBING SHALL MEET ALL PROVISIONS OF THE 2009 NATIONAL PLUMBING CODE, 2009 NEW MEXICO PLUMBING CODE, THE 2009 NEW MEXICO PLUMBING AND MECHANICAL CODE AND OTHER APPLICABLE CODES AND STANDARDS.

23400.02 DAKIN MINI SPLIT OUTDOOR UNIT, MODEL NO. RXS24VJ.U, SEE MECH./ELEC. DRAWINGS

23400.03 DAKIN MINI SPLIT INDOOR UNIT, MODEL NO. FTXS24VJ.U, LOCATE INDOOR MINI SPLIT UNIT ON WALL WITH BOTTOM OF UNIT AT 7'-0" A.F.F MIN. SEE MECH./ELEC. DRAWINGS.

20200.02 ELECTRICAL DISCONNECT BOX (FOR MECH. UNIT).

 EXTERIOR WALL MOUNT LIGHT FIXTURE.
 2 X 7 RECESSED LED TROFFER, DIMENSION: 25.58" X 25.58" X 3.34", 3500K COOL TEMP. MANUFACTURED BY ECOLIGHT.
 MODEL: E7-TR020350.

 EMERGENCY LIGHT

 ELECTRICAL PANEL

 SINGLE SWITCH

 LED LIGHT (EMERGENCY LIGHT WITH BATTERY BACKUP, ECOLIGHT SKU: E4GL09R OR EQUAL)

ITEM	DESCRIPTION	MANUFACTURER (OR EQUAL)	FITTINGS	ROUGH SCHEDULE CUT HW	TDW	Y	REMARKS
MB-1	COMPOSITE LAUNDRY TUB	MUSTER 20 X 30	FAUCET INCLUSIVE	1/2"	1/2"	1"	FURNISH WITH ALL FITTINGS FOR A COMPLETE OPERATIONAL SYSTEM.
WC-1	FLOOR MOUNTED ELONGATED FLUSH-ASSET WATER CLOSET (ADA)	MAGNIA CONCEALED ASSEMBLY	COMPLETE ASSEMBLY HEBET	1/2"	1/2"	2"	2" EPA WATER SENSE TOILET.
LV-1	ADA WALL MOUNTED WITH MANUAL LEVERS LAUNDRATORY / PBK003 WASHING FAUCET SUPPORT	AMERICAN STANDARD MODEL B221 LAUNDRATORY / PBK003 WASHING FAUCET SUPPORT	KOEN MODEL B221	1/2"	1/2"	2"	ADA COMPLIANT WALL MOUNTED LAUNDRATORY WITH MANUAL LEVERS. CONCEALED ADA SUPPORT. WALL HANG CARRIERS: TOMBALOGA

TYPE	QTY	WATTS/TOTAL
110 OUTLETS	7	180 / 1260
220 OUTLETS	1	360
GFIC OUTLETS	1	180
LED TROFFERS	4	38 / 152
EMERGENCY EXIT	1	0.8
EXT. EMERGENCY LIGHT	1	2.8
MINI-SPLIT INDOOR	1	2,210
WATER HEATER	1	4,100
EXHAUST FAN	1	640
TOTAL WATTS /AMPS		8905.6

Section 1: Project Information

Albuquerque, New Mexico
4b
8%

Flood Area
320


percentage FMI's. Design-4% worse than code.

[illegible]

1. All joints and penetrations are caulked, gasketed or covered with a moisture vapor-permeable wrapping material installed in accordance with the manufacturer's installation instructions.
2. Windows, doors, and skylights certified as meeting leakage requirements.
3. Component R-values & U-factors labeled as certified.
4. No roof insulation is installed on a suspended ceiling with removable ceiling panels.


Project Title: Star Limo
 File Name: P:\Comet Projects\STAR LIMO\DRAWINGS\CONSTRUCTION DOCUMENT DRAWINGS\Star Limo Envelope
 Report date: 11/14/18
 Page 1 of 2

Project Title: Star Lino
Data filename: P:\Current Projects\STAR LINO\DRAWINGS\CONSTRUCTION DOCUMENT DRAWINGS\Star Lino Envelope certificate.ccd
Report date: 11/14/18
Page 2 of 2



PANEL NUMBER	MAIN:	200 A	1 PH 3 W	60HZ
	VOLTAGE:	240 Y		
	NEUTRAL:	100 % OF MAIN BUS RATING		
	INTERTRIPPING:	10 KAIC		

CKT #	LOAD DESCRIPTION	LOADS (VA)			LOADS (VA)			BKR	LOAD DESCRIPTION	LOADS (VA)	BKR	LOAD DESCRIPTION	CKT #
		AMP	P	H	AMP	P	H						
1	OUTDOOR LIGHTS	360			20	1	20	1	600			OFFICE RECEPTACLES 1	2
3	INDOOR OFFICE LIGHTS	360			20	1	20	1	240			OFFICE RECEPTACLES 2	4
5	INDOOR UNLESS LIGHT	120			20	1	20	1	120			INBOX GFCI RECEPTACLE	6
7	EMERGENCY EXIT LIGHT	120			20	1	20	2	208			INDOOR MINI SPLIT UNIT	8
9					20		20					INDOOR MINI SPLIT UNIT	10
11					20		20	2	208			OUTDOOR MINI SPLIT UNIT	12
13					20		20	2				OUTDOOR MINI SPLIT UNIT	14
15					20		20	2	208			ON DEMAND WATER HEATER	16
17	ELECTRIC BASEBOARD HEATER	220			20	2	20					ON DEMAND WATER HEATER	18
19	ELECTRIC BASEBOARD HEATER				20		20	1	120			EXHAUST FAN	20

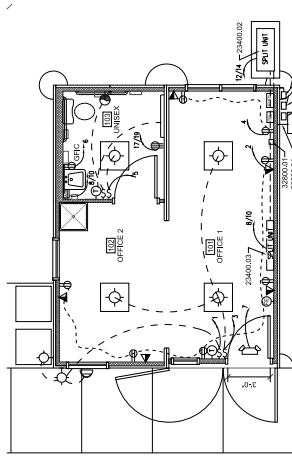[illegible]

	LEE GAMELSKY ARCHITECTS P.A. 240 N. HILLS BLVD. E. SUITE 200 LOS ANGELES, CA 90012 TEL: 323.442.0007 FAX: 323.442.1009 www.lee-gamelsky.com	STATE OF CALIFORNIA I, LEE D. GAMELSKY No. 1931 REGISTERED	Project # 14-0437 Date: 23 January 2017	Sheet: 002 EP-101
LEE GAMELSKY ARCHITECTS P.A.		STAR LIMO Alhambra, New Mexico PROJECT ARCHITECT: LEE GAMELSKY, AIA ELECTRICAL / PLUMBING DRAWINGS		
BY: _____ Title: _____	_____			



COMcheck Software Version 4.0.5.1

Envelope Compliance Certificate

Section 1: Project Information

Energy Code: **2009 IECC**

Project Title: Star Limo

Project Type: New Construction

Construction Site:

800 Avenida Cesar Chavez
Albuquerque, NM 87102

Owner/Agent:

Albuquerque, New Mexico

Designer/Contractor:

Building Location (for weather data):

Climate Zone:

4b

Vertical Glazing / Wall Area Pct.:

8%

Building Use: Activity Type(s)

Floor Area

1-office space (Office) : Nonresidential

320

Section 2: Envelope Assemblies and Requirements Checklist

Envelope FAILS: Design 4% worse than code.

Envelope Assemblies:

Component Name/Description	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U-Factor ^(a)
Roof 1: Metal Building, Standing Seam, [Bldg. Use 1 - office space]	320	38.0	0.0	0.046	0.055
Exterior Wall 1: Metal Building Wall, Single Layer Mineral Fiber, [Bldg. Use 1 - office space]	190	19.0	0.0	0.113	0.084
Exterior Wall 2: Metal Building Wall, Single Layer Mineral Fiber, [Bldg. Use 1 - office space]	152	19.0	0.0	0.113	0.084
Window 1: Vinyl/Fiberglass Frame, Perf. Type: Energy code default, Double Pane with Low-E, Clear, SHGC 0.70, [Bldg. Use 1 - office space]	8	---	---	0.550	0.400
Window 2: Vinyl/Fiberglass Frame, Perf. Type: Energy code default, Double Pane with Low-E, Clear, SHGC 0.70, [Bldg. Use 1 - office space]	12	---	---	0.550	0.400
Door 1: Insulated Metal, Swinging, [Bldg. Use 1 - office space]	21	---	---	0.500	0.700
Exterior Wall 3: Metal Building Wall, Single Layer Mineral Fiber, [Bldg. Use 1 - office space]	190	19.0	0.0	0.113	0.084
Window 2 copy 1: Vinyl/Fiberglass Frame, Perf. Type: Energy code default, Double Pane with Low-E, Clear, SHGC 0.70, [Bldg. Use 1 - office space]	12	---	---	0.550	0.400
Exterior Wall 4: Metal Building Wall, Single Layer Mineral Fiber, [Bldg. Use 1 - office space]	152	19.0	0.0	0.113	0.084
Window 4: Vinyl/Fiberglass Frame, Perf. Type: Energy code default, Double Pane with Low-E, Clear, SHGC 0.70, [Bldg. Use 1 - office space]	20	---	---	0.550	0.400

(a) Budget U-factors are used for software baseline calculations ONLY, and are not code requirements.

Air Leakage, Component Certification, and Vapor Retarder Requirements:

- ☐ 1. All joints and penetrations are caulked, gasketed or covered with a moisture vapor-permeable wrapping material installed in accordance with the manufacturer's installation instructions.
- ☐ 2. Windows, doors, and skylights certified as meeting leakage requirements.
- ☐ 3. Component R-values & U-factors labeled as certified.
- ☐ 4. No roof insulation is installed on a suspended ceiling with removable ceiling panels.

- ☐ 5. 'Other' components have supporting documentation for proposed U-Factors.
- ☐ 6. Insulation installed according to manufacturer's instructions, in substantial contact with the surface being insulated, and in a manner that achieves the rated R-value without compressing the insulation.
- ☐ 7. Stair, elevator shaft vents, and other outdoor air intake and exhaust openings in the building envelope are equipped with motorized dampers.
- ☐ 8. Cargo doors and loading dock doors are weather sealed.
- ☐ 9. Recessed lighting fixtures installed in the building envelope are Type IC rated as meeting ASTM E283, are sealed with gasket or caulk.
- ☐ 10. Building entrance doors have a vestibule equipped with self-closing devices.

Exceptions:

- ☐ Building entrances with revolving doors.
- ☐ Doors not intended to be used as a building entrance.
- ☐ Doors that open directly from a space less than 3000 sq. ft. in area.
- ☐ Doors used primarily to facilitate vehicular movement or materials handling and adjacent personnel doors.
- ☐ Doors opening directly from a sleeping/dwelling unit.