


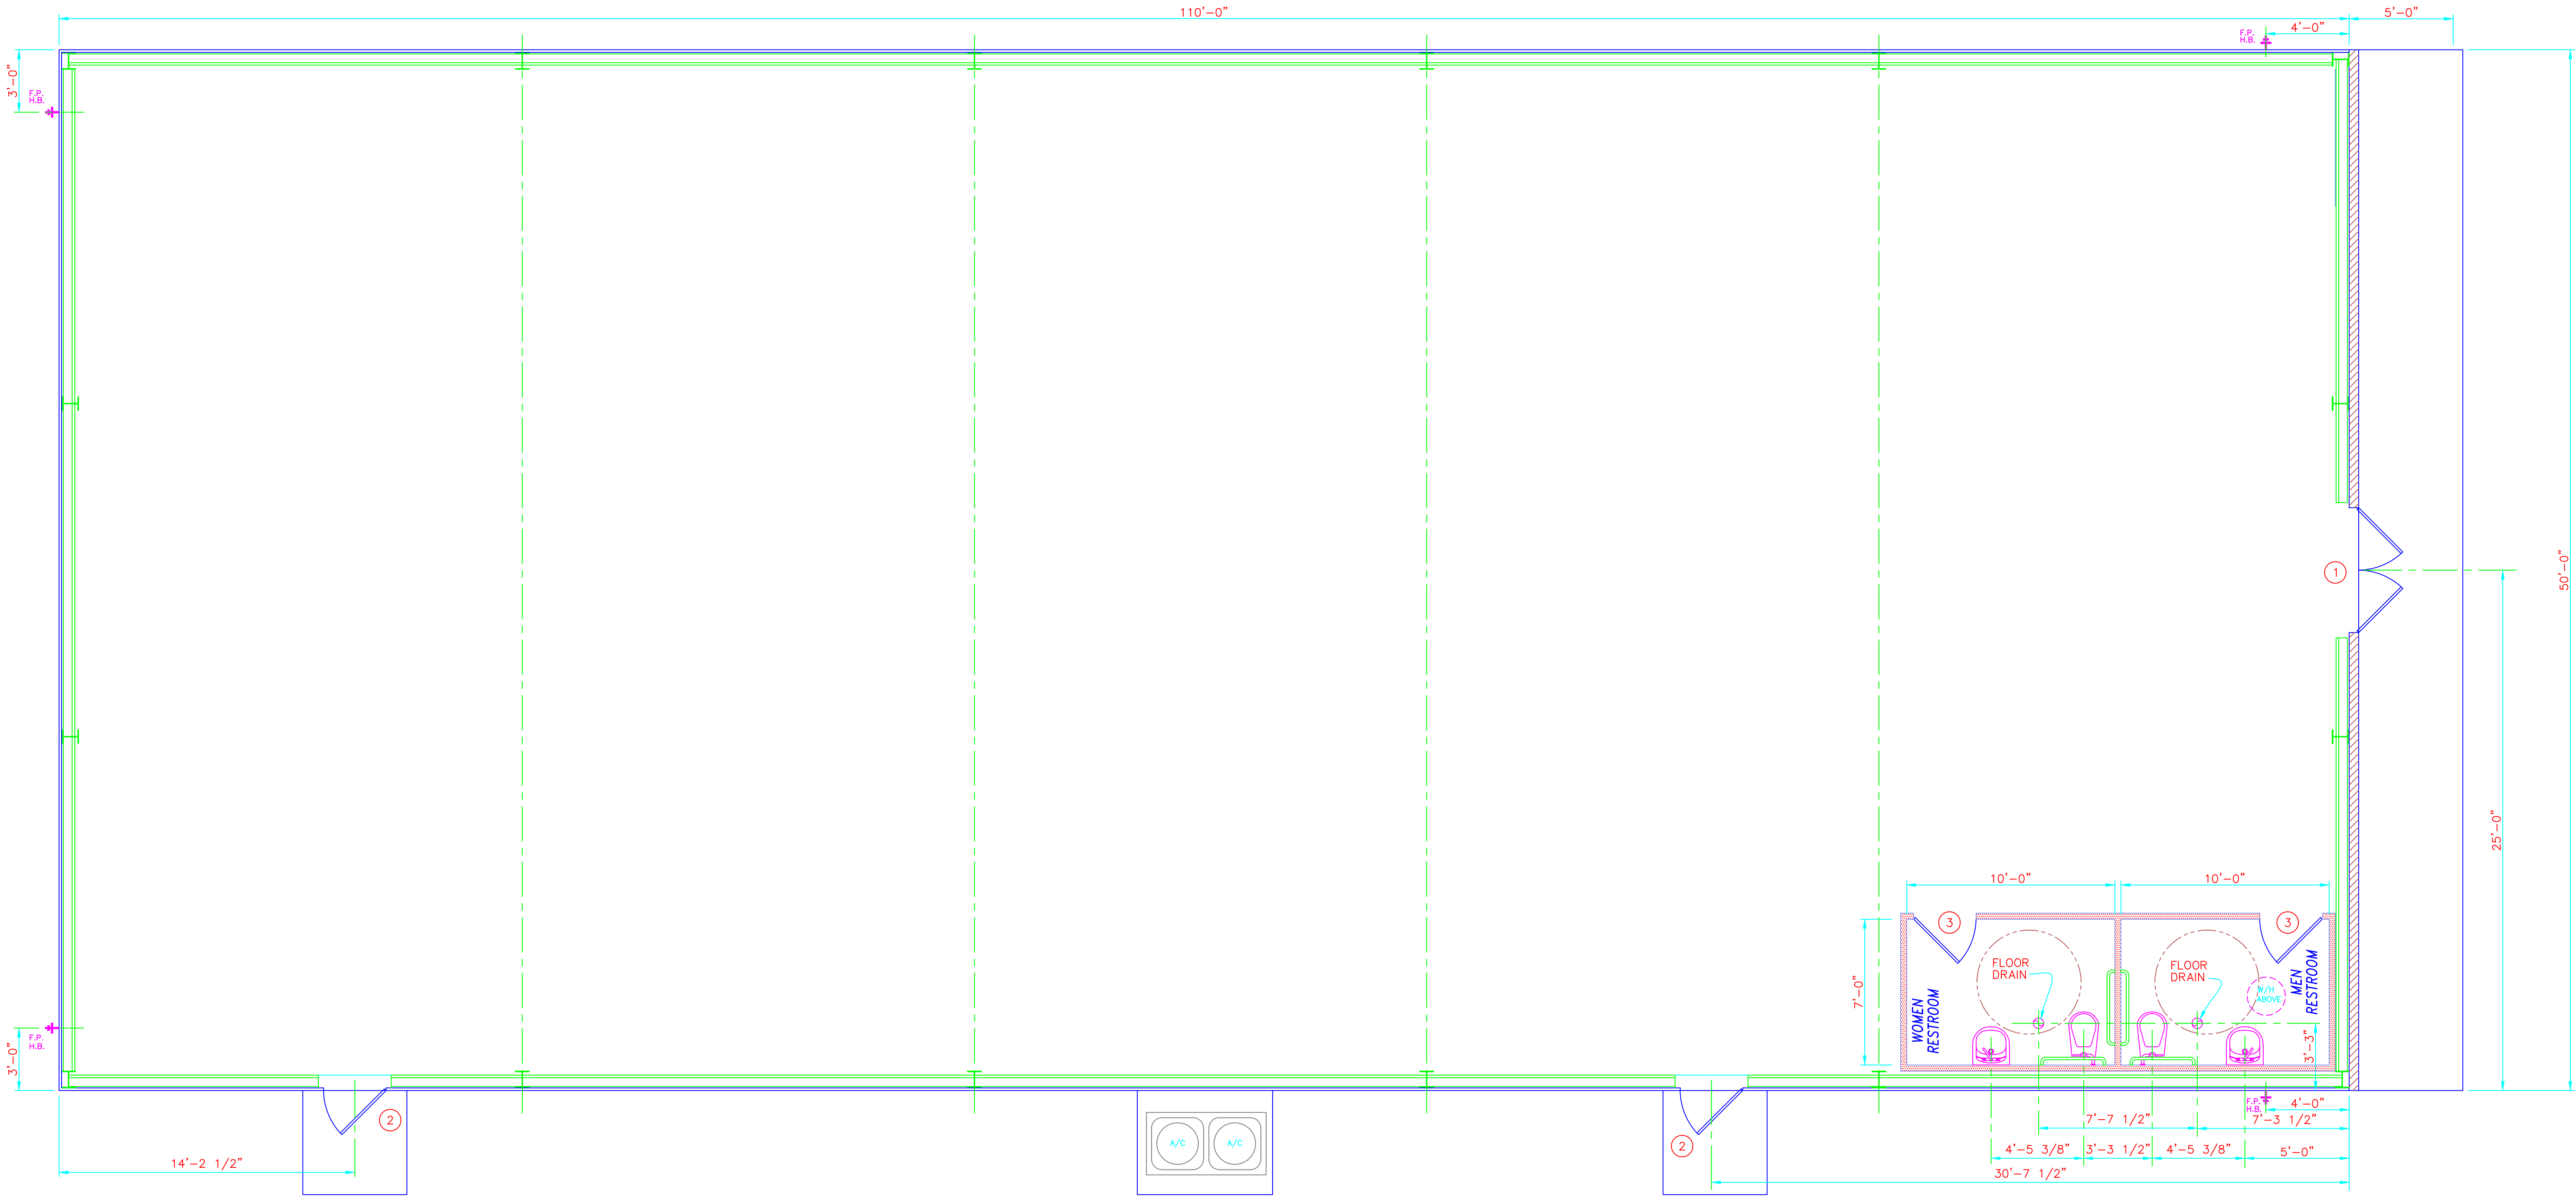

HARDWARE GROUPS:

HDW #1 PANIC BAR PUSH OPEN CLOSER	HDW #2 KEY LOCK MUTES DEAD BOLT - SINGLE CYL. CLOSER	HDW #5 PANIC BAR MUTES CLOSER
--	---	---

HARDWARE NOTES:

ALL HANDLES, LOCKSETS & DEAD BOLT OVERRIDES TO BE "ADA" APPROVED (LEVER-ARM HANDLES TYPICAL). ALL HARDWARE TO MEET ALL STATE & LOCAL CODES INCLUDING "ADA" NATIONAL CODES.


DOOR SCHEDULE

MARK	DESCRIPTION	FRAME	HDW
1	PAIR, 3-0 x 7-0 x 1 3/4", ALUM. GLASS	ALUM.	1
2	3-0 x 6-8 x 1 3/4", H.M.	H.M.	2
3	3-0 x 6-8 x 1 3/4", S.C. WOOD - STAIN GRADE	WOOD - PAINTED	5

* DOOR FRAMES & CASINGS TO BE WOOD AT ALL INTERIOR DOORS

ROOM FINISH SCHEDULE

ROOM NAME	FLOOR	BASE	WALLS	DOOR SIGN	CEILING	CLG. HT.
WOMEN	VCT	VINYL	PAINTED	WOMEN	2x4 LAYIN	9'-0"
MEN	VCT	VINYL	PAINTED	MEN	2x4 LAYIN	9'-0"

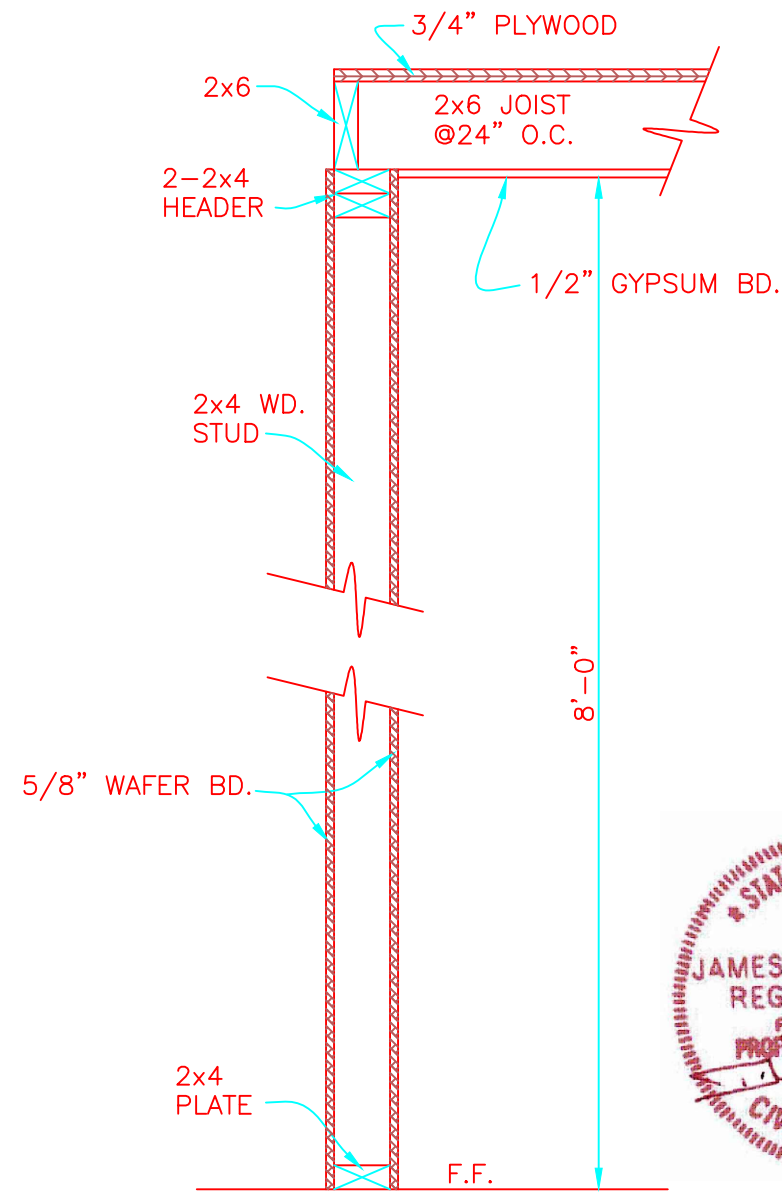

TYP. INTERIOR WALL

GENERAL NOTES:

- THESE DRAWINGS REPRESENT, TO THE BEST OF OUR KNOWLEDGE, THE EXISTING CONDITIONS OF THE PROJECT SITE/BUILDING. SHOULD UNEXPECTED CONDITIONS BE ENCOUNTERED, NOTIFY ARCHITECTS' OFFICE FOR INSTRUCTIONS ON HOW TO PROCEED.
- CONTRACTOR SHALL COORDINATE w/OWNER FOR THE DESIGN & SELECTION OF LIGHTING & ELECTRICAL FIXTURES. ALL WIRING SHALL BE INSTALLED PER THE NATIONAL ELECTRICAL CODE.
- CONTRACTOR SHALL COORDINATE w/OWNER FOR THE LOCATION OF HVAC DUCT/GRILLS. DESIGN & INSTALLATION SHALL CONFORM TO SHREVEPORT MECHANICAL CODE, NFPA 96 & NFPA 90B.
- PROVIDE PER PLANS WALL MOUNTED FIRE EXTINGUISHERS & WALL MOUNTED BRACKETS IN ACCORDANCE w/NFPA 10. FIRE EXTINGUISHERS TO BE (10 Lb. ABC TYPE) w/STANDARD WALL BRACKETS.
- ALL INTERIOR PARTITIONS SHALL BE 3 5/8" x 20 GA. METAL STUDS @ 16" O.C. w/5/8" GYPSUM BOARD BOTH SIDES. TAPE, FLOAT & FINISH GYPSUM BOARD TO 6" ABOVE CEILING. BRACE WALL TO STRUCTURE ABOVE AS REQUIRED. PROVIDE CORNER & CASING BEADS AT ALL OPENINGS & EXPOSED EDGES.
- MAINTAIN FREE & SAFE PASSAGE TO & FROM BUILDING. PREVENT MOVEMENT OR SETTLEMENT OF STRUCTURES. PROVIDE & PLACE BRACING OR SHORING & BE RESPONSIBLE FOR SAFETY & SUPPORT OF STRUCTURE. ASSUME LIABILITY FOR SUCH MOVEMENT, SETTLEMENT, DAMAGE OR INJURY. CEASE OPERATIONS & NOTIFY THE ARCHITECT IMMEDIATELY IF SAFETY OF STRUCTURE APPEARS TO BE ENDANGERED. TAKE PRECAUTIONS TO PROPERLY SUPPORT STRUCTURE. DO NOT RESUME OPERATIONS UNTIL SAFETY IS RESTORED.
- MECHANICAL, ELECTRICAL & PLUMBING PLANS BY OTHERS. ITEMS RELATED TO THESE PLANS ARE SHOWN ON ARCHITECTURAL PLANS FOR REFERENCE ONLY.
- ALL DIMENSIONS ARE TO FACE OF STUDS.
- MAINTAIN A MINIMUM OF 1'-6" ON THE PULL SIDE OF ALL DOORS (12" MIN. ON THE PUSH SIDE OF ALL DOORS w/A DOOR CLOSER).
- ALL EXIT DOORS TO HAVE "ADA" APPROVED EXIT DEVICES.
- PROVIDE SOLID BLOCKING IN WALLS BEHIND, WALL MOUNTED SINKS, GRAB BARS, ETC.
- PROVIDE "ADA" APPROVED SIGNAGE AT PUBLIC RESTROOMS.