



Pathway for Absence of Cu-IUD / LNG-IUD Threads Pregnancy Test Negative

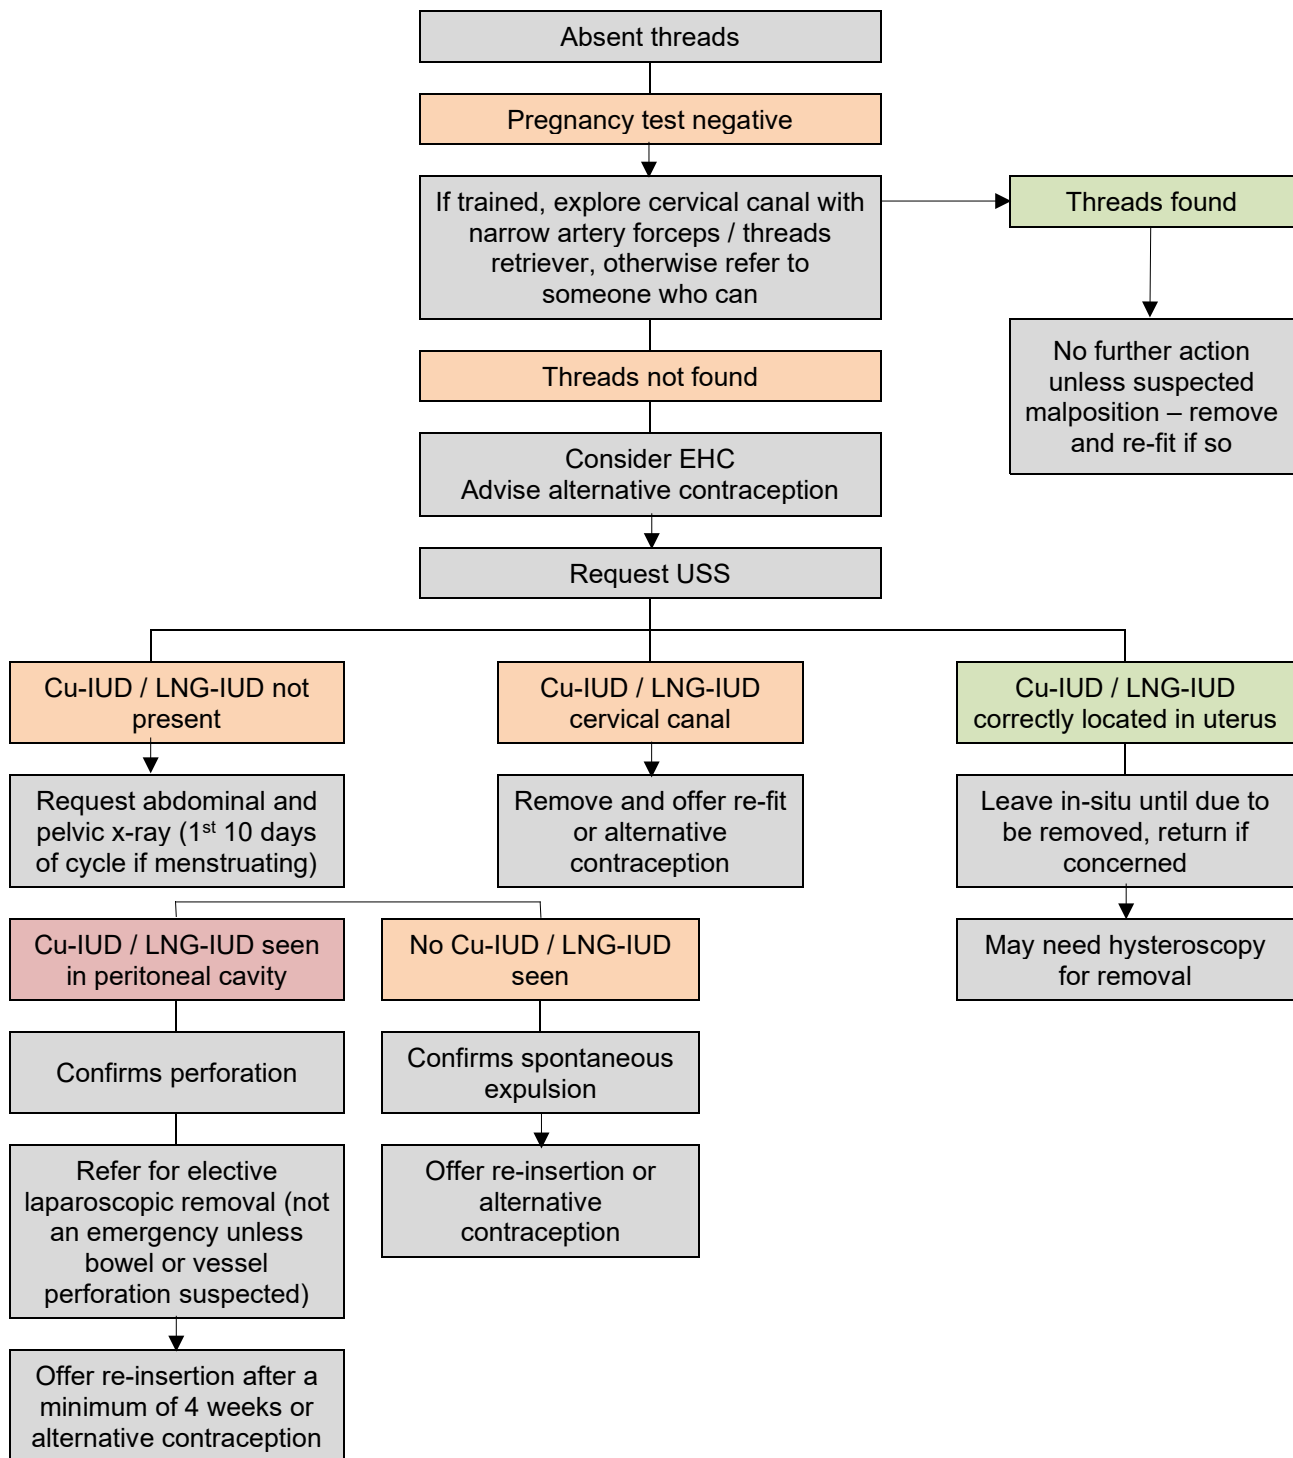

Pathway for Absence of Cu-IUD / LNG-IUD Threads Pregnancy Test Positive

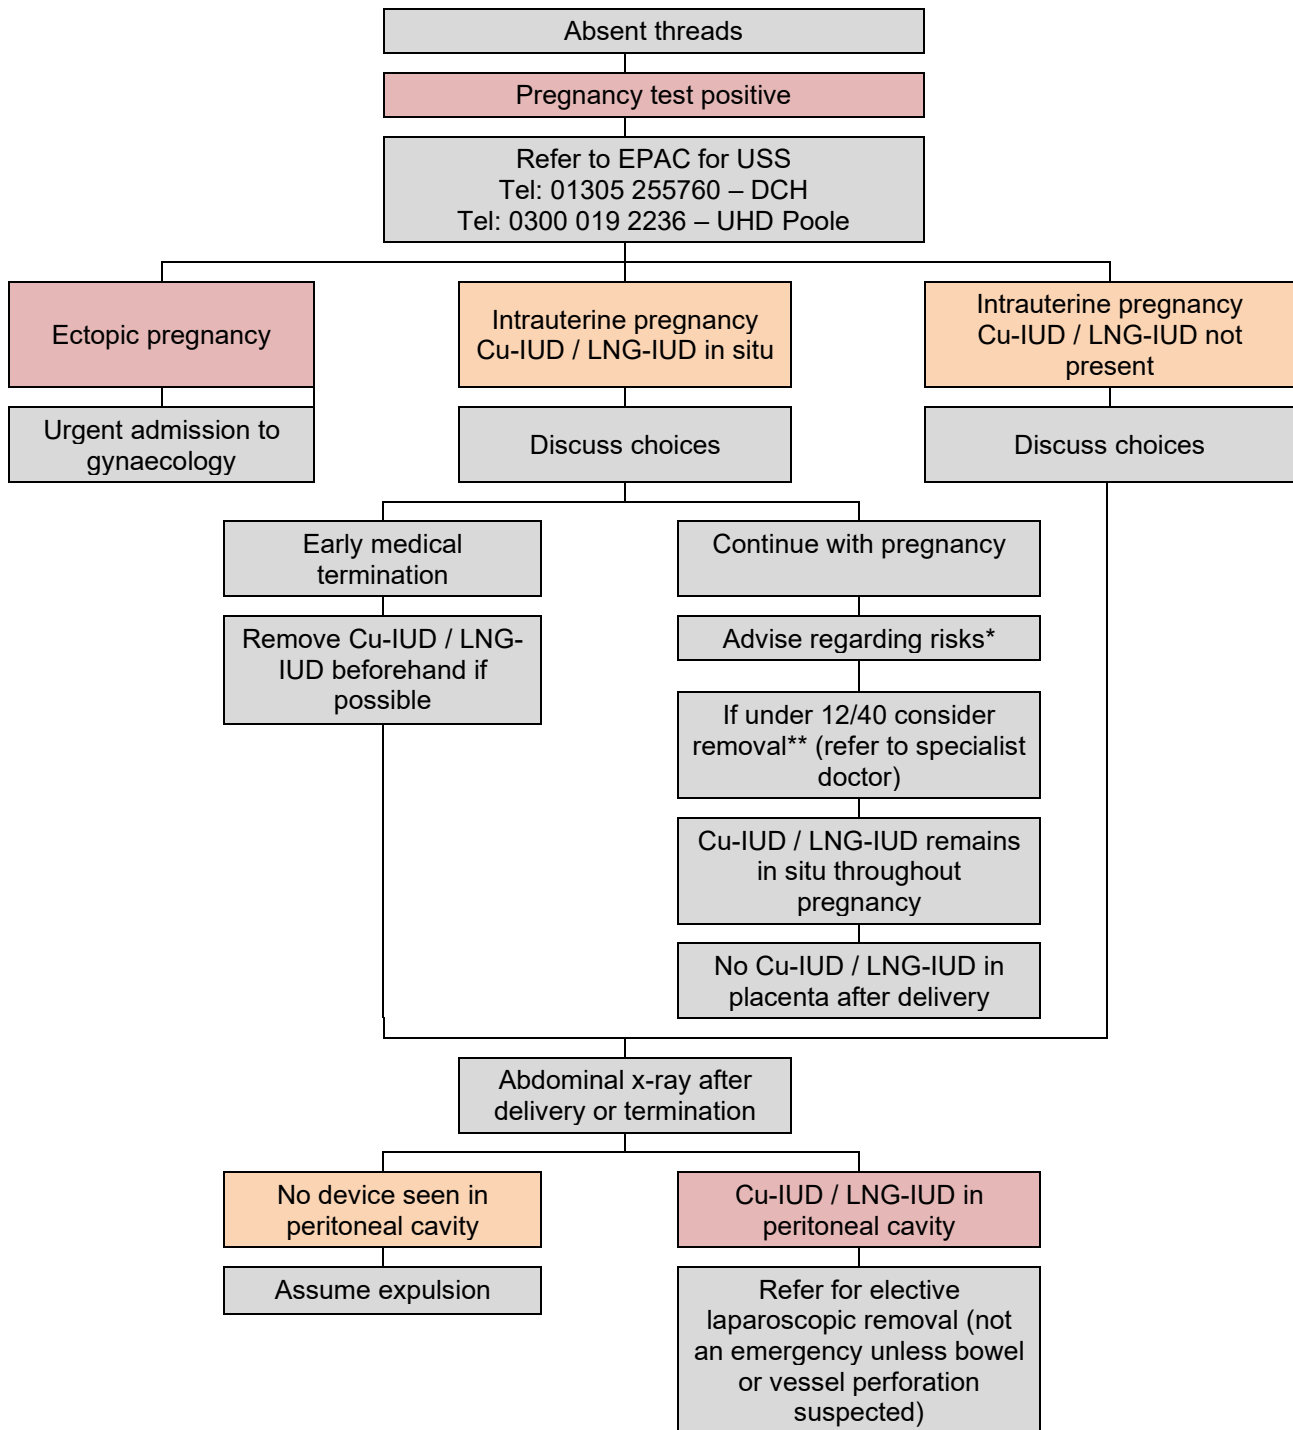

*Increased risk of septic termination, pre-term labour. To date no evidence of increased risk of congenital abnormalities.
 **Increased risk of miscarriage.