
N.6.1 Test on the capability to supply reactive power	P


For static generators are planned capabilities differ depending on the total power:

- for generators in power plants less than 400 kW: The inverter must have a minimum capability of type 'semicircular limited' with cosφ between 0.90 in absorption and 0.90 in supply (See. Figure 15 , the characteristics of the type of Figure 16, however, are recommended as they allow to provide grid services, may be subject to compensation) The Q measured on the limit of capability curve in correspondence with a predetermined value of P. For low values of the active power generated (P ≤ 10% * Sn) are allowed deviations in the supply of reactive power measured at the limit of capability curve in correspondence with a predetermined value of P, up to a maximum of 10% of Sn.
- for generators in power plants totaling more than or equal to 400 kW: the inverter must have a capability of type 'semicircular' whose area of work is internal to the diagram of Figure 16. At the time of compliance with the performance requirements of specific capability in the band P≤10%*Sn is not required as it will be subject to appropriate regulation by the Authority.

For both types of static generators, the active power that can be delivered by them in the basic condition of operation at nominal voltage and cosφ=1 coincides with the rated apparent power of the generator itself.

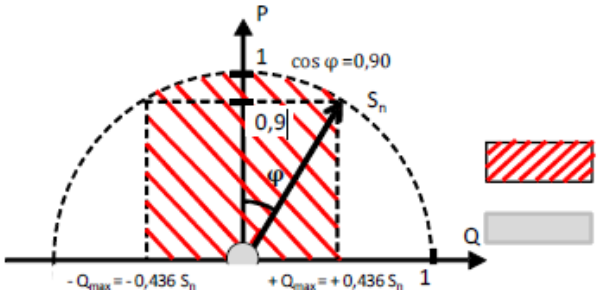

Capability for static generators in power plants < 400 kW (limited semicircular characteristic).

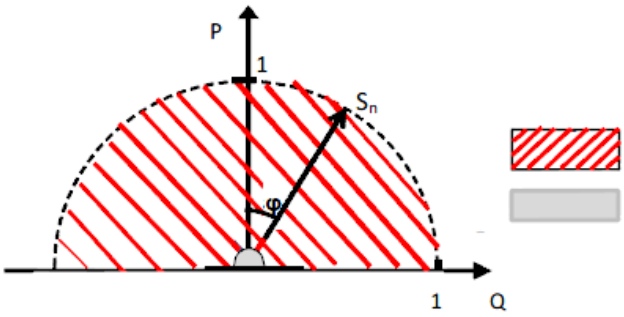

Picture 16-Capability for static generators in power plants > 400 kW (circular characteristic).

S_n: nominal apparent power which can be supplied to Un nominal voltage.

Q_{max}: maximum reactive power which can be supplied at nominal apparent power

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

N.6.1.1 Execution and registration proof applicable to static generators	**P**

Measurements can be made either through acquisition campaign in the field (p.es on a test system) or on a test bench, provided it is representative of the actual operating conditions of the generator (availability of primary source simulated as shown in Annex Q).

For the execution of the test are given the following requirements.

- The drive must be set so that it can absorb respectively (inductive behavior) and supply (capacitive behavior), the maximum reactive power available at each level of the active power output according to your capability.
- It regulates at this point the source d.c. in order to make available at least the full rated active power of the generator under test; further adjustments are possible during the test, so that the source is not limiting for the performance to be measured.
- It regulates (either through source control or by setting in the control system of the converter under test), the active power for values in the 11 intervals [0 ± 5]%, [10 ± 5]%; ...; [100 ± 5]% of rated apparent power, you make the measurement of active power in steady state after about 1 minute after completion of the adjustment (1-min average values calculated based on the measured values of the frequency of fundamental window of 200 ms).
- For each of the 11 levels of active power will have to record a value of the reactive power inductive and capacitive 1 for that, as average values for 1 min calculated on the basis of the measures at the fundamental frequency of the window of 1s. Also, the power factor must be detected and reported as an average for 1 minute.

In addition to measures of setting the limit values of the reactive power, you will have to record the measured values by setting the reactive power delivered to 0 ($\cos \varphi = 1$).

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

N.6.1.1 Execution and registration proof applicable to static generators Systems with less than 400kW	**P**

Test result: AZZURRO 3PH HYD20000 ZSS

-Qmax (inductive)

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,901	0,050	-8,793	-0,489	1,037	0,058	0,201
10% ±5%	1,829	0,102	-8,747	-0,486	2,045	0,114	0,205
20% ±5%	3,663	0,203	-8,715	-0,484	3,905	0,217	0,388
30% ±5%	5,433	0,302	-8,704	-0,484	5,704	0,317	0,530
40% ±5%	7,257	0,403	-8,720	-0,484	7,563	0,420	0,640
50% ±5%	9,075	0,504	-8,737	-0,485	9,420	0,523	0,720
60% ±5%	10,883	0,605	-8,752	-0,486	11,274	0,626	0,779
70% ±5%	12,648	0,703	-8,768	-0,487	13,089	0,727	0,822
80% ±5%	14,446	0,803	-8,745	-0,486	14,941	0,830	0,856
90% ±5%	16,281	0,905	-8,762	-0,487	16,834	0,935	0,881
100% ±5%	18,069	1,004	-8,778	-0,488	18,684	1,038	0,900

+Qmax (capacitive)

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,914	0,051	8,802	0,489	1,026	0,057	0,203
10% ±5%	1,861	0,103	8,723	0,485	2,046	0,114	0,209
20% ±5%	3,633	0,202	8,721	0,485	3,844	0,214	0,385
30% ±5%	5,462	0,303	8,738	0,485	5,703	0,317	0,530
40% ±5%	7,244	0,402	8,732	0,485	7,519	0,418	0,638
50% ±5%	9,061	0,503	8,725	0,485	9,377	0,521	0,720
60% ±5%	10,852	0,603	8,719	0,484	11,214	0,623	0,780
70% ±5%	12,657	0,703	8,714	0,484	13,070	0,726	0,824
80% ±5%	14,455	0,803	8,709	0,484	14,922	0,829	0,857
90% ±5%	16,249	0,903	8,706	0,484	16,773	0,932	0,881
100% ±5%	18,086	1,005	8,706	0,484	18,685	1,038	0,901

Q=0

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,956	0,053	0,367	0,020	1,036	0,058	0,933
10% ±5%	1,848	0,103	0,352	0,020	1,945	0,108	0,982
20% ±5%	3,587	0,199	0,362	0,020	3,716	0,206	0,995
30% ±5%	5,396	0,300	0,363	0,020	5,564	0,309	0,998
40% ±5%	7,211	0,401	0,361	0,020	7,422	0,412	0,999
50% ±5%	9,043	0,502	0,363	0,020	9,303	0,517	0,999
60% ±5%	10,858	0,603	0,380	0,021	11,172	0,621	0,999
70% ±5%	12,657	0,703	0,375	0,021	13,029	0,724	0,999
80% ±5%	14,437	0,802	0,387	0,021	14,872	0,826	0,999
90% ±5%	16,170	0,898	0,377	0,021	16,670	0,926	0,999
100% ±5%	18,010	1,001	0,370	0,021	18,586	1,033	0,999

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.


Test result: AZZURRO 3PH HYD5000 ZSS							
-Qmax (inductive)							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,041	0,01	-2,493	-0,50	0,096	0,02	0,017
10% ±5%	0,449	0,09	-2,489	-0,50	0,511	0,10	0,178
20% ±5%	0,961	0,19	-2,480	-0,50	1,028	0,21	0,361
30% ±5%	1,469	0,29	-2,472	-0,49	1,543	0,31	0,511
40% ±5%	1,975	0,40	-2,463	-0,49	2,058	0,41	0,626
50% ±5%	2,479	0,50	-2,455	-0,49	2,572	0,51	0,711
60% ±5%	2,981	0,60	-2,446	-0,49	3,087	0,62	0,773
70% ±5%	3,482	0,70	-2,438	-0,49	3,603	0,72	0,819
80% ±5%	3,980	0,80	-2,430	-0,49	4,115	0,82	0,853
90% ±5%	4,476	0,90	-2,422	-0,48	4,629	0,93	0,879
100% ±5%	4,970	0,99	-2,414	-0,48	5,142	1,03	0,899
+Qmax (capacitive)							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,050	0,01	2,370	0,47	0,098	0,02	0,021
10% ±5%	0,460	0,09	2,379	0,48	0,511	0,10	0,190
20% ±5%	0,971	0,19	2,389	0,48	1,027	0,21	0,377
30% ±5%	1,478	0,30	2,400	0,48	1,542	0,31	0,525
40% ±5%	1,985	0,40	2,410	0,48	2,058	0,41	0,636
50% ±5%	2,487	0,50	2,421	0,48	2,572	0,51	0,717
60% ±5%	2,989	0,60	2,432	0,49	3,087	0,62	0,776
70% ±5%	3,488	0,70	2,443	0,49	3,601	0,72	0,819
80% ±5%	3,987	0,80	2,455	0,49	4,115	0,82	0,852
90% ±5%	4,482	0,90	2,466	0,49	4,628	0,93	0,876
100% ±5%	4,976	1,00	2,478	0,50	5,141	1,03	0,895
Q=0							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,066	0,01	-0,081	-0,02	0,093	0,02	0,573
10% ±5%	0,491	0,10	-0,045	-0,01	0,510	0,10	0,994
20% ±5%	0,980	0,20	-0,086	-0,02	1,018	0,20	0,994
30% ±5%	1,488	0,30	-0,084	-0,02	1,533	0,31	0,998
40% ±5%	1,993	0,40	-0,078	-0,02	2,047	0,41	0,999
50% ±5%	2,497	0,50	-0,045	-0,01	2,561	0,51	0,999
60% ±5%	3,001	0,60	0,063	0,01	3,075	0,61	0,999
70% ±5%	3,505	0,70	0,080	0,02	3,588	0,72	0,999
80% ±5%	4,007	0,80	0,089	0,02	4,102	0,82	0,999
90% ±5%	4,507	0,90	0,103	0,02	4,614	0,92	0,999
100% ±5%	5,007	1,00	0,113	0,02	5,127	1,03	0,999

Note:
The inverter produceses reactive power according to the circular chratcteristic. The priority is always given by the reactive power.


The tests had been performed on the AZZURRO 3PH HYD20000 ZSS and AZZURRO 3PH HYD5000 ZSS is valid for the AZZURRO 3PH HYD15000 ZSS, AZZURRO 3PH HYD10000 ZSS, AZZURRO 3PH HYD8000 ZSS and AZZURRO 3PH HYD6000 ZSS since it is similar in hardware and just power derated by software.

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Graph of capability curves valid for inverter : AZZURRO 3PH HYD20000 ZSS

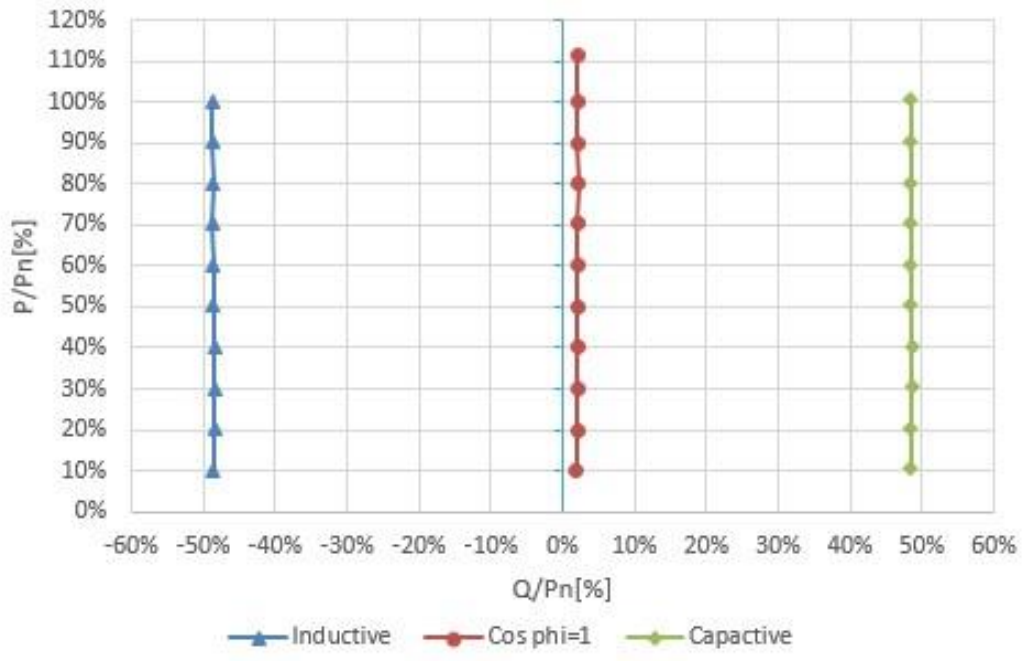

Graph of capability curves valid for inverter : AZZURRO 3PH HYD5000 ZSS

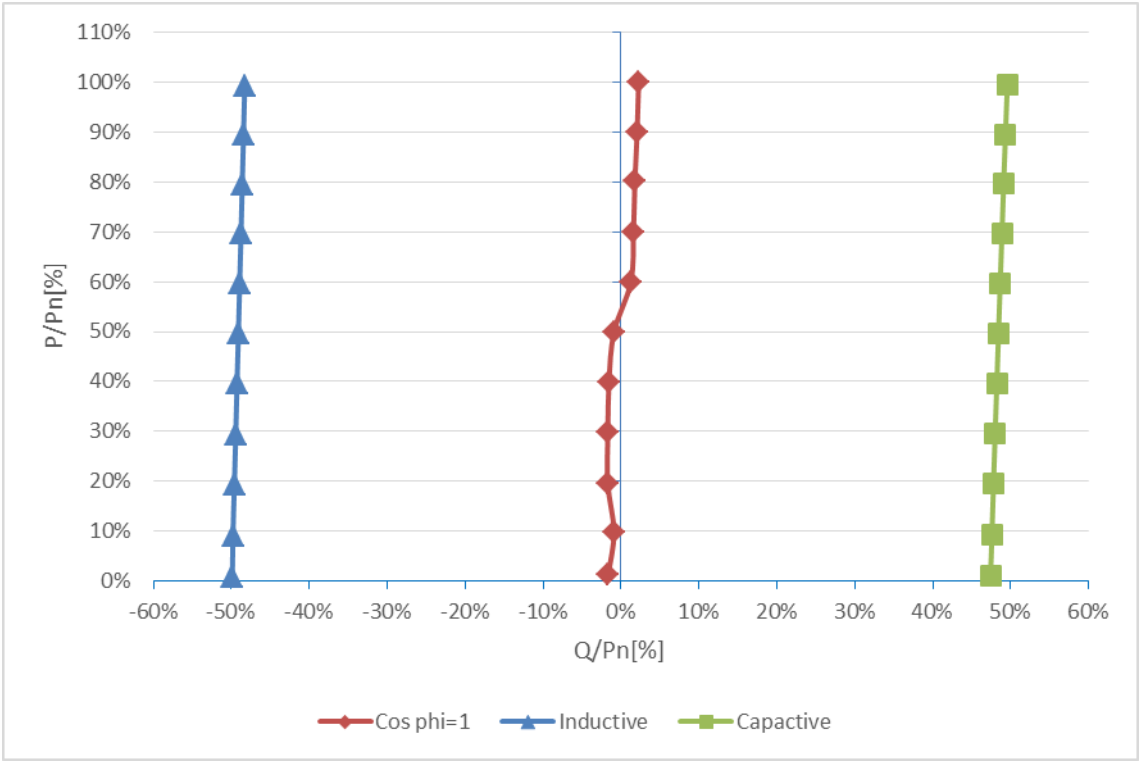

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

N.6.1.1 Execution and registration proof applicable to static generators Systems with equal or more than 400kW	P

Test result: AZZURRO 3PH HYD20000 ZSS

-Qmax (inductive)

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,844	0,042	-19,903	-0,995	1,326	0,066	0,0424
10% ±5%	2,007	0,100	-19,898	-0,995	2,493	0,125	0,1003
20% ±5%	4,038	0,202	-19,887	-0,994	4,539	0,227	0,1990
30% ±5%	6,089	0,304	-19,441	-0,972	6,597	0,330	0,2989
40% ±5%	8,095	0,405	-18,705	-0,935	8,608	0,430	0,3972
50% ±5%	10,114	0,506	-17,448	-0,872	10,626	0,531	0,5015
60% ±5%	12,076	0,604	-16,159	-0,808	12,598	0,630	0,5986
70% ±5%	14,081	0,704	-14,453	-0,723	14,613	0,731	0,6978
80% ±5%	16,063	0,803	-12,198	-0,610	16,602	0,830	0,7964
90% ±5%	18,088	0,904	-8,903	-0,445	18,634	0,932	0,8972
100% ±5%	20,217	1,011	0,570	0,028	20,784	1,039	0,9994

+Qmax (capacitive)

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,857	0,043	19,904	0,995	1,343	0,067	0,0430
10% ±5%	2,011	0,101	19,898	0,995	2,510	0,125	0,1006
20% ±5%	4,044	0,202	19,887	0,994	4,562	0,228	0,1992
30% ±5%	6,081	0,304	19,434	0,972	6,610	0,331	0,2986
40% ±5%	8,117	0,406	18,677	0,934	8,656	0,433	0,3986
50% ±5%	10,145	0,507	17,479	0,874	10,636	0,532	0,5027
60% ±5%	12,107	0,605	16,190	0,810	12,609	0,630	0,5999
70% ±5%	14,112	0,706	14,485	0,724	14,623	0,731	0,6991
80% ±5%	16,094	0,805	12,229	0,611	16,613	0,831	0,7976
90% ±5%	18,119	0,906	8,934	0,447	18,644	0,932	0,8984
100% ±5%	20,248	1,012	0,601	0,030	20,795	1,040	0,9996

Q=0

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	1,001	0,050	0,458	0,023	1,079	0,054	0,9046
10% ±5%	2,030	0,102	-0,314	-0,016	2,132	0,107	0,9882
20% ±5%	4,067	0,203	-0,331	-0,017	4,210	0,210	0,9967
30% ±5%	6,074	0,304	-0,338	-0,017	6,261	0,313	0,9984
40% ±5%	8,037	0,402	-0,338	-0,017	8,272	0,414	0,9991
50% ±5%	10,096	0,505	-0,352	-0,018	10,386	0,519	0,9994
60% ±5%	12,065	0,603	-0,398	-0,020	12,412	0,621	0,9995
70% ±5%	14,049	0,702	-0,446	-0,022	14,457	0,723	0,9995
80% ±5%	16,027	0,801	-0,448	-0,022	16,503	0,825	0,9996
90% ±5%	18,061	0,903	-0,450	-0,023	18,608	0,930	0,9996
100% ±5%	20,084	1,004	-0,448	-0,022	20,710	1,035	0,9997

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.


Test result: AZZURRO 3PH HYD5000 ZSS							
-Qmax (inductive)							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,027	0,005	-4,884	-0,977	0,134	0,027	0,0056
10% ±5%	0,390	0,078	-4,863	-0,973	0,501	0,100	0,0799
20% ±5%	0,913	0,183	-4,809	-0,962	1,024	0,205	0,1864
30% ±5%	1,432	0,286	-4,684	-0,937	1,543	0,309	0,2924
40% ±5%	1,952	0,390	-4,497	-0,899	2,064	0,413	0,3982
50% ±5%	2,473	0,495	-4,242	-0,848	2,585	0,517	0,5037
60% ±5%	2,994	0,599	-3,905	-0,781	3,106	0,621	0,6085
70% ±5%	3,514	0,703	-3,461	-0,692	3,626	0,725	0,7125
80% ±5%	4,034	0,807	-2,868	-0,574	4,145	0,829	0,8149
90% ±5%	4,552	0,910	-2,006	-0,401	4,663	0,933	0,9149
100% ±5%	5,032	1,006	0,239	0,048	5,135	1,027	0,9972
+Qmax (capacitive)							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,077	0,015	4,882	0,976	0,184	0,037	0,0158
10% ±5%	0,387	0,077	4,863	0,973	0,501	0,100	0,0794
20% ±5%	0,911	0,182	4,808	0,962	1,023	0,205	0,1862
30% ±5%	1,432	0,286	4,683	0,937	1,544	0,309	0,2924
40% ±5%	1,950	0,390	4,497	0,899	2,063	0,413	0,3979
50% ±5%	2,474	0,495	4,240	0,848	2,586	0,517	0,5039
60% ±5%	2,994	0,599	3,902	0,780	3,106	0,621	0,6086
70% ±5%	3,513	0,703	3,459	0,692	3,626	0,725	0,7126
80% ±5%	4,034	0,807	2,865	0,573	4,146	0,829	0,8152
90% ±5%	4,554	0,911	1,996	0,399	4,666	0,933	0,9158
100% ±5%	5,036	1,007	0,305	0,061	5,139	1,028	0,9979
Q=0							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVar]	p.u.	[kW]	p.u.	
0% ±5%	0,066	0,013	-0,081	-0,016	0,093	0,019	0,5728
10% ±5%	0,491	0,098	-0,045	-0,009	0,510	0,102	0,9940
20% ±5%	0,980	0,196	-0,086	-0,017	1,018	0,204	0,9937
30% ±5%	1,488	0,298	-0,084	-0,017	1,533	0,307	0,9976
40% ±5%	1,993	0,399	-0,078	-0,016	2,047	0,409	0,9986
50% ±5%	2,497	0,499	-0,045	-0,009	2,561	0,512	0,9991
60% ±5%	3,001	0,600	0,063	0,013	3,075	0,615	0,9994
70% ±5%	3,505	0,701	0,080	0,016	3,588	0,718	0,9995
80% ±5%	4,007	0,801	0,089	0,018	4,102	0,820	0,9996
90% ±5%	4,507	0,901	0,103	0,021	4,614	0,923	0,9997
100% ±5%	5,007	1,001	0,113	0,023	5,127	1,025	0,9997

Note:
The inverter produceses reactive power according to the circular chratcteristic. The priority is always given by the reactive power.


The tests had been performed on the AZZURRO 3PH HYD20000 ZSS and AZZURRO 3PH HYD5000 ZSS is valid for the AZZURRO 3PH HYD15000 ZSS, AZZURRO 3PH HYD10000 ZSS, AZZURRO 3PH HYD8000 ZSS and AZZURRO 3PH HYD6000 ZSS since it is similar in hardware and just power derated by software.

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Graph of capability curves valid for inverter : AZZURRO 3PH HYD20000 ZSS

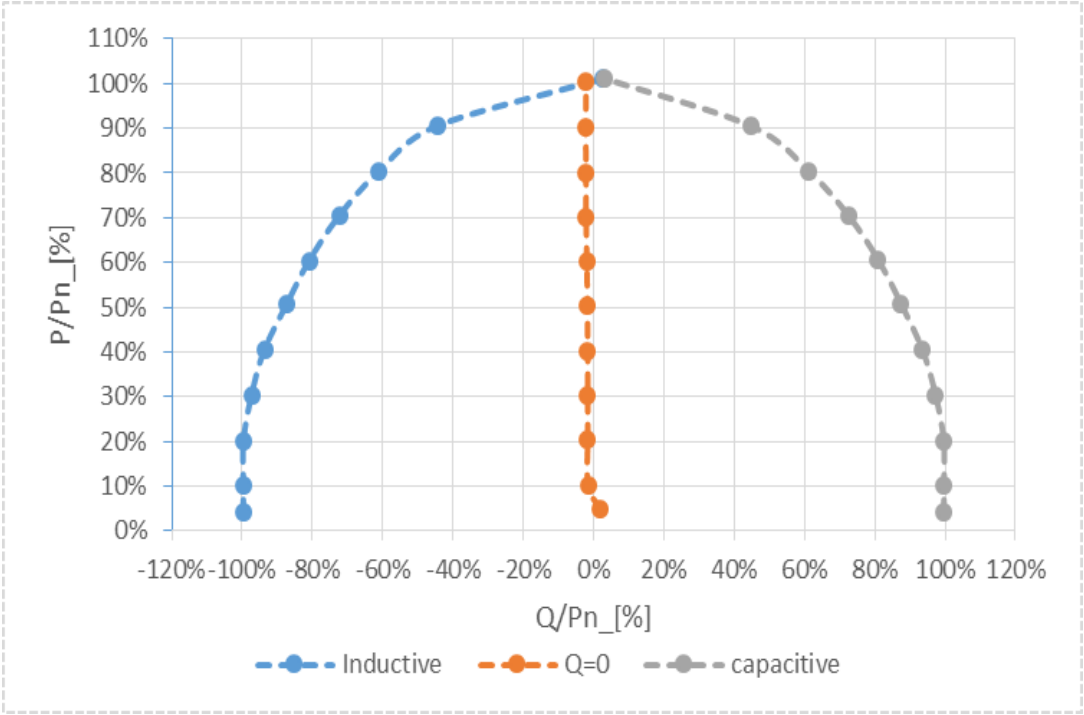

Graph of capability curves valid for inverter : AZZURRO 3PH HYD5000 ZSS

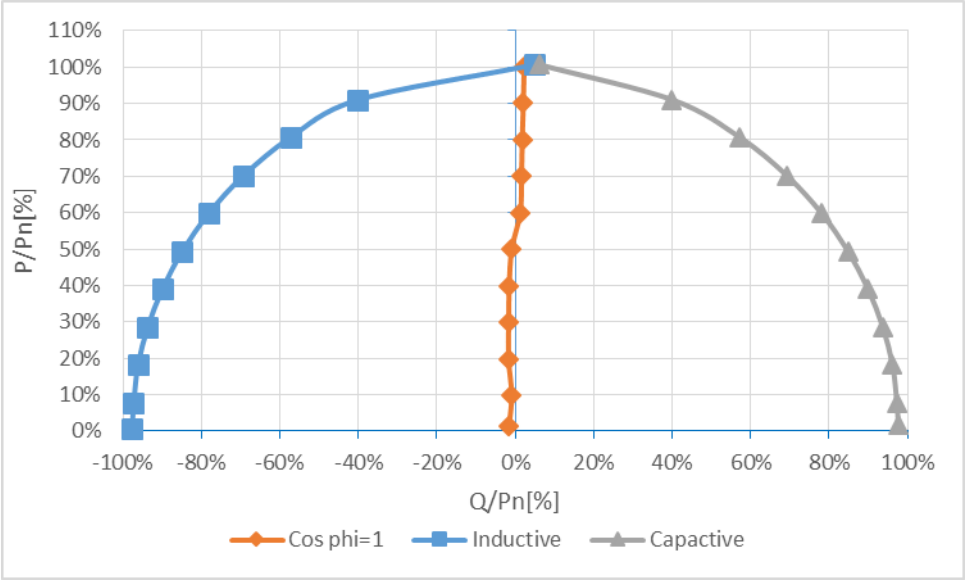

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Nbis.6.2	**Method of execution and recording of the test Systems with more than 400kW**	**P**

Test result: Discharging mode, AZZURRO 3PH HYD20000 ZSS

Inductive cos φ absorbation

Power-BIN	Active power [W]		Reactive power [Var]		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,259	-0,013	-20,003	-1,000	228	0,011	-0,013
10%*P_{SMAX} ± 5%*S_n	1,507	0,075	-19,975	-0,999	2,020	0,101	0,075
20%*P_{SMAX} ± 5%*S_n	3,472	0,174	-19,765	-0,988	4,005	0,200	0,173
30%*P_{SMAX} ± 5%*S_n	5,442	0,272	-19,299	-0,965	5,993	0,300	0,271
40%*P_{SMAX} ± 5%*S_n	7,416	0,371	-18,607	-0,930	7,989	0,399	0,370
50%*P_{SMAX} ± 5%*S_n	9,392	0,470	-17,668	-0,883	9,988	0,499	0,469
60%*P_{SMAX} ± 5%*S_n	11,365	0,568	-16,444	-0,822	11,988	0,599	0,569
70%*P_{SMAX} ± 5%*S_n	13,349	0,667	-14,859	-0,743	14,003	0,700	0,668
80%*P_{SMAX} ± 5%*S_n	15,345	0,767	-12,765	-0,638	16,031	0,802	0,769
90%*P_{SMAX} ± 5%*S_n	17,349	0,867	-9,821	-0,491	18,070	0,904	0,870
100%*P_{SMAX} ± 5%*S_n	19,368	0,968	0,001	0,000	20,073	1,004	1,000

Capacitive cos φ supply

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,260	-0.013	20,003	1.000	0,228	0.011	-0.013
10%*P_{SMAX} ± 5%*S_n	1,500	0,075	19,974	0,999	2,013	0,101	0,075
20%*P_{SMAX} ± 5%*S_n	3,466	0,173	19,766	0,988	3,999	0,200	0,173
30%*P_{SMAX} ± 5%*S_n	5,431	0,272	19,301	0,965	5,982	0,299	0,271
40%*P_{SMAX} ± 5%*S_n	7,401	0,370	18,612	0,931	7,973	0,399	0,370
50%*P_{SMAX} ± 5%*S_n	9,388	0,469	17,668	0,883	9,985	0,499	0,469
60%*P_{SMAX} ± 5%*S_n	11,348	0,567	16,455	0,823	11,970	0,599	0,568
70%*P_{SMAX} ± 5%*S_n	13,331	0,667	14,873	0,744	13,983	0,699	0,667
80%*P_{SMAX} ± 5%*S_n	15,324	0,766	12,788	0,639	16,010	0,801	0,768
90%*P_{SMAX} ± 5%*S_n	17,314	0,866	9,885	0,494	18,035	0,902	0,868
100%*P_{SMAX} ± 5%*S_n	19,363	0,968	0,087	0,004	20,069	1,003	0,999

cos φ=1

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	0,167	0,008	-0,304	-0,015	235	0,012	0,479
10%*P_{SMAX} ± 5%*S_n	1,916	0,096	-0,315	-0,016	2020	0,101	0,987
20%*P_{SMAX} ± 5%*S_n	3,857	0,193	-0,236	-0,012	4002	0,200	0,997
30%*P_{SMAX} ± 5%*S_n	5,795	0,290	-0,092	-0,005	5984	0,299	0,999
40%*P_{SMAX} ± 5%*S_n	7731	0,387	-0,009	0,000	7973	0,399	0,999
50%*P_{SMAX} ± 5%*S_n	9,677	0,484	-0,008	0,000	9977	0,499	0,999
60%*P_{SMAX} ± 5%*S_n	11,601	0,580	-0,006	0,000	11965	0,598	1,000
70%*P_{SMAX} ± 5%*S_n	13,546	0,677	-0,004	0,000	13982	0,699	1,000
80%*P_{SMAX} ± 5%*S_n	15,490	0,775	0,000	0,000	16005	0,800	1,000
90%*P_{SMAX} ± 5%*S_n	17,441	0,872	0,004	0,000	18041	0,902	1,000
100%*P_{SMAX} ± 5%*S_n	19,384	0,969	0,007	0,000	20077	1,004	1,000


Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Test result: Discharging mode, AZZURRO 3PH HYD5000 ZSS							
Inductive cos φ absorbation							
Power-BIN	Active power [W]		Reactive power [Var]		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	0,190	0,038	-4,863	-0,973	0,311	0,062	0,0391
10%*P_{SMAX} ± 5%*S_n	0,580	0,116	-4,858	-0,972	0,706	0,141	0,1185
20%*P_{SMAX} ± 5%*S_n	0,931	0,186	-4,803	-0,961	1,064	0,213	0,1904
30%*P_{SMAX} ± 5%*S_n	1,431	0,286	-4,681	-0,936	1,569	0,314	0,2923
40%*P_{SMAX} ± 5%*S_n	1,930	0,386	-4,502	-0,900	2,073	0,415	0,3940
50%*P_{SMAX} ± 5%*S_n	2,429	0,486	-4,260	-0,852	2,578	0,516	0,4953
60%*P_{SMAX} ± 5%*S_n	2,926	0,585	-3,945	-0,789	3,081	0,616	0,5957
70%*P_{SMAX} ± 5%*S_n	3,430	0,686	-3,527	-0,705	3,590	0,718	0,6971
80%*P_{SMAX} ± 5%*S_n	3,930	0,786	-2,983	-0,597	4,097	0,819	0,7965
90%*P_{SMAX} ± 5%*S_n	4,404	0,881	-2,269	-0,454	4,577	0,915	0,8889
100%*P_{SMAX} ± 5%*S_n	4,912	0,982	0,256	0,051	5,080	1,016	0,9980
Capacitive cos φ supply							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	0,087	0,017	5,077	1,015	0,190	0,038	0,0172
10%*P_{SMAX} ± 5%*S_n	0,571	0,114	5,082	1,016	0,681	0,136	0,1116
20%*P_{SMAX} ± 5%*S_n	0,944	0,189	5,022	1,004	1,062	0,212	0,1848
30%*P_{SMAX} ± 5%*S_n	1,439	0,288	4,907	0,981	1,563	0,313	0,2814
40%*P_{SMAX} ± 5%*S_n	1,942	0,388	4,737	0,947	2,071	0,414	0,3792
50%*P_{SMAX} ± 5%*S_n	2,443	0,489	4,501	0,900	2,578	0,516	0,4770
60%*P_{SMAX} ± 5%*S_n	2,939	0,588	4,193	0,839	3,082	0,616	0,5740
70%*P_{SMAX} ± 5%*S_n	3,439	0,688	3,790	0,758	3,588	0,718	0,6720
80%*P_{SMAX} ± 5%*S_n	3,940	0,788	3,248	0,650	4,096	0,819	0,7716
90%*P_{SMAX} ± 5%*S_n	4,421	0,884	2,515	0,503	4,586	0,917	0,8692
100%*P_{SMAX} ± 5%*S_n	4,908	0,982	0,286	0,057	5,074	1,015	0,9981
cos φ=1							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]		[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	0,057	0,011	-0,082	-0,016	0,086	0,017	0,5685
10%*P_{SMAX} ± 5%*S_n	0,463	0,093	-0,050	-0,010	0,486	0,097	0,9941
20%*P_{SMAX} ± 5%*S_n	0,917	0,183	-0,102	-0,020	0,964	0,193	0,9938
30%*P_{SMAX} ± 5%*S_n	1,399	0,280	-0,098	-0,020	1,457	0,291	0,9975
40%*P_{SMAX} ± 5%*S_n	1,879	0,376	-0,097	-0,019	1,947	0,389	0,9986
50%*P_{SMAX} ± 5%*S_n	2,357	0,471	-0,090	-0,018	2,437	0,487	0,9991
60%*P_{SMAX} ± 5%*S_n	2,842	0,568	0,073	0,015	2,935	0,587	0,9993
70%*P_{SMAX} ± 5%*S_n	3,320	0,664	0,107	0,021	3,427	0,685	0,9995
80%*P_{SMAX} ± 5%*S_n	3,800	0,760	0,109	0,022	3,921	0,784	0,9996
90%*P_{SMAX} ± 5%*S_n	4,282	0,856	0,119	0,024	4,419	0,884	0,9996
100%*P_{SMAX} ± 5%*S_n	4,760	0,952	0,119	0,024	4,914	0,983	0,9997


Note:
The inverter produceses reactive power according to the circular chratcteristic. The priority is always given by the reactive power.
The tests had been performed on the AZZURRO 3PH HYD20000 ZSS and AZZURRO 3PH HYD5000 ZSS is valid for the AZZURRO 3PH HYD15000 ZSS, AZZURRO 3PH HYD10000 ZSS, AZZURRO 3PH HYD8000 ZSS and AZZURRO 3PH HYD6000 ZSS since it is similar in hardware and just power derated by software.

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Graph of capability curves valid for inverter : AZZURRO 3PH HYD20000 ZSS

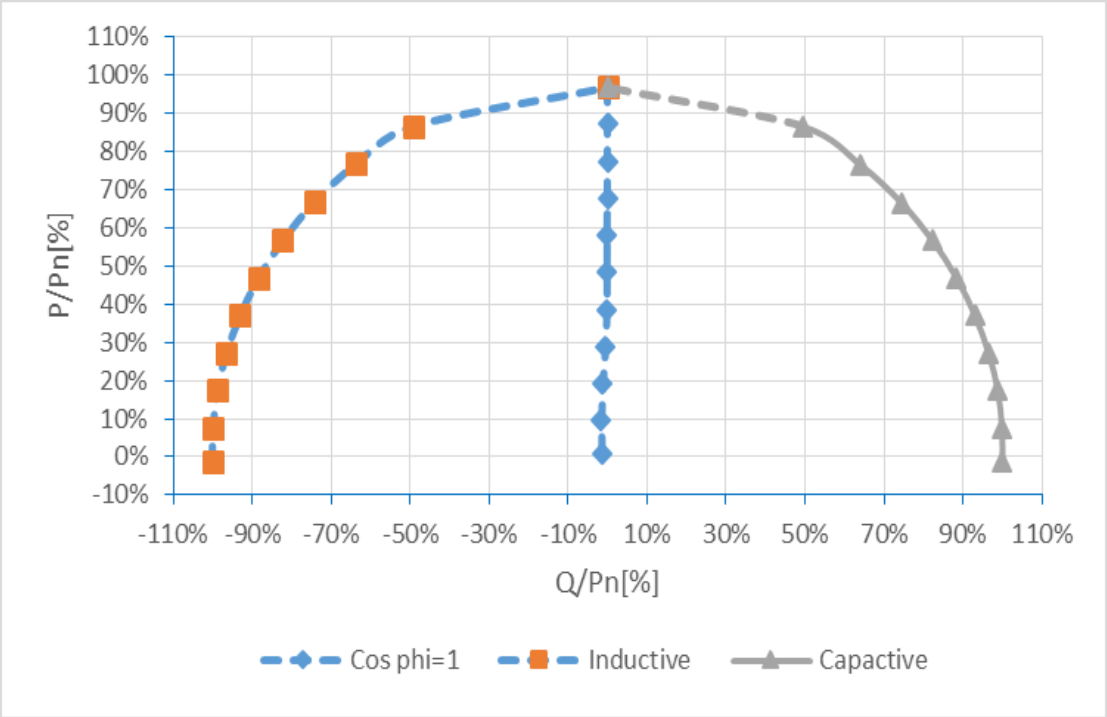

Graph of capability curves valid for inverter : AZZURRO 3PH HYD5000 ZSS

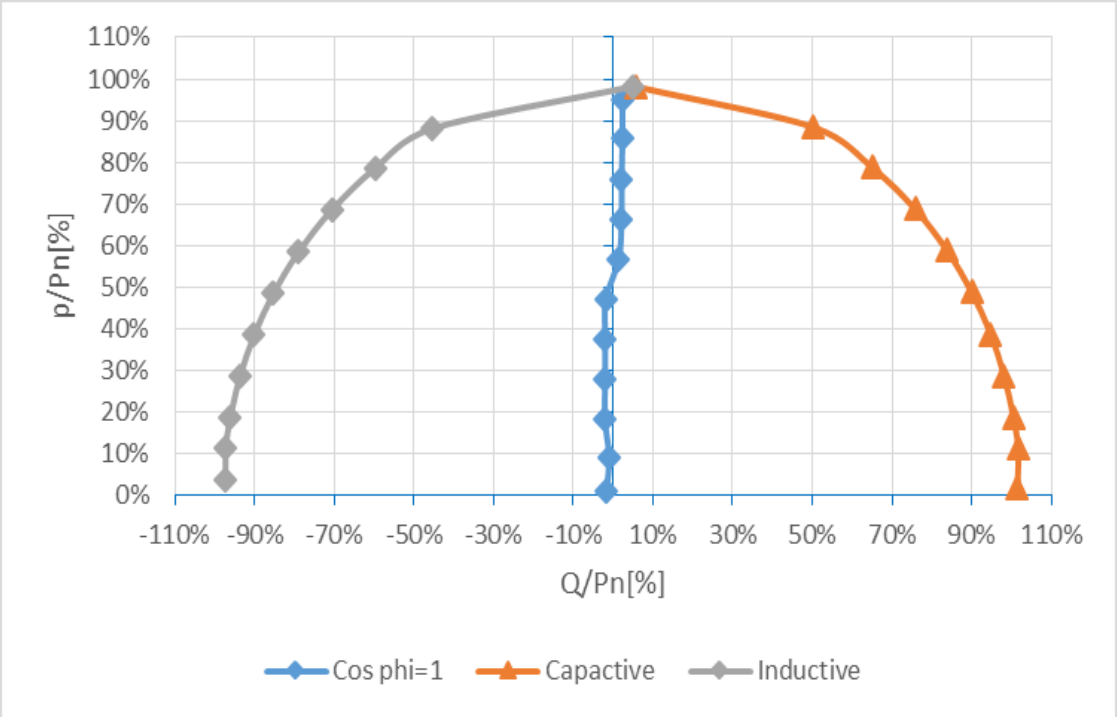

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Nbis.6.2	Method of execution and recording of the test Systems with more than 400kW	P

Test result: Charging mode, AZZURRO 3PH HYD20000 ZSS

Inductive cos φ absorbation

Power-BIN	Active power [W]		Reactive power [Var]		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,439	-0,022	-19,583	-0,979	0,136	0,007	-0,022
10%*P_{SMAX} ± 5%*S_n	-2,254	-0,113	-19,530	-0,977	-1,571	-0,079	-0,115
20%*P_{SMAX} ± 5%*S_n	-4,246	-0,212	-19,172	-0,959	-3,526	-0,176	-0,216
30%*P_{SMAX} ± 5%*S_n	-6225	-0,311	-18602	-0,930	-5480	-0,274	-0,317
40%*P_{SMAX} ± 5%*S_n	-8218	-0,411	-17794	-0,890	-7421	-0,371	-0,419
50%*P_{SMAX} ± 5%*S_n	-10193	-0,510	-16729	-0,836	-9321	-0,466	-0,520
60%*P_{SMAX} ± 5%*S_n	-12,165	-0,608	-15,349	-0,767	-11,388	-0,569	-0,621
70%*P_{SMAX} ± 5%*S_n	-14,150	-0,708	-13,554	-0,678	-13,328	-0,666	-0,722
80%*P_{SMAX} ± 5%*S_n	-16,105	-0,805	-11,206	-0,560	-15,219	-0,761	-0,821
90%*P_{SMAX} ± 5%*S_n	-18,041	-0,902	-7,840	-0,392	-17,104	-0,855	-0,917
100%*P_{SMAX} ± 5%*S_n	-19,897	-0,995	-0,777	-0,039	-18,977	-0,949	-0,998

Capacitive cos φ supply

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,443	-0,022	19,593	0,980	-0,120	-0,006	-0,023
10%*P_{SMAX} ± 5%*S_n	-2,253	-0,113	19,539	0,977	-1,878	-0,094	-0,115
20%*P_{SMAX} ± 5%*S_n	-4,241	-0,212	19,181	0,959	-3,802	-0,190	-0,216
30%*P_{SMAX} ± 5%*S_n	-6,230	-0,312	18,607	0,930	-5,744	-0,287	-0,317
40%*P_{SMAX} ± 5%*S_n	-8,210	-0,410	17,805	0,890	-7,670	-0,384	-0,419
50%*P_{SMAX} ± 5%*S_n	-10,196	-0,510	16,734	0,837	-9,600	-0,480	-0,520
60%*P_{SMAX} ± 5%*S_n	-12,181	-0,609	15,342	0,767	-11,527	-0,576	-0,622
70%*P_{SMAX} ± 5%*S_n	-14,144	-0,707	13,567	0,678	-13,431	-0,672	-0,722
80%*P_{SMAX} ± 5%*S_n	-16,115	-0,806	11,195	0,560	-15,336	-0,767	-0,821
90%*P_{SMAX} ± 5%*S_n	-18,049	-0,902	7,827	0,391	-17,223	-0,861	-0,917
100%*P_{SMAX} ± 5%*S_n	-19,904	-0,995	-0,533	-0,027	-18,881	-0,944	-0,999

cos φ=1

Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,171	-0,009	-0,307	-0,015	-0,108	-0,005	-0,486
10%*P_{SMAX} ± 5%*S_n	-1,956	-0,098	-0,331	-0,017	-1,852	-0,093	-0,986
20%*P_{SMAX} ± 5%*S_n	-3,958	-0,198	-0,361	-0,018	-3,809	-0,190	-0,996
30%*P_{SMAX} ± 5%*S_n	-5,957	-0,298	-0,383	-0,019	-5,759	-0,288	-0,998
40%*P_{SMAX} ± 5%*S_n	-7,951	-0,398	-0,409	-0,020	-7,697	-0,385	-0,999
50%*P_{SMAX} ± 5%*S_n	-9,945	-0,497	-0,436	-0,022	-9,629	-0,481	-0,999
60%*P_{SMAX} ± 5%*S_n	-11,940	-0,597	-0,465	-0,023	-11,555	-0,578	-0,999
70%*P_{SMAX} ± 5%*S_n	-13,936	-0,697	-0,500	-0,025	-13,476	-0,674	-0,999
80%*P_{SMAX} ± 5%*S_n	-15,932	-0,797	-0,538	-0,027	-15,390	-0,770	-0,999
90%*P_{SMAX} ± 5%*S_n	-17,925	-0,896	-0,587	-0,029	-17,296	-0,865	-0,999
100%*P_{SMAX} ± 5%*S_n	-19,919	-0,996	-0,643	-0,032	-19,195	-0,960	-0,999


Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Test result: Charging mode, AZZURRO 3PH HYD5000 ZSS							
Inductive cos φ absorbation							
Power-BIN	Active power [W]		Reactive power [Var]		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,097	-0,019	-4,874	-0,975	0,014	0,0028	-0,0199
10%*P_{SMAX} ± 5%*S_n	-0,353	-0,071	-4,872	-0,974	-0,234	-0,0468	-0,0723
20%*P_{SMAX} ± 5%*S_n	-0,880	-0,176	-4,818	-0,964	-0,753	-0,1506	-0,1797
30%*P_{SMAX} ± 5%*S_n	-1,385	-0,277	-4,702	-0,940	-1,249	-0,2497	-0,2825
40%*P_{SMAX} ± 5%*S_n	-1,886	-0,377	-4,532	-0,906	-1,744	-0,3489	-0,3842
50%*P_{SMAX} ± 5%*S_n	-2,388	-0,478	-4,297	-0,859	-2,240	-0,4481	-0,4857
60%*P_{SMAX} ± 5%*S_n	-2,891	-0,578	-3,984	-0,797	-2,738	-0,5476	-0,5872
70%*P_{SMAX} ± 5%*S_n	-3,400	-0,680	-3,576	-0,715	-3,241	-0,6482	-0,6889
80%*P_{SMAX} ± 5%*S_n	-3,910	-0,782	-3,025	-0,605	-3,745	-0,7490	-0,7908
90%*P_{SMAX} ± 5%*S_n	-4,423	-0,885	-2,232	-0,446	-4,252	-0,8504	-0,8927
100%*P_{SMAX} ± 5%*S_n	-4,970	-0,994	-0,036	-0,007	-4,803	-0,9606	-0,9969
Capacitive cos φ supply							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,231	-0,046	5,061	1,012	-0,131	-0,0261	-0,0455
10%*P_{SMAX} ± 5%*S_n	-0,529	-0,106	5,050	1,010	-0,423	-0,0846	-0,1041
20%*P_{SMAX} ± 5%*S_n	-1,029	-0,206	4,970	0,994	-0,913	-0,1826	-0,2027
30%*P_{SMAX} ± 5%*S_n	-1,525	-0,305	4,832	0,966	-1,402	-0,2805	-0,3010
40%*P_{SMAX} ± 5%*S_n	-2,026	-0,405	4,634	0,927	-1,898	-0,3796	-0,4007
50%*P_{SMAX} ± 5%*S_n	-2,521	-0,504	4,362	0,872	-2,387	-0,4773	-0,5004
60%*P_{SMAX} ± 5%*S_n	-3,016	-0,603	4,019	0,804	-2,875	-0,5751	-0,6002
70%*P_{SMAX} ± 5%*S_n	-3,507	-0,701	3,581	0,716	-3,360	-0,6720	-0,6997
80%*P_{SMAX} ± 5%*S_n	-4,000	-0,800	3,013	0,603	-3,845	-0,7691	-0,7987
90%*P_{SMAX} ± 5%*S_n	-4,486	-0,897	2,203	0,441	-4,322	-0,8645	-0,8975
100%*P_{SMAX} ± 5%*S_n	-4,965	-0,993	0,461	0,092	-4,799	-0,9598	-0,9956
cos φ=1							
Power-BIN	Active power		Reactive power		DC power		Power factor (cos φ)
	[kW]	p.u.	[kVA]	p.u.	[kW]	p.u.	
0%*P_{SMAX} ± 5%*S_n	-0,084	-0,017	-0,079	-0,016	-0,057	-0,011	-0,7254
10%*P_{SMAX} ± 5%*S_n	-0,490	-0,098	-0,058	-0,012	-0,466	-0,093	-0,9929
20%*P_{SMAX} ± 5%*S_n	-0,981	-0,196	-0,117	-0,023	-0,932	-0,186	-0,9929
30%*P_{SMAX} ± 5%*S_n	-1,482	-0,296	-0,126	-0,025	-1,422	-0,284	-0,9964
40%*P_{SMAX} ± 5%*S_n	-1,983	-0,397	-0,132	-0,026	-1,912	-0,382	-0,9978
50%*P_{SMAX} ± 5%*S_n	-2,484	-0,497	-0,142	-0,028	-2,400	-0,480	-0,9984
60%*P_{SMAX} ± 5%*S_n	-2,985	-0,597	-0,148	-0,030	-2,887	-0,577	-0,9988
70%*P_{SMAX} ± 5%*S_n	-3,486	-0,697	-0,156	-0,031	-3,374	-0,675	-0,9990
80%*P_{SMAX} ± 5%*S_n	-3,989	-0,798	-0,164	-0,033	-3,860	-0,772	-0,9992
90%*P_{SMAX} ± 5%*S_n	-4,489	-0,898	-0,173	-0,035	-4,344	-0,869	-0,9993
100%*P_{SMAX} ± 5%*S_n	-4,990	-0,998	-0,184	-0,037	-4,827	-0,965	-0,9993


Note:
The inverter produceses reactive power according to the circular chratcteristic. The priority is always given by the reactive power.
The tests had been performed on the AZZURRO 3PH HYD20000 ZSS and AZZURRO 3PH HYD5000 ZSS is valid for the AZZURRO 3PH HYD15000 ZSS, AZZURRO 3PH HYD10000 ZSS, AZZURRO 3PH HYD8000 ZSS and AZZURRO 3PH HYD6000 ZSS since it is similar in hardware and just power derated by software.

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.

Graph of capability curves valid for inverter : , AZZURRO 3PH HYD20000 ZSS

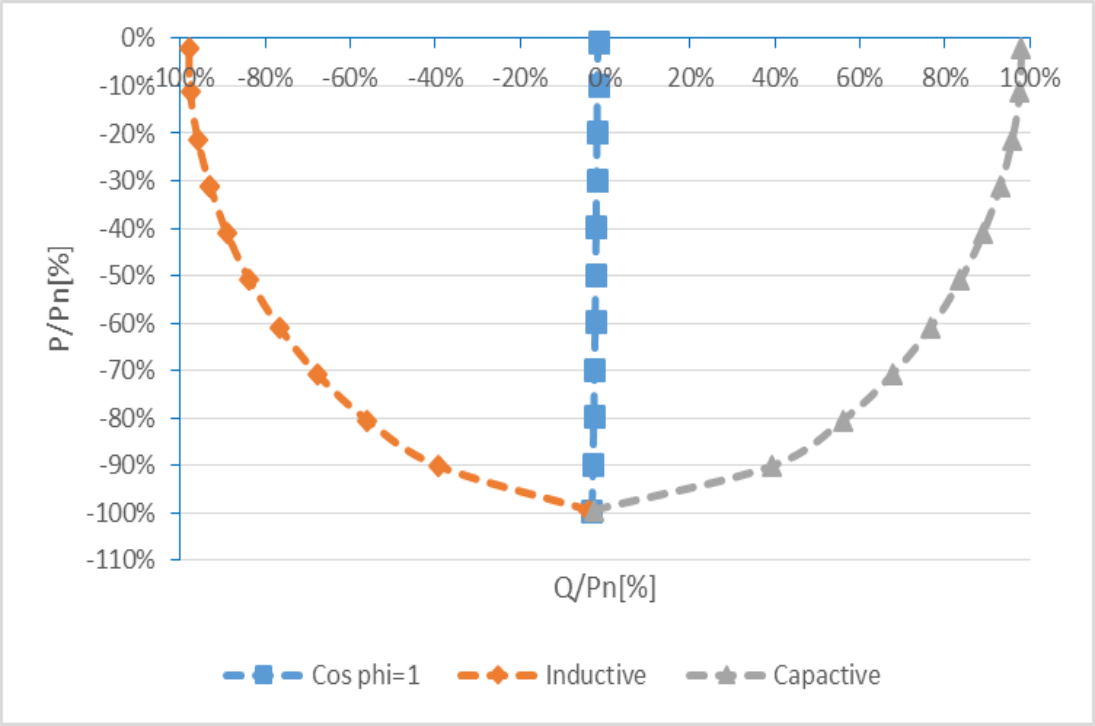

Graph of capability curves valid for inverter : , AZZURRO 3PH HYD5000 ZSS

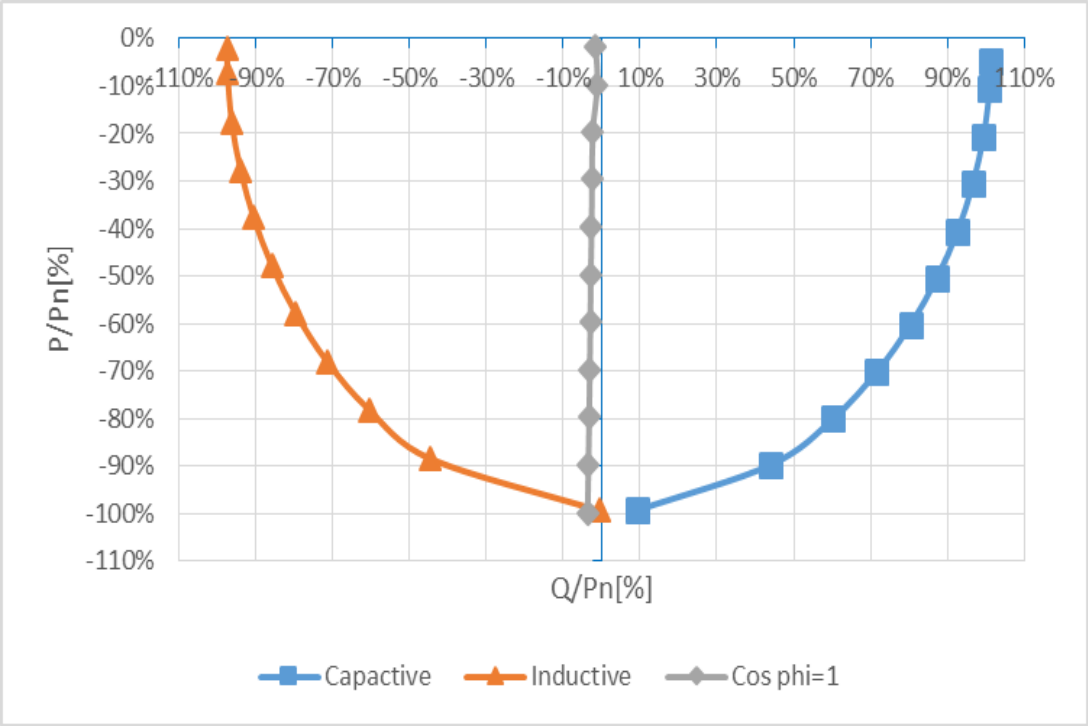

Copyright © Bureau Veritas Consumer Products Services Germany GmbH
This report must not be reproduced in part or in full without the written approval of the issuing testing laboratory.